

AD 613550

Technical Report

R 367

GRAVITY VENTILATION OF
UNDERGROUND SHELTERS

March 1965

20-P

2	OF	3	126
			\$ 1.00
			\$ 0.50



U. S. NAVAL CIVIL ENGINEERING LABORATORY
Port Hueneme, California

DDC

APR 14 1965

DDC-IRA E

ARCHIVE COPY

AD 613550

GRAVITY VENTILATION OF UNDERGROUND SHELTERS

Y-F011-05-02-340

Type C Final Report

by

J. C. King

ABSTRACT

Tests were conducted to determine the suitability of using gravity ventilation as an emergency method of providing air for survival in an underground shelter. The tests consisted of inducing through a simulated test shelter an airflow caused by (a) inside-outside temperature differentials, and (b) stack heaters in the exhaust duct. An additional test was made which involved a device to direct wind into the intake duct. It was found that wind blowing over the inlet and exhaust ducts created a negative pressure in the shelter that could not be satisfactorily overcome by the gravity methods used; thus, minimum ventilation rates could be obtained only when there was no wind blowing.

In the tests conducted to utilize the wind, an NCEL-designed air inducer which mounts on the inlet duct provided satisfactory ventilation during normal weather conditions when there was a wind of 6 to 8 mph.

Qualified requesters may obtain copies of this report from DDC
Release to the Clearinghouse is authorized.
The Laboratory invites comment on this report, particularly on the
results obtained by those who have applied the information

INTRODUCTION

A critical problem in assuring the survival of inhabitants of underground shelters is providing an adequate ventilation system. The usual criteria on shelter ventilation systems require power-operated blowers. However, there is a requirement for minimum ventilation that could supply sufficient air when mechanical systems fail.

NCEL was assigned the task of investigating an emergency ventilation system that would utilize the effect of gravity on the density differential between shelter air and outside air to induce natural convection air currents to flow. Included in the investigation were means of augmenting the natural density difference by (a) an exhaust-stack heater and (b) utilizing wind forces. The task objectives were pursued by determining the airflow in an above-ground test shelter with various density differences and methods of wind utilization. This report includes results of these tests, which indicate that gravity ventilation alone does not provide satisfactory shelter ventilation. However, wind power can provide satisfactory ventilation during average wind conditions.

GRAVITY VENTILATION TESTS

Procedures. There is a motive head, or draft, produced by the difference in weight between a column of heated air and a similar column of unheated air. In an underground shelter, the air is heated by rejection of body heat from the occupants. The column of heated (and less dense) air will rise, thus creating convective air currents. The draft available is expressed by the formula,

$$h_a = H_T (\rho_o - \rho_i) \quad (1)$$

where h_a = available draft head (feet of air)

H_T = vertical distance of the heated column of air (feet)

ρ_o = density of outside air (lb/ft³)

ρ_i = density of inside air (lb/ft³)

To determine the amount of ventilation that would occur from various combinations of inside-outside temperature differentials (Δt) and vertical heights of a heated column of air, a test setup was constructed which consisted of a shelter with inlet and exhaust ducts and with electrical heaters to control the shelter air temperature. A schematic of the test setup is shown in Figure 1.

The shelter, which had a cross section of 8 x 8 feet and a length of 12 feet, was erected on the inside of a 22 x 50-foot Quonset building at NCEL. The shelter was constructed of 3/4-inch-thick plywood, all of the joints were sealed airtight, and the outside was covered with 1-inch-thick fiberglass insulation.

Inlet and exhaust ducts made of galvanized sheet metal were connected into the shelter. Each duct extended through a hole in the roof of the Quonset building to the outside air. The height of the inlet duct was fixed at 13 feet, and the center-line of the opening into the shelter was 1 foot above the shelter floor. The exhaust stack was connected to the top of the shelter, and lengths of 8, 12, and 16 feet were used. These lengths provided effective stack heights of 15, 19, and 23 feet, counting 7 feet inside the shelter. Two intake-and-exhaust duct systems were used; one was 8 inches in diameter, and the other was 12 inches in diameter. An enclosure which could hold a 2-inch-thick, 18-inch-square dust filter was installed on the inlet side. Tests were normally conducted without the filter; however, a limited number of tests were made with it.

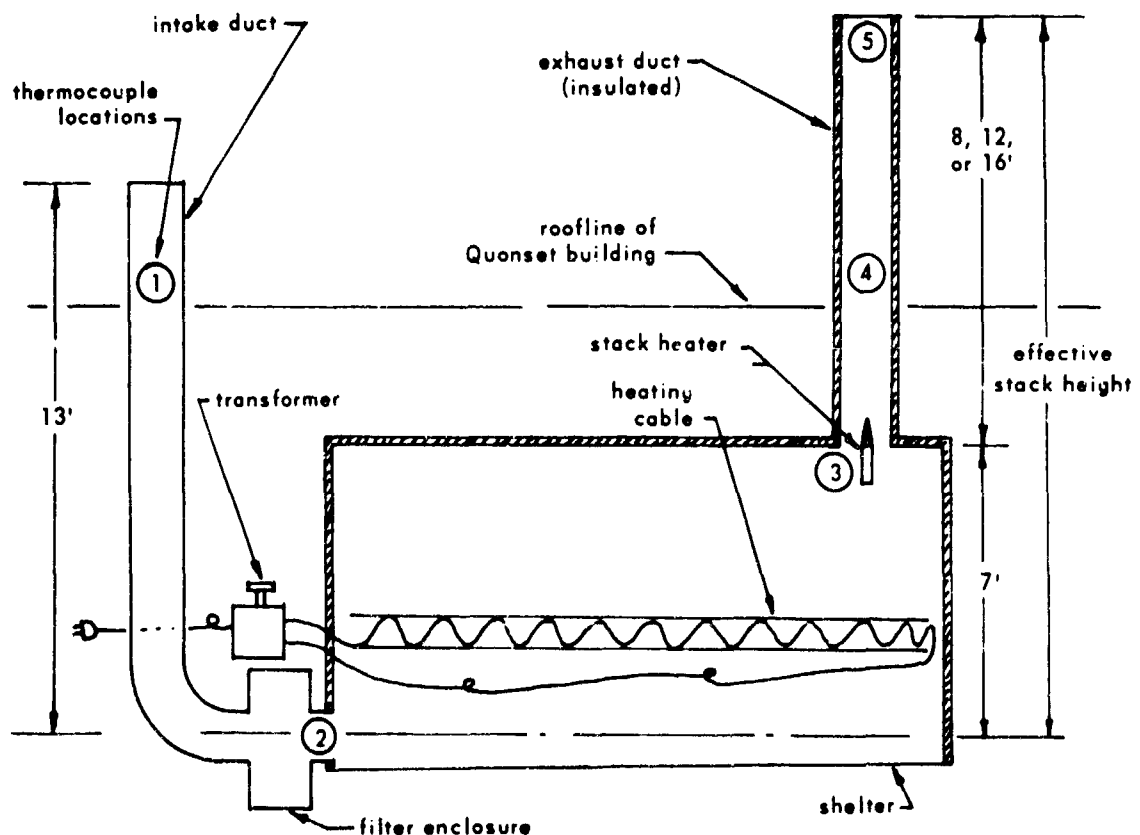


Figure 1. Test setup for investigating ventilation of underground shelters (not to scale).

Thermocouples were installed to measure inside and outside air temperatures. The outside temperature was indicated by thermocouples 1 and 2 (see Figure 1). The inside temperature was indicated by thermocouples 3, 4, and 5. The Δt is the difference in average readings between the outside temperature and the inside temperature. For the tests, Δt 's of 10°F and 20°F were used with each of the three exhaust-stack heights. The shelter air was heated by 960 feet of electric heating cable that was spaced to distribute the heat evenly. A transformer connected in series with the cable permitted control of the cable heat output. An inside view of the shelter is given in Figure 2, and an exterior view of the intake side is shown in Figure 3.

Velocity of the air drawn into the shelter was measured by a hot-wire anemometer, the probe of which was in the inlet duct. Airflow patterns were observed by injecting colored chalk dust into the duct. Outside wind velocities were measured by a 3-cup totalizing anemometer that was mounted on the roof of the Quonset building.

Results. The first tests were conducted during normal weather conditions when the average wind velocity at the test site varied from 5 to 8 mph. Under these conditions, air in the ducts was in a state of turbulence, and any net airflow that might have passed through the shelter could not be detected. The anemometer could not be used in such turbulent air, and dust particles injected into the vertical section of the inlet duct traveled up as well as down. This situation existed even when the largest draft-producing condition of a 20°F Δt and a 16-foot exhaust duct was used.

A number of experiments were conducted in which the inlet duct was protected from the wind so that the opening was in still air. Under these conditions, smooth flow was obtained.

Because of the wind problem, it was necessary to conduct tests during dead calm weather. Results of these tests are in Table I. The data shows that the largest ventilation rate (160 cfm) was obtained with a Δt of 20°F and the 12-inch-diameter duct system with the 16-foot exhaust stack. Conversely, the lowest flow (61 cfm) was obtained with a Δt of 10°F and the 8-inch-diameter duct system with a 8-foot exhaust stack.

During conditions when the stack height and Δt of each duct system were the same, the ventilation rate with 12-inch-diameter ducts was usually about twice the rate with 8-inch-diameter ducts, although the velocity was always higher in the 8-inch ducts. This indicates that a considerable portion of the available draft in the 8-inch ducts is expended in imparting kinetic energy to the ventilation air. The data also show that the ventilation rate obtained with 20°F Δt was only slightly greater than the rate with a 10°F Δt . Several tests with the filter installed showed that the filter would reduce the velocity by about 10%.

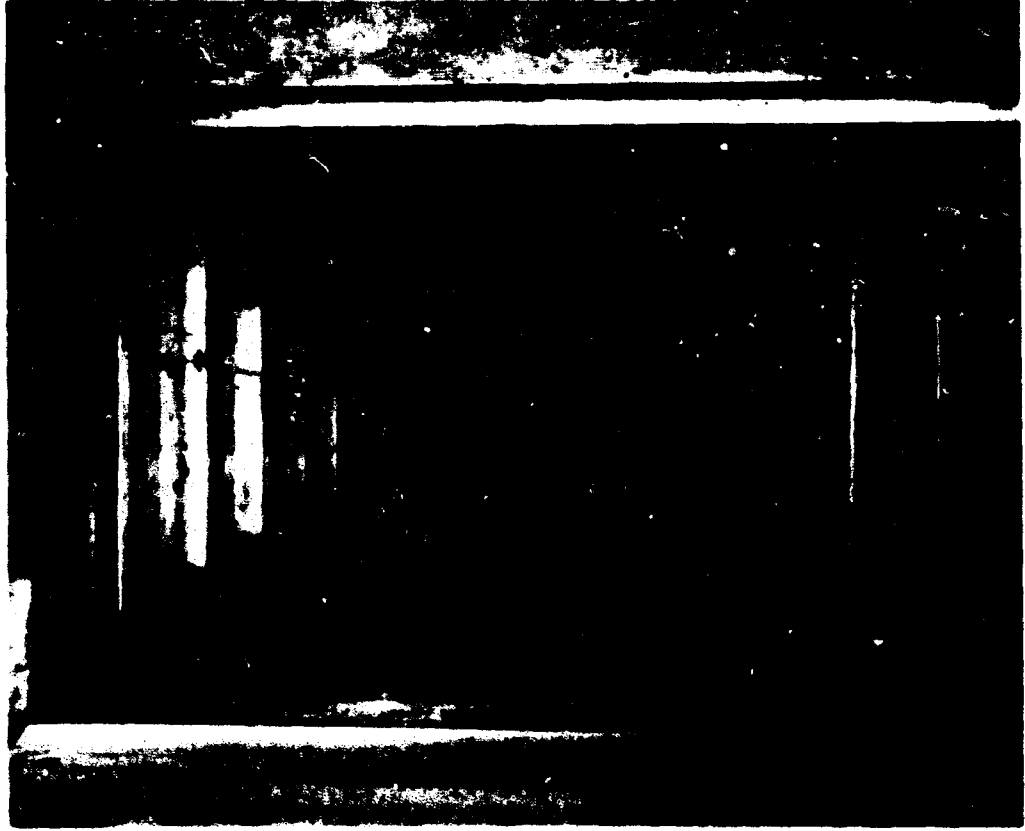


Figure 2. Interior of test shelter. Heating cables can be seen, as well as intake-duct opening.

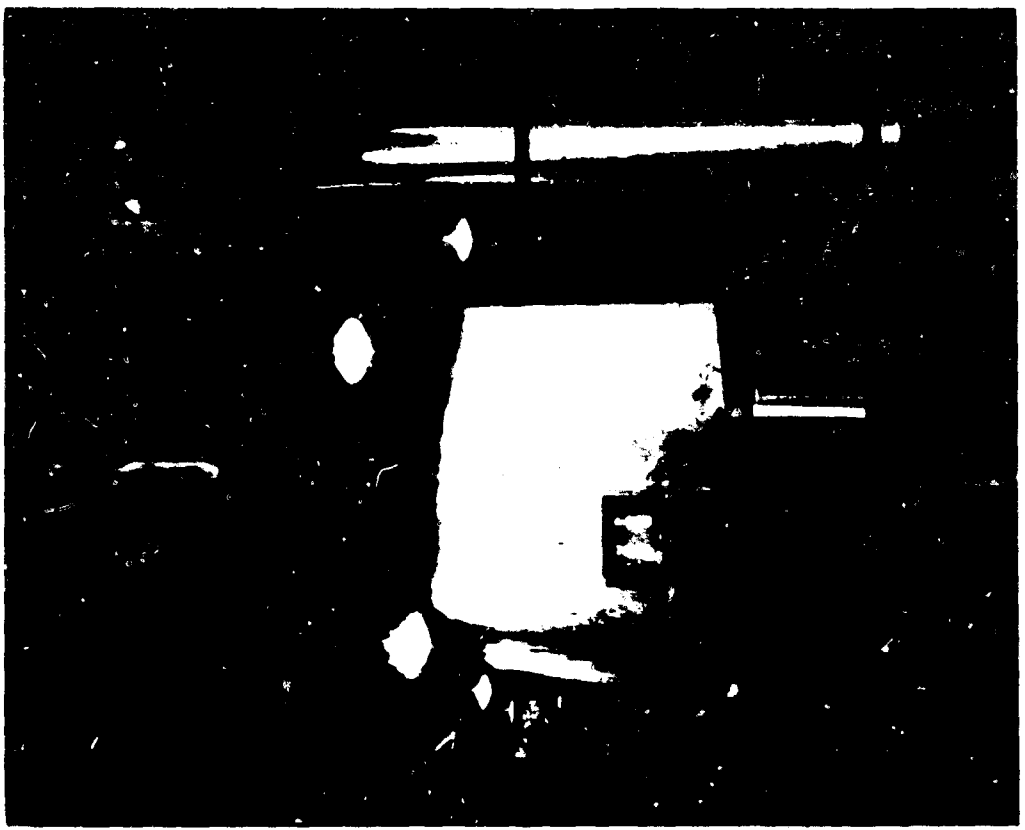


Figure 3. Test shelter and inlet duct in the Quonset building.

Table I. Air Velocities and Calculated Ventilation Rates
From Gravity Ventilation Tests

Exhaust Stack Height ^{1/} (ft)	8-Inch Ducts						12-Inch Ducts			
	10°F Δt			20°F Δt			10°F Δt		20°F Δt	
	V	Q	V _F	V	Q	V _F	V	Q	V	Q
8	120	42	—	175	61	150	79	101	87	111
12	170	60	155	200	70	—	96	122	105	134
16	190	66	—	220	77	190	122	155	125	160

^{1/} For effective stack height, add 7 feet.

Notation: V = Air velocity (fpm) without a filter

V_F = Air velocity (fpm) with a 2-inch thick, 18-inch-square dust filter

Q = Calculated ventilation rate (cfm)

VENTILATION TESTS WITH STACK HEATERS

Purpose. Figure 4, which is taken from the ASHRAE Guide,* shows that there is a decrease in sensible heat rejection as the ambient air temperature increases. Thus, temperature differences caused by heat rejection of shelter occupants are unreliable sources of energy. This problem is compounded by the fact that increased ventilation is needed at the higher temperatures to keep the effective temperature at a habitable level. Seasonal as well as daily weather conditions also influence the temperature differences. For example, in the case of underground shelters, on a warm day in the spring or early summer, cold ground temperatures and warm outside-air temperatures could result in little or no temperature differences. To assist in the flow of air during unfavorable conditions, an exhaust stack heater could be utilized to induce ventilation. Under these conditions, total draft is expressed by the equation,

$$h_a = H_1(\rho_o - \rho_i) + H_2(\rho_o - \rho_s) \quad (2)$$

where h_a = available draft head (feet of air)

H_1 = vertical distance from centerline of inlet duct to top of shelter (feet)

H_2 = vertical distance from top of shelter to top of exhaust stack (feet)

ρ_s = density of exhaust-stack air (lb/ft³)

Procedure. The effectiveness of using a stack heater for ventilation was investigated by utilizing the shelter, duct system, electric heating cable, and instrumentation of the gravity ventilation tests previously described. The stack heater was placed at the lower end of the exhaust duct as shown in Figure 1. It consisted of propane torch tips in which outputs of 4,800, 9,600, and 54,000 Btu per hour could be obtained. Fuel was supplied by a 25-gallon propane tank located outside the Quonset building.

Airflow measurements were made using each heat output with each of the three exhaust-stack heights. Tests were conducted with Δt 's of 0, 10, and 20°F, using first the 8-inch diameter and then the 12-inch-diameter duct system.

*ASHRAE Guide and Data Book, 1961: Fundamentals and Equipment. American Society of Heating, Refrigerating, and Air Conditioning Engineers, Inc. New York, N. Y.

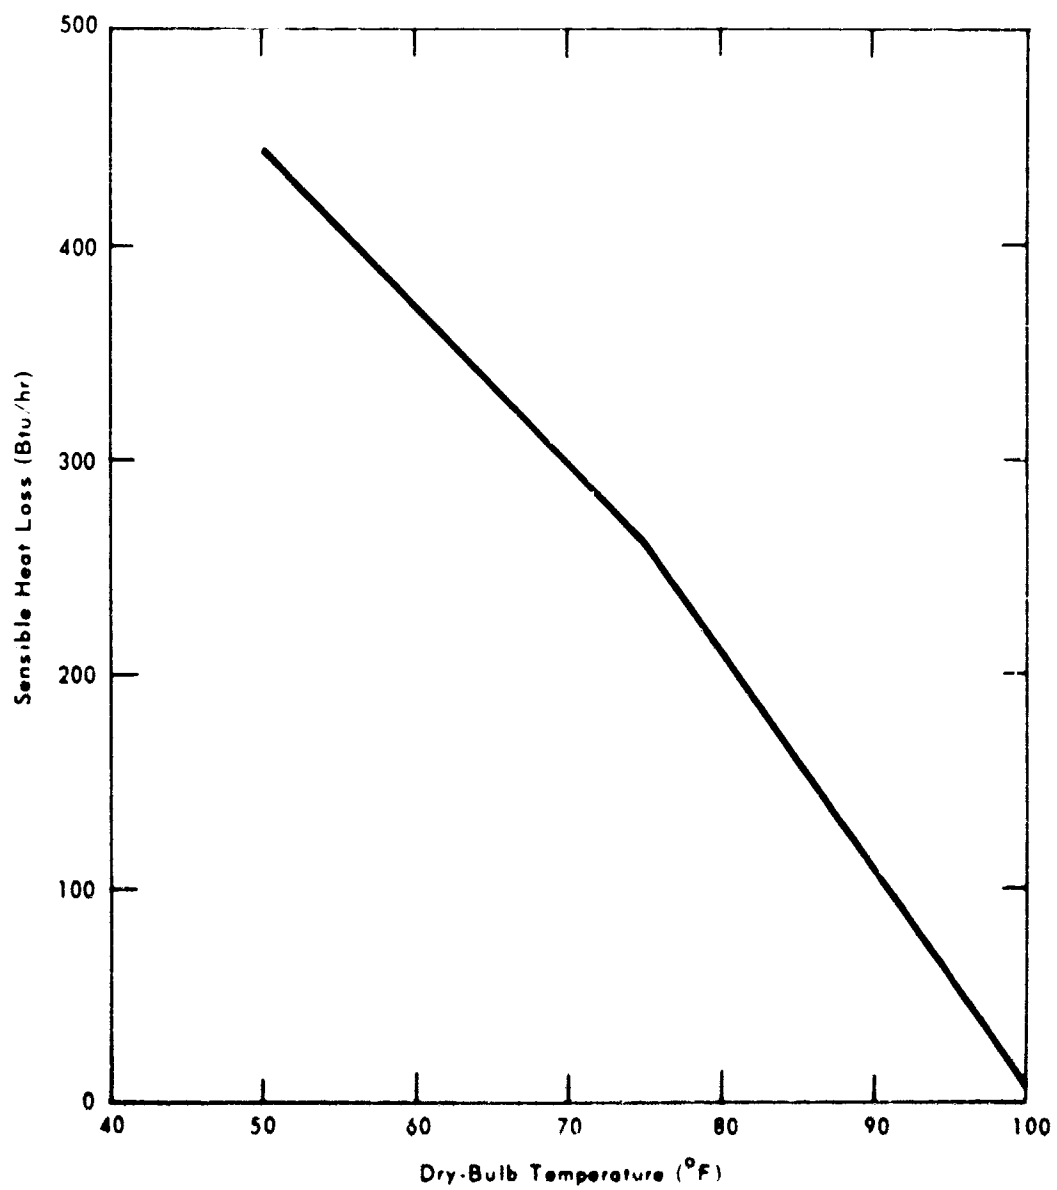


Figure 4. Sensible heat loss by radiation and convection versus dry-bulb temperature for average man at rest.

Results. Tests which were conducted during normal weather conditions again showed that the drafts produced by gravity ventilation, even with stack heaters, could not satisfactorily overcome the opposing negative pressure created in the inlet duct by the wind. When the 54,000 Btu per hour burner was used, some net gain could be detected by observing dust particles, but turbulence was still too great to permit accurate measurements. Figure 5 is a recording of air velocities when using the 12-foot exhaust stack of the 12-inch-diameter duct system at a Δt of 0°F . The left side of the figure shows the airflow when both ducts were exposed to an 8-mph wind. The right side of the figure shows how the flow became reasonably smooth when the inlet-duct opening was protected from the wind.

A series of tests was then conducted in dead calm weather using all combinations of stack heights and stack heater sizes with shelter Δt 's of 0, 10, and 20°F . The results are in Table II.

The data show that the largest ventilation rate obtained was 311 cfm. This occurred with the 12-inch-diameter duct system used in combination with the largest draft conditions consisting of the 54,000 Btu per hour stack heater, a 20°F Δt , and the 16-foot exhaust stack. The smallest rate of 53 cfm occurred in the 8-inch-diameter duct system with the lowest draft produced by the 4,800 Btu per hour heater with the 8-foot exhaust stack.

The pattern of results is similar to those in Table I in that the ventilation rate with 12-inch-diameter ducts was usually about twice the rate obtained with 8-inch-diameter ducts, although the flow velocity in the latter was considerably greater.

It is again shown that only small increases in cfm were obtained when the Δt was increased from 10°F to 20°F . It may also be noted that significant gains in ventilation were not obtained when combined heads of a Δt and a stack heater were used. As an illustration, the 9,600 Btu per hour burner with 0°F Δt caused 153 cfm to flow in the 12-inch-diameter ducts with the 16-foot exhaust stack. Similar conditions without the burner, but with 10°F Δt , resulted in 155 cfm. With both the 10°F Δt and the 9,600 Btu per hour burner, the ventilation was increased only to 189 cfm.

Comparison of data for the various stack heaters shows that the small heaters were utilized more efficiently than the large one. The filter test data are similar to the data of Table I, in that the filter reduced the flow velocity by about 10%.

WIND POWER VENTILATION TESTS

Purpose. The Los Angeles Weather Bureau records show that the city has calm weather, i.e., wind velocity of 0 to 1 mph, less than 1% of the time, and that calm periods usually last 1/2 hour or less and occasionally for an hour. The ASHRAE Guide gives the average wind velocities of 200 cities in the United States. These wind velocities average 9.5 mph, with only 4 cities having average velocities less

than 5 mph. The percentage of time that these velocities occurred is not given, but it appears that all cities listed have enough wind to reduce the flow of air induced through a shelter by gravity ventilation. Therefore, experiments were directed toward utilizing the wind for ventilation.

An equation for calculating the quantity of air forced through ventilation openings by the wind is given in the ASHRAE Guide as

$$Q = EAV \quad (3)$$

where Q = airflow (cfm)

A = free area of inlet opening (ft²)

V = wind velocity (fpm)

E = effectiveness of opening (0.60 for perpendicular winds)

If a 5-mph wind, which is one of the lower recorded average velocities in the ASHRAE Guide, were directed into the 12-inch-diameter duct of the test shelter, calculations indicate a ventilation rate of 207 cfm. This rate might be increased by the drafts produced by temperature difference and by the negative pressure on the exhaust duct. Considering the fact that most places have average wind velocities higher than 5 mph, utilization of wind appeared to be a promising method of providing emergency ventilation.

Procedure. The test shelter with the 12-inch-diameter duct system and the 12-foot exhaust stack was used to investigate various methods of using wind power for ventilation. The methods were tested by observing dust patterns and by taking recordings of wind velocities at the same time that recordings were taken of air velocities in the inlet duct.

Methods and Results. The first method investigated was a 90-degree elbow mounted on the inlet duct with the opening directed into the wind. A smooth air-flow in the duct was obtained; however, large decreases in flow would occur with a small change of wind direction. An attempt was made to increase the flow by mounting another elbow on the exhaust duct with the opening directed away from the wind; however, no increase could be detected.

Another method utilized a Breidert exhaustor on the exhaust duct, and nothing on the intake duct. This method was unsatisfactory because the exhaustor could not satisfactorily operate against the negative pressure in the shelter created by wind at the intake duct.

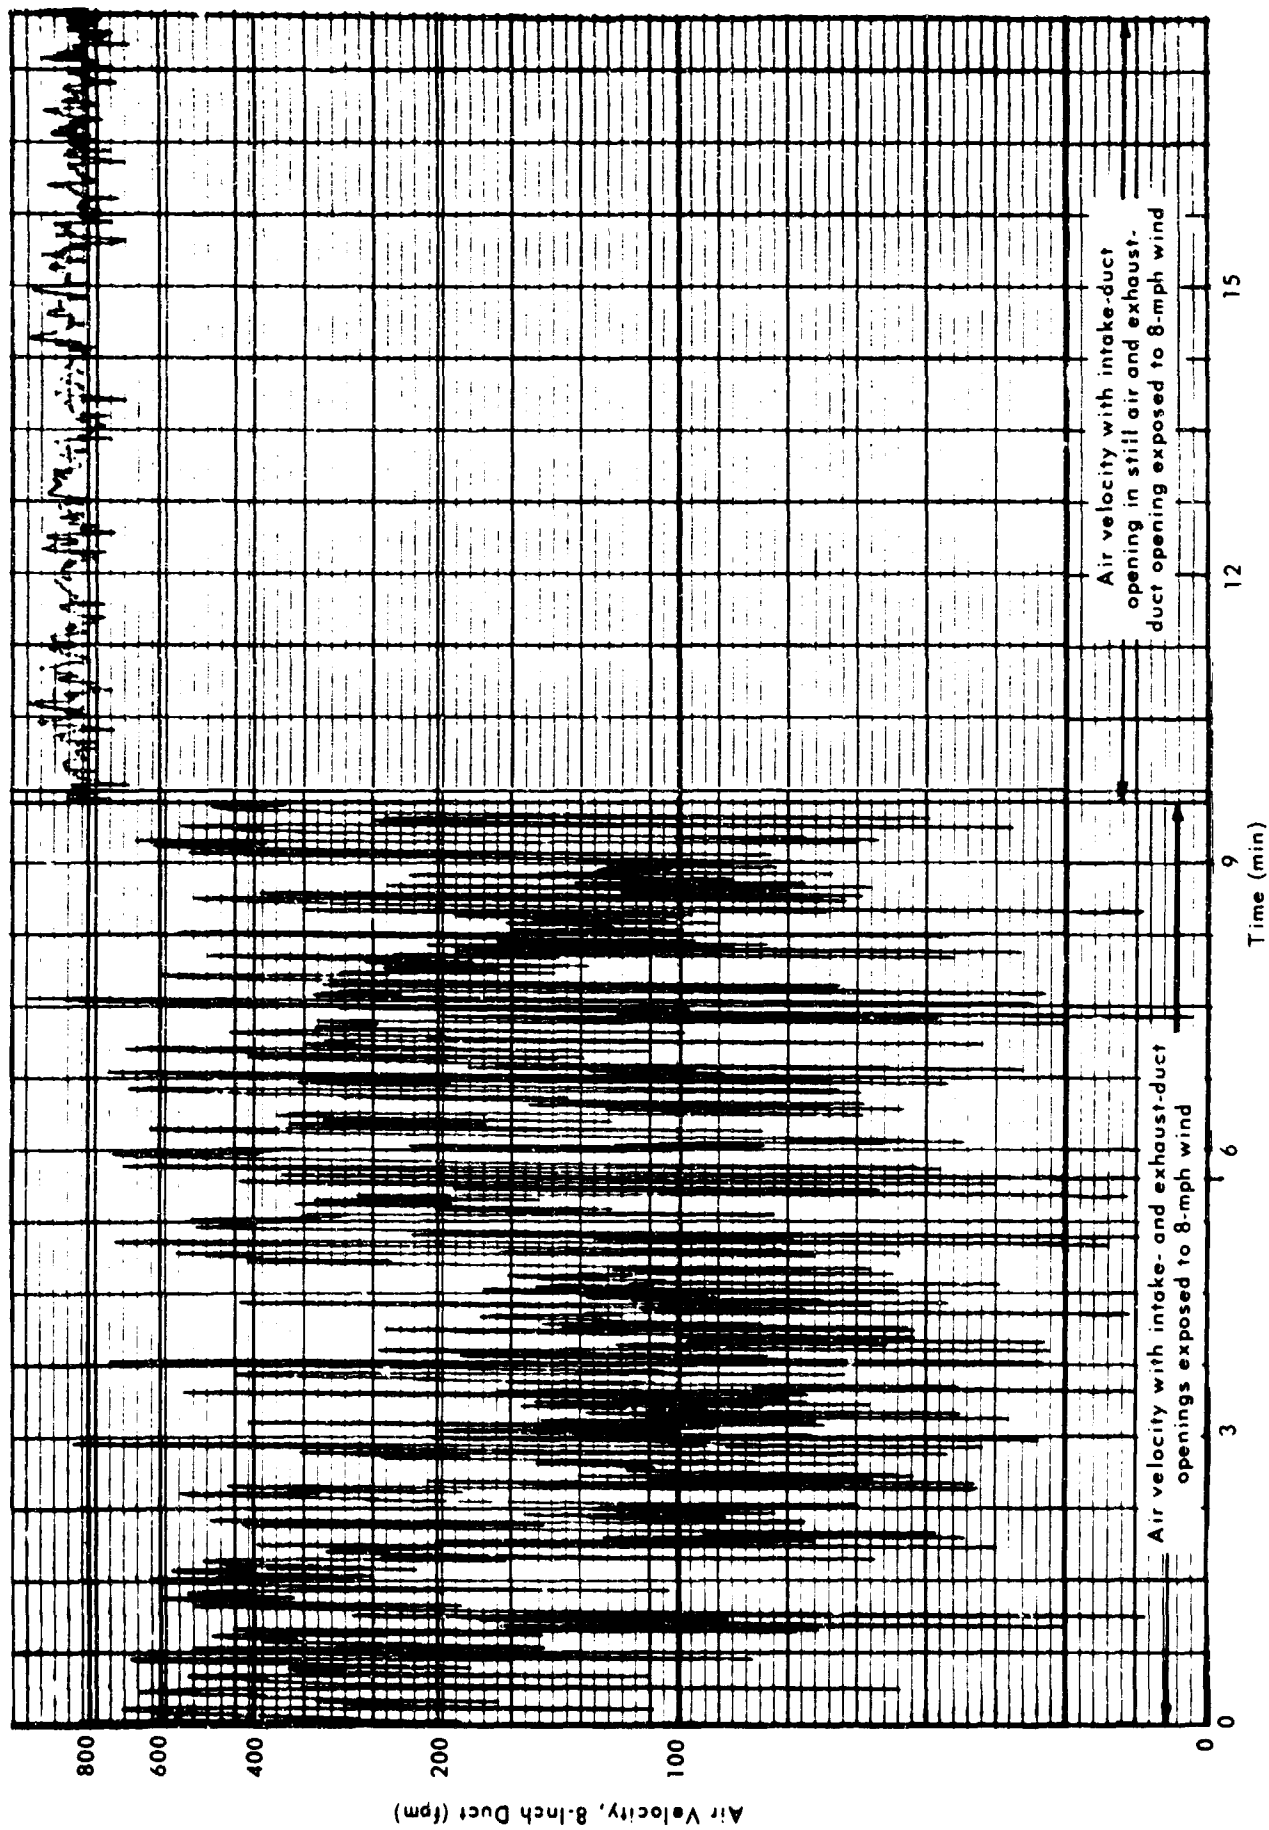


Figure 5. Air-velocity recordings taken during tests of the gravity ventilation system. Recordings were made with a 54,000 Btu per hour burner in a 12-foot exhaust stack and a Δt of 20°F.

Table II. Air Velocities and Calculated Ventilation Rates From Gravity Ventilation Tests With Stack Heaters

Burner Size (Btu/hour)	Exhaust Stack Height ¹ / (ft)	8-Inch Ducts						12-Inch Ducts					
		0°F Δt			10°F Δt			20°F Δt			0°F Δt		
		V	Q	V _F	V	Q	V _F	V	Q	V _F	V	Q	V
4,800	8	150	53	—	200	70	—	240	84	220	61	78	113
	12	180	63	—	220	77	200	290	101	—	87	111	140
	16	185	65	175	275	96	—	325	113	—	105	134	148
9,600	8	175	61	—	210	73	—	225	79	220	70	89	122
	12	190	66	—	220	77	210	300	105	—	87	110	140
	16	220	77	205	325	113	—	375	131	—	120	153	148
54,000	8	220	77	—	350	122	—	400	140	370	140	178	157
	12	260	90	—	420	147	390	500	175	—	175	222	210
	16	310	108	290	475	166	—	550	192	—	210	268	236

¹/ For effective stack height, add 7 feet.

Notation: V = Air velocity (fpm) without a filter

V_F = Air velocity (fpm) with a 2-inch thick, 18-inch square dust filter

Q = Calculated ventilation rate (cfm)

The next method utilized an NCEL air inducer on the intake duct. The inducer, which is described in the Appendix, will direct wind from any direction into the intake duct. A smooth airflow was obtained, and 5-minute recordings of wind velocity versus airflow were taken. Results were averaged and are displayed in Table III. Since results were encouraging, additional tests were conducted in which the inducer was used with the 8-inch-diameter duct system. Results are also in Table III. The 249 cfm obtained with the 12-inch duct system was about twice the rate obtained with the 8-inch ducts, although the air velocity in the 8-inch-diameter system was greater.

Table III. Average Air Velocity and Calculated Ventilation Rate
With Air Inducer on Inlet Duct

(wind velocity from 5 to 8 mph)

Duct Diameter (in.)	Air Velocity (fpm)	Ventilation Rate (cfm)
8	350	122
12	317	249

The filter was put into the system during tests with the 8-inch system, but no decrease in flow could be detected. Also, a Δt of 20°F was applied, but no increase in flow could be detected. If the tests had been conducted in a wind tunnel with constant wind velocities, some increase probably could have been noted when the shelter was heated, and some decrease probably would have occurred when the filter was installed; however, the changes were too minor to be detected by the measuring methods used.

SUMMARY OF RESULTS

1. Ventilation by gravity flow provides a minimum ventilation rate only when there is an inside-outside temperature differential of about 10°F or more and when there is no wind blowing.
2. Ventilation with stack heaters provides a minimum ventilation rate when there is no inside-outside temperature differential and no wind blowing.
3. An air inducer mounted on the intake duct results in a sizeable improvement in ventilation rates over gravity flow both with and without stack heaters.

CONCLUSIONS

1. Ventilation by gravity flow is not suited for underground shelters because (a) there are many occasions when there will be no temperature difference to induce a flow of air; (b) there are many occasions when hot weather will require large amounts of air to maintain a habitable shelter environment; and (c) it will not operate against a negative pressure caused by wind at the inlet duct.
2. Gravity ventilation utilizing stack heaters is not suitable for underground shelters because (a) there are many occasions when hot weather will require large amounts of air to maintain a habitable shelter environment; and (b) it will not operate against a negative pressure caused by wind at the inlet duct.
3. Ventilation by use of the air inducer is suitable for underground shelters, because wind is nearly always blowing.

RECOMMENDATIONS

1. Wind power ventilation methods should be considered for use with underground shelters.
2. The NCEL inducer should be further developed to effectively utilize wind power.

ACKNOWLEDGMENT

Mr. Earl J. Beck of NCEL initiated the concept of using gravity ventilation for protective shelters, and he offered advice concerning the theory of gravity airflow.

Appendix

DESCRIPTION OF NCEL AIR INDUCER

The NCEL air inducer is designed to take advantage of winds to provide shelter ventilation. It functions by diverting wind from any direction into the shelter. Simultaneously, wind that blows over the outside opening of the exhaust duct creates a low-pressure area which draws air out of the shelter. A diagram showing use of wind in this manner is in Figure 6.

Figure 7 is a drawing of the air inducer, and Figure 8 is a photograph. With reference to Figure 7, the top of the inducer is 24 inches in diameter, the transition section (1) tapers at a 30-degree angle, and the bottom opening fits a 12-inch-diameter duct. The device has 5 vanes (2) that join at equal angles in the center and extend to the outer edge of the device. The inside upper edge is cut in the shape of a quarter circle, and a curved deflector (3) is welded to this edge. Wind that strikes the device from any direction will be diverted into the device by either 2 or 3 of the vanes, and the curved deflector will simultaneously divert the wind downward and into a shelter. The vanes are extended into the throat of the device to prevent the air stream from turning below the vanes and being exhausted on the leeward side.

The inducer was constructed of sheet metal; thus, it is suitable only for a fallout shelter. It could, however, be constructed of heavy gage steel which would make it suitable for blast-resistant shelters.

The air inducer was designed primarily for shelter use; however, it could be used to ventilate any type of enclosed space that does not have openings to permit the entrance of fresh air.

The ratio of inducer diameter to intake-duct diameter, which is 2:1 for the one in the test, could range from 1:1 to ratios larger than 2:1. Larger ratios might be needed in locations of low average wind velocities, and smaller ratios could be used in areas of high average wind velocities.

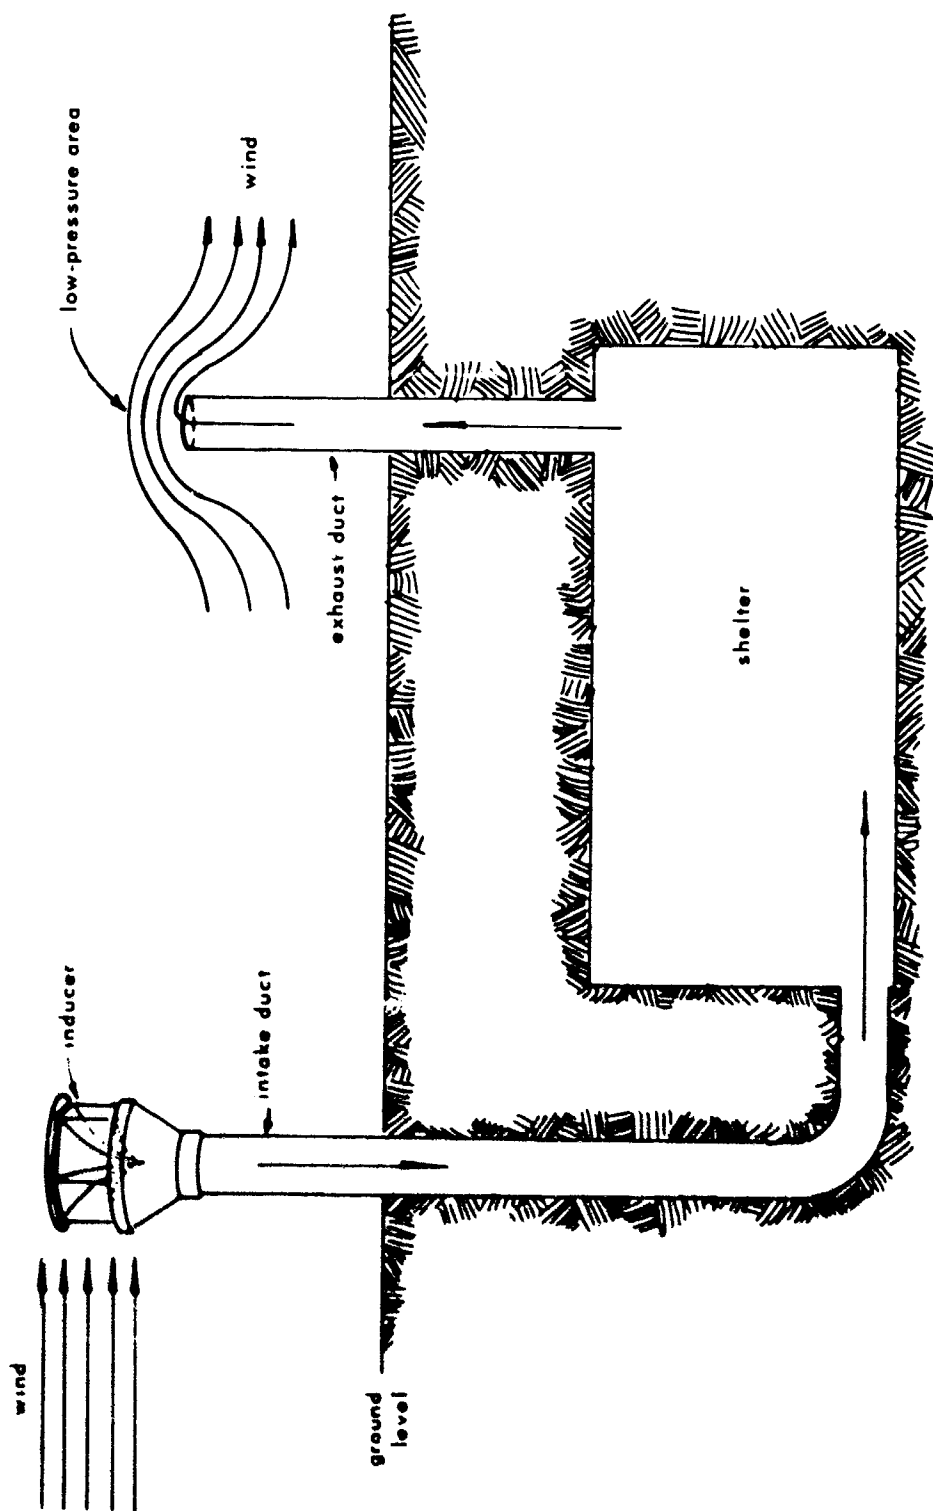


Figure 6. The use of wind for shelter ventilation.

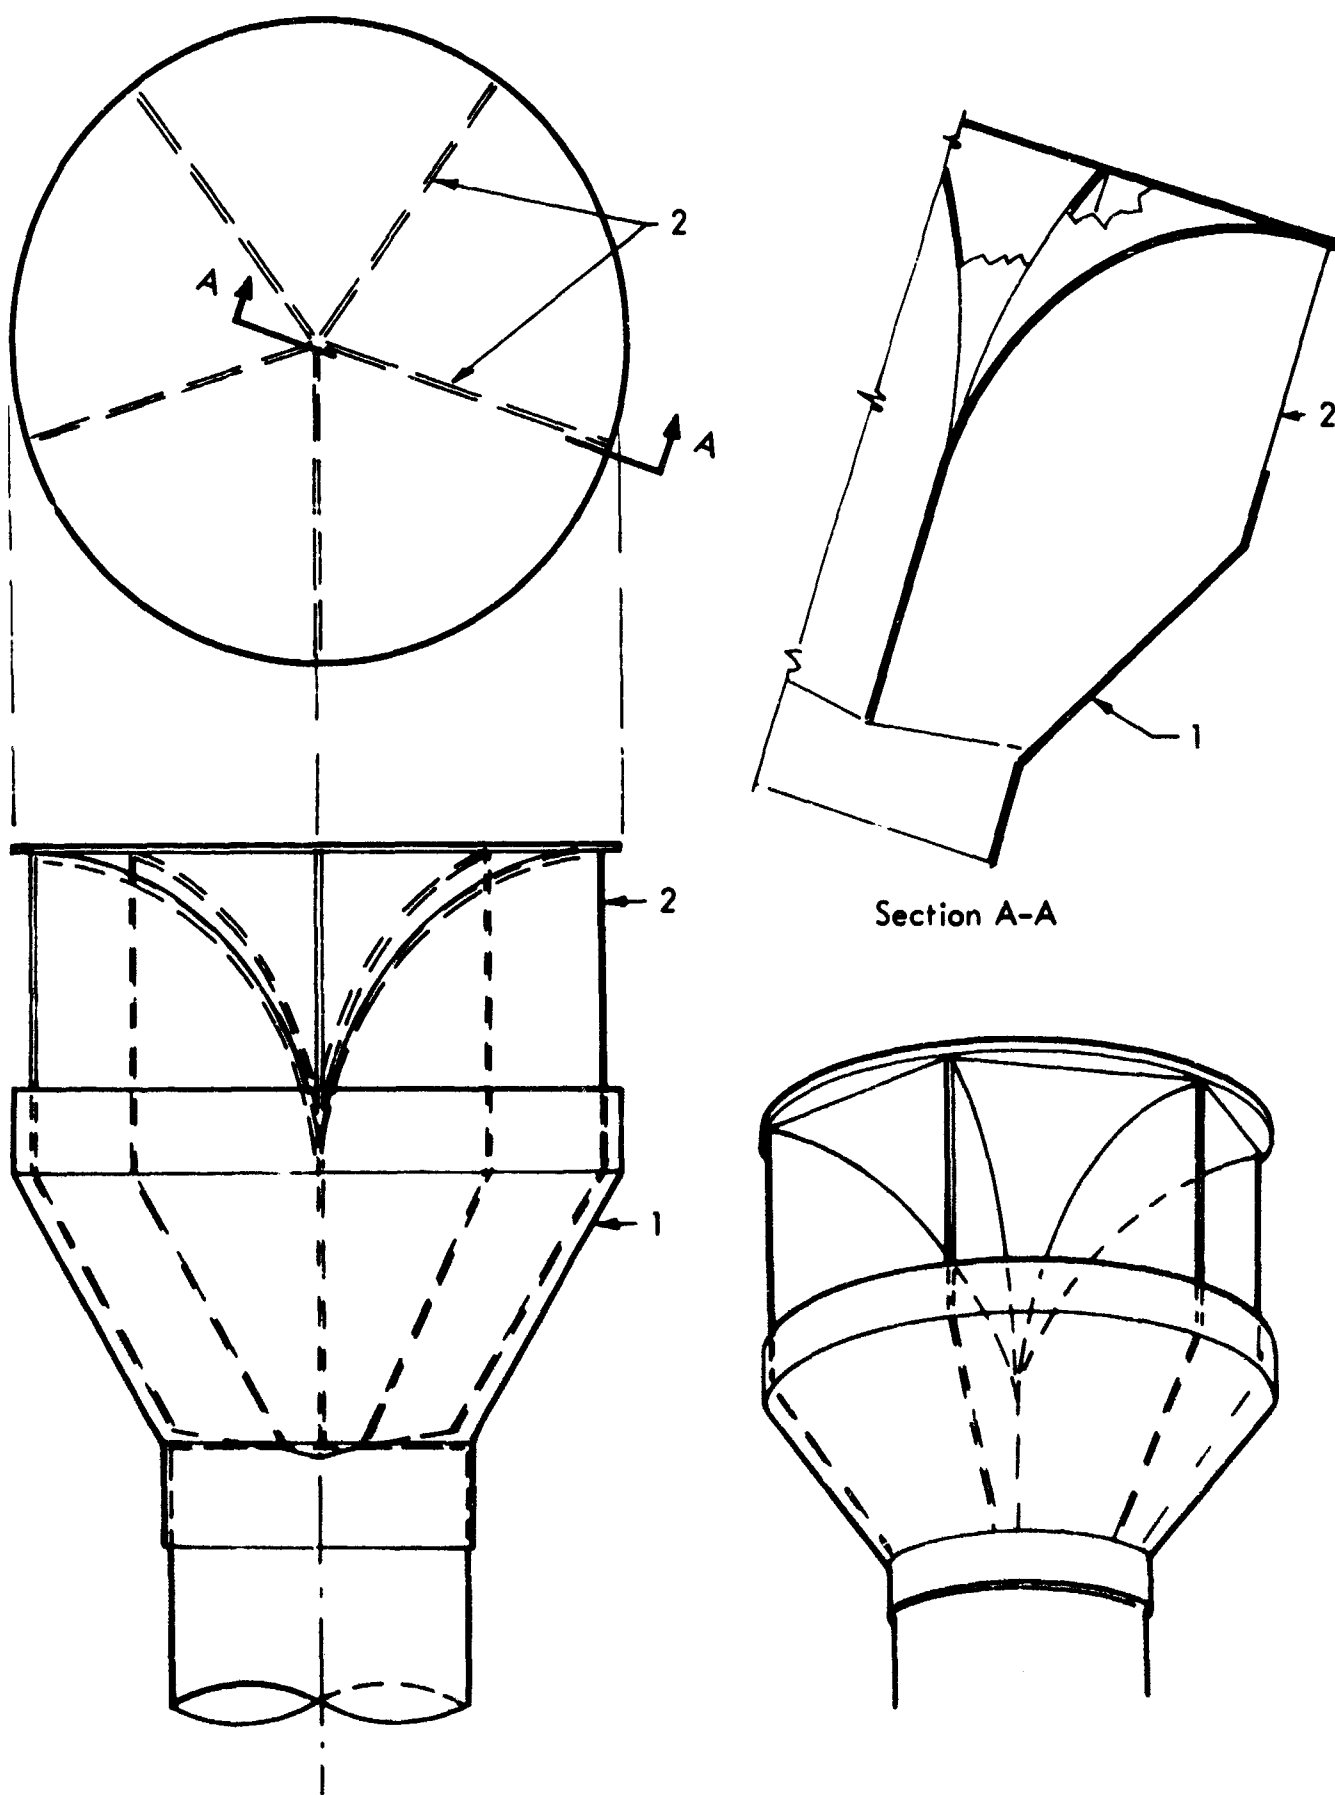


Figure 7. Details of air inducer.



Figure 8. NCEL-designed air inducer.

DISTRIBUTION LIST

SNDL Code	No. of Activities	Total Copies	
	1	10	Chief, Bureau of Yards and Docks (Code 42)
23A	1	1	Naval Forces Commanders (Taiwan only)
39B	2	2	Construction Battalions
39D	5	5	Mobile Construction Battalions
39E	3	3	Amphibious Construction Battalions
39F	1	2	Construction Battalion Base Units
A2A	1	1	Chief of Naval Research - Only
A3	2	2	Chief of Naval Operation (OP-07, OP-04)
A5	5	5	Bureaus
B3	2	2	Colleges
E4	1	2	Laboratory ONR (Washington, D. C. only)
E5	1	1	Research Office ONR (Pasadena only)
E16	1	1	Training Device Center
F9	7	7	Station - CNO (Boston; Key West; San Juan; Long Beach; San Diego; Treasure Island; and Rodman, C. Z. only)
F17	6	6	Communication Station (San Juan; San Francisco; Pearl Harbor; Adak, Alaska; and Guam only).
F41	1	1	Security Station
F42	1	1	Radio Station (Oso and Cheltenham only)
F48	1	1	Security Group Activities (Winter Harbor only)
F61	2	2	Naval Support Activities (London and Naples only)
F77	1	1	Submarine Base (Groton, Conn. only)
F81	2	2	Amphibious Bases
H3	7	7	Hospital (Chelsea; St. Albans, Portsmouth, Va.; Beaufort; Great Lakes; San Diego; and Camp Pendleton only)
H6	1	1	Medical Center
J1	2	2	Administration Command and Unit - BuPers (Great Lakes and San Diego only)
J3	1	1	U. S. Fleet Anti-Air Warfare Training Center (Virginia Beach only)
J19	1	1	Receiving Station (Brooklyn only)
J34	1	1	Station - BuPers (Washington, D. C. only)

DISTRIBUTION LIST (Contd)

SNDL Code	No. of Activities	Total Copies	
J46	1	1	Personnel Center
J48	1	1	Construction Training Unit
J60	1	1	School Academy
J65	1	1	School CEC Officers
J84	1	1	School Postgraduate
J90	1	1	School Supply Corps
J95	1	1	School War College
J99	1	1	Communication Training Center
L1	11	11	Shipyards
L7	4	4	Laboratory - BuShips (New London; Panama City; Carderock; and Annapolis only)
L26	5	5	Naval Facilities - BuShips (Antigua; Turks Island; Barbados; San Salvador; and Eleuthera only)
L42	2	2	Fleet Activities - BuShips
M27	4	4	Supply Center
M28	6	6	Supply Depot (except Guantanamo Bay; Subic Bay; and Yokosuka)
M61	2	2	Aviation Supply Office
N1	6	18	BuDocks Director, Overseas Division
N2	9	27	Public Works Offices
N5	3	9	Construction Battalion Center
N6	5	5	Construction Officer-in-Charge
N7	1	1	Construction Resident-Officer-in-Charge
N9	6	12	Public Works Center
N14	1	1	Housing Activity
R9	2	2	Recruit Depots
R10	2	2	Supply Installations (Albany and Barstow only)
R20	1	1	Marine Corps Schools (Quantico)
R64	3	3	Marine Corps Base
R66	1	1	Marine Corps Camp Detachment (Tongan only)
W1A1	6	6	Air Station

DISTRIBUTION LIST (Contd)

SNDL Code	No. of Activities	Total Copies	
W1A2	35	35	Air Station
W1B	8	8	Air Station Auxiliary
W1C	3	3	Air Facility (Phoenix; Naha; and Naples only)
W1E	6	6	Marine Corps Air Station (except Quantico)
W1H	9	9	Station - BuWeps (except Rota)
	1	1	Deputy Chief of Staff, Research and Development, Headquarters, U. S. Marine Corps, Washington, D. C.
	1	1	President, Marine Corps Equipment Board, Marine Corps School, Quantico, Va.
	1	1	Chief of Staff, U. S. Army, Chief of Research and Development, Department of the Army, Washington, D. C.
	1	1	Office of the Chief of Engineers, Assistant Chief of Engineering for Civil Works, Department of the Army, Washington, D. C.
	1	1	Chief of Engineers, Department of the Army, Washington, D. C., Attn: Engineering Research and Development Division
	1	1	Chief of Engineers, Department of the Army, Washington, D. C., Attn: ENG CW-OE
	1	1	Air Force Weapons Laboratory, Kirtland Air Force Base, Albuquerque, N. M., Attn: Code WLRC
	1	3	Headquarters, U. S. Air Force, Directorate of Civil Engineering, Washington, D. C., Attn: AFOCE-ES
	1	1	Commanding Officer, U. S. Naval Construction Battalion Center, Port Hueneme, Calif., Attn: Materiel Dept., Code 140
	1	1	Deputy Chief of Staff, Development, Director of Research and Development, Department of the Air Force, Washington, D. C.
	1	1	Director, National Bureau of Standards, Department of Commerce, Connecticut Avenue, Washington, D. C.
	1	2	Office of the Director, U. S. Coast and Geodetic Survey, Washington, D. C.
	1	20	Defense Documentation Center, Building 5, Cameron Station, Alexandria, Va.
	1	2	Director of Defense Research and Engineering, Department of Defense, Washington, D. C.
	1	2	Director, Bureau of Reclamation, Washington, D. C.
	1	1	Facilities Officer, Code 108, Office of Naval Research, Washington, D. C.
	1	1	Federal Aviation Agency, Office of Management Services, Administrative Services Division, Washington, D. C., Attn: Library Branch

DISTRIBUTION LIST (Cont'd)

No. of Activities	Total Copies	
1	2	Commander Naval Beach Group Two, U. S. Naval Amphibious Base, Little Creek, Norfolk, Va.
1	1	Commander, Pacific Missile Range, Technical Documentation Section, P. O. Box 10, Point Mugu, Calif., Attn: Code 4332
1	2	U. S. Army Engineer Research and Development Laboratories, Attn: STINFO Branch, Fort Belvoir, Va.
1	1	Director, U. S. Naval Ordnance Laboratory, White Oak, Silver Springs, Md.
1	1	Office of Naval Research, Branch Office, Navy No. 100, Box 39, FPO, New York
1	1	U. S. Naval Radiological Defense Laboratory, San Francisco
1	1	Officer in Charge, CECOS, Port Hueneme, Calif., Attn: ADCE Course
1	1	U. S. Air Force, Asst. Chief of Staff, Intelligence, Building B, AHS, Washington, D. C., Attn: Mr. Sargent White
1	1	Commander, Space Systems Division, Los Angeles Air Force Station, Los Angeles, Calif., Attn: SSSD
1	1	Directorate of Research, Air Force Weapons Laboratory, Kirtland Air Force Base, N. M.
1	1	Chief of Engineers, Department of the Army, Washington, D. C., Attn: ENGTE-E
1	1	Commanding Officer, Engineer Research and Development Laboratories, Fort Belvoir, Va.
1	1	Director, U. S. Army Engineer Waterways Experiment Station, P. O. Box 631, Vicksburg, Miss., Attn: Mr. G. L. Arbuthnot, Jr.
1	1	U. S. Army Nuclear Defense Laboratory, Edgewood Arsenal, Md.
1	1	Director, Ballistic Research Laboratories, Aberdeen, Md.
1	2	Chief Defense Atomic Support Agency, Washington, D. C.
1	1	Headquarters, Field Command, Defense Atomic Support Agency, Sandia Base, Albuquerque, N. M.
1	1	U. S. Atomic Energy Commission, Technical Information Service, P. O. Box 62, Oak Ridge, Tenn.
1	1	Director, Civil Effects Test Group, Atomic Energy Commission, Washington, D. C.
1	1	Formulation and Analysis Branch, Mathematics and Computation Laboratory, National Resource Evaluation Center, Office of Emergency Planning, Washington, D. C.
1	2	Library of Congress, Washington, D. C.
1	2	Officer-in-Charge, U. S. Naval Nuclear Power Unit, U. S. Army Engineer Center, P. O. Box 96, Fort Belvoir, Va.

DISTRIBUTION LIST (Cont'd)

No. of Activities	Total Copies	
1	1	Disaster Recovery Training Officer, Code 450, Construction Battalion Center, Davisville, R. I.
1	1	Commanding Officer, Ballistic Research Laboratories, Attn: AMXBR-TB, Mr. William J. Taylor, Aberdeen Proving Ground, Md.
1	1	LCDR Charles W. Gulick, Jr., CEC, USN, Navy No. 926, FPO, San Francisco
1	1	CDR J. C. LeDoux, Bureau of Yards and Docks, Department of Navy, Washington, D. C.
1	1	CAPT W. M. McLellan, CEC, USN, Ret., 468 1st Street, Albany, N. Y.
1	1	LT Edward S. Perry, U. S. Naval Reserve Officers Training Corps Unit, University of Illinois, Urbana, Ill.
1	1	CAPT L. N. Saunders, CEC, USN, Code C10, U. S. Naval Construction Battalion Center, Port Hueneme, Calif.
1	1	CDR E. M. Saunders, CEC, USN, Chief of Naval Materiel, Department of the Navy, Washington, D. C.
1	1	CDR R. C. Vance, CEC, USN, Logistics Director, U. S. Naval Civil Engineering Laboratory, Port Hueneme, Calif.
1	1	CDR W. A. Walls, CEC, USN, Disaster Control Division, Bureau of Yards and Docks, Washington, D. C.
1	1	LT COL Charles D. Daniel, USA, Defense Atomic Support Agency, Washington, D. C.
1	1	Mr. L. Neal FitzSimons, Office of Civil Defense, Department of Defense, Washington, D. C.
1	1	Mr. Ben Taylor, Office of Civil Defense, Department of Defense, Washington, D. C.
1	1	Mr. Charles M. Eisenhower, Radiation Physics Laboratory, National Bureau of Standards, Washington, D. C.
1	1	Mr. O. H. Hill, Building 12, Room 505, Radiation Physics Division, National Bureau of Standards, Washington, D. C.
1	1	CDR J. D. Andrews, CEC, USN, Executive Officer, U. S. Naval Civil Engineering Laboratory, Port Hueneme, Calif.
1	1	CAPT W. J. Christensen, CEC, USN, Commanding Officer and Director, U. S. Naval Civil Engineering Laboratory, Port Hueneme, Calif.
1	1	CDR J. F. Dobson, CEC, USN, Office of Civil Defense, Department of Army, Washington, D. C.
1	1	LCDR O. L. Dixon, CEC, USN, U. S. Naval School, CEC Officers, Port Hueneme, Calif.
1	1	LCDR N. W. Clements, CEC, USN, Navy Nuclear Power Unit, Fort Belvoir, Va.
1	1	CDR C. Curione, CEC, USN, Resident Officer-In-Charge-Of-Construction, Long Beach Area, P.O. Box XX, Seal Beach, Calif.
1	1	CDR P. A. Phelps, CEC, USN, Science Department, U. S. Navy Academy, Annapolis, Md.

DISTRIBUTION LIST (Cont'd)

No. of Activities	Total Copies	
1	1	LCDR T. Yoshihara, CEC, USN, ROICC, Southeast Asia, APO 143, San Francisco
1	1	LT L. K. Donovan, CEC, USN, U. S. Naval Communication Station, Navy No. 85, FPO, San Francisco
1	1	LCDR Walter J. Eager, Jr., CEC, USN, AFRI-NNMC, Bethesda, Md.
1	1	CDR W. J. Francy, CEC, USN, United States Naval Academy, Annapolis, Md.
1	1	Dr. Lauriston S. Taylor, Chief, Radiation Physics Division, National Bureau of Standards, Washington, D. C.
1	1	Dr. James O. Buchanan, Research Directorate, Office of Civil Defense, Washington, D. C.
1	1	Mr. Jack C. Greene, Office of Civil Defense, Department of Defense, Washington, D. C.
1	1	Dr. Harold A. Knapp, Fallout Studies Branch, Division of Biology and Medicine, U. S. Atomic Energy Commission, Washington, D. C.
1	1	Dr. Karl Z. Morgan, Director, Health Physics Division, Oak Ridge National Laboratory, Oak Ridge, Tenn.
1	1	Dr. Joseph D. Coker, National Resource Evaluation Center, Executive Office Building, Washington, D. C.
1	1	Dr. Charles F. Ksanda, Military Evaluation Division, U. S. Naval Radiological Defense Laboratory, San Francisco
1	1	Mr. John Auxier, Oak Ridge National Laboratory, Oak Ridge, Tenn.
1	1	Dr. William Kieger, Naval Radiological Defense Laboratory, San Francisco
1	1	Dr. Hans Tiller, Nuclear Defense Laboratory, Army Chemical Center, Md.
1	1	Mr. Irving Gaskill, National Resource Evaluation Center, Executive Office Building, Washington, D. C.
1	1	Mr. George Sisson, Office of Civil Defense, Department of Defense, Washington, D. C.
1	1	Mr. James C. Pettee, National Resource Evaluation Center, Executive Office Building, Washington, D. C.
1	1	LCDR I. D. Crowley, CEC, USN, Blast and Shock Division, Defense Atomic Support Agency, Washington, D. C.
1	1	CAPT H. L. Murphy, Room 211, Federal Office Building, San Francisco
1	1	LCDR W. H. Bannister, CEC, USN, Field Command, Defense Atomic Support Agency, Sandia Base, Albuquerque, N. M.
1	1	Major Robert Crawford, USAF, Air Force Weapons Laboratory, Kirtland Air Force Base, Albuquerque, N. M.

DISTRIBUTION LIST (Cont'd)

No. of Activities	Total Copies	
1	1	Mr. J. F. Tamanini, A & E Development Division, Office of Civil Defense, Department of Defense, Washington, D. C.
1	1	CDR C. R. Whipple, CEC, USN, Armed Forces Staff College, Norfolk, Va.
1	1	Dr. W. E. Fisher, Air Force Weapons Laboratory, Kirtland Air Force Base, Albuquerque, N. M.
1	1	Mr. Everitt P. Blizzard, Director, Neutron Physics, Oak Ridge National Laboratory, P. O. Box X, Oak Ridge, Tenn.
1	1	LT M. MacDonald, CEC, USN, U. S. Naval School, CEC Officers, Port Hueneme, Calif.
1	1	Library, Engineering Department, University of California, 405 Hilgard Avenue, Los Angeles
1	1	Sandia Corporation, Box 5800, Albuquerque, N. M.
1	1	Rivers and Harbor Library, Princeton University, Princeton, N. J.
1	1	Head, Civil Engineering Department, Carnegie Institute of Technology, Schenley Park, Pittsburgh, Pa.
1	1	Mr. G. H. Albright, Head, Department of Architectural Engineering, 101 Engineering "A" Bldg., The Pennsylvania State University, University Park, Pa
1	1	Dr. N. M. Newmark, Civil Engineering Hall, University of Illinois, Urbana, Ill.
1	1	Professor J. Neils Thompson, Civil Engineering Department, University of Texas, Austin, Tex.
1	1	Mr. Fred Sauer, Physics Department, Stanford Research Institute, Menlo Park, Calif.
1	1	Dr. T. H. Schiffman, Armour Research Foundation of Illinois, Institute of Technology, Technology Center, Chicago, Ill.
1	1	Dr. Robert V. Whitman, Massachusetts Institute of Technology, Cambridge, Mass.
1	1	Dr. Lewis V. Spencer, Ottawa University, Physics Department, Ottawa, Kan.
1	1	Mr. E. E. Shalowitz, Protective Construction, GSA Building, 19th and F Streets, N. W., Washington, D. C.
1	1	Mr. Werner Weber, Nuclear Engineering Consultant, N. Y. State Civil Defense Commission, P. O. Box 7007, State Office Building, Albany, N. Y.
1	1	Dr. Harold Brode, The Rand Corporation, 1700 Main Street, Santa Monica, Calif.
1	1	Mr. R. D. Cavanaugh, Barry Controls, Inc., 700 Pleasant Street, Watertown, Mass.
1	1	Mr. Kenneth Kaplan, Broadview Research Corporation, 1811 Trousdale Drive, Burlingame, Calif.
1	1	Mr. Thomas Morrison, American Machine and Foundry Company, 7501 North Natchez Avenue, Niles, Ill.

DISTRIBUTION LIST (Cont'd)

No. of Activities	Total Copies	
1	1	Mr. Walter Gunther, The Mitre Corporation, P. O. Box 208, Lexington, Mass.
1	1	Mr. W. R. Perret - 5112, Applied Experiments Division, Sandia Corporation, Albuquerque, N. M.
1	1	Mr. Lyndon Welch, Eberle M. Smith Associates, Inc., 153 East Elizabeth Street, Detroit, Mich.
1	1	Professor Herbert M. Bosch, Public Health Engineering, School of Public Health, University of Minnesota, Minneapolis, Minn.
1	1	Dr. Merit P. White, Civil Engineering Department, School of Engineering, University of Massachusetts, Amherst, Mass.
1	1	Dr. Robert J. Hansen, Department of Civil & Sanitary Engineering, Massachusetts Institute of Technology, Cambridge, Mass.
1	1	Mr. Harold Horowitz, Building Research Institute, National Academy of Sciences, 2101 Constitution Avenue, N. W., Washington, D. C.
1	1	Mr. Luke Vortman - 5112, Applied Experiments Division, Sandia Corporation, Albuquerque, N. M.
1	1	Mr. Richard Park, National Academy of Sciences, 2101 Constitution Avenue, N. W., Washington, D. C.
1	1	Mr. Frederick A. Pawley, AIA Research Secretary, American Institute of Architects, 1735 New York Avenue, N. W., Washington, D. C.
1	1	Dr. E. E. Massey, Defense Research Board, Department of National Defense, Ottawa, Canada
1	1	Dr. Robert Rapp, The Rand Corporation, 1700 Main Street, Santa Monica, Calif.
1	1	Dr. Stephen B. Withey, Program Director, Survey Research Center, University of Michigan, Ann Arbor, Mich.
1	1	Dr. Eric T. Clarke, Technical Operations, Inc., Burlington, Mass.
1	1	Dr. A. B. Chilton, Civil Engineering Hall, University of Illinois, Urbana, Ill.
1	1	Mrs. Shea Valley, CRTZS, A. F. Cambridge Research Center, L. G. Hanscom Field, Bedford, Mass.
1	1	Dr. J. T. Hanley, Department of Civil Engineering, University of Minnesota, Minneapolis, Minn.
1	1	Professor J. Silverman, Department of Chemical Engineering, University of Maryland, College Park, Md.
1	1	Dr. F. T. Mavis, Dean, College of Engineering, University of Maryland, College Park, Md.
1	1	Dr. Raymond R. Fox, Associate Professor and Director, Protective Construction Courses, The George Washington University, Washington, D. C.

DISTRIBUTION LIST (Cont'd)

No. of Activities	Total Copies	
1	1	Professor M. L. P. Go, Civil Engineering Department, University of Hawaii, Honolulu, Hawaii
1	1	Dr. James P. Romualdi, Department of Civil Engineering, Carnegie Institute of Technology, Pittsburg, Pa.
1	1	Dr. Nicholas Perrone, Structural Mechanics Branch, Office of Naval Research, Department of the Navy, Washington , D. C.
1	1	Dr. Aleksandar Sedmak Vesic, Professor of Civil Engineering, College of Engineering, Duke University, Durham, N. C.
1	1	Mr. C. C. Mow, The Rand Corporation, 1700 Main Street, Santa Monica, Calif.
1	1	Systems Engineering Group, Deputy for Systems Engineering, Directorate of Technical Publications and Specifications, Wright-Patterson AFB, Ohio
1	1	Dr. William L. White, Stanford Research Institute, Menlo Park, Calif.
1	1	CDR Allen F. Dill, CEC, USNR, Public Works Officer, Headquarters Support Activity, Taipei, Box 25, APO 63, San Francisco
1	1	Mr. J. G. Jackson, Jr., Soil Dynamics Branch, U. S. Army Engineer Waterways Experiment Station, Vicksburg, Miss.
1	1	Dr. C. V. Chelapati, Assistant Professor of Engineering, Los Angeles State College, Los Angeles, Calif.

U. S. Naval Civil Engineering Laboratory
GRAVITY VENTILATION OF UNDERGROUND SHELTERS, by J. C. King
TR-367 Mar 65 26 p. illus Unclassified

1. Underground shelters — Gravity ventilation 2. Air inducer 1. Y-F011-05-02-340

Tests were conducted to determine the suitability of using gravity ventilation as an emergency method of providing air for survival in an underground shelter. The tests consisted of inducing through a simulated test shelter an airflow caused by (a) inside-outside temperature differentials, and (b) stack heaters in the exhaust duct. An additional test was made which involved a device to direct wind into the intake duct. It was found that wind blowing over the inlet and exhaust ducts created a negative pressure in the shelter that could not be satisfactorily overcome by the gravity methods used; thus, minimum ventilation rates could be obtained only when there was no wind blowing.

In the tests conducted to utilize the wind, an NCEL-designed air inducer which mounts on the inlet duct provided satisfactory ventilation during normal weather conditions when there was a wind of 6 to 8 mph.

U. S. Naval Civil Engineering Laboratory
GRAVITY VENTILATION OF UNDERGROUND SHELTERS, by J. C. King
TR-367 Mar 65 26 p. illus Unclassified

1. Underground shelters — Gravity ventilation 2. Air inducer 1. Y-F011-05-02-340

Tests were conducted to determine the suitability of using gravity ventilation as an emergency method of providing air for survival in an underground shelter. The tests consisted of inducing through a simulated test shelter an airflow caused by (a) inside-outside temperature differentials, and (b) stack heaters in the exhaust duct. An additional test was made which involved a device to direct wind into the intake duct. It was found that wind blowing over the inlet and exhaust ducts created a negative pressure in the shelter that could not be satisfactorily overcome by the gravity methods used; thus, minimum ventilation rates could be obtained only when there was no wind blowing.

In the tests conducted to utilize the wind, an NCEL-designed air inducer which mounts on the inlet duct provided satisfactory ventilation during normal weather conditions when there was a wind of 6 to 8 mph.

U. S. Naval Civil Engineering Laboratory
GRAVITY VENTILATION OF UNDERGROUND SHELTERS, by J. C. King
TR-367 Mar 65 26 p. illus Unclassified

1. Underground shelters — Gravity ventilation 2. Air inducer 1. Y-F011-05-02-340

Tests were conducted to determine the suitability of using gravity ventilation as an emergency method of providing air for survival in an underground shelter. The tests consisted of inducing through a simulated test shelter an airflow caused by (a) inside-outside temperature differentials, and (b) stack heaters in the exhaust duct. An additional test was made which involved a device to direct wind into the intake duct. It was found that wind blowing over the inlet and exhaust ducts created a negative pressure in the shelter that could not be satisfactorily overcome by the gravity methods used; thus, minimum ventilation rates could be obtained only when there was no wind blowing.

In the tests conducted to utilize the wind, an NCEL-designed air inducer which mounts on the inlet duct provided satisfactory ventilation during normal weather conditions when there was a wind of 6 to 8 mph.

U. S. Naval Civil Engineering Laboratory
GRAVITY VENTILATION OF UNDERGROUND SHELTERS, by J. C. King
TR-367 Mar 65 26 p. illus Unclassified

1. Underground shelters — Gravity ventilation 2. Air inducer 1. Y-F011-05-02-340

Tests were conducted to determine the suitability of using gravity ventilation as an emergency method of providing air for survival in an underground shelter. The tests consisted of inducing through a simulated test shelter an airflow caused by (a) inside-outside temperature differentials, and (b) stack heaters in the exhaust duct. An additional test was made which involved a device to direct wind into the intake duct. It was found that wind blowing over the inlet and exhaust ducts created a negative pressure in the shelter that could not be satisfactorily overcome by the gravity methods used; thus, minimum ventilation rates could be obtained only when there was no wind blowing.

In the tests conducted to utilize the wind, an NCEL-designed air inducer which mounts on the inlet duct provided satisfactory ventilation during normal weather conditions when there was a wind of 6 to 8 mph.

Unclassified

Security Classification

DOCUMENT CONTROL DATA - R&D		
(Security classification of title, body of abstract and indexing annotation must be entered when the overall report is classified)		
1 ORIGINATING ACTIVITY (Corporate author) U. S. Naval Civil Engineering Laboratory Port Hueneme, California		2a REPORT SECURITY CLASSIFICATION Unclassified
		2b GROUP
3 REPORT TITLE Gravity Ventilation of Underground Shelters		
4 DESCRIPTIVE NOTES (Type of report and inclusive dates) Final. September 1963 - June 1964		
5 AUTHOR(S) (Last name, first name, initial) J. C. King		
6 REPORT DATE March 1965	7a TOTAL NO. OF PAGES 26	7b NO. OF REFS 0
8a CONTRACT OR GRANT NO.	8a. ORIGINATOR'S REPORT NUMBER(S) R-367	
b. PROJECT NO. Y-F011-05-02-340		
c.	8b. OTHER REPORT NO(S) (Any other numbers that may be assigned this report)	
d.		
10 AVAILABILITY/LIMITATION NOTICES Qualified requesters may obtain copies of this report from DDC.		
11 SUPPLEMENTARY NOTES	12 SPONSORING MILITARY ACTIVITY BuDocks	
13 ABSTRACT Tests were conducted to determine the suitability of using gravity ventilation as an emergency method of providing air for survival in an underground shelter. The tests consisted of inducing through a simulated test shelter an airflow caused by (a) inside - outside temperature differentials, and (b) stack heaters in the exhaust duct. An additional test was made which involved a device to direct wind into the intake duct. It was found that wind blowing over the inlet and exhaust ducts created a negative pressure in the shelter that could not be satisfactorily overcome by the gravity methods used; thus, minimum ventilation rates could be obtained only when there was no wind blowing. In the tests conducted to utilize the wind, an NCEL-designed air inducer which mounts on the inlet duct provided satisfactory ventilation during normal weather conditions when there was a wind of 6 to 8 miles per hour.		

DD FORM 1473

1 JAN 64

0101-807-6800

Unclassified

Security Classification

14 KEY WORDS	LINK A		LINK B		LINK C	
	ROLE	WT	ROLE	WT	ROLE	WT
Ventilation	8					
Gravity	10					
Air flow	10					
Temperature	10					
Differences	10					
Shelters	4					
Subsurface structures	4					
Civil defense	4					

INSTRUCTIONS

1. **ORIGINATING ACTIVITY:** Enter the name and address of the contractor, subcontractor, grantee, Department of Defense activity or other organization (*corporate author*) issuing the report.
- 2a. **REPORT SECURITY CLASSIFICATION:** Enter the overall security classification of the report. Indicate whether "Restricted Data" is included. Marking is to be in accordance with appropriate security regulations.
- 2b. **GROUP:** Automatic downgrading is specified in DoD Directive 5200.10 and Armed Forces Industrial Manual. Enter the group number. Also, when applicable, show that optional markings have been used for Group 3 and Group 4 as authorized.
3. **REPORT TITLE:** Enter the complete report title in all capital letters. Titles in all cases should be unclassified. If a meaningful title cannot be selected without classification, show title classification in all capitals in parentheses immediately following the title.
4. **DESCRIPTIVE NOTES:** If appropriate, enter the type of report, e.g., interim, progress, summary, annual, or final. Give the inclusive dates when a specific reporting period is covered.
5. **AUTHOR(S):** Enter the name(s) of author(s) as shown on or in the report. Enter last name, first name, middle initial. If military, show rank and branch of service. The name of the principal author is an absolute minimum requirement.
6. **REPORT DATE:** Enter the date of the report as day, month, year, or month, year. If more than one date appears on the report, use date of publication.
- 7a. **TOTAL NUMBER OF PAGES:** The total page count should follow normal pagination procedures, i.e., enter the number of pages containing information.
- 7b. **NUMBER OF REFERENCES:** Enter the total number of references cited in the report.
- 8a. **CONTRACT OR GRANT NUMBER:** If appropriate, enter the applicable number of the contract or grant under which the report was written.
- 8b, 8c, & 8d. **PROJECT NUMBER:** Enter the appropriate military department identification, such as project number, subproject number, system numbers, task number, etc.
- 9a. **ORIGINATOR'S REPORT NUMBER(S):** Enter the official report number by which the document will be identified and controlled by the originating activity. This number must be unique to this report.
- 9b. **OTHER REPORT NUMBER(S):** If the report has been assigned any other report numbers (either by the originator or by the sponsor), also enter this number(s).
10. **AVAILABILITY/LIMITATION NOTICES:** Enter any limitations on further dissemination of the report, other than those

imposed by security classification, using standard statements such as:

- (1) "Qualified requesters may obtain copies of this report from DDC."
- (2) "Foreign announcement and dissemination of this report by DDC is not authorized."
- (3) "U. S. Government agencies may obtain copies of this report directly from DDC. Other qualified DDC users shall request through _____."
- (4) "U. S. military agencies may obtain copies of this report directly from DDC. Other qualified users shall request through _____."
- (5) "All distribution of this report is controlled. Qualified DDC users shall request through _____."

If the report has been furnished to the Office of Technical Services, Department of Commerce, for sale to the public, indicate this fact and enter the price, if known.

11. **SUPPLEMENTARY NOTES:** Use for additional explanatory notes.

12. **SPONSORING MILITARY ACTIVITY:** Enter the name of the departmental project office or laboratory sponsoring (paying for) the research and development. Include address.

13. **ABSTRACT:** Enter an abstract giving a brief and factual summary of the document indicative of the report, even though it may also appear elsewhere in the body of the technical report. If additional space is required, a continuation sheet shall be attached.

It is highly desirable that the abstract of classified reports be unclassified. Each paragraph of the abstract shall end with an indication of the military security classification of the information in the paragraph, represented as: TS, S, C, or U.

There is no limitation on the length of the abstract. However, the suggested length is from 150 to 225 words.

14. **KEY WORDS:** Key words are technically meaningful terms or short phrases that characterize a report and may be used as index entries for cataloging the report. Key words must be selected so that no security classification is required. Identifiers, such as equipment model designation, trade name, military project code name, geographic location, may be used as key words but will be followed by an indication of technical content. The assignment of links, roles, and weights is optional.