

REPORT DOCUMENTATION PAGE				<i>Form Approved</i> OMB No. 0704-0188	
Public reporting burden for this collection of information is estimated to average 1 hour per response, including the time for reviewing instructions, searching data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. Send comments regarding this burden estimate or any other aspect of this collection of information, including suggestions for reducing this burden to Washington Headquarters Service, Directorate for Information Operations and Reports, 1215 Jefferson Davis Highway, Suite 1204, Arlington, VA 22202-4302, and to the Office of Management and Budget, Paperwork Reduction Project (0704-0188) Washington, DC 20503.					
PLEASE DO NOT RETURN YOUR FORM TO THE ABOVE ADDRESS.					
1. REPORT DATE (DD-MM-YYYY) 05-11-2015		2. REPORT TYPE Technical		3. DATES COVERED (From - To) April 2015	
4. TITLE AND SUBTITLE Evaluation of Instrumentation for Measuring Undissolved Water in Aviation Turbine Fuels per ASTM D3240				5a. CONTRACT NUMBER	
				5b. GRANT NUMBER	
				5c. PROGRAM ELEMENT NUMBER	
6. AUTHOR(S) Joel Schmitigal				5d. PROJECT NUMBER	
				5e. TASK NUMBER	
				5f. WORK UNIT NUMBER	
7. PERFORMING ORGANIZATION NAME(S) AND ADDRESS(ES) US Army TARDEC RDTA SIE-ES-FPT-PSD 6501 E. 11 Mile Road Mail Stop 110 Warren, MI 48397-5000				8. PERFORMING ORGANIZATION REPORT NUMBER 27372	
9. SPONSORING/MONITORING AGENCY NAME(S) AND ADDRESS(ES) US Army TARDEC RDTA SIE-ES-FPT-PSD 6501 E. 11 Mile Road Mail Stop 110 Warren, MI 48397-5000				10. SPONSOR/MONITOR'S ACRONYM(S)	
				11. SPONSORING/MONITORING AGENCY REPORT NUMBER	
12. DISTRIBUTION AVAILABILITY STATEMENT DISTRIBUTION A. Approved for public release: distribution unlimited.					
13. SUPPLEMENTARY NOTES					
14. ABSTRACT This technical report details the evaluation of three different instruments used for measuring undissolved water (free water) in Aviation Turbine Fuels per ASTM D3240					
15. SUBJECT TERMS fuel, JP-8, aviation fuel, contamination, free water, undissolved water, Aqua-Glo					
16. SECURITY CLASSIFICATION OF:		17. LIMITATION OF ABSTRACT none	18. NUMBER OF PAGES 15	19a. NAME OF RESPONSIBLE PERSON Joel Schmitigal	
a. REPORT Unclassified	b. ABSTRACT Unclassified			c. THIS PAGE Unclassified	19b. TELEPHONE NUMBER (Include area code) 586-282-4235

INSTRUCTIONS FOR COMPLETING SF 298

1. REPORT DATE. Full publication date, including day, month, if available. Must cite at least the year and be Year 2000 compliant, e.g., 30-06-1998; xx-08-1998; xx-xx-1998.

2. REPORT TYPE. State the type of report, such as final, technical, interim, memorandum, master's thesis, progress, quarterly, research, special, group study, etc.

3. DATES COVERED. Indicate the time during which the work was performed and the report was written, e.g., Jun 1997 - Jun 1998; 1-10 Jun 1996; May - Nov 1998; Nov 1998.

4. TITLE. Enter title and subtitle with volume number and part number, if applicable. On classified documents, enter the title classification in parentheses.

5a. CONTRACT NUMBER. Enter all contract numbers as they appear in the report, e.g. F33615-86-C-5169.

5b. GRANT NUMBER. Enter all grant numbers as they appear in the report, e.g. 1F665702D1257.

5c. PROGRAM ELEMENT NUMBER. Enter all program element numbers as they appear in the report, e.g. AFOSR-82-1234.

5d. PROJECT NUMBER. Enter all project numbers as they appear in the report, e.g. 1F665702D1257; ILIR.

5e. TASK NUMBER. Enter all task numbers as they appear in the report, e.g. 05; RF0330201; T4112.

5f. WORK UNIT NUMBER. Enter all work unit numbers as they appear in the report, e.g. 001; AFAPL30480105.

6. AUTHOR(S). Enter name(s) of person(s) responsible for writing the report, performing the research, or credited with the content of the report. The form of entry is the last name, first name, middle initial, and additional qualifiers separated by commas, e.g. Smith, Richard, Jr.

7. PERFORMING ORGANIZATION NAME(S) AND ADDRESS(ES). Self-explanatory.

8. PERFORMING ORGANIZATION REPORT NUMBER. Enter all unique alphanumeric report numbers assigned by the performing organization, e.g. BRL-1234; AFWL-TR-85-4017-Vol-21-PT-2.

9. SPONSORING/MONITORS AGENCY NAME(S) AND ADDRESS(ES). Enter the name and address of the organization(s) financially responsible for and monitoring the work.

10. SPONSOR/MONITOR'S ACRONYM(S). Enter, if available, e.g. BRL, ARDEC, NADC.

11. SPONSOR/MONITOR'S REPORT NUMBER(S). Enter report number as assigned by the sponsoring/ monitoring agency, if available, e.g. BRL-TR-829; -215.

12. DISTRIBUTION/AVAILABILITY STATEMENT. Use agency-mandated availability statements to indicate the public availability or distribution limitations of the report. If additional limitations/restrictions or special markings are indicated, follow agency authorization procedures, e.g. RD/FRD, PROPIN, ITAR, etc. Include copyright information.

13. SUPPLEMENTARY NOTES. Enter information not included elsewhere such as: prepared in cooperation with; translation of; report supersedes; old edition number, etc.

14. ABSTRACT. A brief (approximately 200 words) factual summary of the most significant information.

15. SUBJECT TERMS. Key words or phrases identifying major concepts in the report.

16. SECURITY CLASSIFICATION. Enter security classification in accordance with security classification regulations, e.g. U, C, S, etc. If this form contains classified information, stamp classification level on the top and bottom of this page.

17. LIMITATION OF ABSTRACT. This block must be completed to assign a distribution limitation to the abstract. Enter UU (Unclassified Unlimited) or SAR (Same as Report). An entry in this block is necessary if the abstract is to be limited.

Registration No. 27372



Evaluation of Instrumentation for Measuring Undissolved Water in Aviation Turbine Fuels per ASTM D3240

Joel Schmitigal

DISTRIBUTION A. Approved for public release: distribution unlimited.

November 2015

U.S. Army Tank Automotive Research,
Development, and Engineering Center
Detroit Arsenal
Warren, Michigan 48397-5000

UNCLASSIFIED

NOTICES

Disclaimers

The findings in this report are not to be construed as an official Department of the Army position unless so designated by other authorized documents.

Citation of manufacturer's or trade names does not constitute an official endorsement or approval of the use thereof.

Destroy this report when it is no longer needed. Do not return it to the originator.

UNCLASSIFIED

U.S. Army Tank Automotive Research Development and Engineering Center

Warren, Michigan 48397-5000

Evaluation of Instrumentation for Measuring Undissolved Water in
Aviation Turbine Fuels per ASTM D3240

Joel Schmitigal
Force Projection Technology

DISTRIBUTION A. Approved for public release: distribution unlimited.

Standard Form 298 (Rev. 8/98)

Prescribed by ANSI Std. Z39

List of Figures	II
List of Tables	III
List of Formulas	IV
Introduction	1
1. Evaluation	2
2. Analysis	3
3. Data	5
4. Conclusions	6
References	7
List of Symbols, Abbreviations, and Acronyms	8

List of Figures

Figure 1. a. Aqua-Glo Series V from Gammon Technical Products; b. JF-WA1 from D-2 Incorporated and c. Digital Aqua-Glo instrument prototype from Gammon Technical Products.. 2

List of Tables

Table 1. Test Matrix.....	3
Table 2. Free water measurements utilizing D-2 Incorporated JF-WA1, Gammon Technical Products Aqua-Glo Series V, and Digital Aqua-Glo instruments with varying levels of free water and particulate contamination.	5

List of Formulas

Equation 1. Aqua-Glo Reproducibility	3
Equation 2. JF-WA1: Reproducibility	3
Equation 3. Digital Aqua-Glo Reproducibility	4

Introduction

Fuel quality assurance is accomplished by conducting periodic fuel sampling for the condition monitoring of aviation fuel by detecting, measuring, and reporting the levels of contaminants in the fuel. The currently accepted methods for measuring free water contamination of fuel supplies include:

- ASTM D3240 – Standard Test Method for Undissolved Water in Aviation Turbine Fuels
- ASTM D4176 – Standard Test Method for Free Water and Particulate Contamination in Distillate Fuels (Visual Inspection Procedures)

Excess free water in aviation fuel can diminish the lubricative properties of the fuel and lead to icing of fuel filters at low temperatures commonly found at high altitude and arctic operations. The presence of free water in fuel storage systems can also lead to the growth of microorganisms at the interfacial layer of the fuel and water which can lead to fuel quality degradation, filter plugging, and fuel system corrosion. Free water contamination (droplets) may appear as fine droplets or slugs of water in the fuel systems and is controlled by the use of filter separators and coalescers in fueling handling equipment.

Current standards, such as MIL-STD-3004, Department of Defense Standard Practice for Quality Assurance/Surveillance for Fuels, Lubricants, and Related Products and Field Manual No. 10-67-2, Department of the Army Manual for Petroleum Laboratory Testing and Operations, specifies limits for free water and particulate matter in aviation fuels. Per Army requirements, at a minimum free water is checked daily and cannot exceed 10 parts per million (ppm) (1) (2).

In the early 1960's the US Navy developed the Aeronautical Engine Laboratory (AEL) free water detector and the associated methodology for detecting free water (3). Later in the decade Exxon refined this method to utilize a 25mm uranine dye treated pad, implemented the use of an iris diaphragm to vary the results, and the use of a single built in comparison standard. Gammon Technical products further refined the AquaGlo testing apparatus used in ASTM D3240, under license from Exxon, and has introduced several refinements over the years. The test works by passing a known volume (500 mL) of fuel through an uranine dye-treated filter pad. The free water in the fuel will react with the uranine dye in the filter pad. The pad is then subjected to an ultraviolet (UV) light source that causes the dye that has been in contact with the free water to fluoresce. The fluorescence of the test pad is compared to a known standard, and the free water in the fuel sample is provided in parts per million by volume. Water levels higher than 12 ppm can be calculated by reducing the sample size by a known amount.

Instrumentation that reads the filter pads include the Aqua-Glo Series V from Gammon Technical Products, the JF-WA1 from D-2 Incorporated, and the newly introduced Digital Aqua-Glo instrument from Gammon Technical Products, Figure 1.

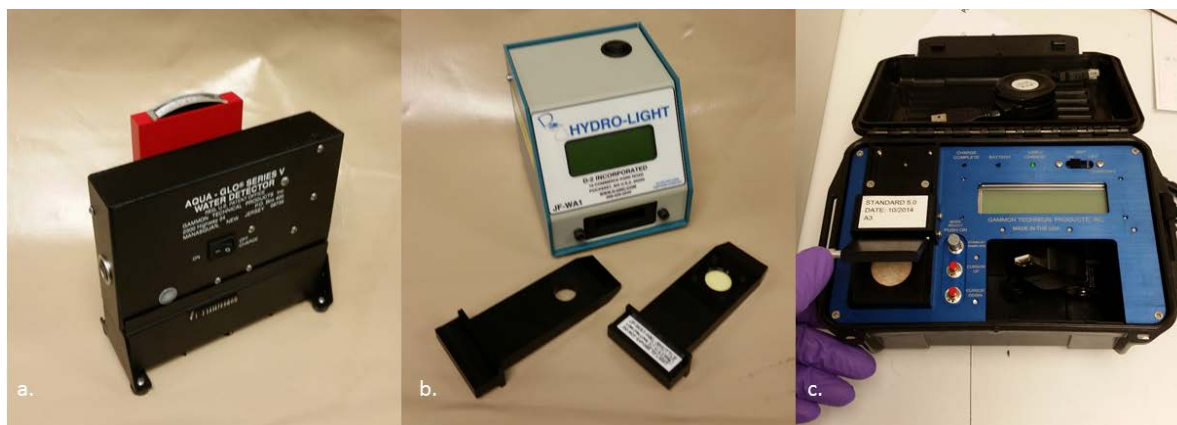


Figure 1. a. Aqua-Glo Series V from Gammon Technical Products; b. JF-WA1 from D-2 Incorporated and c. Digital Aqua-Glo instrument prototype from Gammon Technical Products.

1. Evaluation

The test plan for evaluating the Digital Aqua-Glo pad reader from Gammon Technical Products involved the production of contaminated fuels with varying levels of solid and free water contamination. As a basic evaluation, only one of each instrument was utilized. The AquaGlo V was an older unit and the Digital units were both new. The EI 1581 test facility at Southwest Research Institute was used to develop these fuel samples. Uranine dye-treated filter pads were prepared by passing 500mL of fuel through the filter pad as specified in ASTM D3240. When free water content was expected to be greater than 10 ppm the sample size was cut in half to 250mL and when water content was expected to be greater than 24ppm sample size was cut to 100mL. The filter pad was read on the Aqua-Glo Series V instrument from Gammon Technical Products, the JF-WA1 from D-2 Incorporated, and the Digital Aqua-Glo instrument and the appropriate conversion factors were then applied to instrument readings to provide ppm if applicable. A total of 70 samples were analyzed during the evaluation. The test matrix found in Table 1 provides the contaminate levels tested.

			Free water Concentration PPM					
			0	5	10	15	20	30
Test Dust Concentration (mg/L)	A3	2.5	x		x	x		x
		2	x		x	x		x
		1	x	x	x	x	x	
		0.5	x		x	x		x
		0.25	x		x	x		x
	A2	2.5	x		x	x		x
		2	x		x	x		x
		1	x		x	x		x
		0.5	x	x	x	x		
		0.25	x		x	x		x
	A1	2.5	x		x	x		x
		2	x		x	x		x
		1	x	x	x	x		
		0.5	x	x	x	x		
		0.25	x	x	x	x		

Table 1. Test Matrix

2. Analysis

The D-2 Incorporated JF-WA1 was used as a baseline measurement to compare the Gammon Technical Products Aqua-Glo Series V and Digital Aqua-Glo instruments. Samples that fell below 5.0 ppm on the JF-WA1 instrument were found to vary by an average of 2.7ppm when read on the Aqua-Glo Series V instrument, an average of difference of 131%. Samples that were measured to be greater than 5.0ppm on the JF-WA1 instrument varied by an average of 4.0ppm between when tested on the Aqua-Glo Series V instrument, for an average of 61.4% different. The measurement variation between the two instruments exceeded the established reproducibility of the Aqua-Glo instrument as established in ASTM D3240, Equation 1, in 60 of 70 samples tested. JF-WA1 instrument reproducibility is provided for reference in Equation 2. These are the results of this abbreviated test procedure, which is not as thorough as an ASTM 'Round Robin' test. The AquaGlo Series V results showed errors which were determined to be the result of a faulty instrument.

$$R = 0.54083x^{0.8058} \text{ ppm}$$

Equation 1. Aqua-Glo Reproducibility

$$R = 0.36913x^{0.4997} \text{ ppm}$$

Equation 2. JF-WA1: Reproducibility

UNCLASSIFIED

Samples that fell below 5.0 ppm on the JF-WA1 instrument varied by an average of 0.4 ppm, an average of difference of 29.7% when measured on the Digital Aqua-Glo reader compared to the from the JF-WA1 results. Samples that were measured to be greater than 5.0 varied by an average of 0.6 ppm between the JF-WA1 instrument and the Digital Aqua-Glo, an average of difference of 8.44%. The measurement variation between the two instruments exceeded the established reproducibility, Equation 3, of the Digital Aqua-Glo reader in 7 out of 70 samples tested.

$$R = 0.40703x^{0.5771} \text{ ppm}$$

Equation 3. Digital Aqua-Glo Reproducibility

3. Data

A-3 Dust	0.25 mg/L			0.5 mg/L			1.0 mg/L			2.0 mg/L			2.5 mg/L			2.0 mg/L			2.5 mg/L		
Water	D-2	Gammon V	Gammon D	D-2	Gammon V	Gammon D	D-2	Gammon V	Gammon D	D-2	Gammon V	Gammon D	D-2	Gammon V	Gammon D	D-2	Gammon V	Gammon D	D-2	Gammon V	Gammon D
ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm
0	0.7	2	1.3	0.7	2	1.1	1.3	3.5	1.7	0.8	3	1.3	0.7	2	1.1	1.1	3	4.1	1.2	3	1.6
5	--	--	--	--	--	--	5.0	9	5.1	--	--	--	--	--	--	4.3	7.5	4.0	4.0	8	3.9
10	6.6	12	6.8	5.8	12	6.4	8.8	14	8.6	8.6	18	7.8	8.0	12	7.8	7.5	12	7.9	8.0	14	7.2
15	12.2	19	11.4	15.2	>24	14.8	10.0	16	9.2	16.0	>24	15.8	16.2	>24	16.6	14.4	22	13.8	18.8	>24	17.0
20	--	--	--	--	--	--	14.8	12	14.0	--	--	--	--	--	--	--	--	--	--	--	--
30	28.5	45	19.5	29.0	45	27.5	--	--	--	26.5	42.5	24.0	18.5	30	17.5	--	--	--	--	--	--
A-2 Dust	0.25 mg/L			0.5 mg/L			1.0 mg/L			2.0 mg/L			2.5 mg/L								
Water	D-2	Gammon V	Gammon D	D-2	Gammon V	Gammon D	D-2	Gammon V	Gammon D	D-2	Gammon V	Gammon D	D-2	Gammon V	Gammon D						
ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm						
0	1	2.4	1.5	1.2	3	1.7	1	3	1.2	1.6	4	2.0	1.5	4	1.8						
5	--	--	--	5	9.5	5.0	--	--	--	--	--	--	--	--	--						
10	9	14	8.0	8.8	16	8.0	10.4	18	9.8	9.8	18	9.8	10.2	18	9.6						
15	17	>24	16.6	15.2	>24	14.0	14	20	13.2	14.4	>24	13.6	15.0	>24	14.6						
20	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--						
30	28	45	24.5	--	--	--	17	30	17.5	35.5	60	33.5	32.0	60	31.5						
A-1 Dust	0.25 mg/L			0.5 mg/L			1.0 mg/L			2.0 mg/L			2.5 mg/L								
Water	D-2	Gammon V	Gammon D	D-2	Gammon V	Gammon D	D-2	Gammon V	Gammon D	D-2	Gammon V	Gammon D	D-2	Gammon V	Gammon D						
ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm	ppm						
0	1.7	4.5	1.9	1.3	4.5	1.6	1.5	3.5	1.7	1.5	4	1.9	1.2	3	1.6						
5	5.2	10	5.4	5.5	10	3.8	4.5	9	4.8	--	--	--	--	--	--						
10	11.2	18	10.4	10.8	18	9.2	9.2	17	8.4	11.0	18	10.6	10.2	16	9.8						
15	15.2	>24	15.8	17.6	24	13.2	12.4	19	11.0	15.0	>24	14.2	12.6	21	11.6						
20	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--						
30	--	--	--	--	--	--	--	--	--	29.5	55	21.0	32.5	55	29						

Table 2. Free water measurements utilizing D-2 Incorporated JF-WA1, Gammon Technical Products Aqua-Glo Series V, and Digital Aqua-Glo instruments with varying levels of free water and particulate contamination.

4. Conclusions

Discussions with personnel from Gammon Technical Products indicate that the Aqua-Glo Series V instrument was malfunctioning during the evaluation. The instrument was calibrated every hour. There was no way for the user to determine if the instrument was operating correctly or not. The Aqua-Glo Series V, and similar previous instruments, have been used by the aviation industry for over 40 years, and is the referee method for ASTM D3240. For this reason it is acceptable to accept this conclusion from Gammon Technical Products upon their evaluation of the data presented in this report.

It should be noted that both the Digital Aqua-Glo and the JF-WA1 instrument have calibration checks to verify instrument operation. The Aqua-Glo Series V instrument requires frequent recalibration but does not have a separate verification method which can lead the operator to obtain incorrect readings due to an instrument malfunction as appears to have occurred during this evaluation. Gammon Technical products has stated that a verification check for the analog instrument will be introduced in the near future. The JF-WA1 instrument requires annual factory recalibration but the manufacture has stated that, "The annual calibration can be extended indefinitely as long as the provided verification shuttle meets 1/2 the tolerance shown for both values." The Digital Aqua-Glo performs an internal recalibration before each test reading.

Both the JF-WA1 from D-2 Incorporated and Digital Aqua-Glo pad reader from Gammon Technical Products are easier to operate than the Aqua-Glo Series V instrument and provided results commensurate with the analog instrumentation and should be considered for field use for free water evaluation of jet fuel.

References

1. **Department of Defense Standard Practice.** Quality Assurance/Surveillance for Fuels, Lubricants and Related Products. *MIL-STD-3004C w/change 1*. December 7, 2012.
2. **HeadQuarters Department of the Army.** Petroleum Supply Operations. *ATP 4-43*. Washington, DC : s.n., August 2015.
3. **Johnston, R. and Monita, C.** Evaluation of a Detector for Free Water in Fuel. *Technical Report AFAPL-TR-66-39*. Wright-Patterson Air Force Base, Ohio : Air Force Aero Propulsion Laboratory Research and Technology Division, April 1966.

List of Symbols, Abbreviations, and Acronyms

AEL	Aeronautical Engine Laboratory
ASTM	ASTM International
D-2	D-2 Incorporated
EI	Energy Institute
MIL	Military
mL	Milliliter
PPM	Parts Per Million
STD	Standard
UV	Ultraviolet
US	United States