

AD-A057 921

DAVID W TAYLOR NAVAL SHIP RESEARCH AND DEVELOPMENT CE--ETC F/G 21/5  
COMPARISON OF OPEN AND CLOSED BRAYTON ENGINES FOR RECUPERATED A--ETC(U)  
AUG 78 J S WOHLGEMUTH

UNCLASSIFIED


DTNSRDC-PAS-78-15

NL

| OF |  
ADA  
057921



END  
DATE  
FILMED  
10-78  
DDC

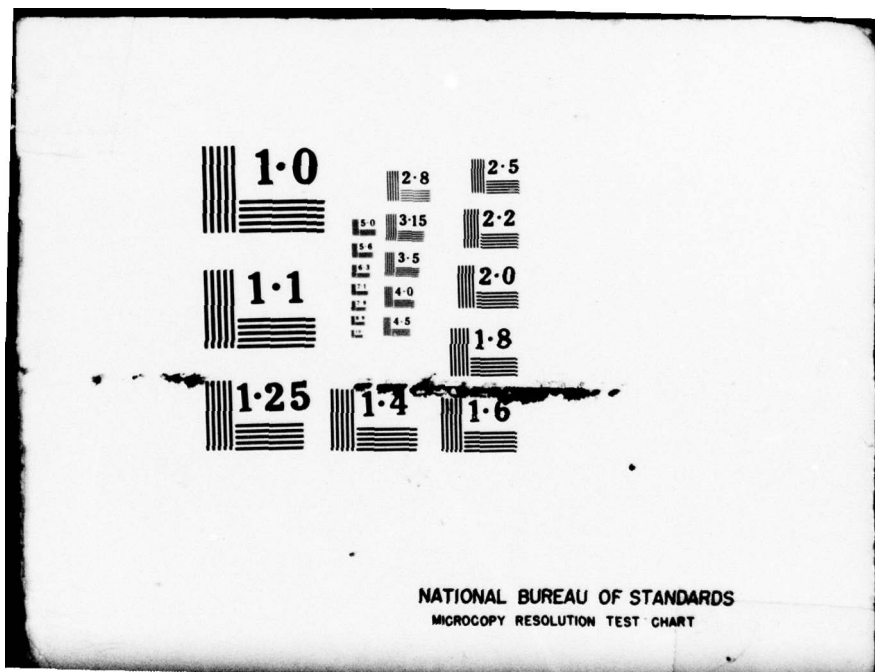

**LEVEL II**

**DAVID W. TAYLOR NAVAL SHIP  
RESEARCH AND DEVELOPMENT CENTER**

Bethesda, Maryland 20084



ADA057921

AT

9 Research and development rept.

12

6 COMPARISON OF OPEN AND CLOSED BRAYTON ENGINES  
FOR RECUPERATED AND SIMPLE CYCLES

by

10 John S. Wohlgemuth

DDC  
AUG 23 1978  
E

AU NO. DDC FILE COPY

APPROVED FOR PUBLIC RELEASE;  
DISTRIBUTION UNLIMITED.

12 47p

PROPULSION AND AUXILIARY SYSTEMS DEPARTMENT  
RESEARCH AND DEVELOPMENT REPORT

78 08 17 027

COMPARISON OF OPEN AND  
AND SIMPLE CYCLES


11 Aug 1978

14 DTNSRDC - PAS-78-15

408 615

Lee

# MAJOR DTNSRDC ORGANIZATIONAL COMPONENTS

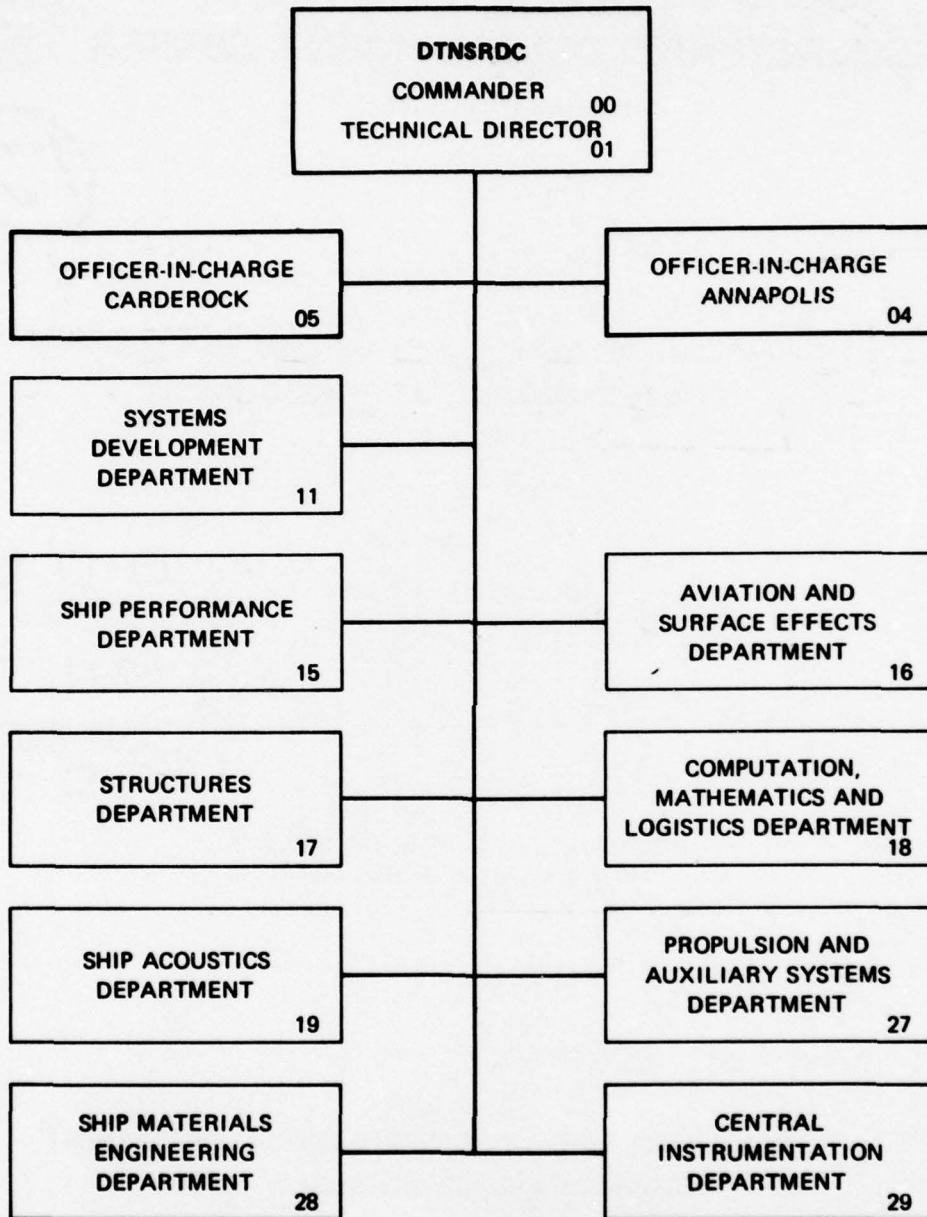

UNCLASSIFIED

SECURITY CLASSIFICATION OF THIS PAGE (When Data Entered)

REPORT DOCUMENTATION PAGE		READ INSTRUCTIONS BEFORE COMPLETING FORM
1. REPORT NUMBER <b>PAS-78-15</b>	2. GOVT ACCESSION NO.	3. RECIPIENT'S CATALOG NUMBER
4. TITLE (and Subtitle) <b>COMPARISON OF OPEN AND CLOSED BRAYTON ENGINES FOR RECUPERATED AND SIMPLE CYCLES</b>		5. TYPE OF REPORT & PERIOD COVERED <b>Research &amp; Development</b>
7. AUTHOR(s) <b>John S. Wohlgemuth</b>		6. PERFORMING ORG. REPORT NUMBER
8. PERFORMING ORGANIZATION NAME AND ADDRESS <b>David W. Taylor Naval Ship R &amp; D Center Annapolis, Maryland 21402</b>		9. CONTRACT OR GRANT NUMBER(s)
10. PROGRAM ELEMENT, PROJECT, TASK AREA & WORK UNIT NUMBERS <b>Work Unit 2720-152</b>		11. CONTROLLING OFFICE NAME AND ADDRESS <b>David W. Taylor Naval Ship R &amp; D Center Bethesda, Maryland 20084</b>
12. REPORT DATE <b>August 1978</b>		13. NUMBER OF PAGES <b>43</b>
14. MONITORING AGENCY NAME & ADDRESS (if different from Controlling Office)		15. SECURITY CLASS. (of this report) <b>Unclassified</b>
15a. DECLASSIFICATION/DOWNGRADING SCHEDULE		
16. DISTRIBUTION STATEMENT (of this Report)  <b>APPROVED FOR PUBLIC RELEASE; DISTRIBUTION UNLIMITED.</b>		
17. DISTRIBUTION STATEMENT (of the abstract entered in Block 20, if different from Report)		
18. SUPPLEMENTARY NOTES		
19. KEY WORDS (Continue on reverse side if necessary and identify by block number) <b>Gas turbine                      Design point component performance effects</b> <b>Performance analysis        Thermal cycle efficiency trade-offs</b> <b><u>Brayton cycle modeling    Recuperator effectiveness</u></b>		
20. ABSTRACT (Continue on reverse side if necessary and identify by block number) <b>To quantitatively compare open and closed Brayton systems for their possible recuperated and simple cycle versions, a general performance analysis is developed. The results of this analysis are summarized in open and closed cycle design point performance maps. The maps present the performance output (such as cycle efficiency) → next page</b> <p style="text-align: right;">(over)</p>		

DD FORM 1473 1 JAN 73

EDITION OF 1 NOV 65 IS OBSOLETE  
S/N 0102-014-6601

UNCLASSIFIED

SECURITY CLASSIFICATION OF THIS PAGE (When Data Entered)

UNCLASSIFIED

SECURITY CLASSIFICATION OF THIS PAGE(When Data Entered)

20. ABSTRACT (cont)

over ranges of design values for the important cycle parameters of recuperation, gas turbine inlet temperature, and pressure ratio. For possible open and closed Brayton systems, cycle efficiency increases with either increasing values of recuperation or turbine inlet temperature, or both. To quantify these performance effects, the open and closed cycles are optimized with respect to pressure ratio. The efficiency improvement of recuperated open and closed Brayton cycles over simple cycles is about +8 points (for typical values of effectiveness of 0.90). This increase in efficiency for recuperated cycles holds over a reasonable range of turbine inlet temperatures of 1400°F (760°C) to 2200°F (1200°C). Since higher values of cycle efficiency can be achieved with recuperated cycles compared to simple cycles at constant turbine inlet temperature; the corollary also holds that, for constant values of efficiency, turbine inlet temperature will be lower for recuperated cycles compared to simple cycles. The reduction in turbine inlet temperatures at constant efficiency for recuperated over simple cycles is about 400°F (220°C) over a reasonable range of cycle efficiencies of 30% to 45%. Up to a recuperator effectiveness of 0.85, the open Brayton cycles have lower required turbine inlet temperatures to achieve the same cycle efficiencies as the closed Brayton cycles. For highly recuperated cycles (effectivenesses of 0.90 to 0.95), the open and closed Brayton cycles have competitive turbine inlet temperatures for competitive cycle efficiencies.

(Author)

UNCLASSIFIED

SECURITY CLASSIFICATION OF THIS PAGE(When Data Entered)

## ADMINISTRATIVE INFORMATION

This study was jointly sponsored by the Defense Advanced Research Projects Agency, Dr. Phillip Selwyn, Program Manager, and the Naval Sea Systems Command (SEA 0331, Mr. Charles Miller, Program Manager). The work was performed in the Gas Turbines Branch of the Power Systems Division, Propulsion and Auxiliary Systems Department, under Work Unit 2721-152.

## LIST OF ABBREVIATIONS

Btu	- British thermal unit
°C	- degree Celsius
CIT	- compressor inlet temperature
cm <sup>2</sup>	- square centimeters
DLPB	- pressure drop for combustor or burner heat exchanger
DLPK	- pressure drop for cooler
LLPHXH	- pressure drop for recuperator heat exchanger, high-pressure cold-side
DLPHXL	- pressure drop for recuperator heat exchanger, low-pressure hot-side
°F	- degree Fahrenheit
F	- fuel flow
FG	- cycle addition of fuel flow
hp	- horsepower
in.	- inch
in. <sup>2</sup>	- square inch
J	- joule
°K	- degree Kelvin
kg	- kilogram
kW	- kilowatt
lb	- pound

ACCESSION for	
WWS	White Section <input checked="" type="checkbox"/>
DDC	Buff Section <input type="checkbox"/>
UNANNOUNCED	<input type="checkbox"/>
JUSTIFICATION.....	
BY.....	
DISTRIBUTION/AVAILABILITY CODES	
Dist. AVAIL. and/or SPECIAL	
A	

lb<sub>f</sub> - pound force  
m - meter  
m<sup>2</sup> - square meter  
MB - gas flow, bleed  
MC - gas flow, compressor  
MCT - gas flow, compressor turbine  
MMIX - gas flow, mixed turbine exit with bleed  
MPT - gas flow, power turbine  
MT - gas flow, turbine expansion  
N - newton  
psia - pounds per square inch absolute  
°R - degree Rankine  
RC - pressure ratio, compressor, =  $P_2/P_1$   
RCT - pressure ratio, compressor turbine  
RIT - recuperator inlet temperature  
RPT - pressure ratio, power turbine  
sec - second  
SFC - specific fuel consumption  
SPHP - net output power  
TIT - turbine inlet temperature  
WC - compressor power absorbed  
WCT - compressor power supplied

## LIST OF SYMBOLS

- CPC - constant pressure specific heat through compressor,  $\frac{\text{Btu}}{\text{lb-}^\circ\text{R}} \left[ \frac{\text{J}}{\text{kg-}^\circ\text{K}} \right]$
- CPT - constant pressure specific heat through turbine,  $\frac{\text{Btu}}{\text{lb-}^\circ\text{R}} \left[ \frac{\text{J}}{\text{kg-}^\circ\text{K}} \right]$
- P - pressure,  $\text{lb}/\text{in.}^2$  ( $\text{N}/\text{cm}^2$ )
- s - entropy,  $\text{Btu}/\text{lb-}^\circ\text{R}$  ( $\text{J}/\text{kg-}^\circ\text{K}$ )
- T - temperature,  $^\circ\text{R}$  ( $^\circ\text{K}$ )
- $\Delta P/P]_r$  - recuperator pressure loss
- $\gamma_c$  - ratio of specific heats through compressor
- $\gamma_T$  - ratio of specific heats through turbine
- $\epsilon_r$  - recuperator effectiveness
- $\eta_B$  - burner or external heater efficiency
- $\eta_c$  - compressor efficiency
- $\eta_{GG}$  - gas generator efficiency
- $\eta_T$  - turbine efficiency
- $\eta_{TH}$  - thermal cycle efficiency

### Numerical Subscripts

- 1 - compressor inlet
- 2 - compressor exit
- 5 - heater inlet
- 6 - maximum cycle temperature and TIT
- 8 - compressor (absorbed) turbine exit and intermediate expansion state-point
- 9 - final turbine expansion state-point
- 9R - cooled turbine exhaust and recuperator inlet (for recuperated cycles)
- 10 - first heat rejection state-point

TABLE OF CONTENTS

	<u>Page</u>
ADMINISTRATIVE INFORMATION.....	i
LIST OF ABBREVIATIONS.....	i
LIST OF SYMBOLS.....	iii
NUMERICAL SUBSCRIPTS.....	iii
LIST OF FIGURES.....	vi
LIST OF TABLES.....	vi
ABSTRACT.....	1
INTRODUCTION.....	2
DESCRIPTION OF UNIVERSAL BRAYTON CYCLE.....	4
General Brayton Cycle.....	4
Flow Schematic with System, Component & Arrangement Flexibility.....	8
DESCRIPTION OF BRAYTON CYCLE PROGRAM.....	11
Input for Brayton Cycle Analysis.....	11
Calculation of Brayton Cycle Performance.....	14
Brayton Cycle Performance Output.....	15
APPROACH.....	16
RESULTS.....	17
CONCLUSIONS.....	21
REFERENCES.....	23
APPENDIX A - FORTRAN Subroutine for Calculating Brayton Cycle Performance and State-Points (1 page)	
INITIAL DISTRIBUTION	

78 08 17 027

## LIST OF FIGURES

- 1 - General Brayton Cycle Diagram
- 2 - Universal Brayton Cycle Flow Model
- 3 - Recuperator Pressure Loss  $\Delta P/P]_r$  vs Effectiveness  $\epsilon_r$  for Open and Closed Brayton Systems
- 4 - Example of Brayton Cycle Efficiency  $\eta_{TH}$  over a Possible Range of Compressor Pressure Ratio RC
- 5 - Thermal efficiency  $\eta_{TH}$  as a function of Turbine Inlet Temperature TIT and Compressor Pressure Ratio RC
- 6 - Design Point Performance Map for Recuperated and Simple Brayton Cycles
- 7 - Performance Map of Open Brayton Systems for Recuperated and Simple Cycles
- 8 - Performance Map of Closed Brayton Systems for Recuperated Cycles

## LIST OF TABLES

- 1 - Component Input for Open and Closed Brayton Cycle Analysis
- 2 - Cycle Temperature Effects on Air Properties

## ABSTRACT

To quantitatively compare open and closed Brayton systems for their possible recuperated and simple cycle versions, a general performance analysis is developed. The results of this analysis are summarized in open and closed cycle design point performance maps. The maps present the performance output (such as cycle efficiency) over ranges of design values for the important cycle parameters of recuperation, gas turbine inlet temperature, and pressure ratio. For possible open and closed Brayton systems, cycle efficiency increases with either increasing values of recuperation or turbine inlet temperature, or both. To quantify these performance effects, the open and closed cycles are optimized with respect to pressure ratio. The efficiency improvement of recuperated open and closed Brayton cycles over simple cycles is about +8 points (for typical values of effectiveness of 0.90). This increase in efficiency for recuperated cycles holds over a reasonable range of turbine inlet temperatures of 1400 degrees F (760 degrees C) to 2200 degrees F (1200 degrees C). Since higher values of cycle efficiency can be achieved with recuperated cycles compared to simple cycles at constant turbine inlet temperature; the corollary also holds that, for constant values of efficiency, turbine inlet temperature will be lower for recuperated cycles compared to simple cycles. The reduction in turbine inlet temperatures at constant efficiency for recuperated over simple cycles is about 400 degrees F (220 degrees C) over a reasonable range of cycle efficiencies of 30 percent to 45 percent. Up to a recuperator effectiveness of 0.85, the open Brayton cycles have lower required turbine inlet temperatures to achieve the same cycle efficiencies as the closed Brayton cycles. For highly recuperated cycles (effectiveness of 0.90 to 0.95), the open and closed Brayton cycles have competitive turbine inlet temperatures for competitive cycle efficiencies.

## INTRODUCTION

The comparison of open and closed Brayton systems for their recuperated and simple cycle versions will be fundamentally based on their common thermodynamic cycle. The four processes of the general thermodynamic Brayton cycle common to both open and closed systems are in order: adiabatic (no heat transfer) compression of the gas, constant-pressure heat addition to the gas, adiabatic expansion of the gas, and finally constant-pressure heat rejection to return the gas to its original conditions. If the compression and expansion of the gas are accomplished by turbomachinery, then the Brayton cycle can be termed the gas turbine cycle also.

In a gas turbine cycle, the turbine exhaust is nearly always appreciably hotter than the gas exiting the compressor. Obviously the amount of heat input to the cycle can be reduced by the use of a heat exchanger in which the hot turbine exhaust gas gives up heat to the relatively cool gas from the compressor. Gas turbine arrangements that have such heat exchangers are called regenerated or recuperated, as opposed to the simple cycle versions that do not. What distinguishes open from closed systems is the manner in which heat addition to -- and heat rejection from -- the Brayton cycles are accomplished.

In the open Brayton cycle, heat addition takes place in a combustor by burning the fuel in the working air stream, with the resultant products of combustion mixing with and becoming part of the working gas. Open Brayton cycle heat rejection is accomplished by discharging the low-pressure exhaust gas into the system surroundings and recharging the open Brayton cycle with ambient air. The closed Brayton cycle gas flow is not allowed to mix with the system surroundings; therefore heat addition and heat rejection must

be accomplished through heat exchangers: a high-temperature heater and a low-temperature cooler, respectively. The manner in which the general Brayton cycle analysis defines the pertinent component parameters and models practical open and closed gas turbine systems for performance comparisons are detailed in the two Description sections found later in this report.

The development of advanced gas turbines will rely, at least partially, on improvements in their component designs. How great will be the performance improvements of advanced gas turbines is also dependent on the candidate systems developed. There are many options for Brayton cycle component improvements that the gas turbine industry may consider<sup>1-3</sup>. The objective of this study is to present a basis for comparison of open and closed Brayton cycle systems that will approximate the performance of possible advanced gas turbine candidates.

To determine where open and closed Brayton systems for possible recuperated and simple cycle versions are competitive, a general performance analysis is developed. This analysis utilizes a universal Brayton cycle (for open and closed, simple and recuperated systems) flow schematic with the flexibility to model most gas turbine configurations (from single to multiple stages) to determine the performance effects of the important component parameters over ranges of feasible design values. The approach used to summarize the numerous gas turbine possibilities was to generate a detailed performance map for each type of Brayton system (open and closed). The maps present the performance results

---

<sup>1</sup>Superscripts refer to similarly numbered entries in the References at the end of the text.

over ranges of gas turbine pressure ratio ( $RC^*$ ), maximum turbine inlet temperature (TIT), and recuperator effectiveness ( $\epsilon_r$ ). These performance maps over ranges of  $RC$ , TIT and  $\epsilon_r$  present possible choices for the important gas turbine component parameters along with their tradeoff effects as their design limits are approached (as detailed in the Approach and Results sections of this report). The ability of the analysis to output performance values such as thermal cycle efficiency ( $\eta_{TH}$ ) and specific fuel consumption (SFC), over ranges of variable component parameters (such as  $RC$ , TIT, and  $\epsilon_r$ ), allows for selecting optimum values for design choices.<sup>4-5</sup> It is advantageous for one to select a system that uses the best component design values available for the material technology the particular application can utilize.<sup>6-7</sup> Furthermore, performance gains due to possible improvements in component technology<sup>8-12</sup> (e.g., higher values of  $\epsilon_r$  or TIT) can be approximated by this study, as shown in the Conclusions section of this report).

## DESCRIPTION OF UNIVERSAL BRAYTON CYCLE

### GENERAL BRAYTON CYCLE

Figure 1 is the basic thermodynamic (T-s) diagram for the general Brayton cycle.<sup>13,14</sup> This general Brayton cycle illustrates the state-points and processes common to both open and closed gas turbines for their recuperated and simple cycle versions. All the processes are irreversible, meaning that actual component pressure losses and turbomachinery inefficiencies are considered. The total gas flow,  $MC$ , is compressed from its lowest temperature,  $T_1$ , to a higher temperature and pressure state-point 2. The ideal process

---

\*Definitions of abbreviations appear on pages i and ii.

to achieve the pressure ratio ( $RC=P_2/P_1$ ) is the reversible adiabatic or isentropic compression. The actual compressor power needed is greater than the ideal by the reciprocal of the compressor efficiency ( $\eta_c$ ), where

$$\eta_c = \frac{\text{ideal compression power}}{\text{actual compressor power absorbed.}}$$

At the compressor exit, a small portion of the gas flow may be bled-off (MB) to supply turbine cooling, gas bearing, or other turbomachinery requirements, after which it returns to the cycle at the turbine exit, state-point 9.

The major portion of the gas flow follows a heat addition process from compressor exit to turbine inlet. During the initial part of the heat addition process, the gas temperature is raised from compressor exit temperature through intermediate temperatures which are still lower than the final turbine exhaust temperature,  $T_{9R}$ . Therefore, heat transfer is possible from the hot-side (turbine-exhaust-side) to the cold-side (compressor-exit-side) if an intermediate heat exchanger (recuperator) is included. Open and closed Brayton cycles with such intermediate heat exchangers are termed "recuperated cycles as opposed to the "simple cycle." Open and closed recuperated cycles have the performance advantage of utilizing heat from the turbine-exhaust-side that would otherwise have to be rejected. This heat transfer to the cycle heat addition process reclaims (or "regenerates") some of the cycle's waste heat, which in turn reduces the heat addition required externally to the cycle (from state-points 5 to 6). A reduction in external heat addition increases the cycle efficiency ( $\eta_{TH}$ ). This recuperation effect can be quantified by the heat exchanger performance parameter, called effectiveness  $\epsilon_r$ . Effectiveness is defined as the actual heat transferred divided by maximum heat

transfer possible between the temperature limits of the two flow streams.<sup>14,15</sup> Higher recuperated (effectiveness) open and closed Brayton cycles require less external heat addition than lower recuperated cycles and the simple Brayton cycle ( $\epsilon_r = 0$ ). Therefore, as  $\epsilon_r$  increases,  $\eta_{TH}$  increases with all other performance parameters ( $T_6$ ,  $\eta_c$ , RC, pressure losses,  $T_1$ ,  $\eta_T$ ) remaining fixed. Effectiveness is not the only cycle performance effect of the recuperator; the other main effect is the additional pressure loss (parameter  $\Delta P/P]_r$ ) it adds to the open or closed Brayton cycle.

The cold-side of the recuperator has a pressure loss (DLPHXH) that is larger than the pressure loss associated with the portion of the heater heat exchanger it replaces in the closed Brayton cycle, or the pressure loss associated with the portion of the heater combustor it replaces in the open Brayton cycle. There is also pressure loss (DLPHXL) associated with the hot-side of the recuperator for both open and closed Brayton cycles. These additional pressure losses (DLPHXH and DLPHXL) have a negative effect on the cycle performance ( $\eta_{TH}$ ) for any Brayton cycle, open or closed. Therefore, in performance comparisons for recuperated and simple cycles, considerations of the positive influence of effectiveness ( $\epsilon_r$ ) and the negative influence of additional pressure losses (DLPHXH and DLPHXL) must be made. The performance gains for increasingly higher values of effectiveness ( $\epsilon_r$ 's) should exceed the performance penalties of the associated higher recuperator pressure losses ( $\Delta P/P]_r$ 's, where  $\Delta P/P]_r = DLPHXH$  and  $DLPHXL$ ) for both open and closed Brayton systems (although the performance trade-offs for open and closed are different).

After internally transferring heat across a recuperator, if one is used, externally supplied heat addition (distinguished by a combustor in open cycles and a heater heat exchanger in closed cycles) raises the gas flow to its maximum cycle temperature, ( $T_6$ ), which is also taken to be turbine inlet temperature (TIT). There is an associated pressure loss (DLPB) for this external heat addition. The pressure ratio now available for open or closed Brayton turbine expansion ( $P_6/P_9$ ) has been reduced due to the pressure losses of the heat transfer components mentioned above. There is one additional pressure loss for the closed Brayton cycle cooler (DLPK) that must be accounted for in closed systems.

Part of the turbine expansion power is absorbed driving the compressor, which is shown in Figure 1, as process 6 to 8. The remaining turbine expansion (pressure ratio,  $P_8/P_9$ ) produces the net open or closed Brayton cycle power. The turbine gas flow (MT) may change during the expansion process if blade cooling and/or staging is used. The actual turbine expansion power is lower than the ideal process (isentropic expansion) power by the turbine efficiency ( $\eta_{TH}$ ), where

$$\eta_{TH} = \frac{\text{actual turbine power produced}}{\text{ideal expansion power.}}$$

Finally, heat rejection (state-points 10 to 1) returns the general (open and closed, recuperated or simple) Brayton cycle to its original state-point 1. Heat rejection in the open cycle is accomplished by discharging the low-pressure gas flow to the atmosphere. At state-point 1, the gas flow is recharged with ambient-temperature air from the atmosphere. Heat rejection in the closed cycle is accomplished by passing

the gas flow through a cooler until its temperature is returned to  $T_1$ .

#### FLOW SCHEMATIC WITH SYSTEM, COMPONENT AND ARRANGEMENT FLEXIBILITY

A flow schematic that models the Brayton cycle (Figure 1) for general mass flows is shown in Figure 2. This schematic is universal in that it can be used for closed or open Brayton systems by specifying cycle flow through a heat rejection cooler (denoted by the closed-loop component  $K$ ), or as exiting the open cycle at an ambient pressure exhaust. Common nomenclature can be used for both closed and open systems, since mass balances have been satisfied for all possible flowpaths. Two of the more important mass balances are: (1) for the closed Brayton cycle, fuel-flow ( $FG$ ) is not added to the gas-flow (this means for the closed cycle  $FG = 0$ ); and (2) the gas-flow that is compressed must equal the gas-flow that expands through the turbine plus any by-pass flow ( $MC = MPT + MB$ ) for either the closed or open Brayton systems. For the open cycle, the flow through the compressor turbine and power turbine stages is increased by the value of the fuel-flow ( $MCT + FG$  and  $MPT + FG$ , respectively). If there is any gas-flow addition between turbine stages, the turbine gas-flow must increase ( $MPT > MCT$ ). The turbine stages that provide compressor power ( $WCT$ , where  $WCT = WC/\eta_{GG}$ ) and those that produce net output power ( $SPHP$ ) may be physically separated into a compressor turbine component (denoted by  $CT$ ) and a power turbine component (denoted by  $PT$ ), or may be integrated into one turbine. If the open or closed Brayton system has an individual power turbine, it may be physically coupled to the compressor turbine (usually referred to as a single-shaft engine), or it may be decoupled from the other turbo-

machinery in a freepower turbine arrangement. This arrangement flexibility is shown in Figure 2 as dashed lines that represent a possible physically connected system. The flow schematic can model any of the above component arrangements by the selection of the proper set of numerical values for mass flows and component parameters.

As an example, for small-output-power Brayton engines, the turbine can be modeled as a single component with a single by-pass gas-flow, as in the case of the DTNSRDC Closed Brayton Laboratory Engine (CCPS 40-1).<sup>16</sup> When the true component design values were put into the flow model, the actual design performance of 31.0 percent was calculated.

The off-design efficiencies of specific gas turbines result from their off-design component parameters (such as  $\eta_c$ ,  $\eta_T$ , and  $RC$ ). There is a unique set of off-design component parameters for each case of part-power for a particular gas turbine. If the off-design component parameters are known, based on known values of part-power matchpoints, then their values can be put into the flow model and the off-design efficiencies for the particular gas turbine can be calculated. This approach was utilized by Bowen<sup>17</sup>, where the component efficiencies were assumed as a function of power. However, what is usually known is the performance characteristics of the individual components of the particular gas turbine, and each part-power case must be solved by finding the matchpoint common to all the components. Such off-design performance predictions of specific gas turbine engines have been developed by others, e.g., the well-known NEPCOMP method<sup>18</sup> for simple cycle engines and the recent extension to closed Brayton cycle engines by Knauss.<sup>19</sup>

Advanced open and closed Brayton engines would be  
PAS-78-15

expected to have multiple turbine stages with several by-pass gas-flow requirements. A general flow schematic for advanced open and closed systems would use separate turbine components for modeling turbine staging with the effect of by-pass flows included. Figure 2, with its complete set of gas-flows and components, can be used to generally model advanced open and closed Brayton systems. Potential performance improvements, for either open or closed systems, will be the results of improved component performances. As discussed above, major cycle performance improvements are possible for higher effectiveness recuperators if the heat exchanger temperatures can be tolerated. Likewise, performance improvements are possible for higher maximum temperature cycles (for both simple and recuperated). It may be simpler to increase the maximum turbine inlet temperature than to increase recuperator effectiveness, or vice versa, as the design limits of one or the other are approached. These component performance trade-offs change at different values of both  $\epsilon_r$  and TIT in both open and closed Brayton systems, although again these parametric effects are dependent on the type of system (open or closed). By having a general flow schematic (Figure 2) that can model both open and closed Brayton systems over ranges of effectiveness and turbine inlet temperatures, performance trade-offs due to these component parameters can be examined for open and closed systems and comparisons between the types of Brayton systems can be made. The description of how the component design values were selected and analyzed by a general Brayton cycle program, and the approach used to generate performance trade-offs, follow in the next two sections.

## DESCRIPTION OF BRAYTON CYCLE PROGRAM

### INPUT FOR BRAYTON CYCLE ANALYSIS

To be able to compare open and closed Brayton systems for their current state of the art to possible advanced versions, it is necessary to choose values for the component parameters that can remain constant over ranges of pressure ratio (RC), maximum turbine inlet temperature (TIT), and recuperator effectiveness ( $\epsilon_r$ ). Values for these component efficiencies and pressure drops, as well as typical turbomachine flowratios, are given in Table 1. Since the burner efficiency ( $\eta_B$ ) for the open cycle is synonymous to the combustor efficiency and does not include a heat exchanger efficiency (as does the closed cycle burner efficiency),  $\eta_B$  is three points higher for open cycle systems compared to closed cycle systems. The other component parameter that is different for the closed and open systems is the additional pressure drop DLPK the closed cycle must have for a cooler. It should be noted that since the effectiveness of state-of-the-art coolers is generally so high ( $\approx 1.0$ ), the compressor inlet temperature (CIT) for the closed cycle can be considered equivalent to that of the open cycle.

The only other fixed inputs for the open and closed Brayton cycle analysis are the working fluid properties. It is possible to use numerous gases in closed Brayton cycles, such as the inert gases argon, helium, etc. However, component performance (turbomachinery efficiencies and pressure losses) are thermodynamically and fluid mechanically dependent on the properties of each particular working gas. The ability to compare the performance ( $\eta_{TH}$ ) of open and closed Brayton cycles as thermodynamically related to the amount of

recuperation ( $\epsilon_r$ ) or the maximum turbine inlet temperature (TIT), for ranges of their feasible design values, requires using the same working gas, air. Any differences in the performance ( $\eta_{TH}$ ) of open and closed Brayton engines for their recuperated or simple cycles would, therefore, be related to differences in their physical component parameters (i.e.,  $\Delta P/P|_r$  for equivalent  $\epsilon_r$ , as explained below) and not to differences in fluid properties due to different gases. It was not within the scope of this study to consider the physical effects on turbomachinery and recuperators that different closed cycle working fluids would have. Cycle temperature effects on air properties were considered as given in Table 2.

The remaining input parameter for the Brayton cycles, recuperator pressure drop ( $\Delta P/P|_r$ ), must be varied over the range of recuperator effectiveness ( $\epsilon_r$ ) for both open and closed systems. A common design approach for heat exchangers is the NTU (number of transfer units) method.<sup>20</sup> A relationship to determine the NTU performance as a function of pressure drop has been derived by Aronson<sup>21</sup> for compact heat exchangers. This function can be described as

$$NTU = f_1(\Delta P/P|_r).$$

The performance can be related to the more classical performance of effectiveness when the heat exchanger geometry is considered,

$$\epsilon_r = f_2(NTU, \text{geometry}).$$

This relationship has been extensively examined in texts such as Kays and London.<sup>22</sup> For a fixed geometry heat exchanger (recuperator), the curve shape,  $\epsilon_r = f_2(NTU)$ , has been derived. Using the approach as referenced above, a

relationship for  $\epsilon_r = f_3 (\Delta P/P)_r$  can be found. Typical recuperator performance results are given in Figure 3.

Pressure losses  $(\Delta P/P)_r$  are lower in the closed recuperators (dashed line) than in the open recuperators (solid line). This can be explained by differences in their flow conditions at an equivalent open and closed recuperator performance rating ( $\epsilon_r$ ). Recuperator pressure loss  $(\Delta P/P)_r$  has a direct relationship to its physical geometry and the velocity of the gas flow passing through it. Also, recuperator performance ( $\epsilon_r$ ) is related to its physical geometry and to its NTU rating as explained above (and in Kays and London).<sup>22</sup> NTU rating is further related to gas flow.<sup>20</sup> Therefore, for open and closed recuperators with equivalent physical geometry and performance ( $\epsilon_r$ ) and equivalent gas flow rates, any difference in pressure loss  $(\Delta P/P)_r$  is due only to a difference in gas flow velocity. Gas flow velocity will be lower in the closed recuperator than in the open recuperator because of the advantage of pressurizing the closed Brayton cycle gas flow. Therefore, a closed cycle recuperator with equivalent physical geometry, performance ( $\epsilon_r$ ), and gas flow as an open cycle recuperator, will have a lower pressure loss  $(\Delta P/P)_r$  than the open cycle recuperator due to the lower closed cycle flow velocity. The lower pressure loss  $(\Delta P/P)_r$  for the closed recuperator can be seen in Figure 3. It is interesting to note that since Kays and London's recuperator performance ( $\epsilon_r$ ) curves<sup>22</sup> approach the value of 1.0 as the values of NTU approach infinity, and NTU is directly related to recuperator pressure loss  $(\Delta P/P)_r$ , the recuperator curves of Figure 3 would approach infinite values of  $\Delta P/P)_r$  at  $\epsilon_r = 1.0$ . Open and closed recuperated Brayton cycles can tolerate only reasonable values of pressure loss  $(\Delta P/P)_r$  before the recuperator pressure loss  $(\Delta P/P)_r$  becomes disproportionately large compared to other component

pressure losses (i.e., DLPB). Therefore,  $(\Delta P/P)_r$  for both open and closed recuperators was limited to 6 percent as a reasonable maximum value with regard to the other Brayton cycle pressure losses, as discussed above.

#### CALCULATION OF BRAYTON CYCLE PERFORMANCE

The overall energy conversion performance of a thermal cycle is usually quantified as the net output power (i.e., shaft) produced for the thermal input power required. The dimensionless conversion ratio of output divided by input is defined as thermal cycle efficiency ( $\eta_{TH}$ ).  $\eta_{TH}$  is not dependent on the absolute magnitude of the output and the input, but is solely dependent on the degree to which the cycle converts the input into the output. To emphasize the fuel required to supply the thermal cycle input for a net output, the conversion ratio of fuel energy divided by output energy yields the performance quantity called specific fuel consumption (SFC). SFC is numerically dependent on the system of units used but, (as with  $\eta_{TH}$ ), is independent of the magnitudes of the cycle output.  $\eta_{TH}$  and SFC are simply dimensionally different forms to express the same degree to which the cycle performs the overall energy conversion. To be independent of the absolute magnitudes of energies converted, both  $\eta_{TH}$  and SFC are independent of the rate with which the conversion occurs. The rate of energy conversion for a thermal cycle (open or closed) is directly dependent on the flow rate of its working fluid, which in turn is related to the absolute physical size of the components. Therefore,  $\eta_{TH}$  and SFC are independent of the cycle flow rate and its relationship to system physical size. Working fluid energies produce or absorb work in the turbomachinery. If the absolute flow rate is used in component performance calculations, then the rate of these

energy conversions, or cycle absolute powers, are calculated. If equivalent size components are used, then component performance may be calculated on a unit-flow-rate basis. Therefore, component powers may be calculated on an absolute or unit basis depending on a similar choice of flow rates; however, the overall cycle performance ( $\eta_{TH}$  or SFC) is independent of the flow rate choice, as mentioned above. Open or closed Brayton cycle performance is calculated by the computer subroutine listed in Appendix A. Component parametric values are put into the appropriate variables in the equations. The equations contain flowrate terms, so that absolute or per unit-flow powers (for WC, WCT and SPHP) can be calculated. Therefore, the subroutine can output either type of turbomachinery powers by inputting either absolute or unit flow rates (for MC, MCT, and MPT + FG, respectively). For example, net output power, SPHP, can be calculated in either absolute units (hp) for the parametric units in the equation, or as a specific value (hp/lb/sec) by inputting MPT and FG as either absolute flow rates (lb/sec) or as flow ratios of MC (lb/sec/lb/sec), respectively.

#### BRAYTON CYCLE PERFORMANCE OUTPUT

The performance of any Brayton cycle (open or closed) is usually quantified in terms of its temperature-and-pressure state-points and the output quantities defined above (i.e.,  $\eta_{TH}$ , SFC, SPHP, etc.). Some of the open and closed Brayton cycle state-points are specified by the physical and material limits of their components (such as TIT and RIT), while other state-points are the results of the performance of the cycles. By using the general component parameters discussed above and utilizing the subroutine of Appendix A, open and closed Brayton cycle performance over ranges of pressure ratio (RC), maximum turbine inlet temperature (TIT), and recuperator effectiveness ( $\epsilon_r$ ) are calculated. These performance values

in the output listing are specific fuel consumption (SFC), thermal efficiency ( $\eta_{TH}$ ), specific horsepower (SPHP) and fuel-air (working fluid) ratio. For each case of recuperator effectiveness ( $\epsilon_r$ ) with a specified turbine inlet temperature (TIT), there is a range of compressor pressure ratios that result in open or closed Brayton cycles with output power. Therefore, the open and closed Brayton analysis calculates the output performance over a range of practical pressure ratios for each case of recuperation and turbine inlet temperature. Figure 4 is an example of the output performance for a possible case of TIT and  $\epsilon_r$  over a range of RC. In the example given (Figure 4), the value of RC = 3.00 would give the "optimum" or highest output thermal efficiency ( $\eta_{TH} = 0.422$ ) for the case of TIT and  $\epsilon_r$  given. By analyzing many cases of  $\epsilon_r$  and TIT, the performance effects of the design parameters can be generated and the output compared for many possible Brayton cycles (open or closed). An approach to analyze open and closed Brayton cycle performance over possible ranges of the important component parameters is discussed in the next section.

#### APPROACH

To compare the performance of recuperated and simple Brayton cycles for open and closed systems, it is necessary to optimize the selection of certain component parameters, and to examine the effects on performance that variable design parameters have over reasonable ranges of their values. An approach to analyzing the many possible choices for either open or closed Brayton systems is to summarize the performance of numerous cycles in a design point performance map. Such maps present the performance output as the results of the more important component design parameters. As discussed above, open or closed Brayton cycle performance increases with increasing TIT and increasing values of recuperation (once

the pressure loss effects are exceeded). Therefore, performance maps (of open and closed Brayton cycles) for ranges of TIT and  $\epsilon_r$  would present possible choices of these important component parameters and would compare their trade-offs when their design limits are approached.

For each case of recuperation analyzed, cycle thermal efficiency ( $\eta_{TH}$ ) can be plotted as a function of TIT and RC. Figure 5 illustrates this cycle behavior approximately for simple Brayton cycles ( $\epsilon_r = 0$ ). It can be seen from Figure 5 that for each value of TIT there is a value for RC that gives a higher value of  $\eta_{TH}$  than any other RC and the same TIT. Hence, for every TIT there is an optimum choice for compressor pressure ratio ( $RC_{OPT}$ , shown as the solid line in Figure 5). The optimum value of pressure ratio ( $RC_{OPT}$ ) for each combination of  $\epsilon_r$  and TIT can be found in the computational output listing. The complete design point performance map can be generated from these optimum combinations of RC for TIT and  $\epsilon_r$  values, as illustrated in Figure 6.

With a detailed performance map for each type of Brayton system (open or closed), comparisons of the effects of recuperation ( $\epsilon_r$ ) and maximum turbine inlet temperature (TIT) can be made. In addition, the open and closed Brayton systems can be compared at important parameter design choices to see if their performance is competitive. These detailed performance maps for open and closed Brayton cycles are presented in the next section.

## RESULTS

As discussed in previous sections, performance maps summarize the results of each type of Brayton system (open and closed). Figures 7 and 8 present the performance maps of open and closed Brayton cycles, respectively. These figures plot

the resultant Brayton cycle efficiency ( $\eta_{TH}$ ) over ranges of the following important component design-point parameters: maximum turbine inlet temperature (TIT), recuperator effectiveness ( $\epsilon_r$ ), and optimum compressor pressure ratio ( $RC_{OPT}$ ).

As can be seen in Figures 7 and 8, the performance ( $\eta_{TH}$ ) gains for increasingly higher values of effectiveness (due to the reduction in heat input to the open or closed Brayton cycle) do exceed the performance penalties of their associated pressure losses. For the open and closed Brayton systems (Figures 7 and 8, respectively), this performance tradeoff occurs at an effectiveness ( $\epsilon_r$ ) of approximately 0.60, with the performance advantage of recuperation becoming increasingly greater over the effectiveness range of  $0.60 < \epsilon_r < 0.95$ . For current technology the performance improvement of recuperation in the open or closed Brayton cycle over the simple cycle is about + 8 points in  $\eta_{TH}$  (for  $\epsilon_r = 0.90$ ). This comparison holds over a reasonable range of turbine inlet temperature of 1400 degrees F (760 degrees C) < TIT < 2200 degrees F (1205 degrees C). The performance pay-off for increasing the amount of recuperation above  $\epsilon_r = 0.90$  is about 1/2 point in thermal cycle efficiency for each one point in effectiveness. This performance effect can be expressed as the recuperation influence factor

$$\frac{\eta_{TH}}{\epsilon_r} \approx \frac{0.5 \text{ point}}{1 \text{ point}}$$

(for the ranges of  $0.85 < \epsilon_r < 0.95$  and 1400 degrees F (760 degrees C) < TIT < 2200 degrees F (1205 degrees C) in Figures 7 and 8) These results show quantitatively that the open or closed Brayton cycle performance ( $\eta_{TH}$ ) effect of recuperation increases rapidly at high values of effectiveness (as does recuperator size). (It took a 90 point increase in  $\epsilon_r$  (from 0.00 to 0.90) to get an 8-point gain in  $\eta_{TH}$ , but then only a 10-point increase in  $\epsilon_r$  (from 0.85 to 0.95) to get a 5-point gain in  $\eta_{TH}$ ).

Since higher values of  $\eta_{TH}$  can be achieved with higher values of  $\epsilon_r$  at constant TIT's; the corollary also holds that for constant values of  $\eta_{TH}$ , lower values of TIT can be used with higher values of  $\epsilon_r$ . An example of this, in Figure 7, is that for a constant value of  $\eta_{TH} = 35$  percent, the required turbine inlet temperature with  $\epsilon_r = 0.90$  is TIT = 1325 degrees F (720 degrees C) which is 400 degrees F (220 degrees C) lower than the required turbine inlet temperature with  $\epsilon_r = 0.00$  of TIT = 1725 degrees F (940 degrees C). This reduction in TIT (for recuperated compared to the simple cycle) of approximately 400 degrees F (220 degrees C) holds for design cases of thermal cycle efficiency over the range of 30 percent  $\leq \eta_{TH} \leq 45$  percent for both open and closed systems.

The performance trade-offs when comparing recuperated to simple Brayton systems are, therefore, considerations of possible  $\eta_{TH}$  improvements if TIT can be maintained constant (over the range of  $\epsilon_r$ ), or the possible reductions in required TIT to maintain a constant  $\eta_{TH}$  in recuperated open or closed Brayton cycles.

When selecting the component parameters for a gas turbine engine, the open or closed Brayton cycle conditions must be compared to the limiting material capabilities. Material technology dictates not only the maximum turbine inlet temperature (TIT), but also the maximum recuperator inlet temperature (RIT) if the open or closed Brayton cycle is recuperated. Therefore, values for RIT are given in the performance maps (Figures 7 and 8) so that the material technology needed can be determined. For high values of TIT and  $\epsilon_r$ , recuperator inlet temperatures range from 1200 degrees F (650 degrees C) to 1600 degrees F (870 degrees C), see Figures 7 and 8. McDonald and others<sup>23-26</sup> have surveyed recuperator technology over possible gas turbine performance ranges. It is suggested

that stainless steel recuperators can be used in advanced gas turbine applications for RIT's of 1200 degrees F (650 degrees C) to 1400 degrees F (760 degrees C), after which superalloy recuperators could be used to a maximum RIT of approximately 1800 degrees F (980 degrees C). Usually, marine gas turbine materials are limited to 1600 degrees F (870 degrees C) for uncooled parts <sup>27</sup> to avoid sulfidation corrosion. Therefore, in marine applications the maximum RIT should be limited to 1600 degrees F (870 degrees C).

As discussed above, with a detailed performance map for both types of Brayton systems (open and closed, Figures 7 and 8, respectively) possible candidates, specified by the design performance ( $\eta_{TH}$ ) required, can be compared for competitiveness. The performances of open and closed systems will differ due to differences in their component parameters. Open Brayton systems have two performance advantages that closed Brayton systems do not have. As discussed above, these advantages are a higher heater efficiency ( $\eta_B$ ) and fuel flow addition to the working fluid for the open cycle (see Figure 2). Closed Brayton recuperated systems have the performance advantage of lower pressure losses ( $\Delta P/P_r$ ) in the recuperator. The Figures 7 and 8 performance maps show where the advantages of one type of system are greater than the advantages of the other. The required TIT and  $\epsilon_r$  values of different systems can be compared to determine if they are competitive. As an example, to obtain a performance of  $\eta_{TH} = 40$  percent, open and closed candidate systems can be found in Figures 7 and 8. Up to an effectiveness ( $\epsilon_r$ ) of 0.85 the open Brayton systems have lower required TIT's than closed systems (e.g., 1650 degrees F (900 degrees C) compared to 1750 degrees F (955 degrees C) at  $\epsilon_r = 0.85$ ). For highly recuperated cycles, the open and closed systems have competitive TIT's of about 1620 degrees F (880 degrees C) at  $\epsilon_r = 0.90$  and 1480 degrees F (805 degrees C) at  $\epsilon_r = 0.95$ . Other design efficiencies ( $\eta_{TH}$ 's) can be

compared similarly by Figures 7 and 8, for whatever performance the particular application requires.

## CONCLUSIONS

It is advantageous to select an open or closed Brayton system that uses a combination of performance improvements and satisfactory component temperature and size requirements for the particular application. Figures 7 and 8 approximate the design performances of possible open and closed Brayton systems for the component technology that one may want to consider.

Furthermore, the performance gains due to possible improvements in component technology (e.g. higher values of TIT or  $\epsilon_r$ ) can be approximated. By examining the performance maps (Figures 7 and 8) for the particular design constraints, the performance pay-offs of possible candidate Brayton systems (open and closed) can rapidly be compared. These performance improvements can be quantified as approximately an increase of +8 points in  $\eta_{TH}$  or as a reduction of 400 degrees F (220 degrees C) in required TIT for recuperated open or closed Brayton cycles compared to simple cycles, or as other design trade-offs as discussed above. Up to an effectiveness ( $\epsilon_r$ ) of 0.85, the open Brayton systems have lower required turbine inlet temperatures (TIT's) to achieve the same cycle efficiencies ( $\eta_{TH}$ 's) as the closed Brayton systems. For highly recuperated cycles ( $0.90 < \epsilon_r < 0.95$ ), the open and closed systems have competitive TIT's for competitive  $\eta_{TH}$ 's.

In addition to being able to make performance comparisons of general open or closed Brayton cycle systems, the analysis developed can model any unique gas turbine

candidate whose design values are defined in typical component parameters. The ability of the analysis to calculate open or closed Brayton cycle performance values over selected ranges of variable design point parameters (such as RC,  $\epsilon_r$ , and TIT) allows for the optimization of these design point parameters.

## REFERENCES

1. Tanabe, K. and R. Okugawa, "Evaluation of Improved Gas Turbine Cycles for Marine Application of an Aircraft Derivative Gas Turbine," ASME Paper No. 76-GT-114 (Jan 1976).
2. McDonald, C. F., "The Role of the Recuperator in High Performance Gas Turbine applications," ASME Paper No. 78-GT-46 (1978).
3. Kydd, P. H. and W. H. Day, "An Ultra High Temperature Turbine for Maximum Performance and Fuels Flexibility," ASME Paper No. 75-GT-81 (Dec 1974).
4. Ushiyama, I. J. and N. Marsumoto, "Approximately Calculating Optimum Pressure Ratios for Various Gas Turbine Cycles," ASME Paper No. 76-GT-21 (Dec 1975).
5. Conkol, Gary and Trilochan Singh, "An Optimizing Design Point Program for Selection of a Gas Turbine Cycle," ASME Paper No. 77-GT-108 (Dec 1976).
6. Kuo, S.C. and H. T. Shu, "Alternative Closed-Cycle Gas Turbine Design Considerations for Ship Propulsion Applications," ASME Paper No. 78-GT-18 (1978).
7. McDonald, C. F., J. C. Bass, and Hans H. Amtmann, "Primary System Design Studies for Advanced Direct Cycle Nuclear Gas Turbine Plant," ASME Paper No. 77-GT-25 (Dec 1976).
8. McDonald, C. F., "The Closed-Cycle Gas Turbine - Present and Future Prospectives for Fossil and Nuclear Heat Sources," ASME Paper No. 78-GT-102 (1978).
9. Bammert, K., J. Rurik and H. Griepentrog, "Highlights and Future Development of Closed-Cycle Gas Turbines," ASME Paper No. 74-GT-7 (Nov 1973).
10. Bammert, K. and G. Groschup, "Status Report on the Closed Cycle Gas Turbines in the Federal Republic of Germany," ASME Paper No. 76-GT-54 (Dec 1975).

11. Armstrong, C. H., "Effect of Recent Advancements in Gas Turbine Technology on Combined-Cycle Efficiency," ASME Paper No. 74-Pwr-8 (Jun 1974).
12. "Closed Brayton Laboratory Engine Upgrade Study," Rept No. 75311511, AiResearch Manufacturing Company of Arizona, Phoenix, Arizona (Oct 1975).
13. Jones, J. B. and G. Hawkins, Engineering Thermodynamics New York: Wiley (1960).
14. El-Wakil, M. M., Nuclear Power Engineering, New York: McGraw-Hill (1962).
15. Dusinberre, G. M. and J. C. Lester, Gas Turbine Power, Scranton, Pa: International Textbook Co. (1958)
16. Duvall, G. D., "Operational Evaluation of a Closed Brayton Cycle Laboratory Engine," Paper 769029 Presented at 11th IECEC Meeting, Lake Tahoe, Nev., Sept. 12-17, 1976.
17. Bowen, T. L., "Gas Turbine Simulation Technique for Ship Propulsion Dynamics and Control Studies," Presented at the 5th Ship Control Systems Symposium, 30 Oct - 3 Nov 1978 U.S. Naval Academy, Annapolis, MD.
18. Caddy, M. J., and S. R. Shapiro, "NEPCOMP - The Navy Engine Performance Computer Program, Version I," NADC Rept NADC-74045-30 (Apr 1975).
19. Knauss, D. T., "A Method of Predicting the Off-Design Performance of Closed Brayton Cycle Engines," DTNSRDC Rept PAS-77-42 (May 1978).
20. Parker, J. D., J. H. Boggs and E. F. Blick, Introduction to Fluid Mechanics and Heat Transfer, Reading, Mass: Addison-Wesley (1969).
21. Aronson, D., "Design of Regenerators for Gas Turbine Service," ASME Paper No. 49-A-144 (1949).
22. Kays, W. M., and A. L. London, Compact Heat Exchangers, New York: McGraw-Hill (1955).
23. McDonald, C. F., "Gas Turbine Recuperator Technology Advancements," ASME Paper No. 72-GT-32 (1972).
24. Fraas, A. P., "Heat Exchangers for High Temperature

Thermodynamic Cycles," ASME Paper No. 75-WA/HT-102  
(Aug 1975).

25. McDonald, C. F., "Recuperator Development Trends for Future High Temperature Gas Turbines," ASME Paper No. 75-GT-50 (Dec 1974).
26. McDonald, C. F., T. Van Hagan, K. Vepa, "Heat Exchanger Design Considerations for Gas Turbine HTGR Power Plant," ASME Paper No. 76-GT-53 (Dec 1975).
27. Lee, S. Y. and W. E. Young, "Gas Turbine Hot-Stage Parts in Aggressive Atmospheres," ASME Paper No. 75-WA/CD-1 (Jul 1975).

Table 1 Component Input for Open and Closed Brayton Cycle Analysis

Parameter	Notation	Value	
		Open	Closed
Compressor efficiency	$\eta_c$	0.85	0.85
Turbine efficiency	$\eta_T$	0.90	0.90
Gas generator efficiency	$\eta_{GG}$	0.99	0.99
Burner efficiency	$\eta_B$	0.98	0.95
Pressure drop for burner	DLPB	0.03	0.03
Pressure drop for cooler	DLPK	-	0.001
Bleed gas flow	MB	0.01	0.01
Compressor turbine gas flow	MCT	0.97	0.97
Power turbine gas flow	MPT	0.99	0.99
Compressor inlet temperature	CIT	70°F (21°C)	70°F (21°C)

Table 2. Cycle Temperature Effects on Air Properties

Parameter	Notation	Value
Constant-pressure specific heat through compressor	CPC	0.240 $\frac{\text{Btu}}{\text{lb-}^\circ\text{R}}$ (1000 $\frac{\text{J}}{\text{kg-}^\circ\text{K}}$ )
Ratio of specific heats through compressor	$\gamma_c$	1.400
Constant-pressure specific heat through turbine	CPT	0.274 $\frac{\text{Btu}}{\text{lb-}^\circ\text{R}}$ (1050 $\frac{\text{J}}{\text{kg-}^\circ\text{K}}$ )
Ratio of specific heats through turbine	$\gamma_T$	1.330

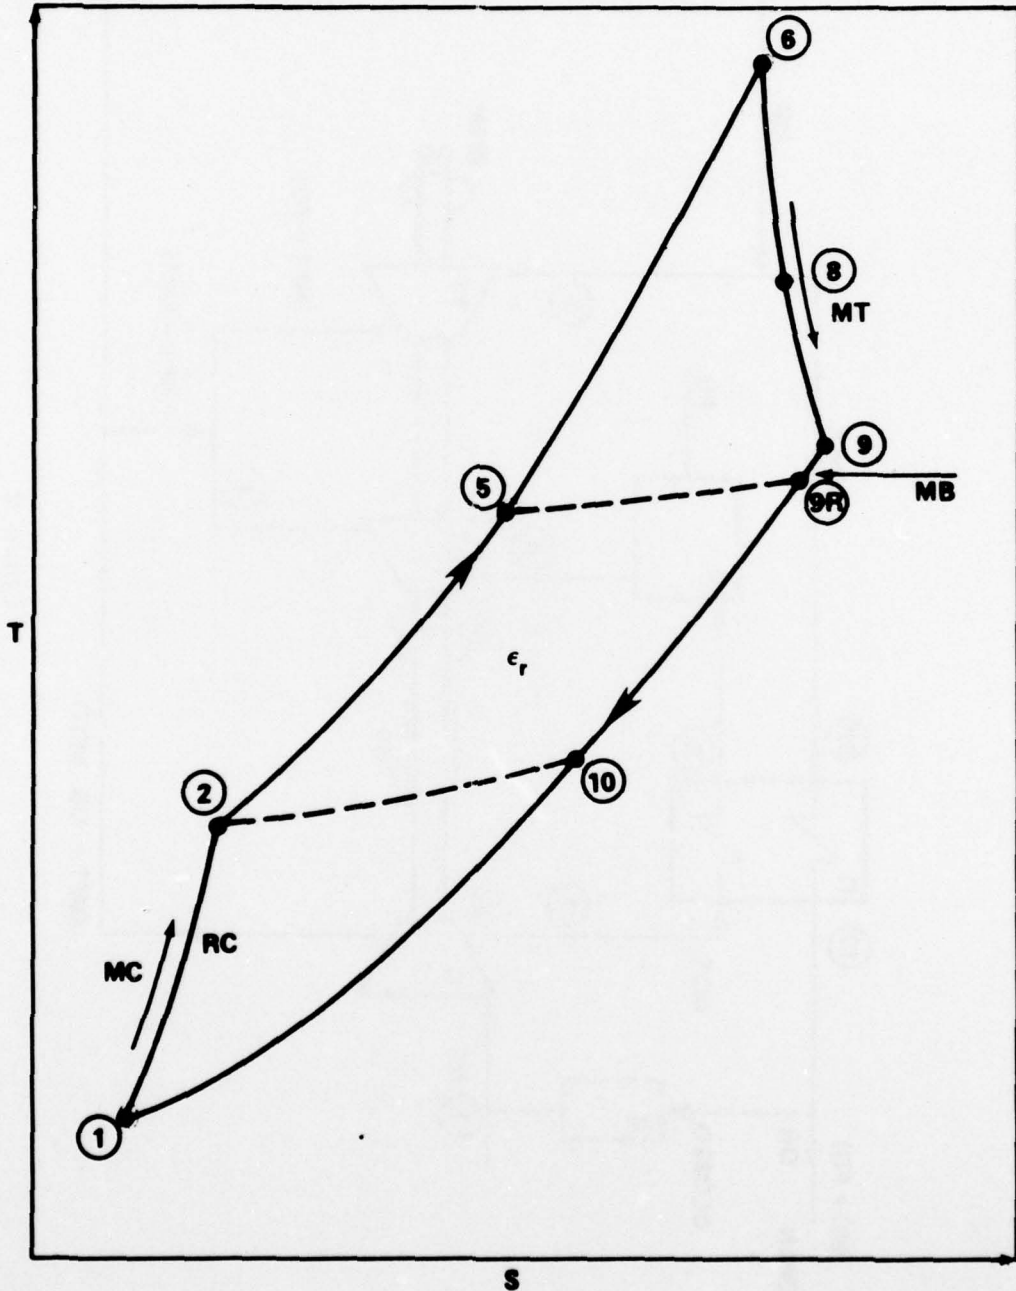


Figure 1  
General Brayton Cycle Diagram

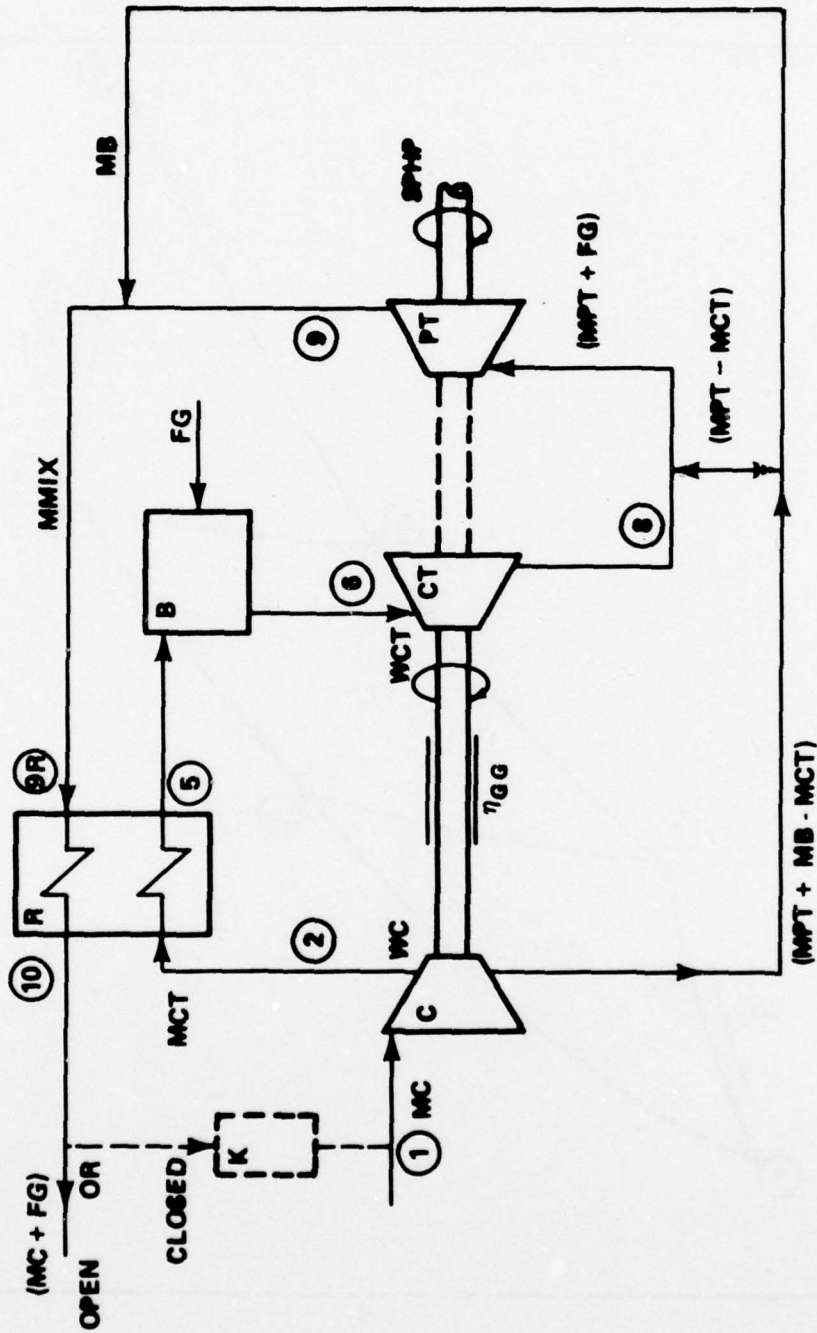


Figure 2  
Universal Brayton Cycle Flow Model

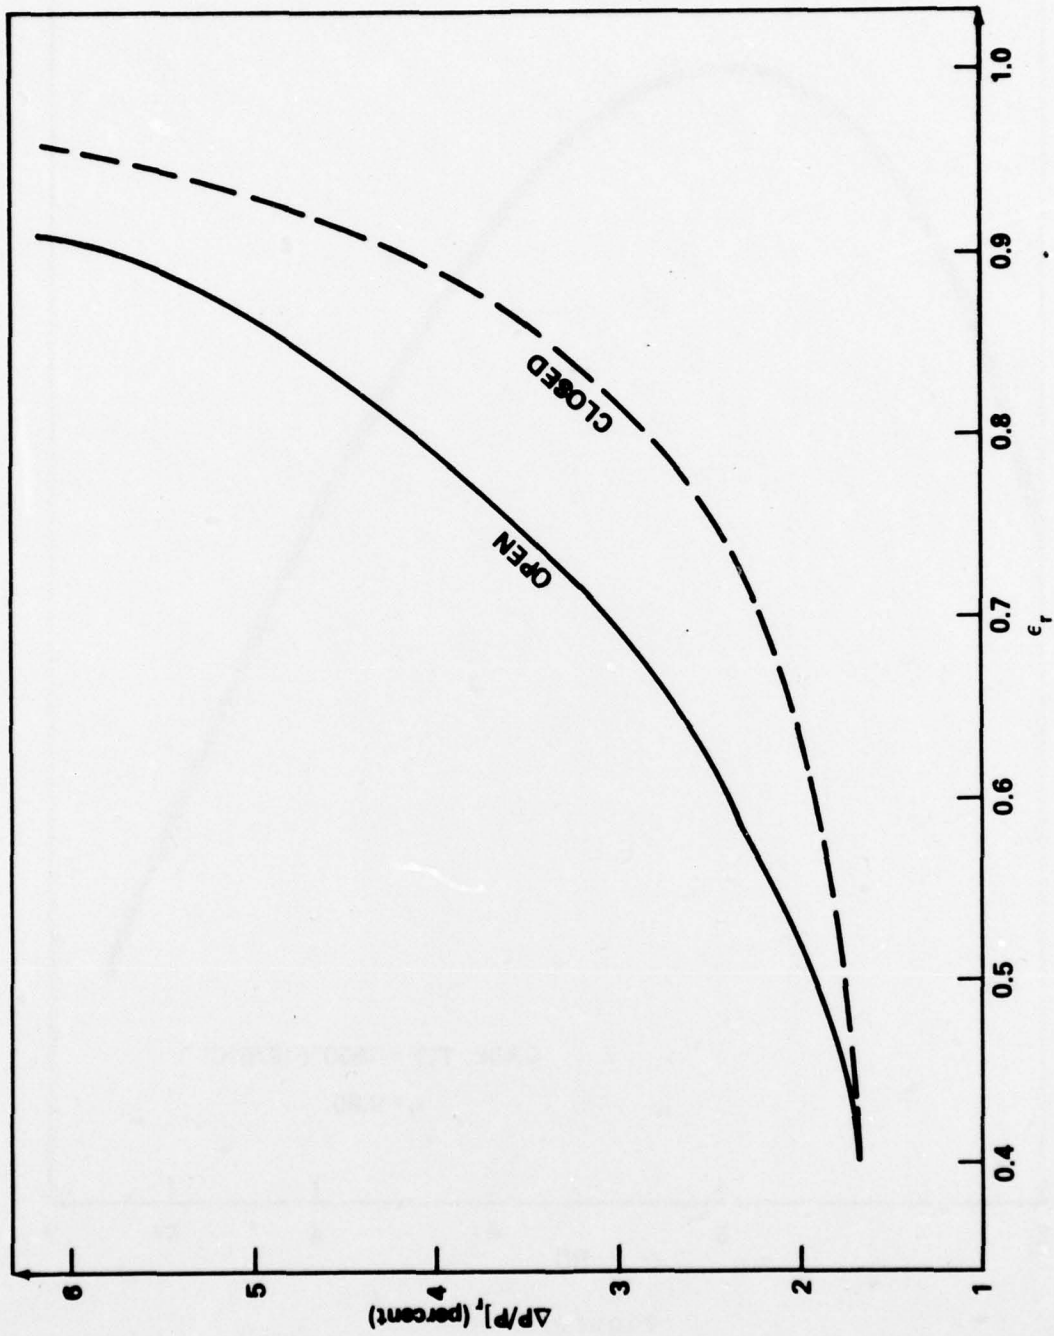


Figure 3  
 Recuperator Pressure Loss  $\Delta P/P_r$  vs Effectiveness  
 $\epsilon_r$  for Open and Closed Brayton Systems

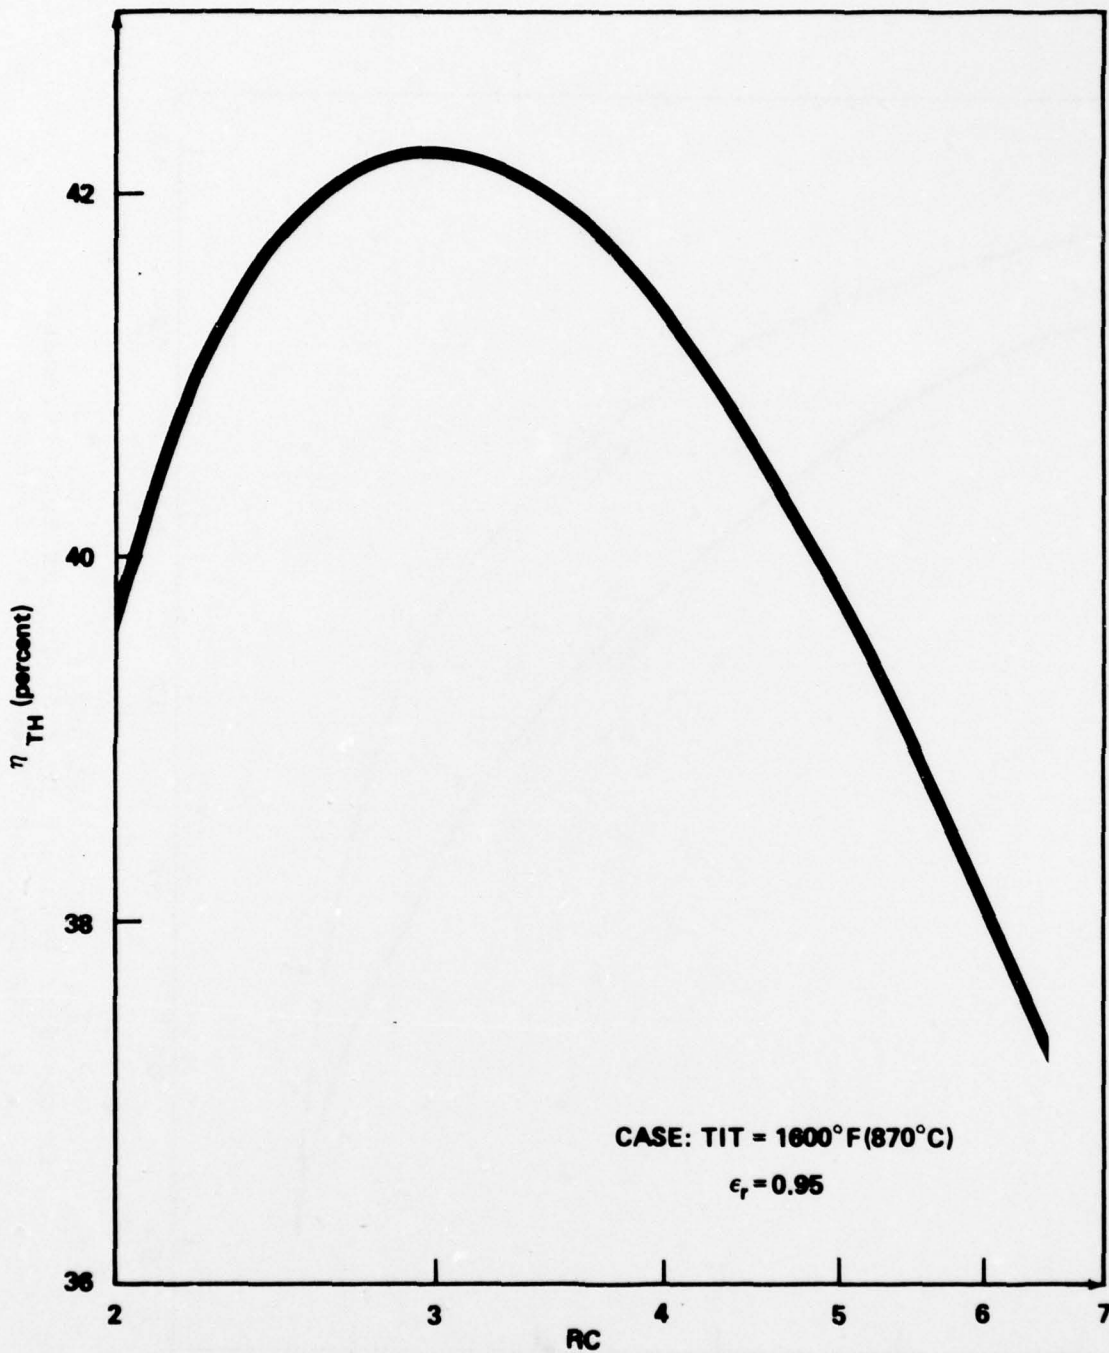


Figure 4  
 Example of Brayton Cycle Efficiency  $\eta_{TH}$  over a  
 Possible Range of Compressor Pressure Ratio RC

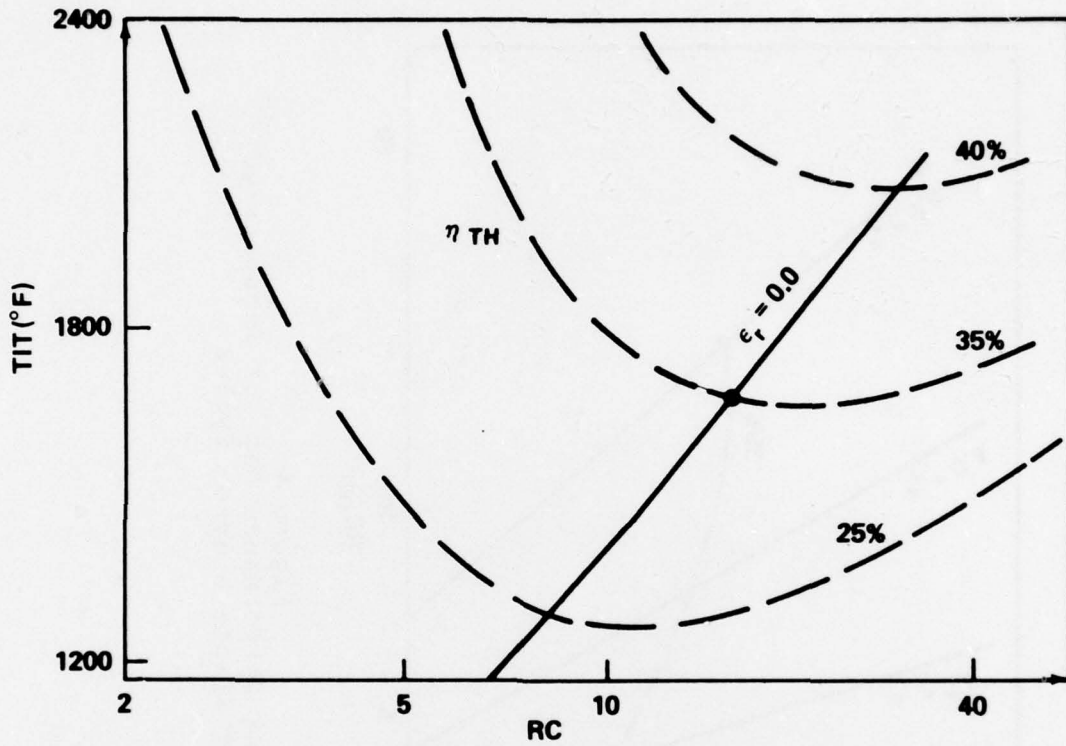


Figure 5  
 Thermal Efficiency  $\eta_{TH}$  as a Function of Turbine  
 Inlet Temperature TIT and Compressor  
 Pressure Ratio RC

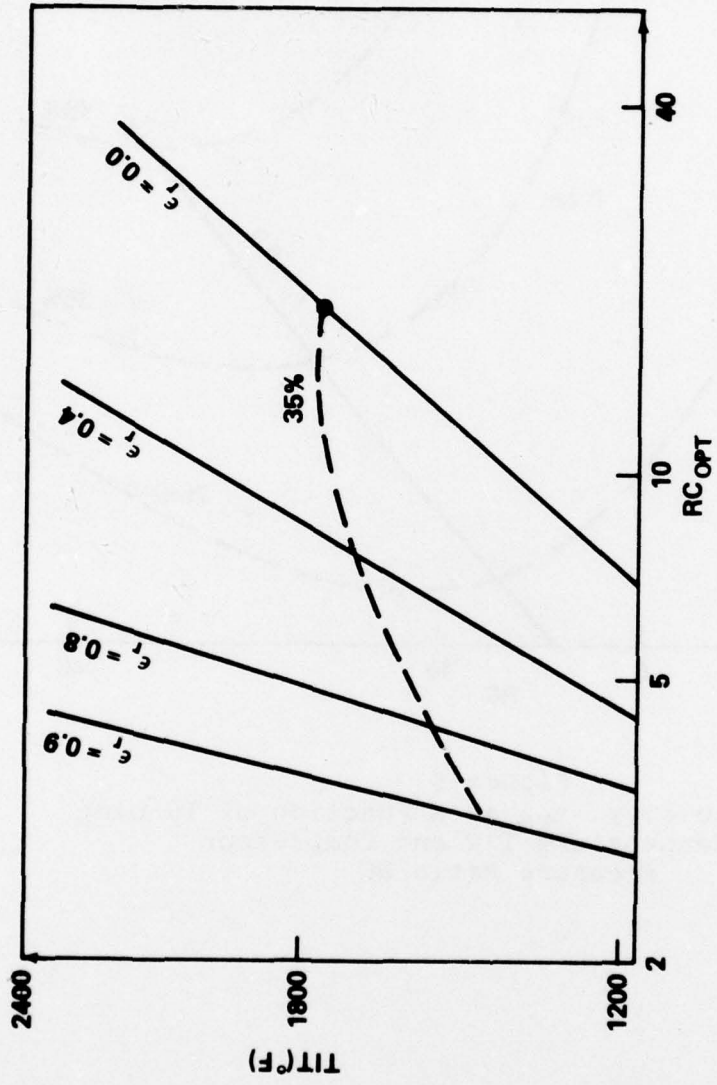


Figure 6  
Design Point Performance Map for Recuperated  
and Simple Brayton Cycles

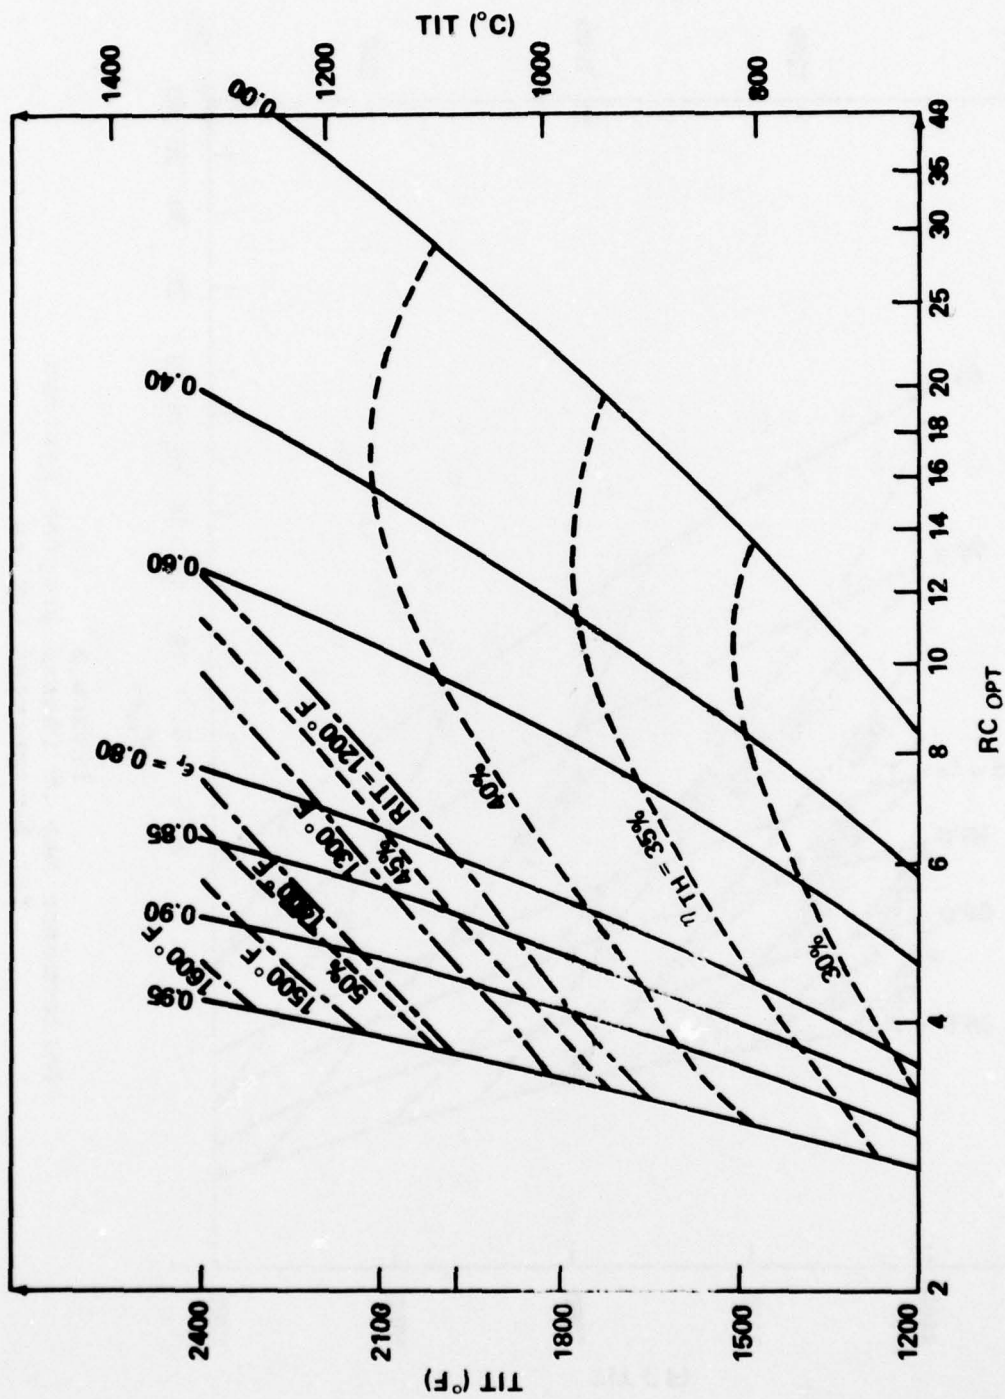


Figure 7  
 Performance Map of Open Brayton Systems for  
 Recuperated and Simple Cycles

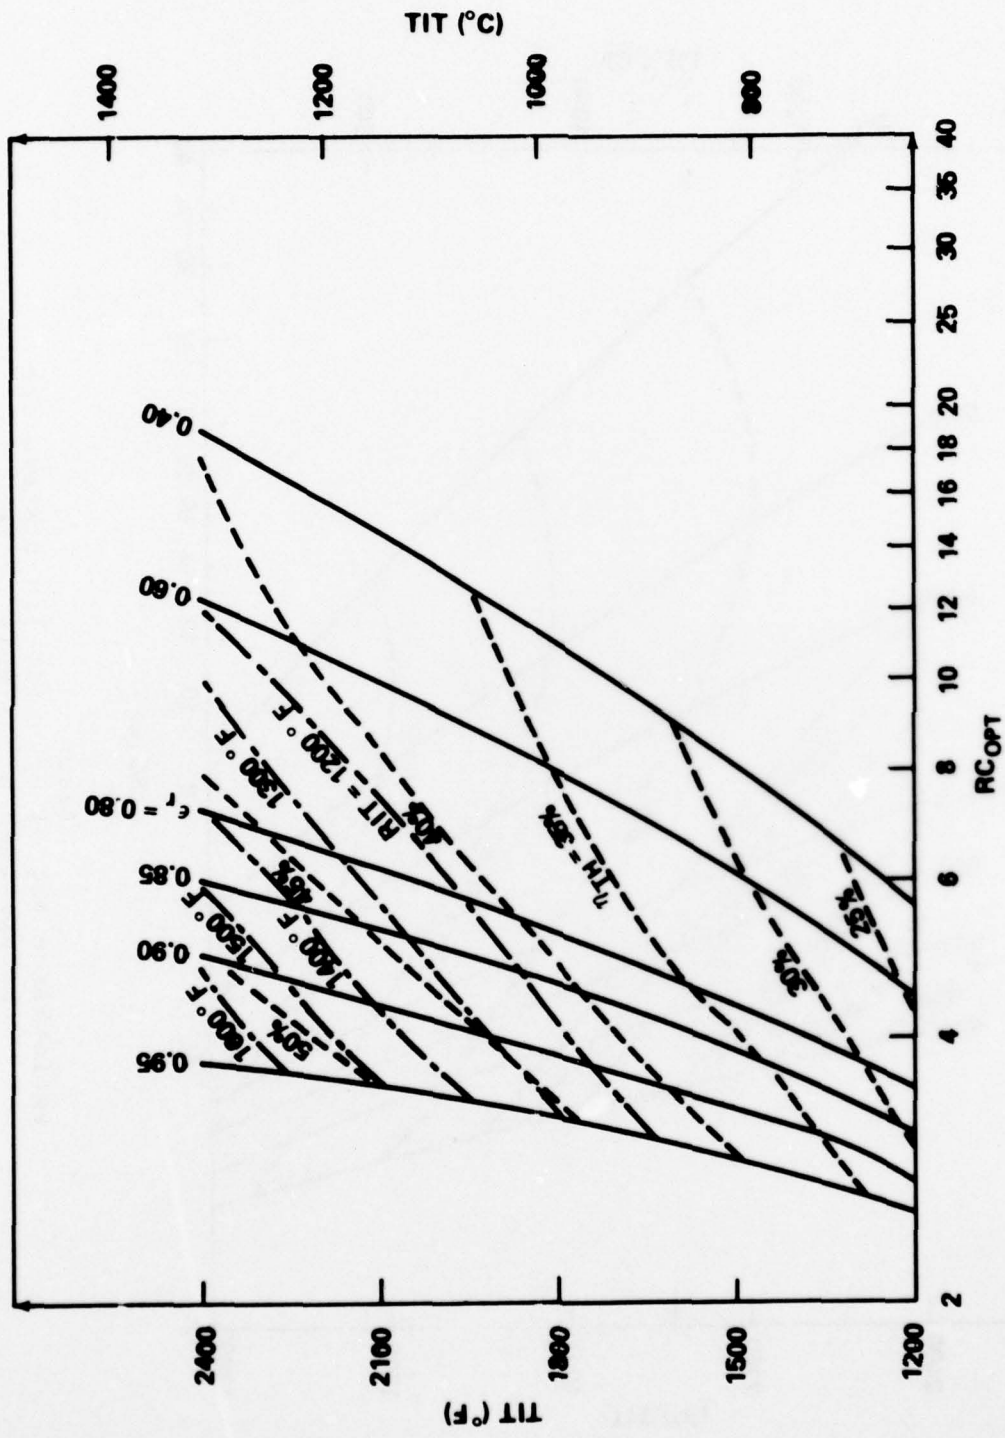


Figure 8  
Performance Map of Closed Brayton Systems  
for Recuperated Cycles

APPENDIX A

FORTRAN SUBROUTINE FOR CALCULATING BRAYTON CYCLE  
PERFORMANCES AND STATE-POINTS

PAS-78-15

```

1  SUBROUTINE CALCS(RC, ICASE, IERR)
   REAL MPT, MCT, MC, MB, MMIX
   COMMON /STPTS/P2, P5, P6, P8, P9, T2, T5, T8, T9, T9R, MC, MCT, RCT, RPT
   COMMON /RZLTS/SFC, ETATH, SPHP, F
   COMMON /PRMETA/ETAC, ETACT, ETAPT, ETAGG, MCT, MPT, MC, MB, MMIX
   COMMON /PARAMC/CPC, GAMC, CPT, GANT, P1, T1
   COMMON /PARAMP/DLPHXH, DLPHXL, EPSHX, DLPB, ETAB, T6, Q, DLPK
   FG=.01
   IF(ICASE.EQ.2)FG=0.
10  IERR=0
   C  CALCULATIONS  CALCULATIONS  CALCULATIONS
   T2=T1+T1*(RC**((GAMC-1.)/GAMC)-1.)/ETAC
   AC=CPC*(T2-T1)*778.*MC
   MCT=WC/ETAGG
7  T8=T6-MCT/(MCT+FG)/CPT/778.
   T8S=T6-(T6-T8)/ETACT
   RCT=(T6/T8S)**(GANT/(GAMT-1.))
   P2=P1*RC
   P5=P2*(1.-DLPHXH)
   P6=P5*(1.-DLPB)
   P8=P5/RCT
   P9=P1/(1.-DLPHXL)/(1.-DLPK)
   RPT=P8/P9
   IF(RPT.LT.1.)GO TO 23
   MMIX=MB+MPT+FG
   T9=T8*(1.-ETAPT*(1.-1./((RPT**((GAMT-1.)/GAMT))))
   SPHP=CPT*(T8-T9)*1.4149*(MPT+FG)
   T9R=MB*T2/MMIX+(MPT+FG)*T9/MMIX
   T5=T2+PSHX*(T9R-T2)
   F=CPT*(T6-T5)/ETAB/Q*MCT
   IF(ICASE.EQ.2)GO TO 9
   IF(ABS((F-FG)/F)-.01)9,9,8
8  FG=F
   GO TO 7
9  SFC=3500.*F/SPHP
   ETATH=.70676*SPHP/Q/F
   RETURN
23  IERR=1
   RETURN
   END
40

```

INITIAL DISTRIBUTION

Copies		CENTER DISTRIBUTION	
		Copies	Code
2	DARPA (Attn: Dr. P. Selwyn, TTO)	1	117 (R. Stevens)
1	ONR (Code 473)	1	27
1	NAVMAT (Code 03412) (Attn: Mr. W. Greenert)	1	272
3	NAVSEA (SEA 0331, C. L. Miller)	1	2720
	(SEA 09G32) (2)	1	2721
		25	2721 (J.S. Wohlgenuth)
2	NAVSEC (SEC 6141)	2	522.1
	(SEC 6145B)	2	522.2
		10	5214.1
		2	5231
1	NAVSECPHILADIV (6734)		
1	NCSL (Attn: Mr. P. G. Sexton)		
1	NUSC Newport (Attn: Mr. T. Black)		
1	AiResearch Mfg. Co. of Arizona 402 South 36th St. P. O. Box 5217 Phoenix, AR 85010 (Attn: Mr. R. Rackley)		
12	DDC		

**DTNSRDC ISSUES THREE TYPES OF REPORTS**

1. DTNSRDC REPORTS, A FORMAL SERIES, CONTAIN INFORMATION OF PERMANENT TECHNICAL VALUE. THEY CARRY A CONSECUTIVE NUMERICAL IDENTIFICATION REGARDLESS OF THEIR CLASSIFICATION OR THE ORIGINATING DEPARTMENT.

2. DEPARTMENTAL REPORTS, A SEMIFORMAL SERIES, CONTAIN INFORMATION OF A PRELIMINARY, TEMPORARY, OR PROPRIETARY NATURE OR OF LIMITED INTEREST OR SIGNIFICANCE. THEY CARRY A DEPARTMENTAL ALPHANUMERICAL IDENTIFICATION.

3. TECHNICAL MEMORANDA, AN INFORMAL SERIES, CONTAIN TECHNICAL DOCUMENTATION OF LIMITED USE AND INTEREST. THEY ARE PRIMARILY WORKING PAPERS INTENDED FOR INTERNAL USE. THEY CARRY AN IDENTIFYING NUMBER WHICH INDICATES THEIR TYPE AND THE NUMERICAL CODE OF THE ORIGINATING DEPARTMENT. ANY DISTRIBUTION OUTSIDE DTNSRDC MUST BE APPROVED BY THE HEAD OF THE ORIGINATING DEPARTMENT ON A CASE-BY-CASE BASIS.