

AD-A068 696

NAVAL RESEARCH LAB WASHINGTON D C

F/G 11/6

SIGNIFICANCE OF COPPER, PHOSPHORUS, AND SULFUR CONTENT TO RADIA--ETC(U)

APR 79 J R HAWTHORNE

RES-79-103

UNCLASSIFIED


NRL-8264

NUREG-CR-0327


NL

| OF |

AD  
A068696

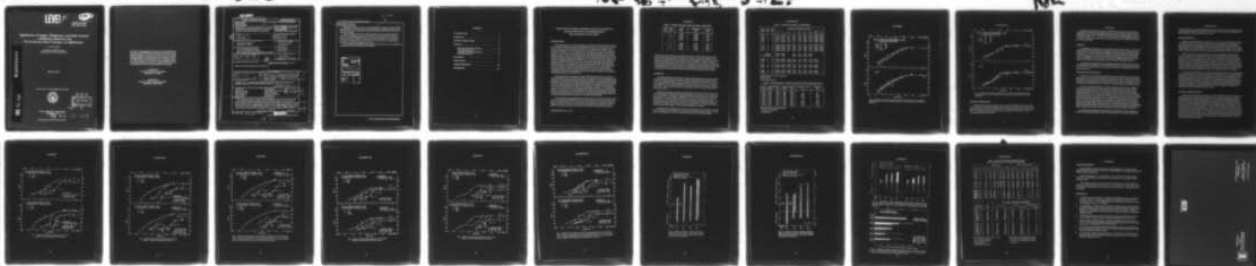

END  
DATE  
FILMED  
6-79  
DDC

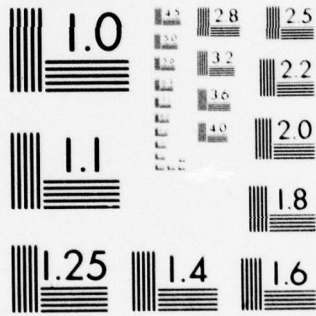

MICROCOPY RESOLUTION TEST CHART  
NATIONAL BUREAU OF STANDARDS-1963-A

**LEVEL II**



NUREG/CR-0327  
NRL Report 8264

**Significance of Copper, Phosphorus, and Sulfur Content  
to Radiation Sensitivity and  
Postirradiation Heat Treatment of A302-B Steel**

J. R. HAWTHORNE

*Thermostructural Materials Branch  
Material Science and Technology Division*

April 12, 1979

Prepared for U.S. Nuclear Regulatory Commission



DDC  
RECEIVED  
MAY 17 1979  
REGULATED

✓  
D

NAVAL RESEARCH LABORATORY  
Washington, D.C.

79 05 16 014

Approved for public release; distribution unlimited.

AD A 068696

DDC FILE COPY

**This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government, nor any agency thereof, nor any of their employees make any warranty, expressed or implied, or assume any legal liability or responsibility for any third party's use, or the results of such use, of any information, apparatus, product or process disclosed in this report, or represent that its use by such third party would not infringe privately owned rights.**

**Available from  
U.S. Nuclear Regulatory Commission  
Washington, D.C. 20555**

**Available from  
National Technical Information Service  
Springfield, Virginia 22161**

UNCLASSIFIED

SECURITY CLASSIFICATION OF THIS PAGE (When Data Entered)

REPORT DOCUMENTATION PAGE		READ INSTRUCTIONS BEFORE COMPLETING FORM
1. REPORT NUMBER NUREG/CR-0327 NRL Report 8264	2. GOVT ACCESSION NO.	3. RECIPIENT'S CATALOG NUMBER
4. TITLE (and Subtitle) SIGNIFICANCE OF COPPER, PHOSPHORUS AND SULFUR CONTENT TO RADIATION SENSITIVITY AND POSTIRRADIATION HEAT TREATMENT OF A302-B STEEL	5. TYPE OF REPORT & PERIOD COVERED Final report on one phase of the NRL Problem	6. PERFORMING ORG. REPORT NUMBER
7. AUTHOR(s) 10 J. R. Hawthorne	8. CONTRACT OR GRANT NUMBER(s) 15 RES-79-103	
9. PERFORMING ORGANIZATION NAME AND ADDRESS Naval Research Laboratory Washington, D.C. 20375	10. PROGRAM ELEMENT, PROJECT, TASK AREA & WORK UNIT NUMBERS NRL Problem M01-40 (See Item 18)	
11. CONTROLLING OFFICE NAME AND ADDRESS U.S. Nuclear Regulatory Commission Office of Nuclear Regulatory Research Reactor Safety Research Division, Washington, D.C. 20555	12. REPORT DATE April 12, 1979	
14. MONITORING AGENCY NAME & ADDRESS (if different from Controlling Office) 11 12 Apr 79	13. NUMBER OF PAGES 23	15. SECURITY CLASS. (of this report) UNCLASSIFIED
16. DISTRIBUTION STATEMENT (of this Report) Approved for public release; distribution unlimited.	15a. DECLASSIFICATION/DOWNGRADING SCHEDULE 14 <del>NUREG CR 0327</del> NRL-8264	
17. DISTRIBUTION STATEMENT (of the abstract entered in Block 20, if different from Report) 12 25 p.	16 <b>Significance of Copper, Phosphorus, and Sulfur Content to Radiation Sensitivity and Postirradiation Heat Treatment of A302-B Steel.</b>	
18. SUPPLEMENTARY NOTES Prepared for the U. S. Nuclear Regulatory Commission, Reactor Safety Research Division, under Interagency Agreement RES-79-103. Distribution category R5.	18 NUREG	
19. KEY WORDS (Continue on reverse side if necessary and identify by block number) A302-B steel Charpy-V properties Embrittlement relief Fracture resistance Notch ductility	19 Nuclear radiation Postirradiation heat treatment Pressure vessel steels Radiation embrittlement Steel impurities 19 CR-0327	
20. ABSTRACT (Continue on reverse side if necessary and identify by block number) The effects of three levels of copper content and phosphorus content and two levels of sulfur content on radiation sensitivity and postirradiation heat treatment response were explored for a reactor pressure vessel steel, Type A302-B. Test plates for the investigation were produced from 182 kg (400-lb) laboratory melts. The contributions of individual elements were assessed from Charpy-V notch ductility changes with 288°C (550°F) irradiation and with a 343°C (650°F) 168 h postirradiation heat treatment. Limited studies of properties recovery by postirradiation 399°C (750°F) heat	20 The effects of three levels of copper content and phosphorus content and two levels of sulfur content on radiation sensitivity and postirradiation heat treatment response were explored for a reactor pressure vessel steel, Type A302-B. Test plates for the investigation were produced from 182 kg (400-lb) laboratory melts. The contributions of individual elements were assessed from Charpy-V notch ductility changes with 288°C (550°F) irradiation and with a 343°C (650°F) 168 h postirradiation heat treatment. Limited studies of properties recovery by postirradiation 399°C (750°F) heat - 257 950 (Continues) e sub v xll	

DD FORM 1473 1 JAN 73

EDITION OF 1 NOV 65 IS OBSOLETE S/N 0102-014-6601

UNCLASSIFIED

SECURITY CLASSIFICATION OF THIS PAGE (When Data Entered)

79 05 16 014

C SUB V

SECURITY CLASSIFICATION OF THIS PAGE (When Data Entered)

20. ABSTRACT (Continued)  
treatment were also made.

Radiation embrittlement sensitivity, as shown by  $C_v$  transition-temperature elevation and  $C_v$  upper-shelf reduction, generally increased with increased copper and phosphorus content and with decreased sulfur content. Certain ranges of phosphorus and copper content were found to be more critical than others.

Response to  $343^\circ\text{C}$  ( $650^\circ\text{F}$ ) postirradiation heat treatment, as evidenced by transition temperature recovery in degrees C, appeared to be independent of copper, phosphorus, and sulfur content for the ranges investigated. Response to heat treatment also appeared to be independent of the magnitude of the prior transition-temperature elevation by irradiation. On the other hand, a dependence of percentage recovery on impurity-element content was observed. A dependence of upper-shelf recovery on copper content was also found.

Six of the eight plate compositions exhibited full upper-shelf recovery but only small transition-temperature recovery after  $343^\circ\text{C}$  ( $650^\circ\text{F}$ ) heat treatment.

ADDITIONAL TO	
DTIC	DTIC Section <input checked="" type="checkbox"/>
DDC	DDC Section <input type="checkbox"/>
UNANNOUNCED	<input type="checkbox"/>
JUSTIFICATION	
BY	
DISTRIBUTION/AVAILABILITY GROUP	
Dist.	AVAIL. and/or SPECIAL
A	

## CONTENTS

INTRODUCTION .....	1
MATERIALS .....	2
MATERIAL IRRADIATION .....	5
RESULTS .....	6
Transition-Temperature Elevation .....	6
Upper-Shelf Reduction .....	7
Transition-Temperature Recovery .....	7
Upper-Shelf Recovery .....	8
DISCUSSION .....	8
CONCLUSIONS .....	9
ACKNOWLEDGMENTS .....	20
REFERENCES .....	20

**SIGNIFICANCE OF COPPER, PHOSPHORUS, AND SULFUR CONTENT TO  
RADIATION SENSITIVITY AND POSTIRRADIATION  
HEAT TREATMENT OF A302-B STEEL**

**INTRODUCTION**

The detrimental effect of neutron radiation on the notch ductility of steel is known to be accentuated by high copper and high phosphorus contents [1]. In current (new) reactor vessel construction, both impurities are being held to low levels in those regions where sensitivity to radiation is to be minimized [2]. For vessels built prior to 1971, copper and phosphorus contents were not specially limited by purchase specifications. The resulting variations in the content of these impurities have led to significant differences in apparent radiation resistance [2]. More importantly, the magnitude of projected reductions in notch ductility properties is such that the requirements of the ASME Code (Section III) [3] and the Code of Federal Regulations (10CFR50) [4], in many cases, may not be satisfied over planned vessel lifetimes. In particular, a present concern is upper-shelf energy retention throughout service. Projections for some vessels indicate that Charpy-V ( $C_v$ ) upper-shelf values will fall below the ASME Code energy index of 68 J (50 ft-lb). This energy level is required to define the reference nil-ductility temperature,  $RT_{NDT}$ . Close estimation of upper-shelf values, however, has been difficult, since trends in upper-shelf reduction with irradiation are not well established for the fluence range of interest and contributing metallurgical variables are not fully known.

The present study was undertaken to help clarify the individual and joint roles of copper and phosphorus in  $C_v$  upper-shelf response to irradiation and to postirradiation heat treatment. In-situ postirradiation heat treatment (annealing) is one method currently being considered for the reduction of detrimental radiation effects to vessels should the need arise. While this method is sanctioned by the national design codes, its effectiveness for recovery has not been fully established for 288°C (550°F) radiation conditions typical of reactor vessel service. Trends in steel reembrittlement following heat treatment, i.e., reirradiation response, in particular have not been investigated in detail. The present study also evaluates sulfur as a third (suspect) impurity. Interest in this residual element stems from Auger spectroscopy observations of high ( $\geq 10\%$ ) sulfur concentrations on postirradiation fracture surfaces of welds having bulk concentrations on the order of 0.010% S [5].

The material test matrix designed for the study is shown in Table 1. The matrix centers on the base composition A302-B, which is typical of older reactor vessel steel plates. Composition variations include two levels of sulfur content and three levels each of copper and phosphorus content. For studies of recovery by postirradiation heat treatment, a 343°C (650°F)—168 h heat treatment was applied to all materials. Only partial embrittlement

---

Manuscript submitted July 5, 1978.

## HAWTHORNE

Table 1 — Design of Test Matrix (Base Composition A302-B Steel)

Melt No.	Cast No.	Sulfur (%)	Phosphorus (%)	Copper (%)
1	1	0.015	0.003	0.15
	2	0.015	0.015	0.15
	3	0.015	0.025	0.15
	4	0.015	0.025	0.30
2	1	0.025	0.015	0.03
	2	0.025	0.015	0.15
	3	0.025	0.015	0.30
	4	0.025	0.025	0.30

relief was expected with this heat-treatment temperature. On the other hand, the 168-h time period was specially selected to eliminate time as an experimental variable. (Prior studies have demonstrated that an extension of the heat treatment beyond 168 h has little effect toward additional recovery for 288°C (550°F) irradiation conditions.) Specimen numbers permitting, higher-temperature heat treatments were also evaluated. On this point, it is emphasized that the study focused on the exploration of material trends and impurity influences rather than on precise definitions of irradiation and heat-treatment effects. Accordingly, each determination was accomplished with as few specimens as possible.

### MATERIALS

Two 182-kg (400-lb) vacuum melts were made. Split-melt procedures were employed to obtain the eight composition variations needed. Impurity additions, as required, were made to the melting furnace prior to the teeming of each ingot. The plates from melt No. 1 were designated Series V6X and contained 0.017% S; plates from melt No. 2 were designated Series V7X and contained 0.029% S. Phosphorus content was the primary variable in Series V6X; copper content was the primary variable in Series V7X. Plate chemistries are indicated in Table 2.

All plates were produced using a cross-rolling ratio of 5:1 and were heat treated under conditions designed to match the mechanical properties and microstructure of representative commercially produced plate, including the ASTM A302-B reference plate [1,6]. The heat treatment consisted of 899°C (1650°F) for 1 h and air cooling followed by 649°C (1200°F) for 1 h and water quenching. Yield and tensile strengths are given in Table 3. The plates show good correspondence in strength and conformance to A302-B steel strength specifications. Figures 1 and 2 compare  $C_v$  notch ductilities of the plates from Series V6X and V7X, respectively. Again, a close similarity of properties is observed.

In planning the investigations, it was expected that the plates would exhibit a relatively low  $C_v$  energy level in the transverse (TL, weak) test orientation before irradiation. Accordingly, the longitudinal (LT, strong) orientation was selected for irradiation studies.

NRL REPORT 8264

Table 2 — Chemical Composition of A302-B Plates

Plate Code	Melt No.	Cast No.	Chemical Composition (wt %) <sup>a</sup>									
			S	P	Cu	C	Mn	Si	Mo	Al <sup>b</sup>	N	
V61	1	1	0.017	0.002	0.15	0.23	1.38	0.26	0.50	0.028	0.001	
V63	1	2	0.017	0.014	0.15	0.24	1.28	0.26	0.49	0.029	0.002	
V65	1	3	0.017	0.024	0.16	0.24	1.36	0.26	0.50	0.029	0.001	
V67	1	4	0.017	0.024	0.29	0.24	1.37	0.26	0.50	0.028	0.001	
V71	2	1	0.029	0.016	0.045	0.25	1.23	0.25	0.49	0.027	0.001	
V73	2	2	0.029	0.016	0.16	0.25	1.23	0.25	0.49	0.027	0.001	
V75	2	3	0.029	0.016	0.30	0.25	1.23	0.25	0.49	0.027	0.001	
V77	2	4	0.029	0.024	0.30	0.25	1.23	0.25	0.49	0.027	0.001	
A302-B Specification			0.040 max.	0.035 max.	—	0.25 max.	1.15 1.50	0.15 0.30	0.45 0.60	—	—	
40B	A	2 <sup>c</sup>	0.021	0.006	0.002	0.24	1.33	0.23	0.54	0.033	—	
40C	A	3 <sup>c</sup>	0.022	0.021	0.008	0.23	1.30	0.21	0.53	0.031	—	
38A	B	1 <sup>c</sup>	0.004	0.003	0.002	0.24	1.34	0.27	0.54	0.032	—	
38B	B	2 <sup>c</sup>	0.004	0.004	0.20	0.24	1.34	0.24	0.54	0.028	—	
39A	C	1 <sup>c</sup>	0.003	0.004	0.002	0.26	1.24	0.21	0.54	0.026	—	
39B	C	2 <sup>c</sup>	0.005	0.004	0.20	0.25	1.25	0.20	0.53	0.021	—	

<sup>a</sup>Ladle analyses by U. S. Steel Corporation

<sup>b</sup>Total aluminum

<sup>c</sup>Plate analysis by NRL [1]

Table 3 — Tensile Properties of A302-B Steel Plates (Ambient Temperature Tests)

Plate Code	Yield Strength <sup>a</sup>		Tensile Strength <sup>b</sup>		Reduction of Area (%)	Elongation (%)
	(MPa)	(ksi)	(MPa)	(ksi)		
V61	528	76.5	664	96.4	-c-	-c-
V63	530	76.9	669	97.0	65.7	23.7
V65	531	77.0	671	97.3	65.7	24.8
V67	531	77.0	675	97.9	65.9	24.1
V71	533	77.4	674	97.7	-c-	-c-
V73	531	77.0	674	97.8	63.5	23.9
V75	537	77.9	677	98.2	63.5	24.5
V77	538	78.4	682	98.9	64.6	24.2

<sup>a</sup>6.4-mm (0.252-in.)-diameter specimens

<sup>b</sup>Average of duplicate tests

<sup>c</sup>Not determined

HAWTHORNE

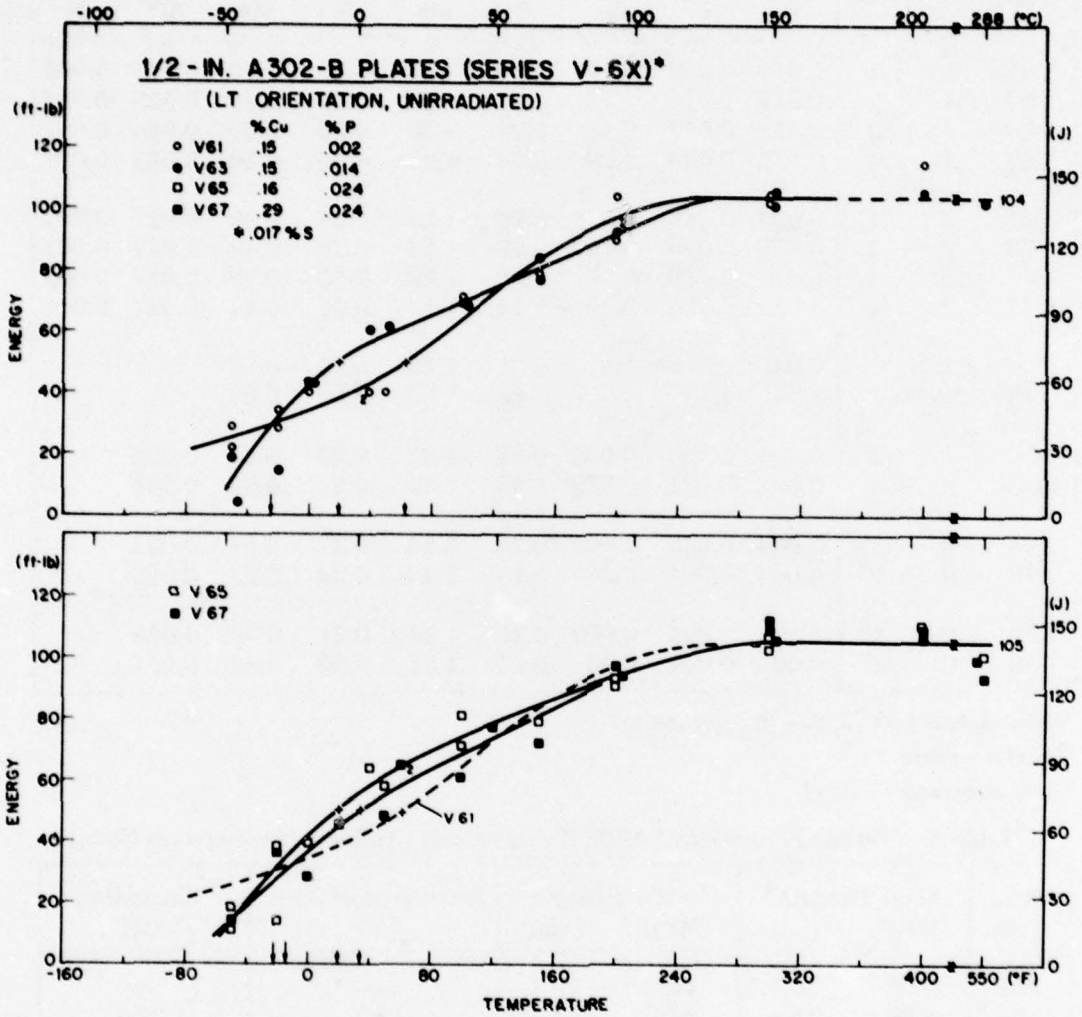


Fig. 1 - Charpy-V notch ductility of plate Series V6X (LT orientation) before irradiation. Upper-shelf values for the TL orientation (not shown) were in the range of 75 to 81 J (55 to 60 ft-lb).

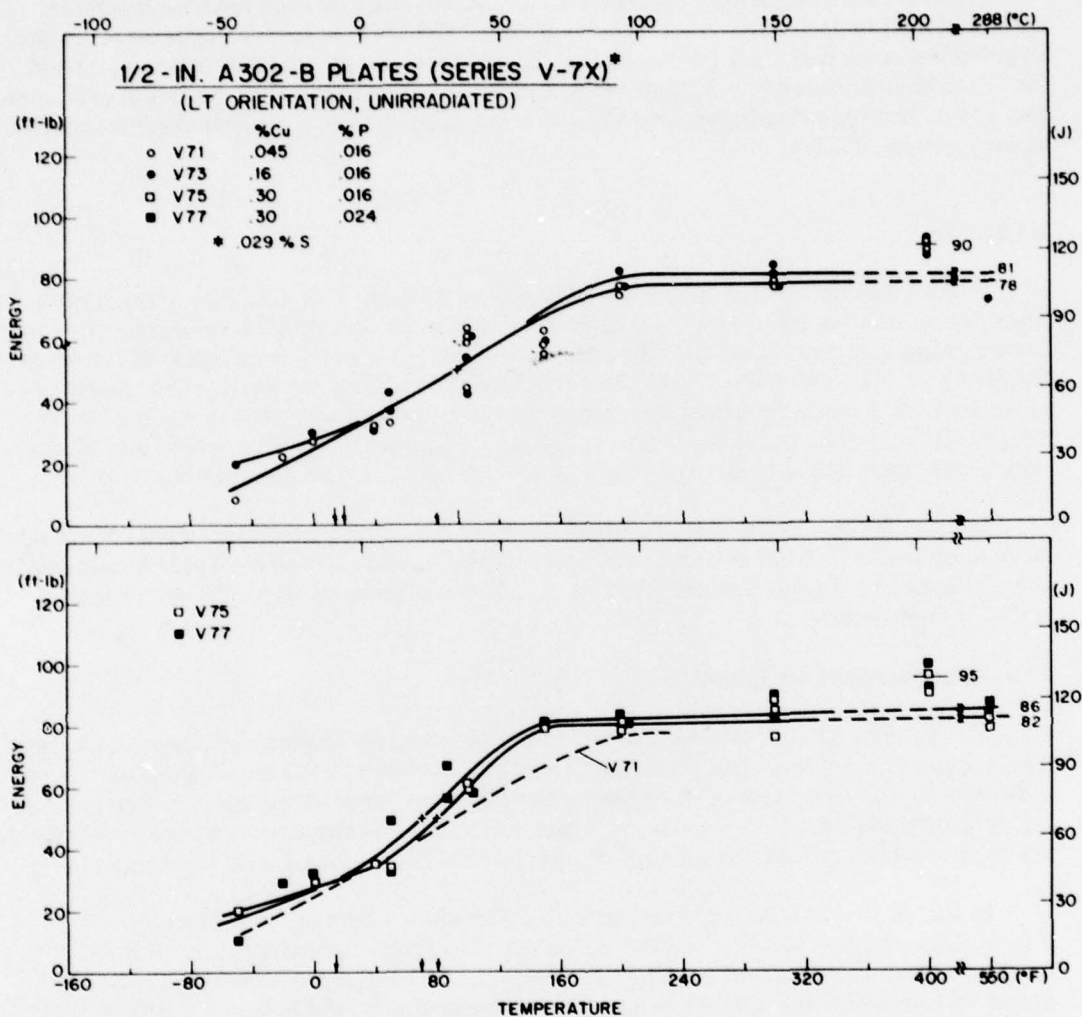


Fig. 2 — Charpy-V notch ductility of plate Series V7X (LT orientation) before irradiation. Upper-shelf values for the TL orientation (not shown) were in the range of 49 to 57 J (36 to 42 ft-lb).

**MATERIAL IRRADIATION**

The plates were irradiated at 288°C (550°F) in two simultaneous experiments in the State University of New York at Buffalo Reactor (UBR). Experiment No. 1 contained the plate Series V6X and plate V73; Experiment No. 2 contained the plate Series V7X and plate V67. The average neutron fluences were  $3.1 \times 10^{19}$  and  $3.3 \times 10^{19}$  n/cm<sup>2</sup> > 1 MeV (calculated spectrum), respectively.

## HAWTHORNE

Fluence determinations were based on measurements with iron neutron dosimeter wires included in each experiment specimen array. For the fuel lattice positions used, the calculated spectrum fluence ( $\Phi^{CS}$ ) and the fluence based on an assumed fission spectrum ( $\Phi^{fs}$ ) had the relation  $\Phi^{CS} = 1.22 \Phi^{fs}$  ( $>1$  MeV). The duration of the irradiation exposure was 959 h. Irradiation temperatures were monitored by means of multiple thermocouples in each specimen array.

## RESULTS

Postirradiation test results for the plate Series V6X are shown in Figs. 3 to 5; those for plate Series V7X are given in Figs. 6 to 8. Figures 9 to 12 and Table 4 summarize the observed changes in notch ductility after irradiation and after postirradiation heat treatment. Typically,  $C_v$  41-J (30 ft-lb) and  $C_v$  68-J (50 ft-lb) transition-temperature changes agree quite well. Differences in reported neutron fluences among plates are the result of small neutron-flux gradients over the length of the irradiation assembly. Plates V67 and V73, which were included in both experiments, show no effect of the fluence variation.

In planning this investigation and in analyzing the results, irradiation data for earlier laboratory melts of A302-B (plate) with controlled impurity levels (see Table 4) were taken into account [1]. In this manner, the test matrix was effectively expanded by four additional compositions.

### Transition-Temperature Elevation

In Figs. 9 to 11 the transition-temperature elevation by irradiation is seen to increase with copper content and with phosphorus content. However, a lower radiation sensitivity is indicated for the plate series (V7X) having the higher sulfur content. An opposite trend for this impurity was anticipated from the Auger study. An investigation of the radiation mechanism(s) involved and additional experiments to confirm the trend with sulfur are planned.

In Fig. 9, the data indicate that an increase in phosphorus content from 0.002% to 0.014% had a large effect on radiation sensitivity but that a further increase to 0.024% produced little additional effect. The difference in radiation sensitivity found between plates V61 and V63 at 0.15% Cu is about the same as that found between similar plates (0.006% and 0.021% P) containing only 0.008% Cu [1] (see Table 4). In Fig. 10, a different trend is observed for copper content. Here, an increase from 0.045% to 0.16% Cu resulted in little effect on radiation sensitivity; however, a large effect was produced by a further increase to 0.30% Cu. In this instance, the contribution of sulfur content to radiation resistance must be acknowledged. Unlike the high-sulfur-content Series V7X, the low-sulfur-content Series 38X and 39X plates (Table 4) [1] studied previously did show an appreciable elevation in radiation sensitivity with an increase in copper from 0.002% to 0.20%. Thus, an effect of sulfur content on the copper contribution to radiation sensitivity is indicated.

It is noted that observations for plate Series V6X and Series V7X are mutually reinforcing. The relative performances of plate V75 and plate V77, for example, confirm the

relative performances of plates V63 and V65 in terms of the trend with phosphorus content. Likewise, the performances of plates V73 and V75 are consistent with those of plate V65 and V67 relative to the trend with copper content.

### Upper-Shelf Reduction

Radiation-induced reductions in upper-shelf level (Fig. 11) were less pronounced than the radiation-induced elevations in transition temperature; nonetheless, a parallelism in upper-shelf change with increasing impurities content is illustrated. Phosphorus content again appears to be most influential in the range 0.002% to 0.014%; copper content appears most influential in the range 0.16% to 0.30%. As one result, plate V61 with 0.15% Cu and 0.002% P had less of an upper-shelf reduction than plate V71 with 0.045% Cu and 0.016% P.

Figure 11 also shows a smaller radiation effect for the higher-sulfur-content plate Series V7X than for plate Series V6X. However, on a percentage basis, the reductions in upper-shelf level appear to be almost the same. (Note that plates V63 and V73 and plates V67 and V77 can be compared directly.) The data in turn raise the question of the most applicable and most meaningful method for assessing the reduction, percentage reduction or absolute reduction. In support of the former, resistance to radiation is suspected of being partly a function of the initial (preirradiation) upper-shelf level, with steels having the higher levels showing the greater propensity to change. The relative performance of the LT vs TL orientations of the ASTM A302-B reference plate [6] also suggest such a relationship.

To achieve full qualification of the effects of phosphorus and copper on postirradiation upper-shelf retention, it is clear that an evaluation of certain plates at "matching embrittlement levels" will have to be made. For example, this would involve the irradiation of plates V61 and V63 to fluences A and B, respectively, such that they would exhibit the same transition-temperature increase, e.g., 60°C (110°F). If a difference in upper-shelf reduction is then observed, the actual role of phosphorus content will be established. Lacking such a comparison at present, it is unclear whether the difference in upper-shelf retention is due directly to the difference in phosphorus content or to the difference in "damage level" brought about by the change in phosphorus content.

### Transition-Temperature Recovery

Figures 9 and 10 illustrate the effectiveness of 343°C (650°F)—168 h annealing for the various compositions. The two plates having the lowest copper and phosphorus contents exhibit the greatest transition-temperature recovery; however, their performances appear only slightly superior to the remaining materials in their series. The V6X series plates and the V7X series plates also appear comparable. Accordingly, the data demonstrate that the effectiveness of 343°C (650°F) annealing is relatively independent of phosphorus, copper, or sulfur content. Of special importance, it is noted that the transition-temperature recoveries exhibited by the two series are relatively independent of the magnitude of the transition-temperature elevation by irradiation. The difference in elevation in some cases approaches a factor of 2. This independence, in turn, suggests that absolute recovery is quite independent of fluence level. On the other hand, the data trends for percentage recovery suggest that the effectiveness of 343°C (650°F) annealing decreases with increasing fluence as well as with increasing impurities content.

## HAWTHORNE

Figures 9 and 10 give specific examples of equal transition-temperature elevations which permit a direct assessment of phosphorus and copper influences on recovery. Plates V63 and V65 with 0.15% Cu and plates V75 and V77 with 0.30% Cu exhibit about the same response to annealing even though their phosphorus contents differ (0.014% vs 0.024% P). Some detrimental effect of increased copper content (0.045% vs 0.16% Cu), on the other hand, is indicated by the performance of plates V71 and V73.

Figure 12 describes the relative benefits of a 399°C (750°F) heat treatment over a 343°C (650°F) heat treatment for five of the plates. Values given for recovery are very approximate because of the limited number of specimens tested. Regardless, the data demonstrate greater recovery with 399°C (750°F) annealing in each instance. Moreover, four of the plates have comparable recovery in spite of differences in initial transition-temperature elevation. That is, annealing response would again appear to be fairly independent of the prior embrittlement condition. The reason for the higher recovery by plate V63 is not clear. It was noted in Fig. 3 that tests were not conducted below the 81-J (60 ft-lb) energy level. However, projections based on the available data describe a recovery in excess of 97°C (175°F).

Finally, it is observed in Fig. 11 that 427°C (800°F)—168 h annealing of one high-copper-, high-phosphorus-content plate was insufficient to produce full transition-temperature recovery.

### Upper-Shelf Recovery

Unlike transition-temperature recovery with annealing, full upper-shelf recovery was obtained in all but two instances. The exceptions were plates V67 and V75, annealed at 343°C (650°F). With plate V67, there is little doubt that the indication of incomplete upper-shelf recovery is correct, since duplicate tests of 343°C (650°F) annealing response were made (two separate radiation experiments). With plate V75, on the other hand, it is quite possible that a bias in the data scatter is providing a false indication (Fig. 7). The suspicion of a false indication by the limited data is reinforced by the full recovery exhibited by plate V77.

From the 343°C (650°F) annealing results, it is tentatively concluded that a copper content of 0.30% is detrimental to upper-shelf recovery for steels having sulfur contents on the order of 0.017% but not for steels having a sulfur content on the order of 0.029%. The relative performances of plates V65 and V67 and of plates V73 and V77 support this conclusion. By the same token, a "high" sulfur content appears beneficial to annealing response. The data also suggest that phosphorus content has neither a positive nor a negative effect on upper-shelf recovery. In this case, biased data scatter is taken to be a correct assumption for plate V75.

## DISCUSSION

The exploratory investigation has yielded several important determinations on the role of copper, phosphorus, and sulfur impurities on irradiation and annealing response and on annealing recovery characteristics per se. The observations also point the way for needed

## NRL REPORT 8264

follow-on investigations such as the development of plate comparisons at "matching embrittlement levels" and at lower fluences in the case of the higher impurities contents. A need for assessing copper-content effects at the lower of the two sulfur contents and clarification of the contribution of sulfur to both irradiation and annealing response is also shown. Further investigations focusing on these needs are under consideration.

For operating reactor vessels having relatively high sensitivity to radiation embrittlement, the results of the present study suggest that a 343°C (650°F) heat treatment has mixed promise for vessel embrittlement relief. Whereas high upper-shelf recovery was found in most cases, only limited transition-temperature recovery was observed. Accordingly, the determination of steel reembrittlement trends following an anneal will be critically important to the assessment of the practicality of the 343°C (650°F) method. Cyclic irradiation and annealing studies are currently in progress at NRL under sponsorship of the Nuclear Regulatory Commission (NRC). The initial report of findings from these studies is expected in 1978.

## CONCLUSIONS

An exploratory investigation has been made on the radiation resistance and postirradiation heat-treatment recovery of A302-B steel as functions of copper, phosphorus, and sulfur content. Primary observations and conclusions of the study are:

1. Radiation-embrittlement sensitivity, in terms of transition-temperature elevation, generally increased with increased copper and phosphorus content and with decreased sulfur content.
2. Radiation-embrittlement sensitivity, in terms of the upper-shelf reduction, also increased with increased copper and phosphorus content and with decreased sulfur content.
3. The effect of increasing phosphorus content on radiation sensitivity was observed predominantly in the range of 0.002% to 0.014% P, compared to the test matrix range of 0.002% to 0.024% P.
4. The effect of increasing copper content on radiation sensitivity was observed predominantly in the range of 0.16% to 0.30% Cu, compared to the test matrix range of 0.045% to 0.30% Cu.
5. A high sulfur content (0.029% S) appears to reduce the detrimental effect of copper content on radiation sensitivity.
6. A 343°C (650°F) 168-h heat treatment produces only small transition temperature recovery (i.e., 22° to 39°C, 40° to 70°F) regardless of the level of copper, phosphorus, and sulfur impurities and the magnitude of the transition-temperature elevation by irradiation. A detrimental effect on recovery of a 0.16% Cu content compared to a 0.045% Cu content is suggested by one set of data.
7. A 343°C (650°F) 168-h heat treatment produces full upper-shelf recovery for most of the impurity compositions investigated.
8. A copper content of 0.30% but not 0.16% is detrimental to upper-shelf recovery for steels containing about 0.017% S.

HAWTHORNE

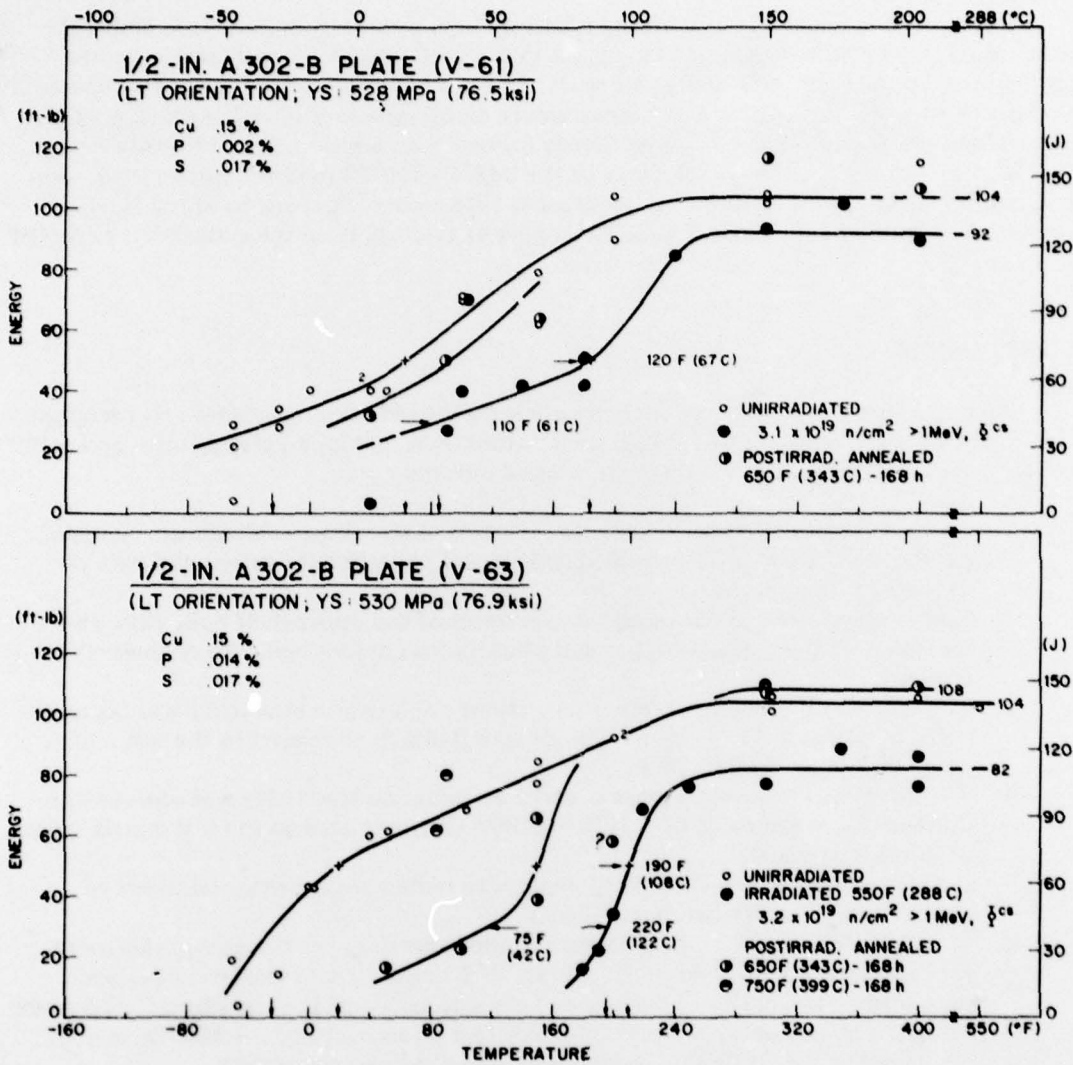


Fig. 3 - Charpy-V notch ductility of plates V61 and V63 after irradiation and after postirradiation heat treatment.

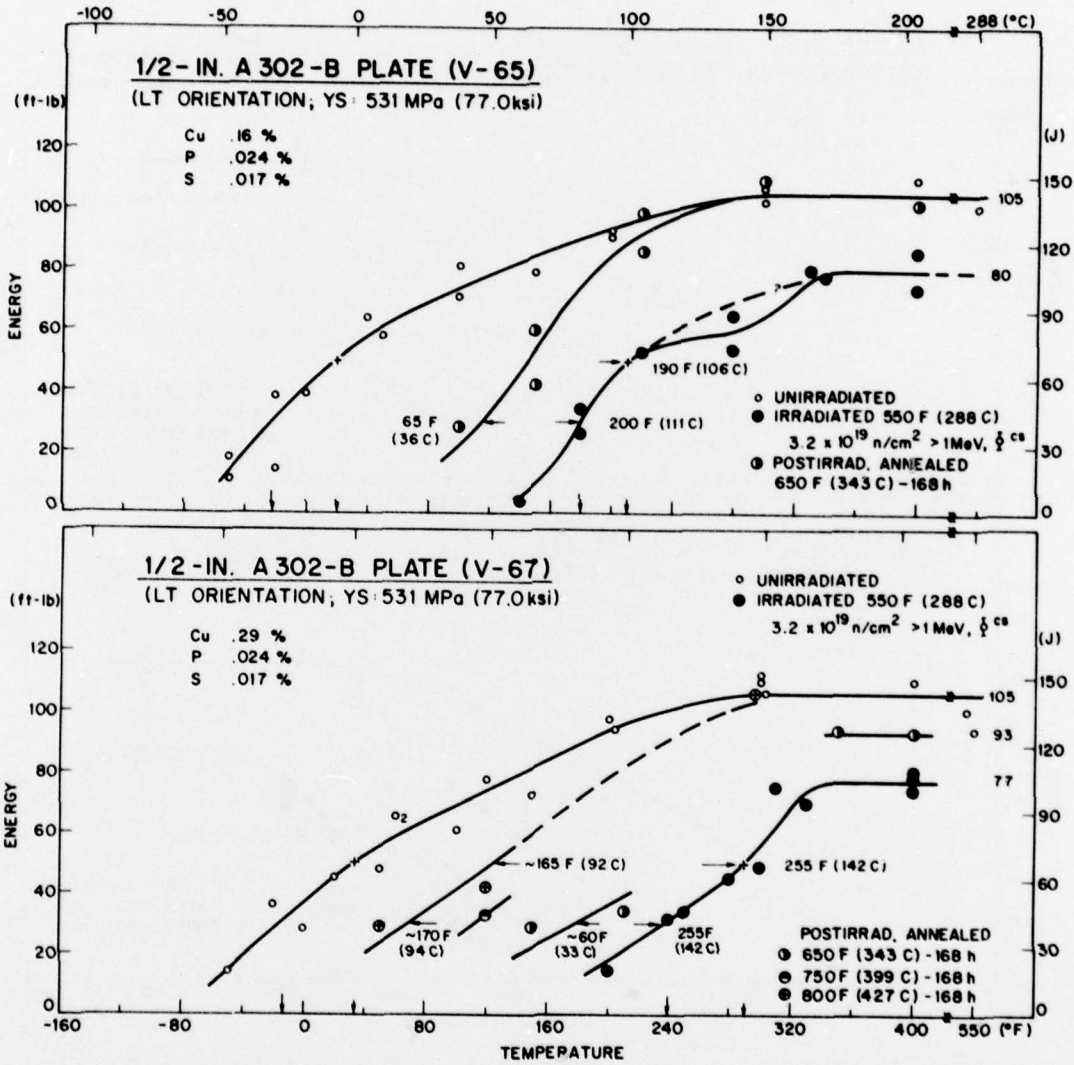


Fig. 4 - Charpy-V notch ductility of plates V65 and V67 after irradiation and after postirradiation heat treatment.

HAWTHORNE

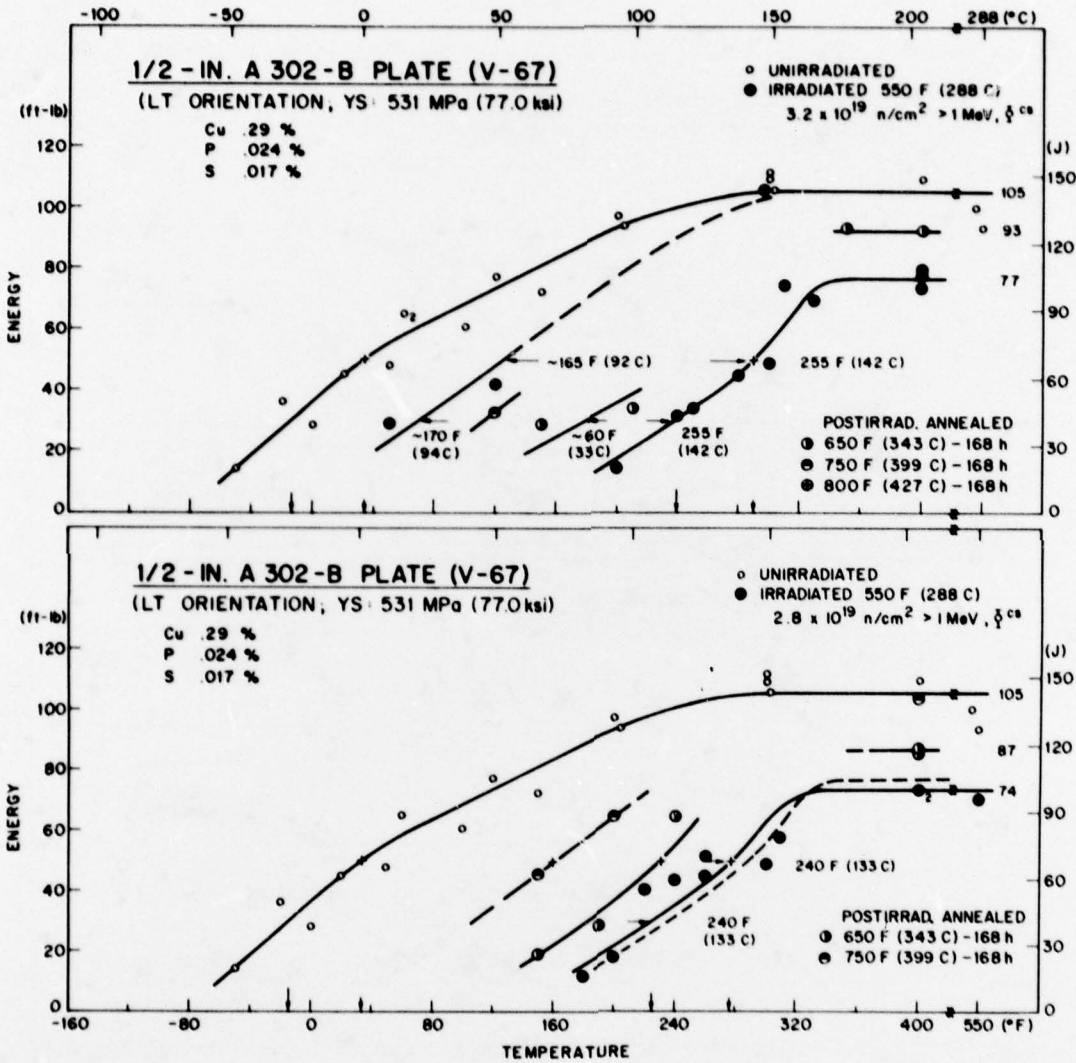


Fig. 5 - Charpy-V notch ductility of plate V67 after irradiation and after postirradiation heat treatment. The upper graph refers to Irradiation Experiment No. 1; the lower graph refers to Irradiation Experiment No. 2. The as-irradiated condition curve from the upper graph is reproduced in the lower graph (see dashed curve) for reference.

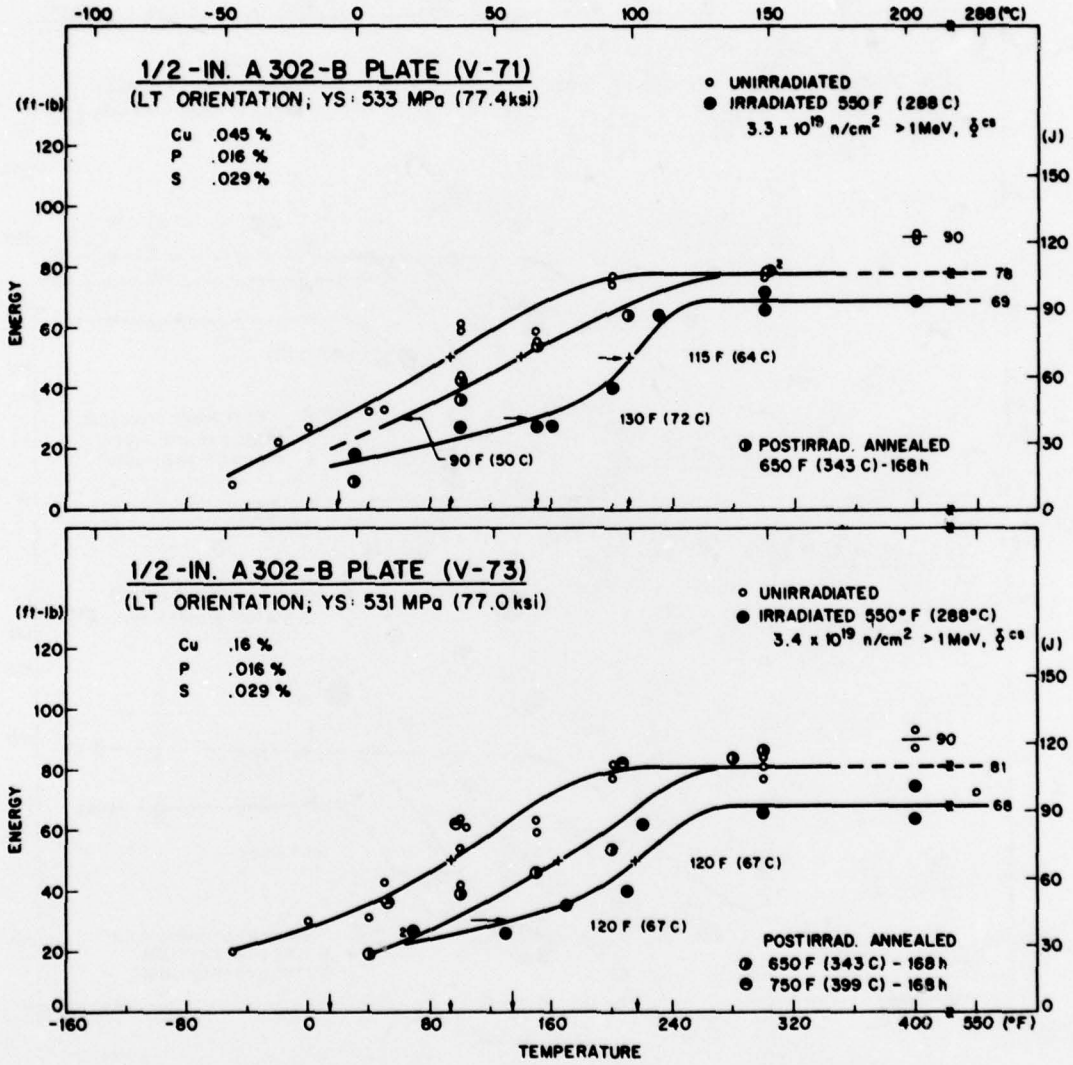


Fig. 6 — Charpy-V notch ductility of plates V 71 and V73 after irradiation and after postirradiation heat treatment.

HAWTHORNE

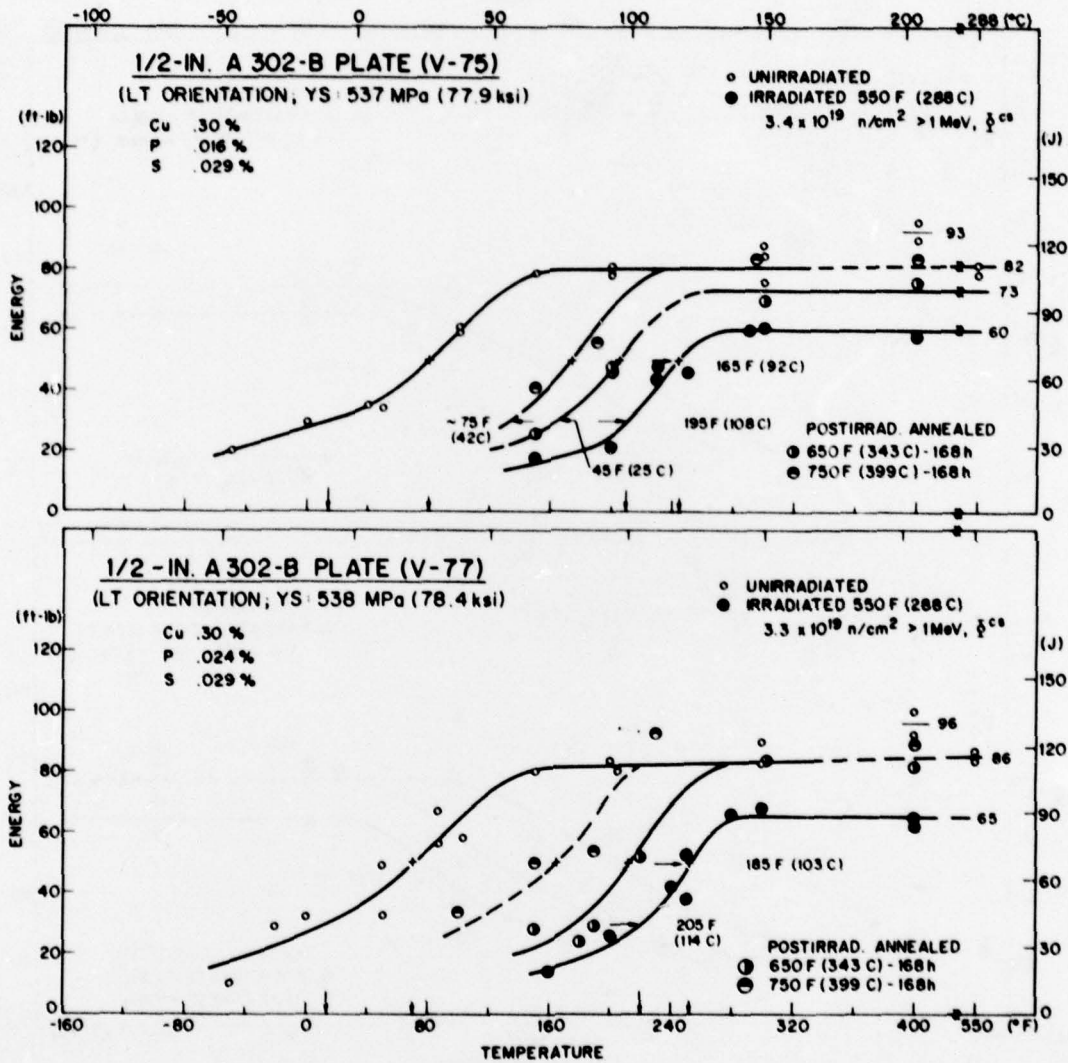


Fig. 7 - Charpy-V notch ductility of plates V75 and V77 after irradiation and after postirradiation heat treatment.

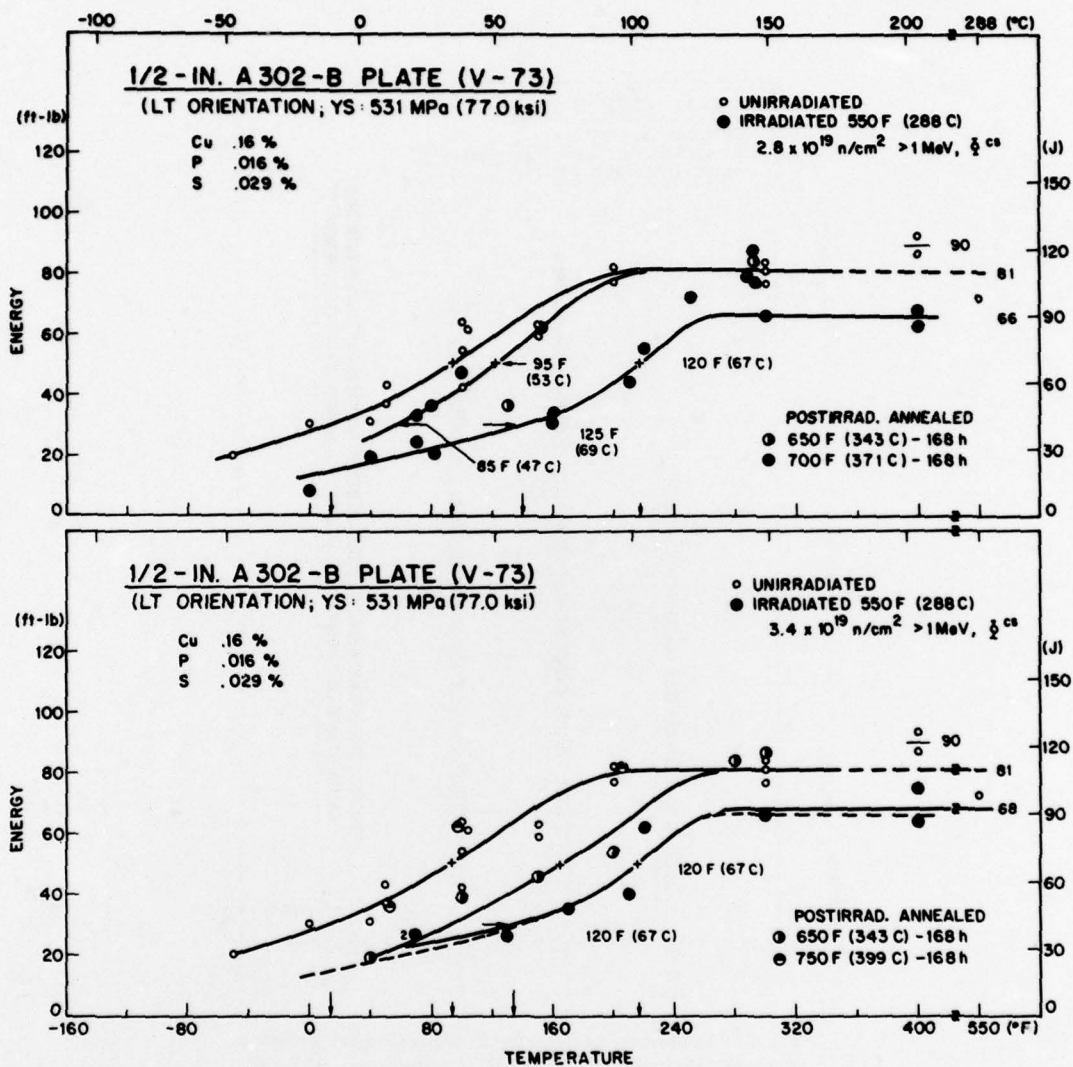


Fig. 8 - Charpy-V notch ductility of plate V73 after irradiation and after postirradiation heat treatment. The upper graph refers to Irradiation Experiment No. 1; the lower graph refers to Irradiation Experiment No. 2. The as-irradiated condition curve from the upper graph is reproduced in the lower graph (see dashed curve) for reference.

HAWTHORNE

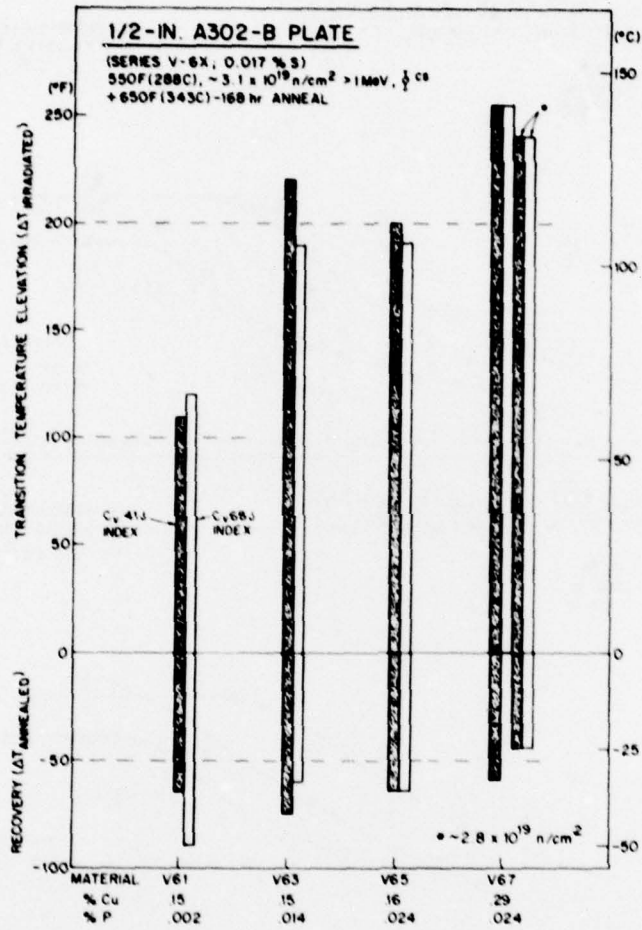


Fig. 9 - Summary of Charpy-V transition-temperature changes (41-J and 68-J indices) of plate Series V6X with 288°C (550°F) irradiation and with 343°C (650°F) postirradiation heat treatment.

NRL REPORT 8264

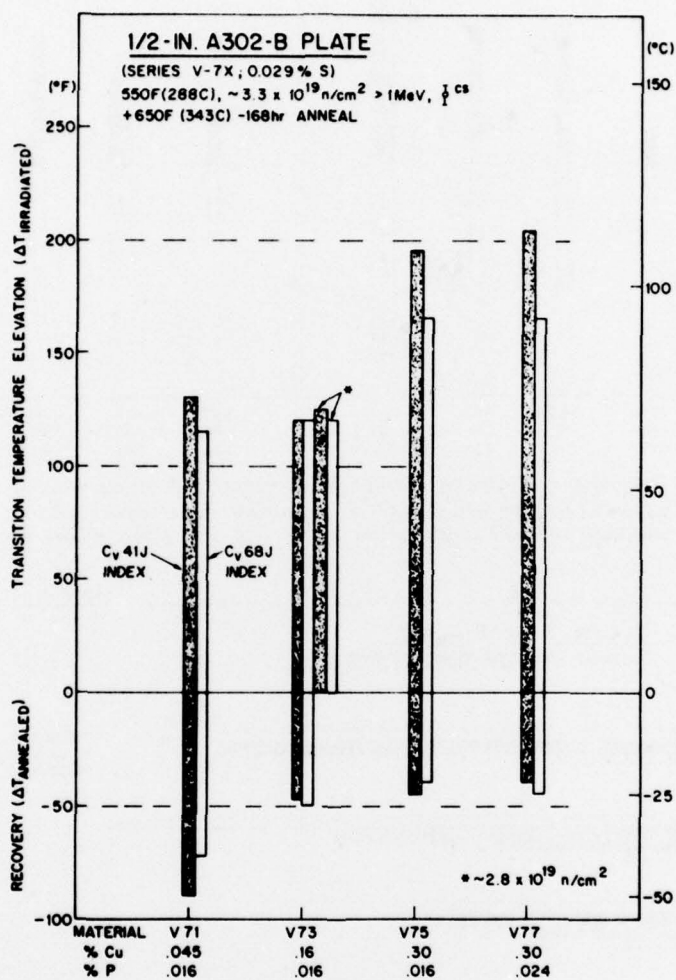


Fig. 10 — Summary of Charpy-V transition-temperature changes (41-J and 68-J indices) of plate Series V7X with 288°C (550°F) irradiation and with 343°C (650°F) postirradiation heat treatment.

### HAWTHORNE

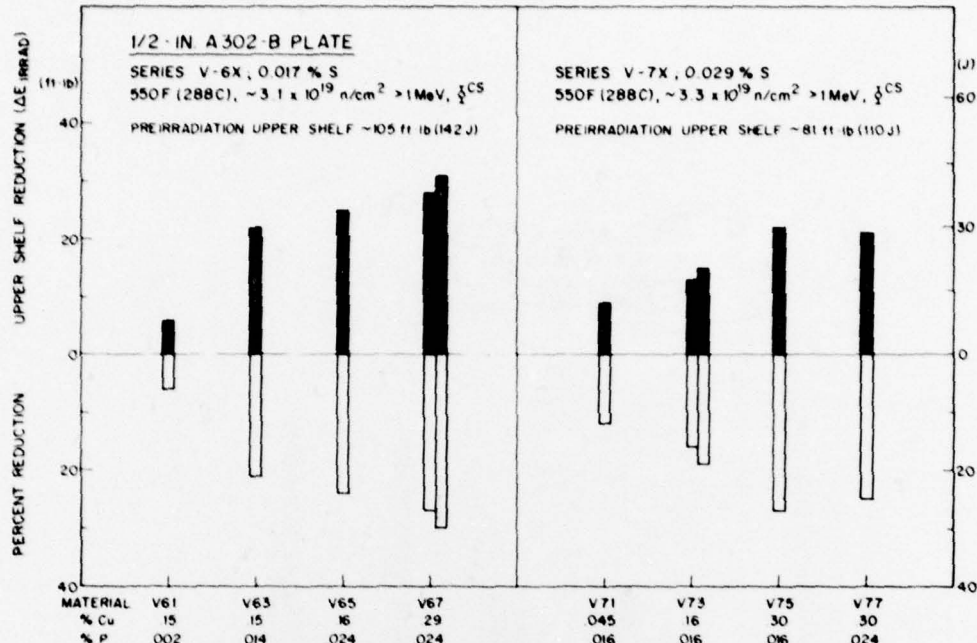


Fig. 11 — Comparison of Charpy-V upper-shelf energy reductions of plate Series V6X and plate Series V7X after 288 C (550 F) irradiation. The upper portion of the graph shows the absolute reduction; the lower portion of the graph shows the percentage reduction.

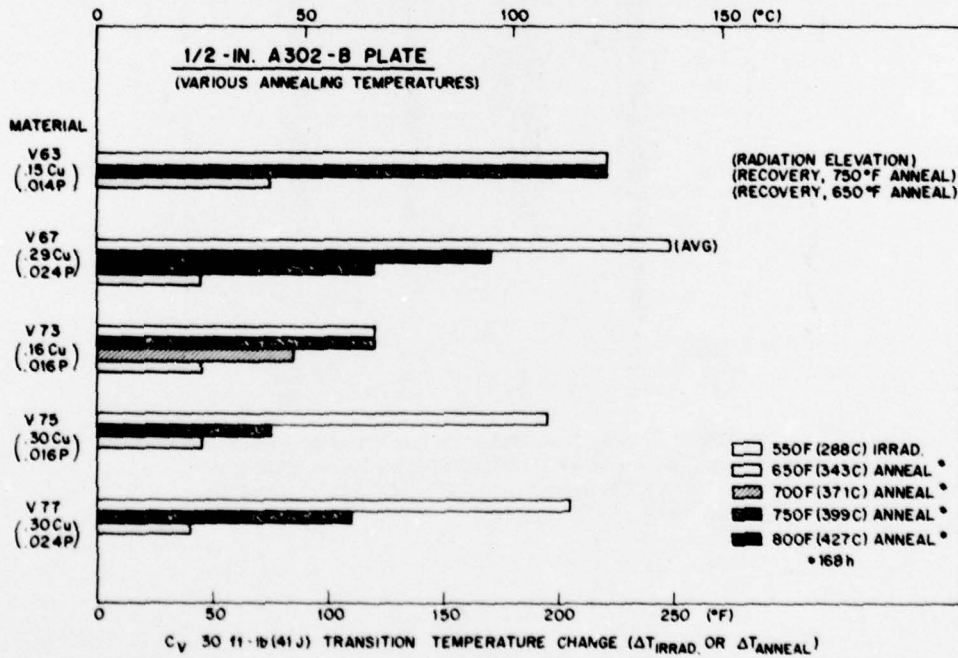


Fig. 12 — Comparison of Charpy-V transition-temperature recovery (41-J index) produced by various postirradiation heat-treatment temperatures. The initial radiation-induced elevations in transition temperature are also shown for reference.

NRL REPORT 8264

Table 4 — Charpy-V Notch Ductility of A302-B Steel Plates Before and After Irradiation and Postirradiation Heat Treatment

Plate Code	Exp. No.	Initial Properties						288°C (550°F) Irradiation					
		$\phi^{CS^a}$ ( $\times 10^{19}$ )	$C_V$ 41 J <sup>b</sup> (°C) (°F)	$C_V$ 68 J <sup>c</sup> (°C) (°F)	$C_V$ USE <sup>d</sup> (J) (ft-lb)		$\Delta C_V$ 41 J ( $\Delta^\circ C$ ) ( $\Delta^\circ F$ )		$\Delta C_V$ 68 J ( $\Delta^\circ C$ ) ( $\Delta^\circ F$ )		$\Delta C_V$ USE ( $\Delta J$ ) ( $\Delta ft-lb$ )		
V61	1	3.1	-32 -25	18 65	141 104	61 110	67 120	8 6					
V63	1	3.2	-32 -25	-7 20	141 104	122 220	106 190	30 22					
V65	1	3.2	-29 -20	-7 20	142 105	111 200	106 190	34 25					
V67	1	3.2	-26 -15	2 35	142 105	142 255	142 255	38 28					
V67	2	2.8	-26 -15	2 35	142 105	133 240	133 240	42 31					
V71	2	3.3	-7 20	35 95	106 78	72 130	64 115	12 9					
V73	2	3.4	-9 15	35 95	110 81	67 120	67 120	18 ~13					
V73	1	2.8	-9 15	35 95	110 81	69 125	67 120	20 15					
V75	2	3.4	-9 15	27 80	111 82	108 195	92 165	30 22					
V77	2	3.3	-9 15	21 70	114 84	114 205	103 185	29 21					
40B(1)	A	~3.3	-18 0	e e	24 75	0 0	e e	~0 ~0					
40C(1)	A	~3.3	-7 20	e e	24 75	44 80	e e	~0 ~0					
38A(1)	B	~2.5	-40 -40	e e	49 120	0 0	e e	~0 ~0					
38B(1)	B	~2.5	-48 -55	e e	60 140	31 55	e e	~14 ~10					
39A(1)	B	~2.5	-46 -50	e e	52 125	0 0	e e	~0 ~0					
39B(1)	B	~2.5	-46 -50	e e	57 135	44 80	e e	~7 ~5					

Plate Code	Exp. No.	$\phi^{CS^a}$ ( $\times 10^{19}$ )	343°C (650°F) Postirradiation Heat Treatment					
			$\Delta C_V$ 41 J ( $\Delta^\circ C$ ) ( $\Delta^\circ F$ )		$\Delta C_V$ 68 J ( $\Delta^\circ C$ ) ( $\Delta^\circ F$ )		$\Delta C_V$ USE (Recovery) ( $\Delta J$ ) ( $\Delta ft-lb$ )	
V61	1	3.1	36	65	53	95	F	F
V63	1	3.2	42	75	33	60	F	F
V65	1	3.2	36	65	36	65	F	F
V67	2	2.8	25	45	25	45	18	13
V67 <sup>f</sup>	2	2.8	~67	~120	64	115	F	F
V67 <sup>f</sup>	1	3.2	~69	~125	e	e	e	e
V67 <sup>g</sup>	1	3.2	94	170	92	165	F	F
V63 <sup>e</sup>	1	3.2	~F	~F	F	F	F	F
V71	2	3.3	50	90	39	70	F	F
V73	2	3.4	25	45	28	50	F	F
V73 <sup>f</sup>	2	3.4	~F	~F	~F	~F	F	F
V73 <sup>i</sup>	1	2.8	47	85	53	95	F	F
V75	2	3.4	25	45	22	40	18	13
V75 <sup>f</sup>	2	3.4	~42	~75	~39	~70	F	F
V77	2	3.3	22	40	25	45	F	F
V77 <sup>f</sup>	2	3.3	~61	~110	~50	~90	F	F

<sup>a</sup> $\phi^{CS}$  (>1 MeV);  $\phi^{CS} > 0.1$  MeV - 2.91  $\phi^{CS} > 1$  MeV

<sup>b</sup> $C_V$  30 ft-lb transition temperature

<sup>c</sup> $C_V$  50 ft-lb transition temperature

<sup>d</sup> $C_V$  upper-shelf energy

<sup>e</sup>Not available or not determined.

<sup>f</sup>399°C (750°F) 168 h postirradiation heat treatment.

<sup>g</sup>427°C (800°F) 168 h postirradiation heat treatment.

<sup>h</sup>371°C (700°F) 168 h postirradiation heat treatment.

F = Full recovery

## HAWTHORNE

### ACKNOWLEDGMENTS

This investigation was sponsored by the Nuclear Regulatory Commission, Reactor Safety Research Division (Mr. C. Z. Serpan, Jr., Project Officer). The continued NRC support of NRL research is appreciated.

The author thanks Dr. L. F. Porter and Dr. J. H. Gross of the United States Steel Corporation (Applied Research Laboratory) for their assistance in securing the A302-B laboratory melts.

The author also expresses his sincere appreciation to Messrs. H. E. Watson and W. E. Hagel of the NRL Operations Section and Mr. T. A. Zimmerman of the NRL High Temperature Systems Criteria Section for their contributions to certain experimental phases of the investigation.

### REFERENCES

1. U. Potapovs and J.R. Hawthorne, "The Effect of Residual Elements on the Response of Selected Pressure-Vessel Steels and Weldments to Irradiation at 550° F," *Nucl. Applications*, 6, No. 1, 27-46 (1969) (also NRL Report 6803, Naval Research Laboratory, Washington, D.C., Nov. 22, 1968).
2. J.R. Hawthorne, J.J. Koziol, and R.C. Groeschel, "Evaluation of Commercial Production A533-B Plates and Weld Deposits Tailored for Improved Radiation Embrittlement Resistance," in *Properties of Reactor Structural Alloys After Neutron or Particle Irradiation*, ASTM STP 570, American Society for Testing and Materials, Philadelphia, 1976, pp. 83-102.
3. ASME Boiler and Pressure Vessel Code, Section III, Subsection NB (Class 1 Components), NB-2331, American Society of Mechanical Engineers, New York, 1974.
4. Fracture Toughness and Surveillance Program Requirements, Appendices G and H, Title 10, Code of Federal Regulations, Part 50 (10 CFR Part 50) U.S. Atomic Energy Commission, Federal Register 38, 136 (17 Jul 1973).
5. F.J. Loss, editor, "Structural Integrity of Water Reactor Pressure Boundary Components, Progress Report ending 31 May 1976," NRL Memorandum Report 3353, NRL-NUREG-2, September 1976, pp. 22-32.
6. J.R. Hawthorne, *Radiation Effects Information Generated on the ASTM Reference Correlation Monitor Steels*, ASTM Data Series 54, American Society for Testing and Materials, Philadelphia, 1972.

DEPARTMENT OF THE NAVY

NAVAL RESEARCH LABORATORY  
Washington, D.C. 20375

OFFICIAL BUSINESS

PENALTY FOR PRIVATE USE: \$300

POSTAGE AND FEES PAID  
DEPARTMENT OF THE NAVY  
DOD-316  
THIRD CLASS MAIL

