

AD-A685 050

NAVAL POSTGRADUATE SCHOOL MONTEREY CA
DEVELOPMENT OF A NONLINEAR 'D' TYPE BOILER MODEL.(U)
DEC 79 T D WALKER

F/6 13/10

UNCLASSIFIED

NL

1 OF 1
ADA
095050

END
DATE
FILMED
7-80
DTIC

50
ADA 085050

2

NAVAL POSTGRADUATE SCHOOL

Monterey, California

LEVEL



TIC
CTE
JUN 4 1980
D
C

THESIS

DEVELOPMENT OF A NONLINEAR "D" TYPE
BOILER MODEL

by

Thomas Daniel Leclair Walker

December 1979

Thesis Advisor:

T. M. Houlihan

Approved for public release; distribution unlimited.

DDC FILE COPY

80 6 3 048

UNCLASSIFIED

SECURITY CLASSIFICATION OF THIS PAGE (When Data Entered)

REPORT DOCUMENTATION PAGE		READ INSTRUCTIONS BEFORE COMPLETING FORM
1. REPORT NUMBER	2. GOVT ACCESSION NO. AD-A085050	3. RECIPIENT'S CATALOG NUMBER 9
4. TITLE (and Subtitle) Development of a Nonlinear "D" Type Boiler Model.		5. TYPE OF REPORT & PERIOD COVERED Master's Thesis December 1979
7. AUTHOR(s) Thomas Daniel LeClair/Walker		6. PERFORMING ORG. REPORT NUMBER
9. PERFORMING ORGANIZATION NAME AND ADDRESS Naval Postgraduate School Monterey, California 93940		8. CONTRACT OR GRANT NUMBER(s)
11. CONTROLLING OFFICE NAME AND ADDRESS Naval Postgraduate School Monterey, California 93940		10. PROGRAM ELEMENT, PROJECT, TASK AREA & WORK UNIT NUMBERS
14. MONITORING AGENCY NAME & ADDRESS (if different from Controlling Office)		12. REPORT DATE December 1979
		13. NUMBER OF PAGES 91 (1292)
		15. SECURITY CLASS. (of this report) Unclassified
		15a. DECLASSIFICATION/DOWNGRADING SCHEDULE
16. DISTRIBUTION STATEMENT (of this Report) Approved for public release; distribution unlimited.		
17. DISTRIBUTION STATEMENT (of the abstract entered in Block 20, if different from Report)		
18. SUPPLEMENTARY NOTES		
19. KEY WORDS (Continue on reverse side if necessary and identify by block number) Boiler Model, Shrink, Swell, Nonlinear Model, "D" Type Boiler.		
20. ABSTRACT (Continue on reverse side if necessary and identify by block number) A nonlinear digital model of a "D" type marine boiler is developed with emphasis on water level shrink and swell phenomena. Results indicate that further specifications of the phenomena are necessary before operational values of drum level are attained.		

DD FORM 1473
1 JAN 73
(Page 1)EDITION OF 1 NOV 65 IS OBSOLETE
S/N 0102-014-6601

UNCLASSIFIED

SECURITY CLASSIFICATION OF THIS PAGE (When Data Entered)

1

251450

Approved for public release; distribution unlimited

DEVELOPMENT OF A NONLINEAR "D" TYPE
BOILER MODEL

by

Thomas Daniel LeClair Walker
Lieutenant, United States Navy
BSEE, Purdue University, 1973


Submitted in partial fulfillment of the
requirements for the degree of

MASTER OF SCIENCE IN MECHANICAL ENGINEERING

from the


NAVAL POSTGRADUATE SCHOOL
December 1979

Author

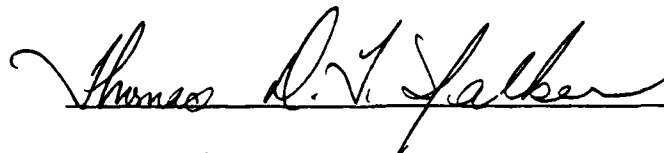

Approved by:

Thesis Advisor



Chairman, Department of Mechanical Engineering



Dean of Science and Engineering

ABSTRACT

A nonlinear digital model of a "D" type marine boiler is developed with emphasis on water level shrink and swell phenomena. Results indicate that further specifications of the phenomena are necessary before operational values of drum level are attained.

Accession For	
NTIS GMA&I	☒
DDC TAB	☐
Unannounced	
Justification	
By _____	
Distribution/	
Availability Codes	
Dist	Available/or Special

A

TABLE OF CONTENTS

ABSTRACT -----	3
LIST OF TABLES -----	6
LIST OF FIGURES -----	7
I. INTRODUCTION -----	8
II. MODEL CONSIDERATIONS -----	10
A. BOILER TYPE -----	10
B. MODEL NOMENCLATURE -----	10
C. EQUATION DEVELOPMENT FORMAT -----	11
D. ASSUMPTIONS -----	11
III. MODEL DEVELOPMENT -----	13
A. GENERAL -----	13
B. FURNACE SIDE HEAT TRANSFER -----	13
1. Furnace to Screen Risers -----	15
2. Flue Gas to Superheater -----	17
3. Flue Gas to Main Bank Risers -----	21
4. Flue Gas to Economizer -----	23
C. WATER SIDE HEAT TRANSFER -----	25
1. Risers -----	25
2. Desuperheater -----	27
3. Economizer -----	30
4. Superheater -----	32
D. WATER SIDE CIRCULATION -----	33
1. General -----	33
2. Downcomer Pressure Drop -----	34

3.	Riser Pressure Drop -----	36
4.	Riser Continuity -----	41
5.	Riser Quality and Density -----	42
6.	Riser Boiling Boundary Location -----	45
7.	Steam Drum Liquid Mass and Energy Balance -----	46
8.	Circulation System Initial Condition Iteration Procedure -----	49
9.	Superheater Pressure Drop -----	51
10.	Steam Valve Equation -----	51
E.	EQUATIONS OF STATE -----	52
IV.	RESULTS AND CONCLUSIONS -----	53
A.	GENERAL -----	53
B.	OPEN LOOP RESPONSE -----	55
C.	CONCLUSIONS -----	57
D.	SUGGESTIONS FOR FURTHER RESEARCH -----	58
V.	TABLE -----	60
VI.	FIGURES -----	61
	APPENDIX A: INITIAL CONDITION PROGRAM -----	68
	APPENDIX B: MODEL PROGRAM LISTING -----	79
	APPENDIX C: TECHNICAL MANUAL DATA -----	87
	LIST OF REFERENCES -----	89
	INITIAL DISTRIBUTION LIST -----	91

LIST OF TABLES

Table I.	MODEL NOTATION -----	60
----------	----------------------	----

LIST OF FIGURES

Figure 1.	Schematic Diagram of a Naval Boiler -----	61
Figure 2.	Open Loop - 10% Increase in Throttle Opening Water Level -----	62
Figure 3.	Open Loop - 10% Increase in Throttle Opening Steam Flow Rate -----	63
Figure 4.	Open Loop - 10% Increase in Throttle Opening Superheater Outlet Temperature -----	64
Figure 5.	Open Loop - 10% Increase in Throttle Opening Riser Outlet Quality -----	65
Figure 6.	Open Loop - 10% Increase in Throttle Opening Drum Pressure -----	66
Figure 7.	Open Loop - 10% Increase in Throttle Opening Riser Mass Flow Rates -----	67

I. INTRODUCTION

Recent developments in control theory and practice coupled with digital electronics advances have produced increased interest in digital power plant modeling. Although conventional marine boiler modeling is not a new concept, it is still an area of increased interest due to the relative lack of analytical data. This deficiency is due primarily to the extreme environment that must be endured by sampling equipment. Advances in data collecting and processing equipment have made boiler data collection practically feasible, and in fact, nuclear steam generator development depends heavily on actual data. However, it is not economically feasible for a single manufacturer to retrofit modern data collection systems on a standard marine boiler. The majority of marine boiler models available are not attractive from the control engineer's viewpoint because of one or more of the following:

- a. The model is over-simplified to the point of being a "teapot" model.
- b. The model is completely developed and written in Laplace transforms and the state space equations are too difficult to extract.
- c. The model is over-complicated to the point of being computationally inefficient.

- d. The causes and modeling of "shrink and swell" phenomena are ignored.

This model attempts to compromise between simplification and complication while including a theory and model for shrink and swell. The model follows the path specified by Fini [1] restated below:

- a. A general D-type marine boiler model is prepared in Continuous System Modeling Program (CSMP) language.
- b. A general FORTRAN program is used to prepare the initial conditions needed by the CSMP model.
- c. The initial condition program depends only on data easily obtained from the manufacturer's technical manual and engineering handbooks.

II. MODEL CONSIDERATIONS

A. BOILER TYPE

The D-type boiler was chosen for modeling because of its comparative standardization among manufacturers coupled with its popularity in naval ship power plants. This particular boiler is one installed in the LHA-1 class of United States naval ships. Since D-type boilers operate under a wide range of geometry and output conditions the initial condition and model programs are designed to operate over similar ranges.

B. MODEL NOMENCLATURE

The model nomenclature differs from reference [1] because of a need to clarify the model equations and afford readability to the actual computer programs. The following objectives were considered when developing the nomenclature.

- a. The equations must be easily read, necessitating minimum variable-definition referrals by the reader.
- b. The notation used in the model development must be the same as that used in the computer programs.

The resulting notation combines a. and b. and consists of frequently used notations for variables followed by a subscript to indicate state point location and/or time using Figure 1.

Table 1, a tabulation of general rules and examples,

should suffice to allow the reader to follow the model development.

C. EQUATION DEVELOPMENT FORMAT

The dynamic model and initial condition programs are developed simultaneously with corresponding equations written in appropriate proximity to each other. A notation of [IC] following an equation indicates that it is an initial condition equation, while a notation of [ME] indicates a model equation. In some instances the equation applies to both programs, an indication of [IC, ME] is used to indicate this.

In as many instances as possible equations are developed directly from elementary heat transfer and fluid dynamic principles. This stems from a desire to encourage more research in this particular field and to foster a better understanding of marine boiler dynamics among students of marine engineering. The model was developed to be read and used by students with a minimum of additional research.

D. ASSUMPTIONS

Various assumptions are made to facilitate either model simplification or program tractability. The latter are not always desirable and further research or different programming techniques may obviate the need for them. The following major assumptions are made:

1. The energy transferred to the generating tubes is distributed uniformly, i.e. "even heating" exists.

2. There is a thorough mixing of the fluid in the steam drum.
3. Steam generation occurs only in the boiling section of the screen and main bank risers.
4. All generating tubes and downcomers in a particular circuit have the average geometry.

Uniform energy transfer is assumed to facilitate model simplification and is justifiable since the generating banks are designed to optimize uniform heat transfer. Mixing of the fluid in the drum is a result of the turbulence in the drum. The third assumption results from a lack of reliable experimental data and the knowledge that D-type boilers are natural circulation boilers relying on a density difference in the circulation loop to promote flow. Steam production outside of the generating banks would decrease the density difference, thus inhibiting natural circulation. The geometry assumption is necessitated by model simplification.

III. MODEL DEVELOPMENT

A. GENERAL

The boiler is developed from control volumes for which the appropriate equations for energy transfer and storage rates are written. The initial condition equations are generated by setting the rate (d/dt) terms equal to zero and solving for the desired variables.

The model is developed with three different elements:

1. Furnace-side heat transfer
2. Water-side heat transfer
3. Water-side circulation

B. FURNACE-SIDE HEAT TRANSFER

The gas flow path can be followed on Figure 1 where it is represented by the dashed line. The fuel and air mixture enters the furnace at state point Q where radiation heat transfer occurs to the screen riser tube metal. The flue gas then leaves the furnace and exchanges heat via convection with the superheater (state point R-S), main bank riser tubes (state points S-T), and economizer (state points T-U) in that order.

At state point Q the fuel-to-air ratio and fuel and air temperatures are relatively constant. This allows the sensible heat of the fuel and air to be lumped. The mass flow rate into the furnace is the sum of the air flow and fuel flow.

$$MQQ = MFQQ + MAQQ \quad [ME]$$

The initial values of fuel and air flow at a specified operating point are known. Therefore, the corresponding initial condition equation is:

$$MQQ\phi = MFQQ\phi + MAQQ\phi \quad [IC]$$

The mass flow rates through the remaining sections of the boiler are the same.

$$MQQ = MRR = MSS = MTT = MUU \quad [ME]$$

$$MQQ\phi = MRR\phi = MSS\phi = MTT\phi = MUU\phi \quad [IC]$$

The total heat supplied to the boiler can be written as the product of the mass flow rate of fuel and the "lumped" fuel heating value.

$$QQ = MFQQ * FHV \quad [ME]$$

At a specific operating point the heat released to the furnace is available from the technical manual as is the furnace volume. The total heat input at steady state is the product of these two.

$$QQ\phi = QTOT\phi * FURVOL \quad [IC]$$

This allows the computation of the fuel heating value.

$$FHV = QQ\phi / MFQQ\phi \quad [IC]$$

1. Furnace to Screen Risers

The heat transfer to the furnace screen tubes occurs primarily through radiation, i.e.

$$Q = \sigma A (T_{RR}^4 - T_{VV}^4)$$

which is the Stefan-Boltzmann law¹ where σ is the Stefan-Boltzmann constant defined as:

$$\sigma = 2.8567 \times 10^{-11} \frac{\text{BTU}}{\text{Sec-ft}^2-\text{R}^4}$$

Therefore the heat transfer to the furnace screen can be written

$$Q1 = \text{SIGMAA} * ((T_{RR} + 46\phi.\phi) ** 4.\phi - (T_{VV} + 46\phi.\phi) ** 4.\phi) \quad [\text{ME}]$$

where

$$\text{SIGMAA} \equiv \sigma * A$$

At a given operating point, technical manual values are specified for the furnace heat absorption rate and the area of the radiant heat absorbing surface of the furnace screen. The product of these two yields the steady state heat transfer rate which in turn can be used to compute SIGMAA.

¹This equation assumes that all the radiation from the combustion flame strikes the screen tubes, and both the flame and the tubes behave as black surfaces.

$$Q1\phi = QFURAB * ARAD \quad [IC]$$

$$SIGMAA = Q1\phi / ((TRR\phi + 46\phi.\phi) ** 4.\phi - (TVV\phi + 46\phi.\phi) ** 4.\phi)$$

An energy balance equation for the mass of flue gases in the furnace region can be written in the form

$$\frac{d}{dt} (m c_p T) = \text{total energy supplied} - \text{energy transferred to screen tubes} - \text{energy of gas leaving furnace region}$$

or

$$\frac{d}{dt} (MASSQR * CQR * TRR) = QQ - Q1 - MRR * CQR * (TRR - TAMB)$$

Note: TRR-TAMB is the absolute temperature. At steady state the rate terms are equal to zero. Values of total heat supplied to the boiler, heat transfer rate to the screen tubes, total flue gas flow rate, and flue gas temperature are available from previous equations. This allows the specific heat of the flue gas in the furnace region to be computed.

$$CQR = (QQ\phi - Q1\phi) / (MRR\phi * (TQR\phi - TAMB)) \quad [IC]$$

During a transient, the density of the flue gas in the furnace and the specific heat of the furnace flue gas can be regarded as constants near a steady state operating point. The dynamic equation can be written as

$$DTRR = \frac{(QQ - Q1 - MRR * CQR * (TRR - TAMB))}{(MASSQR * CQR)} \quad [ME]$$

where

$$MASSQR = RFLUE * FURVOL \quad [IC]$$

Thus,

$$TRR = \int_{t_1}^{t_2} DTRR + TRR\phi$$

or in CSMP-III language

$$TRR = INTGRL(TRR\phi, DTRR) \quad [ME]$$

The value for TRR0 is available from the technical manual.

2. Flue Gas to Superheater

For the remaining tube banks heat transfer occurs primarily through convection. The energy given up by the flue gas in flowing over the tube surfaces is represented by the general equation

$$\begin{array}{lcl} \text{energy} & = & \text{mass flow} * \text{specific} \\ \text{given up} & & \text{rate of} \quad \text{heat of} \\ & & \text{flue gas} \quad \text{flue gas} \end{array}$$

* change in temperature of the gas

i.e.

$$q = \dot{m} C_p \Delta T$$

At steady state, the energy transferred to the superheater tubes from the gas must equal the energy transferred from the tubes to the steam.

$$Q_{3\phi} = Q_{4\phi} \quad [IC]$$

The steady state values for superheater inlet and outlet steam temperature and pressure are specified by the technical manual along with the superheated steam mass flow rate. This allows the direct computation of Q_{40} and Q_{30} .

$$Q_{4\phi} = \dot{M}_{MM\phi} * (H_{NN\phi} - H_{MM\phi}) \quad [IC]$$

H_{MM0} is the enthalpy of saturated steam corresponding to drum pressure, computed with curve fitted equations [2]. H_{NN0} is available directly from the technical manual. The specific heat of the flue gas in the superheater region can now be computed.

$$C_{RS} = Q_{3\phi} / (\dot{M}_{RR\phi} * (T_{RR\phi} - T_{SS\phi})) \quad [IC]$$

Thus the dynamic equation for heat transferred from the flue gas to the tube metal is written:

$$Q_3 = \dot{M}_{RR} * C_{RS} * (T_{RR} - T_{SS}) \quad [ME]$$

The heat transferred to the tubes via convection may also be represented by the Grimson correlation [3] which states that for cross flow over tubes;

$$\frac{hd}{k_f} = C \left(\frac{u_\infty d}{\nu_f} \right)^n Pr^{1/3}$$

where

u_∞ = velocity

d = tube diameter

C = constant

Pr = Prandtl number

Since h can also be written

$$h = q / A \Delta T$$

then

$$q = AC \left(\frac{u_\infty d}{\nu_f} \right)^n Pr^{1/3} \Delta T \left(\frac{k_f}{d} \right)$$

also

$$u_\infty = \frac{\dot{m}}{\rho A}$$

leading to the general equation

$$q = AC \left(\frac{d}{\nu_f \rho A} \right)^n Pr^{1/3} \dot{m}^n \Delta T \left(\frac{k_f}{d} \right)$$

Around a particular steady state operating point the physical properties can be regarded as a constant and the physical dimensions are constant, i.e.

$$AC \left(\frac{d}{\nu_f \rho A} \right)^n Pr^{1/3} = \text{constant}$$

which implies

$$q = (\text{constant}) * \dot{m}^n \Delta T$$

For flow over tube banks with differing rows of tubes and differing tube geometries the constant (n) varies little and the average is approximately .6 [3]. Therefore, in the case of the superheater and main bank riser tubes, the correlation is used in the form

$$q = C \dot{m}^{.6} \Delta T$$

or for the superheater

$$Q3 = KRS * MRR * * .6 * (TRS - TWW)$$

where TRS is the average flue gas temperature

$$TRS = (TRR + TSS) / 2.0$$

Since the steady state values for Q30, MRR0, TRR0, TSS0, and TWW0 are given by the technical manual the constant KRS can be calculated.

$$KRS = Q30 / (MRR0 * * .6 * (TRS0 - TWW0)) [IC]$$

To provide the dynamic solution of superheater flue gas outlet temperature, the two transient equations for the flue gas to superheater tube metal heat transfer are equated resulting in

$$\frac{TRS - TWW}{TRR - TSS} = MRR \cdot .4 * CRS / KRS$$

where

$$TRS = (TRR + TSS) / 2.0$$

Solving the above for TSS gives

$$TSS = (TRR * (PHI1 - 1) + 2 * TWW) / (PHI1 + 1) \quad [ME]$$

where

$$PHI1 = 2 * MRR * .4 * CRS / KRS \quad [ME]$$

3. Flue Gas to Main Bank Risers

The equations for the flue gas to tube metal energy transfer in the main bank are derived similarly. For the equation involving flue gas specific heat;

$$Q5 = MSS * CST * (TSS - TTT) \quad [ME]$$

The Grimson correlation equation for the main bank risers is

$$Q5 = KST * MSS * .6 * (TST - TTY)$$

where

$$T_{ST} = (T_{SS} + T_{TT}) / 2.0$$

By equating these two equations as was done with the superheater the flue gas temperature leaving the main bank can be written

$$T_{TT} = (T_{SS} * (PHI2 - 1) + 2 * T_{YY}) / (PHI2 + 1) \text{ [ME]}$$

where

$$PHI2 = 2 * M_{SS} * 0.4 * C_{ST} / K_{ST} \text{ [ME]}$$

The steady state heat transfer is computed differently than that for the superheater. Since the steady state heat transfer to the screen bank has been computed, the energy transferred to the main bank is the difference between the total energy transferred and the desuperheater and screen bank energy transfer. At steady state the mass flow rate of steam out of the boiler is equal to the mass flow rate of feed in the boiler and the total energy transferred is the mass flow rate multiplied by the enthalpy change between the outgoing steam and incoming feedwater. Thus, the steady state energy transfer equation for the main bank is

$$Q_{60} = M_{MM} * (H_{MM} - H_{SS}) - Q_{20} - Q_{990} \text{ [IC]}$$

Q₉₉₀ is computed in the water side heat transfer section.

Since Q₅₀ = Q₆₀ at steady state the heat transfer coefficient K_{ST} and the specific heat C_{ST} can be computed.

$$K_{ST} = Q_{50} / (M_{SS} * 0.6 * (T_{ST} - T_{YY})) \text{ [IC]}$$

$$C_{ST} = Q_{50} / (M_{SS} * (T_{SS} - T_{TT})) \text{ [IC]}$$

4. Flue Gas to Economizer

The economizer tubes differ from the generating and superheater tubes in that they are finned. A reasonable finned tube heat transfer correlation was developed by Weirmann, et al. [4]

$$j = \frac{h P_r^{2/3}}{C_p G_{\max}}$$

$G_{\max}$ $\equiv$ maximum mass flow rate

j $\equiv$ correlation constant

C_p $\equiv$ specific heat of flue gas

Since $h = \frac{q}{A \Delta T}$ the above

correlation can be written

$$q = \frac{j A \Delta T C_p G_{\max}}{P_r^{2/3}}$$

$G_{\max}$ is a function of mass flow rate into the tube bank and tube bank geometry. Similar to the case of the Grimson coefficient used for the superheater and main bank tubes the physical and geometric properties are considered constant leading to the use of the correlation in the form

$$q = C \dot{m} \Delta T$$

Therefore, for the economizer the equation is

$$Q7 = K_{TU} * M_{TT} * (T_{TU} - T_{XX})$$

where

$$T_{TU} = \frac{T_{TT} + T_{UU}}{2.0}$$

Paralleling the superheater and main bank, the heat transfer may also be written

$$Q7 = M_{TT} * C_{TU} * (T_{TT} - T_{UU}) \quad [ME]$$

The steady state equation development follows that of the superheater and main bank sections and is not repeated here.

The equations are:

$$Q8\phi = MAA\phi * (H_{BS\phi} - H_{AA\phi}) \quad [IC]$$

$$Q7\phi = Q8\phi \quad [IC]$$

$$C_{TU} = Q7\phi / (M_{TT\phi} * (T_{TT\phi} - T_{UU\phi})) \quad [IC]$$

$$K_{TU} = Q7\phi / (M_{TT\phi} * (T_{TU\phi} - T_{XX\phi})) \quad [IC]$$

$$T_{TU\phi} = (T_{TT\phi} + T_{UU\phi}) / 2.0 \quad [IC]$$

Knowing the values for K_{TU} and C_{TU} developed by the initial condition program allows the solution of the flue gas outlet temperature in the transient analysis. Thus,

$$[ME] \quad T_{UU} = (T_{TT} * (PHI3 - 1.0) + 2.0 * T_{XX}) / (PHI3 + 1.0)$$

$$[ME] \quad PHI3 = 2.0 * C_{TU} / K_{TU}$$

C. WATER SIDE HEAT TRANSFER

1. Risers

The heat supplied to the riser banks is used both in the boiling and nonboiling length of the tube; however the assumption is made here that the heat transfer is all under fully developed flow boiling conditions. Since the nonboiling length of the risers is relatively small, little error is produced. For fully developed nucleate flow boiling, Levy [5] suggests the equation

$$Q = \frac{A P_{sat}^{4/3}}{1.782 \times 10^6} \Delta T_{sat}^3 \frac{BTU}{sec-ft^2}$$

By lumping the constant area and denominator the riser equations can be written in the forms

$$Q = C * P_{SAT}^{4/3} * \Delta T_{SAT}^3$$

Therefore, the two riser equations are

$$Q_2 = K_V * P_{SAT} * (4.0/3.0) * (T_W - T_{SAT}) * 3.0 \text{ [ME]}$$

and

$$Q_6 = K_Y * P_{SAT} * (4.0/3.0) * (T_Y - T_{SAT}) * 3.0 \text{ [ME]}$$

for the screen and main bank respectively. A simple energy balance on the tube metal yields the metal temperatures, i.e.,

$$mass * C_p * \frac{dT}{dt} = q_{in} - q_{out}$$

The equations for screen and main bank metal temperatures are:

$$\begin{aligned} \text{DTVV} &= (Q1 - Q2) / (\text{MASSV} * \text{CPV}) & [\text{ME}] \\ \text{TVV} &= \text{INTGRL}(\text{TVV}\phi, \text{DTVV}) & [\text{ME}] \\ \text{DTYY} &= (Q5 - Q6) / (\text{MASSY} * \text{CPY}) & [\text{ME}] \\ \text{TYV} &= \text{INTGRL}(\text{TYV}\phi, \text{DTYY}) & [\text{ME}] \end{aligned}$$

The heat transfer coefficient KY can be computed directly from tube geometrical data available in the technical manual:

$$\text{KY} = \text{AREAMB} / 1.782 \text{E } \phi 6 \quad [\text{IC}]$$

Since $Q10 = Q20$ at steady state, the dynamic equation for $Q20$ can be solved in a steady state situation for KV,

$$[\text{IC}] \quad \text{KV} = Q1\phi / (\text{PSAT} ** (4/3) * (\text{TVV}\phi - \text{TSAT}) ** 3.\phi)$$

$Q60$ was computed in Section III-B.3. This allows the calculation of the initial main bank riser tube metal temperature,

$$[\text{IC}] \quad \text{TYV}\phi = (Q6\phi / (\text{KY} * \text{PSAT} ** (4/3))) ** (1/3) + \text{TSAT}$$

In the case of the screen risers, the initial tube metal temperature is available from the technical manual and the initial heat transfer rate has been previously calculated. This allows the calculation of the screen riser steamside heat transfer coefficient,

$$[\text{IC}] \quad \text{KV} = Q1\phi / (\text{PSAT} ** (4.\phi/3.\phi) * (\text{TVV}\phi - \text{TSAT}) ** 3.\phi)$$

2. Desuperheater

The Dittus-Boelter correlation [6] is used to compute the heat transfer rate from the steam to the desuperheater tubes. This correlation in its basic format is

$$Nu = .023 Re^{0.8} Pr^n$$

where

Nu => Nusselt number

Re => Reynolds number

Pr => Prandtl number

n => .3 (for cooling fluid)

When the appropriate variables and constants are substituted for the dimensionless numbers, the Dittus-Boelter correlation can be written

$$Q = K \dot{m}^{.8} \Delta T$$

where the constant K is defined as:

$$K = .023 * \frac{\text{thermal conductivity} * \text{heat transfer area}}{\text{tube diameter}}$$

$$* \left(\frac{4}{\pi * \text{tube diameter} * \text{viscosity} * \text{nr of tubes}} \right)^{.8}$$

$$* Pr^{.3}$$

and ΔT is the log-mean-temperature difference (LMTD).

Thus, for the desuperheater, the equation is

$$Q9 = KNP * MNN * .8 * LMTDNP$$

KNP can be computed directly. Thus,

$$KNP = ((.023 * THCONN) / DNP) * (4.0 / (PI * DNP * VISCON * NTUBOS)) * .8 * PRAN * .3 * AREADS \quad [IC]$$

The energy given up by the steam to the tubes may also be written in terms of steam specific heat, flow rate, and temperature difference.

$$Q9 = CNP * MNN * (TNN - TPP) \quad [ME]$$

Similarly since the heat transfer to the water in the drum is totally by convection;

$$Q99 = KZ * (TZZ - THH) \quad [ME]$$

For initial condition calculations THH is considered to be equal to TSAT. Therefore

$$KZ = Q99 / (TZZ - TSAT) \quad [IC]$$

The desuperheater outlet temperature is solved by equating the two dynamic equations for Q9 and solving for the desired outlet temperature.

$$TPP = (TNN - TZZ) / (EXP(KNP / (CNP * MNN * .2))) + TZZ \quad [ME]$$

The instantaneous desuperheater tube metal temperature is obtained by an energy balance on the tube metal similar to that for the riser tube metal.

$$\text{mass} * C_p * \frac{dT}{dt} = q_{in} - q_{out}$$

Solving the appropriate equation for dT/dt results in

$$DTZZ = (Q9 - Q99) / (\text{MASSZ} * CPZ) \quad [ME]$$

$$TZZ = \text{INTERL}(TZZ\phi, DTZZ \quad [ME]$$

The specific heat of the steam in the desuperheater (CNP) may be calculated using the known steady state values for desuperheated steam flow rate and the desuperheater inlet and outlet temperatures and pressures.

$$Q9\phi = MNN\phi * (HNN\phi - HPP\phi) \quad [IC]$$

$$CNP = Q9\phi / (MNN\phi * (TNN\phi - TPP\phi)) \quad [IC]$$

With the value of $Q90$ computed the initial log-mean-temperature difference can be calculated.

$$LMTDNP = Q9\phi / (KNP * MNN\phi * \phi.8)$$

The log-mean-temperature difference is a function of steam temperature in, tube metal temperature, and steam temperature out; therefore the initial tube metal temperature may be calculated.

$$T_{\bar{z}\bar{z}\phi} = (T_{NN\phi} - EXP_{ODS} * T_{PP\phi}) / (1.\phi - EXP_{ODS}) \quad [IC]$$

$$EXP_{ODS} = EXP((T_{NN\phi} - T_{PP\phi}) / LMT_{ONP}) \quad [IC]$$

3. Economizer

Paralleling the desuperheater development the Dittus-Boelter correlation is used to relate the heat transfer from the tube metal to the feedwater. Thus,

$$Nu = .\phi 23 Re^{.8} Pr^n$$

the only difference being that n is now .4 vice .3 because the fluid is now being heated. The appropriate constants are again lumped yielding

$$Q_8 = KX * MAA * \phi .8 * LMT_{DAB}$$

An energy balance on the water gives the heat absorbed in two other forms;

$$Q_8 = MAA * (H_{BB} - H_{AA})$$

$$Q_8 = MAA * C_{AB} * (T_{BB} - T_{AA}) \quad [ME]$$

At the specified operating point the inlet and outlet conditions of the economizer as well as the mass flow rate are given, allowing the computation of the steady state heat transfer.

$$Q_{8\phi} = MAA_{\phi} * (H_{BB\phi} - H_{AA\phi}) \quad [IC]$$

The heat transfer coefficient KX is computed directly.

$$KX = ((.023 * THCONA) / DAB) * (4.0 / (PI * DAB * VISCOA * NTUBEC)) * \phi.8 * PRAA * \phi.4 * AREAAC \quad [IC]$$

This permits the solution of the steady state log-mean-temperature difference.

$$LMTDAB = Q8\phi / (KX * MAA\phi * \phi.8) \quad [IC]$$

Following the identical path delineated for the desuperheater, the tube metal initial temperature can be computed.

$$TXX\phi = (TAA\phi - TBB\phi * EXPOEC) / (1.0 - EXPOEC) \quad [IC]$$

$$EXPOEC = EXP((TBB\phi - TAA\phi) / LMTDAB) \quad [IC]$$

An energy balance on the economizer tube metal yields its instantaneous temperature.

$$DTXX = (Q8 - Q7) / (MASSX * CPX) \quad [ME]$$

$$TXX = INTGRL(TXX\phi, DTXX) \quad [ME]$$

By equating the formulations for Q8 involving LMTD and specific heat, the economizer outlet temperature may be calculated.

$$TBB = (TAA - TXX) / (EXP(KX / (CAB * MAA * \phi.2))) + TXX \quad [ME]$$

The specific heat of the feedwater in the economizer is calculated at steady state using the computed value of steady state heat transfer and the given mass flow rates and inlet and outlet temperatures.

$$CAB = Q8\phi / (MAA\phi * (TBS\phi - TAA\phi)) \quad [IC]$$

4. Superheater

The development of the superheater equations follows that of the desuperheater and economizer and for that reason the development will not be repeated. The equations are listed below.

$$Q4 = CMN * MMM * (TNN - TMM) \quad [ME]$$

$$Q4\phi = MMM\phi * (HNN\phi - HMM\phi) \quad [IC]$$

$$CMN = Q4\phi / (MMM\phi * (TNN\phi - TMM\phi)) \quad [IC]$$

The initial superheater log-mean-temperature difference is computed directly allowing the subsequent calculation of the tube-metal-to-steam heat transfer coefficient used in the Dittus-Boelter equation.

$$LMTOMN = (TNN\phi - TMM\phi) / (A \log ((TWW\phi - TMM\phi) / (TWW\phi - TNN\phi))) \quad [IC]$$

$$KW = Q4\phi / (MMM\phi * \phi.8 * LMTOMN) \quad [IC]$$

An energy balance on the tube metal yields the instantaneous tube metal temperature, the initial tube metal temperature being available from the technical manual.

$$DTWW = (Q3 - Q4) / (MASSW * CPW) \quad [ME]$$

$$TWW = \text{INTGRL} (TWW\phi, DTWW) \quad [ME]$$

The superheater outlet temperature can now be calculated.

$$TNN = (TMM - TWW) / (\text{EXP} (KW / (CMN * MNN * \phi.2))) + TWW \quad [ME]$$

D. WATER-SIDE CIRCULATION

1. General

The water/steam side circulation equations are by far the most difficult to visualize and codify. These equations must be accurate in order to predict phenomena such as shrink and swell while appropriate assumptions and simplifications must be made in order to make the equations tractable.

As can be seen in Figure 1, the feedwater enters the economizer at state point A, passes through the economizer to the steam drum where it becomes part of the water volume. The liquid leaves the drum via the downcomers, both main bank and screen at state points G and C respectively. The main bank downcomer delivers its liquid to the main bank risers via the water drum, and the main bank risers deliver the fluid to the steam separators. The flow through the screen risers is the same with the exception that there is no water drum in this circuit. The steam separators separate the majority of

the water from the steam leaving the drum at state point M and the majority of the steam from the water being discharged back into the drum liquid. The steam, with a negligible amount of water passes through the superheater via state point M-N. At the outlet of the superheater the steam leaving at path III is used for "main" steam; that leaving via path II travels to the desuperheater where it is cooled, then leaves via state point P and is used for auxiliary steam.

The water leaving the separators with a small amount of entrained vapor is mixed with the incoming feed water and forms a "foaming" vapor/liquid mass in the bottom half of the drum. The liquid from this mass leaves via the downcomers and is circulated through the loop.

2. Downcomer Pressure Drop

A closer look at the downcomer flow is necessary to justify assumptions that are made in the development of the pressure-drop equations.

Circulation ratio is defined as the ratio of the total weight of steam liberated to the drum [7]. For a 600 pound marine boiler this circulation ratio is on the order of 20:1 [7 and 8]. This implies that for every 21 pounds of liquid flowing down the downcomers, 20 pounds of it has already traveled up the riser and is at saturation temperature. Therefore, assuming the downcomers are perfectly insulated, it is reasonable to assume that the downcomer liquid is at or very near saturation temperature.

The momentum equation for the downcomers may be written:

$$\begin{aligned}
 & \text{pressure at top} - \text{pressure at bottom} \\
 = & \text{frictional loss} - \text{gravitational head} \\
 & + \text{entrance loss} \quad + \text{bend loss} \\
 & + \text{exit loss} \quad + \text{inertia force}
 \end{aligned}$$

The inertia force term may be considered negligible [9].

This is the quasistatic approximation which basically states that pressure waves move much more rapidly through the system than the important time constants. This is mathematically equivalent to the elimination of a large negative eigenvalue. This quasistatic approximation is only good for on-line transients and does not apply for extremely large discontinuities which would result in the boiler being taken out of operation, (e.g., a ruptured tube). Therefore the downcomer momentum equation can be written:

$$\begin{aligned}
 & \text{pressure at top} - \text{pressure at bottom} \\
 = & (\text{friction factor} * \text{downcomer length} \\
 & \div \text{downcomer diameter} + \text{entrance factor} \\
 & + \text{bend factor} \quad + \text{exit factor}) \\
 * & (\text{downcomer mass flow rate})^2 \div (2 * (\text{downcomer} \\
 & \text{cross sectional area})^2 * \text{density of fluid} \\
 & \text{in downcomer} * g_c) - \text{density of fluid in} \\
 & \text{downcomer} * \text{gravitational acceleration} * \\
 & \text{height of downcomer} \div g_c
 \end{aligned}$$

In the model notation

$$P_{CPD} = (F_{CD} * L_{CD}/O_{CD} + ENTR_{CD} + BEND_{CD} + EXIT_{CD}) * M_{CC} * 2.0 / (2.0 * A_{CD} * 2.0 * \rho_{HCD} * G) - \rho_{HCD} * G * Z_{CD}/G$$

$$P_{GPH} = (F_{GH} * L_{GH}/O_{GH} + ENTR_{GH} + BEND_{GH} + EXIT_{GH}) * M_{GG} * 2.0 / (2.0 * A_{GH} * 2.0 * \rho_{HGH} * G) - \rho_{HGH} * G * Z_{GH}/G$$

for the screen and main bank downcomers respectively. F_{CD} and F_{GH} are friction factors of the form

$$f = 1 / (1.74 - 2 \log (R/KS))$$

where R is the pipe radius and KS is the relative sand roughness [11].

$$F_{CD} = 1.0 / (1.74 - 2.0 * A \log_{10} (KS_{CD})) \quad [IC, ME]$$

$$F_{GH} = 1.0 / (1.74 - 2.0 * A \log_{10} (KS_{GH})) \quad [IC, ME]$$

3. Riser Pressure Drop

The momentum equation for the riser boiling section must take two phase flow effects into account because the flow in the boiling section is not homogeneous. Thus, there is a relative velocity between the liquid and vapor phases here. The steam separators are included in the riser length. However,

the effective length of the separators and thus the pressure drop are considered negligible because of a general lack of information concerning these items.

The pressure drop due to single phase or homogeneous flow in the nonboiling riser section can be written

$$\Delta P_{SPF} = \Delta P_{\text{acceleration}} + \Delta P_{\text{friction}} + \Delta P_{\text{gravity}}$$

$$\Delta P_{\text{acceleration}} = \frac{\dot{m}^2}{g_c * A^2} * \frac{(\rho_{\text{out}} - \rho_{\text{in}})}{\rho_{\text{out}} * \rho_{\text{in}}}$$

$$\Delta P_{\text{friction}} = \frac{4 * f * \text{length} * \dot{m}^2}{g_c * D * (\rho_{\text{out}} + \rho_{\text{in}}) * A^2}$$

$$\Delta P_{\text{gravity}} = \frac{g * \text{height} * (\rho_{\text{out}} + \rho_{\text{in}})}{2 * g_c}$$

Experiments conducted by Babcock and Wilcox [10] indicate that these homogeneous flow pressure drops may be modified to give the appropriate two phase flow pressure drops using correction factors that are functions of outlet quality and operating pressure. The two phase flow pressure drop can be written;

$$\begin{aligned} \Delta P_{TPF} = & \Delta P_{\text{acceleration}} * r_{\text{acceleration}} \\ & + \Delta P_{\text{friction}} * r_{\text{friction}} \\ & + \Delta P_{\text{gravity}} * r_{\text{gravity}} \end{aligned}$$

where the r terms are two phase flow correction factors available by using curve fits of the data from reference [10].

The form of these r terms become:

$$R_{GRAVE} = 24.794 * XFF\phi * 2.\phi - 6.5\phi66 * XFF\phi + .9776 \quad [IC]$$

$$R_{GRAVK} = 24.794 * XLL\phi * 2.\phi - 6.5\phi66 * XLL\phi + .9776 \quad [IC]$$

$$R_{ACLE} = 15.4564 * XFF\phi * 2.\phi + 18.4944 * XFF\phi - .\phi\phi\phi\phi7 \quad [IC]$$

$$R_{ACLJ} = 15.4564 * XLL\phi * 2.\phi + 18.4944 * XLL\phi - .\phi\phi\phi\phi7 \quad [IC]$$

$$R_{FRICE} = -34.\phi822 * XFF\phi * 2.\phi + 23.7164 * XFF\phi + .8734 \quad [IC]$$

$$R_{FRICK} = -34.\phi822 * XLL\phi * 2.\phi + 23.7164 * XLL\phi + .8734 \quad [IC]$$

Therefore, in the boiling region of the riser

$$\Delta P_{TPF} = \frac{\dot{m}^2 r_{acl}}{g_c \rho_{in} A^2} + \frac{2 f (\text{boiling length}) \dot{m}^2 r_{fric}}{g_c (\text{diameter}) \rho_{in} A^2} + \frac{g (\text{height of boiling region}) \rho_{in} r_{grav}}{g_c}$$

The total pressure drop across the length of the riser is;

$$\Delta P = \Delta P_{SPF} + \Delta P_{TPF}$$

In model notation the equations are

$$\begin{aligned}
 POPF = & (MOD ** 2. \phi * (RHOEE - RHODD)) / (GC * RHOEE * \\
 & RHODD * ADE ** 2. \phi) + (4. \phi * FDE * LDE \\
 & * MOD ** 2. \phi) / (GC * DDE * (RHODD + \\
 & RHOEE) * ADE ** 2. \phi) + (G * ZDE * (RHODD \\
 & + RHOEE)) / (GC * 2. \phi) + (MOD ** 2. \phi * \\
 & RACLE) / (GC * RHOEE * AEF ** 2. \phi) + \\
 & (2. \phi * FEF * LEF * MOD ** 2. \phi * RFRICE) / \\
 & (GC * DEF * RHOEE * AEF ** 2. \phi) + \\
 & (G * ZEF * RHOEE * RGRAVE) / GC
 \end{aligned}$$

$$\begin{aligned}
 PJPL = & (MJJ ** 2. \phi * (RHOKK - RHQJJ)) / GC * RHOKK * \\
 & RHQJJ * AJK ** 2. \phi) + (4. \phi * FJK * MJJ ** \\
 & 2. \phi * LJK) / (GC * DJK * (RHQJJ + RHOKK) * \\
 & AJK ** 2. \phi + G * ZJK * (RHQJJ + RHOKK) / \\
 & (GC * 2. \phi) + (MJJ ** 2. \phi * RACK) / \\
 & (GC * RHOKK * AKL ** 2. \phi) + (2. \phi * \\
 & FKL * LKL * MJJ ** 2. \phi * RFRICK) / \\
 & (GC * DKL * RHOKK * AKL ** 2. \phi) + \\
 & (G * ZKL * RHOKK * RGRAVK) / GC
 \end{aligned}$$

The friction factors are in the same form as those for the downcomers

$$FDE = 1. \phi / (1.74 - 2. \phi * A \log 1 \phi (KSDE)) \quad [IC]$$

$$FEF = 1. \phi / (1.74 - 2. \phi * A \log 1 \phi (KSEF)) \quad [IC]$$

$$FJK = 1. \phi / (1.74 - 2. \phi * A \log 1 \phi (KSJK)) \quad [IC]$$

$$FKL = 1. \phi / (1.74 - 2. \phi * A \log 1 \phi (KSKL)) \quad [IC]$$

At a specified steady state operating point the pressure drop across the downcomers must equal the pressure drop across the risers and the downcomer flow rate must equal the riser flow rate. Therefore by equating the appropriate pressure drop equations and solving the resultant relation for the flow rates, the initial flow rates may be computed as

$$\begin{aligned} MFF\phi\phi = & ((RH\phi CD\phi * G * ZCD - G * ZDE\phi * ((RH\phi DD\phi \\ & + RH\phi EE\phi) / 2. \phi) - G * ZEF\phi * RH\phi EE\phi * \\ & RGRAVE) / ((FC\phi * LCD / DCD + ENTRCD + \\ & BENDCD + EXITCD) / (2. \phi * ACD * * 2. \phi \\ & * RH\phi CD\phi) + ((RH\phi EE\phi - RH\phi DD\phi) / \\ & (RH\phi EE\phi * RH\phi DD\phi * ADF * * 2. \phi)) + \\ & (4. \phi * FDE * LDE\phi * 2. \phi) / (2. \phi * DDF \\ & * (RH\phi EE\phi + RH\phi DD\phi) * ADF * * 2. \phi) + \\ & RACLE / (RH\phi EE\phi * ADF * * 2. \phi) + (4. \phi \\ & * FEF * LEF\phi * RFRICE) / (2. \phi * DDF \\ & * RH\phi EE\phi * ADF * * 2. \phi))) * * \phi.5 \quad [IC] \end{aligned}$$

$$\begin{aligned}
 MLL\phi\phi = & ((RHOSH\phi * G * ZGH - G * ZJK\phi * ((RHOJJ\phi \\
 & + RHOKK\phi / 2.\phi) - G * ZKL\phi * RHOKK\phi * \\
 & RGRAVK) / ((FGH * LGH / DGH + ENTGSH + \\
 & BENOSH + EXITGH) / (2.\phi * AGH * * 2.\phi \\
 & * RHOSH\phi + (RHOKK\phi - RHOJJ\phi) / \\
 & (RHOKK\phi * RHOJJ\phi * AJL * * 2.\phi)) + \\
 & (4.\phi * FJK * LJK\phi * 2.\phi) / (2.\phi * DJL \\
 & * (RHOKK\phi + RHOJJ\phi) * AJL * * 2.\phi) + \\
 & RACLJ / (RHOKK\phi * AJL * * 2.\phi) + (4.\phi \\
 & * FKL * LKL\phi * RFRICK) / (2.\phi * DJK \\
 & * RHOKK\phi * AJL * * 2.\phi))) * * \phi.5 \quad [IC]
 \end{aligned}$$

4. Riser Continuity

The relationship between the riser inlet and outlet mass flow rates is written in terms of the continuity equation for one dimensional unsteady flow,

$$\sum_{cs} \rho \bar{V} \cdot \bar{A} = - \frac{d}{dt} \int_{cv} \rho dV$$

In model notation, this becomes

$$MLL = MJJ - DRHOJL * VOLJL \quad [ME]$$

$$MFF = MOD - DRHODF * VOLDF \quad [ME]$$

The numerical differentiation technique used by CSMP-III is highly suspect, as are other techniques. An "averaging" system is used in the actual dynamic model. In addition, the flow rate down the downcomer and into the riser is held constant for the open loop boiler model.

5. Riser Quality and Density

The average density in the risers must be solved for explicitly. Linearly varying quality along the riser tube length follows directly from the assumption of uniform heat flux along the riser tube length. The average density along the tube length is the sum of the total change in density and the density entering divided by the riser tube length [1]. Assuming the density varies only in the boiling length of the riser, the total change in density can be written;

$$\int_{\text{boiling length}} \rho(l) dl$$

The average density is

$$\rho_{\text{average}} = \frac{1}{L} \left[\int_{\text{boiling length}} \rho(l) dl + \rho_f * \text{nonboiling length} \right]$$

where ρ_f = density of saturated water
 L = total tube length

Since $\rho(l)$ varies linearly from entering to exiting, $\rho(l)$ can be written in the form

$$\rho(l) = \frac{1}{V_f + \frac{X_{\text{out}}}{L_B} (1 - L_{NB}) V_{fg}} \quad [1]$$

where V_f = specific volume entering
 X_{out} = quality at riser outlet

L_B = boiling length

LN_B = nonboiling length

V_{fg} = change in specific volume from saturated liquid to saturated vapor

The integral of the explicit equation for $\rho(z)$ may be solved after rearrangement to

$$\rho(z) = \frac{1}{\left(V_f - \frac{x_{out} LN_B V_{fg}}{L_B}\right) + \frac{x_{out} V_{fg}}{L_B} z}$$

which is of the form

$$\frac{1}{a + bz}$$

This yields the average density,

$$\rho_{av} = \frac{1}{L} \left[\frac{L_B}{x_{out} V_{fg}} \ln \left[\frac{x_{out} V_{fg}}{V_f} + 1 \right] + \rho_f LN_B \right]$$

In model notation the formula is written

$$\begin{aligned} \text{RHODF}\phi &= (1.\phi / \text{LOF}) * (\text{LEF}\phi / ((\text{XFF}\phi) * \text{VFG}) \\ &\quad * \text{ALOG} (((\text{XFF}\phi) / \text{VF}) * \text{VFG} + 1.\phi) \\ &\quad + \text{RHODD}\phi * \text{LOE}\phi) \quad [\text{IC}, \text{ME}] \end{aligned}$$

$$\begin{aligned} \text{RHOTL}\phi &= (1.\phi / \text{LTL}) * (\text{LKL}\phi / ((\text{XLL}\phi) * \text{VFG}) * \\ &\quad \text{ALOG} ((\text{XLL}\phi * \text{VFG}) / \text{VF} + 1.\phi) + \text{RHOTJ}\phi \\ &\quad * \text{LTK}\phi \quad [\text{IC}, \text{ME}] \end{aligned}$$

To permit calculation of the quality term the energy balance on the liquid in the riser tubes is evaluated. Thus,

$$\begin{aligned} \text{rate of change} &= \text{flow energy} - \text{flow energy} \\ \text{of riser energy} &\quad \text{in} \quad \text{out} \\ &+ \text{thermal energy in} \end{aligned}$$

$$\frac{d}{dt} (\rho h V) = \dot{m}_{in} h_{in} - \dot{m}_{out} h_{out} + q_{in}$$

If the enthalpy term is treated as the average enthalpy in the riser the equation may be written

$$\frac{d}{dt} (\rho (h_f + x_{out} * h_{fg} / 2) V) = \dot{m}_{in} h_{in} - \dot{m}_{out} h_{out} + q_{in}$$

In model notation this is written in the form:

$$\begin{aligned} DHXLL = & (MGG * (HJT - HF - XLL * HFG / 2.0) + Q6 - MLL \\ & * XLL * HFG / 2.0) / (RHOJL * VOLKL) \quad [ME] \end{aligned}$$

$$HXLL = \text{INTGRL}(HXLL0, DHXLL) \quad [ME]$$

$$XLL = (HXLL - HF) * 2.0 / HFG \quad [ME]$$

$$\begin{aligned} DHXFF = & (MCC * (HDD - HF - XFF * HFG / 2.0) + Q2 \\ & - MFF * XFF * HFG / 2.0) / (RHODF * VOLEF) \quad [ME] \end{aligned}$$

$$HXFF = \text{INTGRL}(HXFF0, DHXFF) \quad [ME]$$

$$XFF = (HXFF - HF) * 2.0 / HFG \quad [ME]$$

The initial conditions, HXLLO and HXFFO are calculated in the initial condition program.

The steady state equations for quality are derived differently. The energy transfer rate to the riser liquid may be written in the form

$$\dot{Q} = \dot{m} \Delta h$$

where

$$\begin{aligned}\Delta h &= h_{out} - h_{in} \\ &= h_f + x_{out} h_{fg} - h_{in}\end{aligned}$$

Solving for x_{out} yields

$$x_{out} = (\dot{Q} + \dot{m} (h_f - h_{in})) / (\dot{m} h_{fg})$$

or

$$x_{FF\phi} = (Q1\phi + MFF\phi * (HF - HDD\phi)) / (MFF\phi * HFG) \quad [IC]$$

$$x_{LL\phi} = (Q5\phi + MLL\phi * (HF - HJJ\phi)) / (MLL\phi * HFG) \quad [IC]$$

6. Riser Boiling Boundary Location

The nonboiling length of riser tube is the product of the riser tube length and sensible to total heat ratio [1]

$$L_{NB} = L \ q_s / q_t$$

The sensible to total heat ratio may be expressed as the enthalpy change in raising the water to saturated conditions divided by the total enthalpy change, i.e.

$$\frac{q_s}{q_t} = \frac{h_f - h_{in}}{(h_f + x_{out} h_{fg}) - h_{in}}$$

The equations for nonboiling length are

$$LOE\phi = LDF * A_{MAX1}((HF - HDD\phi), \phi.\phi) / ((HDD\phi + x_{FF\phi} * HFG) - HDD\phi) \quad [IC]$$

$$LJK\phi = LTL * A_{MAX1}((HF - HJJ\phi), \phi.\phi) / ((HJJ\phi + x_{LL\phi} * HFG) - HJJ\phi) \quad [IC]$$

The Fortran function AMAX1 is used here because the above equations are used in an iterative loop in the initial condition program and there is a possibility during iterations of reaching a situation where the enthalpy entering is greater than saturation enthalpy. The final initial condition solution prevents this. The AMAX1 function is not used for the dynamic model. Thus,

$$LOE = LDF * (HF - HDD) / ((HF + XFF * HFG) - HDD) \quad [ME]$$

$$LJK = LJL * (HF - HJJ) / ((HF + XLL * HFG) - HJJ) \quad [ME]$$

The boiling volume is derived directly from the solution for the nonboiling length.

$$\text{boiling volume} = \text{total volume} * \frac{\text{boiling length}}{\text{total length}} \quad \text{Hence,}$$

$$VOLEF = VOLDF * LEF/LDF \quad [ME]$$

$$VOLKL = VOLJL * LKL/LJL \quad [ME]$$

7. Steam Drum Liquid Mass and Energy Balance

The rate of change of liquid mass within the drum is equal to the sum of the mass flow rates entering and leaving the drum. The liquid mass flowing into the drum is the saturated liquid from the risers, the liquid from steam condensation in the drum, and the incoming feedwater. The liquid leaving is that leaving via the downcomers. The dynamic model equation is

$$\begin{aligned} \text{DOMASL} = & \text{MLL} * (1.\phi - \text{XLL}) + \text{MFF} * (1.\phi - \text{XFF}) \\ & + \text{MCOND} + \text{MBS} - \text{MCC} - \text{MGG} \quad [\text{ME}] \end{aligned}$$

The instantaneous mass of liquid in the drum is

$$\text{DMASL} = \text{INTGRL}(\text{DMASL}\phi, \text{DOMASL}) \quad [\text{ME}]$$

where

$$\text{DMASL}\phi = (\text{VOLDRM} * \text{RODRML}) / 2.\phi \quad [\text{IC}]$$

The drum energy balance is derived similarly, i.e.,

$$\begin{aligned} \text{DDMOHL} = & \text{MLL} * (1.\phi - \text{XLL}) * \text{HF} + \text{MFF} * (1.\phi - \text{XFF}) \\ & * \text{HF} + \text{MCOND} * \text{HFG} + \text{MBS} * \text{HBS} - \text{MCC} \\ & * \text{HCC} - \text{MGG} * \text{HGG} \quad [\text{ME}] \end{aligned}$$

The instantaneous drum energy is

$$\text{DMOHL} = \text{INTGRL}(\text{DMOHL}\phi, \text{DDMOHL}) \quad [\text{ME}]$$

The initial drum energy is the product of the initial drum liquid mass and initial drum enthalpy.

$$\text{DMOHL}\phi = \text{DMASL}\phi * \text{HDRUM}\phi \quad [\text{IC}]$$

The initial drum liquid enthalpy is

$$\text{DH} = \text{DMOHL} / \text{DMASL}$$

In the dynamic model, drum liquid enthalpy is considered the enthalpy of saturated liquid.

The steam condensation rate equation is based on the difference between the pressure and temperature of the steam and that of the liquid [12]

$$M_{COND} = 56\phi.93 * (P_{MM} / (T_{MM} + 46\phi.\phi) * * \phi.5 - P_{SAT} / (T_{SAT} + 46\phi.\phi) * * \phi.5) + .\phi2568 \quad [ME]$$

The water level in a marine boiler is generally considered in reference to a mid-drum zero, that is, a water level of plus one inch implies the water level is one inch above the drum centerline. For computational efficiency the assumption is made that for small changes in water level around the midpoint of the drum the water surface area remains constant. This allows a simplified level equation, i.e.,

$$LEVEL = (DMOV - VOLORM / 2.\phi) / (LSTMOM * OSTMODM) \quad [ME]$$

DMOV is the equation for the total volume of "liquid" in the drum. Recalling that a small percentage of steam leaving the separators is entrained in the liquid, the rate equation for "liquid" volume in the drum is

$$\begin{aligned} DDMOV = & ((MFF + MLL - MBB) * VF + PCU * (MLL + MFF) \\ & * VV + MBB * VBB - (MCC + MGG) * VF \\ & + MCOND * VFG) \quad [ME] \end{aligned}$$

where DMDVO is the volume occupied at time zero which is half the drum volume.

8. Circulation System Initial Condition Iteration Procedure

The initial conditions for the circulation system are found by flow rate balancing in the downcomer-riser flow loops. An initial guess of flow rate is made using the assumed riser exit quality of .05 percent which is reasonable for this type of boiler [7]. Coupling this assumption with the assumption that the percent carryunder is zero, an initial approximation of the flow rate can be determined using the figures for initial heat transfer rate to the risers calculated in Section III-A. Hence,

$$\text{mass flow rate} = \frac{\text{heat transfer rate}}{\text{assumed quality} * \text{latent heat of vaporization}}$$

A first approximation of downcomer enthalpy for both banks can be calculated. This downcomer enthalpy is assumed to be the same for all downcomers. Using an energy balance on the liquid in the steam drum

$$MFF\phi = Q1\phi / (XASUME * HFG) \quad [IC]$$

$$MLL\phi = Q5\phi / (XASUME * HFG) \quad [IC]$$

$$HCD\phi = ((MFF\phi + MLL\phi - MBB\phi) * HF + MBB\phi * HBB\phi) / (MFF\phi + MLL\phi) \quad [IC]$$

$$HGH\phi = HCD\phi \quad [IC]$$

The screen riser inlet enthalpy is assumed to be equal to that of the screen downcomer; however the main bank fluid absorbs additional energy from the desuperheater located in that circuit. Therefore, the main bank riser inlet enthalpy

must be calculated separately. Thus,

$$H_{JJ\phi} = H_{GH\phi} + Q_{\phi} / m_{HH\phi} \quad [IC]$$

The downcomer density must be calculated for use in the pressure drop calculations. Hence,

$$V_{CD\phi} = \frac{((m_{FF\phi} + m_{LL\phi} - m_{BS\phi}) * V_F + m_{BS\phi} * V_{BS\phi})}{(m_{FF\phi} + m_{LL\phi})} \quad [IC]$$

$$R_{HOC\phi} = 1.0 / V_{CD\phi} \quad [IC]$$

$$R_{HOGH\phi} = R_{HOC\phi} \quad [IC]$$

The riser outlet quality is calculated using the initial quality formulation previously developed. This computation is followed by the calculation of the riser non-boiling and boiling lengths.

The average density of the risers is calculated along with the two phase flow multiplication factors for use in the flow rate/pressure drop calculation.

An updated flow rate is now computed and compared with the first approximation. If it is within a specified error criteria calculation stops. If not the previous approximation is updated and the calculations continued with the new approximation.

Upon completion of the flow rate balancing the initial flow rates in the downcomer/riser loops are known along with the riser outlet quality.

The steady state drum specific volume and density are computed as

$$VDRML\phi = VCD\phi + PCU * VV$$

$$RODRML = 1.\phi / VDRML\phi$$

The initial steam mass in the drum is then calculated as

$$OSTM\phi = VOLORM * RHOV / 2.\phi$$

9. Superheater Pressure Drop

All entrance, head, and exit losses are considered negligible in the superheater compared to the frictional pressure drop.

$$\Delta P = f \frac{L}{D} \frac{\dot{m}^2}{A^2 g_{average}}$$

By lumping the constants the pressure drop equation is

$$PMM - PNN = KON1 * MMM * * 2.\phi / RHOMN\phi$$

The following definitions apply here:

$$KON3 = (PMM\phi + PNN\phi) / (RHOMM\phi + RHONN\phi) \quad [IC]$$

$$RHOMN\phi = (RHOMM\phi + RHONN\phi) / 2.\phi$$

$$KON1 = ((PMM\phi - PNN\phi) * RHOMN\phi) / MMM\phi * * 2 \quad [IC]$$

10. Steam Valve Equation

The flow through the steam valve is considered directly proportional to the outlet pressure and valve opening, i.e.,

$$\dot{m} = C * P * (\text{Valve Opening})$$

$$MMMIII = PNN * KON4 * VALVE \quad [ME]$$

The constant is computed in the initial condition program.

$$KON4 = MMMIII / (VALVE * PNN) \quad [IC]$$

E. EQUATIONS OF STATE

The equations of state listed below are used in both the initial condition and dynamic programs. With the exception of the subcooled specific volume equation used for the feedwater entering the drum, they are reasonably accurate in the 300-1500 psi range. The subcooled specific volume equation is accurate in the 600-800 psi range.

$$PSAT = \exp((\text{ALOG}(HSAT) - 4.46708) / .26452) \quad [2]$$

$$TSAT = \exp((.22151 * \text{ALOG}(PSAT) + 4.77125)) \quad [2]$$

$$HSAT = \exp(.26452 * \text{ALOG}(PSAT) + 4.46708) \quad [2]$$

$$HFG = 922.15 - .40516 * PSAT + 1.717E-04 * PSAT ** 2.0 - 4.219E-08 * PSAT ** 3.0 \quad [2]$$

$$RHOF = 63.8 - .01781 * TSAT + 1.132E-05 * TSAT ** 2.0 - 6.786E-08 * TSAT ** 3.0 \quad [2]$$

$$\begin{aligned} VBB = & .01600488 - .0000020146 * TBB \\ & + 3.6511E-08 * TBB ** 2.0 \\ & - 8.142E-11 * TBB ** 3.0 + 1.4081E-13 \\ & * TBB ** 4.0 - 1.148E-16 * TBB ** 5.0 \\ & + 8.034E-20 * TBB ** 6.0 \end{aligned}$$

IV. RESULTS AND CONCLUSIONS

A. GENERAL

A listing of the initial condition program and the dynamic boiler model program is given in Appendices A and B respectively. The initial condition program output data must be properly formatted for input to the CSMP-III dynamic model. In addition, because the dynamic model utilizes the liquid in the steam drum as a saturation state point from which all other state points are derived, two of the initial conditions must be modified to eliminate a discontinuity between the steady state program and the dynamic model. The equations involved and an explanation are given below.

$DMASL\phi = (VOLDRM * RHOC\phi) / 2.\phi$	[IC]
$DMDHL\phi = DMASL\phi * HORUM\phi$	[IC]
$DMDHL = INTGRL(DMDHL\phi, DDMOHL)$	[ME]
$DMASL = INTGRL(DMASL\phi, DDMASL)$	[ME]
$DH = DMDHL / DMASL$	[ME]

As stated previously, the enthalpy of the liquid in the drum is considered saturation enthalpy. The dynamic model must begin with the rate of condensation in the drum (MCOND) as close to zero as possible. This is a natural steady state position - drum liquid and drum steam both at the same pressure and temperature. In order to insure this to be the case DMASLO and/or DMDHLO must be modified such that the initial

drum enthalpy (DH) very closely approximates the enthalpy of saturated liquid corresponding to the drum steam temperature and pressure (PMM and TMM). This is easily facilitated by the use of the CALL DEBUG statement in the dynamic program. With this procedure:

1. The initial condition program is executed and the initial conditions formatted for CSMP-III use.
2. The dynamic model is executed for only a short run time, i.e. 5 seconds.
3. Observing the DEBUG output from the model, DNASLO and/or DMDHLO are modified such that PSAT and TSAT equal PMM and TMM.
4. The model is reexecuted for a short run to check. MCOND should be very small.
5. Since DH is implicitly related to PMM and TMM, the procedure may have to be repeated a few times. The objective is to force as many of the "DERIVATIVE" terms in the DEBUG output to comparatively small figures as possible.

The model as used operates satisfactorily with DNASLO = 8002.2 and DMDHLO = 3.96163E 06. This forces the initial MCOND term to .35949.

Because of the CSMP function DERIV used in the program, the model is extremely sensitive to integration time step. Numerical differentiation is not a desirable function to perform in a dynamic model; however attempts to explicitly differentiate the equations concerned failed. One solution

to the problem is to "smooth" the derivative function by averaging it over several timesteps. The model performed satisfactorily with a fixed-step integration procedure (Runge-Kutta), an integration time step of .04 seconds, and averaging the derivative over sixteen time steps.

B. OPEN LOOP RESPONSE

The open loop response to a ten percent increase in throttle opening is shown in Figures 2-7. As expected, the response of the main bank circulation loop and screen bank circulation loop is different. This is in keeping with the different purposes of those two loops, steam generation and furnace screening respectively. The effect of the valve opening increase is barely noticeable in the screen circulation loop.

The swell effect is not noticeable. Further conversations with Mr. Paul Weitzel at Babcock and Wilcox indicate that the percentage of "carry under" is not a constant as it was treated in this program. One to two percent is a good starting estimate for steady state; however during a transient "carry under" mass flow rate is computed by subtracting the amount of steam leaving the boiler from the amount of steam produced. This should always be a positive number. The vapor that does not leave the boiler is "carried under." The following program will implement this "carry under":

Modify
the section of the dynamic
model titled "COMPUTE THE
DRUM SPECIFIC VOLUME" to
read:

```

PROCEDURE CRYUND=FILTR8(MMM)
IF(TIME.GT.0.0)GO TO 45
CRYUND=PCU*(MLL+MFF)
GO TO 46
45  CRYUND=(MLL*XLL+MFF*XFF)-MMM
46  RISE1=DELAY (250,RISTIM,CRYUND)
    RISE2=CRYUND
    IF(VALUE.GT..51)GO TO 55
    RISE=RISE2
    GO TO 57
55  RISE=RISE1
57  CONTINUE
ENDPROCEDURE
DDMDV=((MFF+MLL-MBB)*VF+CRYUND*VV...
      +MBB0*VBB-(MCC+MGG)*VF+MCOND...
      *VFG-RISE*VV)

```

Follow the above statements with the unmodified
equations for DMDV.

The previous procedure was not implemented in the present
dynamic model. The quality formulation in the present model
is apparently too simplified and this causes a shortfall in
quality at the outlet of the screen riser bank. As a result of
this shortfall, there are instances during transient operation
when the model is not "producing" as much steam as it is "using".
Mr. Weitzel suggests using twenty node finite difference
approximation for quality. This could be done using an equation
for quality such as:

$$X = \frac{q}{A g_f V_{in} h_{fg}} z$$

where

X = quality

Z = distance up the riser (ft)

- q = heat input to riser (BTU/s-ft)
- A = cross sectional area of riser (ft²)
- ρ_f = density of saturated liquid (lbm/ft³)
- V_{in} = velocity of liquid entering (ft/s)
- h_{fg} = latent heat of vaporization (BTU/lbm)

Simultaneously an implicit equation for continuity could be applied to produce a balanced mass flow rate without assuming that the downcomer mass flow rate remains constant.

C. CONCLUSIONS

The model presented is not a finished model. Further research is needed to successfully implement the shrink and swell theories presented. When the previously mentioned difficulty with riser outlet quality is solved, the model should approximate the dynamics of a wide range of D-type marine boilers depending on the initial conditions supplied to the initial condition program.

The initial condition program develops the initial conditions necessary for the detailed boiler model with the relatively scant data available from the boiler technical manual shown in Appendix C and a small amount of data from common engineering handbooks. Because of the relatively small amount of data required the initial condition program and/or the model can serve as a basis for a boiler condition monitoring system.

D. SUGGESTIONS FOR FURTHER RESEARCH

It is evident that the model suffers by using the CSMP-III function DERIV. In order to facilitate the explicit solution of the continuity equation for the riser banks some form of differentiation is required, either numerical or explicit. An explicit solution is much more desirable from a stability standpoint. A more detailed investigation with fewer assumptions might produce the correct form for the explicit differentiation equation. It should be noted, however, that when using explicit differentiation the model must average the derivative over at least two time steps to avoid the creation of an algebraic loop. This is easily done with the same PROCEDURE format used to average the derivative in the current model.

The use of small perturbation techniques to linearize the model and thus allow a state-space representation for multivariable control development and analysis should be undertaken. There is a computer code available locally to facilitate this for CSMP models; however it does not accept the CSMP DERIV function and/or the averaging procedure. A means of bypassing this problem would result in a general D-type boiler model - applicable to a very wide range of boilers currently in use - which could be linearized about specific operating points. These individual models could then be used for the development and testing of multivariable control systems.

Using locally available optimizing computer codes, an optimal D-type boiler design could be attempted with regards to boiler geometry.

A more detailed analytical and experimental investigation of current D-type marine boilers should be undertaken locally. Little research has been done in this area and that which has been done has often been based on either an incorrect physical model of a marine boiler or on a nuclear steam generating plant. A starting point could be the data analysis of common horizontal and vertical steam separators followed by an optimum design for these elements. The improper and/or maintenance of drum internals apparently grossly affects boiler operation and water level stability during rapid transients.

TABLE 1
MODEL NOTATION

PRINCIPAL LETTER OR ACRONYM	MEANING	EXAMPLES
T	TEMPERATURE	TAA - temperature of fluid entering the economizer TAB - average temperature of fluid in the economizer TAAO - initial temperature of fluid entering the economizer
H	ENTHALPY	HDD - enthalpy of liquid entering the screen riser HDDO - enthalpy of liquid entering the screen riser at time zero
V	SPECIFIC VOLUME	VBB - specific volume of liquid at economizer outlet
X	QUALITY	XFF - quality at outlet of screen risers XLL - quality at outlet of main bank risers DXFF - time rate of change screen riser outlet quality
RHO	DENSITY	RHODD - density at outlet of screen downcomer RHODC - average density in screen downcomer
M	MASS FLOW RATE	MGG - mass flow rate down main bank downcomer MRRO - mass flow rate of flue gas through the superheater at time zero
Q	ENERGY TRANSFER	Q1 - energy transfer from furnace flue gas to screen riser tube metal Q2 - energy transfer from screen riser tube metal to screen riser fluid

NOTE: In general, rate variables $\frac{d}{dt}$ are preceded by the letter D, i.e., DXFF, DRHOJL.

SCHEMATIC DIAGRAM OF A NAVAL BOILER

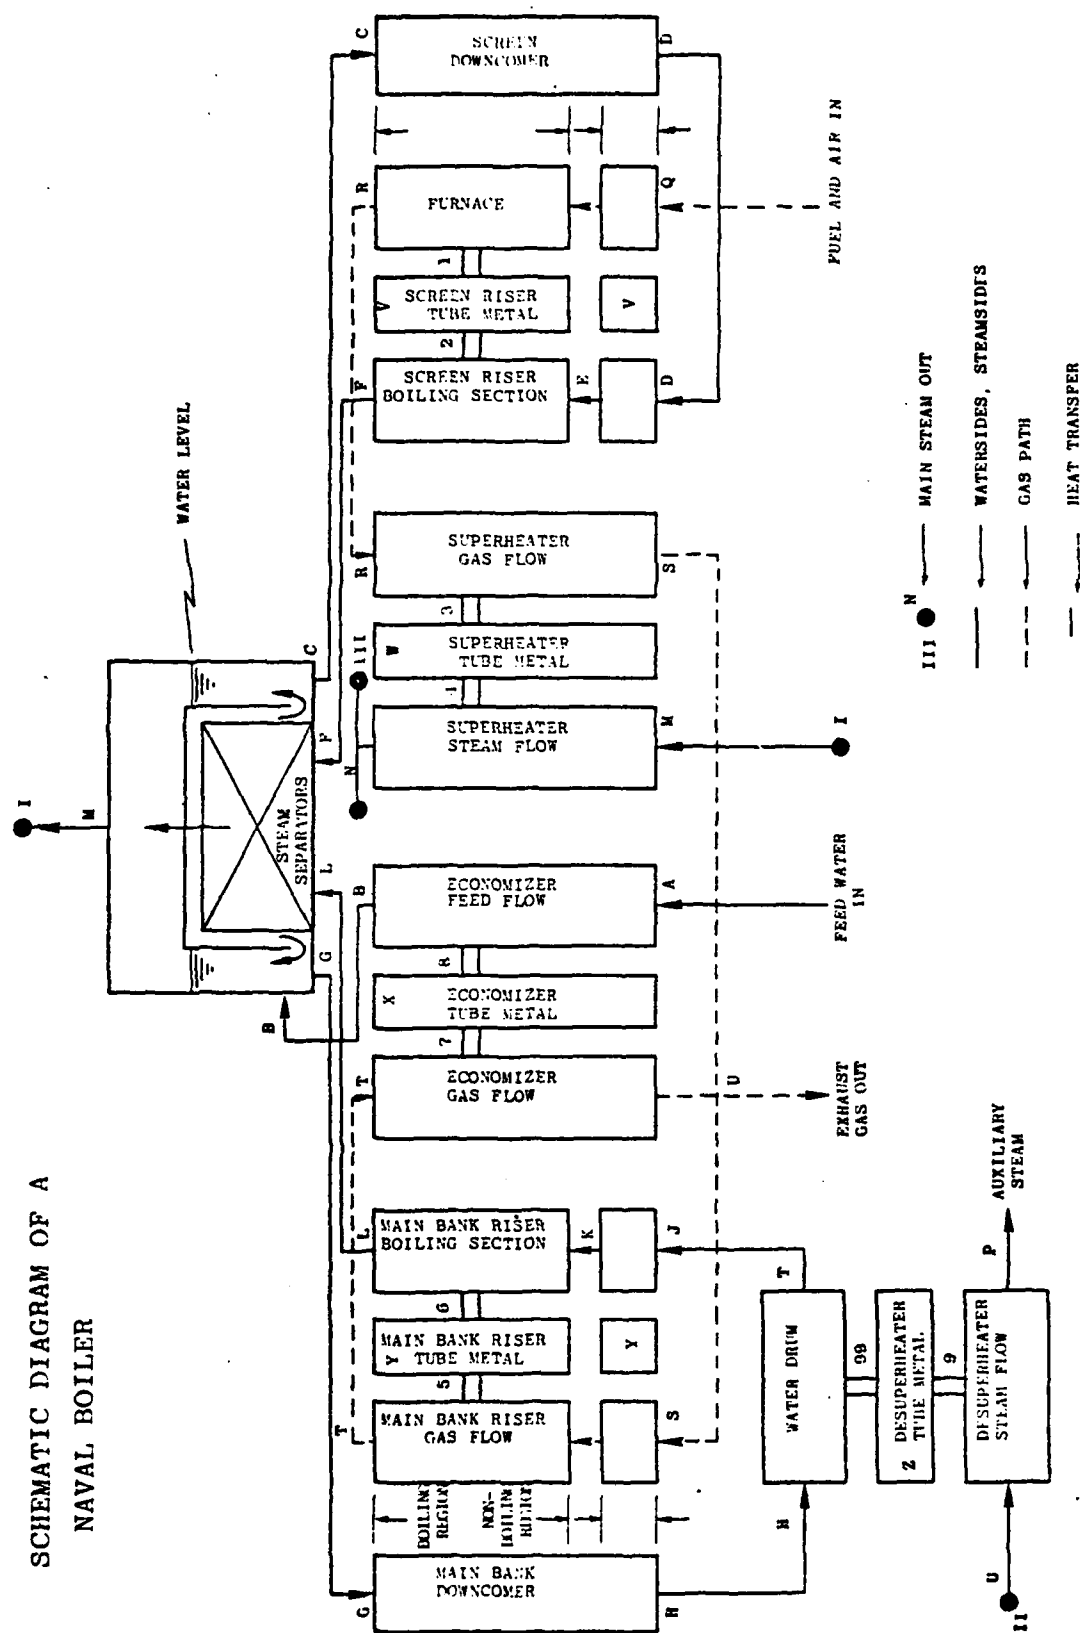


Figure 1.

OPEN LOOP - 10% INCREASE IN THROTTLE OPENING WATER LEVEL

LEGEND

LEVEL □

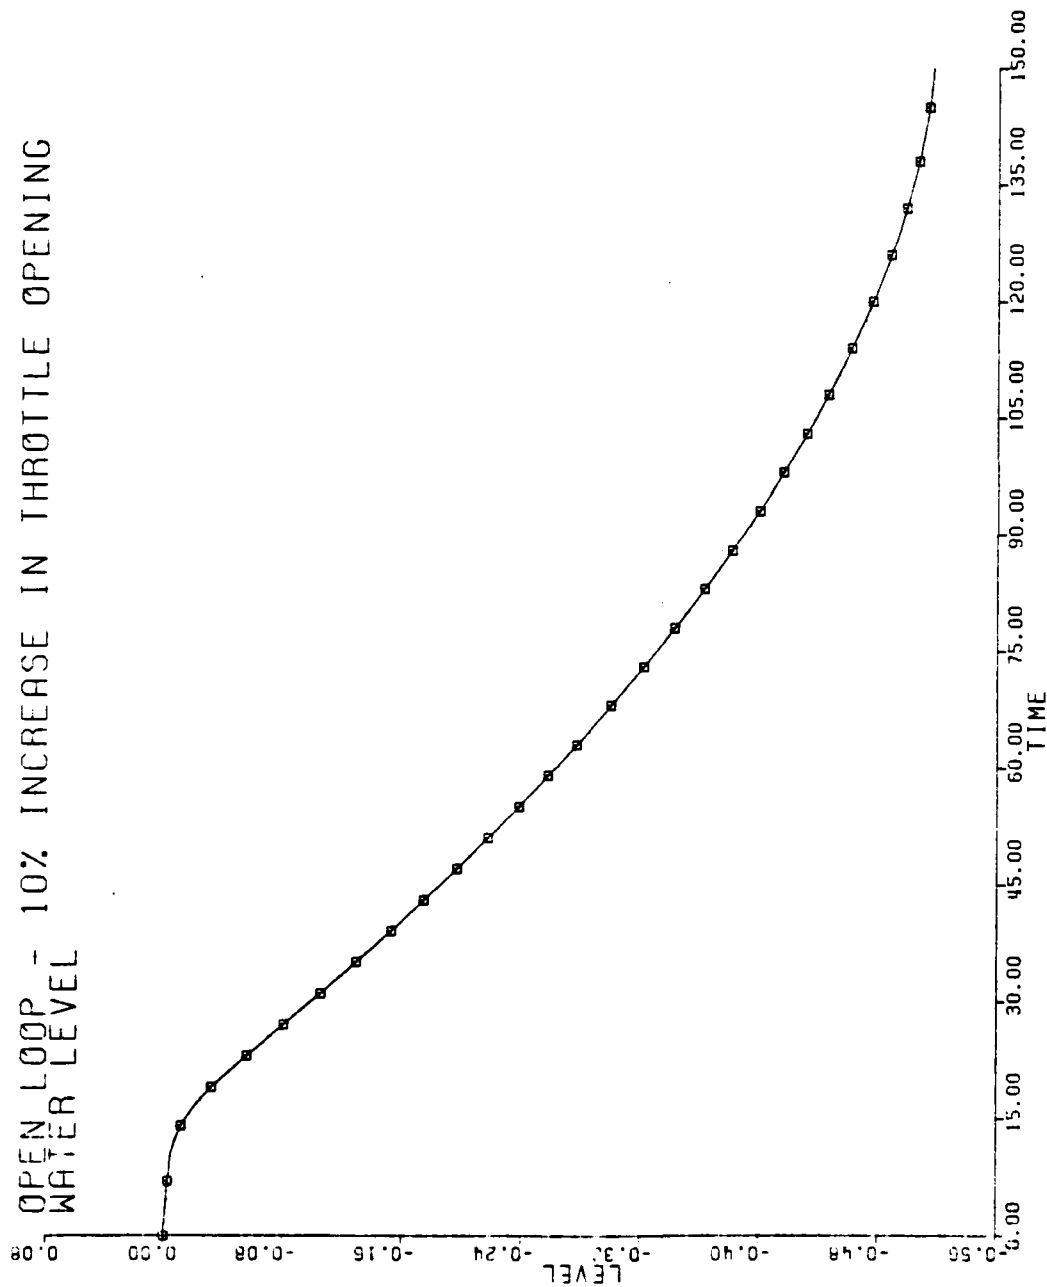


Figure 2.

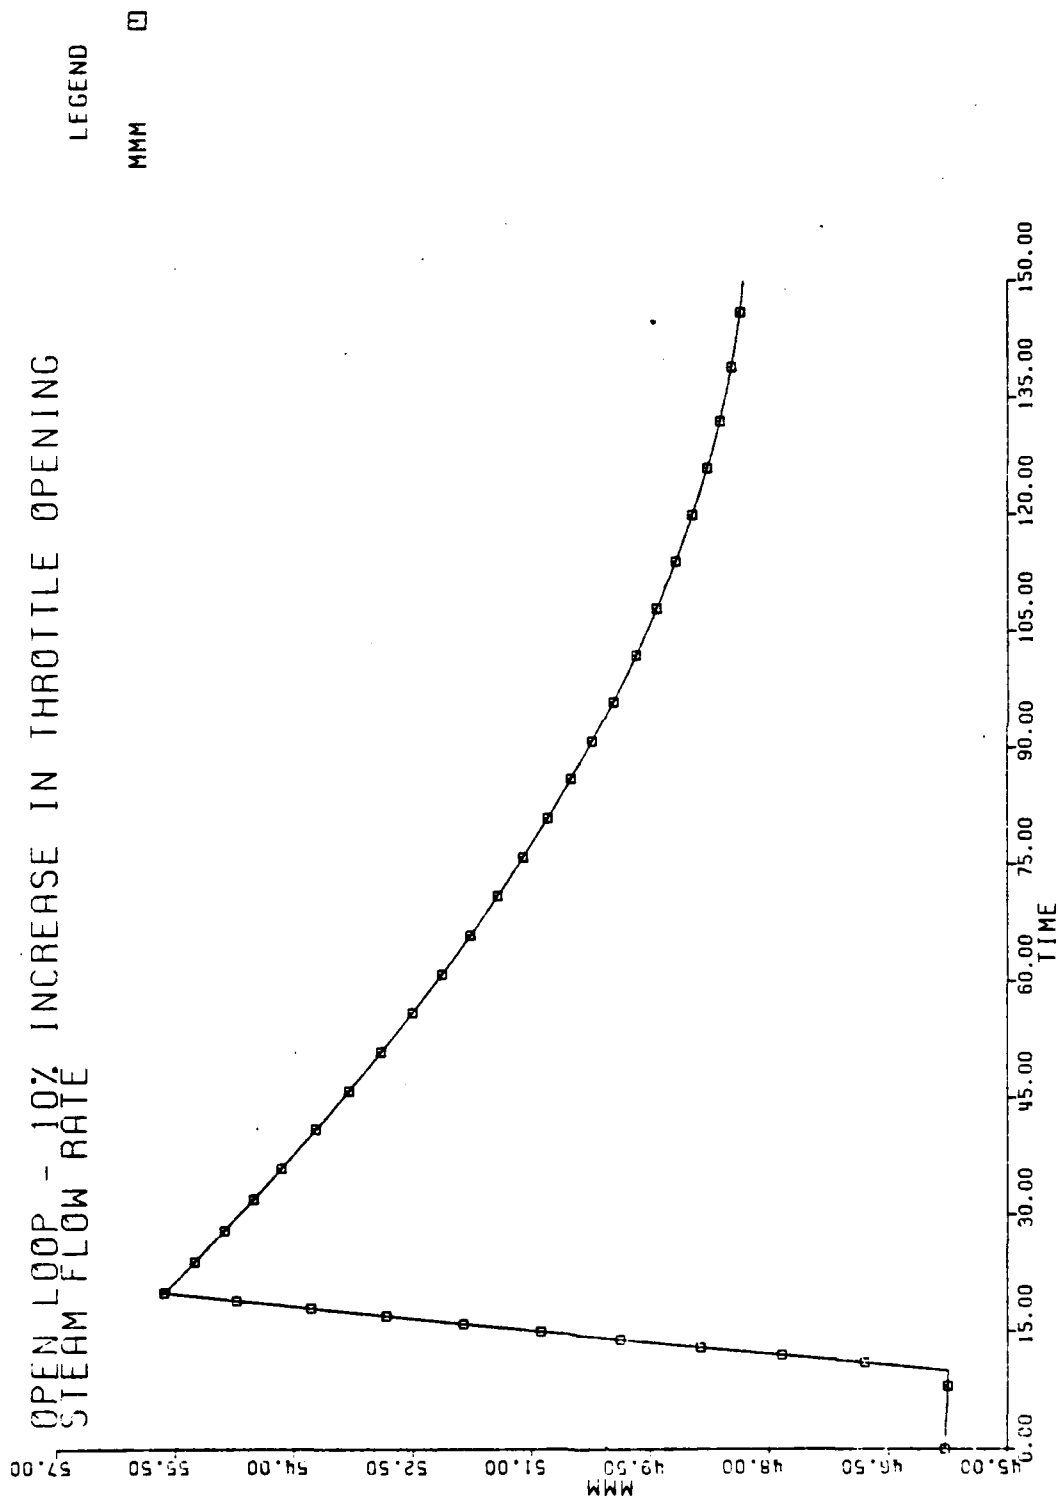


Figure 3.

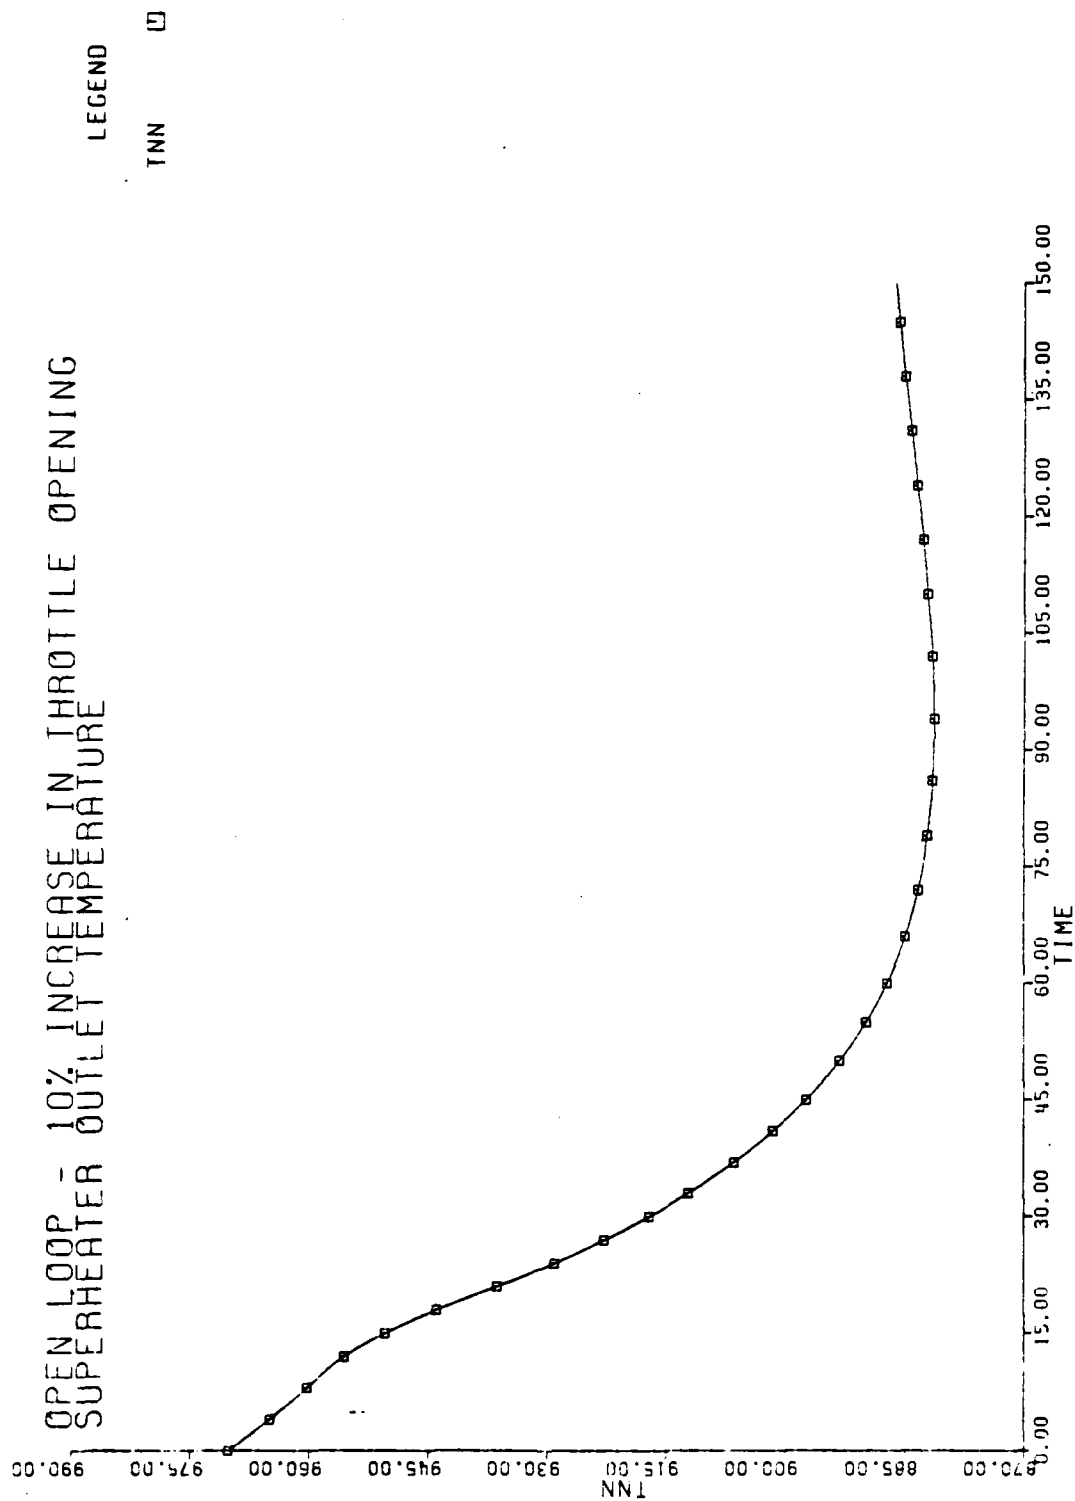


Figure 4.

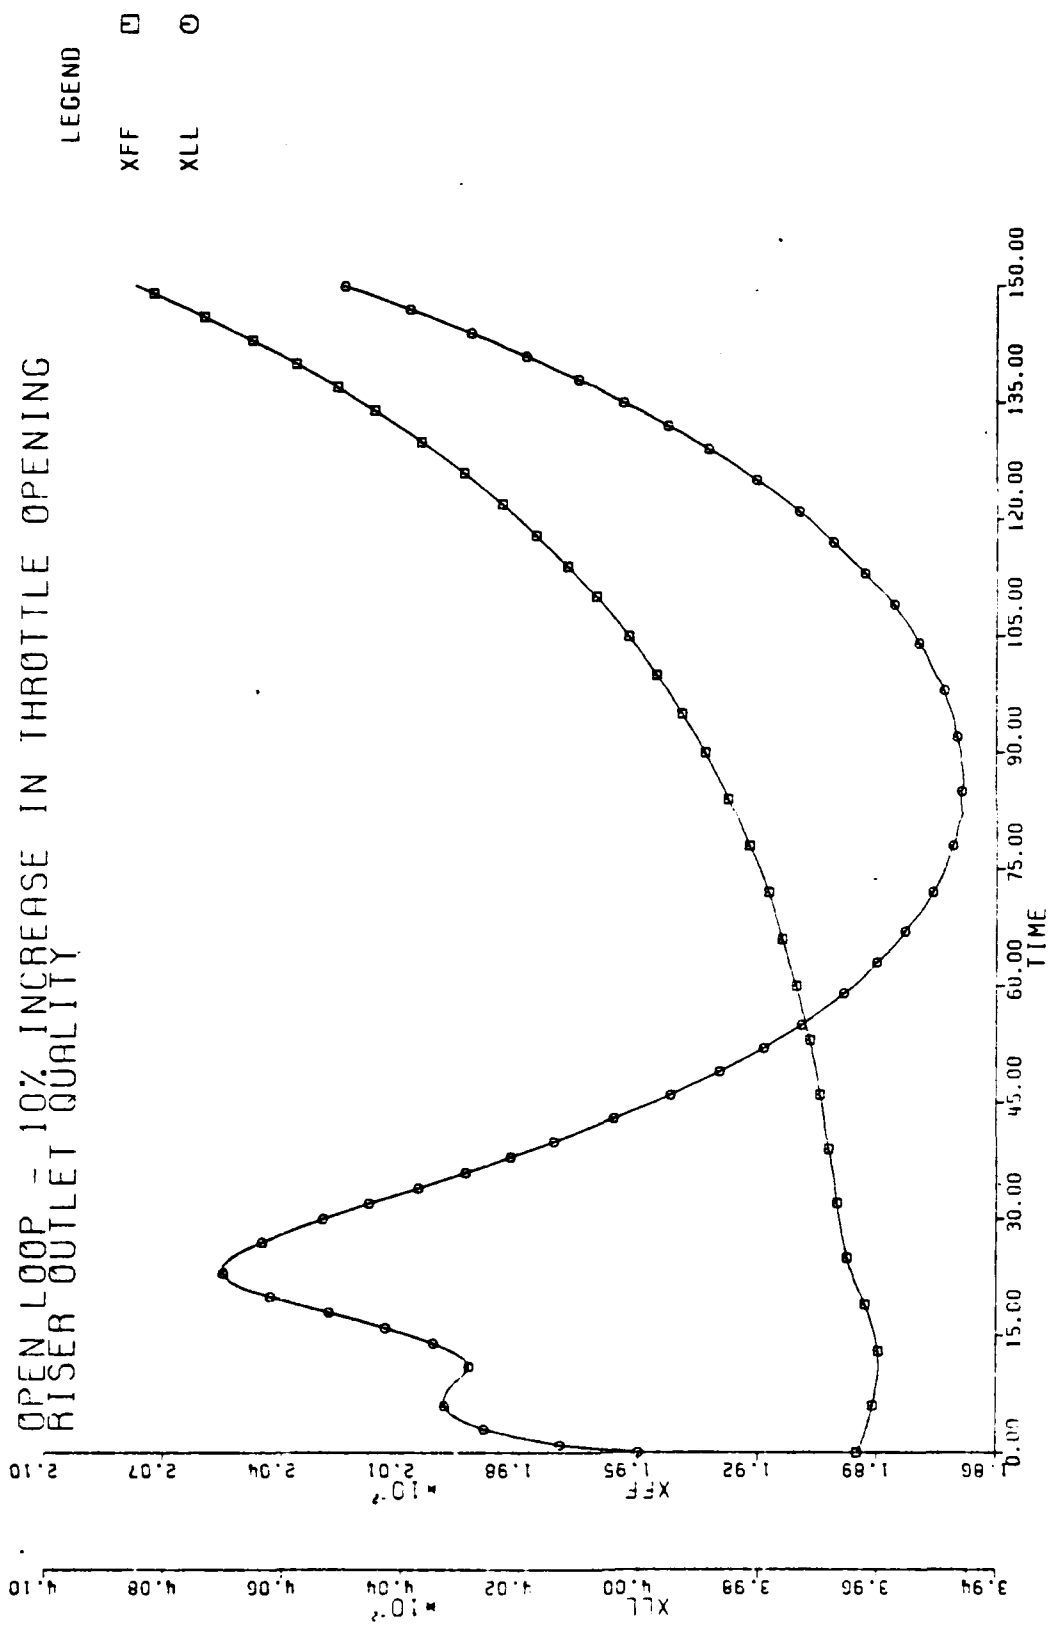


Figure 5.

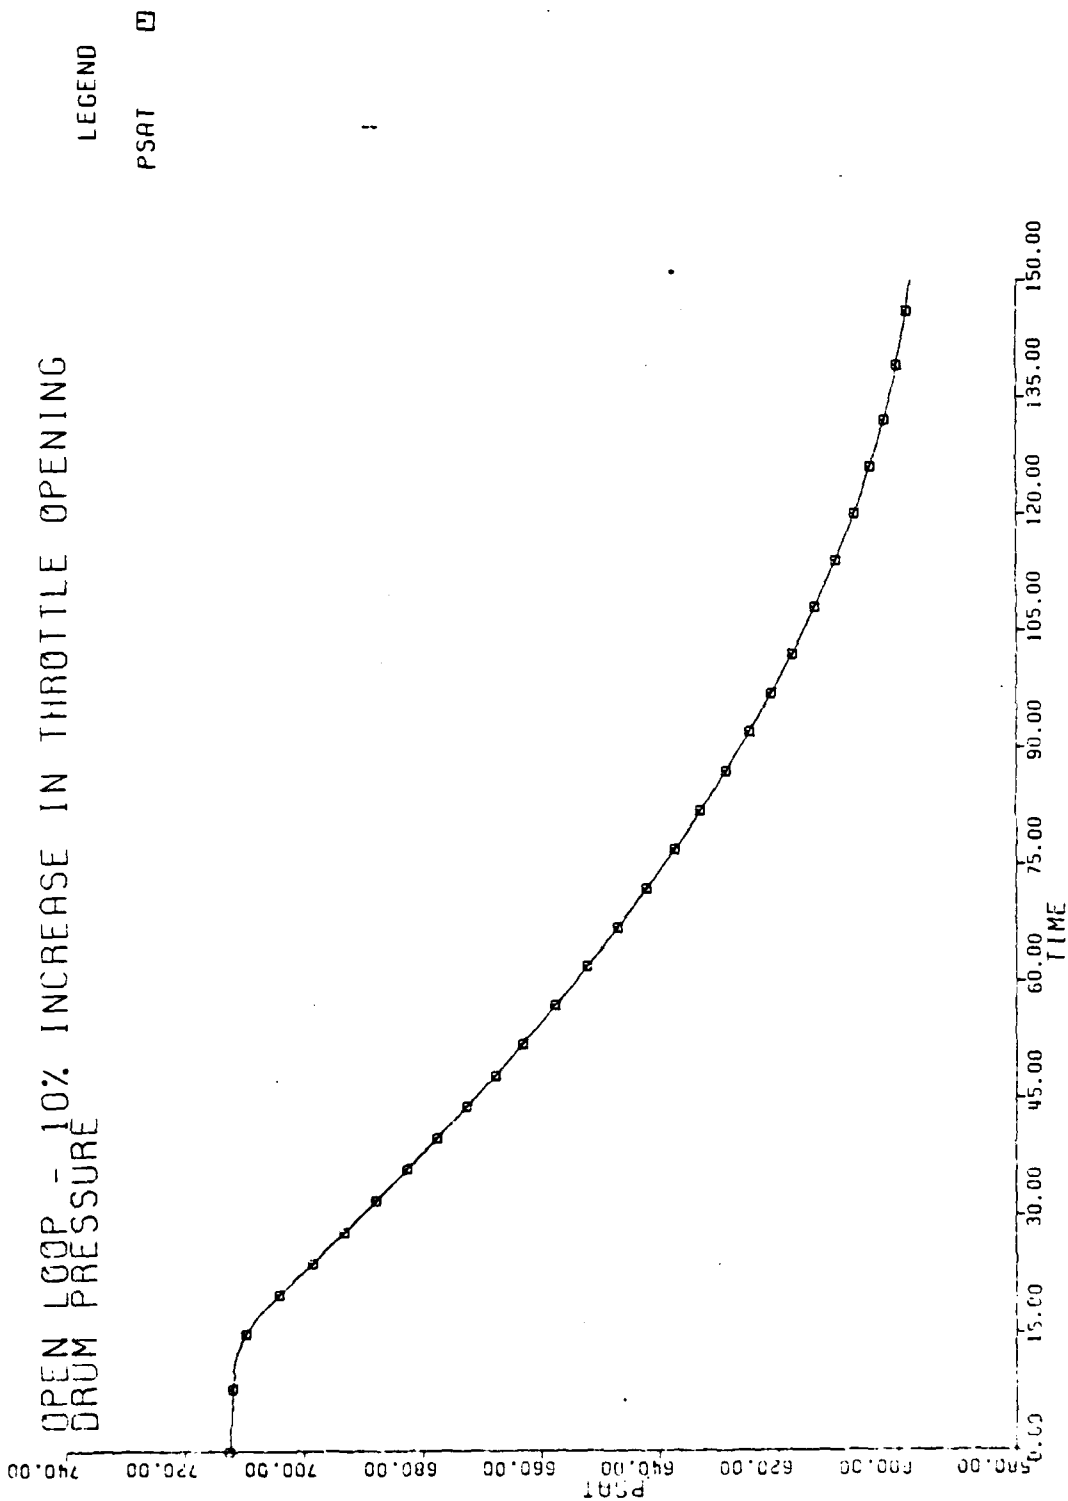


Figure 6.

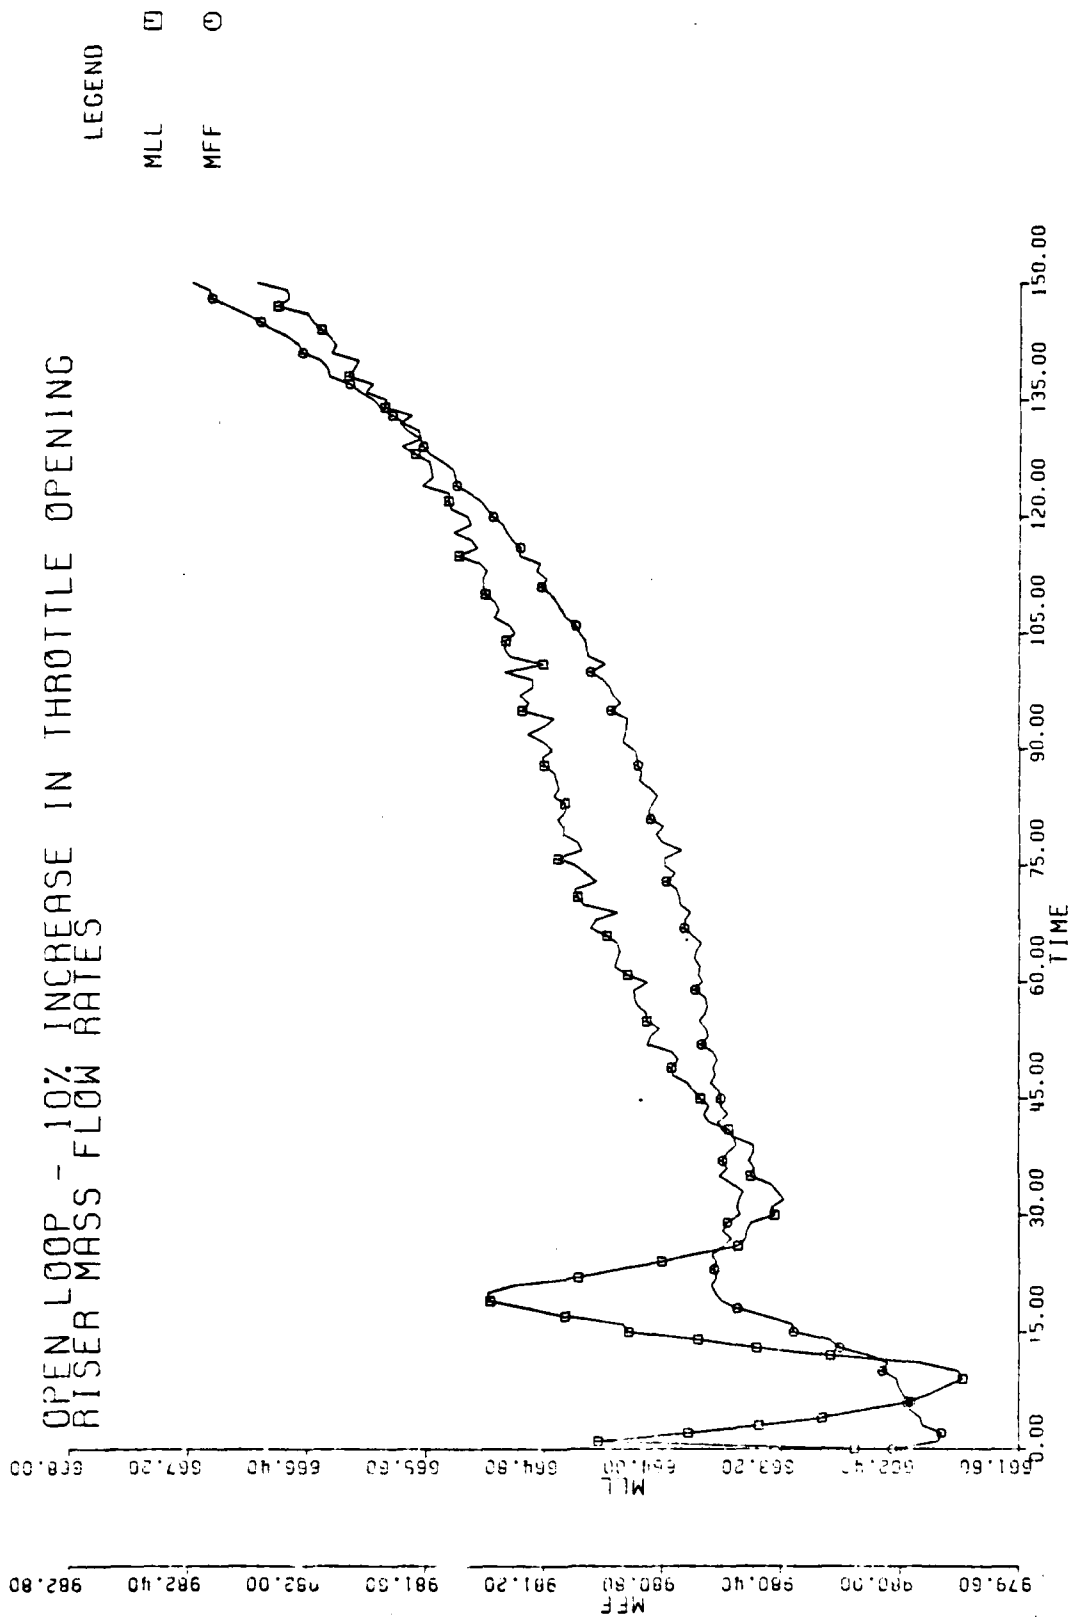


Figure 7.

APPENDIX A

08/30/79 20.55.11

FILE: CONSTANT.FORTRAN P1

NAVAL POSTGRADUATE SCHOOL

THIS PROGRAM CALCULATES THE CONSTANTS AND INITIAL CONDITIONS FOR A US NAVY D-TYPE BOILER GIVEN THE INPUT DATA OBTAINED FROM THE ECILER TECHNICAL MANUAL, STEAM TABLES, AND STANDARD ENGINEERING HANDBOOKS. THE INPUT DATA ARE ENTERED IN NAME LIST FORMAT. NAMELIST DESIGNATIONS AND INPUT MEMONICS FOLLOW

INCON1:

OPPNT OPERATING POINT (PERCENT) *
TOTSTM TOTAL STEAM FLOW (LB/HR)
SPHSTM SUPERHEATER STEAM FLOW (LB/HR)
DSHSTM DESUPERHEATED STEAM FLOW (LB/HR)
PCRMU DRUM PRESSURE (PSIG)
SHOT SUPERHEATER OUTLET TEMPERATURE (DEG-F)
SHOP SUPERHEATER OUTLET PRESSURE (PSIG)
DSHOT DESUPERHEATER OUTLET TEMPERATURE (DEG-F)
DSHOP DESUPERHEATER OUTLET PRESSURE (PSIG)
ECONIT ECONOMIZER FEED INLET TEMPERATURE (DEG-F)
ECONOT ECONOMIZER FEED OUTLET TEMPERATURE (DEG-F)
AIP1AP AIR INLET TEMPERATURE TO REGISTERS (DEG-F)
CILTMP CIL TEMPERATURE AT BURNER INLET (DEG-F)
AIRFLOW AIRFLOW RATE (LB/HR)
OILFLOW OIL FLOW RATE (LB/HR)
XCSAIR EXCESS AIR (PERCENT) *
DRAFT DRAFT LOSS (IN-H2O)
TGASSC FLUE GAS TEMPERATURE LEAVING SCREEN (DEG-F)
TGASSH FLUE GAS TEMPERATURE LEAVING SUPERHEATER (DEG-F)
TGASMB FLUE GAS TEMPERATURE LEAVING MAIN BANK (DEG-F)
TGASEC FLUE GAS TEMPERATURE LEAVING ECONOMIZER (DEG-F)
TSCRN SCREEN TUBE WALL TEMPERATURE (DEG-F)
TSPHTR SUPERHEATER TUBE WALL TEMPERATURE (DEG-F)
HMFVCL HEAT RELEASE (KBTU/HR/100 FT FURNACE VOLUME)
FHAS FURNACE HEAT ABSORPTION (KBTU/HR/SQ FT RADIANT HEAT ABSORBING AREA)

NOTE: "PERCENT" VALUES ARE TO BE LOGGED AS DECIMALS.

\$SCREEN

DTUBSC AVERAGE INSIDE DIAMETER OF SCREEN TUBES (IN)
LAVSC AVERAGE LENGTH OF SCREEN TUBE (FT)
NTUBSC NUMBER OF SCREEN TUBES
RHASSC RADIANT HEAT ABSORBING AREA OF FURNACE SCREEN (SQ FT)
MASSSC TOTAL WEIGHT OF SCREEN TUBES (LB)

\$SPHTR

AREASH TOTAL SUPERHEATER HEAT TRANSFER AREA (SQ FT)
MASSSH TOTAL WEIGHT OF SUPERHEATER TUBES

\$MNBANK

DTUBMB AVERAGE INSIDE DIAMETER OF MAIN BANK TUBES (IN)
LAVMB AVERAGE LENGTH OF MAIN BANK TUBE (FT)
NTUBMB NUMBER OF MAIN BANK TUBES
MASSMB TOTAL WEIGHT OF MAIN BANK TUBES (LB)
AREAMB TOTAL HEAT TRANSFER AREA (SQ FT)

\$ECON

DILSEC INSIDE DIAMETER OF ECONOMIZER TUBES (IN)
NPASSE NUMBER OF TUBE PASSES
NTUBEC NUMBER OF TUBES PER PASS
LITSEC AVERAGE LENGTH OF ECONOMIZER TUBE (FT)
MASSEC TOTAL WEIGHT OF ECONOMIZER (LB)

CON00010
CON00020
CON00030
CON00040
CON00050
CON00060
CON00070
CON00080
CON00090
CON00100
CON00110
CON00120
CON00130
CON00140
CON00150
CON00160
CON00170
CON00180
CON00190
CON00200
CON00210
CON00220
CON00230
CON00240
CON00250
CON00260
CON00270
CON00280
CON00290
CON00300
CON00310
CON00320
CON00330
CON00340
CON00350
CON00360
CON00370
CON00380
CON00390
CON00400
CON00410
CON00420
CON00430
CON00440
CON00450
CON00460
CON00470
CON00480
CON00490
CON00500
CON00510
CON00520
CON00530
CON00540
CON00550
CON00560
CON00570
CON00580
CON00590
CON00600
CON00610
CON00620
CON00630
CON00640
CON00650
CON00660
CON00670
CON00680
CON00690
CON00700

SCESPT

DTUBDS INSIDE DIAMETER OF DESUPERHEATER TUBE (IN)
 NTUBDS NUMBER OF DESUPERHEATER TUBES PER PASS
 NPASSO NUMBER OF DESUPERHEATER TUBE PASSES
 LTUBDS LENGTH OF DESUPERHEATER TUBE (FT)
 AREASO TOTAL HEAT TRANSFER AREA OF DESUPERHEATER (SQ FT)
 MASSOS TOTAL WEIGHT OF DESUPERHEATER ASSEMBLY (LB)

SDRMDCR

DTUBDO AVERAGE DIAMETER OF DRUM DOWNCOMER TUBES (IN)
 LAVDC AVERAGE LENGTH OF DRUM DOWNCOMER TUBE (FT)
 NTUBDC NUMBER OF DRUM DOWNCOMER TUBES

SHDRDCR

DTUBHC AVERAGE INSIDE DIAMETER OF HEADER DOWNCOMER (IN)
 LAVHD AVERAGE LENGTH OF HEADER DOWNCOMER (FT)
 NTUBHD NUMBER OF HEADER DOWNCOMERS

SBCILR

DSTMOM DIAMETER OF STEAM DRUM (IN)
 LSTMDM LENGTH OF STEAM DRUM (FT)
 DWTROM DIAMETER OF WATER DRUM (IN)
 LWTRDM LENGTH OF WATER DRUM (FT)
 HNCAM HEIGHT OF NORMAL WATER LEVEL ABOVE BENCH MARK (FT)
 HHDR HEIGHT OF HEADER (SCREEN) ABOVE BENCH MARK (FT)
 HWTRDM HEIGHT OF WATER DRUM ABOVE BENCH MARK (FT)
 FLRVCL FURNACE VOLUME (CU FT)

NOTE: CHOICE OF BENCH MARK IS ARBITRARY

STHERMO

HSHOUT ECONOMIZER OUTLET ENTHALPY (BTU/LBM)
 HOSJUT DESUPERHEATER OUTLET ENTHALPY (BTU/LBM)
 HECIN ENTHALPY OF ECONOMIZER FEED INLET (BTU/LBM)
 HECOUT ENTHALPY OF ECONOMIZER FEED OUTLET (BTU/LBM)
 (1)KH2O THERMAL CONDUCTIVITY OF WATER (BTU/HR.FT.DEG-F)
 (1)FPH2O PRANDTL NUMBER FOR WATER
 (1)VSCH2O KINEMATIC VISCOSITY FOR WATER (LBM/FT-SEC)
 (2)KSTM THERMAL CONDUCTIVITY FOR STEAM (BTU/HR.FT.DEG-F)
 (2)PRSTM PRANDTL NUMBER FOR STEAM
 (2)VSCSTM KINEMATIC VISCOSITY FOR STEAM (LBM/FT-SEC)
 RSHOUT SUPERHEATER OUTLET DENSITY (LBM/CU FT)
 ROSJUT DESUPERHEATER OUTLET DENSITY (LBM/CU FT)
 RFLUE DENSITY OF FLUE GAS AT TGASSC (LBM/CU FT)
 NOTES: (1) EVALUATED AT AVERAGE ECONOMIZER WATER TEMPERATURE
 (2) EVALUATED AT AVERAGE DESUPERHEATER STEAM TEMPERATURE

SLCSSES

KSCSC ROUGHNESS RATIO (SAND EQUIVALENT) FOR SCREEN TUBES
 KSD49 ROUGHNESS RATIO (SAND EQUIVALENT) OF MAIN BANK TUBE
 KSCCO ROUGHNESS RATIO (SAND EQUIVALENT) FOR DRUM DOWNCOMER
 KSDHO ROUGHNESS RATIO (SAND EQUIVALENT) FOR HEADER DOWNCOMER
 ENTSC SCREEN TUBE ENTRANCE LOSS
 BENSCC SCREEN TUBE BEND LOSS
 ENTMB MAIN BANK ENTRANCE LOSS
 BENCMR MAIN BANK BEND LOSS FACTOR
 ENTOD DRUM DOWNCOMER ENTRANCE LOSS FACTOR
 BENDOD DRUM DOWNCOMER BEND LOSS FACTOR
 ENTHC HEADER DOWNCOMER ENTRANCE LOSS FACTOR

CONC0710
 CONC0720
 CONC0730
 CONC0740
 CONC0750
 CONC0760
 CONC0770
 CONC0780
 CONC0790
 CONC079C
 CONC0800
 CONC0810
 CONC0820
 CONC0830
 CONC0840
 CONC0850
 CONC0860
 CONC0870
 CONC0880
 CONC0890
 CONC0900
 CONC0910
 CONC0920
 CONC0930
 CONC0940
 CONC0950
 CONC0960
 CONC0970
 CONC0980
 CONC0990
 CONC1000
 CONC1010
 CONC1020
 CONC1030
 CONC1040
 CONC1050
 CONC1060
 CONC1070
 CONC1080
 CONC1090
 CONC1100
 CONC1110
 CONC1120
 CONC1130
 CONC1140
 CONC1150
 CONC1160
 CONC1170
 CONC1180
 CONC1190
 CONC1200
 CONC1210
 CONC1220
 CONC1230
 CONC1240
 CONC1250
 CONC1260
 CONC1270
 CONC1280
 CONC1290
 CONC129C
 CONC1300
 CONC1310
 CONC1320
 CONC1330
 CONC1340
 CONC1350
 CONC1360
 CONC1370
 CONC1380
 CONC1390
 CONC1400

FILE: CONSTANT FORTRAN P1

NAVAL POSTGRADUATE SCHOOL

```

C      BENDHD HEADER DOWNCOMER BEND LOSS FACTOR
C
      IMPLICIT REAL(A-Z)
      INTEGER NPASSE
      DIMENSION TH2D(20),OPASS(20)
C
C      DEFINE NAMELISTS
      NAMELIST/INCCNO/CFPNT,TOTSTM,SPHSTM,DSHSTM,PORUM,SHOT,SHDP,DSHPT,
      1DSHOP,ECJIT,ECJNT,AIRTMP,JILFLD,AIRFLC,XCSAIR,DRAFT,TGASSC,
      2TGASSH,CASMA,TGASEC,TSCPA,TSPHT,HFVFL,FHAS,JILTMP
      NAMELIST/SCREEN/DTUBSC,LAVSC,NTUBSC,RHASSC,MASSSC
      NAMELIST/SPHTR/AREASH,MASSSH
      NAMELIST/MWBANK/LTUBMB,LAVMB,NTUBMB,MASMB,AREAMB
      NAMELIST/ECCH/DTUBEC,NPASSE,NTUBEC,LTUBEC,MASSEC
      NAMELIST/DESPH/DTUBDS,NTUBDS,NPASSD,LTUBDS,AREADS,MASSDS
      NAMELIST/DMDCCR/LTUBCD,NTUBCD,MASCD
      NAMELIST/HDRD/DTUBHD,LAVHD,NTUBHD
      NAMELIST/BUILER/DSTMCM,LSTMCM,DWTRDM,LWTRDM,HNDRM,HHRM,HWTRDM,
      $FLURVL
      NAMELIST/THERM/HSHOUT,HDSOUT,HECIN,HECOUT,
      1KH2C,PRH2C,VCH2C,KSTM,PESTM,VSCSTM,RSHOUT,RDSOUT,RFLUE
      NAMELIST/LDSSES/KSDSC,KJMB,KJDD,KSDH,ENTSC,BENCSC,ENTMB,
      $BENDMB,ENTCD,BEICD,ENTH,BENDH
      NAMELIST/INCCN1/TRD,TVO,TWHO,
      $TYC,TZC,TXO,TAO
      NAMELIST/INCCN2/MAO,MFOO,MAOO,
      $MNO,MMO,MGO,
      $MCO,MGO,MBO,
      $MFO,MLLO,MVE,
      $MASSV,MASSW,MASSY,
      $MASSX,MASSZ,MASOR,
      $DMHLC,DMASLO,DSTM,ESTMDM,
      $LSTM,ESTMDM
      NAMELIST/INCCN3/CM,CAB,CPV,
      $CPY,CPX,CPZ,
      $CPW,CQR,CRS,CST,
      $CTU,CNF,G,GC
      NAMELIST/CONST1/KSJL,KDOF,KSGH,
      $KSCC,KSDC,KSEF,
      $KSKJ,KSKL,KZ,
      $KW,KRS,KST,
      $KON1,KON3,KON4,
      $KX,KHJ,KV,
      $KTU,KY
      NAMELIST/CONST2/AJL,CJL,LJL2,
      $LJL1,DJF,LDF,
      $LCFL,ACF,LGF,
      $AGH,CGH,DCD,
      $LCD,LDEO,LJKO
      NAMELIST/CONST3/ACC,ZRENC1,ZBENC2,
      $VOLJL,VCLDF,VCLDM,
      $VOLHJ,ZDF,ZJL,
      $LJL,DJF,DKL,
      $DEF,DJK,ZO
      NAMELIST/CONST4/FCD,FGH,FDE,
      $FEF,FJK,FKL,
      $ENTRGH,ENTCD,BENDGH,
      $BENDCD,EXITGH,EXITCC
      NAMELIST/CONST5/FHV,XLLO,XFFO,
      $TAMB,DRICFO,DRJLO,
      $SIGMA
      NAMELIST/OUTPLT/CJO,C40,Q6C,Q8C,Q90,MFFO,MLLO,CCO,
      $XFFO,XLLO,XCFO,FHJLO,RHFFO,RHLLLO,
      $HSAT,HCDC,HAAD,HB3D,HJJO,HFG,RHCF,DMDVO,HXFFO,HXLLLO
C
      READ(5,INCCNO)
      READ(5,SCREEN)
      READ(5,SPHT)
      READ(5,MWBANK)

```

CON01410
 CON01420
 CON01430
 CON01440
 CON01450
 CON01460
 CON01470
 CON01480
 CON01490
 CON01500
 CON01510
 CON01520
 CON01530
 CON01540
 CON01550
 CON01560
 CON01570
 CON01580
 CON01590
 CON01600
 CON01610
 CON01620
 CON01630
 CON01640
 CON01650
 CON01660
 CON01670
 CON01680
 CON01690
 CON01700
 CON01710
 CON01720
 CON01730
 CON01740
 CON01750
 CON01760
 CON01770
 CON01780
 CON01790
 CON01800
 CON01810
 CON01820
 CON01830
 CON01840
 CON01850
 CON01860
 CON01870
 CON01880
 CON01890
 CON01900
 CON01910
 CON01920
 CON01930
 CON01940
 CON01950
 CON01960
 CON01970
 CON01980
 CON01990
 CON02000
 CON02010
 CON02020
 CON02030
 CON02040
 CON02050
 CON02060
 CON02070
 CON02080
 CON02090
 CON02100

```

      READ(5, ECOND)
      READ(5, DESPH)
      READ(5, DPMOCR)
      READ(5, H2OOCR)
      READ(5, BOILER)
      READ(5, THERMO)
      READ(5, LOSSES)
C      CALCULATION OF PRELIMINARY CONSTANTS
      FI=3.1415927
      G=32.2
      PRAA=P*RH2O
      VISCOA=VSCOH2O
      THCONA=K*H2O
      PRAH=PR*STH
      VISCON=VSCOSTH
      THCONH=K*STH
      XASUM=0.05
      FCL=.015
      GC=32.2
      VALVEO=JPOINT
      KSCD=KSDH2O
      KSDF=KSDH2O
      KSEF=KSDH2O
      CM=.11
      CPV=CM
      CPY=CM
      CPX=CM
      CPZ=CM
      CPW=CM
      KSGH=KSDH2O
      KSJL=KSDH2O
      KSJK=KSDH2O
      KSKL=KSDH2O
      ENTRCD=ENTH2O
      ENTPGH=ENTH2O
      RENDCD=RENH2O
      RENOGH=RENH2O
      EXITCD=1.0
      EXITGH=1.0
      PSAT=PCRH2O+14.7
      HSAT=EXP(0.25452*ALOG(PSAT)+4.46703)
      HFG=922.15-C.40516*PSAT+1.717E-04*PSAT**2.0-4.219E-09*PSAT**3.0
      FM=PSAT+HFG
      HMMO=H2O
      HF=HSAT
      TSAT=EXP(1.22151*ALOG(PSAT)+4.77123)
      MFCQC=OILFLU/3600.0
      MACCO=AIRFLU/3600.0
      TRRO=TJASSC
      TVVO=TSORH
      THHO=TSPTTR
      TQRO=TRRC
      TSSO=TGASSH
      TMNO=TSAT
      TTTO=TGAS48
      TUJO=TGASEC
      TTLC=(TTTO+TUJO)/2.0
      TAM9=80.0
      MMNO=TJST/3600.0
      MMME=MMMC*.0001
      MMHII=SPHST/3600.0
      TNNO=SHCT
      TPPC=DSHOT
      PNNO=SHPT+14.7
      FMNO=FORLA
      MMHII=JSHST/3600.0
      MNNO=MMHII
      TAAO=ECENT

```

```

CON02110
CON02120
CON02130
CON02140
CON02150
CON02160
CON02170
CON02180
CON02190
CON02200
CON02210
CON02220
CON02230
CON02240
CON02250
CON02260
CON02270
CON02280
CON02290
CON02300
CON02310
CON02320
CON02330
CON02340
CON02350
CON02360
CON02370
CON02380
CON02390
CON02400
CON02410
CON02420
CON02430
CON02440
CON02450
CON02460
CON02470
CON02480
CON02490
CON02500
CON02510
CON02520
CON02530
CON02540
CON02550
CON02560
CON02570
CON02580
CON02590
CON02600
CON02610
CON02620
CON02630
CON02640
CON02650
CON02660
CON02670
CON02680
CON02690
CON02700
CON02710
CON02720
CON02730
CON02740
CON02750
CON02760
CON02770
CON02780
CON02790
CON02800

```

FILE: CCANSTANT FORTRAN P1

NAVAL POSTGRADUATE SCHOOL

```

TRBO=ECJNT
V880=.01600488-.0000020146*TRBO+.000000036511*TRBO**2.0
E-8.142E-11*TRBO**3.0+1.4041E-13*TRBO**4.0-1.148E-16*
&TRBO**5.0+8.034E-20*TRBO**6.0
CTCTO=HRFVCL*1000.0/3600.0
HNNO=HSHCUT
CFIRAB=FTAS*1000.0/3600.0
ARAC=RHASSC
HPPC=HUSJLT
LCFI=LAVSC
LOF2=LJEL*NTUBSC
CDF=DTJHSC*NTUBSC/12.0
CDE=CDF
DEF=DUE
ACF=PI*CTUBSC**2.0*NTUBSC/(4.0*144.0)
VCLDF=ACF*LCFI
MASSV=MASSSC
MASSW=MASSSH
LJL1=LAVMB
LJL2=NTJRM3*LJL1
DJL=DTJRM3*NTJRM3/12.0
DJK=DJL
CKL=DJK
AJL=PI*CTJRM3**2.0*NTJRM3/(4.0*144.0)
VJLJL=AJL*LJL1
MASSY=MASSM3
MASSX=MASSXC
MASSZ=MASSZS
ZBENC1=HJRM-HHOF
LDF=ZBENC1
ZDF=ZBENC1
ZBENC2=HJRM-HHOF
LJL=ZBENC2
ZJL=ZBENC2
ZCC=ZCF
ZGH=ZJL
ZROCF=0.0
DRCJLO=0.0
LAB=LTUREC
CAB=CTUREC/12.0
AREAEC=NTUREC*LAB*PI*DAB*NFASSE
DNP=CTUREC/12.0
LCD=LAVHC*NTUREC
LGH=LAVDD*NTUREC
DCC=DTUREC*NTUREC/12.0
DGH=CTUREC*NTUREC/12.0
ACD=NTUREC*(PI*(CTUREC/24.0)**2.0)
AGH=NTUREC*(PI*(CTUREC/24.0)**2.0)
VOLDPM=(PI*JSTM**2.0/(4.0*144.0))*LSTMCM
VOLHJ=(PI*JSTM**2.0/(4.0*144.0))*LWTRDM
HAAD=HECIN
HBBO=HECCLT
RHOF=63.8-U.01781*TSAT+1.132E-05*TSAT**2.0-6.786E-08*TSAT**3.0
VF=1.0/RHCF
VFG=524.0/PSAT-0.1
VV=VF+VFG
RHOV=1.0/VV
RHOFG=RHOF-RHOV
RHOMNO=RHOFV
RHOMNO=RSHOLT
RHOPPO=RCSTOT
MAAO=MNO
MBOC=MAAC

```

CON02810
 CON02820
 CON02830
 CON02840
 CON02850
 CON02860
 CON02870
 CON02880
 CON02890
 CON02900
 CON02910
 CON02920
 CON02930
 CON02940
 CON02950
 CON02960
 CON02970
 CON02980
 CON02990
 CON03000
 CON03010
 CON03020
 CON03030
 CON03040
 CON03050
 CON03060
 CON03070
 CON03080
 CON03090
 CON03100
 CON03110
 CON03120
 CON03130
 CON03140
 CON03150
 CON03160
 CON03170
 CON03180
 CON03190
 CON03200
 CON03210
 CON03220
 CON03230
 CON03240
 CON03250
 CON03260
 CON03270
 CON03280
 CON03290
 CON03300
 CON03310
 CON03320
 CON03330
 CON03340
 CON03350
 CON03360
 CON03370
 CON03380
 CON03390
 CON03400
 CON03410
 CON03420
 CON03430
 CON03440
 CON03450
 CON03460
 CON03470
 CON03480
 CON03490
 CON03500

CALCULATE THE TOTAL MASS OF FLUE GAS IN THE FURNACE
 MASSCR=QFLUE*FJRVTL
 CALCULATE THE TOTAL ENERGY ENTERING BOILER

C
 C
 C
 C
 C

FILE: CONSTANT FORTRAN P1

NAVAL POSTGRADUATE SCHOOL

QQC=QTOTC*FLRVCL

CALCULATE "LIMPEC" LOWER HEATING VALUE OF FUEL/AIR MIX

FHV=QQC/MFOCU

CALCULATE ENERGY ABSORBED BY RADIATION IN FURNACE-C

C1C=CFLFAB*ARAD

C20=C10

CALCULATE THE STEFAN-BOLTZMAN CONSTANT MULTIPLIED BY THE SCREEN AREA

SIGMAA=Q10/((TORC+460.0)**4.0-(TVVO+460.0)**4.0)

CALCULATE THE TOTAL FLUE GAS MASS FLOW RATE INTO BOILER

MCCO=MFCGO+MACCO

MRRU=MQRUC

MSSU=MRRUC

MTTO=MSSUC

MUUC=MTTUC

COMPUTE THE ENERGY TRANSFERRED TO THE WATER (LOWER) DRUM BY THE DESUPERHEATER

Q90=MNNO*(HNNO-HPPD)

Q990=Q90

CALCULATE THE ENERGY TRANSFERRED TO THE MAIN BANK RISERS

Q6C=MNNO*(HMNO-HEEJ)-Q20-Q990

Q5C=Q6C

COMPUTE THE MAIN BANK HEAT TRANSFER COEFFICIENT-TUBE METAL TO STEAM SIDES

KY=AREAM8/1.782E6

COMPUTE THE MAIN BANK TUBE METAL TEMPERATURE

TTYO=(Q60/(KY*PSAT**((4.0/3.0)))+(1.0/3.0)+TSAT

COMPUTE THE MAIN BANK HEAT TRANSFER COEFFICIENT-FLUE GAS TO TUBE METAL

TSTO=(TSSO+TTTO)/2.0

KST=Q50/(MSSO**0.8*(TSTO-TTYO))

COMPUTE THE SCREEN BANK HEAT TRANSFER COEFFICIENT-TUBE METAL TO STEAM SIDES

KV=Q10/(PSAT**((4.0/3.0)*(TVVO-TSAT)**3.0)

COMPUTE THE HEAT TRANSFER TO THE SUPERHEATER

Q4C=MNNO*(HNNO-HPPD)

Q30=Q40

COMPUTE THE SPECIFIC HEAT OF THE STEAM IN THE SUPERHEATER

C4N=Q40/(MNNO*(TNNO-TMNO))

COMPUTE THE SUPERHEATER HEAT TRANSFER COEFFICIENT-FLUE GAS TO TUBE METAL-C

TRSC=(TRRO+TSSO)/2.0

CON03510
CON03520
CON03530
CON03540
CON03550
CON03560
CON03570
CON03580
CON03590
CON03600
CON03610
CON03620
CON03630
CON03640
CON03650
CON03660
CON03670
CON03680
CON03690
CON03700
CON03710
CON03720
CON03730
CON03740
CON03750
CON03760
CON03770
CON03780
CON03790
CON03800
CON03810
CON03820
CON03830
CON03840
CON03850
CON03860
CON03870
CON03880
CON03890
CON03900
CON03910
CON03920
CON03930
CON03940
CON03950
CON03960
CON03970
CON03980
CON03990
CON04000
CON04010
CON04020
CON04030
CON04040
CON04050
CON04060
CON04070
CON04080
CON04090
CON04100
CON04110
CON04120
CON04130
CON04140
CON04150
CON04160
CON04170
CON04180
CON04190
CON04200

FILE: CONSTANT FORTRAN PI

NAVAL POSTGRADUATE SCHOOL

KRS=Q30/(MRR0**0.6*(TRSO-TW0))

COMPUTE THE HEAT TRANSFER TO THE ECONOMIZER

Q8C=MAA0*(TB80-TAA0)

Q7C=Q80

COMPUTE THE SPECIFIC HEAT OF THE FEEDWATER
IN THE ECONOMIZER

CAB=Q8C/(MAAG*(TB80-TAA0))

COMPUTE THE SPECIFIC HEAT OF FLUE GAS IN THE FURNACE

QCR=(Q20-Q10)/(MRR0*(TQ20-TAMB))

COMPUTE THE SPECIFIC HEAT OF FLUE GAS IN THE SUPERHEATER

CRS=Q30/(MRR0*(TRR0-TSS0))

COMPUTE THE SPECIFIC HEAT OF FLUE GAS IN THE MAIN BANK

CST=Q50/(MSS0*(TSS0-TT0))

COMPUTE THE SPECIFIC HEAT OF FLUE GAS IN THE ECONOMIZER

CTL=Q70/(MTT0*(TTT0-TU0))

COMPUTE THE ECONOMIZER HEAT TRANSFER COEFFICIENT-TUBE
METAL TO LIQUID

KX=((0.23*THC0NA)/CAB)*(4.0/(PI*OAB*VISCOA*NTUBEC))**0.8
8*PRAA**0.4*AREAEC

COMPUTE THE LMTD FOR THE ECONOMIZER

LMTDAB=Q80/(KX*MAA0**0.8)

COMPUTE THE ECONOMIZER TUBE METAL TEMPERATURE

EXPOEC=EXP((TB80-T1AC)/LMTDAB)
TXX0=(T1A0-T2B0*EXPOEC)/(1.0-EXPOEC)

COMPUTE THE ECONOMIZER HEAT TRANSFER COEFFICIENT-FLUE
GAS TO TUBE METAL

KTU=Q70/(MTT0*(TTU0-TXX0))

COMPUTE THE DESUPERHEATER HEAT TRANSFER COEFFICIENT-TUBE
METAL TO STEAM

KZ=((0.23*THC0NP)/KNP)*(4.0/(PI*ONP*VISCON*NTUBDS))
8**0.8*PRAN**0.3*AREADS

COMPUTE THE DESUPERHEATER LMTD

LMTDNP=Q90/(KZ*MNN0**0.8)

COMPUTE THE SPECIFIC HEAT OF STEAM IN THE DESUPERHEATER

CNP=Q90/(MNN0*(TNN0-TPO0))

COMPUTE DESUPERHEATER TUBE METAL TEMPERATURE

EXPDS=EXP((TNN0-TPO0)/LMTDNP)
T220=(TNN0-EXPDS*TPO0)/(1.0-EXPDS)

COMPUTE THE DESUPERHEATER HEAT TRANSFER COEFFICIENT-
WATER DRUM LIQUID TO TUBE METAL

CON04210
CON04220
CON04230
CON04240
CON04250
CON04260
CON04270
CON04280
CON04290
CON04300
CON04310
CON04320
CON04330
CON04340
CON04350
CON04360
CON04370
CON04380
CON04390
CON04400
CON04410
CON04420
CON04430
CON04440
CON04450
CON04460
CON04470
CON04480
CON04490
CON04500
CON04510
CON04520
CON04530
CON04540
CON04550
CON04560
CON04570
CON04580
CON04590
CON04600
CON04610
CON04620
CON04630
CON04640
CON04650
CON04660
CON04670
CON04680
CON04690
CON04700
CON04710
CON04720
CON04730
CON04740
CON04750
CON04760
CON04770
CON04780
CON04790
CON04800
CON04810
CON04820
CON04830
CON04840
CON04850
CON04860
CON04870
CON04880
CON04890
CON04900

FILE: CONSTANT FORTRAN PL

NAVAL POSTGRADUATE SCHOOL

KHJ=C990/(TZ2C-TSAT)

COMPUTE THE SUPERHEATER LMTD

LMTDM=(TANO-T4MO)/(ALOG((T4WO-T4MO)/(T4WO-T4NC)))

CALCULATE THE SUPERHEATER HEAT TRANSFER COEFFICIENT-TU E
METAL TO STEAM

KW=Q40/(MMO**0.8*LMTDM)

CALCULATE THE THROTTLE VALVE FLOW COEFFICIENT

KON4=MMIII/(VALVE)*FANO)

CALCULATE THE SUPERHEATER OUTLET DENSITY

KON3=(P4MO+P4NO)/(RHO4MO+RHO4NO)

RHO4MO=(RHO4MO)+RHO4NO)/2.0

KON1=((P4NO-P4MO)*RHO4MO)/MMO**2.0

COMPUTE THE FRICTION FACTORS FOR THE DOWNCOMERS
AND THE RISERS

FCD=1.0/(1.74-2.0*ALOG10(KSCD))

FGH=1.0/(1.74-2.0*ALOG10(KSCH))

FDE=1.0/(1.74-2.0*ALOG10(KSDE))

FEF=1.0/(1.74-2.0*ALOG10(KSEF))

FJK=1.0/(1.74-2.0*ALOG10(KSJK))

FKL=1.0/(1.74-2.0*ALOG10(KSKL))

START ITERATION TO BALANCE CIRCULATION LOOPS

COMPUTE INITIAL VALUE OF RISER OUTLET MASS FLOW RATE

MFFC=0.10/(XASUME*HFG)

MLLO=C50/(XASUME*HFG)

CALCULATE THE INITIAL DOWNCOMER ENTHALPY

71 HCDC=((MFFC+MLLO-M380)*HF+M380*H380+0.0*(MFFC+MLLO)
6*HV)/(MFFC+MLLO)

HGH0=HCDC

COMPUTE THE INITIAL DRUM ENTHALPY

FORUM0=HCDC

COMPUTE MAIN BANK RISER INLET ENTHALPY

MHFO=MLLO

HJJ0=HGH0+Q90/MHFO

CALCULATE THE RISER INLET DENSITY

RHCD00=RHOE

RHCJJ0=RHOE

COMPUTE THE DOWNCOMER DENSITY

VCDC=((MFFC+MLLO-M380)*VF+M380*V380)
6/(MFFC+MLLO)

RHDCDC=1.0/VCDC

RHJGF0=RHO00

CALCULATE THE RISER OUTLET QUALITY

CON04910

CON04920

CON04930

CON04940

CON04950

CON04960

CON04970

CON04980

CON04990

CON05000

CON05010

CON05020

CON05030

CON05040

CON05050

CON05060

CON05070

CON05080

CON05090

CON05100

CON05110

CON05120

CON05130

CON05140

CON05150

CON05160

CON05170

CON05180

CON05190

CON05200

CON05210

CON05220

CON05230

CON05240

CON05250

CON05260

CON05270

CON05280

CON05290

CON05300

CON05310

CON05320

CON05330

CON05340

CON05350

CON05360

CON05370

CON05380

CON05390

CON05400

CON05410

CON05420

CON05430

CON05440

CON05450

CON05460

CON05470

CON05480

CON05490

CON05500

CON05510

CON05520

CON05530

CON05540

CON05550

CON05560

CON05570

CON05580

CON05590

CON05600

FILE: CONSTANT FORTRAN P1

NAVAL POSTGRADUATE SCHOOL

```

HDDO=HCCO
XFFO=(JIC+MFFO*(HF-HCJO))/(MFFO*HFG)
XLLO=(JJO+MLLO*(HF-HJJO))/(MLLO*HFG)

      CALCULATE THE RISER OUTLET DENSITY
RHCFPC=RHCF-XFFO*RHCFG
RHOLLC=PHJF-XLLO*RHCFG

      CALCULATE THE NONBOILING LENGTH OF THE RISERS
ZBENC1=FNORM-HHCF
LDF=ZBENC1
LDEO=LDF*MAX1((HF-HDDO),0.0)/((HDDO+XFFO*HFG)-HDDO)
ZBENC2=HNCRM-HWTRCM
LJL=ZBENC2
LJKO=LJL*MAX1((HF-HJJO),0.0)/((HJJO+XLLO*HFG)-HJJO)

      CALCULATE BOILING LENGTH OF RISERS
LEFO=LDF-LDEO
LKLO=LJL-LJKO

      CALCULATE THE AVERAGE DENSITY IN THE SCREEN RISER
RHCFPO=(1.0/LDF)*(LEFO/((XFFO)*VFG)*ALOG((XFFO
6)/VFG)+1.0)+RHCCO*LDEO)

      CALCULATE THE AVERAGE DENSITY IN THE MAIN BANK RISER
RHCFJO=(1.0/LJL)*(LKLO/((XLLO)*VFG)*ALOG((XLLO
6)*VFG)/VFG+1.0)+RHCCO*LJKO)

      CALCULATE THE EFFECTIVE HEIGHT OF THE RISERS
ZDEO=ZDF-LEFO
ZJKO=ZJL-LKLO
ZEFO=ZDF-ZDEO
ZKLO=ZJL-ZJKO

      COMPUTE THE TWO PHASE FLOW MULTIPLICATION FACTORS
RGRAVE=24.794*XFFO**2.0-6.5066*XFFO+.9776
RGRAVK=24.794*XLLO**2.0-6.5066*XLLO+.9776
RACLE=15.4564*XFFO**2.0+13.4944*XFFO-.00007
RACLJ=15.4564*XLLO**2.0+13.4944*XLLO-.00007
RFRICE=-34.0522*XFFO**2.0+23.7164*XFFO+.8734
RFRICK=-34.0322*XLLO**2.0+23.7164*XLLO+.8734

      CALCULATE SECOND APPROXIMATION OF MASS FLOW RATE AT
      EXIT OF SCREEN RISERS
RHDEEO=RHDDO
MFFCC=((RHCCO*G*ZDEO-G*ZDEO*((RHDDO+RHCFEO)/2.0)
6-G*ZEFO+RHDEEO*RGRAVE)/((FCO*LCD/DC)+ENTRCD
6+BEITCD+EXITCD)/(2.0*ACD**2.0*PHJJO)+((PHJEO-RHDDO)
6/(RHDEEO+RHDDO*ADF**2.0))+(4.0*FDE*LDEO*2.0
6)/(2.0*ADF*(PHJEO+RHDDO)*ADF**2.0)+RACLE/
6(RHDEEO*ADF**2.0)+(4.0*FEF*LEF)*FICE)/
6(2.0*DDF*RHDEEO*ADF**2.0))**0.5

      CALCULATE SECOND APPROXIMATION OF MASS FLOW RATE
      AT EXIT OF MAIN BANK RISERS
RHOKKO=PHOJJO
MLLOO=((RHJJO*G*ZJKO-G*ZJKO*((RHJJO+RHOKKO)/2.0)
6-G*ZKLO+RHOKKO*RGRAVK)/((FCO*LCD/DC)+ENTRCH
6+BEITGH+EXITGH)/(2.0*AGH**2.0*RHJJO)+((PHJJO-RHCFJO)
6/(RHOKKO+RHJJO*AJL**2.0))+(4.0*FJK*LJKO*2.0
6)/(2.0*DJL*(RHJJO+RHCFJO)*AJL**2.0)+RACLJ/

```

CON05610
 CON05620
 CON05630
 CON05640
 CON05650
 CON05660
 CON05670
 CON05680
 CON05690
 CON05700
 CON05710
 CON05720
 CON05730
 CON05740
 CON05750
 CON05760
 CON05770
 CON05780
 CON05790
 CON05800
 CON05810
 CON05820
 CON05830
 CON05840
 CON05850
 CON05860
 CON05870
 CON05880
 CON05890
 CON05900
 CON05910
 CON05920
 CON05930
 CON05940
 CON05950
 CON05960
 CON05970
 CON05980
 CON05990
 CON06000
 CON06010
 CON06020
 CON06030
 CON06040
 CON06050
 CON06060
 CON06070
 CON06080
 CON06090
 CON06100
 CON06110
 CON06120
 CON06130
 CON06140
 CON06150
 CON06160
 CON06170
 CON06180
 CON06190
 CON06200
 CON06210
 CON06220
 CON06230
 CON06240
 CON06250
 CON06260
 CON06270
 CON06280
 CON06290
 CON06300

FILE: CONSTANT FORTRAN P1

NAVAL POSTGRADUATE SCHOOL

$\& (RHKKK*AJL**2.0) + (4.C*FKL*LKLO*RFRIK) /$
 $\& (2.0*CJK*RHKKO*AJL**2.0)) * 0.5$

COMPARE PREVIOUS APPROXIMATION FOR RISER MASS
 FLOW RATE TO CURRENT, IF WITHIN ERROR CRITERIA CONTINUE,
 IF NOT, UPDATE AND THEN REITERATE-

CHECK=0.0
 IF (ABS(MFFC-MFFCC).LT..01) GO TO 52
 MFFC=(MFFCJ-MFFC)/2.0+MFFC

62 CHECK=1.0
 IF (ABS(MLLO-MLLOC).LT..01) GO TO 54
 MLLO=(MLLOJ-MLLO)/2.0+MLLO

GO TO 71
 64 IF (CHECK.EQ.1.0) GO TO 71

COMPUTE INITIAL MASS OF LIQUID IN DRUM

DMASLO=(VOLDRM*RHOCCO)/2.0

COMPUTE THE INITIAL DRUM "LIQUID" VOLUME

DMOVC=VOLDRM/2.0

COMPUTE THE INITIAL ENERGY STORED IN DRUM LIQUID

DMCHLO=DMASLO*HCRUMO

EQUATE INITIAL FLOW RATES

MCDQ=MFFC
 MGHQ=MLLO

COMPUTE INITIAL MASS OF STEAM IN STEAM
 DRUM

DSTMQ=VOLDRM*RHOV/2.0

COMPUTE HXFFO AND HXLLQ

HXFFO=HF+HFG*HFFC/2.0
 HXLLQ=HF+HFG*HLLC/2.0

600 WRITE(5,600)
 FORMAT(1H1)
 WRITE(6,INCN1)
 WRITE(6,601)
 601 FORMAT(1H1)
 WRITE(6,INCN2)
 WRITE(6,601)
 WRITE(6,INCN3)
 WRITE(6,601)
 WRITE(6,CONST1)
 WRITE(6,601)
 WRITE(6,CONST2)
 WRITE(6,601)
 WRITE(6,CONST3)
 WRITE(6,601)
 WRITE(6,CONST4)
 WRITE(6,601)
 WRITE(6,CONST5)
 WRITE(6,601)
 WRITE(6,600)
 WRITE(6,OUTPUT)
 WRITE(7,INCN1)
 WRITE(7,INCN2)
 WRITE(7,INCN3)
 WRITE(7,CONST1)
 WRITE(7,CONST2)
 WRITE(7,CONST3)

CON06310
 CON06320
 CON06330
 CON06340
 CON06350
 CON06360
 CON06370
 CON06380
 CON06390
 CON06400
 CON06410
 CON06420
 CON06430
 CON06440
 CON06450
 CON06460
 CON06470
 CON06480
 CON06490
 CON06500
 CON06510
 CON06520
 CON06530
 CON06540
 CON06550
 CON06560
 CON06570
 CON06580
 CON06590
 CON06600
 CON06610
 CON06620
 CON06630
 CON06640
 CON06650
 CON06660
 CON06670
 CON06680
 CON06690
 CON06700
 CON06710
 CON06720
 CON06730
 CON06740
 CON06750
 CON06760
 CON06770
 CON06780
 CON06790
 CON06800
 CON06810
 CON06820
 CON06830
 CON06840
 CON06850
 CON06860
 CON06870
 CON06880
 CON06890
 CON06900
 CON06910
 CON06920
 CON06930
 CON06940
 CON06950
 CON06960
 CON06970
 CON06980
 CON06990
 CON07000

FILE: CONSTANT FORTRAN P1

NAVAL POSTGRADUATE SCHOOL

WRITE(7,CONST4)
WRITE(7,CONST5)
WRITE(7,OUTPUT)
STOP
END

CONC7C10
CONC7020
CONC7030
CONC7040
CONC7050

APPENDIX B

08/30/75 21.26.15

FILE: CSMP FORTRAN P1

NAVAL POSTGRADUATE SCHOOL

//HOPEFULL J03 (2473,C567,NE91,,9), 'WALKER SMC 1319', TIME=2

// EXEC CSMPXV

//X.SYSIN DO *

*

*

*

THIS D TYPE RTILER MODEL IS WRITTEN IN CSMP-III
COMPUTER LANGUAGE. IT IS A NONLINEAR MODEL
WHICH UTILIZES A SET OF INITIAL CONDITIONS AND
OTHER DATA PREPARED BY AN INITIAL CONDITION FORTRAN
MODEL WHICH PRECEDES THIS ONE. THE MODEL IS GOOD
FOR SMALL TRANSIENTS AROUND THE OPERATING POINT
SPECIFIED BY THE INITIAL CONDITION PROGRAM.

*

INITIAL

CONST DRA41=C.C,DRA42=C.C,DRA43=C.C,DRA44=C.C,DRA45=C.C,DRA46=C.C,...
DRA47=C.C,DRA48=C.C,DRA49=C.C,DRA50=C.C,DRA51=C.C,DRA52=C.C,DRA53=C.C,DRA54=C.C,...
DRA55=C.C,DRA56=C.C,DRA57=C.C,DRA58=C.C

CONST ONE=1.C, ...

TRRO= 2563.0000 ,TVVJ= 600.00000 ,TWVJ= 1033.0000 ,TYYC=...

515.42745 ,TZZD= 600.99976 ,TXXO= 360.36450

CONST TWO=2.0, ...

DMJHO= 2.754667.0 ,CMASST= 5415.8164 ,MAAJ= 45.000000 ,TAAO=...

254.00000 ,MFOOJ= 3.3074999 ,MAQOJ= 55.398880 ,MMNO=...

7.7500000 ,MMOJ= 45.000000 ,VLLVEO= 0.50549999 ,MAOO=...

55.206375 ,CMN= 0.65523028 ,CAB= 1.0761900 ,CPV=0.10999995,...

CPV= 0.10999995 ,CPX= 0.10999995 ,CPZ= 0.10999995 ,CPW=...

0.10999995 ,DMJLO=3961620.0 ,CMASLO=8002.2000 ,DMOVO=163.65698

CONST THREE=3.C, ...

DRODFO= 0.0 ,JFOJLO= 0.0 ,MROD= 45.000000 ,LSTMDV=...

16.665555 ,MGHO= 062.70825 ,MROD= 45.000000 ,LSTMDV=...

CONST FOUR=4.0, ...

KSJL= 0.55555591E-04 ,KSJF= 0.29999996E-04 ,KSGH= 0.45999999E-05 ,KSCD=...

0.45555599E-05 ,KSJE= 0.25555596E-04 ,KSEF= 0.29999996E-04, ...

KSJL= 0.55555591E-04, ...

KSKL= 0.55555591E-04 ,AJL= 10.678426 ,DJL= 196.57166 ,LJL2=...

26420.000 ,LJL1= 10.000000 ,DJF= 35.897476 ,LJF=15.750000,...

LDF1= 12.700000 ,CF= 4.0646048 ,LGH= 25.000000 ,AGH=...

1.4451332 ,SAMPL=250 ,RISTIM=10.0

CONST FIVE=5.0, ...

OGH= 1.5183321 ,DCO= 4.6699991 ,LCC= 9+500000 ,LDEO=...

2.6166515 ,LJKJ= 0.80500102 ,ACD= 2.9547773 ,MASSV=7951.3984...

,MASSW= 10752.000 ,VSSY= 25192.000 ,MASX= 24443.000 ,MASSZ=...

1017.0000 ,ZBENC1= 15.750000 ,FCO= 0.81023693E-01, ...

FCE= 0.92714840E-01 ,FEF= 0.92714840E-01 ,FGH=0.81023693E-01

CONST SIX=6.0, ...

ZBENC2= 12.410001 ,MASSJR= 71.355 ,VOLJL= 106.78426 ,VCLC...

F= 51.620468 ,VLDRA= 327.51396 ,VOLHJ= 58.174744

CONST SEVEN=7.0, ...

COJ= 0.51599814 ,CFS= 0.30453670 ,CST= 0.29042804 ,CTU=...

C.26026064 ,CMP= 0.53347189 ,KNP= 18.508820 ,KW=2.0997724,...

SIGMA= 0.21122812E-05 ,KRS= 0.87199436 ,KST= 2.2037563

CONST EIGHT=8.0, ...

KTU= 0.44126600 ,ENTRCH= 0.99999964E-01 ,ENTPCD= 0.99999964E-01,...

1.0000000 ,RENTCD= 0.99999964E-01 ,EXITCH= 1.0000000 ,EXITCD=...

KJN4= 0.10777515 ,MAAJ= 221.00000 ,KJN1= 0.10345870E-01,...

GC= 32.199997 ,TAM= 80.000000 ,ZCO= 15.750000 ,ZOF=...

15.750000 ,ZJL= 12.410001 ,LJL= 12.410001 ,...

RENOGH= 0.14555553 ,KONJ= 647.71460 ,J=32.199997 ,DSTWJ=247.59802

CONST NINE=9.0, ...

KX= 10.077373 ,KZ= 14.930669 ,KV= 0.32769013E-05,...

FHV= 15200.456 ,DJF= 35.897476 ,DKL= 196.57166 ,DEF=...

35.897476 ,DJK= 196.57166 ,KY= 0.36682502E-02,...

DRA1C=C.C,DRA20=0.0,XFF)=0.13950000E-01,...

CSM00010
CSM00020
CSM00030
CSM00040
CSM00050
CSM00060
CSM00070
CSM00080
CSM00090
CSM00100
CSM00110
CSM00120
CSM00130
CSM00140
CSM00150
CSM00160
CSM00170
CSM00180
CSM00190
CSM00200
CSM00210
CSM00220
CSM00230
CSM00240
CSM00250
CSM00260
CSM00270
CSM00280
CSM00290
CSM00300
CSM00310
CSM00320
CSM00330
CSM00340
CSM00350
CSM00360
CSM00370
CSM00380
CSM00390
CSM00400
CSM00410
CSM00420
CSM00430
CSM00440
CSM00450
CSM00460
CSM00470
CSM00480
CSM00490
CSM00500
CSM00510
CSM00520
CSM00530
CSM00540
CSM00550
CSM00560
CSM00570
CSM00580
CSM00590
CSM00600
CSM00610
CSM00620
CSM00630
CSM00640
CSM00650
CSM00660
CSM00670
CSM00680
CSM00690
CSM00700

FILE: CSMP FORTRAN P1 NAVAL POSTGRADUATE SCHOOL

XLLO=C.4CCCCCCE-01,MFFC=9EC.02734,MLLO=662.70825
 CRST TEN=10.0
 DRA11=C.0,DRA12=0.0,DRA13=C.0,DRA14=C.0,DRA15=0.0,DRA16=0.0,...
 DRA17=0.0,DRA21=C.0,DRA22=C.0,DRA23=0.0,DRA24=0.0,...
 FCL=.015,CCO=63836.395,ZSF=12.410001
 DPA25=C.0,DPA26=C.0,DPA27=0.0,HXLLC=505.81,HXFFO=502.34
 DYNAMIC

```

*
*      INPUT EQUATIONS
*
VALVE=.015*RAMP(10.0)-.015*RAMP(20.0)+.51
MNN=MNNC
MAA=MAAO
TAA=TAAO
*
*      COMPUTE THE TOTAL FLUE GAS FLOW RATE INTO BOILER
*
MCC=MCCO
*
*      COMPUTE THE ENERGY ENTERING THE BOILER
*
QO=QOO
*
*      COMPUTE THE ENERGY TRANSFERRED TO THE SCREEN RISERS
*      VIA RADIATION
*
C1=SIGMAA*((TRR+460.0)**4.0-(TVV+460.0)**4.0)
*
*      COMPUTE THE RATE EQUATION FOR FURNACE FLUE GAS
*      TEMPERATURE
*
DTRR=(QO-C1-MRR*COR*(TRR-TAMB))/(MASSQR*COR)
*
*      COMPUTE THE FLUE GAS TEMPERATURE
*
TRR=INTGRL(TRRO,DTRR)
*
*      COMPUTE THE TEMPERATURE OF THE FLUE GAS
*      LEAVING THE SUPERHEATER
*
PH11=2.0*MRR*0.4*CRS/KPS
TSS=(TRR*(PH11-1.0)+2.0*TWX)/(PH11+1.0)
*
*      COMPUTE THE SUPERHEATER ENERGY TRANSFER
*      FLUE GAS TO TUBE METAL
*
Q3=MRR*CRS*(TRR-TSS)
*
*      COMPUTE THE MAIN BANK ENERGY TRANSFER
*      FLUE GAS TO TUBE METAL
*
Q5=MSS*GST*(TSS-TTT)
*
*      COMPUTE THE TEMPERATURE OF THE FLUE GAS
*      LEAVING THE MAIN BANK
*
PH12=2.0*MSS*0.4*GST/KST
TTT=(TSS*(PH12-1.0)+2.0*TYX)/(PH12+1.0)
*
*      COMPUTE THE TEMPERATURE OF THE FLUE GAS LEAVING-
*      THE ECONOMIZER
*
PH13=2.0*CTL/KTL
TUU=(TTT*(PH13-1.0)+2.0*TXX)/(PH13+1.0)
*
*      COMPUTE ECONOMIZER ENERGY TRANSFER
*      FLUE GAS TO TUBE METAL
*
Q7=MTT*CTL*(TTT-TUU)
*

```

CSM00710
 CSM00720
 CSM00730
 CSM00740
 CSM00750
 CSM00760
 CSM00770
 CSM00780
 CSM00790
 CSM00800
 CSM00810
 CSM00820
 CSM00830
 CSM00840
 CSM00850
 CSM00860
 CSM00870
 CSM00880
 CSM00890
 CSM00900
 CSM00910
 CSM00920
 CSM00930
 CSM00940
 CSM00950
 CSM00960
 CSM00970
 CSM00980
 CSM00990
 CSM01000
 CSM01010
 CSM01020
 CSM01030
 CSM01040
 CSM01050
 CSM01060
 CSM01070
 CSM01080
 CSM01090
 CSM01100
 CSM01110
 CSM01120
 CSM01130
 CSM01140
 CSM01150
 CSM01160
 CSM01170
 CSM01180
 CSM01190
 CSM01200
 CSM01210
 CSM01220
 CSM01230
 CSM01240
 CSM01250
 CSM01260
 CSM01270
 CSM01280
 CSM01290
 CSM01300
 CSM01310
 CSM01320
 CSM01330
 CSM01340
 CSM01350
 CSM01360
 CSM01370
 CSM01380
 CSM01390
 CSM01400

FILE: CSMP

F0RTRAN P1

NAVAL POSTGRADUATE SCHOOL

```

*
*      USE CONTINUITY RELATIONSHIP TO COMPUTE THE MASS
*      FLOW RATE UP THE RISERS
*
MLL=MJJ-DRHOJL*VOLJL
FFF=MCC-DRHOCF*VOLCF
DRA16=DEFIN(DRA10,RHOJL)
DRA28=DEFIN(DRA20,RHOCF)
PROCEDURE CRFCJL=FILTER1(DRA14)
IF(KEEP.NE.1)GO TO 1
DRHJL=(DRA13+DRA17+DRA16+DRA15+DRA14+DRA13+DRA12+DRA11+...
      DRA31+DRA32+DRA33+DRA34+DRA35+DRA36+DRA37+DRA38)/16.0
DRA53=DRA52
DRA52=DRA51
DRA51=DRA31
DRA31=DRA32
DRA32=DRA33
DRA33=DRA34
DRA34=DRA35
DRA35=DRA36
DRA36=DRA37
DRA37=DRA38
DRA38=DRA11
DRA11=DRA12
DRA12=DRA13
DRA13=DRA14
DRA14=DRA15
DRA15=DRA16
DRA16=DRA17
DRA17=DRA18
1  CONTINUE
ENDPROCEDURE
PROCEDURE CRFCF=FILTER2(DRA24)
IF(KEEP.NE.1)GO TO 2
CRHCF=(DRA26+DRA27+DRA26+DRA25+DRA24+DRA23+DRA22+DRA21+...
      DRA41+DRA42+DRA43+DRA44+DRA45+DRA46+DRA47+DRA48)/16.0
DRA63=DRA62
DRA62=DRA61
DRA61=DRA41
DRA41=DRA42
DRA42=DRA43
DRA43=DRA44
DRA44=DRA45
DRA45=DRA46
DRA46=DRA47
DRA47=DRA48
DRA48=DRA21
DRA21=DRA22
DRA22=DRA23
DRA23=DRA24
DRA24=DRA25
DRA25=DRA26
DRA26=DRA27
DRA27=DRA28
2  CONTINUE
ENDPROCEDURE
*
*      COMPUTE THE AVERAGE DENSITY IN THE RISERS
*
*
RHOJL=(1.0/LJL)*((LKL/(XLL*VFG))*ALOG((XLL/VF)*VFG+1.0)...
      +RHCUJ*LJK)
RHOCF=(1.0/LCF)*((LEF/(XFF*VFG))*ALOG((XFF/VF)*VFG+1.0)...
      +RHCCF*LJE)
RHOCF=RHOCF-XFF*RHJFG
RHOLL=RHOCF-XLL*RHOCF
*      COMPUTE THE MAIN BANK ENERGY TRANSFER -
*      TUBE METAL TO MAIN BANK MIXTURE
*
C6=KY*FSAT**14.0/3.0*(TYY-TSAT)**3.0

```

```

CSMC1410
CSMC1420
CSMC1430
CSMC1440
CSMC1450
CSMC1460
CSMC1470
CSMC1480
CSMC1490
CSMC1500
CSMC1510
CSMC1520
CSMC1530
CSMC1540
CSMC1550
CSMC1560
CSMC1570
CSMC1580
CSMC1590
CSMC1600
CSMC1610
CSMC1620
CSMC1630
CSMC1640
CSMC1650
CSMC1660
CSMC1670
CSMC1680
CSMC1690
CSMC1700
CSMC1710
CSMC1720
CSMC1730
CSMC1740
CSMC1750
CSMC1760
CSMC1770
CSMC1780
CSMC1790
CSMC1800
CSMC1810
CSMC1820
CSMC1830
CSMC1840
CSMC1850
CSMC1860
CSMC1870
CSMC1880
CSMC1890
CSMC1900
CSMC1910
CSMC1920
CSMC1930
CSMC1940
CSMC1950
CSMC1960
CSMC1970
CSMC1980
CSMC1990
CSMC2000
CSMC2010
CSMC2020
CSMC2030
CSMC2040
CSMC2050
CSMC2060
CSMC2070
CSMC2080
CSMC2090
CSMC2100

```

FILE: CSMP

FORTRAN P1

NAVAL POSTGRADUATE SCHOOL

```

*
*      COMPUTE THE SCREEN RISER ENERGY TRANSFER -
*      TUBE METAL TO SCREEN RISER MIXTURE
*
Q2=KV*PSAT**(.40/3.0)*(TVV-TSAT)**3.0
*
*      COMPUTE THE RISER AVERAGE ENTHALPIES
*
HOF=HDD+XFF*HFG/2.0
HJL=HJJ+XLL*HFG/2.0
*
*      COMPUTE THE RISER OUTLET ENTHALPIES
*
HFF=HF+XFF*HFG
HLL=HF+XLL*HFG
*
*      COMPUTE THE RISER EFFECTIVE HEIGHTS
*
ZCE=ZCF-LEF
ZJK=ZJL-LKL
ZKL=ZJL-ZJK
ZEF=ZCF-ZDE
*
*      COMPUTE THE SPECIFIC VOLUME OF THE ECONOMIZER
*      OUTLET LIQUID
*
V8B=.0160046-.0000020146*T8B+.00000036511*T8B**2.0...
-.142E-11*T8B**3.0)+1.403E-13*T8B**4.0-1.148E-16*T8B**5.0...
+.034E-20*T8B**6.0
*
*      COMPUTE THE RATE EQUATION FOR RISER OUTLET QUALITY
*
CHXLL=(MCG*(HJJ-HF-XLL*HFG/2.0)+Q2-MLL*XLL*HFG/2.0)/(RHOJL*VOLKL)
HXLL=INTGR1(HXLLC,CHXLL)
ALL=(HXLL-HF)*2.0/HFG
CHXFF=(MCG*(HCE-HF-XFF*HFG/2.0)+Q2-MFF*XFF*HFG/2.0)/(RHODF*VOLF)
HXFF=INTGR1(HXFFC,CHXFF)
XFF=(HXFF-HF)*2.0/HFG
*
*
*      COMPUTE THE RISER BOILING VOLUME
*
VOLCF=VOLDF*LEF/LCF
VOLKL=VOLJL*LKL/LJL
*
*      COMPUTE THE NUCLEATING LENGTH OF THE RISERS
*
LDE=LCF*(HF-HDD)/((HF+AFF*HFG)-HDD)
LJK=LJL*(HF-HJJ)/((HF+ALL*HFG)-HJJ)
*
*      COMPUTE THE BOILING LENGTH OF THE RISERS
*
LKL=LJL-LJK
LEF=LCF-LDE
*
*
*      COMPUTE THE MASS RATE EQUATION FOR STEAM CONDENSING IN
*      THE DRUM
*
MCCND=560.93*(P4M/(TM+460.0))**0.5-PSAT/(TSAT+460.0)**0.5)...
+.02568
*
*      COMPUTE THE RATE EQUATION FOR DRUM LIQUID MASS
*
COMASL=MLL*(1.0-ALL)*MFF*(1.0-XFF)+MCOND+MBBO-MCC-MGG
*
*      COMPUTE THE DRUM LIQUID MASS

```

FILE: CSMP

FORTRAN PL

NAVAL POSTGRADUATE SCHOOL

```

*
* MASL=INTGR(L,DMA SL,DDMASL)
*
*      COMPUTE THE RATE EQUATION FOR ENERGY IN THE DRUM LIQUID
* DMHSL=MLL*(1.0-ALL)*HF+MFF*(1.0-XFF)*HF+MCOND*HFG+MBB*HBB...
*      -MCC*MCC-MGG*MGG
*
*      COMPUTE THE ENERGY IN THE DRUM LIQUID
* DMCHL=INTGR(L,DMHSL,DDMDHL)
*
*      COMPUTE THE ENTHALPY OF THE DRUM LIQUID
* DH=DMCHL/DMASL
*
*      COMPUTE THE DRUM SPECIFIC VOLUME
*
* CRYUND=PCU*(MLL+MFF)
* PROCEDURE RISE2=FILTR4(CRYUND)
* RISE1=DELAY(250,RIST14,CRYUND)
* RISE2=CRYUND
* IF (VALVE.GT..51) GO TO 55
* RISE=RISE2
* GO TO 57
* 55 RISE=RISE1
* 57 CONTINUE
* ENDPROCEDURE
* DMCDV=((MFF+MLL-MBB)*VF+PCU*(MFF+MLL)*VV+MBB*VBB-(MCC+MGG)*VF+MCOND...
*      *VFG-RISE*VV)
* DMCDV=INTGR(L,DMCDV,DDMDCV)
*
*      COMPUTE THE DRUM LEVEL
* LEVEL=(DMCDV-VCLLR/2.0)/(LSTMDM*ESTMDM)
*
*      COMPUTE THE DOWNCOMER ENTHALPY
* HCD=((MFF+MLL-MBB)*HF+MBB*HBB)/(MFF+MLL)
* HGH=HCD
* HCC=HCD
* HCG=HGH
*
*      COMPUTE THE DOWNCOMER SPECIFIC VOLUME AND DENSITY
*
* VCD=((MFF+MLL-MBB)*VF+MBB*VBB)/(MFF+MLL)
* RHCD=1.0/VCD
* RHCGH=RHCCD
*
*      COMPUTE THE SATURATION PRESSURE AND TEMPERATURE
*      CORRESPONDING TO THE DOWNCOMER ENTHALPY
*
* PSAT=EXP((ALOG(HSAT)-4.47(3))/26452)
* TSAT=EXP((.22151*ALOG(PSAT)+4.77123))
*
*      COMPUTE THE ENTHALPY OF THE LIQUID ENTERING THE
*      MAIN BANK RISER
*
* HJJ=HGH+C9/MMH
*
*      COMPUTE THE RATE EQUATION FOR THE MAIN BANK AND
*      SCREEN RISER TUBE METAL TEMPERATURES
*
* DTVV=(C1-C2)/(MASSV*CPV)
* DTTY=(C3-C4)/(MASSY*CPY)
*
*      COMPUTE THE SCREEN AND MAIN BANK RISER TUBE
*      METAL TEMPERATURES

```

```

CSMC2810
CSMC2820
CSMC2830
CSMC2840
CSMC2850
CSMC2860
CSMC2870
CSMC2880
CSMC2890
CSMC2900
CSMC2910
CSMC2920
CSMC2930
CSMC2940
CSMC2950
CSMC2960
CSMC2970
CSMC2980
CSMC2990
CSMC3000
CSMC3010
CSMC3020
CSMC3030
CSMC3040
CSMC3050
CSMC3060
CSMC3070
CSMC3080
CSMC3090
CSMC3100
CSMC3110
CSMC3120
CSMC3130
CSMC3140
CSMC3150
CSMC3160
CSMC3170
CSMC3180
CSMC3190
CSMC3200
CSMC3210
CSMC3220
CSMC3230
CSMC3240
CSMC3250
CSMC3260
CSMC3270
CSMC3280
CSMC3290
CSMC3300
CSMC3310
CSMC3320
CSMC3330
CSMC3340
CSMC3350
CSMC3360
CSMC3370
CSMC3380
CSMC3390
CSMC3400
CSMC3410
CSMC3420
CSMC3430
CSMC3440
CSMC3450
CSMC3460
CSMC3470
CSMC3480
CSMC3490
CSMC3500

```

```

TVV=INTGRL(TVVC,DTVV)
*YY=INTGRL(TYYO,CTYY)
*
*      COMPUTE THE HEAT TRANSFER FOR THE DESUPERHEATER
*      -STEAM TO TUBE METAL
*
Q9=CNP*MNN*(TNN-TPP)
*
*      COMPUTE THE TEMPERATURE OF THE STEAM LEAVING THE
*      DESUPERHEATER
*
TPP=(TNN-TZZ)/(EXP(KNP/(CNP*MNN**0.2)))+TZZ
*
*      SET THE DOWNCOMER ENTRANCE AND EXIT TEMPERATURES
*      EQUAL TO THE SATURATION TEMPERATURE CORRESPONDING
*      TO DRUM ENTRALPY
*
TGG=TSAT
THH=TSAT
TCC=TSAT
TDC=TSAT
*
*      COMPUTE THE ENERGY TRANSFER FOR THE DESUPERHEATER
*      TUBE METAL TO DRUM LIQUID
*
Q99=KZ*(TZZ-THH)
*
*      COMPUTE THE RATE EQUATION FOR DESUPERHEATER TUBE METAL
*      TEMPERATURE
*
DTZZ=(Q9-Q99)/(MASSZ*CPZ)
*
*      COMPUTE THE DESUPERHEATER TUBE METAL TEMPERATURE
*
TZZ=INTGRL(TZZO,DTZZ)
*
*      COMPUTE THE ECONOMIZER ENERGY TRANSFER-TUBE METAL
*      TO FEED WATER
*
Q8=MAA*CAE*(TEB-TAA)
*
*      COMPUTE THE FEED TEMPERATURE AT OUTLET
*      OF ECONOMIZER
*
TBB=(TAA-TXX)/(EXP(KX/(CAP*MAA**0.2)))+TXX
*
*      COMPUTE THE RATE EQUATION FOR THE ECONOMIZER TUBE
*      METAL TEMPERATURE
*
DTXX=(Q8-Q7)/(MASSX*CPX)
*
*      COMPUTE THE ECONOMIZER TUBE METAL TEMPERATURE
*
TXX=INTGRL(TXXO,DTXX)
*
*      COMPUTE THE SUPERHEATED STEAM OUTLET TEMPERATURE
*
TNN=(TMM-TWW)/(EXP(KW/(CMN*MNN**0.2)))+TWW
*
*      COMPUTE THE SUPERHEATER ENERGY TRANSFER-TUBE METAL
*      TO STEAM
*
Q4=CMN*MNN*(TNN-TMM)
*
*      COMPUTE THE RATE EQUATION FOR SUPERHEATER TUBE METAL
*      TEMPERATURE
*
DTWW=(Q3-Q4)/(MASSW*CPW)
*
*      COMPUTE THE SUPERHEATER TUBE METAL TEMPERATURE

```

CSM03510
 CSM03520
 CSM03530
 CSM03540
 CSM03550
 CSM03560
 CSM03570
 CSM03580
 CSM03590
 CSM03600
 CSM03610
 CSM03620
 CSM03630
 CSM03640
 CSM03650
 CSM03660
 CSM03670
 CSM03680
 CSM03690
 CSM03700
 CSM03710
 CSM03720
 CSM03730
 CSM03740
 CSM03750
 CSM03760
 CSM03770
 CSM03780
 CSM03790
 CSM03800
 CSM03810
 CSM03820
 CSM03830
 CSM03840
 CSM03850
 CSM03860
 CSM03870
 CSM03880
 CSM03890
 CSM03900
 CSM03910
 CSM03920
 CSM03930
 CSM03940
 CSM03950
 CSM03960
 CSM03970
 CSM03980
 CSM03990
 CSM04000
 CSM04010
 CSM04020
 CSM04030
 CSM04040
 CSM04050
 CSM04060
 CSM04070
 CSM04080
 CSM04090
 CSM04100
 CSM04110
 CSM04120
 CSM04130
 CSM04140
 CSM04150
 CSM04160
 CSM04170
 CSM04180
 CSM04190
 CSM04200

FILE: CSMP FORTRAN P1

NAVAL POSTGRADUATE SCHOOL

```

TMM=INTGR1(TMM0,DTMM)
*
*      COMPUTE THE IMPLICIT EQUATION FOR TOTAL STEAM
*      FLOW RATE FROM BOILER
*
*MM=INFL(MMM0,MMPE,MMINP)
*
*      COMPUTE THE SUPERHEATER OUTLET PRESSURE
*
PMM=SQRT(PSAT**2.0-2.0*KONE*KONI*MM**2.0)
MMIII=PMM*KCN4*VALVE
MMII=MMNO
MMIIP=MMIII+MMIII
*
*      EQUATE THE FLUE GAS MASS FLOW RATES
*
MRR=MQQ
MSS=MRR
MTT=MSS
MLL=MTT
*
*      SET RISER INLET DENSITY EQUAL TO
*      SATURATED LIQUID DENSITY
*
RHCEE=RHCF
RHOUJ=RHCF
RHOC=RHCEE
RHCKA=RHCJJ
*
*      EQUATE DOWNCOMER FLOW RATES TO RISER ENTRANCE FLOW
*      RATES AND SET RISER ENTRANCE FLOW RATES TO THE
*      FLOW RATES AT THE INITIAL TIME
*
MHH=MGG
MCC=MDD
MGG=MJJ
MDD=MFFC
MJJ=MLLO
*
*      COMPUTE THE DERIVATIVE OF AVERAGE RISER DENSITY
*
*
*      COMPUTE THE STEAM MASS RATE EQUATION FOR THE STEAM
*      DRUM
DDSTM=XFF*MFF+XLL*MLL-MCND-MMM
*
*      COMPUTE THE DRUM STEAM MASS
*
CSTM=INTGR1(CSTM0,DDSTM)
*
*      COMPUTE THE VOLUME OF STEAM IN THE STEAM DRUM
*
VOLSTM=VOLCRM-DMASL/RHOF
*
*      COMPUTE THE DENSITY OF STEAM IN THE STEAM DRUM
*
RHCSM=CSTM/VOLSTM
RHOMM=RHCSM
VVM=1.0/RHOMM
VFGMM=VVM-VF
*
*      COMPUTE THE STEAM DRUM STEAM OUTLET PRESSURE
*
PRESSM=524.0/(VFGMM+.1)
PROCEDURE FMM=FILTER5(PRESSM)
IF(PRESSM.LT.0.0)CALL DEBUG(3,0.0)
FMM=PRESSM
ENDPROCEDURE
*
*      COMPUTE THE STEAM DRUM STEAM OUTLET TEMPERATURE

```

CSMC4210
 CSMC4220
 CSMC4230
 CSMC4240
 CSMC4250
 CSMC4260
 CSMC4270
 CSMC4280
 CSMC4290
 CSMC4300
 CSMC4310
 CSMC4320
 CSMC4330
 CSMC4340
 CSMC4350
 CSMC4360
 CSMC4370
 CSMC4380
 CSMC4390
 CSMC4400
 CSMC4410
 CSMC4420
 CSMC4430
 CSMC4440
 CSMC4450
 CSMC4460
 CSMC4470
 CSMC4480
 CSMC4490
 CSMC4500
 CSMC4510
 CSMC4520
 CSMC4530
 CSMC4540
 CSMC4550
 CSMC4560
 CSMC4570
 CSMC4580
 CSMC4590
 CSMC4600
 CSMC4610
 CSMC4620
 CSMC4630
 CSMC4640
 CSMC4650
 CSMC4660
 CSMC4670
 CSMC4680
 CSMC4690
 CSMC4700
 CSMC4710
 CSMC4720
 CSMC4730
 CSMC4740
 CSMC4750
 CSMC4760
 CSMC4770
 CSMC4780
 CSMC4790
 CSMC4800
 CSMC4810
 CSMC4820
 CSMC4830
 CSMC4840
 CSMC4850
 CSMC4860
 CSMC4870
 CSMC4880
 CSMC4890
 CSMC4900

FILE: CSMP FORTRAN P1

NAVAL POSTGRADUATE SCHOOL

```

*
TM=EXP(.22151*ALOG(P4M)+4.77123)
*
*           SOLVE FOR THE ECONOMIZER FEED OUTLET ENTHALPY
HBE=(MBB*HAAO+C8)/MBB
*
*           FEEDRATE EQUATION
*
*MBB=MB80
*
*           TWO PHASE FLOW MULTIPLIER EQUATIONS
*
RGRAVE=24.794*XFF**2.0-6.5066*XFF+.9776
RGRAVK=24.794*XLL**2.0-6.5066*XLL+.9776
RACLE=15.456*XFF**2.0+15.4944*XFF-.00007
RACLJ=15.456*XLL**2.0+15.4944*XLL-.00007
RFRICE=-34.0822*XFF**2.0+23.7164*XFF+.8734
RFRICK=-34.0822*XLL**2.0+23.7164*XLL+.8734
*
*           STATE POINT EQUATIONS
*
HSAT=DH
HF=HSAT
HFG=922.15-0.40516*PSAT+1.717E-04*PSAT**2.0-4.219E-06...
*PSAT**3.0
HV=HSAT+HFG
HCHF=63.8-0.01781*TSAT+1.132E-05*TSAT**2.0-6.786E-08...

```

```

CSMC4910
CSMC4920
CSMC4930
CSMC4940
CSMC4950
CSMC4960
CSMC4970
CSMC4980
CSMC4990
CSMC5000
CSMC5010
CSMC5020
CSMC5030
CSMC5040
CSMC5050
CSMC5060
CSMC5070
CSMC5080
CSMC5090
CSMC5100
CSMC5110
CSMC5120
CSMC5130
CSMC5140
CSMC5150
CSMC5160
CSMC5170
CSMC5180

```

APPENDIX C

G. Anticipated Performance

	Endurance 2 Boilers	Design Rated Full Power	Maximum Intermittent Power	Endurance 1 Boiler	Boiler Overload
Rate of Operation - Per Cent	56	83	97	114	120
Total Steam Generated lb/hr	195,000	290,000	340,000	400,000	420,000
Superheated Steam lbs/hr.	155,000	235,000	265,000	300,000	320,000
Desuperheated Steam lbs/hr.	40,000	55,000	75,000	100,000	100,000
Boiler Drum Pressure psig	690	690	690	690	690
Superheater Outlet Pressure psig	665	630	610	580	570
Superheater Outlet Temperature °F	912	914	980	898	895
Desuperheated Steam Outlet Pressure psig	651	606	558	480	470
Desuperheated Steam Outlet Temperature °F	635	659	680	690	690
Economizer Inlet Pressure psig	715	726	733	749	754
Economizer Inlet Temperature °F	250	250	250	250	250
Economizer Outlet Pressure psig	703	705	703	708	710
Economizer Outlet Temperature °F	355	372	372	377	380
Casing Air Inlet Temperature °F	100	100	100	100	100
Total Air Flow lb/hr	242,229	368,092	433,589	513,154	540,952
Total Oil Flow lb/hr	14,333	21,781	25,656	30,364	32,009
Anticipated Efficiency %	85.7	84.4	83.8	83.0	82.7
Guaranteed Efficiency %	85.7	84.4	83.8	83.0	82.7
Radiation and Unaccounted for Losses %	.99	.99	.95	1.01	.98
Excess Air %	15.0	15.0	15.0	15.0	15.0
Carbon Dioxide %	13.0	13.0	13.0	13.0	13.0
Number of Burners in Operation	6	6	6	6	6
Throttle or Non-Throttle of Air Doors	N.T.	N.T.	N.T.	N.T.	N.T.
Draft Loss - Total Inches Water	13.74	33.98*	47.96	69.51	76.22** 93.48***
Through Double Casing	1.33	3.09	4.28	6.00	6.67 10.22
Through Burner Register	2.60	6.00	8.50	11.50	13.00 15.88
Through Boiler & Superheater	4.83	12.29	18.14	25.61	28.15 38.32
Through Economizer	4.98	12.60	17.04	26.40	28.40 29.06
Gas Temperature Leaving Superheater Screen °F	2471	2594	2642	2686	2699
Gas Temperature Leaving Superheater °F	1826	1961	2021	2085	2103
Gas Temperature Leaving Main Bank °F	694	774	812	856	872
Gas Temperature Leaving Economizer °F	373	427	453	484	498
Heat Release KB/Hr./Sq. Ft. Radiant Heat Absorbing Surface	447	680	800.6	948	999
Heat Release KB/Hr./Sq. Ft. Total Heating Surface	15.5	23.6	28.0	32.9	34.7
Heat Release KB/Hr./Cu. Ft. Furnace Volume	183.9	279.5	329.2	389.6	410.8
Furnace Heat Absorption KB/Hr./Sq. Ft	128.4	171.0	191.1	213.19	221.5
Heat Absorption First Water Screen Row KB/Hr./Sq. Ft. (Max.)	210	231	255.3	288	256
Heat Absorption Maximum KB/Hr./Sq. Ft (Furnace Screen)	210	231	255.3	288	256

*Draft Losses (Full Power) Based On 241 Cu. Ft. of 100°F Air/Lb. of Fuel Oil

**Draft Losses (Overload) Based On 241 Cu. Ft. of 100°F Air/Lb. of Fuel Oil

***Draft Losses (Overload) Based on 260 Cu. Ft. of 68°F Air/Lb. of Fuel Oil

II. Anticipated Metal Temperature Degree F.

	Endurance 2 Boilers	Design Rated Full Power	Maximum Intermittent Power	Endurance 1 Boiler	Boiler Overload
Water Screen Tubes Outside	644	656	661	667	680
Water Screen Tubes Inside	554	554	554	554	555
Superheater Tubes Outside - Maximum	1022	1046	1049	1048	1048
Superheater Tubes Inside - Maximum	1044	1020	1019	1014	1012
Maximum Inner Casing Temperature	800	825	835	850	870
Maximum Outer Casing Temperature at way of Structural ties	350	350	350	350	350
Maximum Outer Casing Temperature	145	145	145	145	145

I. Tube Data

	O.D.	M.W.T.	No.	Material
Side Wall and Roof	2"	.134"	71	MIL-T-16286 CL. A*
Rear Wall	2"	.134"	54	MIL-T-16286 CL. A*
Front Wall	2"	.134"	22	MIL-T-16286 CL. A*
Screen Bank	2"	.134"	102	MIL-T-16286 CL. A*
Superheater	1.5"	.120	22	MIL-T-16286 CL. E
Main Bank	2"	.134"	34	MIL-T-16286 CL. A*
Main Bank	1"	.085"	2808	MIL-T-16286 CL. A*
Economizer	2"	.180"	182	MIL-T-16286 CL. A
Desuperheater (in Water Drum)	2"	.220"	6	SA-268 TP-430
Downcomers	8 5/8"	.483"	1	Schedule 80 Pipe ASME SA-106-B
Downcomers	10 3/4"	.519"	5	Schedule 80 Pipe ASME SA-106-B
Downcomers	12 3/4"	.601	2	Schedule 80 Pipe ASME SA-106-B
Risers	6"	.500"	7	ASME SA-106-B

*These tubes may be MIL-T-16286, Class A (Seamless) or MIL-T-17188 (Seamed) electric resistance welded.

LIST OF REFERENCES

1. Fini, W. P., A Computer Simulation of a Naval Boiler, Masters Thesis, Naval Postgraduate School, Monterey, CA, 1978.
2. Oak Ridge National Laboratory Report ORNL-TM-4248
ORCON 1: A FORTRAN Code for the Calculation of a Steam Condenser of Circular Cross Section, by J. A. Hafford, July 1973.
3. Grimson, E. D., "Correlation and Utilization of New Data on Flow Resistance and Heat Transfer for Cross Flow of Gases over Tube Banks," Trans. ASME, Vol. 59, pp. 583-594, 1937.
4. Weierman, C., and others, Comparison of the Performance of Inline and Staggered Banks of Tubes with Segmented Fins, paper presented at the Fifteenth National Heat Transfer Conference, AIChE-ASME, San Francisco, CA, August 10-13, 1975.
5. Tong, L. S., Boiling Heat Transfer and Two Phase Flow, p. 118, Wiley, 1965.
6. Dittus, F. W., and Boelter, L.M.K., University of California (Berkeley) Pub. Eng., Vol. 2, p. 443, 1936.
7. Signell, W. I., Marine Boiler Design Today, paper presented at Annual Meeting of The Society of Naval Architects and Marine Engineers, New York, NY, November 13-16, 1968.
8. Weitzel, P., Telecon, Subject: Dynamic Modeling of Boiler Shrink and Swell Phenomena, 13 June, 6 July, 9 July, 17 July, 20 August 1979.
9. Leondes, C. T., and others, Control and Dynamic Systems, Vol. 14, p. 175, Academic Press, 1978.
10. Thom, J.R.S., Prediction of Pressure Drop During Forced Circulation Boiling of Water, International Journal of Heat and Mass Transfer, Vol. 7, p. 709-724, Pergamon Press, 1964.
11. Schlichting, H., Boundary Layer Theory, 6th ed., McGraw Hill, 1968.

12. Rohsenow, W. M., and P. Griffith, "Correlation of Maximum Heat Flux Data for Boiling of Saturated Liquids,"
AIChE-ASME Heat Transfer Symp., Louisville, Ky., 1955.

INITIAL DISTRIBUTION LIST

	No. Copies
1. Defense Documentation Center Cameron Station Alexandria, Virginia 22314	2
2. Library, Code 0142 Naval Postgraduate School Monterey, California 93940	2
3. Department Chairman, Code 69 Department of Mechanical Engineering Naval Postgraduate School Monterey, California 93940	2
4. Dr. Thomas M. Houlihan, Code 69Hm Department of Mechanical Engineering Naval Postgraduate School Monterey, California 93940	5
5. Lieutenant Thomas D.L. Walker USN Department of Mechanical Engineering Code 69 Naval Postgraduate School Monterey, California 93940	2
6. Paul Weitzel Babcock and Wilcox 20 South Van Buren Avenue Barberton, Ohio 44203	1
7. Mr. Thomas Graf Code 67230 Naval Ship Engineering Center Philadelphia, PA 19112	1