

AD-A090 448

ARMY NATICK RESEARCH AND DEVELOPMENT COMMAND MA F/G 6/8  
HEAT CONDUCTION IN FINITE CYLINDERS AND THE COMPUTER-AIDED CALC--ETC(U)  
JUN 80 C P WANG, A BRYNJOLFSSON


UNCLASSIFIED

NL

11 80  
AC  
201118



END  
DATE  
FILMED  
11 80  
DTIC

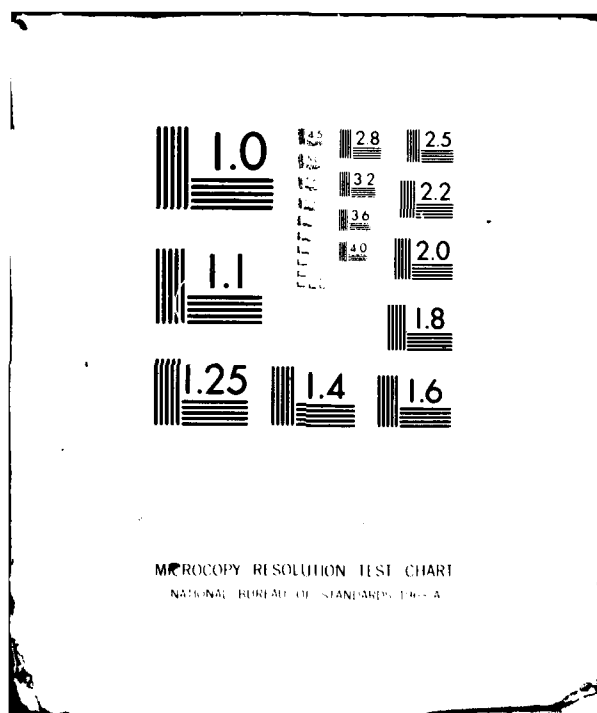

MICROCOPY RESOLUTION TEST CHART  
NATIONAL BUREAU OF STANDARDS-1963-A

\*WANG and BRYNJOLFSSON

AD A090448

6 HEAT CONDUCTION IN FINITE CYLINDERS AND THE COMPUTER-AIDED CALCULATION OF BACTERIA SURVIVAL IN HEAT STERILIZATION

10 CHIA PING WANG DR. ARI BRYNJOLFSSON DR.

US ARMY NATICK RESEARCH AND DEVELOPMENT COMMAND NATICK, MASSACHUSETTS 01760

12 13

11 11 80 1. INTRODUCTION

The temperature distribution T(x,y,z,t) in a specimen during heating and cooling of its outer surface is determined by solving the heat diffusion equation for given boundary conditions. Solutions are often obtained for special forms, such as infinite cylinders or infinite slabs, of the specimen, and for some simplified boundary conditions, such as abrupt initial temperature change at the surface of the sample. In practical problems, the solutions are often approximated by simple forms of the time temperature relations. For instance, in the case of retorting of food, the center temperature in the can is usually approximated by a zero order Bessel function valid for very large values of time. Such approximations, while valuable, are inadequate for exact studies. Using modern computers, we were able to calculate T(x,y,z,t) very accurately for any practical size cylinder and for different boundary conditions corresponding to Nusselt numbers between 0 and 5000. The high accuracy and the rapid calculations make the method very useful in many fields of thermal engineering. In the present paper, we apply this method to exact integral calculations of the survival fraction of bacteria during heat sterilization process. This is used in

2. HEAT DIFFUSION EQUATION FOR A FINITE CYLINDER

The conduction of heat in a cylinder is given by a second order differential equation. In cylindrical coordinates it is:

∂T(r, θ, z, t) / ∂t = κ ∇²T(r, θ, z, t) (1)

DDC FILE COPY

385

This document is prepared for public release unless otherwise indicated.

357

DTIC ELECTRONIC S OCT 20 1980

80 10 17 026

\*WANG and BRYNJOLFSSON

where  $T(r, \theta, z, t)$  is the temperature at point  $P(r, \theta, z)$  and at time  $t$ , and  $\kappa$  is the thermal diffusivity of the material of the solid

$$\kappa = \frac{\lambda}{\rho \cdot c} = \frac{\text{thermal conductivity}}{\text{density} \cdot \text{specific heat}} \quad (2)$$

We will consider heating a cylindrical specimen from an initial temperature  $T_i$  with a constant temperature  $T_h$  on the outside of the surface. Then the temperature  $T(r, \theta, z, t)$  at any point in the specimen at any time  $t$  will be given by Eq. (1), together with the boundary conditions. To simplify the equations, we introduce a new temperature variable:

$$T = T - T_h \quad (3)$$

Eq. (1) becomes

$$\frac{\partial T}{\partial t} = \kappa \nabla^2 T \text{ for } r \leq a, |z| \leq l \quad (4)$$

where  $a$  is the radius, and  $l$  the half-length of the cylinder. The initial value of  $T$  at any point of the specimen is:

$$T_i = T_i - T_h, \text{ for } t \leq 0 \quad (5)$$

We will consider here the case of convective heating outside the cylinder. At the boundary there will be an interface or transition layer in which the temperature is changing from  $T_h$  to the actual temperature of the specimen at the surface. We then obtain the following boundary conditions by equating the heat flowing through the transition layer and the heat flowing through the outermost layer of the specimen.

$$\frac{\partial T}{\partial r} + \frac{h}{\lambda} T = 0 \text{ at } r = a \quad (6)$$

$$\frac{\partial T}{\partial z} + \frac{h}{\lambda} T = 0 \text{ at } z = l \quad (7)$$

$$-\frac{\partial T}{\partial z} + \frac{h}{\lambda} T = 0 \text{ at } z = -l \quad (8)$$

where  $\lambda$  is conductivity of the specimen, and  $h = \lambda_{\text{gas}}/\delta_{\text{gas}}$ , the conductivity of the gas (air) divided by the thickness of the gas (air) film, is the coefficient of heat transfer due to the gas film only.

Due to radiation at the surface,  $h$  actually would be equal to  $\lambda_{\text{gas}}/\delta_{\text{gas}}$  plus some constant. Also, in the case of a meat sample with casing, we have two transition layers instead of one at the surface, the solid casing material and the gas film adhered onto it. All these three factors can be combined into a single coefficient in front of  $T$  in Eqs. (6), (7) and (8). Henceforth,  $h/\lambda$  in Eqs. (6), (7) and (8) will stand for this effective coefficient.

Eq. (4) with boundary conditions Eqs. (6) - (8), i.e.,  $\partial T/\partial r$  being proportional to  $T$ , can be solved with the usual technique of the separation of variables.<sup>(1,2)</sup> The solution for the temperature distribution in a finite cylinder, in our case, takes the following form:

$$T = \sum_j \sum_n A_{j,n} \cdot \cos(\lambda_j z) \cdot J_0(\alpha_n r) \cdot e^{-\kappa(\lambda_j^2 + \alpha_n^2)t} \quad (9)$$

where  $A_{j,n}$  are the coefficients of expansion and where  $x_n = a \cdot \alpha_n$  are the roots of the following equation ( $J_0$  and  $J_1$  being Bessel functions of order zero and one respectively),

$$x_n \cdot J_1(x_n) = \frac{h}{\lambda} a \cdot J_0(x_n) \quad (10)$$

and  $y_j = \lambda_j l$  are the roots of

$$\frac{hl}{\lambda} \cos y_j - y_j \sin y_j = 0 \quad (11)$$

We have deduced from the boundary conditions the coefficients of expansion  $A_{j,n}$  in Eq. (9). After some lengthy calculation,  $A_{j,n}$  are found to be

$$A_{j,n} = 2T_i \frac{1}{x_n \left[ \left( \frac{x_n}{v} \right)^2 + 1 \right] \cdot J_1(x_n)} \cdot \frac{4 \sin y_j}{\sin(2 y_j) + 2 y_j} \quad (12)$$

The temperature  $T = T(r, \theta, z, t)$  of the specimen is then

$$T - T_h = 2(T_i - T_h) \sum_{j=1}^{\infty} \sum_{n=1}^{\infty} \frac{1}{x_n \left[ \left( \frac{x_n}{v} \right)^2 + 1 \right] \cdot J_1(x_n)} \quad (13)$$

$$J_0(\alpha_n r) \cdot \frac{4 \sin y_j}{\sin(2 y_j) + 2 y_j} \cdot \cos \lambda_j z \cdot e^{-\kappa(\lambda_j^2 + \alpha_n^2)t}$$

\*WANG and BRYNJOLFSSON

where

$$\nu = \frac{h}{\lambda} \cdot a = \text{effective conduction Nusselt Number,} \\ \text{or Biot Number} \quad (3) \quad (14)$$

and  $x_n$  and  $y_i$  are roots of Eqs. (10) and (11).

### 3. CALCULATIONS OF THE TEMPERATURE DISTRIBUTION

The temperature distribution  $T(r, \theta, z, t)$  can be computed for any point  $P(r, \theta, z)$  inside the cylinder and any time  $t$  provided the roots  $x_n$  of Eq. (1) for a given  $\nu$ , and the roots  $y_i$  of Eq. (11) for a given value of  $h\ell/\lambda$  are known.

Our task then is to devise first some means to compute rapidly these roots with any practical values of  $\nu$  and  $h\ell/\lambda$ .

We have written computer programs which enable us to compute the first 36 roots of Eqs. (10) and (11), for  $\nu = 0$  to 5000 and  $h\ell/\lambda = 0$  to 10,000, with rapid convergence.

Likewise, the double summation of Eq. (13) has been carried out with the computer. This double summation in principle could be carried out to as many terms as we wish, so long as the values of the roots  $x_n$  and  $y_i$  are available.

We have also used a temperature variable  $\Psi$ , the "relative excess temperature", which is independent of the actual initial and heating temperature,

$$\Psi = \frac{T - T_h}{T_i - T_h} \quad (15)$$

It is seen from Eq. (13) that  $\Psi$  is equal to twice the double summation of that equation, and is independent of  $T_i$  and  $T_h$ . Thus, the actual temperature distributions  $T(r, \theta, z, t)$ , due to different initial and heating temperatures, can be directly compared or derived from one another.

The temperature distribution  $T(r, \theta, z, t)$  in specimens during heating and cooling has often been obtained by some approximations for the heat diffusion equation or its solution. In the present paper we deduced, on the other hand, the exact analytical solution to the heat diffusion equation for finite cylinders in convective heating. The truncation of the two series in Eq. (13) to 36 terms in each of

|               |         |
|---------------|---------|
| SEARCHED      | INDEXED |
| SERIALIZED    | FILED   |
| APR 1961      |         |
| FBI - MEMPHIS |         |
| A             |         |

\*WANG and BRYNJOLFSSON

the summations results in a very accurate form, allowing  $T(r, \theta, z, t)$  to be calculated for any practical size finite cylinders and for Nusselt (Biot) number extending from 0 to 5000. The method developed should have great applicability in thermal engineering industry. Tables I - II give the relative excess temperature  $\Psi$  on the cross sections at  $z/l = 0$ , and 0.6 respectively, at  $r/a = 0, 0.2, 0.4, \dots, 1.0$  and times  $t = 5, 10, 15, \dots, 240$  minutes, for a specimen of radius  $a = 5$  cm, half-length  $l = 2.5$  cm, with  $\kappa = 1.35 \times 10^{-3} \text{ cm}^2\text{s}^{-1}$  and  $\nu = 6.0$ . Similar tables for  $\Psi$  on the cross sections  $z/l = 0.2, 0.4, 0.8$ , and 1.0, are available from the authors.

The last columns of these tables give the survival fraction calculations of bacteria during sterilization to be discussed in later sections.

Figs. 1a-1f are the computer plots of these tables.

#### 4. CALCULATION OF BACTERIA SURVIVAL IN HEAT STERILIZATION

We now apply the above calculations of heat diffusion to thermal killing of bacteria in finite cylindrical specimens. The microbial kill is described quantitatively by the survival fraction  $N/N_0$  where  $N$  is the number of bacteria survived at time  $t$  and  $N_0$  is the initial value of  $N$ . For a large class of microorganisms,  $N/N_0$  during thermal sterilization at a given constant temperature  $T$  follows closely the following equation (1,5,6):

$$\ln \frac{N}{N_0} = -C \cdot [\exp(-E_a/RT)] \cdot t \quad (16)$$

where

$E_a$  = the Arrhenius activation energy in  $\text{kcal}\cdot\text{mol}^{-1}$  for inactivating a unit or a molecule that is essential for the survival of a bacterium

$R$  = the universal gas constant in  $\text{J}\cdot\text{mol}^{-1}$

$T$  = sterilization temperature in Kelvin

$t$  = sterilization time in s

$C$  = a constant

389

TABLE I & II - RELATIVE TEMPERATURE DIFFERENCES,  $\psi = (T - T_0) / (T_1 - T_0)$  IN TWO CROSS SECTIONS AT  $Z/L = 0$  AND  $0.6$ . THE FIRST COLUMN GIVES THE TIME, THE COLUMNS 2-7 GIVE  $\psi$  FOR DIFFERENT DISTANCES  $r/a$  0, 0.2, 0.4, 0.6, 0.8, 1.0 AND COLUMN 8 GIVES THE SURVIVAL FRACTION FOR C1. BOTULIUM SPORES AT  $r/a = 0$ .

| TIME<br>MIN | A Z    |        | L = 2.5 CM |        | Z/L = 0 |        | S F    |          |
|-------------|--------|--------|------------|--------|---------|--------|--------|----------|
|             | 0.0    | 0.6    | 0.2        | 0.4    | 0.6     | 0.8    | 1.0    | AT AXIS  |
| 5           | 0.9773 | 0.9773 | 0.9770     | 0.9766 | 0.9753  | 0.9749 | 0.9745 | 1.000000 |
| 10          | 0.9827 | 0.9818 | 0.9820     | 0.9815 | 0.9802  | 0.9798 | 0.9794 | 1.000000 |
| 15          | 0.9872 | 0.9861 | 0.9866     | 0.9861 | 0.9848  | 0.9844 | 0.9840 | 1.000000 |
| 20          | 0.9910 | 0.9897 | 0.9904     | 0.9899 | 0.9886  | 0.9882 | 0.9878 | 1.000000 |
| 25          | 0.9942 | 0.9928 | 0.9932     | 0.9927 | 0.9914  | 0.9910 | 0.9906 | 1.000000 |
| 30          | 0.9968 | 0.9953 | 0.9958     | 0.9953 | 0.9940  | 0.9936 | 0.9932 | 1.000000 |
| 35          | 0.9988 | 0.9972 | 0.9978     | 0.9973 | 0.9960  | 0.9956 | 0.9952 | 1.000000 |
| 40          | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 45          | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 50          | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 55          | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 60          | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 65          | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 70          | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 75          | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 80          | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 85          | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 90          | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 95          | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 100         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 105         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 110         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 115         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 120         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 125         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 130         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 135         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 140         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 145         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 150         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 155         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 160         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 165         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 170         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 175         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 180         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 185         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 190         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 195         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 200         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 205         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 210         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 215         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 220         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 225         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 230         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 235         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |
| 240         | 0.9999 | 0.9982 | 0.9988     | 0.9983 | 0.9970  | 0.9966 | 0.9962 | 1.000000 |

TABLE II

| TIME<br>MIN | A Z    |        | L = 2.5 CM |        | Z/L = 0.6 |        | S F    |          |
|-------------|--------|--------|------------|--------|-----------|--------|--------|----------|
|             | 0.0    | 0.6    | 0.2        | 0.4    | 0.6       | 0.8    | 1.0    | AT AXIS  |
| 5           | 0.9277 | 0.9277 | 0.9277     | 0.9277 | 0.9277    | 0.9277 | 0.9277 | 1.000000 |
| 10          | 0.7601 | 0.7601 | 0.7601     | 0.7601 | 0.7601    | 0.7601 | 0.7601 | 1.000000 |
| 15          | 0.7023 | 0.7023 | 0.7023     | 0.7023 | 0.7023    | 0.7023 | 0.7023 | 1.000000 |
| 20          | 0.6456 | 0.6456 | 0.6456     | 0.6456 | 0.6456    | 0.6456 | 0.6456 | 1.000000 |
| 25          | 0.5893 | 0.5893 | 0.5893     | 0.5893 | 0.5893    | 0.5893 | 0.5893 | 1.000000 |
| 30          | 0.5336 | 0.5336 | 0.5336     | 0.5336 | 0.5336    | 0.5336 | 0.5336 | 1.000000 |
| 35          | 0.4784 | 0.4784 | 0.4784     | 0.4784 | 0.4784    | 0.4784 | 0.4784 | 1.000000 |
| 40          | 0.4237 | 0.4237 | 0.4237     | 0.4237 | 0.4237    | 0.4237 | 0.4237 | 1.000000 |
| 45          | 0.3695 | 0.3695 | 0.3695     | 0.3695 | 0.3695    | 0.3695 | 0.3695 | 1.000000 |
| 50          | 0.3158 | 0.3158 | 0.3158     | 0.3158 | 0.3158    | 0.3158 | 0.3158 | 1.000000 |
| 55          | 0.2626 | 0.2626 | 0.2626     | 0.2626 | 0.2626    | 0.2626 | 0.2626 | 1.000000 |
| 60          | 0.2099 | 0.2099 | 0.2099     | 0.2099 | 0.2099    | 0.2099 | 0.2099 | 1.000000 |
| 65          | 0.1577 | 0.1577 | 0.1577     | 0.1577 | 0.1577    | 0.1577 | 0.1577 | 1.000000 |
| 70          | 0.1060 | 0.1060 | 0.1060     | 0.1060 | 0.1060    | 0.1060 | 0.1060 | 1.000000 |
| 75          | 0.0548 | 0.0548 | 0.0548     | 0.0548 | 0.0548    | 0.0548 | 0.0548 | 1.000000 |
| 80          | 0.0041 | 0.0041 | 0.0041     | 0.0041 | 0.0041    | 0.0041 | 0.0041 | 1.000000 |
| 85          | 0.0033 | 0.0033 | 0.0033     | 0.0033 | 0.0033    | 0.0033 | 0.0033 | 1.000000 |
| 90          | 0.0025 | 0.0025 | 0.0025     | 0.0025 | 0.0025    | 0.0025 | 0.0025 | 1.000000 |
| 95          | 0.0017 | 0.0017 | 0.0017     | 0.0017 | 0.0017    | 0.0017 | 0.0017 | 1.000000 |
| 100         | 0.0009 | 0.0009 | 0.0009     | 0.0009 | 0.0009    | 0.0009 | 0.0009 | 1.000000 |
| 105         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 110         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 115         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 120         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 125         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 130         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 135         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 140         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 145         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 150         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 155         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 160         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 165         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 170         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 175         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 180         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 185         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 190         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 195         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 200         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 205         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 210         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 215         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 220         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 225         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 230         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 235         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |
| 240         | 0.0001 | 0.0001 | 0.0001     | 0.0001 | 0.0001    | 0.0001 | 0.0001 | 1.000000 |

390

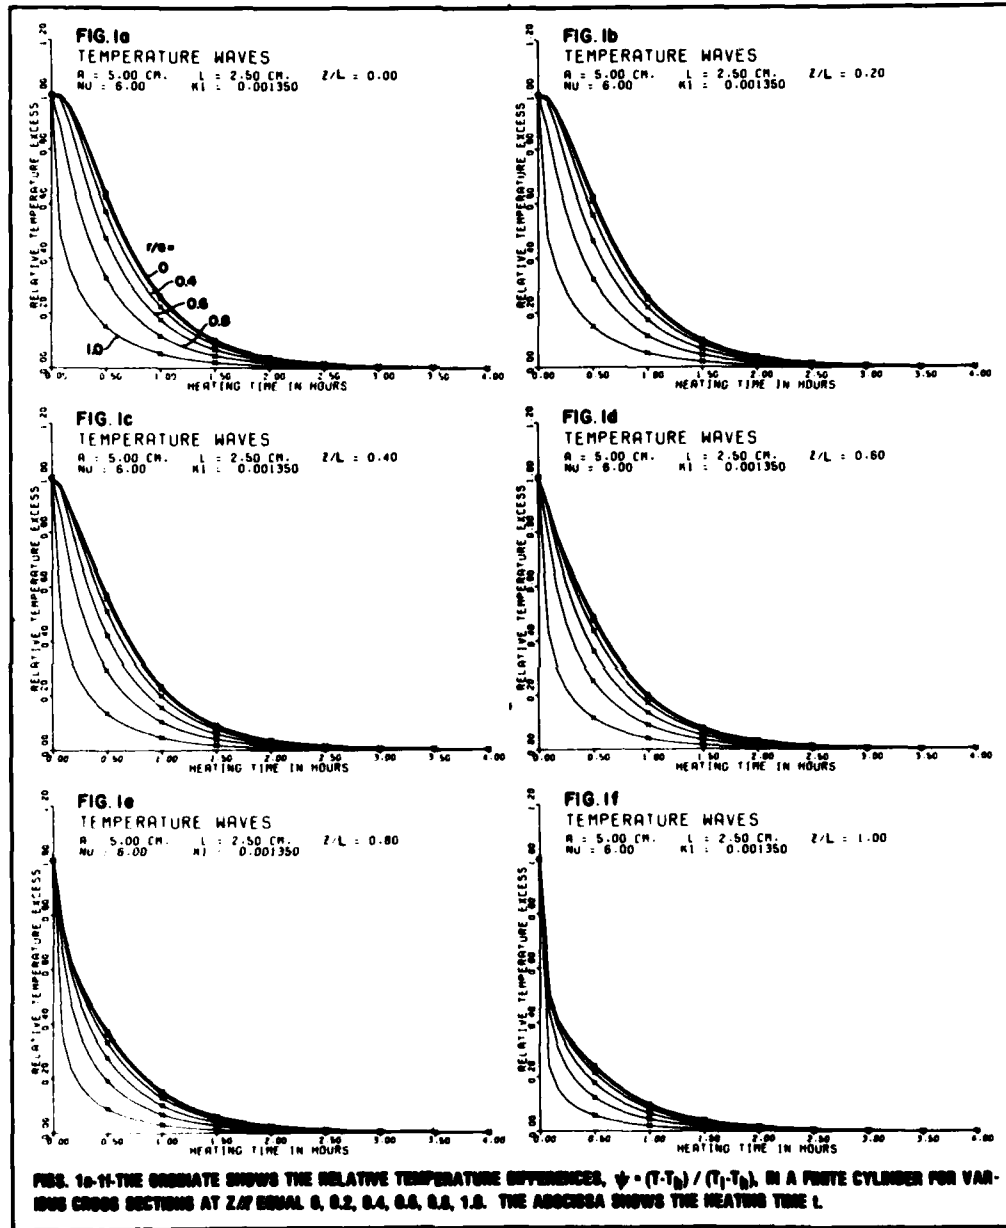


FIG. 1a-1f-THE ORDINATE SHOWS THE RELATIVE TEMPERATURE DIFFERENCES,  $\psi = (T-T_0) / (T_1-T_0)$ , IN A FINITE CYLINDER FOR VARIOUS CROSS SECTIONS AT Z/L EQUAL 0, 0.2, 0.4, 0.6, 0.8, 1.0. THE ABSCISSA SHOWS THE HEATING TIME t.

391

\*WANG and BRYNJOLFSSON

In this case where  $T$  is constant, we obtain by differentiation of Eq. (16), that the kill rate function  $(dN/dt)/N$  is the exponential  $\exp(-E_a/RT)$ , that is:

$$\frac{dN}{dt} \cdot \frac{1}{N} = -C \cdot [\exp(-E_a/RT)] = -C \cdot F(T(t), t) \quad (17)$$

In some experiments it is found that the semi-logarithmic plot of the survival fraction has a "shoulder". This may be represented by the function

$$F(T(t), t) = 1 - [1 - \exp(-E_a/RT(t))]^n \quad (18)$$

which for  $n = 1$  reduces to the form in Eq. (17), the frequently used Arrhenius function:

$$F(T(t), t) = \exp[-E_a/RT(t)] \quad (19)$$

We now show that for the general case where the kill rate function assumes a general form  $F(T(t), t)$ , with the temperature  $T(t)$  varying with time  $t$ , the survival fraction is given by the following time integral:

$$\ln \frac{N}{N_0} = -C \int_0^t F(T(t), t) dt \quad (20)$$

From the empirical law Eq. (16) for constant  $T$ ,

$$\ln \frac{N}{N_0} = -C \cdot [\exp(-E_a/RT)] \cdot T \quad (16)$$

we obtain the following differential form in terms of the kill rate

$$\frac{dN}{dt} = -C \cdot [\exp(-E_a/RT)] \cdot N \quad (21)$$

Now we generalize Eq. (21) to include the case where  $T$  varies with  $t$ . By integrating Eq. (21) for this temperature varying case, we have the following time integral for the logarithmic survival fraction

$$\ln \frac{N}{N_0} = -C \int_0^t \exp(-E_a/RT) dt \quad (22)$$

\*WANG and BRYNJOLFSSON

Next, we generalize Eqs. (21) for the general kill rate function  $F(T(t), t)$ ,

$$\frac{dN}{dt} = -C \cdot F(T(t), t) \cdot N \quad (21a)$$

the logarithmic survival fraction is then

$$\log \frac{N}{N_0} = -C \int_0^t F(T(t), t) dt \quad (22a)$$

which is Eq. (20).

#### 5. CALCULATIONS OF BACTERIAL SURVIVAL EQUATION

We now put our function  $T(t)$  of Eq. (13) into the "bacterial survival integral" of Eqs. (22) or (22a) to calculate the survival fraction  $N/N_0$  of the bacterium. In this paper, we carried out the calculations for Cl. botulinum spores for which we assume the kill rate function to be given by the exponential function  $\exp(-E_a/RT)$  rather than the general function  $F(T(t), t)$  which may represent any empirical function or other theoretical function such as Eyring's.

The calculations for other microorganisms will be exactly the same.

The integrand of Eq. (22) after substituting  $T$  from Eq. (13) looks quite complicated. We have written computer programs to carry out the computation. But, before we carry out the computation, the two constants, which characterize the bacterium being considered,  $C$  and  $E_a$  in Eqs. (16) and (22), have to be determined.

#### 6. DETERMINATION OF $E_a$

We show in some details below the relationship between the so-called  $z$ -value in the terminology used by the microbiologist, the temperature  $T$ , and the Arrhenius activation energy  $E_a$ .

The reaction rate equation, Eq. (21a),

$$\frac{dN}{dt} = -kN = -C \cdot [\exp(-E_a/RT)] \cdot N \quad (21)$$

means that the temperature dependence of  $k$  is through  $T$  in the exponential function  $\exp(-E_a/RT)$  only where  $E_a$  is a constant independent of  $T$ . Otherwise,  $k$  will have to be expressed by the general function

393

7

\*WANG and BRYNJOLFSSON

$F(T(t), t)$ . Thus, at temperatures  $T_1$  and  $T_2$ , we have

$$\left(\frac{dN}{dt}\right)_1 = -C \cdot [\exp(-E_a/RT_1)] \cdot N \quad (23)$$

$$\left(\frac{dN}{dt}\right)_2 = -C \cdot [\exp(-E_a/RT_2)] \cdot N \quad (24)$$

From Eqs. (23) and (24),

$$\frac{(dN/dt)_1}{(dN/dt)_2} = \exp \left[ -\frac{E_a}{R} \frac{T_2 - T_1}{T_1 T_2} \right] \quad (25)$$

Now if we choose the temperature  $T_2$  such that the rate of inactivation is changed by a factor of 10 from that at  $T_1$ , that is:

$$\frac{(dN/dt)_1}{(dN/dt)_2} = 10 \quad (26)$$

whence, using Eq. (25) it follows that:

$$E_a = \frac{(\ln 10) \cdot R T_1 T_2}{T_1 - T_2} = \frac{(\ln 10) \cdot R T_1 T_2}{z} \quad (27)$$

where, by definition,  $T_1 - T_2$ , the temperature change as specified, is the  $z$ -value.

In case of *Cl. botulinum* spores, representative values for  $z$  are in the range  $z = 10.4 \pm 0.8^\circ$  at  $121.1^\circ\text{C}$ <sup>(4)</sup>. From Eq. (27), we have then for *Cl. botulinum* spores,

$$\begin{aligned} E_a &= \frac{(\ln 10) \cdot 394.26 \cdot 384.26 \cdot 1.987 \cdot 10^{-3}}{10.4} \\ &= 66.6 \pm 5.4 \text{ kcal. mol}^{-1} \end{aligned} \quad (28)$$

#### 7. DETERMINATION OF THE CONSTANT C

For *Cl. botulinum* spores, we will use for 12D (i.e., reduction of the spore number to  $10^{-12}$  of the initial number) the conservative  $F_0$ -value of 3.5 min for non-acid and non-cured meats, which means that heating at  $121.1^\circ\text{C}$  for 17.5 sec. ( $= 3.5 \times 60/12$ ) reduces

(394)

\*WANG and BRYNJOLFSSON

the number  $N$  by one order of magnitude. Thus, from Eq. (16), for Cl. botulinum spores,

$$[C \cdot \exp(-E_a/RT)] \cdot 17.5 = \ln 10$$

giving

$$C = \frac{2.3026}{17.5} \cdot e^{85.076}$$

$$= 1.17 \cdot 10^{36} s^{-1}$$

Calculations are made rather simply with the computer of Eq. (22) as a function of time. The last columns of Tables I and II give the values of the survival fraction  $N/N_0$  at the axis thus computed. Fig. 2 is the plot of these "integral" survival curves for Cl. botulinum spores at the center of the cross-sectional planes  $z/l = 0, 0.4, 0.6, 0.8$  and  $1.0$ , of the cylinder with  $a = 5$  cm,  $v = 6$  and  $\kappa = 1.35 \times 10^{-3} \text{ cm}^2 s^{-1}$ . The heating and the initial temperatures  $T_h$  and  $T_i$ , are  $121.1^\circ\text{C}$  and  $21^\circ\text{C}$  respectively.

It is seen from the survival curve for  $z = 0$  that in order to reduce the survival fraction of Cl. botulinum spores to  $10^{-12}$  of the initial spore number, about  $1-1/2$  hours heating is needed for a beef roll of radius = 5 cm and 5 cm long.

395

\*WANG and BRYNJOLFSSON

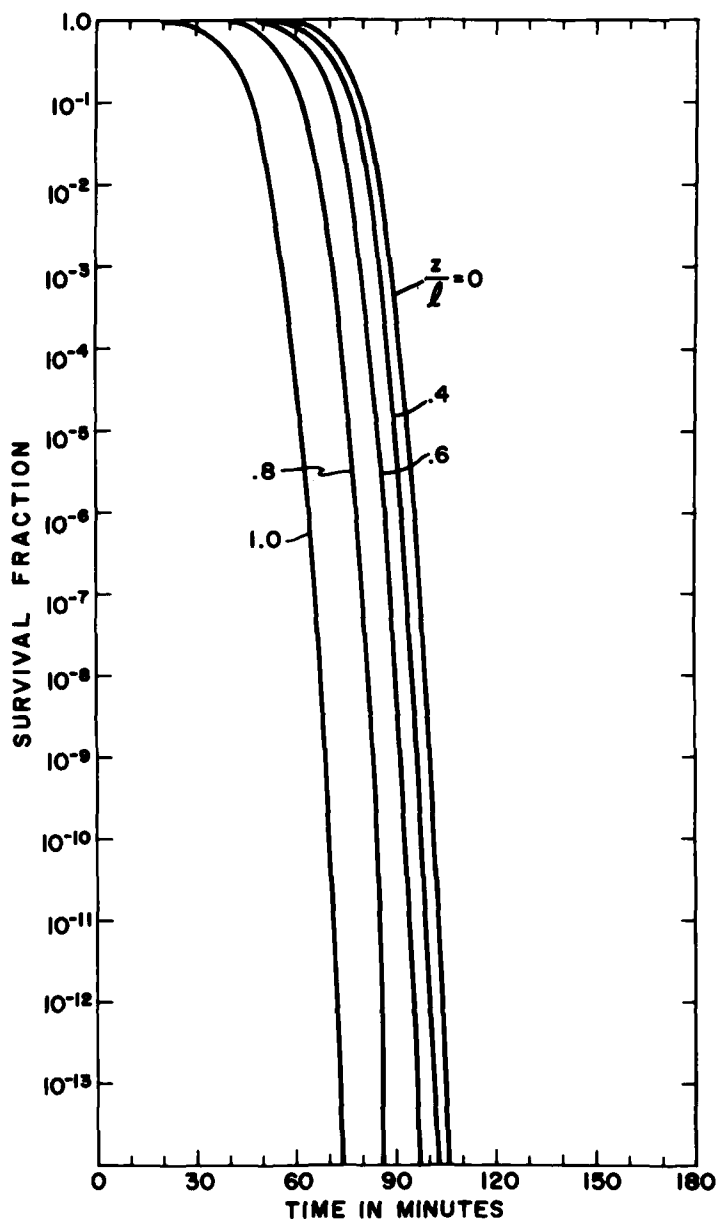


FIG. 2. INTEGRAL SURVIVAL CURVES FOR CL. BOTULINUM SPORES AT THE CENTER ( $r/a=0$ ) OF THE CROSS SECTIONAL PLANES  $z/l = 0, 0.4, 0.6, 0.8, 1.0$ , OF A FINITE CYLINDER.

396

\*WANG and BRYNJOLFSSON

REFERENCES

1. Wang, C. P. and Brynjolfsson, A., "Heat Transfer and the Killing of Bacteria during Thermal Sterilization of Meat Rolls," paper 78-WA/HT-56, *Winter Annual Meeting of the American Society of Mechanical Engineers* in San Francisco, Dec. 10-15, 1978.
2. Carslow, H.S., and Jagger, J.C., *Conduction of Heat in Solids*, 2nd ed., Oxford University Press, 1959.
3. Schneider, P.J., *Conduction Heat Transfer*, Addison-Wesley Publishing Co., 1955.
4. Pflug, I. J., and Odlaug, T.E., "A Review of z and F Values Used to Ensure the Safety of Low-Acid Canned Food," *Food Technology*, 32, No. 6, June 1978, pp. 63-67.
5. Aiba, S., Humphrey, A. E., and Millis, Nancy F., *Biochemical Engineering*, 2nd ed., Academic Press, 1973.
6. "Overview - Symposia in Food Science and Technology," *Food Technology*, 32, No. 3, March 1978.

(377)-398x

**DAT  
FILM**