


12

LEVEL II

AD A108821

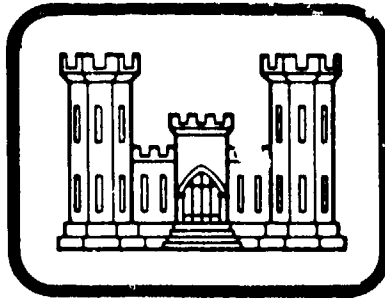

United States Army Corps of Engineers

*... Serving the Army
... Serving the Nation*

FACILITIES ENGINEERING SUPPORT AGENCY

FESA-T-2106

KIMBOROUGH HOSPITAL ENERGY AUDIT

NUS Corporation
4 Research Place
Rockville, Maryland 20850

September 1981

Final Report

APPROVED FOR PUBLIC RELEASE, DISTRIBUTION UNLIMITED

Prepared for:

U. S. Army Facilities Engineering Support Agency
Technology Support Division
Fort Belvoir, Virginia 22060

DTIC
ELECTE
DEC 23 1981

E
12 78

DTIC FILE COPY

404340

81 1 23 080

Notice

The contents of this report are not to be used for advertising, publication, or promotional purposes. Citation of trade names does not constitute an official indorsement or approval of the use of such commercial products. The findings of this report are not to be construed as an official Department of the Army position, unless so designated by other authorized documents.

Comments

Comments on the contents of this report are encouraged, and should be submitted to:

Commander and Director
US Army Facilities Engineering Support Agency
Fort Belvoir, Virginia 22060

KIMBOROUGH HOSPITAL ENERGY AUDIT

PREPARED UNDER

CONTRACT NO. DACA 31-80-D-0019

TASK ORDER NO. 00006

PREPARED FOR
U.S. DEPARTMENT OF THE ARMY
CORPS OF ENGINEERS
FACILITIES ENGINEERING SUPPORT AGENCY
FORT BELVOIR, VIRGINIA 22060

PREPARED BY
NUS CORPORATION
4 RESEARCH PLACE
ROCKVILLE, MARYLAND 20850

September 1981

Author Robert Whell
R. W. Fell
Lead Engineer

Approved Paul Utterback
P. M. Utterback
Project Manager

Approved M. R. Mychajliw
M. R. Mychajliw, Manager
Mechanical Engineering
Department

Accession For	
NTIS GRA&I	<input checked="" type="checkbox"/>
DTIC TAB	<input type="checkbox"/>
Unannounced	<input type="checkbox"/>
Justification	
By _____	
Distribution/	
Availability Codes	
Dist	Avail and/or Special
A	

Unclassified

SECURITY CLASSIFICATION OF THIS PAGE (When Data Entered)

REPORT DOCUMENTATION PAGE		READ INSTRUCTIONS BEFORE COMPLETING FORM
1. REPORT NUMBER FESA-T-2106	2. GOVT ACCESSION NO. AD A108821	3. RECIPIENT'S CATALOG NUMBER
4. TITLE (and Subtitle) Kimborough Hospital Energy Audit		5. TYPE OF REPORT & PERIOD COVERED
7. AUTHOR(s) Robert W. Fell		6. PERFORMING ORG. REPORT NUMBER
9. PERFORMING ORGANIZATION NAME AND ADDRESS NUS Corporation 4 Research Place Rockville, MD 20850		8. CONTRACT OR GRANT NUMBER(s) DACA 31-80-D-0019 Task Order 00006
11. CONTROLLING OFFICE NAME AND ADDRESS U. S. Army Facilities Engineering Support Agency Technology Support Division Fort Belvoir, VA 22060		10. PROGRAM ELEMENT, PROJECT, TASK AREA & WORK UNIT NUMBERS
14. MONITORING AGENCY NAME & ADDRESS (if different from Controlling Office) James A. Carelock, Project Engineer, FESA --Phone: (703) 664-5732		12. REPORT DATE July, 1981
		13. NUMBER OF PAGES 78
		15. SECURITY CLASS. (of this report) Unclassified
		15a. DECLASSIFICATION/DOWNGRADING SCHEDULE
16. DISTRIBUTION STATEMENT (of this Report) Approved for Public Release, Distribution Unlimited		
17. DISTRIBUTION STATEMENT (of the abstract entered in Block 20, if different from Report) ---		
18. SUPPLEMENTARY NOTES ---		
19. KEY WORDS (Continue on reverse side if necessary and identify by block number) Energy Conservation, Energy Audit		
20. ABSTRACT (Continue on reverse side if necessary and identify by block number) The results of an energy audit on Kimborough Hospital, Fort Meade, Maryland, are detailed herein. The report investigates various systems which consume energy in order to identify energy conservation opportunities. These selected systems include HVAC equipment, temperature and humidity controls, heat recovery equipment, building insulation, ventilation rate reduction, lighting systems and domestic hot water. The study analyzes energy conservation opportunities to determine which are cost effective and produce adequate energy savings. ←		

DD FORM 1 JAN 73 1473 EDITION OF 1 NOV 65 IS OBSOLETE

Unclassified

SECURITY CLASSIFICATION OF THIS PAGE (When Data Entered)

KIMBOROUGH HOSPITAL ENERGY AUDIT

TABLE OF CONTENTS

	<u>Page No.</u>
1.0 INTRODUCTION	1
2.0 SUMMARY OF FINDINGS	1
2.1 General Condition of Hospital	1
2.2 Potential Energy Savings Projects	1
3.0 DISCUSSION OF PROJECT DEVELOPMENT VS. LEVEL OF EFFORT	3
3.1 Level 1 - Hospital Survey and Drawing Review	3
3.2 Level 2 - Metering Of Energy Consumption And Evaluation By Hand Calculations	3
3.3 Level 3 - Computer Modeling of the Hospital and Subsequent Evaluation of Potential Modification	3
4.0 ENERGY CONSUMPTION BREAKDOWN	5
4.1 Heating Loads and Cost	5
4.2 Cooling Loads and Cost	5
4.3 Electric Energy Demands	5
4.3.1 Winter Electric Loads	5
4.3.2 Summer Electric Loads	7
4.3.3 Annual Electric Loads	7
4.4 Total Energy Cost	7
5.0 ENERGY SAVING MODIFICATIONS WITH GOOD ECONOMIC INCENTIVE	7
5.1 Fan Cycling for New Clinic Addition	11
5.2 Induced Air Makeup System for Kitchen Exhaust Hoods	13
5.3 Waste Heat Recovery Loop Between Exhaust and Inlet Ventilation Ducts	16
5.4 Additional Insulation to the Roof of the Old Hospital	21
5.5 Repair of Leaking Condensate Return	21
5.6 Repair of Steam Leakage from Domestic Hot Water System	21
6.0 ENERGY SAVINGS MODIFICATIONS WITH MODERATE ECONOMIC INCENTIVE	21
6.1 Additional Insulation to the Roof of the New Clinic Without Fan Cycling	21
6.2 Additional Insulation to the Roof of the New Clinic With Fan Cycling	21
Appendix A - Calculations	

TABLE OF CONTENTS (CONTINUED)

LIST OF FIGURES

		<u>Page</u>
FIGURE 1	Kimborough Army Hospital Base Case Energy Requirements	6
FIGURE 2	Typical Electrical Load for a Week in January	8
FIGURE 3	Kimborough Army Hospital Electricity Consumption	9
FIGURE 4	Kimborough Army Hospital - New Addition - Typical Electrical Load for a Week in January	12
FIGURE 5	Kimborough Army Hospital - New Addition - Fan Cycling Energy Consumption	14
FIGURE 6	Kimborough Army Hospital - Kitchen Exhaust Hood Induced Air System	17
FIGURE 7	Kimborough Army Hospital - Heat Recovery Loop	19

LIST OF TABLES

TABLE 1	Summary of Energy Savings Projects	2
TABLE 2	Project Development vs. Level of Effort	4
TABLE 3	Energy Consumption and Costs for Kimborough Army Hospital	10
TABLE 4	Proposed Fan Cycling Schedule for the New Addition	13

1.0 INTRODUCTION

The Department of the Army, Baltimore District, Corps of Engineers, under work order contract DACA 31-80-0019 Task Order 00006 dated April 21, 1980, assigned NUS Corporation to perform an energy audit of the Kimborough Army Hospital at Fort Meade, Maryland. The philosophy of the project was to carry out the energy audit in three separate parts or levels of effort. The first level of effort was to identify energy saving opportunities by means of site inspection and engineering judgement. The second level involved metering of the hospital's energy consumption and making appropriate hand calculations to confirm the accuracy of the Level 1 recommendations and identify additional energy saving opportunities. The third level of effort utilized computer modeling as a tool to investigate further energy savings possibilities.

2.0 SUMMARY OF FINDINGS

The Kimborough Army Hospital is in excellent condition, has already adopted energy conservation programs, and maintains an outstanding planned maintenance program to keep equipment in top condition. Nevertheless, there are several projects which, if incorporated, can save the hospital approximately \$57,000 (1980 dollars) per year with a simple investment payback of less than 1.6 years. This saving represents approximately a 12% reduction in energy cost (1980 dollars).

2.1 General Condition of the Hospital

The Kimborough Army Hospital was built in 1958. A new addition was added several years later. The hospital consists of one three story, block and brick veneer structure with three wings totaling approximately 138,660 square feet and providing sufficient space for 300 beds; and a new single level clinic of approximately 56, 217 square feet. The entire hospital totals approximately 194,880 square feet.

The building characteristics that place this hospital into an energy efficient category are as follows:

- o All windows are presently double glazed
- o All entrances (except for rear emergency exits) are double door entrance foyers
- o Compared to the building size, the heating, ventilating and air conditioning units are operated at relatively low outside air inlet flow rates
- o All lighting (except for the machine spaces) is done with fluorescent fixtures
- o All mechanical and electrical equipment is well maintained, and controls are calibrated at frequent intervals

2.2 Potential Energy Saving Projects

The energy audit exposed six potential energy savings projects; four of these require capital energy saving investment with the other two requiring only maintenance. In addition, two alternative projects are listed for information. A summary of these projects is presented in Table 1. All costs presented, both in this table and other sections of the report are in 1980 dollars.

TABLE 1

SUMMARY OF ENERGY SAVINGS PROJECTS

Item	Project	Annual Energy Savings Potential (Million BTUe)	Annual Cost Savings Potential (1980 Dollars)	Estimated Installed Cost (1980 Dollars)	Simple Payback Time (Years)	E/C Ratio (Million BTUe/ \$1000 Investment)
1	New Clinic Fan Cycling Control	5,755	\$ 32,780	\$12,000	0.4	480
2	Induced Air Makeup System for Kitchen Exhaust Hoods	936	\$13,570	\$10,000	0.6	117
3	Waste Heat Recovery Loop Between Exhaust and Inlet Ventilation Ducts	240	\$ 6,068	\$10,000	1.6	25
4	Additional Insulation to the Roof of the Old Hospital	373	\$ 4,150	\$19,000	4.6	19.6
5	Fix Leaking Condensate Return	9.6 960 Gallons of Water	\$ 135	No cost other than maintenance and repair parts	1.0	50 (approx.)
6	Repair of Steam Leakage from Domestic Hot Water System	43.8 5290 Gallons of Water	\$ 497	No cost other than maintenance and repair parts	1.0	50 (approx.)
7	Additional Insulation to the Roof of the New Clinic without Fan Cycling	579	\$ 6,078	\$28,000	4.6	20.7
8	Additional Insulation to the Roof of the New Clinic with Fan Cycling	211	\$ 2,529	\$16,800	6.6	12.5

3.0 DISCUSSION OF PROJECT DEVELOPMENT VS. LEVEL OF EFFORT

The costs and levels of effort expended to identify energy savings projects are summarized in Table 2.

3.1 Level 1 - Hospital Survey and Drawing Review

Because the Kimborough Hospital is in excellent condition and most low cost energy saving concepts have already been incorporated, no new, non-capital intensive projects were yielded by the Level 1 effort. Only maintenance projects numbers 5 and 6 were identified. Nevertheless, the Level 1 survey information was essential for the more complex projects identified in Levels 2 and 3. The Level 1 effort consumed approximately 25 percent of the total project budget.

3.2 Level 2 - Metering Of Energy Consumption And Evaluation By Hand Calculations

Two major energy savings projects were identified during this phase of the work effort. Project 1, a microprocessor control system to cycle ventilation fans in the new addition was identified as a result of metering the electric consumption of the new addition over a period of one month. It was noted that the electric power consumption during the non-working hours (nights and weekends) was a steady 50 percent of the maximum power consumed during weekdays. Based upon a review of electrical drawings of the new addition, it was concluded that most of the non-working hour power consumption was due to the ventilation fans. Consequently a fan cycling project was identified to reduce power consumption during these times. The overall evaluation of this project to determine its total energy savings potential had to wait, however, until Level 3 was performed.

The second energy saving project identified in Level 2 was the kitchen induced air makeup system, project 2. A major kitchen exhaust load consuming large quantities of winter heating energy was identified. Consequently, the induced air makeup system for the kitchen exhaust loads was developed to reduce the amount of heated air exhausted to the outside. Hand calculations were made to estimate the energy and cost savings, therefore, project 2 was fully developed as a result of the Level 2 effort. Level 2 effort consumed approximately 25 percent of the project budget.

3.3 Level 3 - Computer Modeling of the Hospital and Subsequent Evaluation of Potential Modification

The DOE - II computer code was utilized to evaluate the more complex energy saving projects. This code was employed to predict the heating and cooling loads as they would be affected by changes to ventilation flow rates, insulation, and heating and ventilation system changes. The computer analysis was used to predict the energy savings potential for project 1 (fan cycling in the new addition), project 3 (waste heat recovery loop between exhaust and inlet ventilation ducts), and project 4 (additional insulation to the top floor ceiling in the old section of the hospital). In addition, the computer was employed to perform sensitivity analyses for the addition of insulation to the new addition, both with and without fan cycling (projects 7 and 8). The remaining 50 percent of the budget was expended in the completion of the Level 3 effort.

TABLE 2

PROJECT DEVELOPMENT VERSUS LEVEL OF EFFORT

LEVEL OF EFFORT	DESCRIPTION OF TYPICAL ACTIVITIES	ENERGY SAVING PROJECT FOR WHICH THE ACTIVITY WAS REQUIRED								APPROXIMATE PERCENTAGE OF BUDGET EXPENDED ON LEVEL OF EFFORT
		1	2	3	4	5	6	7	8	
1	Survey Hospital; Review Drawings; Engineering Judgments	X	X	X	X	X	X	X	X	25
2	Install Energy Records; Review Data; Perform Hand Calculations;	X	X						X	25
3	Computer Modeling of Hospital; Evaluate Changes to Systems; Evaluate Computer Outputs	X		X	X				X	50
	Approximate Percentage of Budget Expended on Project	36	10	16	12	2	2	12	10	100

4.0 ENERGY CONSUMPTION BREAKDOWN

A breakdown of the energy consumption of the Kimborough Army Hospital is listed as follows:

- o Heating
- o Humidification
- o Cooling
- o Fans
- o Lighting
- o Kitcher.
- o Miscellaneous (i.e., of ice equipment, air compressors, x-ray and other medical equipment)
- o Domestic hot water

4.1 Heating Loads and Cost

The annual heating and humidification requirements for the hospital are estimated to be 23.5 billion BTUs per year with a maximum January heating load of 5.0 billion BTUs.

The heating loads are supplied by a central steam boiler house containing three boilers fired by number 2 or number 6 fuel oil. This boiler house provides the steam needs for the hospital, a hospital staff barracks building, a medical laboratory, and a warehouse. The hospital consumes approximately 75% of the total steam generated by the boiler house.

The estimated cost for heating the hospital is based on the hospital heating loads, shown in Figure 1, a boiler efficiency of 83%, and a fuel oil cost of approximately \$1.30/gallon (for number 2 fuel oil at 140,000 BTUs/gallon). The estimated 1980 heating cost then computes to \$263,000 per year.

4.2 Cooling Loads and Cost

The expected cooling loads for the hospital are also plotted in Figure 1. The yearly cooling requirements are estimated to be 7.6 billion BTUs per cooling season. The maximum hourly cooling load is expected to occur in June at approximately 6.6 million BTU/hour. This cooling load draws additional electrical energy of approximately 557,000 KWhr during the cooling season. In addition, the maximum cooling load creates an additional electrical demand of approximately 483.6 KW.


The estimated cost for providing the cooling is based on the season cooling electrical energy requirement and an estimated cost of 0.04 \$/KWhr (based on an average demand charge of 0.0089 \$/KWhr; fuel charge of 0.02 \$/KWhr; and an average generation charge of 0.011 \$/KWhr). Therefore, the estimated cost for air conditioning is \$22,350 per season.

4.3 Electricity Energy Demands

4.3.1 Winter Electric Loads

During the winter months, the Kimborough Army Hospital is presently consuming 60,130 KWhr per week of electric energy with a peak load of approximately 500 KW.

FIGURE 1
KIMBOROUGH ARMY HOSPITAL
BASE CASE ENERGY REQUIREMENTS

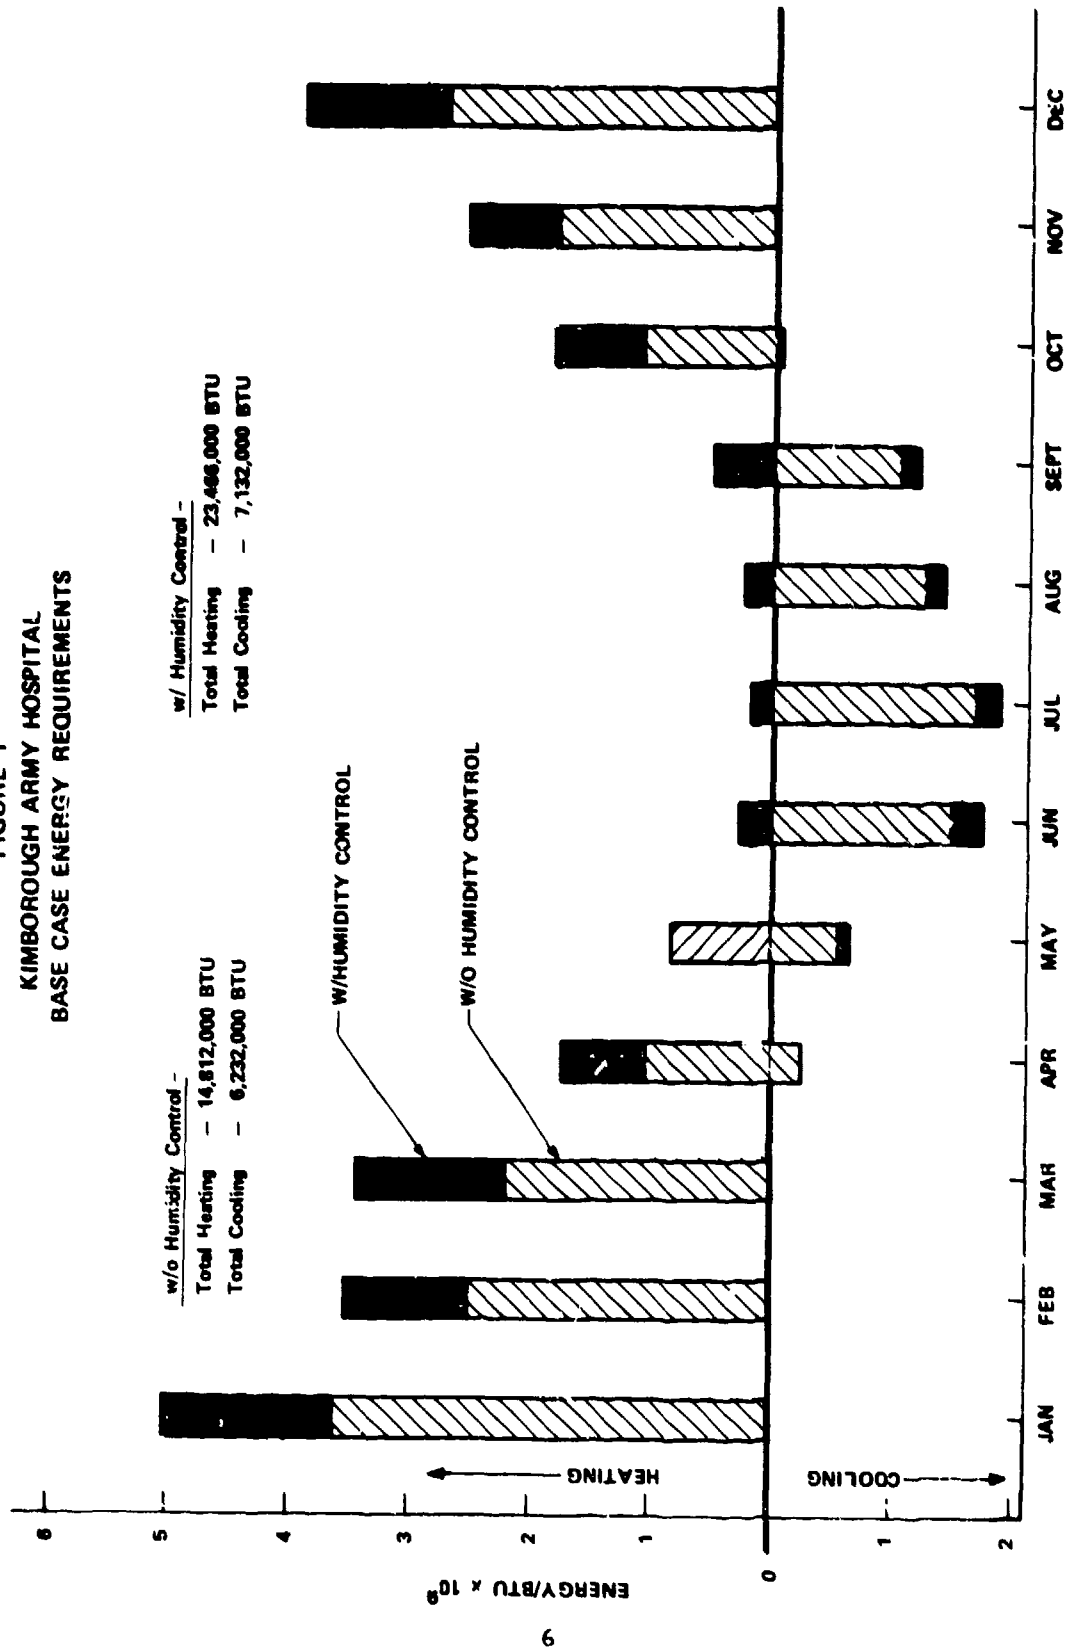

The typical weekly profile is shown in Figure 2 for January weather. This electric load is essentially independent of cooling and heating needs. It consists of the following items:

- o Ventilation and air circulation fans - approximately 164 KW - for an estimated 1,428,000 KWhr/yr
- o Lights - approximately 224 KW - for an estimated 892,000 KWhr per year
- o Other hospital equipment - approximately 90 KW - for an estimated 805,920 KWhr per year

These loads together total approximately 3,126,600 KWhr/year.

3.2 Summer Electric Loads

During the summer months, cooling adds an additional maximum load of approximately 484 KW and consume an estimated 557,000 KWhr during the cooling season.

3.3 Annual Electric Loads

The expected annual electrical energy consumption is plotted in Figure 3. The total annual electricity consumption (summer plus winter) is estimated to be approximately 3,683,500 KWhr. The cost for this electric energy is approximately \$147,300 per year.

Actual total charges for electricity are, of course, based upon a combination of charges for usage (KWH) and demand (KWD). Since Fort Meade is metered as a unit, the applicable demand charge is determined by the peak loading for the entire base. The effect of peak reduction at Kimborough Hospital upon the peak of the base as a whole is indeterminate. Therefore, electricity charges used in this report have been determined utilizing average demand charges for the base as a whole.

4 Total Energy Cost

Table 3 presents the total energy consumption and cost. The total annual energy cost for heating, cooling, humidification, kitchens, and other electric usage is approximately \$427,420 per year.

5.0 ENERGY SAVING MODIFICATIONS WITH GOOD ECONOMIC INCENTIVE

Based on the survey taken of the Kimborough Army Hospital, the following modifications or corrections have been identified that will save energy and lower operating cost with a high degree of economic merits. These modifications/corrections are as follows:

- o Install a microprocessor controller to cycle the ventilation fans in the new clinic section based on time of day and day of week.
- o Install an induced air makeup system to the exhaust ventilation hoods in the kitchen.

FIGURE 2
TYPICAL ELECTRICAL LOAD FOR A WEEK IN JANUARY


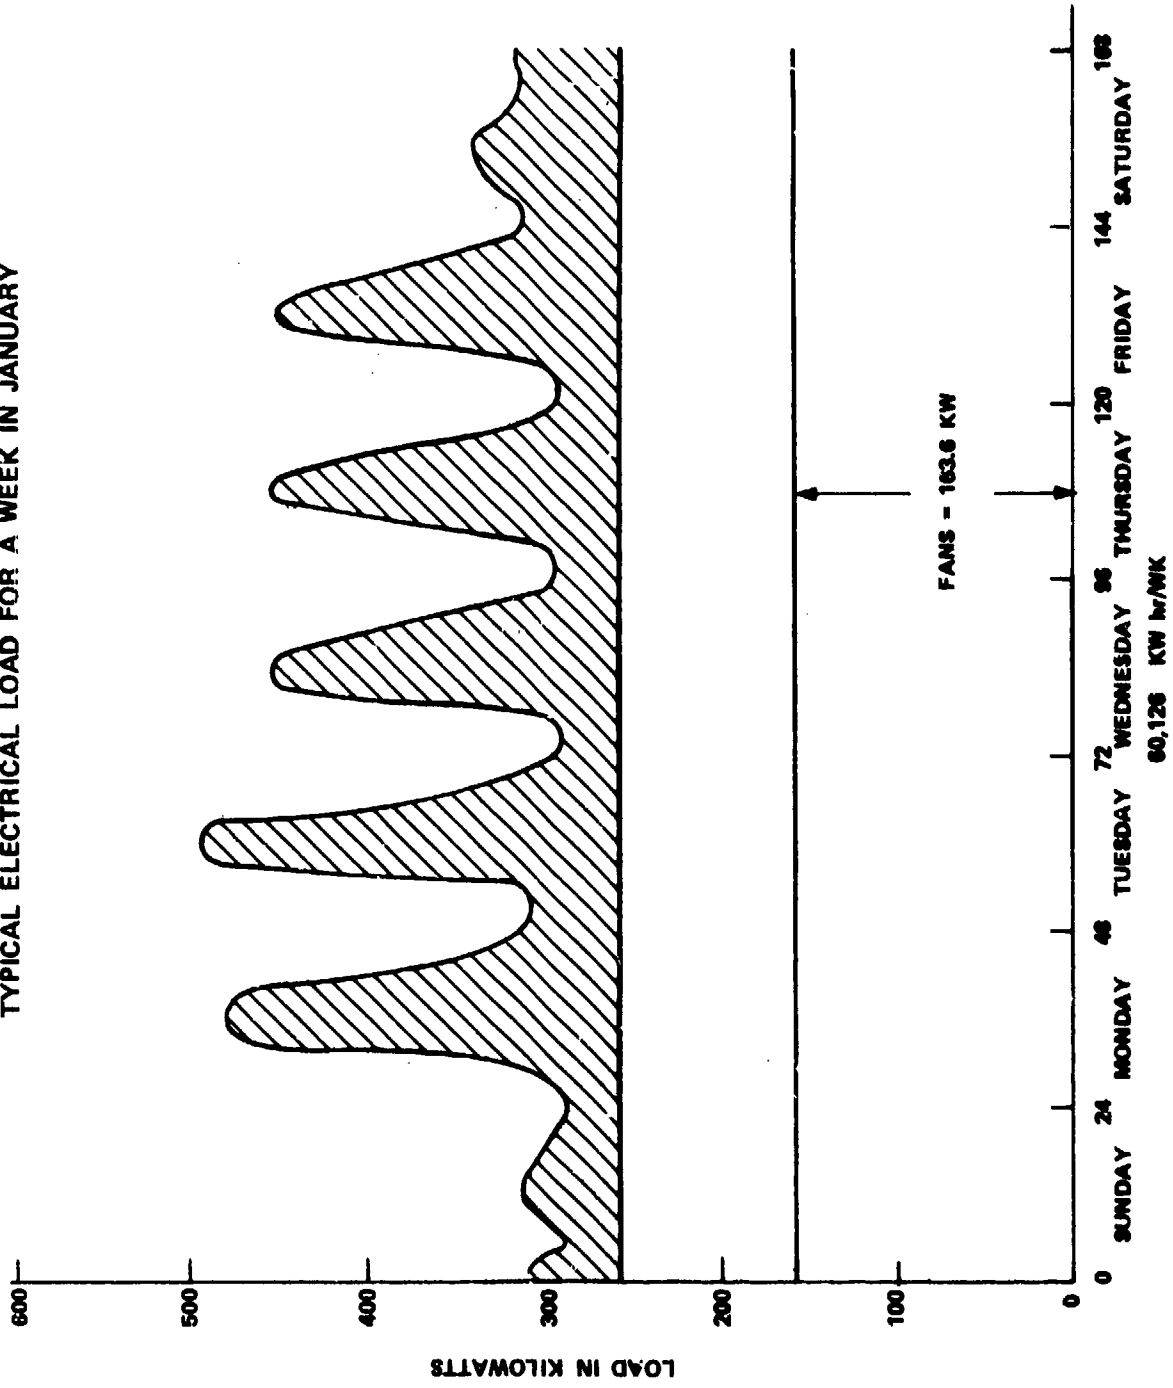


FIGURE 3
KIMBOROUGH ARMY HOSPITAL
ELECTRICAL CONSUMPTION
(W/HUMIDITY CONTROL)

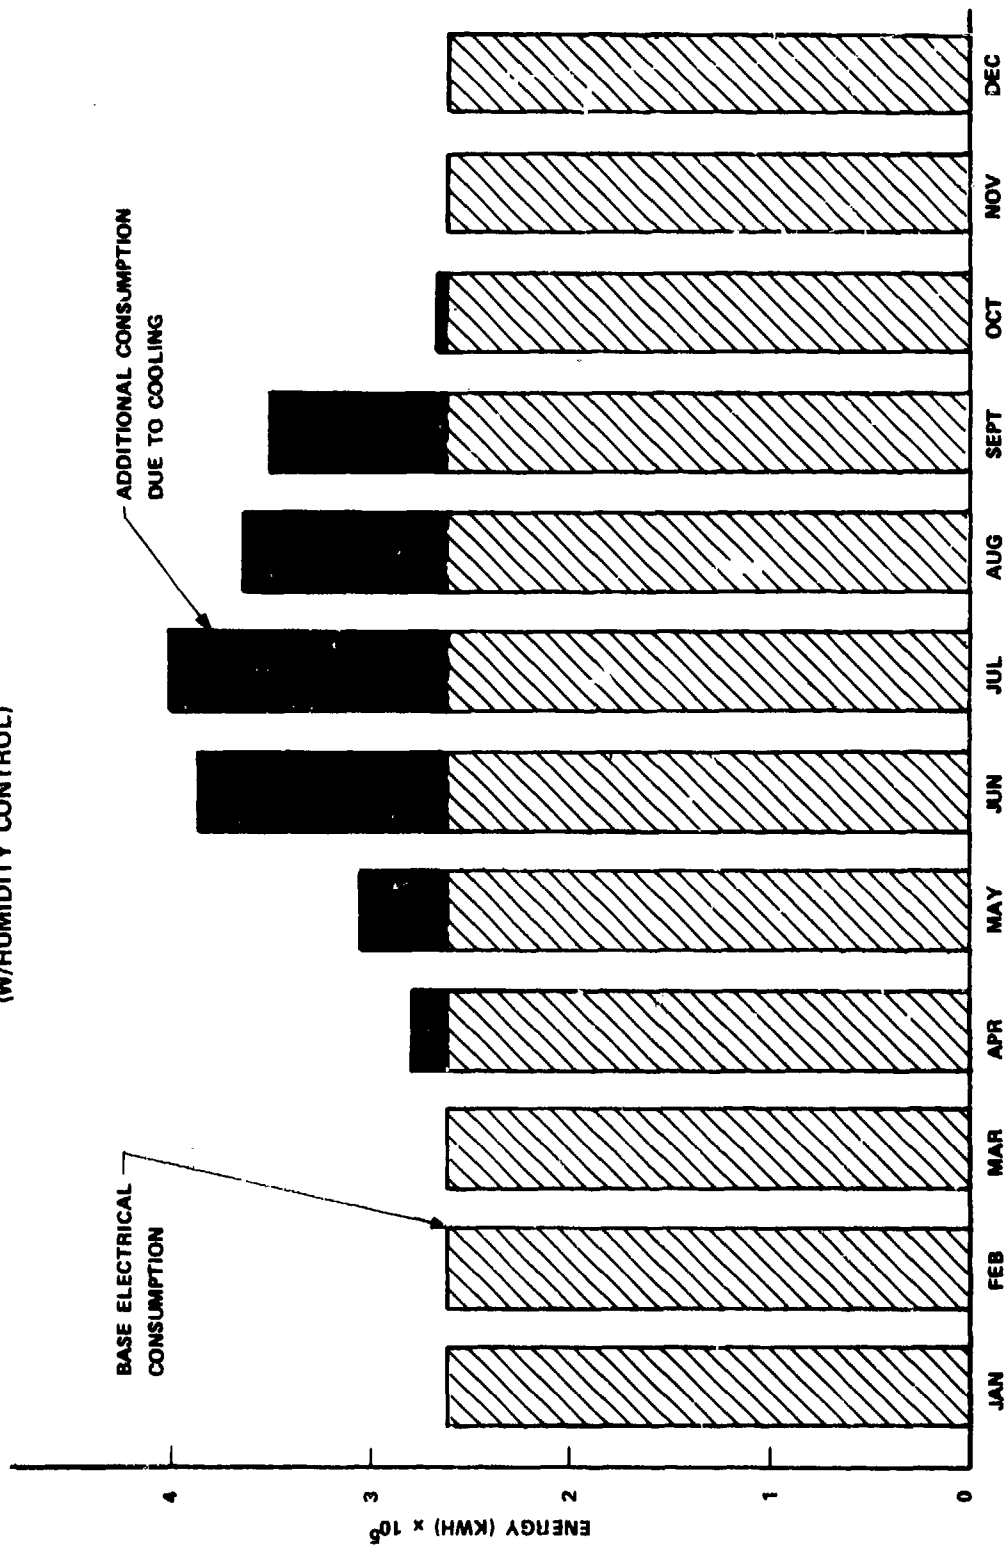

(TOTAL YEARLY ELECTRICAL CONSUMPTION = 3,840,000 KWH)

TABLE 3
ENERGY CONSUMPTION AND COSTS FOR KIMBOROUGH ARMY HOSPITAL

<u>Item</u>	<u>Annual Energy Use</u>	<u>Annual Cost</u>	<u>%Based on Costs</u>
Heating	14.8x10 BTUs	\$165,760	38.8
Humidification	8.6x10 BTUs	\$99,680	23.3
Fans	1,428,640 KWhrs	\$57,150	13.4
Lights	891,990 KWhrs	\$35,680	8.3
Cooling	55,7000 KWhrs	\$22,350	5.2
Kitchen	1.2x10 BTUs	\$13,440	3.1
Domestic Hot Water	0.1x10 BTUs	\$1,120	0.3
Miscellaneous	805,920 KWhrs	\$32,240	7.5
Total:		\$427,420	100

- o Install a heat recovery loop between the ventilation exhaust and inlet air ducts
- o Install two inches of insulation above of the drop ceiling beneath the roof of the original hospital section.
- o Repair the leaking condensate return sump tank and pumps serving the new clinic addition.
- o Repair the leaking steam traps serving the domestic hot water system.

The detailed explanation for these modifications regarding energy and cost savings is presented in the following paragraphs.

5.1 Fan Cycling For New Clinic Addition.

The present operation of the new addition allows the ventilation fans to continue operation during periods when the building is unoccupied. These unoccupied periods are primarily Saturdays, Sundays, and weekdays between 6:00 p.m. and 8:00 a.m. Figure 4 presents typical electrical load during January for the clinic section. As shown in the figure, there is a steady minimum demand of approximately 90 KW that occurs during the unoccupied hours of which approximately 70 to 80 KW are supply, return and exhaust fans. By establishing a new schedule which allows the fan operation to be curtailed and temperatures to be reduced, significant heating, cooling, and electric energy can be saved. Table 4 presents such a suggested schedule.

Figure 5 shows the estimated difference in energy consumption for this modification. These savings are estimated to be as follows:

Heating	1570 million BTUs Saved
Cooling (Electrical Load)	37,000 KWhr Saved
Fan (Electrical Load)	343,210 KWhr Saved
Fuel saved at Electric Generating Station (Baltimore Gas & Light)	4185 million BTUs Saved

The cost savings to the hospital associated with this energy saving is estimated to be \$17,570 for heating oil and \$15,210 for electricity for a total savings of \$32,780 per year.

The control equipment necessary to incorporate a fan cycling schedule would be a small microprocessor programmed with the control schedule logic. These microprocessors are commercially available. They have an internal clock that keeps track of time of day and days per week. Temperature inputs to these controllers are obtained via thermostats placed in the rooms served by the ventilation system. Approximately four inputs would probably be required for Kimborough Hospital. The outputs from the controller are relay switches that turn equipment "on" or "off" in accordance with the programmed logic.

The installed cost for a microprocessor and associated equipment to cycle the ventilation fans is estimated to be approximately \$12,000. (This is based on comparative installed cost of microprocessor building control system.)

FIGURE 4
KIMBOROUGH ARMY HOSPITAL - NEW ADDITION
TYPICAL ELECTRICAL LOAD FOR A WEEK IN JANUARY


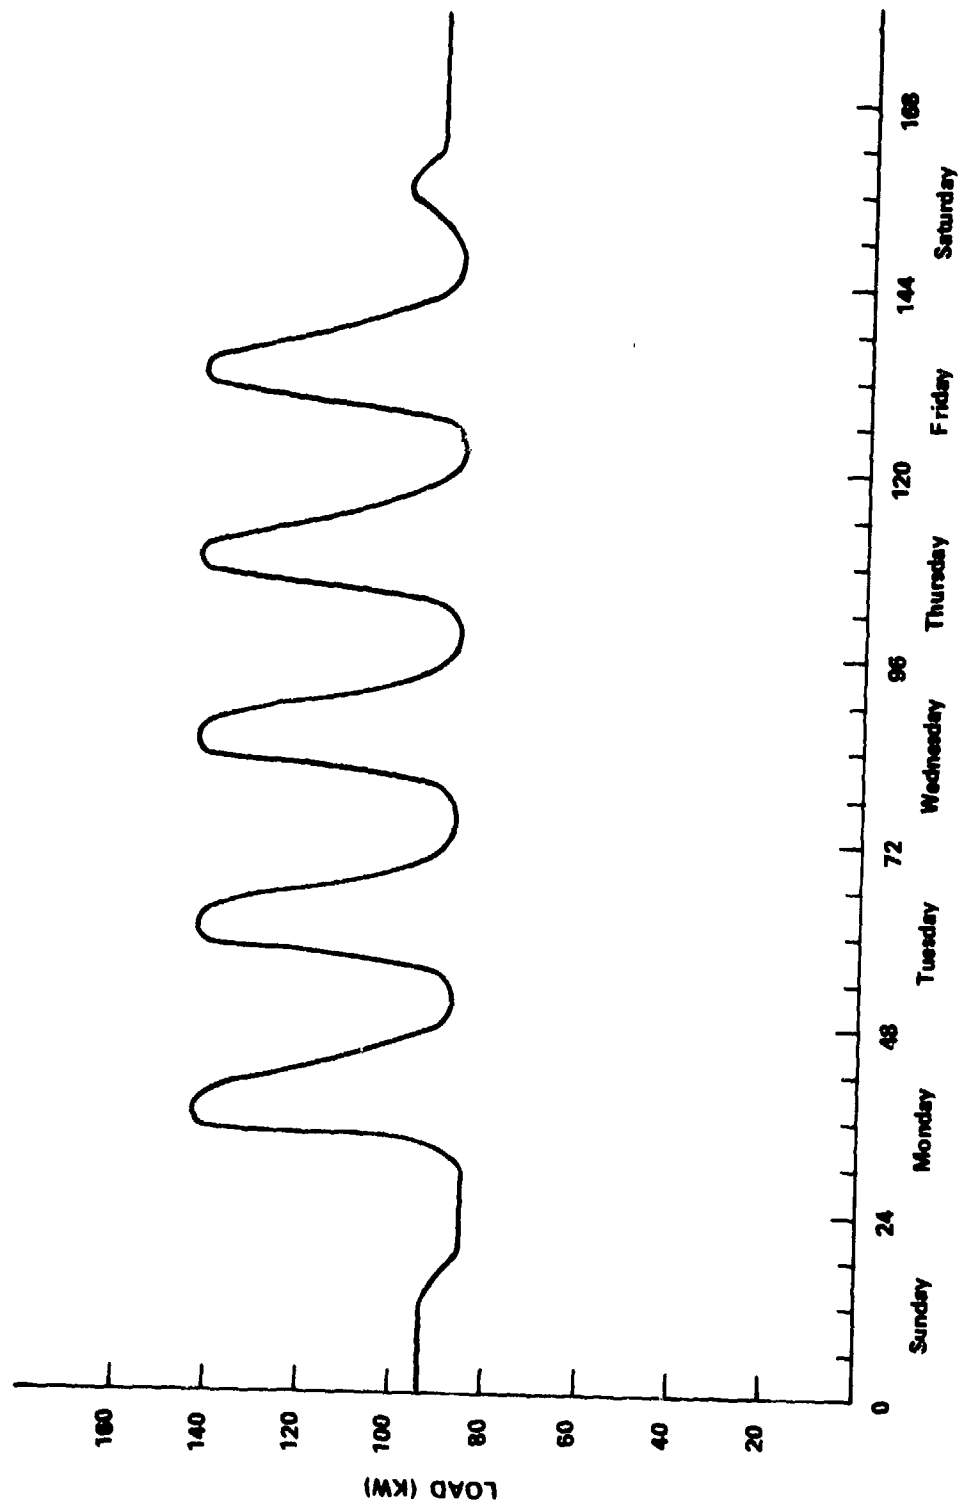


TABLE 4

PROPOSED FAN CYCLING SCHEDULE
FOR THE NEW ADDITION

<u>Time</u>	<u>Fan Operation</u>	<u>Thermostat Set Points</u>
Weekdays		
8 a.m. to 6 p.m.	All run	75°F
6 p.m. to 8 a.m.	All off except to maintain clinic above 58°F during winter months	58°F
Saturday & Sunday	All off except to maintain clinic above 58°F during winter months	58°F

FIGURE 5

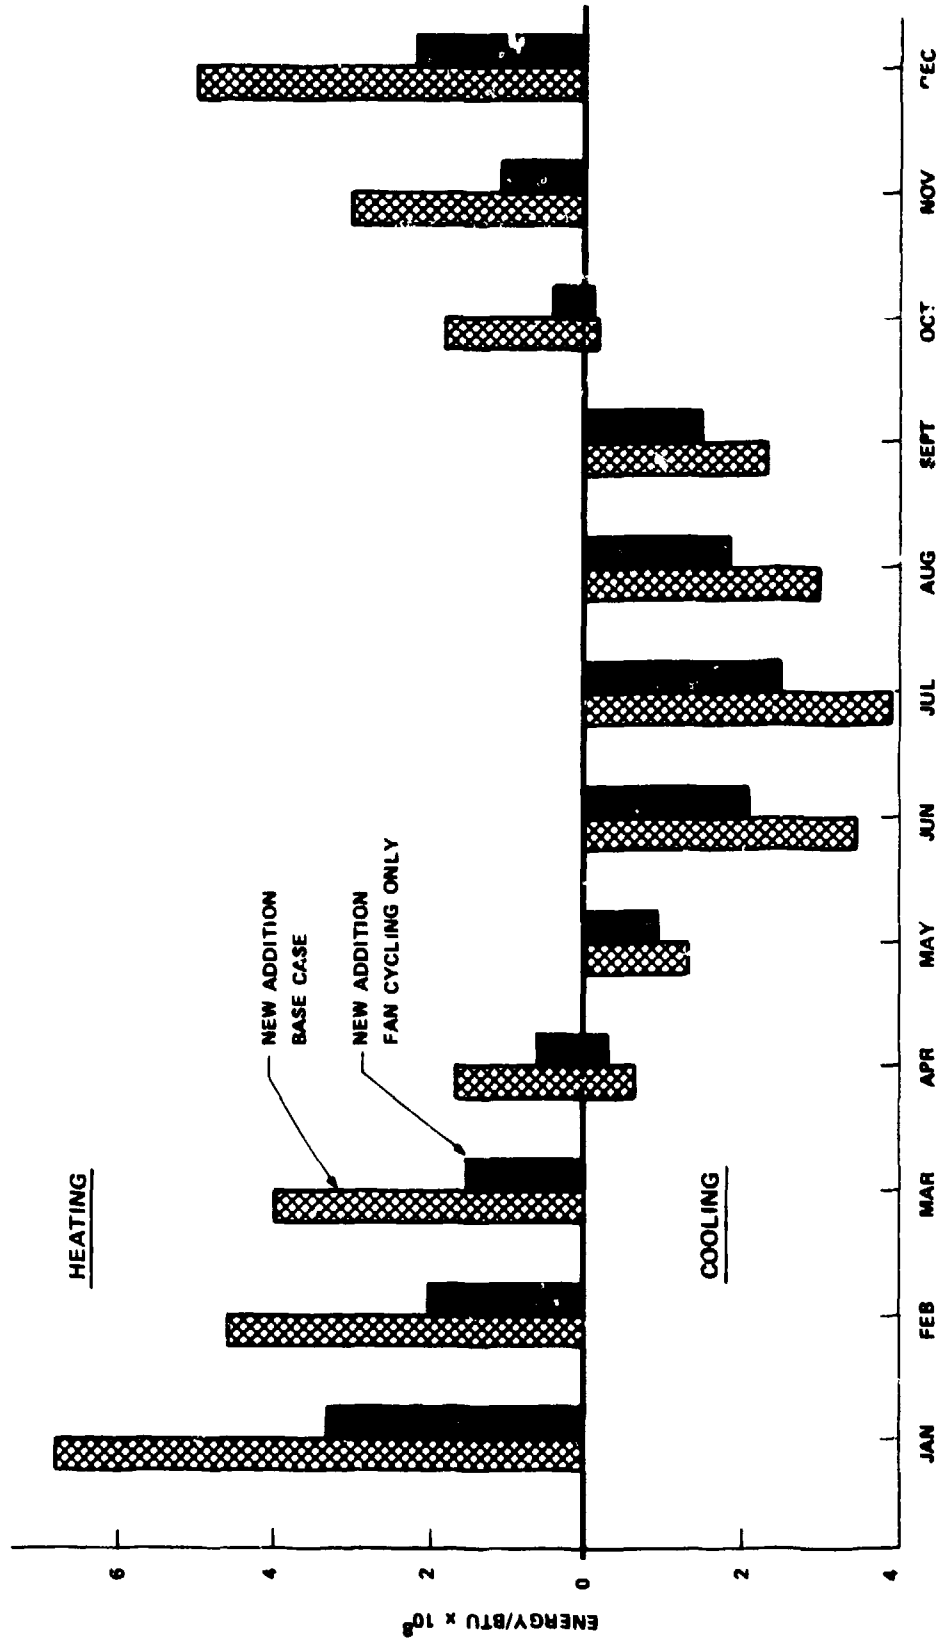

ECONOMIC ANALYSIS SUMMARY

Location: Ft. Meade, Kimborough Army Hospital FY 1981
 Project: Install microprocessor to cycle air handling fans on
 new addition
 Economic Life 10 Yrs. Date Prepared 3/7/81 Prepared by R. W. Fell

COSTS

1. Non-Recurring Initial Capital Costs:

a. CNE	\$	<u>12,000</u>
b. Design	\$	<u>0</u>
c.	\$	<u>0</u>
d. Total	\$	<u>12,000</u>

BENEFITS

2. Recurring Benefit/Cost Differential Other than Energy:

a. Annual Labor Decrease (+)/Increase (-)	\$	<u>-</u>
b. Annual Material Decrease (+)/Increase (-)	\$	<u>-</u>
c. Other Annual Decrease (+)/Increase (-)	\$	<u>-</u>
d. Total Costs	\$	<u>-</u>
e. 10% Discount Factor	\$	<u>-</u>
f. Discounted Recurring Cost (d x e)	\$	<u>-</u>

3. Recurring Energy Benefit/Costs:

a. Type of Fuel: <u>Oil</u>		
(1) Annual Energy <u>Decrease (+)</u> /Increase (-)		<u>1,570 MBTU</u>
(2) Cost per MBTU	\$	<u>11.19</u>
(3) Annual Dollar <u>Decrease</u> /Increase ((1)x(2))	\$	<u>17,570</u>
(4) Differential Escalation Rate (<u>8 %</u>) Factor		<u>9,136</u>
(5) Discounted Dollar <u>Decrease</u> /Increase (3)x(4)	\$	<u>160,520</u>
b. Type of Fuel: <u>Electricity</u>		
(1) Annual Energy <u>Decrease (+)</u> /Increase (-)		<u>380,210 KWH*</u>
(2) Cost per KWH	\$	<u>0.04</u>
(3) Annual Dollar <u>Decrease</u> /Increase ((1)x(2))	\$	<u>15,210</u>
(4) Differential Escalation Rate (<u>7 %</u>) Factor		<u>8,737</u>
(5) Discounted Dollar <u>Decrease</u> /Increase ((3)x(4))	\$	<u>132,890</u>
c. Type of Fuel: _____		
(1) Annual Energy Decrease (+)/Increase (-)		<u>-</u>
(2) Cost per MBTU	\$	<u>-</u>
(3) Annual Dollar Decrease/Increase ((1)x(2))	\$	<u>-</u>
(4) Differential Escalation Rate (<u> % </u>) Factor		<u>-</u>
(5) Discounted Dollar Decrease/Increase ((3)x(4))	\$	<u>-</u>
d. Discounted Energy Benefits (3a(5)+3b(5)+3c(5)+3d(5))	\$	<u>293,410</u>
4. Total Benefits (Sum 2f+3d)	\$	<u>293,410</u>
5. Discounted Benefit/Cost Ratio (Line 4/Line 1d)		<u>24.4</u>
6. Total Annual Energy Savings (3a(1)+3b(1)+3c(1))		<u>5,755 MBTU</u>
7. E/C Ratio (Line 6 ÷ Line 1a/1000)		<u>480</u>
8. Annual \$ Savings (2d+3a(3)+3b(3)+3c(3))	\$	<u>32,780</u>
9. Pay-Back Period ((Line 1a - Salvage)÷Line 8)		<u>0.4 Years</u>

*4,185 MBTU at generating station

Based on the cost savings due to reduced energy consumption and the estimated installer capital cost, the simple payback period for this modification is less than one half a year; the present worth of the savings is approximately \$293,410 (for a ten year depreciation, 10% return on present worth, and 8% fuel escalation over inflation), and the energy saved per \$1000 investment (E/C ratio) is 480.

5.2 Install Induced Air Makeup System for Kitchen Exhaust Hoods

The amount of kitchen conditioned air exhausted to the outside could be significantly reduced by circulating unconditioned outside air directly underneath the exhaust hoods over the stoves as is commonly done on new systems. A constant volume fan is used so that air flow velocities within the hood remain unchanged and grease separation efficiency of the hood is maintained. However, because unconditioned outside air is directed underneath the hood, the quantity of room conditioned air exhausted by the hood is reduced. This reduction in conditioned air exhaust lowers the outside air makeup that must be heated during the winter and cooled during the summer.

Figure 6 illustrates this modification. The concept recommended consists of a roof supply fan forcing approximately 12,000 cfm of unconditioned air through a single air duct and discharging 6,000 cfm under each of the two existing stove exhaust hoods.

The heating energy saved is estimated to be approximately 1400 million BTUs for an estimated heating oil savings of \$15,670 per year. On the other hand, the additional electricity consumed by the fan (requiring 464 million BTUs of additional heat energy to generate the electricity) is estimated to be 40,000 KWhr per year for an additional electricity cost of approximately \$1600, therefore, the net effect is a real energy savings of 936 million BTUs and a cost savings of \$13,570 per year. The present worth of this savings over 25 years is \$258,600.

The Current Working Estimate (CWE) to install the fan system is \$8000, with a total estimated capital investment of approximately \$10,000. Therefore, the estimated simple payback period for this modification is less than one year, and the E/C ratio is approximately 117 million BTUs saved per \$1000 invested.

5.3 Waste Heat Recovery Loop Between Exhaust and Inlet Ventilation Ducts

Figure 7 illustrates a waste heat recovery loop that extracts heat from the exhaust ventilation air and expels this heat back into the inlet air of the ventilation system. This waste heat recovery system consists of an air to water heat exchanger installed in the exhaust duct upstream of Fan F-7 and another heat exchanger installed in the inlet duct upstream of AC unit 2. A pump circulates a solution of water/glycol (to prevent freezing) through the exhaust heat exchanger where it extracts heat by cooling the exhaust flow. The water solution is then pumped through the inlet air heat exchanger where it raises the inlet air temperature. An expansion tank is required to accommodate the thermal expansion of the water and some controls are required to start and stop the circulating water pump based on inlet and exhaust air temperature.

The estimated annual heating energy saved by incorporating this waste heat recovery loop is approximately 760 million BTUs of heating energy. The cost savings in heating oil associated with this energy savings is approximately \$8,360 per year. However, the circulating water pump operating for approximately 4000 hours per year is estimated

KIMBOROUGH ARMY HOSPITAL ENERGY AUDIT

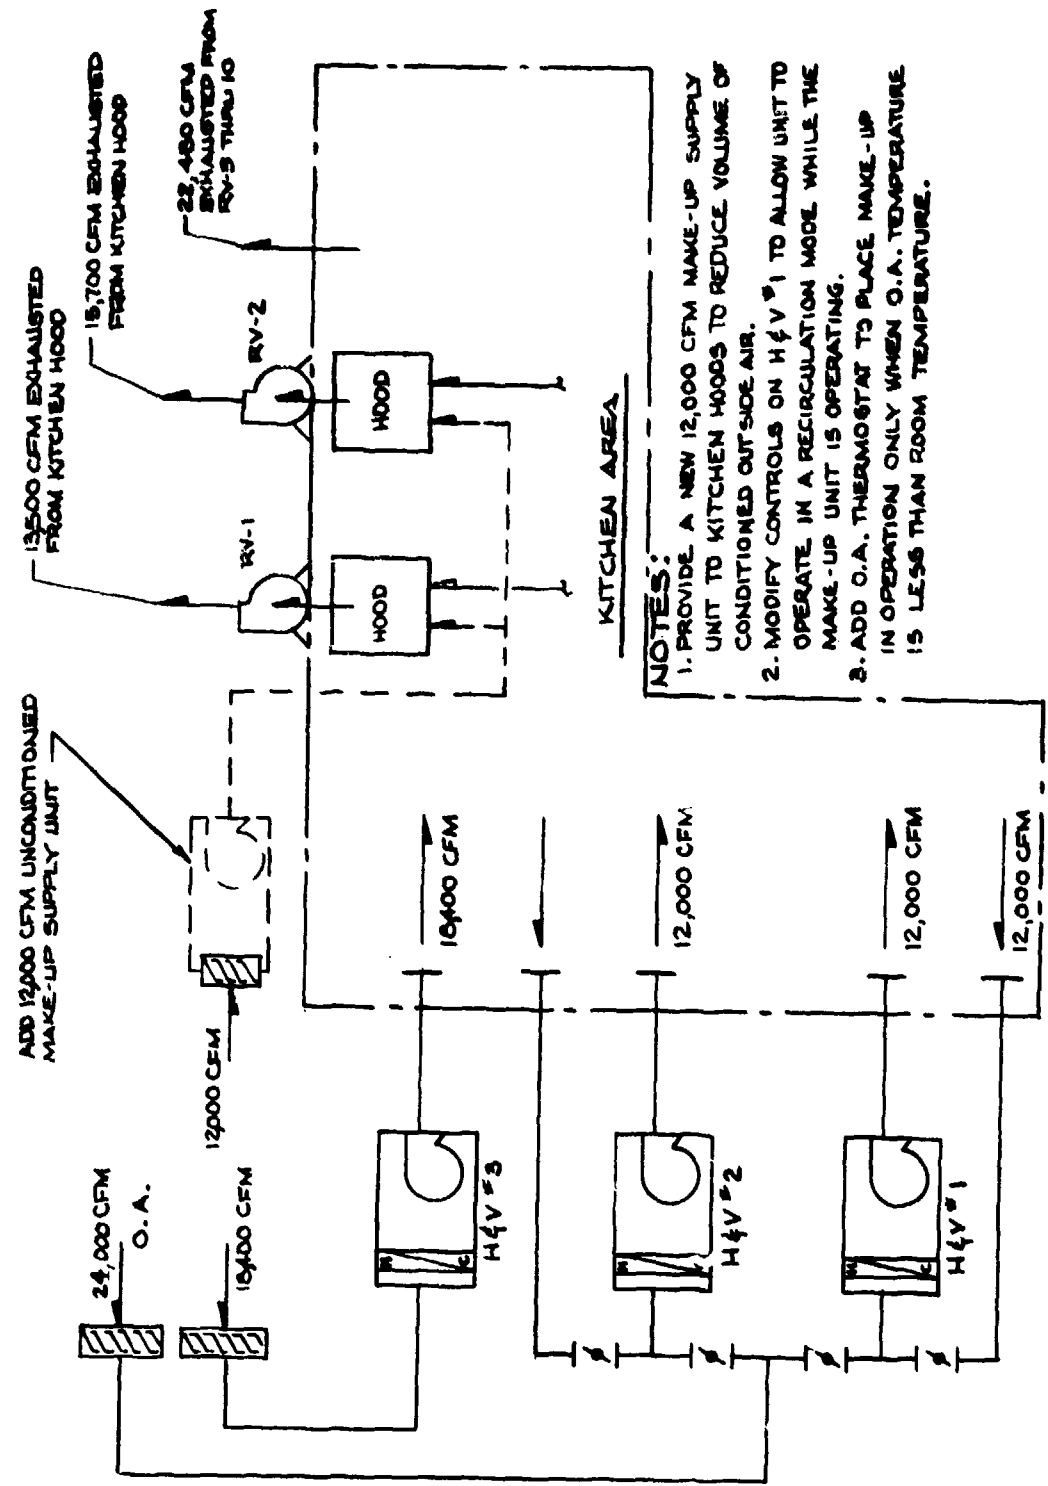


FIGURE 6

ECONOMIC ANALYSIS SUMMARY

Location: Ft. Meade, Kimborough Army Hospital FY 1981
 Project: Install induced air make-up system for kitchen exhaust hood
 Economic Life 25 Yrs. Date Prepared 3/7/81 Prepared by R. W. Fell

COSTS

1. Non-Recurring Initial Capital Costs:	
a. CME	\$ <u> 8,000 </u>
b. Design	\$ <u> 2,000 </u>
c. _____	\$ <u> 0 </u>
d. Total	\$ <u> 10,000 </u>

BENEFITS

2. Recurring Benefit/Cost Differential Other than Energy:	
a. Annual Labor Decrease (+)/Increase (-)	\$ <u> - 500 </u>
b. Annual Material Decrease (+)/Increase (-)	\$ <u> 0 </u>
c. Other Annual Decrease (+)/Increase (-)	\$ <u> 0 </u>
d. Total Costs	\$ <u> - 500 </u>
e. 10% Discount Factor	\$ <u> 9,524 </u>
f. Discounted Recurring Cost (d x e)	\$ <u> -4,750 </u>
3. Recurring Energy Benefit/Costs:	
a. Type of Fuel: <u> Oil </u>	
(1) Annual Energy Decrease (+)/Increase (-)	<u> 1,400 MBTU </u>
(2) Cost per MBTU	\$ <u> 11.19 </u>
(3) Annual Dollar Decrease/Increase ((1)x(2))	\$ <u> 15,670 </u>
(4) Differential Escalation Rate (8 %) Factor	<u> 20,015 </u>
(5) Discounted Dollar Decrease/Increase (3)x(4)	\$ <u> 313,550 </u>
b. Type of Fuel: <u> Electricity </u>	
(1) Annual Energy Decrease (+)/Increase (-)	<u> - 40,000 KWH* </u>
(2) Cost per KWH	\$ <u> 0.04 </u>
(3) Annual Dollar Decrease/Increase ((1)x(2))	\$ <u> - 1,600 </u>
(4) Differential Escalation Rate (7 %) Factor	<u> 18,049 </u>
(5) Discounted Dollar Decrease/Increase ((3)x(4))	\$ <u> - 28,800 </u>
c. Type of Fuel: <u> - </u>	
(1) Annual Energy Decrease (+)/Increase (-)	\$ _____
(2) Cost per MBTU	\$ _____
(3) Annual Dollar Decrease/Increase ((1)x(2))	\$ _____
(4) Differential Escalation Rate (- %) Factor	\$ _____
(5) Discounted Dollar Decrease/Increase ((3)x(4))	\$ _____
d. Discounted Energy Benefits (3a(5)+3b(5)+3c(5)+3d(5))	\$ <u> 284,750 </u>
4. Total Benefits (Sum 2f+3d)	\$ <u> 280,000 </u>
5. Discounted Benefit/Cost Ratio (Line 4/Line 1d)	<u> 28.0 </u>
6. Total Annual Energy Savings (3a(1)+3b(1)+3c(1))	<u> 936 MBTU </u>
7. E/C Ratio (Line 6 ÷ Line 1a/1000)	<u> 117 </u>
8. Annual \$ Savings (2d+3a(3)+3b(3)+3c(3))	\$ <u> 13,570 </u>
9. Pay-Back Period ((Line 1a - Salvage)÷Line 8)	<u> 0.60 Years </u>

*464 MBTU at generating station

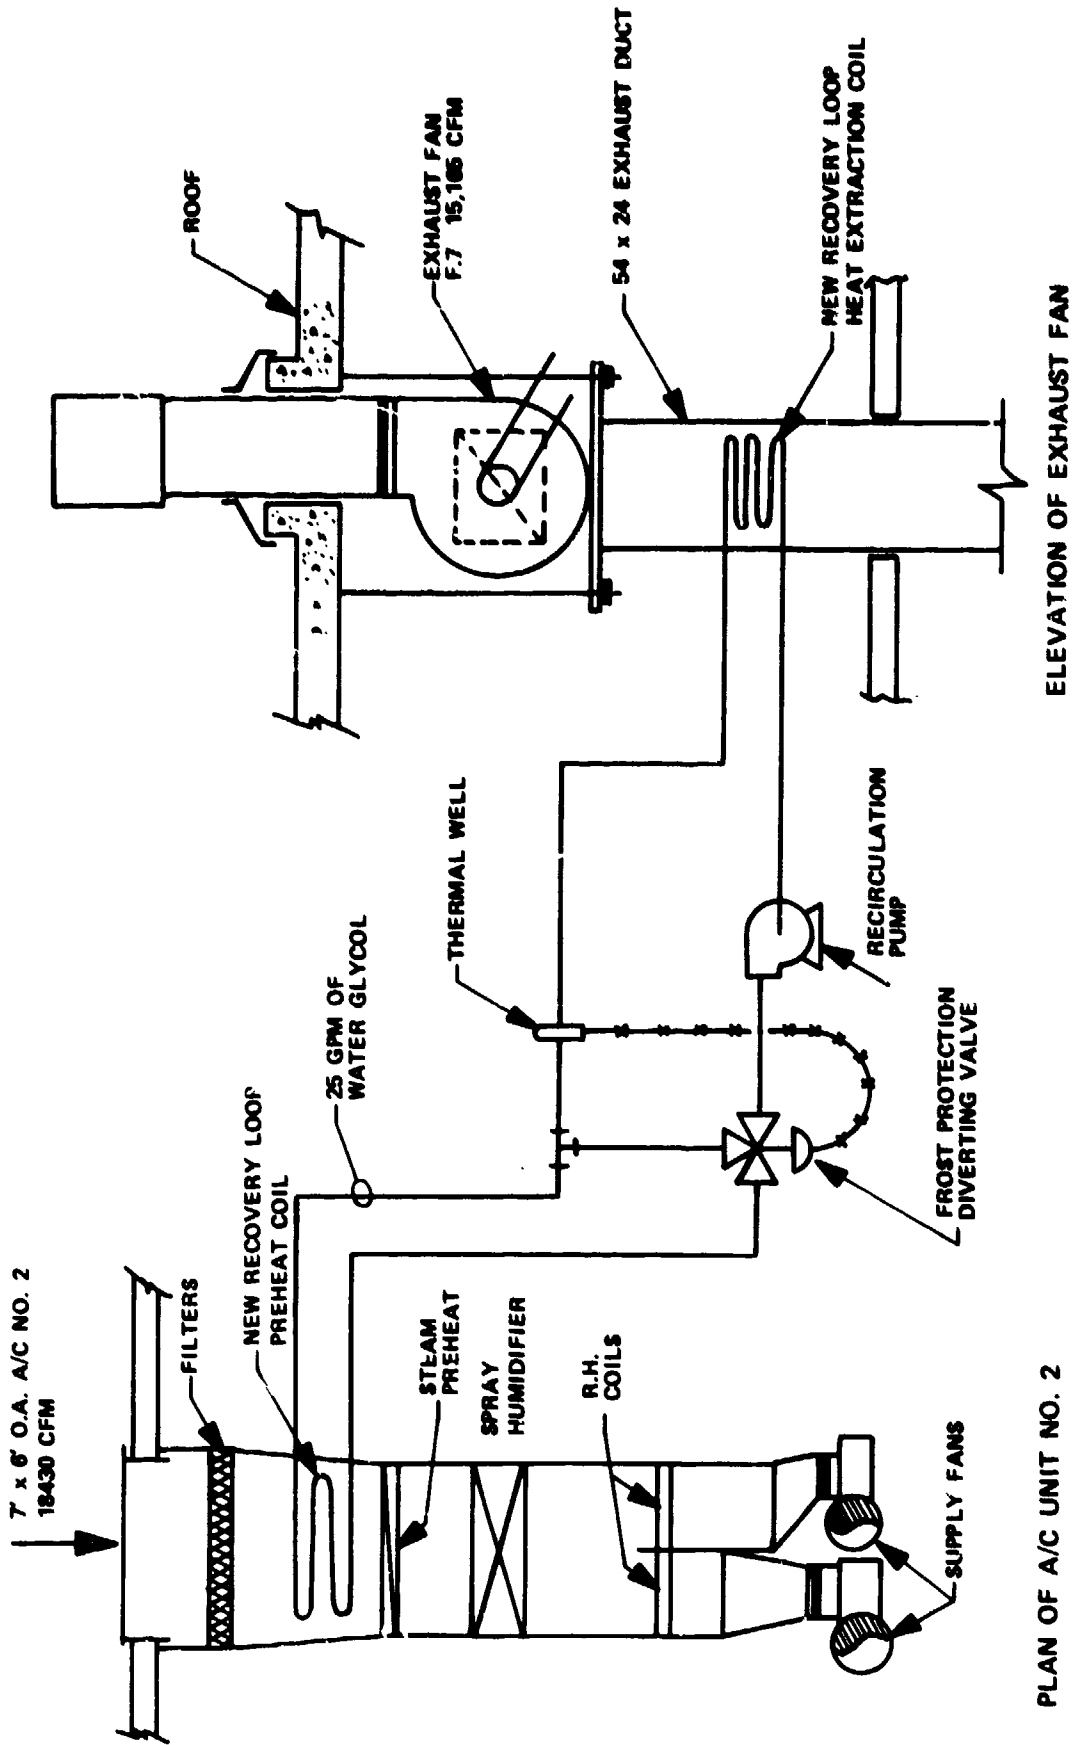


FIGURE 7
KIMBOROUGH ARMY HOSPITAL
HEAT RECOVERY COIL LOOP

ECONOMIC ANALYSIS SUMMARY

Location: Ft. Meade, Kimborough Army Hospital FY 1981
 Project: Install waste heat recovery loop between exhaust and intake
 ventilation ducts
 Economic Life 25 Yrs. Date Prepared 3/25/81 Prepared by R. W. Fell/G. Leiko

COSTS

1. Non-Recurring Initial Capital Costs:	
a. CWE	\$ 9,500
b. Design (6% of installed cost)	\$ 500
c. _____	\$ 0
d. Total	\$ 10,000

BENEFITS

2. Recurring Benefit/Cost Differential Other than Energy:	
a. Annual Labor Decrease (+)/Increase (-)	\$ - 500
b. Annual Material Decrease (+)/Increase (-)	\$ 0
c. Other Annual Decrease (+)/Increase (-)	\$ 0
d. Total Costs	\$ - 500
e. 10% Discount Factor	\$ 9.524
f. Discounted Recurring Cost (d x e)	\$ -4.750
3. Recurring Energy Benefit/Costs:	
a. Type of Fuel: Oil	
(1) Annual Energy Decrease (+)/Increase (-)	+ 760 MBTU
(2) Cost per MBTU	\$ 11.19
(3) Annual Dollar Decrease/Increase ((1)x(2))	\$ 8,360
(4) Differential Escalation Rate (8 %) Factor	20.050
(5) Discounted Dollar Decrease/Increase (3)x(4)	\$ 167.618
b. Type of Fuel: Electricity	
(1) Annual Energy Decrease (+)/Increase (-)	- 44,806* KWH
(2) Cost per KWH	\$ 0.04
(3) Annual Dollar Decrease/Increase ((1)x(2))	\$ 1,792
(4) Differential Escalation Rate (7 %) Factor	18.049
(5) Discounted Dollar Decrease/Increase ((3)x(4))	\$ -32,343
c. Type of Fuel: _____	
(1) Annual Energy Decrease (+)/Increase (-)	
(2) Cost per MBTU	
(3) Annual Dollar Decrease/Increase ((1)x(2))	
(4) Differential Escalation Rate (___ %) Factor	
(5) Discounted Dollar Decrease/Increase ((3)x(4))	
d. Discounted Energy Benefits (3a(5)+3b(5)+3c(5)+3d(5))	\$ 135.275
4. Total Benefits (Sum 2f+3d)	\$ 130,525
5. Discounted Benefit/Cost Ratio (Line 4/Line 1d)	13.0
6. Total Annual Energy Savings (3a(1)+3b(1)+3c(1))	240 MBTU
7. E/C Ratio (Line 6 ÷ Line 1a/1000)	25
8. Annual \$ Savings (2d+3a(3)+3b(3)+3c(3))	\$ 6,068
9. Pay-Back Period ((Line 1a - Salvage)÷Line 8)	1.6 Years

*520 MBTU at generating station

to consume an additional 3,000 KWhrs; also, the additional fan horsepower required to accommodate the added air pressure drop across the two heat exchangers is estimated to consume an additional 42,000 KWhrs. Therefore, the total additional electricity cost is estimated to be \$1792 per year and an additional 520 million BTUs of heat is required to generate the electricity. The net energy and cost savings for this heat recovery system is estimated to be 240 million BTUs and \$6068 per year.

The CWE for this heat recovery system is approximately \$9500 with a total estimated installed cost of \$10,000. Therefore, the simple payback time is approximately 1.6 years and the E/C ratio is estimated to be 25.

5.4 Additional Insulation to the Roof of the Old Hospital

By adding two-inches of additional insulation on top of the drop ceiling that exists beneath the roof of the old hospital an estimated savings of 370 million BTUs of heating energy will be realized. This translates to a cost savings of approximately \$4140 per year. The estimated installed cost for this insulation to cover the 37,764 ft² of ceiling area is approximately \$19,000. This yields a simple payback period of 4.6 years and a E/C ratio of approximately 19.6.

5.5 Repair of Leaking Condensate Return Sump Tank and Pumps for the New Addition

The condensate return tank and pumps serving the new addition are leaking approximately four gallons per hour of condensate return water. The leakage is estimated to result in an increase in makeup water of approximate 9600 gallons and an increase in heating energy of 9.6 million BTUs per heating season. The cost savings for fixing this leak is, therefore, estimated to be \$106 for fuel and \$29 for makeup water for a total of \$135 saved per heating season. No capital investment is required.

5.6 Repair Steam Leakage from the Domestic Hot Water System

Steam is leaking from the domestic hot water heaters at an estimated rate of approximately 5 pounds per hour. This leakage rate, if not fixed, will unnecessarily consume an additional 43.8 million BTUs of heating energy and approximately 5300 gallons of water each year. If the hot water system is repaired to stop the steam leakage, the annual cost savings estimated to be \$481 for heating oil and \$16 for makeup water for a total savings of \$497, could be realized. No capital investment is required.

6.0 ENERGY SAVINGS MODIFICATION WITH MODERATE ECONOMIC INCENTIVE

6.1 Additional Insulation to the Roof of the New Clinic without Fan Cycling

If the fan cycling modification presented in Section 5.1 is not incorporated, then adding insulation between the roof and drop ceiling of the new addition offers some merit. For example, adding four inches of blown insulation on top of the drop ceiling will save an estimated 540 million BTUs of heat during the winter and 47 million BTUs of cooling (i.e., 3443 KWhr). The net effect is annual cost savings of approximately \$5940 for heating and \$138 for cooling, totaling \$6078.

The estimated cost for blowing four inches of insulation on the top of the drop ceiling is \$28,000. Thus the simple payback is estimated to be 4.6 years, and the E/C ratio is estimated to be 20.7.

6.2 Additional Insulation to the Roof of the New Clinic with Fan Cycling

If the fan cycling control scheme as identified in Section 5.1 is incorporated, then the addition of more insulation in the drop ceiling has marginal economic incentive. For example, adding two inches of blown insulation will result in an incremental heating energy savings of 239 million BTUs but an additional air conditioning electrical consumption of 2420 KWhr. The incremental annual energy and cost savings for this case is, therefore, 21 million BTUs and approximately \$2500.

The estimated cost for installing the insulation on the ceiling is \$16,800. This yields a simple payback of approximately seven years and an E/C ratio of 12.5. These economic merit figures are considered marginally acceptable.

ECONOMIC ANALYSIS SUMMARY

Location: Ft. Meade, Kimborough Army Hospital FY 1981

Project: Adding 2" insulation to the roof of old hospital

Economic Life 25 Yrs. Date Prepared 3/25/81 Prepared by G. A. Lelko

COSTS

1. Non-Recurring Initial Capital Costs:

a. CWE	\$	19,000
b. Design	\$	0
c. _____	\$	0
d. Total	\$	19,000

BENEFITS

2. Recurring Benefit/Cost Differential Other than Energy:

a. Annual Labor Decrease (+)/Increase (-)	\$	0
b. Annual Material Decrease (+)/Increase (-)	\$	0
c. Other Annual Decrease (+)/Increase (-)	\$	0
d. Total Costs	\$	0
e. 10% Discount Factor	\$	0
f. Discounted Recurring Cost (d x e)	\$	0

3. Recurring Energy Benefit/Costs:

a. Type of Fuel: <u>Oil</u>		
(1) Annual Energy <u>Decrease (+)</u> /Increase (-)		+ 370 MBTU
(2) Cost per MBTU	\$	11.19
(3) Annual Dollar <u>Decrease</u> /Increase ((1)x(2))	\$	4,140
(4) Differential Escalation Rate (<u>8 %</u>) Factor		20.050
(5) Discounted Dollar <u>Decrease</u> /Increase (3)x(4)	\$	83,007
b. Type of Fuel: <u>Electricity</u>		
(1) Annual Energy <u>Decrease (+)</u> /Increase (-)		+ 271*KWH
(2) Cost per KWH	\$.04
(3) Annual Dollar <u>Decrease</u> /Increase ((1)x(2))	\$	10.84
(4) Differential Escalation Rate (<u>7 %</u>) Factor		18.049
(5) Discounted Dollar <u>Decrease</u> /Increase ((3)x(4))	\$	195.65
c. Type of Fuel: _____		
(1) Annual Energy Decrease (+)/Increase (-)		
(2) Cost per MBTU	\$	
(3) Annual Dollar Decrease/Increase ((1)x(2))	\$	
(4) Differential Escalation Rate (____%) Factor		
(5) Discounted Dollar Decrease/Increase ((3)x(4))	\$	
d. Discounted Energy Benefits (3a(5)+3b(5)+3c(5)+3d(5))	\$	83,202

4. Total Benefits (Sum 2f+3d)	\$	83,202
5. Discounted Benefit/Cost Ratio (Line 4/Line 1d)		4.38
6. Total Annual Energy Savings (3a(1)+3b(1)+3c(1))		373 MBTU
7. E/C Ratio (Line 6 ÷ Line 1a/1000)		19.6
8. Annual \$ Savings (2d+3a(3)+3b(3)+3c(3))	\$	4,150
9. Pay-Back Period ((Line 1a - Salvage)+Line 6)		4.6 Years

*3.14 MBTU at generating station

ECONOMIC ANALYSIS SUMMARY

Location: Ft. Meade Army Hospital FY 1981
 Project: Add 4" insulation to drop ceiling of new clinic
 Economic Life 25 Yrs. Date Prepared 3/7/81 Prepared by R.W. Fell

COSTS

1. Non-Recurring Initial Capital Costs:	
a. CWE	\$ <u>28,000</u>
b. Design	\$ <u>0</u>
c. _____	\$ <u>0</u>
d. Total	\$ <u>28,000</u>

BENEFITS

2. Recurring Benefit/Cost Differential Other than Energy:	
a. Annual Labor Decrease (+)/Increase (-)	\$ <u>0</u>
b. Annual Material Decrease (+)/Increase (-)	\$ <u>0</u>
c. Other Annual Decrease (+)/Increase (-)	\$ <u>0</u>
d. Total Costs	\$ <u>0</u>
e. 10% Discount Factor	\$ <u>0</u>
f. Discounted Recurring Cost (d x e)	\$ <u>0</u>
3. Recurring Energy Benefit/Costs:	
a. Type of Fuel: <u>Oil Heating</u>	
(1) Annual Energy <u>Decrease (+)</u> /Increase (-)	<u>540</u> MBTU
(2) Cost per MBTU	\$ <u>11</u> MBTU
(3) Annual Dollar <u>Decrease</u> /Increase ((1)x(2))	\$ <u>5,940</u>
(4) Differential Escalation Rate (<u>8</u> %) Factor	<u>20,050</u>
(5) Discounted Dollar <u>Decrease</u> /Increase (3)x(4)	\$ <u>119,100</u>
b. Type of Fuel: <u>Electricity</u>	
(1) Annual Energy <u>Decrease (+)</u> /Increase (-)	<u>3,443</u> KWHR*
(2) Cost per MBTU	\$ <u>.04</u>
(3) Annual Dollar <u>Decrease</u> /Increase ((1)x(2))	\$ <u>138</u>
(4) Differential Escalation Rate (<u>7</u> %) Factor	<u>18,049</u>
(5) Discounted Dollar <u>Decrease</u> /Increase ((3)x(4))	\$ <u>2,490</u>
c. Type of Fuel: <u>-</u>	
(1) Annual Energy Decrease (+)/Increase (-)	_____
(2) Cost per MBTU	\$ _____
(3) Annual Dollar Decrease/Increase ((1)x(2))	\$ _____
(4) Differential Escalation Rate (<u>-</u> %) Factor	_____
(5) Discounted Dollar Decrease/Increase ((3)x(4))	\$ _____
d. Discounted Energy Benefits (3a(5)+3b(5)+3c(5)+3d(5))	\$ <u>121,590</u>
4. Total Benefits (Sum 2f+3d)	\$ <u>121,590</u>
5. Discounted Benefit/Cost Ratio (Line 4/Line 1d)	<u>4.3</u>
6. Total Annual Energy Savings (3a(1)+3b(1)+3c(1))	<u>579</u> MBTU
7. E/C Ratio (Line 6 ÷ Line 1a/1000)	<u>20.7</u>
8. Annual \$ Savings (2d+3a(3)+3b(3)+3c(3))	\$ <u>6,078</u>
9. Pay-Back Period ((Line 1a - Salvage)÷Line 8)	<u>4.6</u> Years

*39 MBTU at generating station

ECONOMIC ANALYSIS SUMMARY

Location: Ft. Meade Army Hospital FY 1981
 Project: Install 2" of insulation with fan cycling for the
new addition clinic
 Economic Life 25 Yrs. Date Prepared 3/7/81 Prepared by R. W. Fell

COSTS

1. Non-Recurring Initial Capital Costs:

a. CWE	\$ 16,800
b. Design	\$ 0
c.	\$ 0
d. Total	\$ 16,800

BENEFITS

2. Recurring Benefit/Cost Differential Other than Energy:

a. Annual Labor Decrease (+)/Increase (-)	\$ 0
b. Annual Material Decrease (+)/Increase (-)	\$ 0
c. Other Annual Decrease (+)/Increase (-)	\$ 0
d. Total Costs	\$ 0
e. 10% Discount Factor	\$ 0
f. Discounted Recurring Cost (d x e)	\$ 0

3. Recurring Energy Benefit/Costs:

a. Type of Fuel: <u>Heating Oil</u>	
(1) Annual Energy <u>Decrease (+)</u> /Increase (-)	239 MBTU/Yr
(2) Cost per MBTU	\$ 11
(3) Annual Dollar <u>Decrease</u> /Increase ((1)x(2))	\$ 2,629
(4) Differential Escalation Rate (<u>8%</u>) Factor	20.05
(5) Discounted Dollar <u>Decrease</u> /Increase (3)x(4)	\$ 52,711
b. Type of Fuel: <u>Electricity</u>	
(1) Annual Energy Decrease (+) <u>Increase (-)</u>	- 2,420 KWHR*
(2) Cost per MBTU	\$.04
(3) Annual Dollar Decrease <u>Increase</u> ((1)x(2))	\$ - 100
(4) Differential Escalation Rate (<u>7%</u>) Factor	18.049
(5) Discounted Dollar Decrease <u>Increase</u> ((3)x(4))	\$ - 1,804
c. Type of Fuel: <u>-</u>	
(1) Annual Energy Decrease (+)/Increase (-)	
(2) Cost per MBTU	
(3) Annual Dollar Decrease/Increase ((1)x(2))	
(4) Differential Escalation Rate (<u>-%</u>) Factor	
(5) Discounted Dollar Decrease/Increase ((3)x(4))	
d. Discounted Energy Benefits (3a(5)+3b(5)+3c(5)+3d(5))	\$ 50,907
4. Total Benefits (Sum 2f+3d)	\$ 50,907
5. Discounted Benefit/Cost Ratio (Line 4/Line 1d)	3.03
6. Total Annual Energy Savings (3a(1)+3b(1)+3c(1))	211 MBTU
7. E/C Ratio (Line 6 ÷ Line 1a/1000)	12.5
8. Annual \$ Savings (2d+3a(3)+3b(3)+3c(3))	\$ 2,529
9. Pay-Back Period ((Line 1a - Salvage) ÷ Line 8)	6.6 Years

*28 MBTU at generating station

CALCULATIONS

CLIENT FESA	CALC. No. 5398-M-01
SUBJECT Install Microprocessor to Cycle Air Handling Fans on New Addition	

PROBLEM: Evaluate the merits of cycling the fans based on time of day, days per week, and temperature control for the new addition.	
CHECKER'S REMARKS:	

APPROACH/ASSUMPTIONS: DOE-2 computer runs were employed to evaluate the problem. Approximately 60 KW of fans are candidates for control.	
CHECKER'S REMARKS:	

SOURCES-DATA/EQUATIONS: Measured power consumption indicates a 70 KW steady load that could be controlled by a microprocessor	
CHECKER'S REMARKS:	

CONCLUSIONS. Heating energy saved \approx 1570 MBTU/Yr Electricity saved \approx 380,000 KW Hr/Yr Total energy saved \approx 5755 MBTU/Yr Annual \$ saved \approx \$32,780 E/C ratio \approx 480 Simple payback period \approx 4 Years	
CHECKER'S REMARKS:	

CALCULATED BY R. W. Fell	DATE 3/7/81
CHECKED BY G. A. Leiko	DATE 7/8/81

ED-501 (2/80)



DATE 3/7/81

CLIENT FESA FILE NO. 539B-M-01 BY R.W. FELL
SUBJECT KIMBOROUGH HOSPITAL ENERGY MGMT Checked By G.A. LELKO

PROBLEM:

EVALUATE THE MERITS OF CYCLING THE FANS IN THE NEW CLINIC BASED ON TIME OF DAY, DAYS PER WEEK AND TEMPERATURE CONTROL FOR THE NEW ADDITION.

SOLUTION:

BASED ON RESULTS OF DOE II Computer Run:

	HEATING 10 ⁶ BTU/YR	COOLING 10 ⁶ BTU/YR	ELECTRIC * ENERGY Kwh/YR
BASE	2680	1479	828535
w/ 2" Ceiling Insulation	2275	1446	.
w/ 4" Ceiling Insulation	2147	1432	
w/ 6" Ceiling Insulation	2079	1424	
Thermostatic Fan Reshad.	1111	922	662,649

* BASED ON 29 KW OF fan POWER

$$\text{HEATING ENERGY SAVED BY FAN CYCLING} = (2680 - 1111) \times 10^6 \text{ BTU/YR} \\ = 1569 \times 10^6 \text{ BTU/YR}$$

$$\text{COOLING ENERGY SAVED BY FAN CYCLING} = (1479 - 922) \times 10^6 \text{ BTU/YR} \\ = 557 \times 10^6 \text{ BTU/YR}$$

$$\text{ELECTRICITY SAVED IN COOLING} = \frac{557 \times 10^6 \text{ BTU/YR}}{4.4} \times \frac{1 \text{ KWH}}{3412 \text{ BTU}} = 37,101 \\ \approx 37,000 \text{ KWH/YR}$$

DATE 3/7/81

CLIENT FESA FILE NO. 5398-M-01 BY R.W. FELL
SUBJECT KIMBOROUGH Hospital Energy Audit Checked By G.A. LELAND

Electricity Saved via fans @ 29 kW =

$$(828,535 - 662,649) \text{ kWh/yr} = 165,886 \text{ kWh/yr}$$

It was later determined that the computer input of 29 kW for fan horsepower was incorrect and should have been 60 kW. Therefore the estimated electricity saved in fan horsepower is given by:

$$\text{Total Electricity Saved} = 165,886 \times \frac{60}{29} \approx 343,210 \text{ kWh}$$

The cost savings reflected by the above energy savings are given by:

Heating Oil Costs:

$$\frac{1569 \times 10^6 \text{ BTU/yr}}{.83} \times \frac{1 \text{ GAL}}{140,000 \text{ BTU}} \times \$1.30/\text{gal} = \$17,550/\text{yr}$$

where .83 is the estimated boiler efficiency and 140,000 BTU/gal is a typical heating value for No. 2 oil

Electricity Costs:

$$(37,000 + 343,210) \text{ kWh/yr} \times \$0.04/\text{kWh} =$$

$$380,210 \text{ kWh/yr} \times \$0.04/\text{kWh} = \$15,210/\text{yr}$$

TOTAL Cost Savings =

$$(\$17,550/\text{yr} + \$15,210/\text{yr}) = \$32,760/\text{yr}$$

ECONOMIC ANALYSIS SUMMARY

Location: Ft. Meade, Kimborough Army Hospital FY 1981
 Project: Install microprocessor to cycle air handling fans on
new addition
 Economic Life 10 Yrs. Date Prepared 3/7/81 Prepared by R. W. Fell

COSTS

1. Non-Recurring Initial Capital Costs:

a. CWE	\$	12,000
b. Design	\$	0
c.	\$	0
d. Total	\$	12,000

BENEFITS

2. Recurring Benefit/Cost Differential Other than Energy:

a. Annual Labor Decrease (+)/Increase (-)	\$	
b. Annual Material Decrease (+)/Increase (-)	\$	
c. Other Annual Decrease (+)/Increase (-)	\$	
d. Total Costs	\$	
e. 10% Discount Factor	\$	
f. Discounted Recurring Cost (d x e)	\$	

3. Recurring Energy Benefit/Costs:

a. Type of Fuel: Oil

(1) Annual Energy <u>Decrease (+)</u> /Increase (-)		1,570 MBTU
(2) Cost per MBTU	\$	11.19
(3) Annual Dollar <u>Decrease</u> /Increase ((1)x(2))	\$	17,570
(4) Differential Escalation Rate (<u>8%</u>) Factor		9.136
(5) Discounted Dollar <u>Decrease</u> /Increase (3)x(4)	\$	160,520

Type of Fuel: Electricity

(1) Annual Energy <u>Decrease (+)</u> /Increase (-)		380,210 KWH*
(2) Cost per KWH	\$	0.04
(3) Annual Dollar <u>Decrease</u> /Increase ((1)x(2))	\$	15,210
(4) Differential Escalation Rate (<u>7%</u>) Factor		8.737
(5) Discounted Dollar <u>Decrease</u> /Increase ((3)x(4))	\$	132,890

c. Type of Fuel: _____

(1) Annual Energy Decrease (+)/Increase (-)		
(2) Cost per MBTU	\$	
(3) Annual Dollar Decrease/Increase ((1)x(2))	\$	
(4) Differential Escalation Rate (<u> </u> %) Factor		
(5) Discounted Dollar Decrease/Increase ((3)x(4))	\$	

d. Discounted Energy Benefits (3a(5)+3b(5)+3c(5)+3d(5))

	\$	293,410
--	----	---------

4. Total Benefits (Sum 2f+3d)

	\$	293,410
--	----	---------

Discounted Benefit/Cost Ratio (Line 4/Line 1d)

		24.4
--	--	------

Total Annual Energy Savings (3a(1)+3b(1)+3c(1))

		5,755 MBTU
--	--	------------

E/C Ratio (Line 6 ÷ Line 1a/1000)

		480
--	--	-----

7. Annual \$ Savings (2d+3a(3)+3b(3)+3c(3))

	\$	32,780
--	----	--------

9. Pay-Back Period ((Line 1a - Salvage)÷Line 8)

		0.4 Years
--	--	-----------

*4,185 MBTU at generating station

CLIENT FESA	CALC. No. 5398-M-02
SUBJECT Induced Air Makeup System for Kimborough Army Hospital Kitchen	

PROBLEM: Evaluate merits of an induced air makeup system for the kitchen exhaust hoods at the Kimborough Army Hospital	
CHECKER'S REMARKS:	

APPROACH/ASSUMPTIONS: Non-conditioned air is introduced directly underneath the hoods to reduce the amount of conditioned air that would be exhausted out the building	
CHECKER'S REMARKS:	

SOURCES-DATA/EQUATIONS: See calculations	
CHECKER'S REMARKS:	

CONCLUSIONS: 936 MBTU are saved Expected cost savings ≈ \$13,570/Yr E/C ratio ≈ 117 Simple payback period ≈ 0.6 Year	
CHECKER'S REMARKS:	

CALCULATED BY R. W. Fell	DATE 3/7/81
CHECKED BY G. A. Lelko	DATE 7/8/81

ED-501 (2/80)



Page 1 of 2

DATE 3/7/81

CLIENT FESA FILE NO. 5398-M-02 BY BOB FELL
SUBJECT Kimborough Hospital Energy Audit Checked By GA. LELKO

PROBLEM: EVALUATE THE MERITS OF AN INDUCED AIR MAKEUP SYSTEM FOR THE KITCHEN EXHAUST HOOD AT THE KIMBOROUGH ARMY HOSPITAL

SOLUTION:

1. CONDITIONED AIR SAVED = 12000 CFM

2. HEATING ENERGY SAVED =

$$12000 \text{ CFM} \times 1.08 \frac{\text{BTU}}{\text{HR} \cdot \text{CFM}} \times 4200 \frac{\text{DEGREES}}{\text{SEASON}} \times 24 \frac{\text{HR}}{\text{DAY}}$$

$$\times 0.79 \times 1.36 = 1.4 \times 10^9 \text{ BTU/season SAVED}$$

where 0.79 = Heat Loss vs. Degree Day Interim factor (Co)

1.36 = Part Load Correction factor (Cf)

(Both Co and Cf are from ASHRAE modified Degree Day method, Ref 1976 ASHRAE SYSTEMS HANDBOOK)

3. COST Savings for Heating Oil

$$\frac{1.4 \times 10^9 \text{ BTU/season}}{140,000 \text{ BTU/GAL}} \times \frac{1}{.83} \times \$1.30/\text{GAL}$$

$$\$15,670/\text{yr}$$

4. Power Consumed by Fan

Approximately 10 HP will be required to drive the fans to circulate 12000 CFM

BECAUSE THE SYSTEM WILL FUNCTION ONLY IN WINTER, IT WILL BE ASSUMED TO RUN APPROXIMATELY 4000 HOURS/YR.



Page 2 of 2

DATE 3/7/81

CLIENT FESA FILE NO. 5398-M-02 BY R.W. FELL
SUBJECT Kimborough Hospital Energy Audit Checked By G.A. Lelko

Assuming motor efficiency of 75%, the electric power consumption for a 10 HP motor is estimated to be:

$$10 \text{ HP} \times \frac{746 \text{ WATTS}}{\text{HP}} \times \frac{1}{.75} \approx 10,000 \text{ WATTS}$$

THE ESTIMATED ELECTRIC ENERGY CONSUMED IS THEREFORE:

$$10,000 \text{ WATTS} \times 4000 \text{ HRS/yr} = 40,000 \text{ KWH/yr}$$

5. Cost of additional electricity consumed

$$\text{Cost} = 40,000 \text{ KWH/yr} \times \$0.04/\text{KWH} = \$1600/\text{yr}$$

6. Additional energy consumption required at generating station to produce the electricity:

$$\text{Energy} = 40,000 \text{ KWH/yr} \times 11600 \text{ BTU/KWH} = 4.64 \times 10^8 \text{ BTU/yr}$$

where 11,600 BTU/KWH is the assumed heat rate of the electric generating facility.

ECONOMIC ANALYSIS SUMMARY

Location: Ft. Meade, Kimborough Army Hospital FY 1981
 Project: Install induced air make-up system for kitchen exhaust hood

Economic Life 25 Yrs. Date Prepared 3/7/81 Prepared by R. W. Fell

COSTS

1. Non-Recurring Initial Capital Costs:	
a. CWE	\$ 8,000
b. Design	\$ 2,000
c.	\$ 0
d. Total	\$ 10,000

BENEFITS

2. Recurring Benefit/Cost Differential Other than Energy:	
a. Annual Labor Decrease (+)/Increase (-)	\$ - 500
b. Annual Material Decrease (+)/Increase (-)	\$ 0
c. Other Annual Decrease (+)/Increase (-)	\$ 0
d. Total Costs	\$ - 500
e. 10% Discount Factor	\$ 9,524
f. Discounted Recurring Cost (d x e)	\$ -4,750
3. Recurring Energy Benefit/Costs:	
a. Type of Fuel: <u>Oil</u>	
(1) Annual Energy Decrease (+)/Increase (-)	1,400 MBTU
(2) Cost per MBTU	\$ 11.19
(3) Annual Dollar Decrease/Increase ((1)x(2))	\$ 15,670
(4) Differential Escalation Rate (<u>8.8</u>) Factor	20,015
(5) Discounted Dollar Decrease/Increase (3)x(4)	\$ 313,550
b. Type of Fuel: <u>Electricity</u>	
(1) Annual Energy Decrease (+)/Increase (-)	- 40,000 KWH*
(2) Cost per KWH	\$ 0.04
(3) Annual Dollar Decrease/Increase ((1)x(2))	\$ - 1,600
(4) Differential Escalation Rate (<u>7.8</u>) Factor	18,049
(5) Discounted Dollar Decrease/Increase ((3)x(4))	\$ - 28,800
c. Type of Fuel: <u>-</u>	
(1) Annual Energy Decrease (+)/Increase (-)	
(2) Cost per MBTU	
(3) Annual Dollar Decrease/Increase ((1)x(2))	
(4) Differential Escalation Rate (<u>- 8</u>) Factor	
(5) Discounted Dollar Decrease/Increase ((3)x(4))	
d. Discounted Energy Benefits (3a(5)+3b(5)+3c(5)+3d(5))	\$ 264,750
4. Total Benefits (Sum 2f+3d)	\$ 280,000
5. Discounted Benefit/Cost Ratio (Line 4/Line 1d)	28.0
6. Total Annual Energy Savings (3a(1)+3b(1)+3c(1))	936 MBTU
7. E/C Ratio (Line 6 ÷ Line 1a/1000)	117
8. Annual \$ Savings (2d+3a(3)+3b(3)+3c(3))	\$ 13,570
9. Pay-Back Period ((Line 1a - Salvage)÷Line 8)	0.60 Years

*464 MBTU at generating station

CLIENT FESA	CALC. No. 5398-M-03
SUBJECT Waste Heat Recovery Loop - Kimborough Army Hospital	

PROBLEM: Evaluate a run-around ventilation exhaust to ventilation inlet heat recovery loop	
CHECKER'S REMARKS:	

APPROACH/ASSUMPTIONS: Computer code, DOE-2, was employed to predict the energy performance of the old hospital section with a waste heat recovery loop	
CHECKER'S REMARKS:	

SOURCES-DATA/EQUATIONS: Included with the calculations	
CHECKER'S REMARKS:	

CONCLUSIONS: Total energy saved \approx 240 MBTU Simple payback period \approx 1.6 Years E/C ratio \approx 25	
CHECKER'S REMARKS:	

CALCULATED BY R. W. Fell	DATE 3/25/81
CHECKED BY G. A. Lelko	DATE 7/8/81

ED-501 (2-80)

Page 1 of 8DATE 3/25/81CLIENT FESA FILE NO. 5398-M-03 BY R.W. FELL
SUBJECT KIMBOROUGH HOSPITAL ENERGY AUDIT Checked By G.A. LELKO

HEAT RECOVERY LOOP

1. ENERGY DIFFERENTIAL FROM HEAT RECOVERY LOOP,
-
- BASED UPON DOE-II COMPUTER RUNS.

	BASE CASE	W/HEAT RECOVERY LOOP
HEATING	12131 MBTU/yr	11372 MBTU/yr
COOLING	4758 MBTU/yr	4753 MBTU/yr

$$\text{HEATING ENERGY SAVED} = 12131 - 11372 = 759.9 \text{ MBTU/yr}$$

$$\text{COOLING ENERGY SAVED} = 4758 - 4753 = 5 \text{ MBTU/yr}$$

2. Power consumed by circulating water pump

- 2.1 Capacity of heat recovery loop

$$\dot{Q} \approx 760 \frac{\text{MBTU}}{\text{SEASON}} \times \frac{\text{SEASON}}{6 \text{ months}} \times \frac{\text{MONTH}}{30 \text{ DAYS}} \times \frac{\text{DAY}}{24 \text{ HRS.}} \times 2$$
$$\approx 351,800 \frac{\text{BTU}}{\text{hr}}$$


- 2.2 Circulating water pump flow rate

$$\dot{Q} = \dot{m} c_p \Delta T$$

$$\text{Assume } \Delta T = 65\text{F} - 32\text{F} = 33\text{F}$$

A-10

CLIENT FESA FILE NO. 5398-M-03 BY R.W. FELL
 SUBJECT Kimborough Hospital Energy Audit Checked By G.A. LELKO

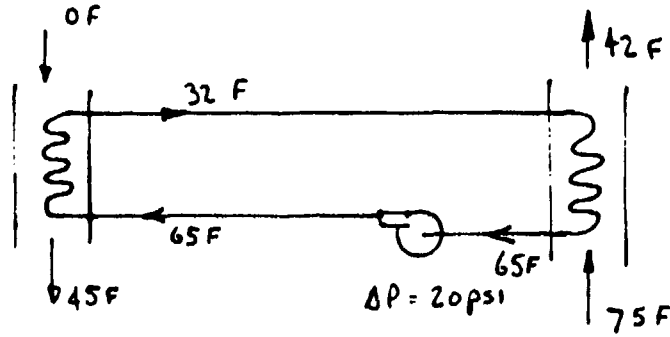

$$\dot{m} = \frac{351,800 \text{ BTU/HR}}{1 \frac{\text{BTU}}{\text{LB-F}} \times 33 \text{ F}} \times \frac{1 \text{ HR}}{60 \text{ MIN}} \times \frac{1 \text{ GAL}}{8.3 \text{ LB}} = 21.4 \text{ GM}$$

Assume the pump differential = 20psi

Then pump power =

$$\begin{aligned} \text{Power} &= \frac{\dot{m} \Delta P}{\rho} \\ &= \frac{21.4 \frac{\text{GAL}}{\text{HR}} \times 8.3 \frac{\text{LB}}{\text{GAL}}}{62.4 \frac{\text{LB}}{\text{FT}^3}} \times \frac{20 \frac{\text{LB}}{\text{IN}^2} \times 144 \frac{\text{IN}^2}{\text{FT}^2}}{60 \text{ SEC}} \\ &\times \frac{1 \text{ HP}}{550 \frac{\text{FT-LB}}{\text{SEC}}} \approx .25 \text{ HP} \end{aligned}$$

Assume a 1 horsepower motor is used to drive the pump.

Page 3 of 8DATE 3/25/01CLIENT FESA FILE NO. 5398-M-03 BY FELL
SUBJECT KIMBOROUGH HOSPITAL ENERGY AUDIT Checked By G.A. LELKO

The best recovery loop will operate approximately 4000 hrs per year. Therefore, pump motor energy consumption is given by:

$$\begin{aligned} E_{\text{pump}} &= 1 \text{ hp} \times 746 \frac{\text{WATTS}}{\text{hp}} \times 4000 \text{ hrs} \times \frac{1 \text{ kW}}{1000 \text{ WATTS}} = \\ &2984 \text{ kWh/yr} \end{aligned}$$

3. Additional fan power req'd to overcome added pressure loss:

$$\text{Power} = \dot{m} C_p \Delta T$$

3.1 Exhaust Fan

Exhaust Fan \approx 16000 CFM

$$\Delta T_{\text{across fan}} = T_1 \left(\frac{P_2}{P_1} \right)^{\frac{k-1}{k}} - T_1$$

where T_1 = FAN INLET Temp
 P_1 = FAN INLET Press
 P_2 = FAN OUTLET Press

Page 4 of 8DATE 3/25/81CLIENT FESA FILE NO. 5398-M-03 BY FELL
SUBJECT Kimborough Hospital ENERGY AUDIT Checked By GA. LELKO

FOR AN ADDITIONAL ΔP ADDED TO THE FAN DISCHARGE PRESSURE DUE TO THE INSERTION OF HEAT RECOVERY COILS, THE INCREMENTAL INCREASE IN DISCHARGE TEMPERATURE CAN BE ESTIMATED TO BE:

$$\Delta T_{\text{INCREASE}} \approx T_1 \left(\frac{P_2 + \Delta P}{P_1} \right)^{\frac{k-1}{k}} - T_1 \left(\frac{P_2}{P_1} \right)^{\frac{k-1}{k}}$$

ASSUME $P_1 = 14.3 \text{ psia}$

$$P_2 = P_1 + 7 \text{ IN-H}_2\text{O} = 14.3 \text{ psia} + \frac{7 \text{ IN-H}_2\text{O}}{27.6 \frac{\text{IN-H}_2\text{O}}{\text{PSIA}}}$$

($P_2 =$ FAN DISCHARGE PRESSURE BEFORE ADDING HEAT RECOVERY COILS)

$$P_3 = P_2 + \Delta P = \text{FAN DISCHARGE PRESSURE AFTER ADDING HEAT RECOVERY COILS}$$

ASSUME $\Delta P = 1 \text{ IN-H}_2\text{O}$
HEAT RECOVERY COILS

$$P_3 = 14.3 + \frac{7}{27.6} + \frac{1}{27.6} = (14.3 + \frac{8}{27.6}) \text{ PSIA}$$

$$T_1 = \text{FAN INLET TEMPERATURE} \approx 80 \text{ F} = 540 \text{ R}$$

$$\Delta T_{\text{INCR. ISENTROPIC}} = 540 \left(\frac{14.3 + \frac{8}{27.6}}{14.3} \right)^{\frac{1.4-1}{1.4}} - 540 \left(\frac{14.3 + \frac{7}{27.6}}{14.3} \right)^{\frac{1.4-1}{1.4}}$$

$$= 543.1 \text{ R} - 542.7 = .4 \text{ R}$$

Page 5 of 8DATE 3/25/81CLIENT FESA FILE NO. 5398-M-03 BY R.W. FELL
SUBJECT KIMBOROUGH HOSPITAL ENERGY AUDIT Checked By G.A. LELKO

INCREASE in isentropic Power =

$$\begin{aligned} \Delta P /_{\text{isentropic}} &= \dot{m} C_p \Delta T /_{\text{isentropic}} \\ &= 16000 \frac{\text{FT}^3}{\text{MIN}} \times 0.075 \frac{\text{LB}_m}{\text{FT}^3} \times 0.25 \frac{\text{BTU}}{\text{LB}_m \cdot \text{R}} \times 4 \text{R} \times \\ &\times \frac{1 \text{ WATT} \cdot \text{HR}}{3.412 \text{ BTU}} \times \frac{1 \text{ HP}}{746 \text{ WATTS}} \times 60 \frac{\text{MIN}}{\text{HR}} \end{aligned}$$

$$\Delta P /_{\text{isentropic}} = 2.83 \text{ hp}$$

Assume that the fan & motor together convert electric power to air flow with an efficiency of 65%. Then THE power demand of the motor WILL BE:

$$\frac{2.83 \text{ hp}}{.65} \times \frac{746 \text{ WATTS}}{\text{hp}} \approx 3282 \text{ WATTS}$$

The ENERGY consumed by continuous RUNNING will be given by:

$$\begin{aligned} \text{Energy} &= 3282 \text{ WATTS} \times 8760 \frac{\text{hrs}}{\text{YR}} \times \frac{1 \text{ KW}}{1000 \text{ WATTS}} \\ &= 28,750 \text{ KWHR/YR} \end{aligned}$$

Page 6 of 8DATE 3/25/81CLIENT FESA FILE NO. 5398-M-03 BY FELL
SUBJECT Kimborough Hospital Energy Audit Checked By L.ELKO

3.2 Supply Fan

BECAUSE of larger flow ACROSS THIS section, Assume the differential pressure ACROSS THE INLET HEAT RECOVERY COIL TO BE:

$$\Delta P_{\text{INLET}} = 0.5 \text{ in-H}_2\text{O}$$

$$\text{Supply Fan Flow} = 19000 \text{ FT}^3/\text{min}$$

$$\text{Power} = \dot{m} C_p \Delta T$$

$$\Delta T \left| \begin{array}{l} \text{increase in} \\ \text{Supply Fan} \\ \text{Discharge Temp} \end{array} \right. = T_1 \left(\frac{P_2 + \Delta P}{P_1} \right)^{\frac{K-1}{K}} - T_1 \left(\frac{P_2}{P_1} \right)^{\frac{K-1}{K}}$$

where P_1 = inlet pressure
 P_2 = Fan outlet pressure before
adding Recovery coil
 ΔP = pressure drop across Recovery
coil

$$\text{Assume: } T_1 = 60^\circ\text{F} = 460 + 60 = 520 \text{ R}$$

$$P_1 = 14.3 \text{ psia}$$

$$P_2 = 14.3 \text{ psia} + \frac{7}{27.6} \text{ psia}$$

$$\Delta P = 0.5 \text{ in-H}_2\text{O}$$

$$\Delta T = 520 \left(\frac{14.3 + \frac{7.5}{27.6}}{14.3} \right)^{\frac{1.4-1}{1.4}} - 520 \left(\frac{14.3 + \frac{7}{27.6}}{14.3} \right)^{\frac{1.4-1}{1.4}}$$

$$= 522.80 \text{ R} - 522.62 \text{ R} = .18 \text{ R}$$

CLIENT FESA FILE NO. 5398-M-03 BY FELL
 SUBJECT KIMBOROUGH HOSPITAL ENERGY AUDIT Checked By LELKO

Additional supply fan power is given by:

$$\Delta \text{ Power} \Big|_{\text{Isotropic}} = \dot{m} C_p \Delta T =$$

$$= 19000 \frac{\text{FT}^3}{\text{min}} \times 0.075 \frac{\text{LBM}}{\text{FT}^3} \times 0.24 \frac{\text{BTU}}{\text{LBM-R}} \times 1.18 \text{R} \times \frac{1 \text{ WATT-HR}}{3.412 \text{ BTU}}$$

$$\times \frac{1 \text{ hp}}{746 \text{ watt}} \times \frac{60 \text{ min}}{\text{hr}}$$

$$\Delta \text{ Power} \Big|_{\text{isotropic}} = 1.45 \text{ hp}$$

Assume 72% TOTAL FAN efficiency (motor plus fan) due to THE larger motor size. Then total increase in Electrical power will be approximately:

$$P_{\text{elec}} = \frac{1.45}{.72} \approx 2 \text{ hp}$$

Electric energy consumed =

$$2 \text{ hp} \times 746 \frac{\text{watts}}{\text{hp}} \times 8760 \frac{\text{hr}}{\text{yr}} = 13069 \text{ kWh}$$

4.0

Total Energy consumed by THE HEAT RECOVERY loop

Exhaust Fans	28753	kwh
Supply FANS	13069	kwh
Water Pump	2984	kwh

Total Energy Consumed 44806 kwh



Page 8 of 8

DATE 3/25/81

CLIENT FESA FILE NO. 5398-M-03 BY FELL
SUBJECT Kimborough Hospital Energy Audit Checked By LELKO

5. Electricity Cost

$$44806 \text{ kWh/yr} \times \$.04 / \text{kWh} = \$ 1792.20 / \text{yr}$$

6. Additional fuel required at the electric generating station:

$$\begin{aligned} \text{Fuel} &= 44,806 \text{ kWh/yr} \times 11600 \text{ BTU/kWh} \\ \text{Power Plant} & \\ &= 519.7 \text{ M BTU/yr} \end{aligned}$$

where: 11600 BTU/kWh is the assumed heat rate of the generating station.

ECONOMIC ANALYSIS SUMMARY

Location: Ft. Meade, Kimborough Army Hospital FY 1981
 Project: Install waste heat recovery loop between exhaust and intake
ventilation ducts
 Economic Life 25 Yrs. Date Prepared 3/25/81 Prepared by R. W. Fell/G.Lelko

COSTS

1. Non-Recurring Initial Capital Costs:	
a. CWE	\$ 9,500
b. Design (6% of installed cost)	\$ 500
c. _____	\$ 0
d. Total	\$ 10,000

BENEFITS

2. Recurring Benefit/Cost Differential Other than Energy:	
a. Annual Labor Decrease (+)/Increase (-)	\$ - 500
b. Annual Material Decrease (+)/Increase (-)	\$ 0
c. Other Annual Decrease (+)/Increase (-)	\$ 0
d. Total Costs	\$ - 500
e. 10% Discount Factor	\$ 9.524
f. Discounted Recurring Cost (d x e)	\$ -4,750
3. Recurring Energy Benefit/Costs:	
a. Type of Fuel: <u>Oil</u>	
(1) Annual Energy <u>Decrease (+)/Increase (-)</u>	+ 760 MBTU
(2) Cost per MBTU	\$ 11.19
(3) Annual Dollar <u>Decrease/Increase ((1)x(2))</u>	\$ 8,360
(4) Differential Escalation Rate (<u>8%</u>) Factor	20.050
(5) Discounted Dollar <u>Decrease/Increase ((3)x(4))</u>	\$ 167,618
b. Type of Fuel: <u>Electricity</u>	
(1) Annual Energy Decrease (+) <u>Increase (-)</u>	- 44,806* KWH
(2) Cost per KWH	\$ 0.04
(3) Annual Dollar Decrease <u>Increase ((1)x(2))</u>	\$ 1,792
(4) Differential Escalation Rate (<u>8%</u>) Factor	18.049
(5) Discounted Dollar Decrease <u>Increase ((3)x(4))</u>	\$ -32,343
c. Type of Fuel: _____	
(1) Annual Energy Decrease (+)/Increase (-)	
(2) Cost per MBTU	
(3) Annual Dollar Decrease/Increase ((1)x(2))	
(4) Differential Escalation Rate (<u> </u> %) Factor	
(5) Discounted Dollar Decrease/Increase ((3)x(4))	
d. Discounted Energy Benefits (3a(5)+3b(5)+3c(5)+3d(5))	\$ 135,275
4. Total Benefits (Sum 2f+3d)	\$ 130,525
5. Discounted Benefit/Cost Ratio (Line 4/Line 1d)	13.0
6. Total Annual Energy Savings (3a(1)+3b(1)+3c(1))	240 MBTU
7. E/C Ratio (Line 6 ÷ Line 1a/1000)	25
8. Annual \$ Savings (2d+3a(3)+3b(3)+3c(3))	\$ 6,068
9. Pay-Back Period ((Line 1a - Salvage)÷Line 8)	1.6 Years

*520 MBTU at generating station

CLIENT FESA	CALC. No. 5398-M-04
SUBJECT 2" Insulation to Ceiling of Old Section of Kimborough Army Hospital	

PROBLEM: Evaluate adding 2" of insulation to the top of the drop ceiling beneath the roof of the Kimborough Army Hospital (old section).	
CHECKER'S REMARKS:	

APPROACH/ASSUMPTIONS: DOE-2 computer runs were made to simulate the performance of the hospital before and after the insulation was added.	
CHECKER'S REMARKS:	

SOURCES-DATA/EQUATIONS: Area of the roof is 37764 Ft ²	
CHECKER'S REMARKS:	

CONCLUSIONS: Total energy saved ≈ 373 MBTU Simple payback period ≈ 4.6 Years E/C ratio ≈ 19.6	
CHECKER'S REMARKS:	

CALCULATED BY R. W. Fell	DATE 3/25/81
CHECKED BY G. A. Lelko	DATE 7/8/81

ED-501 (2/80)



DATE 3/25/81

CLIENT FESA FILE NO. 5398-M-04 BY R. W. FELL
SUBJECT KIMBOROUGH HOSPITAL ENERGY AUDIT Checked By G. A. LELKO

PROBLEM: EVALUATE THE ADDITION OF 2" INSULATION TO THE OF THE OLD HOSPITAL SECTION.

1. FROM DOE-II COMPUTER RUNS, THE FOLLOWING TABLE SUMMARIZES THE BEFORE AND AFTER HEATING AND COOLING LOADS.

	PRESENT (MBTU/YR)	AFTER ADDITION OF 2" INSULATION (MBTU/YR)	SAVINGS (MBTU/YR)
HEATING	12,131	11,761	370
COOLING	4753.3	4749.6	3.7

$$\text{HEAT ENERGY SAVED} = 370 \text{ MBTU}$$

$$\text{FUEL COST SAVING} = 370 \text{ MBTU} \times \$11.19/\text{MBTU} = \$4140$$

$$\text{Electricity Saved} = \frac{3.7 \times 10^6}{4} \times \frac{1}{3412} = 271 \text{ KWH/YR}$$

where

ϕ = Coefficient of performance of chiller

$$\text{FUEL SAVED AT GENERATING STATION} =$$

$$271 \text{ KWH/YR} \times 11600 \text{ BTU/KWH} =$$

$$3.14 \text{ MBTU/YR}$$



Page 2 of 2

DATE 3/25/81

CLIENT FESA FILE NO. 5398-M-04 BY R.W. FELL
SUBJECT Kimborough Hospital Energy Audit Checked By G.A. LELKO

2. CEILING AREA AND INSULATION COST

THE CEILING AREA = 37,764 FT², FROM DRAWINGS

THE INSTALLED COST FOR BLOWING IN APPROXIMATELY 2" OF INSULATION IS APPROXIMATELY \$.50/FT²

∴ THE ESTIMATED INSTALLED COST FOR ADDING 2" OF BLOWN INSULATION IS

$$\text{Cost} = 37764 \text{ FT}^2 \times \$.50 = \underline{\underline{\$19,000}}$$

ECONOMIC ANALYSIS SUMMARY

Location: Ft. Meade, Kimborough Army Hospital FY 1981
 Project: Adding 2" insulation to the roof of old hospital

 Economic Life 25 Yrs. Date Prepared 3/25/81 Prepared by G. A. Lelko

COSTS

1. Non-Recurring Initial Capital Costs:

a. CNE	\$	19,000
b. Design	\$	0
c.	\$	0
d. Total	\$	<u>19,000</u>

BENEFITS

2. Recurring Benefit/Cost Differential Other than Energy:

a. Annual Labor Decrease (+)/Increase (-)	\$	0
b. Annual Material Decrease (+)/Increase (-)	\$	0
c. Other Annual Decrease (+)/Increase (-)	\$	0
d. Total Costs	\$	0
e. 10% Discount Factor	\$	0
f. Discounted Recurring Cost (d x e)	\$	<u>0</u>

3. Recurring Energy Benefit/Costs:

a. Type of Fuel: <u>Oil</u>		
(1) Annual Energy <u>Decrease (+)</u> /Increase (-)		+ 370 MBTU
(2) Cost per MBTU	\$	11.19
(3) Annual Dollar <u>Decrease</u> /Increase ((1)x(2))	\$	4,140
(4) Differential Escalation Rate (<u>8%</u>) Factor		20.050
(5) Discounted Dollar <u>Decrease</u> /Increase (3)x(4)	\$	<u>83,007</u>
b. Type of Fuel: <u>Electricity</u>		
(1) Annual Energy <u>Decrease (+)</u> /Increase (-)		+ 271 KWH
(2) Cost per KWH	\$.04
(3) Annual Dollar <u>Decrease</u> /Increase ((1)x(2))	\$	10.84
(4) Differential Escalation Rate (<u>7%</u>) Factor		18.049
(5) Discounted Dollar <u>Decrease</u> /Increase ((3)x(4))	\$	<u>195.65</u>
c. Type of Fuel: _____		
(1) Annual Energy Decrease (+)/Increase (-)		
(2) Cost per MBTU	\$	
(3) Annual Dollar Decrease/Increase ((1)x(2))	\$	
(4) Differential Escalation Rate (____%) Factor		
(5) Discounted Dollar Decrease/Increase ((3)x(4))	\$	
d. Discounted Energy Benefits (3a(5)+3b(5)+3c(5)+3d(5))	\$	<u>83,202</u>
4. Total Benefits (Sum 2f+3d)	\$	<u>83,202</u>
5. Discounted Benefit/Cost Ratio (Line 4/Line 1d)		<u>4.38</u>
6. Total Annual Energy Savings (3a(1)+3b(1)+3c(1))		<u>373 MBTU</u>
7. E/C Ratio (Line 6 ÷ Line 1a/1000)		<u>19.6</u>
8. Annual \$ Savings (2d+3a(3)+3b(3)+3c(3))	\$	<u>4,150</u>
9. Pay-Back Period ((Line 1a - Salvage)÷Line 8)		<u>4.6 Years</u>

*3.14 MBTU at generating station

CLIENT FESA	CALC. No. 5398-M-05
SUBJECT Condensate Return Leak in New Addition	

PROBLEM: Estimate energy loss and cost for condensate return leakage in new clinic	
CHECKER'S REMARKS:	

APPROACH/ASSUMPTIONS: See attached sheet	
CHECKER'S REMARKS:	

SOURCES-DATA/EQUATIONS: See attached sheet	
CHECKER'S REMARKS:	

CONCLUSIONS: Energy loss ≈ 9.6 MBTU/Season Water loss ≈≈ 9600 Gal/Season Cost for fuel ≈≈ \$105.60/Season Cost for makeup water ≈ \$28.80/Season	
CHECKER'S REMARKS:	

CALCULATED BY R. W. Fell	DATE 3/25/81
CHECKED BY G. A. Lelko	DATE 7/8/81

ED-501 (2/80)

Page 1 of 1DATE 3/25/81CLIENT FESA FILE NO: 5378-M-05 BY R.W. FELL
SUBJECT KIMBOROUGH HOSPITAL ENERGY AUDIT Checked By G.A. LELKO

PROBLEM: Evaluate THE EFFECT OF REPAIRING THE
CONDENSATE LEAK IN THE NEW ADDITION

SOLUTION:

① Estimated quantity of water lost

LEAK rate \approx 4 gallon/hr (BY on-site estimate)

Heat Lost per season

$$Q = M C_p \Delta T$$

$$Q_{\text{condensate}} = 4 \text{ gal/hr} \times 8.3 \text{ LB/gal} \times 24 \frac{\text{hr}}{\text{day}} \times 100 \frac{\text{DAY}}{\text{SEASON}} \times (180-60) \text{ F} \times 1 \frac{\text{BTU}}{\text{LB-F}}$$

where $(180-60) =$ STEAM TEMPERATURE MINUS MAKEUP
WATER TEMPERATURE

$$Q_{\text{condensate}} = 9.56 \times 10^6 \text{ BTU/season}$$

$$\text{FUEL COST} = 9.56 \times 10^6 \text{ BTU/season} \times \$11/10^6 \text{ BTU} = \$105.60/\text{season}$$

② QUANTITY OF MAKEUP WATER

$$4 \text{ gal/hr} \times 24 \text{ hr/day} \times 100 \text{ DAY/SEASON} = 9600 \text{ gal/season}$$

COST FOR MAKEUP WATER (@ \$3/1000 gal)

$$= 9600 \text{ gal} \times \$3/1000 \text{ gal} = \$28.80/\text{season}$$

CLIENT FESA	CALC. No. 5398-M-06
SUBJECT Steam Leakage at Kimborough Army Hospital	

PROBLEM: Evaluate the energy loss associated with observed steam leakage in the hot water heating system.	
CHECKER'S REMARKS:	

APPROACH/ASSUMPTIONS: See attached sheet	
CHECKER'S REMARKS:	

SOURCES-DATA/EQUATIONS: See attached sheet	
CHECKER'S REMARKS:	

CONCLUSIONS: Energy loss \approx 43.8 MBTU/Yr Makeup water \approx 5290 Gal/Yr Energy cost \approx \$481/Yr	
CHECKER'S REMARKS:	

CALCULATED BY R. W. Fell	DATE 3/25/81
CHECKED BY G. A. Lelko	DATE 7/8/81

ED-901 (2/80)

Page 1 of 1DATE 3/25/81CLIENT FESA FILE NO. 5398-M-06 BY R.W. FELL
SUBJECT KIMBORDUGH HOSPITAL ENERGY AUDIT Checked By GA LELKO

PROBLEM: EVALUATE THE EFFECT OF OBSERVED STEAM LEAKAGE FROM THE HOT WATER HEATING SYSTEM IN THE HOSPITAL BASEMENT.

ESTIMATED LEAKAGE = 5 LB/HR (BY OBSERVATION)

$$\textcircled{1} \text{ HEAT LOST} = 5 \text{ LB/HR} \times 1000 \frac{\text{BTU}}{\text{LB}} \times 8760 \text{ HR/YR} \\ = 43.8 \times 10^6 \text{ BTU/YR}$$

$$\text{Cost of HEAT LOST} = 43.8 \times 10^6 \text{ BTU/YR} \times \$11/10^6 \text{ BTU} \\ = \$481/\text{YR}$$

$$\textcircled{2} \text{ MAKEUP WATER} = 5 \text{ LB/HR} \times 8760 \text{ HR/YR} \times \frac{1 \text{ GAL}}{8.3 \text{ LB}} \\ = 5290 \text{ GAL/YR}$$

$$\text{Cost of MAKEUP WATER (@ } \$3/1000 \text{ GAL)} \\ = 5290 \text{ GAL} \times \$3/1000 \text{ GAL} \\ \approx \$16/\text{YEAR}$$

CLIENT FESA	CALC. No. 5398-M-07
SUBJECT Add 4" Insulation to Drop Ceiling of New Clinic	

PROBLEM: Evaluate adding 4" of insulation to the top of the drop ceiling beneath the roof of the new clinic section of the Kimborough Army Hospital	
CHECKER'S REMARKS:	

APPROACH/ASSUMPTIONS: DOE-2 computer runs were made to simulate the performance of the hospital before and after the insulation was added	
CHECKER'S REMARKS:	

SOURCES-DATA/EQUATIONS: Area of the roof is approximately 56,000 Ft ² based on review of drawings	
CHECKER'S REMARKS:	

CONCLUSIONS: Total energy saved \approx 579 MBTU E/C ratio \approx 20.7 Simple payback period \approx 4.6 Years	
CHECKER'S REMARKS:	

CALCULATED BY R. W. Lell	DATE 3/7/81
CHECKED BY G. A. Lelko	DATE 7/8/81

ED-501 (2/80)

CLIENT FESA FILE NO. 5398-M-07 BY R.W.FELL
SUBJECT Kimborough Hospital Energy Audit Checked By G.A.LELKO

PROBLEMS: EVALUATE THE ADDITION OF INSULATION TO THE SPACE ABOVE THE DROP CEILING IN THE NEW CLINIC

SOLUTION:
HEATING AND COOLING DEMANDS: FROM THE RESULTS OF DOE-II COMPUTER RUNS, THE FOLLOWING HEATING AND COOLING CHARACTERISTICS ARE PREDICTED:

	Present (MBtu/yr)	After Addition of 4" INSULATION (MBtu/yr)	Energy Savings (MBtu/yr)
HEATING	2680	2147	~ 540
COOLING	1474	1432	~ 47

$$\text{Cost Savings for heating} = 540 \text{ MBtu/yr} \times \$11/\text{MBtu} = \$5940$$

$$\text{Cooling Electricity Saved} = \frac{47 \times 10^6 \text{ BTU}}{4} \times \frac{1 \text{ kWh}}{3412 \text{ BTU}} = 3443 \frac{\text{kWh}}{\text{yr}}$$

where 4 = COP OF CHILLER

$$\text{Cost Savings for Electricity} = 3443 \text{ kWh} \times \$0.04/\text{kWh} = \$138$$

ENERGY SAVED AT THE Electric POWER GENERATION station =

$$3443 \text{ kWh/yr} \times 11600 \text{ BTU/kWh} = 39 \times 10^6 \text{ BTU/yr}$$

where

$$11,600 \text{ BTU/kWh} = \text{ASSUMED HEAT RATE OF GENERATING STATION}$$



Page 2 of 2

DATE 3/7/81

CLIENT FESA FILE NO. 5398-M-07 BY R.W. FELL

SUBJECT Kimborough Hospital Energy Audit Checked By G.A. LELKO

ESTIMATED COST FOR INSTALLING BLOWN INSULATION
IN DROP CEILING IN NEW ADDITION.

Area of drop ceiling $\approx 56,000 \text{ FT}^2$

The estimated cost for installing blown
INSULATION is $\$.50/\text{FT}^2$. Therefore the
INSTALLED COST for the INSULATION is estimated
TO BE: $\$$

$$\text{COST} = 56,000 \text{ FT}^2 \times \$.50/\text{FT}^2 = \$28,000$$

ECONOMIC ANALYSIS SUMMARY

Location: Ft. Meade Army Hospital FY 1981
 Project: Add 4" insulation to drop ceiling of new clinic
 Economic Life 25 Yrs. Date Prepared 3/7/81 Prepared by R.W. Fell

COSTS

1. Non-Recurring Initial Capital Costs:	
a. CWE	\$ 28,000
b. Design	\$ 0
c.	\$ 0
d. Total	\$ 28,000

BENEFITS

2. Recurring Benefit/Cost Differential Other than Energy:	
a. Annual Labor Decrease (+)/Increase (-)	\$ 0
b. Annual Material Decrease (+)/Increase (-)	\$ 0
c. Other Annual Decrease (+)/Increase (-)	\$ 0
d. Total Costs	\$ 0
e. 10% Discount Factor	\$ 0
f. Discounted Recurring Cost (d x e)	\$ 0
3. Recurring Energy Benefit/Costs:	
a. Type of Fuel: <u>Oil Heating</u>	
(1) Annual Energy <u>Decrease (+)</u> /Increase (-)	540 MBTU
(2) Cost per MBTU	\$ 11 MBTU
(3) Annual Dollar <u>Decrease</u> /Increase ((1)x(2))	\$ 5,940
(4) Differential Escalation Rate (<u>8 %</u>) Factor	20,050
(5) Discounted Dollar <u>Decrease</u> /Increase (3)x(4)	\$ 119,100
b. Type of Fuel: <u>Electricity</u>	
(1) Annual Energy <u>Decrease (+)</u> /Increase (-)	3,443 KWHR*
(2) Cost per MBTU	\$.04
(3) Annual Dollar <u>Decrease</u> /Increase ((1)x(2))	\$ 138
(4) Differential Escalation Rate (<u>7 %</u>) Factor	18,049
(5) Discounted Dollar <u>Decrease</u> /Increase ((3)x(4))	\$ 2,490
c. Type of Fuel: <u>-</u>	
(1) Annual Energy Decrease (+)/Increase (-)	\$
(2) Cost per MBTU	\$
(3) Annual Dollar Decrease/Increase ((1)x(2))	\$
(4) Differential Escalation Rate (<u>- %</u>) Factor	\$
(5) Discounted Dollar Decrease/Increase ((3)x(4))	\$
d. Discounted Energy Benefits (3a(5)+3b(5)+3c(5)+3d(5))	\$ 121,590
4. Total Benefits (Sum 2f+3d)	\$ 121,590
5. Discounted Benefit/Cost Ratio (Line 4/Line 1d)	4.3
6. Total Annual Energy Savings (3a(1)+3b(1)+3c(1))	579 MBTU
7. E/C Ratio (Line 6 ÷ Line 1a/1000)	20.7
8. Annual \$ Savings (2d+3a(3)+3b(3)+3c(3))	\$ 6,078
9. Pay-Back Period ((Line 1a - Salvage) ÷ Line 8)	4.6 Years

*39 MBTU at generating station

CLIENT	FESA	CALC. No.	5398-M-08
SUBJECT	Install 2" of Insulation with Fan Cycling for New Addition of Kimborough Army Hospital		

PROBLEM:	
Evaluate the merits of adding 2" of insulation to the roof of the new addition if it already has installed the fan cycling control scheme	
CHECKER'S REMARKS:	

APPROACH/ASSUMPTIONS:	
DOE-2 computer runs were made to simulate the performance of the new addition with fan cycling before and after 2 inches of insulation was added	
CHECKER'S REMARKS:	

SOURCES-DATA/EQUATIONS:	
Area of roof for new addition is approximately 56,000 Ft ² based on review of drawings.	
CHECKER'S REMARKS:	

CONCLUSIONS:	
Total energy saved % 211 MBTU	
Simple payback period % 6.6 Years	
E/C ratio % 12.5	
CHECKER'S REMARKS:	

CALCULATED BY	DATE
R. W. Fell	3/7/81
CHECKED BY	DATE
G. A. Lelko	7/8/81

ED-901 (2/80)



Page 1 of 2

DATE 3/7/81

CLIENT FESA FILE NO. 5398-M-08 BY R.W.FELL

SUBJECT KIMBOROUGH HOSPITAL ENERGY AUDIT Checked By CA LELKO

PROBLEM: EVALUATE THE EFFECT OF ADDING 2" ADDITIONAL INSULATION TO THE ROOF OF THE NEW CLINIC IF THE FAN CYCLING SYSTEM SUGGESTED IN PROJECT NO. 1 IS EMPLOYED.

SOLUTION: THE FOLLOWING HEATING AND COOLING DEMANDS FOR THE NEW ADDITION WERE PREDICTED BY THE DOE-II COMPUTER CODE.

	FAN CYCLING ONLY (MBTU/YR)	FAN CYCLING W/ 2" INSULATION (MBTU/YR)	ENERGY SAVINGS (MBTU/YR)
HEATING	1111	872	239
COOLING	922	955	-33

ADDITIONAL ELECTRICITY CONSUMED =

$$\frac{-33 \times 10^6 \text{ BTU/YR}}{4} \times \frac{1 \text{ Kwhe}}{3412 \text{ BTU}} = -2420 \text{ Kwhe/YR}$$

ADDITIONAL FUEL CONSUMED AT GENERATING STATION

$$2420 \text{ Kwhe} \times 11600 \text{ BTU/KWHR} = 28 \text{ MBTU/YR}$$

$$\text{TOTAL ENERGY SAVED} = 239 \text{ MBTU/YR} - 28 \text{ MBTU/YR} = 211 \text{ MBTU/YR}$$



Page 2 of 2

DATE 3/7/81

CLIENT FESA FILE NO. 5398-M-08 BY RW FELL

SUBJECT KIMBOROUGH Hospital ENERGY AUDIT Checked By GA LELKO

THE INSTALLED COST FOR BLOWING 2" INSULATION INTO THE CEILING AREA IS ESTIMATED AS FOLLOWS:

AREA OF CEILING = 56000 FT²

ESTIMATED COST PER SQUARE FOOT IS \$.30/FT². THEREFORE THE TOTAL ESTIMATED INSTALLED COST IS:

$$\text{COST} = 56,000 \text{ FT}^2 \times \$.30/\text{FT}^2 = \$16,800$$

ECONOMIC ANALYSIS SUMMARY

Location: Ft. Meade Army Hospital FY 1981
 Project: Install 2" of insulation with fan cycling for the
new addition clinic
 Economic Life 25 Yrs. Date Prepared 3/7/81 Prepared by R. W. Fall

COSTS

1. Non-Recurring Initial Capital Costs:	
a. CWE	\$ <u>16,800</u>
b. Design	\$ <u>0</u>
c. _____	\$ <u>0</u>
d. Total	\$ <u>16,800</u>

BENEFITS

2. Recurring Benefit/Cost Differential Other than Energy:	
a. Annual Labor Decrease (+)/Increase (-)	\$ <u>0</u>
b. Annual Material Decrease (+)/Increase (-)	\$ <u>0</u>
c. Other Annual Decrease (+)/Increase (-)	\$ <u>0</u>
d. Total Costs	\$ <u>0</u>
e. 10% Discount Factor	\$ <u>0</u>
f. Discounted Recurring Cost (d x e)	\$ <u>0</u>
3. Recurring Energy Benefit/Costs:	
a. Type of Fuel: <u>Heating Oil</u>	
(1) Annual Energy <u>Decrease (+)</u> /Increase (-)	<u>239</u> MBTU/Yr
(2) Cost per MBTU	\$ <u>11</u>
(3) Annual Dollar <u>Decrease</u> /Increase ((1)x(2))	\$ <u>2,629</u>
(4) Differential Escalation Rate (<u>8%</u>) Factor	<u>20.05</u>
(5) Discounted Dollar <u>Decrease</u> /Increase (3)x(4)	\$ <u>52,711</u>
b. Type of Fuel: <u>Electricity</u>	
(1) Annual Energy Decrease (+) <u>Increase (-)</u>	<u>- 2,420</u> KWHR*
(2) Cost per MBTU	\$ <u>.04</u>
(3) Annual Dollar Decrease/ <u>Increase</u> ((1)x(2))	\$ <u>- 100</u>
(4) Differential Escalation Rate (<u>7%</u>) Factor	<u>18.049</u>
(5) Discounted Dollar Decrease/ <u>Increase</u> ((3)x(4))	\$ <u>- 1,804</u>
c. Type of Fuel: <u>-</u>	
(1) Annual Energy Decrease (+)/Increase (-)	\$ _____
(2) Cost per MBTU	\$ _____
(3) Annual Dollar Decrease/Increase ((1)x(2))	\$ _____
(4) Differential Escalation Rate (<u>- 8%</u>) Factor	_____
(5) Discounted Dollar Decrease/Increase ((3)x(4))	\$ _____
d. Discounted Energy Benefits (3a(5)+3b(5)+3c(5)+3d(5))	\$ <u>50,907</u>
4. Total Benefits (Sum 2f+3d)	\$ <u>50,907</u>
5. Discounted Benefit/Cost Ratio (Line 4/Line 1d)	<u>3.03</u>
6. Total Annual Energy Savings (3a(1)+3b(1)+3c(1))	<u>211</u> MBTU
7. E/C Ratio (Line 6 ÷ Line 1a/1000)	<u>12.5</u>
8. Annual \$ Savings (2d+3a(3)+3b(3)+3c(3))	\$ <u>2,529</u>
9. Pay-Back Period ((Line 1a - Salvage) ÷ Line 8)	<u>6.6</u> Years

*28 MBTU at generating station

US Military Academy
ATTN: Dept of Mechanics
West Point, NY 10996

US Military Academy
ATTN: Library
West Point, NY 10996

HQDA (DALO-TSE-F)
WASH DC 20314

HQDA (DAEN-ASI-L) (2)
WASH DC 20314

HQDA (DAEN-MPO-B)
WASH DC 20314

HQDA (DAEN-MPR-A)
WASH DC 20314

HQDA (DAEN-MPO-U)
WASH DC 20314

HQDA (DAEN-MPZ-A)
WASH DC 20314

HQDA (DAEN-MPZ-E)
WASH DC 20314

HQDA (DAEN-MPZ-G)
WASH DC 20314

HQDA (DAEN-RDM)
WASH DC 20314

HQDA (DAEN-RDL)
WASH DC 20314

Director, USA-WES
ATTN: Library
P.O. Box 631
Vicksburg, MS 39181

Commander, TRADOC
Office of the Engineer
ATTN: ATEN
Ft. Monroe, VA 23651

Commander, TRADOC
Office of the Engineer
ATTN: ATEN-FE-U
Ft Monroe, VA 23651

AF Civil Engr Center/XRL
Tyndall AFB, FL 32401

Naval Facilities Engr Command
ATTN: Code 04
200 Stovall St.
Alexandria, VA 22332

Defense Documentation Center
ATTN: TCA (12)
Cameron Station
Alexandria, VA 22314

Commander and Director
USA Cold Regions Research Engineering
Laboratory
Hanover, NH 03755

FORSCOM
ATTN: AFEN
Ft McPherson, GA 30330

FORSCOM
ATTN: AFEN-FE
Ft McPherson, GA 30330

Officer-in-Charge
Civil Engineering Laboratory
Naval Construction Battalion Center
ATTN: Library (Code LO8A)
Port Hueneme, CA 93043

Commander and Director
USA Construction Engineering
Research Laboratory
P.O. Box 4005
Champaign, IL 61820

Commanding General, 3d USA
ATTN: Engineer
Ft. McPherson, GA 30330

DIST 1

Commanding General, 5th USA
ATTN: Engineer
Ft Sam Houston, TX 78234

AFCE Center
Tyndall AFB, FL 32403

Commander, DARCOM
Director, Installation
and Services
5001 Eisenhower Ave.
Alexandria, VA 22333

Commander, DARCOM
ATTN: Chief, Engineering Div.
5001 Eisenhower Ave
Alexandria, VA 22333

Air Force Weapons Lab/AFWL/DE
Chief, Civil Engineering
Research Division
Kirtland AFB, NM 87117

Strategic Air Command
ATTN: DSC/CE (DEEE)
Offutt AFB, NE 68112

Headquarters USAF
Directorate of Civil Engineering
AF/PREES
Bolling AFB, Washington, DC 20333

Strategic Air Command
Engineering
ATTN: Ed Morgan
Offutt AFB, NE 68113

USAF Institute of Technology
AFIT/DED
Wright Patterson AFB, OH 45433

Air Force Weapons Lab
Technical Library (DOUL)
Kirtland AFB, NM 87117

Chief, Naval Facilities
Engineer Command
ATTN: Chief Engineer
Department of the Navy
Washington, DC 20350

Commander
Naval Facilities Engineering Cnd
200 Stovall St
Alexandria, VA 22332

Commander
Naval Facilities Engr Cnd
Western Division
Box 727
San Bruno, CA 94066

Civil Engineering Center
ATTN: Moreell Library
Port Hueneme, CA 93043

Commandant of the Marine Corps
HQ, US Marine Corps
Washington, DC 20380

National Bureau of Standards (4)
Materials & Composites Section
Center for Building Technology
Washington, DC 20234

Assistant Chief of Engineer
Rm 1E 668, Pentagon
Washington, DC 20310

The Army Library (ANRAL-R)
ATTN: Army Studies Section
Room 1A 518, The Pentagon
Washington, DC 20310

Commander-in-Chief
USA, Europe
ATTN: AEAEN
APO New York, NY 09403

DIST 2

Commander
USA Foreign Science and
Technology Center
220 8th St. N.E.
Charlottesville, VA 22901

Commander
USA Science & Technology
Information Team, Europe
APO New York, NY 09710

Commander
USA Science & Technology
Center - Far East Office
APO San Francisco, CA 96328

Commanding General
USA Engineer Command, Europe
APO New York, NY 09403

Deputy Chief of Staff
for Logistics
US Army, The Pentagon
Washington, DC 20310

Commander, TRADOC
Office of the Engineer
ATTN: Chief, Facilities
Engineering Division
Ft Monroe, VA 23651

Commanding General
USA Forces Command
Office of the Engineer
(AFEN-FES)
Ft McPherson, GA 30330

Commanding General
USA Forces Command
ATTN: Chief, Facilities
Engineering Division
Ft McPherson, GA 30330

Commanding General, 1st USA
ATTN: Engineer
Ft George G. Meade, MD 20755

Commander
USA Support Command, Hawaii
Fort Shafter, HI 96858

Commander
Eighth US Army
APO San Francisco 96301

Commander
US Army Facility Engineer
Activity - Korea
APO San Francisco 96301

Commander
US Army, Japan
APO San Francisco, CA 96343

Facilities Engineer
Fort Belvoir
Fort Belvoir, VA 22060

Facilities Engineer
Fort Benning
Fort Benning, GA 31905

Facilities Engineer
Fort Bliss
Fort Bliss, TX 79916

Facilities Engineer
Carlisle Barracks
Carlisle Barracks, PA 17013

Facilities Engineer
Fort Chaffee
Fort Chaffee, AR 72902

Facilities Engineer
Fort Dix
Fort Dix, NJ 08640

Facilities Engineer
Fort Eustis
Fort Eustis, VA 23604

Facilities Engineer
Fort Gordon
Fort Gordon, GA 30905

Facilities Engineer
Fort Hamilton
Fort Hamilton, NY 11252

Facilities Engineer
Fort A P Hill
Bowling Green, VA 22427

Facilities Engineer
Fort Jackson
Fort Jackson, SC 29207

Facilities Engineer
Fort Knox
Fort Knox, KY 40121

Facilities Engineer
Fort Lee
Fort Lee, VA 23801

Facilities Engineer
Fort McClellan
Fort McClellan, AL 36201

Facilities Engineer
Fort Monroe
Fort Monroe, VA 23651

Facilities Engineer
Presidio of Monterey
Presidio of Monterey, CA 93940

Facilities Engineer
Fort Pickett
Blackstone, VA 23824

Facilities Engineer
Fort Rucker
Fort Rucker, AL 36362

Facilities Engineer
Fort Sill
Fort Sill, OK 73503

Facilities Engineer
Fort Story
Fort Story, VA 23459

Facilities Engineer
Kansas Army Ammunition Plant
Parsons, KS 67357

Facilities Engineer
Lone Star Army Ammunition Plant
Texarkana, TX 75501

Facilities Engineer
Picatinny Arsenal
Dover, NJ 07801

Facilities Engineer
Louisiana Army Ammunition Plant
Shreveport, LA 71130

Facilities Engineer
Milan Army Ammunition Plant
Milan, TN 38358

Facilities Engineer
Pine Bluff Arsenal
Pine Bluff, AR 71601

Facilities Engineer
Radford Army Ammunition Plant
Radford, VA 24141

Facilities Engineer
Rock Island Arsenal
Rock Island, IL 61201

Facilities Engineer
Rocky Mountain Arsenal
Denver, CO 80340

Facilities Engineer
Scranton Army Ammunition Plant
156 Cedar Avenue
Scranton, PA 18503

Facilities Engineer
Tobyhanna Army Depot
Tobyhanna, PA 18466

DIST 4

Facilities Engineer
Tooele Army Depot
Tooele, UT 84074

Facilities Engineer
Arlington Hall Station
400 Arlington Blvd
Arlington, VA 22212

Facilities Engineer
Cameron Station, Bldg 17
5010 Duke Street
Alexandria, VA 22314

Facilities Engineer
Sunny Point Military Ocean Terminal
Southport, NC 28461

Facilities Engineer
US Military Academy
West Point Reservation
West Point, NY 10996

Facilities Engineer
Fort Ritchie
Fort Ritchie, MD 21719

Facilities Engineer
Army Materials & Mechanics
Research Center
Watertown, MA 02172

Facilities Engineer
Ballistics Missile Advanced
Technology Center
P.O. Box 1500
Huntsville, AL 35807

Facilities Engineer
Fort Wainwright
172d Infantry Brigade
Fort Wainwright, AK 99703

Facilities Engineer
Fort Greely
Fort Greely, AK 98733

Facilities Engineer
Fort Richardson
Fort Richardson, AK 99505

Facilities Engineer
Harry Diamond Laboratories
2800 Powder Mill Rd
Adelphi, MD 20783

Facilities Engineer
Fort Missoula
Missoula, MT 59801

Facilities Engineer
New Cumberland Army Depot
New Cumberland, PA 17070

Facilities Engineer
Oakland Army Base
Oakland, CA 94626

Facilities Engineer
Vint Hill Farms Station
Warrentown, VA 22186

Facilities Engineer
Twin Cities Army Ammunition Plant
New Brighton, MN 55112

Facilities Engineer
Volunteer Army Ammunition Plant
Chattanooga, TN 37401

Facilities Engineer
Watervliet Arsenal
Watervliet, NY 12189

Facilities Engineer
St Louis Area Support Center
Granite City, IL 62040

Facilities Engineer
Fort Mornmouth
Fort Mornmouth, NJ 07703

Facilities Engineer
Redstone Arsenal
Redstone Arsenal, AL 35809

Facilities Engineer
Detroit Arsenal
Warren, MI 48039

Facilities Engineer
Aberdeen Proving Ground
Aberdeen Proving Ground, MD 21005

Facilities Engineer
Jefferson Proving Ground
Madison, IN 47250

Facilities Engineer
Dugway Proving Ground
Dugway, UT 84022

Facilities Engineer
Fort McCoy
Sparta, WI 54656

Facilities Engineer
White Sands Missile Range
White Sands Missile Range, NM 88002

Facilities Engineer
Yuma Proving Ground
Yuma, AZ 85364

Facilities Engineer
Natick Research & Dev Ctr
Kansas St.
Natick, MA 01760

Facilities Engineer
Fort Bragg
Fort Bragg, NC 28307

Facilities Engineer
Fort Campbell
Fort Campbell, KY 42223

Facilities Engineer
Fort Carson
Fort Carson, CO 80913

Facilities Engineer
Fort Drum
Watertown, NY 13601

Facilities Engineer
Fort Hood
Fort Hood, TX 76544

Facilities Engineer
Fort Indiantown Gap
Annville, PA 17003

Facilities Engineer
Fort Lewis
Fort Lewis, WA 98433

Facilities Engineer
Fort MacArthur
Fort MacArthur, CA 90731

Facilities Engineer
Fort McPherson
Fort McPherson, GA 30330

Facilities Engineer
Fort George G. Meade
Fort George G. Meade, MD 20755

Facilities Engineer
Fort Polk
Fort Polk, LA 71459

Facilities Engineer
Fort Riley
Fort Riley, KS 66442

Facilities Engineer
Fort Stewart
Fort Stewart, GA 31312

Facilities Engineer
Indiana Army Ammunition Plant
Charlestown, IN 47111

Facilities Engineer
Joliet Army Ammunition Plant
Joliet, IL 60436

Facilities Engineer
Anniston Army Depot
Anniston, AL 36201

Facilities Engineer
Corpus Christi Army Depot
Corpus Christi, TX 78419

Facilities Engineer
Red River Army Depot
Texarkana, TX 75501

Facilities Engineer
Sacramento Army Depot
Sacramento, CA 95813

Facilities Engineer
Sharpe Army Depot
Lathrop, CA 95330

Facilities Engineer
Seneca Army Depot
Romulus, NY 14541

Facilities Engineer
Fort Ord
Fort Ord, CA 93941

Facilities Engineer
Presidio of San Francisco
Presidio of San Francisco, CA 94129

Facilities Engineer
Fort Sheridan
Fort Sheridan, IL 60037

Facilities Engineer
Holston Army Ammunition Plant
Kingsport, TN 37662

Facilities Engineer
Baltimore Output
Baltimore, MD 21222

Facilities Engineer
Bayonne Military Ocean Terminal
Bayonne, NJ 07002

Facilities Engineer
Bay Area Military Ocean Terminal
Oakland, CA 94626

Facilities Engineer
Gulf Output
New Orleans, LA 70146

Facilities Engineer
Fort Huachuca
Fort Huachuca, AZ 86513

Facilities Engineer
Letterkenny Army Depot
Chambersburg, PA 17201

Facilities Engineer
Michigan Army Missile Plant
Warren, MI 48089

COL E.C. Lussier
Fitzsimons Army Med Center
ATTN: HSF-DFE
Denver, CO 80240

US Army Engr Dist, New York
ATTN: NANEN-E
26 Federal Plaza
New York, NY 10007

USA Engr Dist, Baltimore
ATTN: Chief, Engr Div
P.O. Box 1715
Baltimore, MD 21203

USA Engr Dist, Charleston
ATTN: Chief, Engr Div
P.O. Box 919
Charleston, SC 29402

USA Engr Dist, Detroit
P.O. Box 1027
Detroit, MI 48231

USA Engr Dist, Kansas City
ATTN: Chief, Engr Div
700 Federal Office Bldg.
601 E. 12th St
Kansas City, MO 64106

USA Engr Dist, Omaha
ATTN: Chief, Engr Div
7410 USOP and Courthouse
215 N. 17th St
Omaha, NE 68102

USA Engr Dist, Fort Worth
ATTN: Chief, SWFED-D
P.O. Box 17300
Fort Worth, TX 76102

USA Engr Dist, Sacramento
ATTN: Chief, SPKED-D
650 Capitol Mall
Sacramento, CA 95814

USA Engr Dist, Far East
ATTN: Chief, Engr Div
APO San Francisco, CA 96301

USA Engr Dist, Japan
APO San Francisco, CA 96343

USA Engr Div, Europe
European Div, Corps of Engineers
APO New York, NY 09757

USA Engr Div, North Atlantic
ATTN: Chief, NADEN-r
90 Church St.
New York, NY 10007

USA Engr Div, South Atlantic
ATTN: Chief, SAEN-TE
510 Title Bldg
30 Pryor St, SW
Atlanta, GA 30303

USA Engr Dist, Mobile
ATTN: Chief, SAMEN-C
P.O. Box 2288
Mobile, AL 36601

USA Engr Dist, Louisville
ATTN: Chief, Engr Div
P.O. Box 59
Louisville, KY 40201

USA Engr Div, Norfolk
ATTN: Chief, NAOEN-D
803 Front Street
Norfolk, VA 23510

USA Engr Div, Missouri River
ATTN: Chief, Engr Div
P.O. Box 103 Downtown Station
Omaha, NE 68101

USA Engr Div, South Pacific
ATTN: Chief, SPDED-TG
630 Sansome St, Rm 1216
San Francisco, CA 94111

USA Engr Div, Huntsville
ATTN: Chief, HNDED-ME
P.O. Box 1600 West Station
Huntsville, AL 35807

USA Engr Div, Ohio River
ATTN: Chief, Engr Div
P.O. Box 1159
Cincinnati, Ohio 45201

USA Engr Div, North Central
ATTN: Chief, Engr Div
536 S. Clark St.
Chicago, IL 60605

USA Engr Div, Southwestern
ATTN: Chief, SWDED-TM
Main Tower Bldg, 1200 Main St
Dallas, TX 75202

USA Engr Dist, Savannah
ATTN: Chief, SASAS-L
P.O. Box 889
Savannah, GA 31402

Commander
US Army Facilities Engineering
Support Agency
Support Detachment II
Fort Gillem, GA 30050

DIST 8

Commander
US Army Facilities Engr Spt Agency
ATTN: MAJ Brisbane
Support Detachment III
P.O. Box 6550
Fort Bliss, TX 79916

NCOIC
US Army Facilities Engr Spt Agency
Support Detachment III
ATTN: FESA-III-SI
P.O. Box 3031
Fort Sill, OK 73503

NCOIC
US Army Facilities Engr Spt Agency
Support Detachment III
ATTN: FESA-III-PR
P.O. Box 29704
Presidio of San Francisco, CA 94129

NCOIC
US Army Facilities Engr Spt Agency
ATTN: FESA-III-CA
Post Locator
Fort Carson, CO 80913

Commander/CPT Ryan
US Army Facilities Engr Spt Agency
Support Detachment IV
P.O. Box 300
Fort Mornmouth, NJ 07703

NCOIC
US Army Facilities Engr Spt Agency
ATTN: FESA-IV-MU
P.O. Box 300
Fort Mornmouth, NJ 07703

NCOIC
US Army Facilities Engr Spt Agency
Support Detachment IV
ATTN: FESA-IV-ST
Stewart Army Subpost
Newburgh, New York 12250

NCOIC
US Army Facilities Engineering
Support Agency
Support Detachment II
ATTN: FESA-II-JA
Fort Jackson, SC 29207

NCOIC
US Army Facilities Engr Spt Agency
Support Detachment II
ATTN: FESA-II-BE
P.O. Box 2207
Fort Benning GA 31905

NCOIC
US Army Facilities Engr Spt Agency
Support Detachment II
ATTN: FESA-II-KN
Fort Knox, KY 40121

Naval Facilities Engineering Omd
Energy Programs Branch, Code 1023
Hoffmann Bldg. 2, (Mr. John Hughes)
Stovall Street
Alexandria, VA 22332

Commander
US Army Facilities Engineering
Support Agency
FE Support Detachment I
APO New York, NY 09081

Navy Energy Office
ATTN: W.R. Mitchum
Washington DC 20350

David C. Hall
Energy Projects Officer
Dept. of the Air Force
Sacramento Air Logistics Center (AFLC)
2852 ABG/DEE
McClellan, CA 95652

USA Engineer District, Chicago
219 S. Dearborn Street
ATTN: District Engineer
Chicago, IL 60604

Directorate of Facilities Engineer
Energy Environmental & Self Help Center
Fort Campbell, KY 42223

Commander and Director
Construction Engineering Research
Laboratory
ATTN: COL Circeo
P.O. Box 4005
Champaign, IL 61820

Mr. Ray Heller
Engineering Services Branch
DFAE, Bldg, 1950
Fort Sill, OK 73503

Commander-in-Chief
HQ, USAEUR
ATTN: AEAEN-EH-U
APO New York 09403

HQ AFESC/RDVA
ATTN: Mr. Hathaway
Tyndall AFB, FL 32403

Commander and Director
Construction Engineering Research Lab
ATTN: Library
P.O. Box 4005
Champaign, IL 61820

HQ, 5th Signal Command
Office of the Engineer
APO New York 09056

HQ, Us Military Community Activity,
Heilbronn
Director of Engineering & Housing
ATTN: Rodger D. Romans
APO New York 09176

Commanding General
HQ USATC and Fort Leonard Wood
ATTN: Facility Engineer
Fort Leonard Wood, MO 65473

SSG Ruiz Burgos Andres
D.F.E., HHC HQ Qnd 193d Inf
BDE
Ft. Clayton, C/Z

Energy/Environmental Office
ATTN: David R. Nichols
USMCA-NBG (DEH)
APO New York 09696

Commander
535th Engineer Detachment
P.O. Box 300
Fort Monmouth, NJ 07703

NCOIC
535th Engineer Detachment, Team A
ATTN: SFC Prenger
P.O. Box 224
Fort Knox, KY 40121

NCOIC
535th Engineer Detachment, Team B
ATTN: SP6 Cathers
P.O. Box 300
Fort Monmouth, NJ 07703

NCOIC
535th Engineer Detachment, Team C
ATTN: SFC Jackson
P.O. Box 4301
Fort Eustis, VA 23604

NCOIC
535th Engineer Detachment, Team D
ATTN: SFC Hughes
Stewart Army Subpost
Newburg, New York 12550

Commander
Persidio of San Francisco,
California
ATTN: AFZM-DI/Mr. Prugh
San Francisco, CA 94129

Facilities Engineer
Corpus Christi Army Depot
ATTN: Mr. Joseph Canpu/Stop 24
Corpus Christi, TX 78419

Walter Reed Army Medical Center
ATTN: KHSWS-E/James Prince
6825 16th St., NW
Washington, DC 20012

Commanding Officer
Installations and Services Activity
ATTN: DRCIS-RI-IB
Rock Island Arsenal
Rock Island, IL 61299

DIST 10

Commanding Officer
Northern Division Naval
Facilities Engineering Command
Code 102 (Mr. E.F. Humm)
Naval Base
Philadelphia, PA 19112

Commander, US Army Facilities Engineering
Support Agency
Support Detachment I
APO New York 09081

HQ, USA Health Services Cnd
Bldg. 2792
ATTN: HSLO-F
Fort Sam Houston, TX 78234

HQDA
(DAEN-MPE-E)
WASH DC 20314

Commanding Officer
Northern Division Naval
Facilities Engineering Command
Code 10
Naval Base, Building 77
Philadelphia, PA 19112

Facilities Engineer
Fort Leavenworth
Fort Leavenworth, KS 66027

Facilities Engineer
Fort Benjamin Harrison
Fort Benjamin Harrison, IN 46216

Office of the A&E
ATTN: MAJ Johnson
Camp Ripley
Little Falls, MN 56345

Commander
US Army Garrison
ATTN: HSD-FE
Fort Detrick, MD 21701

AFESC/DEB
ATTN: Mr. Fred Beason
Tyndall AFB, FL 32403

Mr. David White
Defense Audit Service
888 North Sepulveda Blvd.
Suite 610
El Segundo, CA 90245

Facilities Engineer
Bldg. 308
Fort Myer, VA 22211

NAVFAC
ATTN: John Zekan
Code 0833 Hoffmann Building
200 Stovall Street
Alexandria, VA 22332

HQ, USASCH
Director Engineering & Housing
Fort Shafter, HI 96858

HQ, WESTCOM
ATTN: APEN-CE
Fort Shafter, HI 96858

Headquarters US Army Materiel Development
& Readiness Command
ATTN: Energy Office, DRCIS-C
Alexandria, VA 22333

One Stop Coordinator
Army Corps of Engineers
ATTN: ORNED-D (Connie Flatt)
P.O. Box 1070
Nashville, TN 37202

Solar Energy Research Institute
1617 Cole Boulevard
Golden, CO 80401

American Telephone & Telegraph Co.
ATTN: Kenneth T. Risberg
222 Mt. Airy Road, Rm 192B5
Basking Ridge, NJ 07920

LCDR D. J. Clark
Navy Material Command
Code 08E
Washington, DC 20360

DIST 11

Office of Secretary of Defense
Installations & Housing
ATTN: Mr. Millard Carr
WASH DC 20301

Commandant (G-ECV-2/65)
ATTN: LTC Peck
US Coast Guard HQTRS
2100 2nd St. SW
WASH DC 20593

HQ AFESC/DEB
ATTN: COL. William R. Gaddie
Tyndall AFB, FL 32403

DIST 12