

12
DNA 5793F-2

AD A109727

CALCULATION OF THE NEUTRON AND GAMMA-RAY ENVIRONMENT IN AND AROUND THE AFRRI TRIGA REACTOR

Volume II

Victor V. Verbinski
Costa G. Cassapakis
Science Applications, Inc.
P.O. Box 2351
La Jolla, California 92038

1 June 1981

Final Report for Period 5 May 1980—31 December 1980

CONTRACT No. DNA 001-80-C-0308


APPROVED FOR PUBLIC RELEASE;
DISTRIBUTION UNLIMITED.

THIS WORK SPONSORED BY THE DEFENSE NUCLEAR AGENCY
UNDER RDT&E RMSS CODE B350080464 U99QAXMJ00068 H2590D.

DTIC FILE COPY

Prepared for
Director
DEFENSE NUCLEAR AGENCY
Washington, D. C. 20305

DISCLAIMER NOTICE

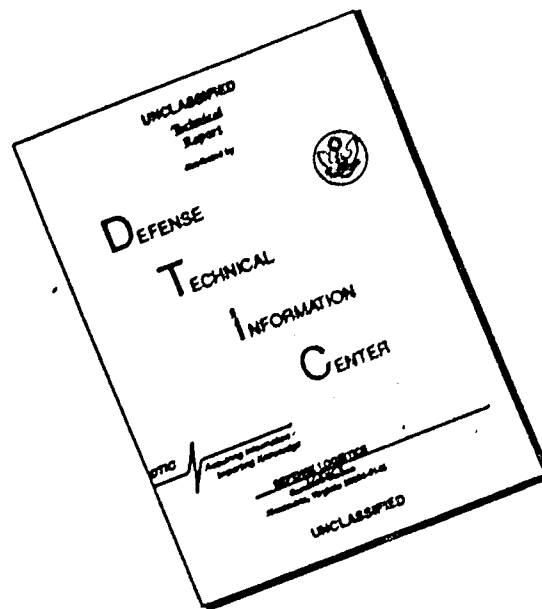

THIS DOCUMENT IS BEST QUALITY AVAILABLE. THE COPY FURNISHED TO DTIC CONTAINED A SIGNIFICANT NUMBER OF PAGES WHICH DO NOT REPRODUCE LEGIBLY.

Destroy this report when it is no longer
needed. Do not return to sender.

PLEASE NOTIFY THE DEFENSE NUCLEAR AGENCY,
ATTN: STTI, WASHINGTON, D.C. 20305, IF
YOUR ADDRESS IS INCORRECT, IF YOU WISH TO
BE DELETED FROM THE DISTRIBUTION LIST, OR
IF THE ADDRESSEE IS NO LONGER EMPLOYED BY
YOUR ORGANIZATION.




UNCLASSIFIED

SECURITY CLASSIFICATION OF THIS PAGE (When Data Entered)

REPORT DOCUMENTATION PAGE		READ INSTRUCTIONS BEFORE COMPLETING FORM
1 REPORT NUMBER DNA 5793F-2	2 GOVT ACCESSION NO. AD-272-81-183RI-LJ	3 RECIPIENT'S CATALOG NUMBER
4 TITLE (and Subtitle) CALCULATION OF THE NEUTRON AND GAMMA-RAY ENVIRONMENT IN AND AROUND THE AFRRRI TRIGA REACTOR Volume II	5 TYPE OF REPORT & PERIOD COVERED Final Report for Period 5 May 80—31 Dec 80	
7 AUTHOR Victor V. Verbinski Costa G. Cassapakis	6 PERFORMING ORG. REPORT NUMBER SAI-272-81-183RI-LJ	
9 PERFORMING ORGANIZATION NAME AND ADDRESS Science Applications, Inc P.O. Box 2351 La Jolla, California 92038	8 CONTRACT OR GRANT NUMBER(s) DNA 001-80-C-0308	
11 CONTROLLING OFFICE NAME AND ADDRESS Director Defense Nuclear Agency Washington, D.C. 20305	10 PROGRAM ELEMENT PROJECT, TASK AREA & WORK UNIT NUMBERS Subtask U99QAXMJ000-68	
14 MONITORING AGENCY NAME & ADDRESS (if different from Controlling Office)	12 REPORT DATE 1 June 1981	
	13 NUMBER OF PAGES 268	
	15 SECURITY CLASS (of this report) UNCLASSIFIED	
	15a DECLASSIFICATION DOWNGRADING SCHEDULE N/A	
16 DISTRIBUTION STATEMENT (of this Report) Approved for public release; distribution unlimited.		
17 DISTRIBUTION STATEMENT (of the abstract entered in Block 20, if different from Report)		
18 SUPPLEMENTARY NOTES This work sponsored by the Defense Nuclear Agency under RDT&E RMSS Code B350080464 U99QAXMJ00068 H2590D.		
19 KEY WORDS (Continue on reverse side if necessary and identify by block number) Computer Codes Cross Sections One-Dimensional Calculations Three-Dimensional Calculations		
20 ABSTRACT (Continue on reverse side if necessary and identify by block number) This document summarizes the neutron spectral measurements and the neutron and gamma-ray calculations for five different irradiation geometries commonly employed in biological and electronic "radiation-damage" studies: free field in both ER1 and ER2 exposure rooms; behind a 2-inch lead wall and inside an exercise wheel; behind a 6-inch lead wall and inside a 2-inch lead cave; and at the center of a tissue-equivalent phantom located behind a 6-inch lead wall.		

UNCLASSIFIED

SECURITY CLASSIFICATION OF THIS PAGE(When Data Entered)



UNCLASSIFIED

SECURITY CLASSIFICATION OF THIS PAGE(When Data Entered)

PREFACE

The author would like to thank Capt. E. Daxon and Lt. K. Ferlic of AFRR1 for their support and interest in this program. The technical contributions and suggestions of Drs. T. Albert and L. Simmons of SAI are also appreciated.

Don Tor	
6721	X
102	
10016	
10017	
10018	
10019	
10020	
10021	
10022	
10023	
10024	
10025	
10026	
10027	
10028	
10029	
10030	
10031	
10032	
10033	
10034	
10035	
10036	
10037	
10038	
10039	
10040	
10041	
10042	
10043	
10044	
10045	
10046	
10047	
10048	
10049	
10050	
10051	
10052	
10053	
10054	
10055	
10056	
10057	
10058	
10059	
10060	
10061	
10062	
10063	
10064	
10065	
10066	
10067	
10068	
10069	
10070	
10071	
10072	
10073	
10074	
10075	
10076	
10077	
10078	
10079	
10080	
10081	
10082	
10083	
10084	
10085	
10086	
10087	
10088	
10089	
10090	
10091	
10092	
10093	
10094	
10095	
10096	
10097	
10098	
10099	
10100	
10101	
10102	
10103	
10104	
10105	
10106	
10107	
10108	
10109	
10110	
10111	
10112	
10113	
10114	
10115	
10116	
10117	
10118	
10119	
10120	
10121	
10122	
10123	
10124	
10125	
10126	
10127	
10128	
10129	
10130	
10131	
10132	
10133	
10134	
10135	
10136	
10137	
10138	
10139	
10140	
10141	
10142	
10143	
10144	
10145	
10146	
10147	
10148	
10149	
10150	
10151	
10152	
10153	
10154	
10155	
10156	
10157	
10158	
10159	
10160	
10161	
10162	
10163	
10164	
10165	
10166	
10167	
10168	
10169	
10170	
10171	
10172	
10173	
10174	
10175	
10176	
10177	
10178	
10179	
10180	
10181	
10182	
10183	
10184	
10185	
10186	
10187	
10188	
10189	
10190	
10191	
10192	
10193	
10194	
10195	
10196	
10197	
10198	
10199	
10200	
10201	
10202	
10203	
10204	
10205	
10206	
10207	
10208	
10209	
10210	
10211	
10212	
10213	
10214	
10215	
10216	
10217	
10218	
10219	
10220	
10221	
10222	
10223	
10224	
10225	
10226	
10227	
10228	
10229	
10230	
10231	
10232	
10233	
10234	
10235	
10236	
10237	
10238	
10239	
10240	
10241	
10242	
10243	
10244	
10245	
10246	
10247	
10248	
10249	
10250	
10251	
10252	
10253	
10254	
10255	
10256	
10257	
10258	
10259	
10260	
10261	
10262	
10263	
10264	
10265	
10266	
10267	
10268	
10269	
10270	
10271	
10272	
10273	
10274	
10275	
10276	
10277	
10278	
10279	
10280	
10281	
10282	
10283	
10284	
10285	
10286	
10287	
10288	
10289	
10290	
10291	
10292	
10293	
10294	
10295	
10296	
10297	
10298	
10299	
10300	
10301	
10302	
10303	
10304	
10305	
10306	
10307	
10308	
10309	
10310	
10311	
10312	
10313	
10314	
10315	
10316	
10317	
10318	
10319	
10320	
10321	
10322	
10323	
10324	
10325	
10326	
10327	
10328	
10329	
10330	
10331	
10332	
10333	
10334	
10335	
10336	
10337	
10338	
10339	
10340	
10341	
10342	
10343	
10344	
10345	
10346	
10347	
10348	
10349	
10350	
10351	
10352	
10353	
10354	
10355	
10356	
10357	
10358	
10359	
10360	
10361	
10362	
10363	
10364	
10365	
10366	
10367	
10368	
10369	
10370	
10371	
10372	
10373	
10374	
10375	
10376	
10377	
10378	
10379	
10380	
10381	
10382	
10383	
10384	
10385	
10386	
10387	
10388	
10389	
10390	
10391	
10392	
10393	
10394	
10395	
10396	
10397	
10398	
10399	
10400	
10401	
10402	
10403	
10404	
10405	
10406	
10407	
10408	
10409	
10410	
10411	
10412	
10413	
10414	
10415	
10416	
10417	
10418	
10419	
10420	
10421	
10422	
10423	
10424	
10425	
10426	
10427	
10428	
10429	
10430	
10431	
10432	
10433	
10434	
10435	
10436	
10437	
10438	
10439	
10440	
10441	
10442	
10443	
10444	
10445	
10446	
10447	
10448	
10449	
10450	
10451	
10452	
10453	
10454	
10455	
10456	
10457	
10458	
10459	
10460	
10461	
10462	
10463	
10464	
10465	
10466	
10467	
10468	
10469	
10470	
10471	
10472	
10473	
10474	
10475	
10476	
10477	
10478	
10479	
10480	
10481	
10482	
10483	
10484	
10485	
10486	
10487	
10488	
10489	
10490	
10491	
10492	
10493	
10494	
10495	
10496	
10497	
10498	
10499	
10500	
10501	
10502	
10503	
10504	
10505	
10506	
10507	
10508	
10509	
10510	
10511	
10512	
10513	
10514	
10515	
10516	
10517	
10518	
10519	
10520	
10521	
10522	
10523	
10524	
10525	
10526	
10527	
10528	
10529	
10530	
10531	
10532	
10533	
10534	
10535	
10536	
10537	
10538	
10539	
10540	
10541	
10542	
10543	
10544	
10545	
10546	
10547	
10548	
10549	
10550	
10551	
10552	
10553	
10554	
10555	
10556	
10557	
10558	
10559	
10560	
10561	
10562	
10563	
10564	
10565	
10566	
10567	
10568	
10569	
10570	
10571	
10572	
10573	
10574	
10575	
10576	
10577	
10578	
10579	
10580	
10581	
10582	
10583	
10584	
10585	
10586	
10587	
10588	
10589	
10590	
10591	
10592	
10593	
10594	
10595	
10596	
10597	
10598	
10599	
10600	
10601	
10602	
10603	
10604	
10605	
10606	
10607	
10608	
10609	
10610	
10611	
10612	
10613	
10614	
10615	
10616	
10617	
10618	
10619	
10620	
10621	
10622	
10623	
10624	
10625	
10626	
10627	
10628	
10629	
10630	
10631	
10632	
10633	
10634	
10635	
10636	
10637	
10638	
10639	
10640	
10641	
10642	
10643	
10644	
10645	
10646	
10647	
10648	
10649	
10650	
10651	
10652	
10653	
10654	
10655	
10656	
10657	
10658	
10659	
10660	
10661	
10662	
10663	
10664	
10665	
10666	
10667	
10668	
10669	
10670	
10671	
10672	
10673	
10674	
10675	
10676	
10677	
10678	
10679	
10680	
10681	
10682	
10683	
10684	
10685	
10686	
10687	
10688	
10689	
10690	
10691	
1069	

TABLE OF CONTENTS

Part I

<u>Section</u>		<u>Page</u>
	PREFACE	1
1	INTRODUCTION.	3
2	COMPUTER CODES AND CROSS SECTIONS	7
3	ONE-DIMENSIONAL CALCULATIONS.	13
	3.1 One-Dimensional Models	13
	3.2 One-Dimensional Results.	25
4	THREE-DIMENSIONAL CALCULATIONS.	109
	4.1 Three-Dimensional Models	109
5	COMPARISON OF 1-D AND 3-D RESULTS	164

Part II

6	FREE FIELD SPECTRA AS A FUNCTION OF DISTANCE FROM THE REACTOR IN ER1 AND ER2	165
7	CONCLUSIONS AND SUMMARY	258
8	REFERENCES.	259

1. INTRODUCTION

The computer calculations performed for this project served two major functions. First, input spectra for the SAND II unfolding code were needed in order to unfold the foil data and produce measured spectra. These input spectra were provided as a result of some of the calculations done for this project. Good agreement on spectral shape and intensity verified the analytical techniques and the calculational effort was extended to configurations for which there were no measurements. Thus, the second major function of the calculations, to provide data for other reactor/room configurations, was accomplished using verified computational methods, assumptions, codes, and cross sections.

This data has been prepared with the AFRRRI Triga user in mind. Recommended spectra, front and back angular distributions, and several commonly used responses (e.g. dose, silicon damage, etc.) are given for all of the ten configurations studied. The data is suitable for application to exposure experiments, boot-strapping to further radiation transport calculations, or input to radiation effects computer codes. All of the calculations and resulting spectra are in the DNA DLC-31¹ energy group structure consisting of 37 neutron groups and 21 gamma-ray groups. This is a commonly used group structure for radiation effects work.

The cases which have been analyzed are briefly described in Table II.1.1. The position at which the fluxes were calculated for each case is shown in Table II.1.2. As can be seen in Table II.1.1, both one-dimensional and three-dimensional calculations were done for most cases, while only one-dimensional results were calculated for others. This resulted from the fact that in many cases, the 1-D and 3-D spectra were essentially the same. Thus, there was no need to run the expensive 3-D calculations. Notable exceptions to this rule are the calculations involving the exercize wheel and the cylindrical phantom. Good examples of the agreement between the 1-D and 3-D results are the spectra calculated for the free field case in both ER1 and ER2.

This gives rise to the third large block of data (following the 1-D and 3-D results). One-dimensional neutron and gamma-ray spectra, angular data, and responses were calculated as a function of distance from the reactor center in the free field ER1 and ER2. This data, in conjunction with the data presented on the effects of different configurations on the free field spectra, should allow a

Table II.1.1. Case Descriptions.

Case	1-D	3-D	Description
1	Y	Y	ER1 free field
2	Y	Y	ER1 with 6" Pb shield
3	Y	Y	ER1 with 6" Pb shield and 2" Pb cave
4	Y	Y	ER1 with 2" Pb shield and exercise wheel
5	Y	Y	ER2 free field
6	Y	Y	ER1 free field - core moved back 12"
7	Y	Y	ER1 with 2" Pb shield
8	Y	N	Flux at pneumatic tubes near ER2
9	Y	Y	ER1 with 6" Pb shield and cylindrical phantom
10	Y	N	ER1 free field with core moved back 5"

Table II.1.2. Detector Positions*.

Location at Which Flux is Reported

Case	Distance from Reactor Center (cm)	Height Above Floor (cm)
1	100	120
2	100	120
3	100	120
4	90	120
5	100	120**
6	100	120
7	100	120
8	———— In Center of Tubes ————	
9	100	120
10	100	120

*Same as foil positions except where noted.

**Foil were 92 cms above the floor.

reasonable estimate of the neutron and gamma-ray spectrum at any point in the rooms with a wide range of reactor and room configurations.

The next section contains a discussion of the computer codes and cross sections used for these calculations. This is followed by chapters containing the 1-D, 3-D, and flux as a function of distance results respectively.

2. COMPUTER CODES AND CROSS SECTIONS

Two radiation transport computer codes were used for this project. ANISN², a one-dimensional discrete ordinates code, was used for the 1-D calculations and MORSE³, a three-dimensional Monte Carlo code was used for the 3-D calculations. In addition, the BLENDR⁴ code was used to mix the cross sections external to the ANISN and MORSE codes. ANISN allows the calculation of the angular flux at each mesh boundary in a sphere, cylinder, or slab model. Due to the lamentable fact the most systems (and none of those involved in this project) are not constructed out of concentric spheres, cylinders, or planar slabs, ANISN results must be verified with higher dimensioned codes, such as MORSE. As the calculations progressed, it was learned when 1-D approximations were valid, but until that time 3-D calculations were done for all cases.

MORSE is a Monte Carlo code employing a flexible Combinatorial Geometry modeling package. It uses the same cross sections as ANISN and was, in fact, coupled to ANISN boundary leakages for this project. This coupling will be discussed in Chapter 4.

The cross section library used for all of these calculations was the DNA DLC-31 '37 neutron/21 gamma-ray group library¹. The energy group structure can be seen in Tables II.2.2 and II.2.3. This is a convenient set to use since much of the radiation effects work has been done using this group structure. One drawback, however, is that it does not contain two elements needed for these calculations: cadmium and zirconium. This stimulated a search for other cross section libraries which did contain all of the elements needed. Unfortunately, none of the sets examined (CASK, BUGLE 80, SAILWR) filled the need. After studying the behavior of the cadmium and zirconium cross sections with energy in BNL 325⁵ (the "barn book"), it was decided to substitute boron-10 with a number density 0.492 times that of cadmium for the cadmium and molybdenum at 0.10 times the number density of zirconium for the zirconium. These substitutions stem from the fact that the substitute materials have the same shape cross section with neutron energy, but a different absolute value, hence the scaling factor. In addition, note that the effects of gamma rays in these substitute materials is insignificant due to the low number density of zirconium in the fuel and the thinness of the cadmium shield region to gamma rays. For clarity, the material in the cadmium shield (really boron-10) will be referred to as cadmium. The

compositions of the various materials used in these calculations, as prepared in the mixing code BLENDR, are shown in Table II.2.1

The proper mixture for the core material (fuel, coolant, and cladding) and 6061-T6 aluminum alloy were derived in part from information supplied by personnel at the General Atomic Company^{6,7}. Another source of data necessary for preparing these mixtures (as well as other facets of this work) was the AFRRI Triga Mark-F Reactor Operations Manual⁸.

Another aspect of this work involved calculating various integral flux quantities such as dose and damage for the positions of interest. This calculation consists of performing the integral:

$$\int_0^{\infty} F(E)R(E)dE \quad (1)$$

where $F(E)$ is the neutron flux per unit energy and $R(E)$ is the response function per unit flux as a function of energy. In a many-group calculation this translates to the following sum:

$$\sum_{i=1}^N F_i R_i \quad (2)$$

where F_i is the flux in the i^{th} energy group, R_i is the response for the i^{th} group, and N is the number of groups. The values of R_i for the calculated responses are shown in Table II.2.2 for the neutrons and Table II.2.2 for the gamma rays. In addition, neutron flux above 1 Mev and total neutron flux was calculated.

Other dosimetry work employing foil data and calculated spectra as input to the unfolding code⁹ has shown a sensitivity to the fission spectrum used in the calculation. Accordingly, the latest ENDF/V-B compilation of the U-235 fission spectrum was used for this project¹⁰. It is tabulated in Table II.2.4. Only the neutron portion of the fission spectrum was used as a source for these calculations. The gamma-ray portion was omitted because the gamma-ray yield from the core is dominated by secondary gamma production. In addition, fission product gamma rays have been omitted for the same reason and because their intensity and spectrum vary with time and fuel exposure. It is felt the neither of these omissions impair the accuracy of the gamma-ray results.

Table II.2.1. Material Compositions.

Mixture	Element	Density (atoms/bn-cm)
1. Core Material	Hydrogen	5.79-2
	Molybdenum	2.26-3
	U-235	1.60-4
	U-238	6.33-4
	Oxygen	1.10-2
	Carbon	8.51-6
	Silicon	3.21-5
	Chromium	6.25-4
	Manganese	5.46-5
	Iron	2.09-3
	Nickel	3.07-4
2. Water at 1.0 gm/cc	Hydrogen	6.69-2
	Oxygen	3.35-2
3. 6061-T6 Al Alloy at 2.7 gm/cc	Silicon	3.48-4
	Copper	6.91-5
	Magnesium	6.69-4
	Chromium	6.25-5
	Aluminum	5.90-2
4. Cadmium at 8.65 gm/cc	Boron-10	2.43-2
5. Gadolinium Oxide at 7.41 gm/cc	Gadolinium	4.09-2
	Oxygen	6.13-2
6. Wood at 0.64 gm/cc	Carbon	1.43-2
	Hydrogen	2.40-2
	Oxygen	1.19-2
7. Lucite at 1.2 gm/cc	Carbon	3.61-2
	Hydrogen	5.78-2
	Oxygen	1.44-2
8. Lead at 11.35 gm/cc	Lead	3.30-2
9. Steel at 7.84 gm/cc	Iron	8.29-2
	Nickel	1.61-3
10. Permalli JN at 1.35 gm/cc	Hydrogen	4.88-2
	Boron-10	4.88-4
	Boron-11	1.77-3
	Oxygen	2.49-2
	Carbon	2.57-2
	Sodium	6.36-4
11. Air at 1 atmosphere	Nitrogen	4.03-5
	Oxygen	9.49-6
12. Phantom Tissue Solution at 1.06 gm/cc	Hydrogen	6.32-2
	Carbon	6.79-3
	Nitrogen	1.54-3
	Oxygen	2.91-2

Table II.2.2. Neutron Responses as a Function of Energy.
⁺
 Silicon Damage $\times 10^{-4}$ = Damage Relative to
 1 MeV Fluence.

	ENERGY (MEV)	SULFUR ACTIVATION	SILICON DAMAGE ⁺	NEUTRON DOSE (RAD)	NEUTRON DOSE (REM)
1	1.96E+01	1.12E-01	2.50E-01	7.86E-09	6.18E-08
2	1.69E+01	1.71E-01	2.50E-01	7.78E-09	5.47E-08
3	1.49E+01	2.25E-01	2.50E-01	7.74E-09	5.85E-08
4	1.42E+01	2.53E-01	2.50E-01	7.71E-09	5.78E-08
5	1.38E+01	2.91E-01	2.46E-01	7.49E-09	5.51E-08
6	1.28E+01	3.31E-01	2.42E-01	7.21E-09	5.16E-08
7	1.22E+01	3.76E-01	2.16E-01	6.90E-09	4.78E-08
8	1.11E+01	3.80E-01	2.29E-01	6.49E-09	4.31E-08
9	1.00E+01	3.55E-01	2.22E-01	6.23E-09	4.09E-08
10	9.05E+00	3.33E-01	2.16E-01	6.10E-09	4.03E-08
11	8.19E+00	3.23E-01	2.05E-01	5.97E-09	4.00E-08
12	7.41E+00	3.16E-01	1.82E-01	5.82E-09	4.11E-08
13	6.30E+00	2.73E-01	1.71E-01	5.57E-09	4.25E-08
14	4.97E+00	2.37E-01	2.07E-01	5.34E-09	4.16E-08
15	4.72E+00	3.00E-01	1.67E-01	6.09E-09	4.16E-08
16	4.07E+00	1.90E-01	1.33E-01	4.56E-09	3.87E-08
17	3.01E+00	9.10E-02	1.40E-01	4.00E-09	3.56E-08
18	2.39E+00	8.96E-02	1.50E-01	3.82E-09	3.49E-08
19	2.31E+00	3.62E-02	1.38E-01	3.74E-09	3.49E-08
20	1.83E+00	1.03E-03	9.61E-02	3.52E-09	3.69E-08
21	1.11E+00	4.10E-06	9.95E-02	2.94E-09	3.23E-08
22	5.50E-01	0.00E+00	7.11E-02	1.69E-09	1.68E-08
23	1.58E-01	0.00E+00	7.01E-03	9.72E-10	7.81E-09
24	1.11E-01	0.00E+00	8.85E-03	7.45E-10	4.97E-09
25	5.25E-02	0.00E+00	7.60E-03	5.88E-10	2.73E-09
26	2.48E-02	0.00E+00	7.50E-03	6.13E-10	1.92E-09
27	2.19E-02	0.00E+00	7.50E-03	4.49E-10	1.30E-09
28	1.03E-02	0.00E+00	7.50E-03	4.21E-10	1.00E-09
29	3.35E-03	0.00E+00	7.50E-03	4.79E-10	1.03E-09
30	1.23E-03	0.00E+00	7.50E-03	5.25E-10	1.05E-09
31	5.83E-04	0.00E+00	7.50E-03	5.68E-10	1.12E-09
32	1.01E-04	0.00E+00	7.50E-03	6.94E-10	1.17E-09
33	2.90E-05	0.00E+00	7.50E-03	6.18E-10	1.24E-09
34	1.07E-05	0.00E+00	7.50E-03	6.28E-10	1.26E-09
35	3.06E-06	0.00E+00	7.50E-03	6.22E-10	1.25E-09
36	1.13E-06	0.00E+00	7.50E-03	6.70E-10	1.20E-09
37	4.14E-07	0.00E+00	7.50E-03	6.17E-10	1.03E-09

Table II.2.3. Gamma Dose as a Function of Energy.

ENERGY (MEV)		GAMMA DOSE
1	1.40E+01	3.21E-09
2	1.00E+01	2.47E-09
3	8.00E+00	2.09E-09
4	7.00E+00	1.87E-09
5	6.00E+00	1.66E-09
6	5.00E+00	1.44E-09
7	4.00E+00	1.10E-09
8	3.00E+00	1.01E-09
9	2.50E+00	8.71E-10
10	2.00E+00	7.26E-10
11	1.50E+00	5.64E-10
12	1.00E+00	4.11E-10
13	7.00E-01	2.93E-10
14	4.50E-01	1.92E-10
15	3.00E-01	1.11E-10
16	1.50E-01	6.48E-11
17	1.00E-01	3.71E-11
18	7.00E-02	3.67E-11
19	4.50E-02	6.33E-11
20	3.00E-02	1.42E-10
21	2.00E-02	4.41E-10

Table II.2.4. ENDF/V-B U-235 Fission Spectrum Collapsed to the DLC-31 Group Structure.

Group	Energy (MeV)	$S(E)\Delta E$	Group	Energy (MeV)	$S(E)\Delta E$
1	19.6	3.81-6	21	1.11	1.92-1
2	16.9	1.94-5	22	0.55	1.20-1
3	14.9	1.98-5	23	0.158	1.03-2
4	14.2	1.46-5	24	0.111	1.04-2
5	13.8	8.61-5	25	5.25-2	3.48-3
6	12.8	7.53-5	26	2.48-2	2.89-4
7	12.2	3.39-4	27	2.19-2	9.33-4
8	11.1	7.28-4	28	1.03-2	3.92-4
9	10.0	1.42-3	29	3.35-3	6.62-5
10	9.05	2.56-3	30	1.23-3	1.29-5
11	8.19	4.27-3	31	5.83-4	5.74-6
12	7.41	1.11-2	32	1.01-4	3.79-7
13	6.38	3.68-2	33	2.90-5	5.35-8
14	4.97	1.07-2	34	1.07-5	1.30-8
15	4.72	3.95-2	35	3.06-6	1.85-9
16	4.07	1.09-1	36	1.13-6	4.22-10
17	3.01	1.05-1	37	4.14-7	1.40-10
18	2.39	1.58-2			
19	2.31	1.11-1			
20	1.83	2.14-1			

3. ONE-DIMENSIONAL CALCULATIONS

3.1. One-Dimensional Models

ANISN calculations are limited to systems of concentric spheres, cylinders, and planar slabs. Clearly, a slab model for the cylindrical core and tank of the AFRRRI Triga reactor is inappropriate. Because the core is a right cylinder, a cylindrical model might seem to be the most correct approach. However, the core has a radius of 21.8 cms and a height (length) of 38.1 cms. A one-dimensional cylindrical model necessarily consists of concentric cylinders which are infinitely long. As the distance from the core to the detector is increased, the core will begin to look more and more like a sphere than an infinite cylinder. Thus, it was not clear at the outset whether a spherical or cylindrical model would be most accurate. The question was resolved by performing calculations with both models and comparing the results to measurements made by AFRRRI personnel.

The AFRRRI measurements which were used consisted of placing sulfur buttons on the face of the reactor tank and irradiating them for ten minutes at a reactor power of 5 kilowatts¹¹. For the purposes of this application only the button which was placed at the core midplane on the part of the tank which extends the furthest into the room was used. The placement and application of the rest of the buttons will be discussed in the next chapter. Using the $^{32}\text{S}(n,p)$ reaction, the "sulfur fluence" could be measured at the position of each button. This sulfur fluence can also be taken to be the fluence of neutrons with energy greater than or equal to 3 Mev. For the button of interest here, the sulfur fluence was measured to be $7.86 \times 10^{11} \text{ n/cm}^2$.

A cylindrical calculation was run which yielded a sulfur fluence of $1.08 \times 10^{12} \text{ n/cm}^2$ or 37% higher than the measurement. A spherical calculation was then run in which the radius of the core was determined by requiring that the sphere which represented the core should have the same volume as the real core. This yielded a spherical core radius of 23.84 cms. The spherical calculation yielded a sulfur fluence of $8.55 \times 10^{11} \text{ n/cm}^2$, only 9% higher than the measurement. This relative agreement, in conjunction with the fact that the spherical model becomes more and more appropriate as the detector position is moved away from the core, makes the choice of the spherical model clear.

Having decided on spherical geometry, the position of the wooden walls in the model was studied. This is not straightforward for these 1-D calculations because the distance from the core to the back wall is different from the distance from the core to the ceiling, floor, and side walls. In ER1 the back wall is about 20 feet from the reactor center while the floor is about 4 feet away and the ceiling is about 6 feet away (these numbers differ slightly in ER2). The question is an important one because of the angular information required from these calculations. In addition to knowing the neutron and gamma-ray spectra at a particular location, it is necessary to also know the "front" and "back" spectra. "Front" means that component of the spectrum which is directed away from the front wall where the reactor is located. In other words, it is that component of the spectrum which would impinge upon the front of an irradiation subject facing the reactor. "Back" refers to that part of the spectrum which is directed away from the back wall. It is the spectrum which would impinge upon the back of an irradiation subject facing the reactor. As might be expected, the back flux is sensitive to the position of the wall in the spherical ANISN model. In general, the total flux (sum of the front and back fluxes) is not sensitive to the wall position because the front flux is usually much larger than the back flux.

This question was resolved by comparing the back flux for the ER1 free field case calculated with 1-D and 3-D codes. Because the 3-D model has the walls, ceiling, and floor in the proper position, the wall position in the 1-D model was adjusted to agree with the 3-D spectrum. One-dimensional calculations were run with walls at 20 feet from the core center and 10 feet from the core center. The 1-D and 3-D spectra agreed best with the walls at 20 feet. When the walls are moved in to 10 feet, the magnitude of the back flux increases by a factor of about 3. It was thus shown that the walls in the 1-D model for ER1 should be 20 feet from the core center and, by extension, the walls for ER2 should be 14 feet from the core center.

With geometry and wall position questions answered, the 1-D models for the different cases could be formulated. They are shown in Tables II.3.1 through II.3.10. The position at which the spectra were reported for each case is shown in Table II.1.2.

Table II.3.1.

1-D Model

Case No.: 1

Description: ER1 free field

	Zone	Material	Outer Radius (cm)
1.	Core	Core material	23.840
2.	Coolant	Water	26.353
3.	Shroud	Al	26.829
4.	Coolant	Water	28.575
5.	Tank and Al Shield	Al	29.251
6.	Gd ₂ O ₃	Gd ₂ O ₃	29.254
7.	Cd Shield	Cd	29.356
8.	Air	Air	638.956
9.	Gd ₂ O ₃ Paint	Gd ₂ O ₃	638.957
10.	Wood	Wood	669.438

Table II.3.2.

1-D Model

Case No.: 2

Description: ER1 with 6" Pb Shield

	Zone	Material	Outer Radius (cm)
1.	Core	Core material	23.840
2.	Coolant	Water	26.353
3.	Shroud	Al	26.829
4.	Coolant	Water	28.575
5.	Tank and Al Shield	Al	29.251
6.	Gd ₂ O ₃ Paint	Gd ₂ O ₃	29.254
7.	Cadmium	Cd	29.356
8.	Air	Air	43.500
9.	Al Sheet	Al	44.135
10.	6" Pb Shield	Pb	59.375
11.	Al Sheet	Al	60.010
12.	Air	Air	609.600
13.	Gd ₂ O ₃ Paint	Gd ₂ O ₃	609.601
14.	Wood	Wood	640.080

Table II.3.3.

1-D Model

Case No.: 3

Description: ER1 with 6" Pb Shield and 2" Pb Cave

	Zone	Material	Outer Radius (cm)
1.	Core	Core material	23.840
2.	Coolant	Water	26.353
3.	Shroud	Al	26.829
4.	Coolant	Water	28.575
5.	Tank and Al Shield	Al	29.251
6.	Gd ₂ O ₃ Paint	Gd ₂ O ₃	29.254
7.	Cadmium	Cd	29.356
8.	Air	Air	43.500
9.	Al Sheet	Al	44.135
10.	6" Pb Shield	Pb	59.375
11.	Al Sheet	Al	60.010
12.	Front of Cave	Pb at 42.2% density	106.096
13.	Back Wall of Cave	Pb	113.208
14.	Air	Air	609.600
15.	Gd ₂ O ₃ Paint	Gd ₂ O ₃	609.601
16.	Wood	Wood	640.080

Table II.3.4.

1-D Model

Case No.: 4

Description: ER1 with 2" Pb Shield and Exercise Wheel

	Zone	Material	Outer Radius (cm)
1.	Core	Core material	23.840
2.	Coolant	Water	26.353
3.	Shroud	Al	26.829
4.	Coolant	Water	28.575
5.	Tank and Al Shield	Al	29.251
6.	Gd ₂ O ₃ Paint	Gd ₂ O ₃	29.254
7.	Cadmium	Cd	29.356
8.	Air	Air	43.500
9.	Al Sheet	Al	44.135
10.	2" Pb Shield	Pb	49.215
11.	Al Sheet	Al	49.850
12.	Air	Air	71.990
13.	Lucite Box Wall	Lucite	73.260
14.	Inside of Lucite Box	Lucite at 11% density	103.740
15.	Box Wall and Exercise Wheel Disc	Lucite	106.598
16.	Inside of Exercise Wheel	Al at 1% density	167.558
17.	Exercise Wheel Disc	Lucite	169.146
18.	Air	Air	609.600
19.	Gd ₂ O ₃ Paint	Gd ₂ O ₃	609.601
20.	Wood	Wood	640.082

Table II.3.5.

1-D Model

Case No.: 5

Description: ER2 Free Field

	Zone	Material	Outer Radius (cm)
1.	Core	Core material	23.840
2.	Coolant	Water	26.353
3.	Shroud	Al	26.829
4.	Coolant	Water	29.052
5.	Tank	Al	29.687
6.	Air	Air	457.200
7.	Gd ₂ O ₃	Gd ₂ O ₃	457.201
8.	Wood	Wood	487.680

Table II.3.6.

1-D Model

Case No.: 6

Description: ER1 Free Field - Core Moved Back 12" in Tank

	Zone	Material	Outer Radius (cm)
1.	Core	Core material	23.840
2.	Coolant	Water	26.353
3.	Shroud	Al	26.829
4.	Coolant	Water	56.769
5.	Tank and Al Shield	Al	57.445
6.	Gd ₂ O ₃ Paint	Gd ₂ O ₃	57.448
7.	Cadmium	Cd	57.550
8.	Air	Air	640.080
9.	Gd ₂ O ₃ Paint	Gd ₂ O ₃	640.081
10.	Wood	Wood	670.560

Table II.3.7.

1-D Model

Case No.: 7

Description: ER1 with 2" Pb Shield

	Zone	Material	Outer Radius (cm)
1.	Core	Core material	23.840
2.	Coolant	Water	26.353
3.	Shroud	Al	26.829
4.	Coolant	Water	28.575
5.	Tank and Al Shield	Al	29.251
6.	Gd ₂ O ₃ Paint	Gd ₂ O ₃	29.254
7.	Cadmium	Cd	29.356
8.	Air	Air	43.500
9.	Al Sheet	Al	44.135
10.	2" Pb Shield	Pb	49.215
11.	Al Sheet	Al	49.850
12.	Air	Air	609.600
13.	Gd ₂ O ₃ Paint	Gd ₂ O ₃	609.601
14.	Wood	Wood	640.080

Table II.3.8.

1-D Model

Case No.: 8

Description: Flux at Pneumatic Tubes Near ER2

	Zone	Material	Outer Radius (cm)
1.	Core	Core material	23.840
2.	Coolant	Water	26.353
3.	Shroud	Al	26.829
4.	Coolant	Water	28.575
5.	Tubes	Water at 43.8% density + at 13.7% density	31.750
6.	Coolant	Water	62.230

Table II.3.9.

1-D Model

Case No.: 9

Description: ER1 with 6" Pb Shield and Cylindrical Phantom

	Zone	Material	Outer Radius (cm)
1.	Core	Core material	23.840
2.	Coolant	Water	26.353
3.	Shroud	Al	26.829
4.	Coolant	Water	28.575
5.	Tank and Al Shield	Al	29.251
6.	Gd ₂ O ₃ Paint	Gd ₂ O ₃	29.254
7.	Cadmium	Cd	29.356
8.	Air	Air	43.500
9.	Al Sheet	Al	44.135
10.	6" Pb Shield	Pb	59.375
11.	Al Sheet	Al	60.010
12.	Air	Air	91.120
13.	Phantom	Phantom Tissue Solution	108.900
14.	Air	Air	609.600
15.	Gd ₂ O ₃ Paint	Gd ₂ O ₃	609.601
16.	Wood	Wood	640.080

Table II.3.10.

1-D Model

Case No.: 10

Description: ER1 Free Field - Core Moved Back 5" in Tank

Zone		Material	Outer Radius (cm)
1.	Core	Core material	23.840
2.	Coolant	Water	26.353
3.	Shroud	Al	26.829
4.	Coolant	Water	39.529
5.	Tank and Al Shield	Al	40.205
6.	Gd ₂ O ₃ Paint	Gd ₂ O ₃	40.208
7.	Cadmium	Cd	40.310
8.	Air	Air	640.080
9.	Gd ₂ O ₃ Paint	Gd ₂ O ₃	640.081
10.	Wood	Wood	670.560

3.2. One-Dimensional Results

The results of the ANISN calculations for all ten cases are displayed in Figures II.3.1 through II.3.60 and Tables II.3.11 through II.3.30. The data is presented in increasing order starting with Case 1. For each case the first figure is the front neutron spectrum, the second is front gamma spectrum, the third is back neutron spectrum, the fourth is back gamma spectrum, the fifth is total neutron spectrum, and the sixth is total gamma spectrum. These six figures are followed two tables (one for neutrons, the other for gamma rays) containing the tabulated spectra data. The spectra are given in units of particles/cm²/sec/unit lethargy/kilowatt reactor power. The lethargy width of an energy group with upper and lower bounds of E_u and E_l respectively is:

$$\Delta u = \ln(E_u/E_l). \quad (3)$$

Thus, to get the flux in units of particles/cm²/sec for a particular energy group, the numbers given here should be multiplied by the lethargy width of the group and the reactor power in kilowatts. This system of units was chosen to facilitate comparison of these spectra with other published data for various irradiation fields.

In addition to the spectra, certain commonly use integral quantities were calculated for each case. These responses are also broken down into front, back, and total components and are shown in Table II.3.31 through II.3.33.

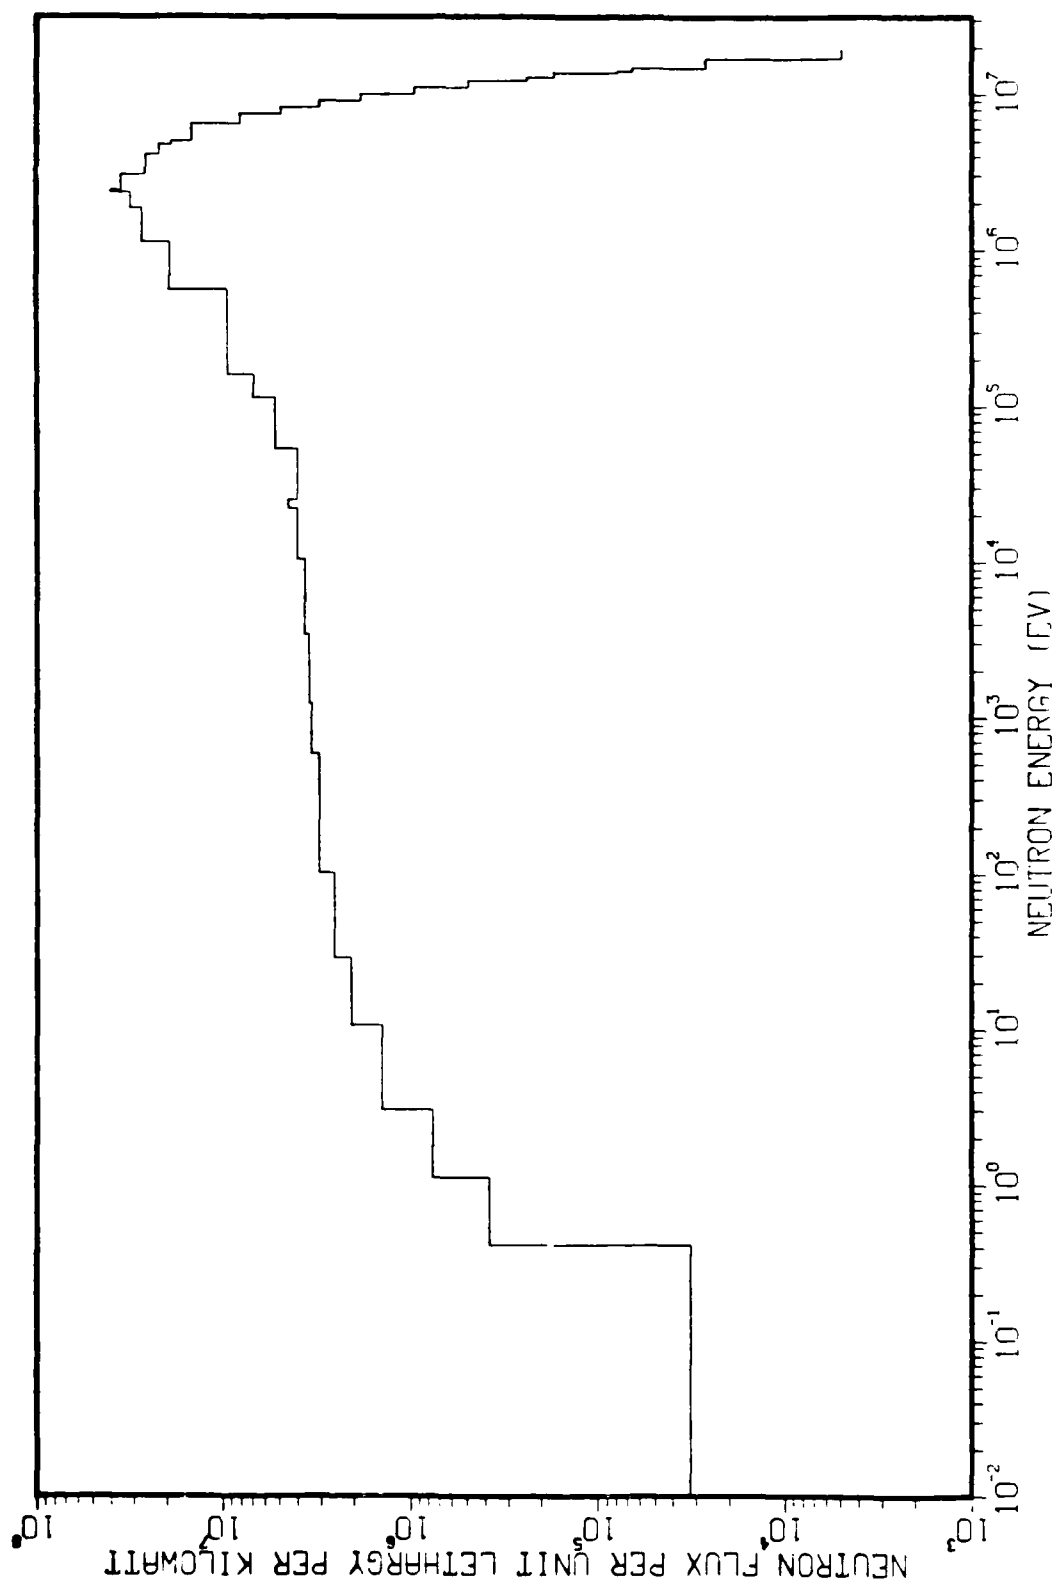


Figure II.3.1. Front (1-D) Neutron Flux vs Energy ER1 Free Field.

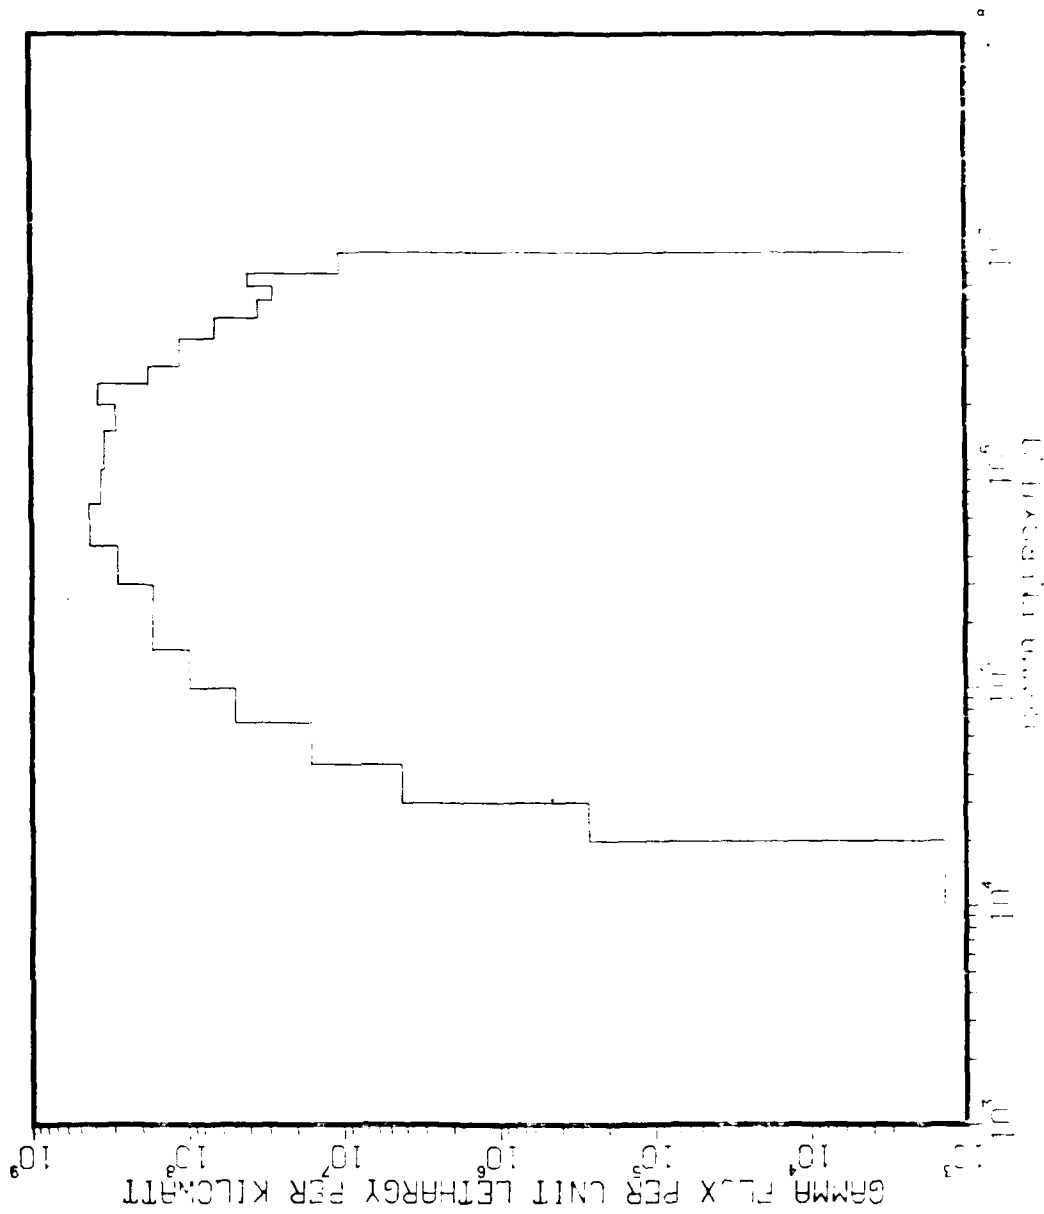


Figure II.3.2. Front Gamma Flux vs Energy ERI Free Field.

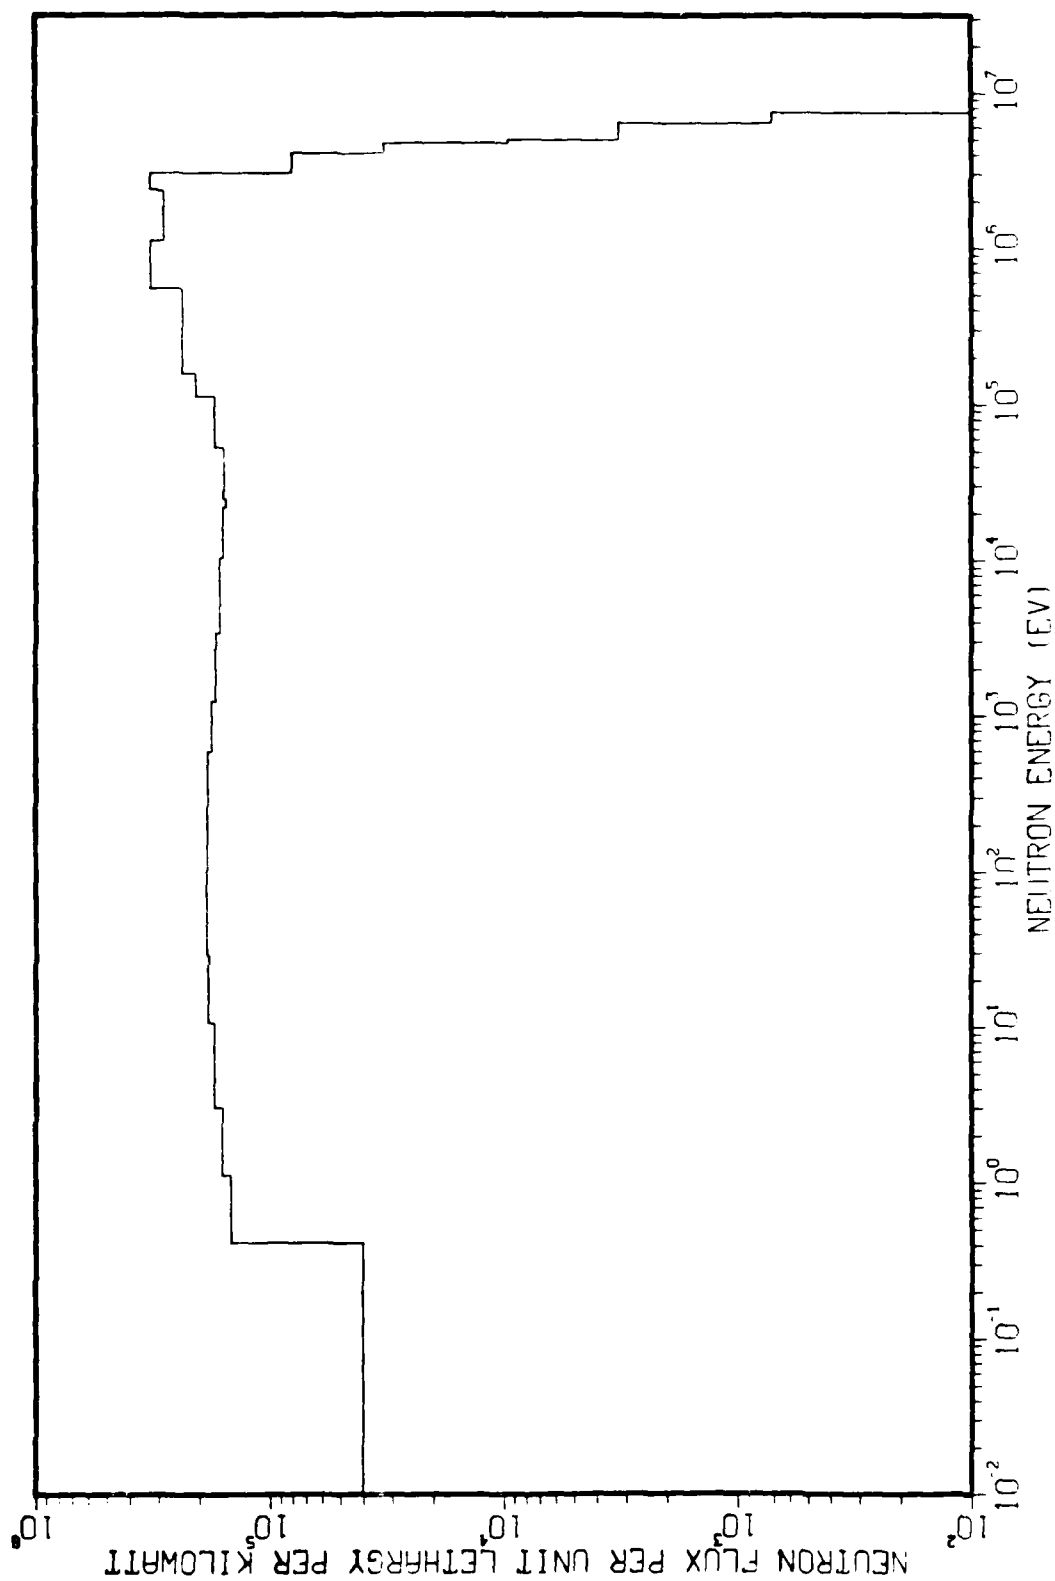


Figure 11.3.3. Back (1-D) Neutron Flux vs Energy ER1 Free Field.

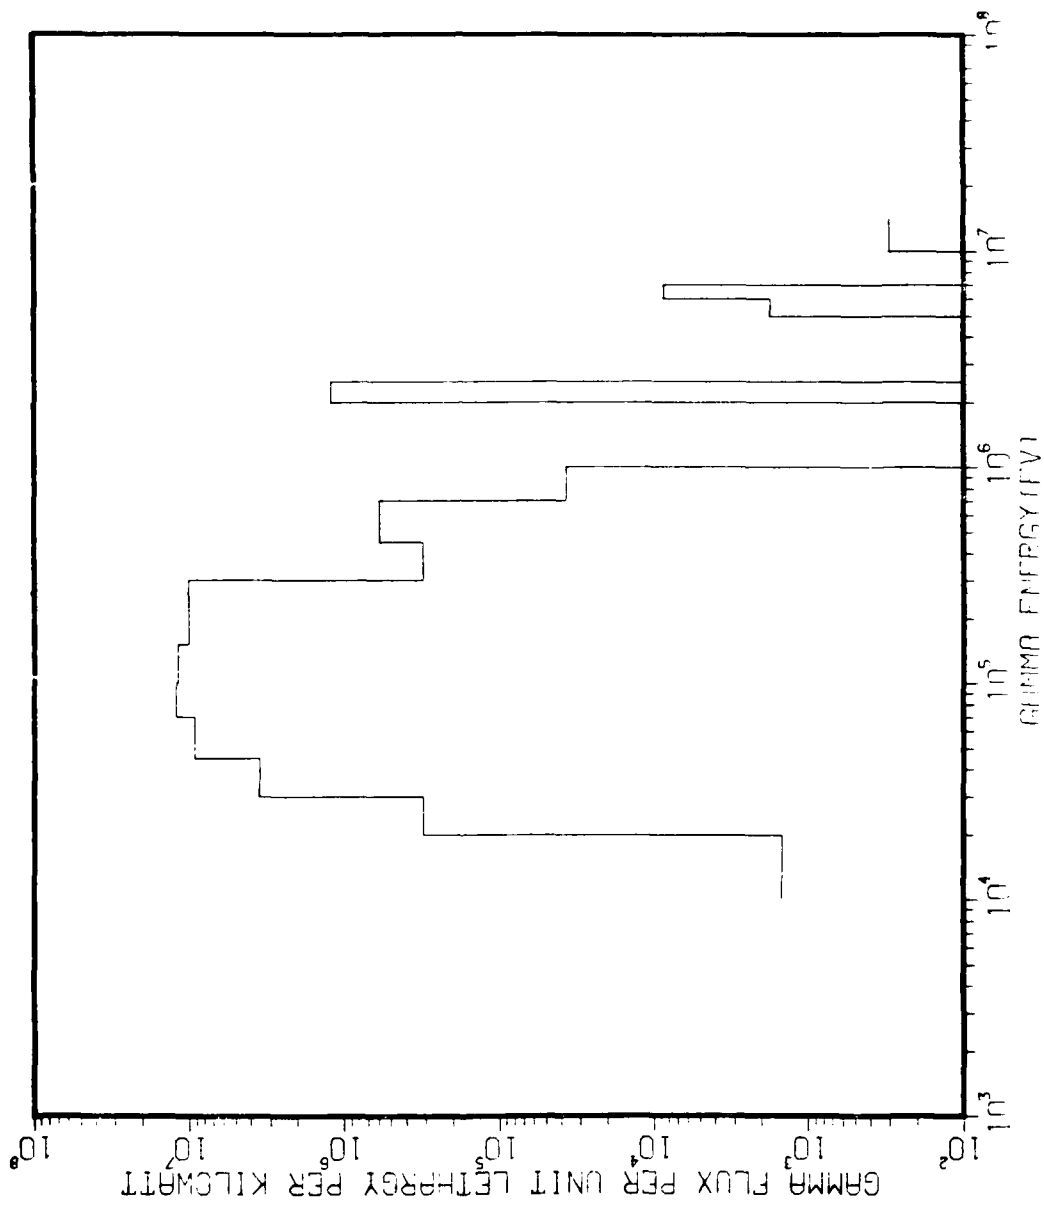


Figure II.3.4. Back Gamma Flux vs Energy ERI Free Field.

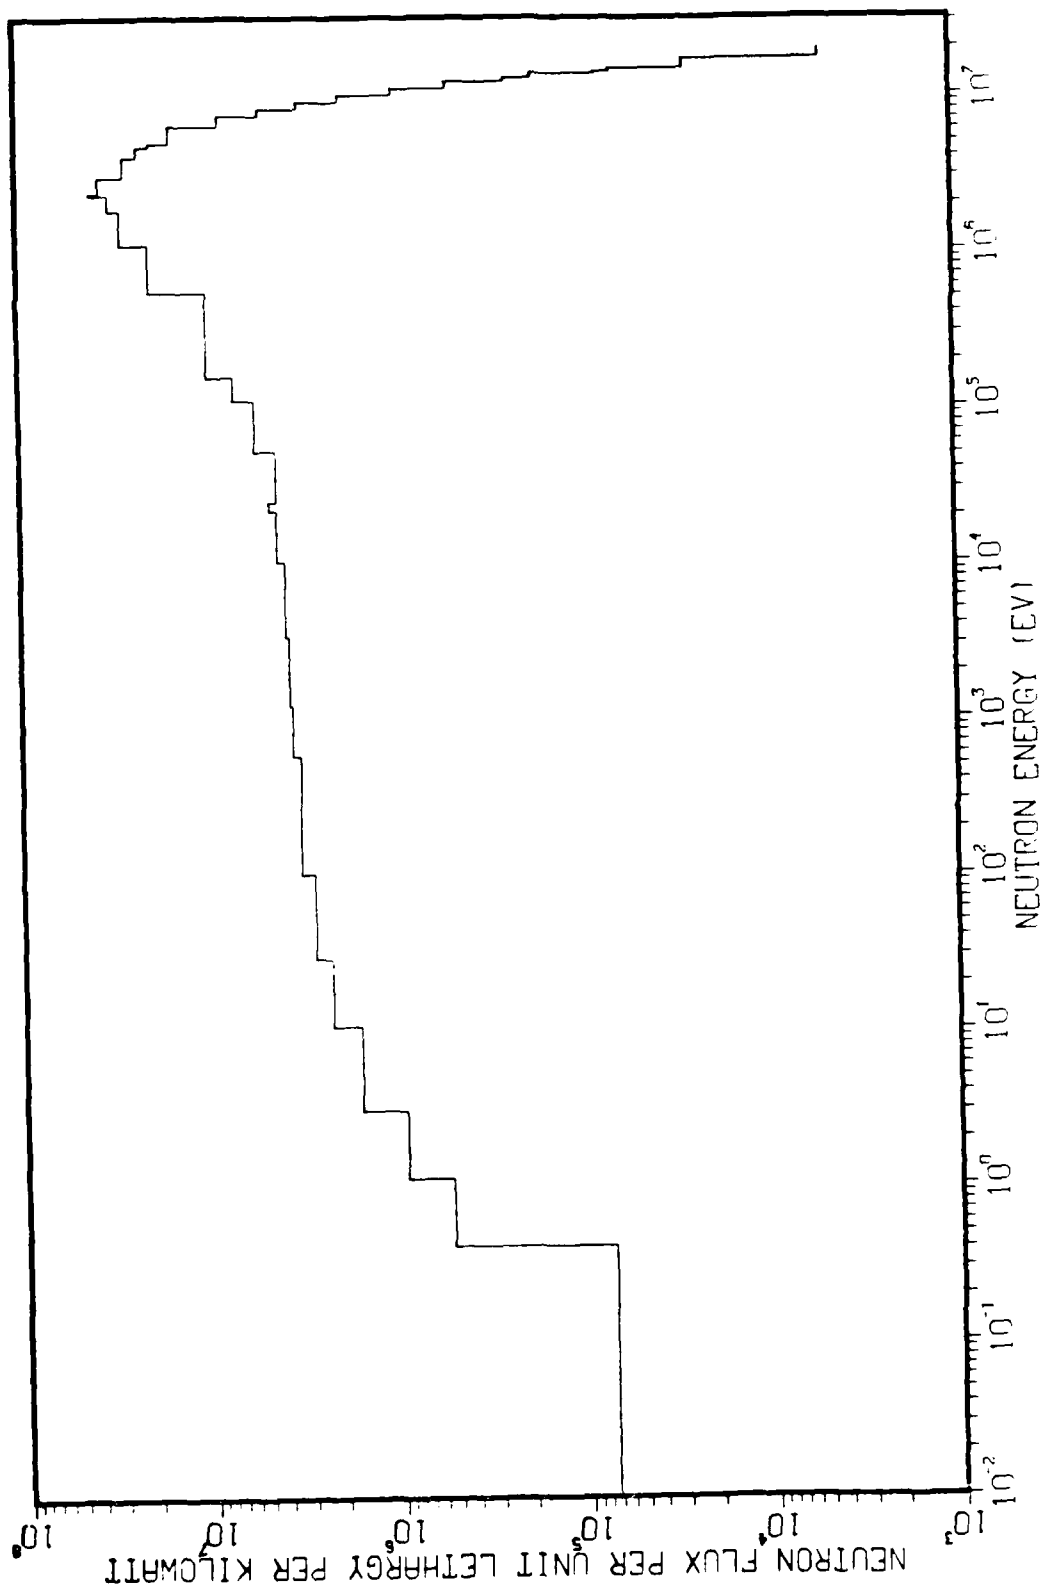


Figure 11.3.5. Total (Front+Back, 1-D) Neutron Flux vs Energy ERI Free Field.

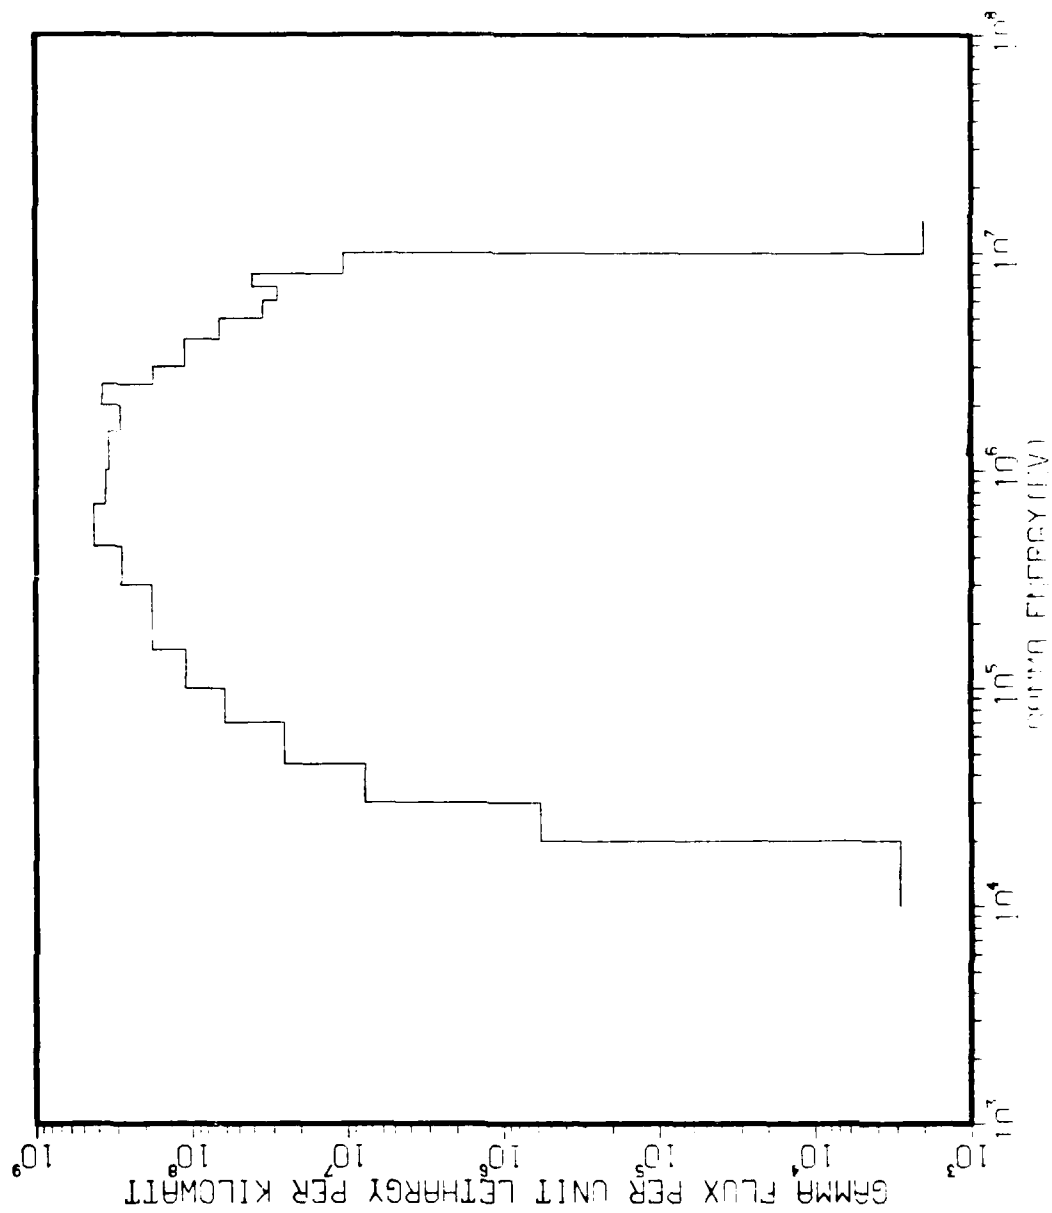


Figure II.3.6. Total (Front+Back) Gamma Flux vs Energy ERI Free Field.

Table II.3.11. Neutron Flux per Unit Lethargy per Kilowatt.

GROUP	ENERGY (EV)	ER1 FREE FIELD		TOTAL
		FRONT	BACK	
1	1.960E+07	4.97E+03	0.00E+00	4.97E+03
2	1.690E+07	2.66E+04	0.00E+00	2.66E+04
3	1.490E+07	6.56E+04	0.00E+00	6.56E+04
4	1.420E+07	7.91E+04	0.00E+00	7.91E+04
5	1.380E+07	1.74E+05	0.00E+00	1.74E+05
6	1.280E+07	2.41E+05	0.00E+00	2.41E+05
7	1.220E+07	4.93E+05	0.00E+00	4.93E+05
8	1.110E+07	9.53E+05	0.00E+00	9.53E+05
9	1.000E+07	1.86E+06	0.00E+00	1.86E+06
10	9.050E+06	3.07E+06	0.00E+00	3.07E+06
11	8.190E+06	4.91E+06	0.00E+00	4.91E+06
12	7.410E+06	8.13E+06	7.06E+02	8.13E+06
13	6.380E+06	1.48E+07	3.20E+03	1.48E+07
14	4.970E+06	1.89E+07	9.47E+03	1.89E+07
15	4.720E+06	2.22E+07	3.23E+04	2.22E+07
16	4.070E+06	2.61E+07	8.05E+04	2.62E+07
17	3.010E+06	3.52E+07	3.21E+05	3.56E+07
18	2.390E+06	3.97E+07	2.98E+05	4.00E+07
19	2.310E+06	3.15E+07	2.83E+05	3.18E+07
20	1.830E+06	2.71E+07	2.82E+05	2.74E+07
21	1.110E+06	1.93E+07	3.23E+05	1.96E+07
22	5.500E+05	9.52E+06	2.35E+05	9.75E+06
23	1.580E+05	6.87E+06	2.06E+05	7.08E+06
24	1.110E+05	5.27E+06	1.72E+05	5.44E+06
25	5.250E+04	4.05E+06	1.57E+05	4.21E+06
26	2.480E+04	4.48E+06	1.54E+05	4.63E+06
27	2.190E+04	4.05E+06	1.58E+05	4.20E+06
28	1.030E+04	3.69E+06	1.64E+05	3.85E+06
29	3.350E+03	3.50E+06	1.71E+05	3.67E+06
30	1.230E+03	3.38E+06	1.79E+05	3.56E+06
31	5.830E+02	3.09E+06	1.85E+05	3.27E+06
32	1.010E+02	2.58E+06	1.87E+05	2.77E+06
33	2.900E+01	2.09E+06	1.85E+05	2.27E+06
34	1.070E+01	1.44E+06	1.74E+05	1.61E+06
35	3.060E+00	7.69E+05	1.60E+05	9.29E+05
36	1.130E+00	3.82E+05	1.48E+05	5.30E+05
37	4.140E-01	8.24E+04	4.05E+04	7.29E+04

Table II.3.12. Gamma Flux per Unit Lethargy per Kilowatt.

GROUP	ENERGY (EV)	ERI FREE FIELD		TOTAL
		FRONT	BACK	
1	1.400E+07	1.68E+03	3.01E+02	1.98E+03
2	1.000E+07	1.05E+07	0.00E+00	1.05E+07
3	8.000E+06	4.07E+07	0.00E+00	4.07E+07
4	7.000E+06	2.81E+07	8.57E+03	2.81E+07
5	6.000E+06	3.48E+07	1.75E+03	3.48E+07
6	5.000E+06	6.61E+07	0.00E+00	6.61E+07
7	4.000E+06	1.11E+08	0.00E+00	1.11E+08
8	3.000E+06	1.77E+08	0.00E+00	1.77E+08
9	2.500E+06	3.73E+08	1.22E+06	3.74E+08
10	2.000E+06	2.85E+08	0.00E+00	2.85E+08
11	1.500E+06	3.41E+08	0.00E+00	3.41E+08
12	1.000E+06	3.58E+08	3.67E+04	3.58E+08
13	7.000E+05	4.24E+08	5.95E+05	4.25E+08
14	4.500E+05	2.84E+08	3.12E+05	2.84E+08
15	3.000E+05	1.69E+08	1.02E+07	1.79E+08
16	1.500E+05	9.78E+07	1.19E+07	1.10E+08
17	1.000E+05	4.93E+07	1.21E+07	6.14E+07
18	7.000E+04	1.60E+07	9.24E+06	2.52E+07
19	4.500E+04	4.22E+06	3.54E+06	7.76E+06
20	3.000E+04	2.68E+05	3.12E+05	5.79E+05
21	2.000E+04	1.38E+03	1.49E+03	2.87E+03

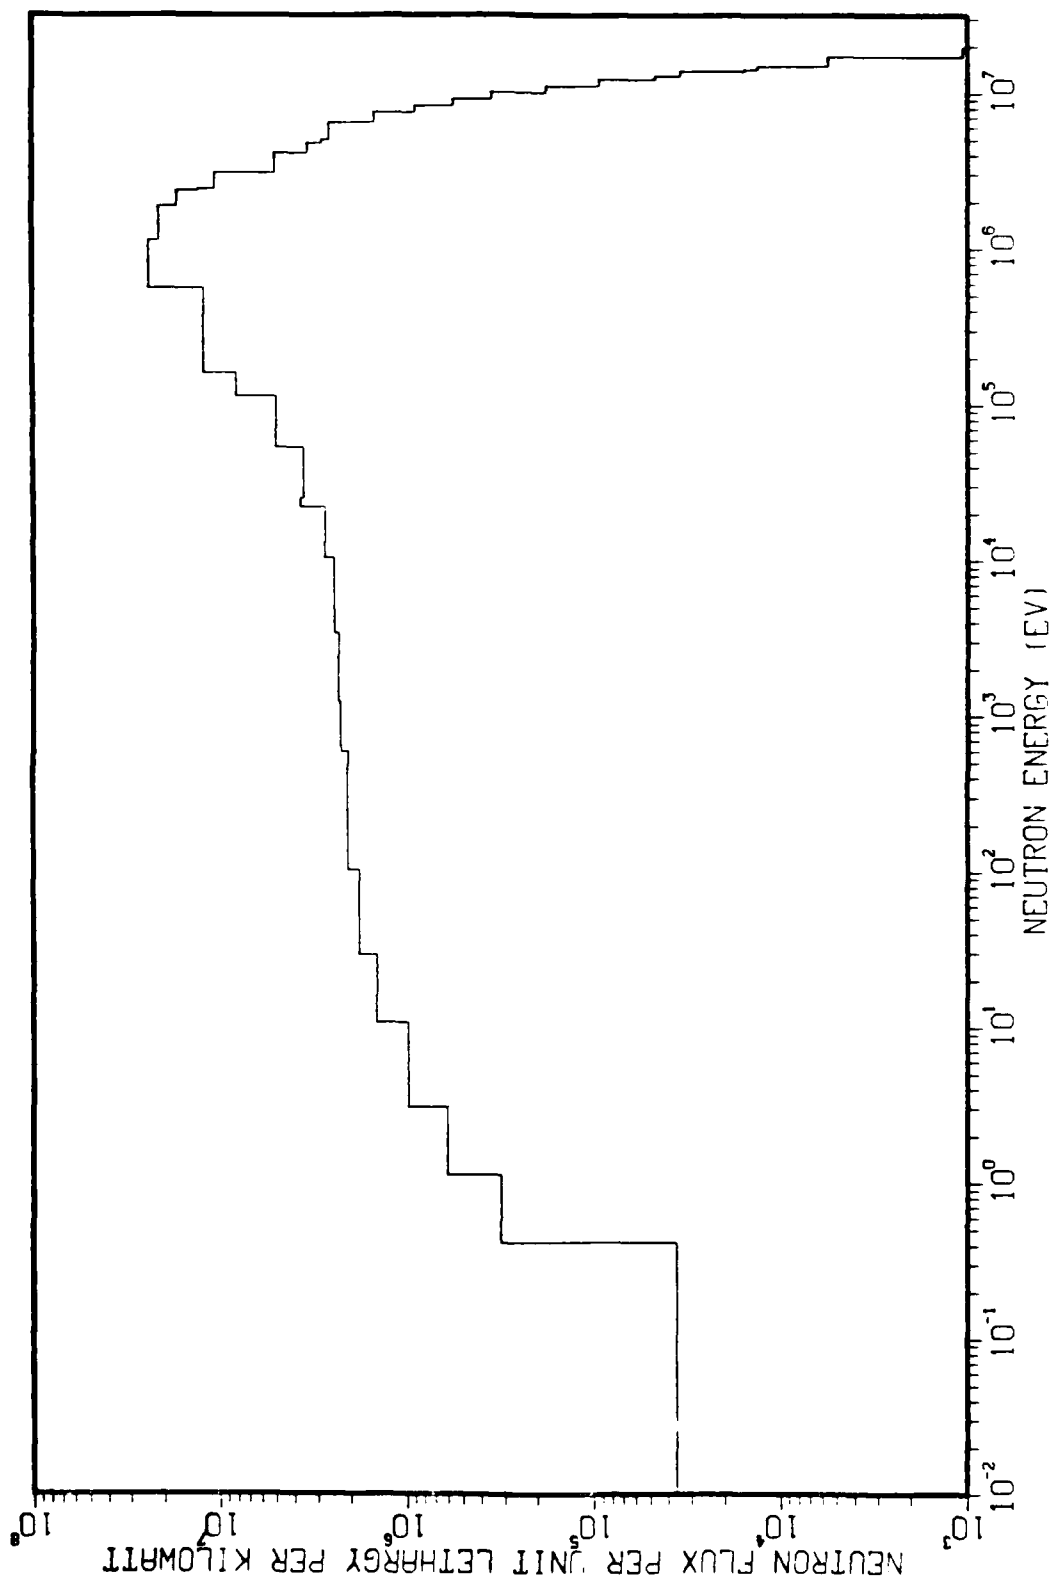


Figure 11.3.7. Front (1-0) Neutron Flux vs Energy ER1 with 6" Pb.

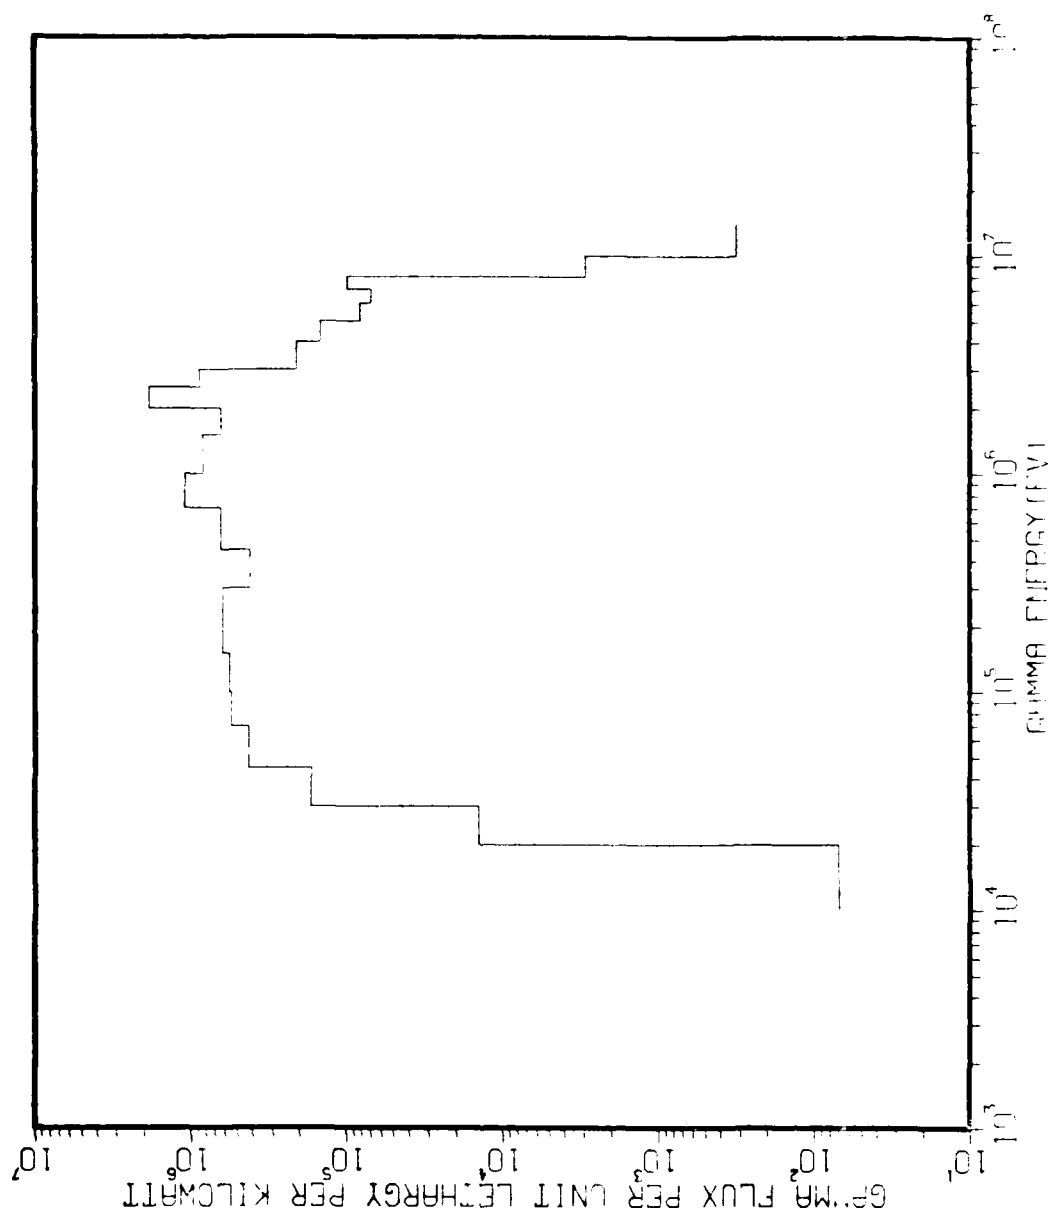


Figure II.3.8. Front Gamma Flux vs Energy ERI With 6" PB.

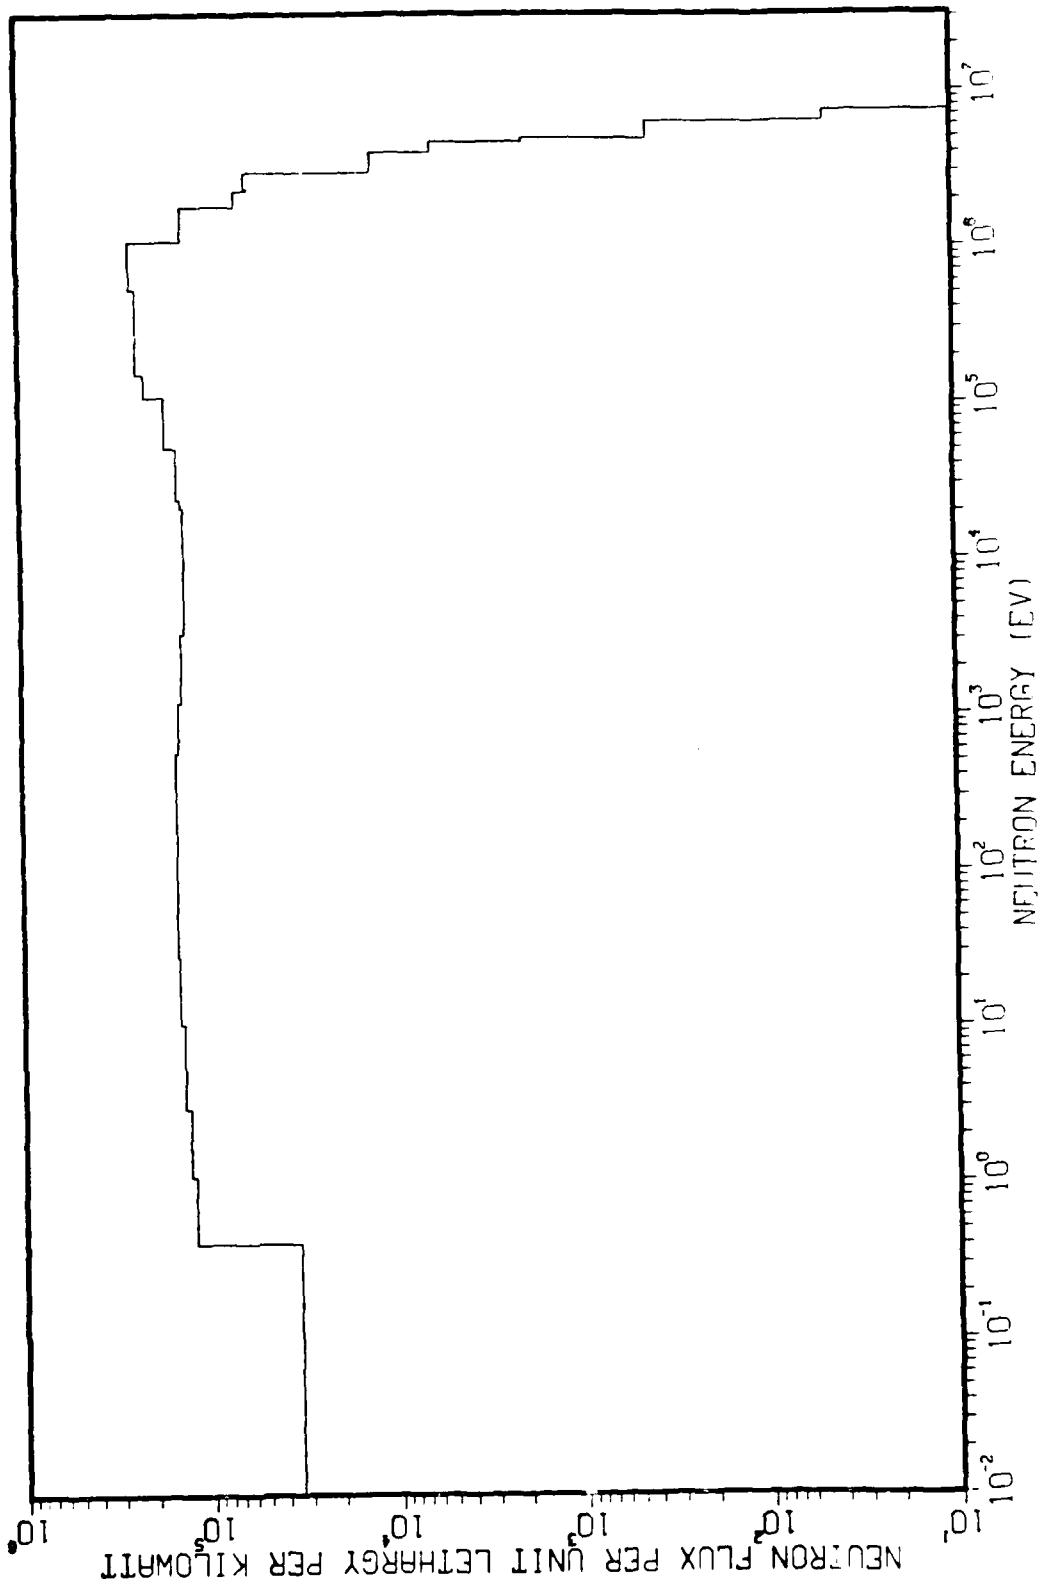


Figure II.3.9. Back (1-D) Neutron Flux vs Energy ERI With 6" PB.

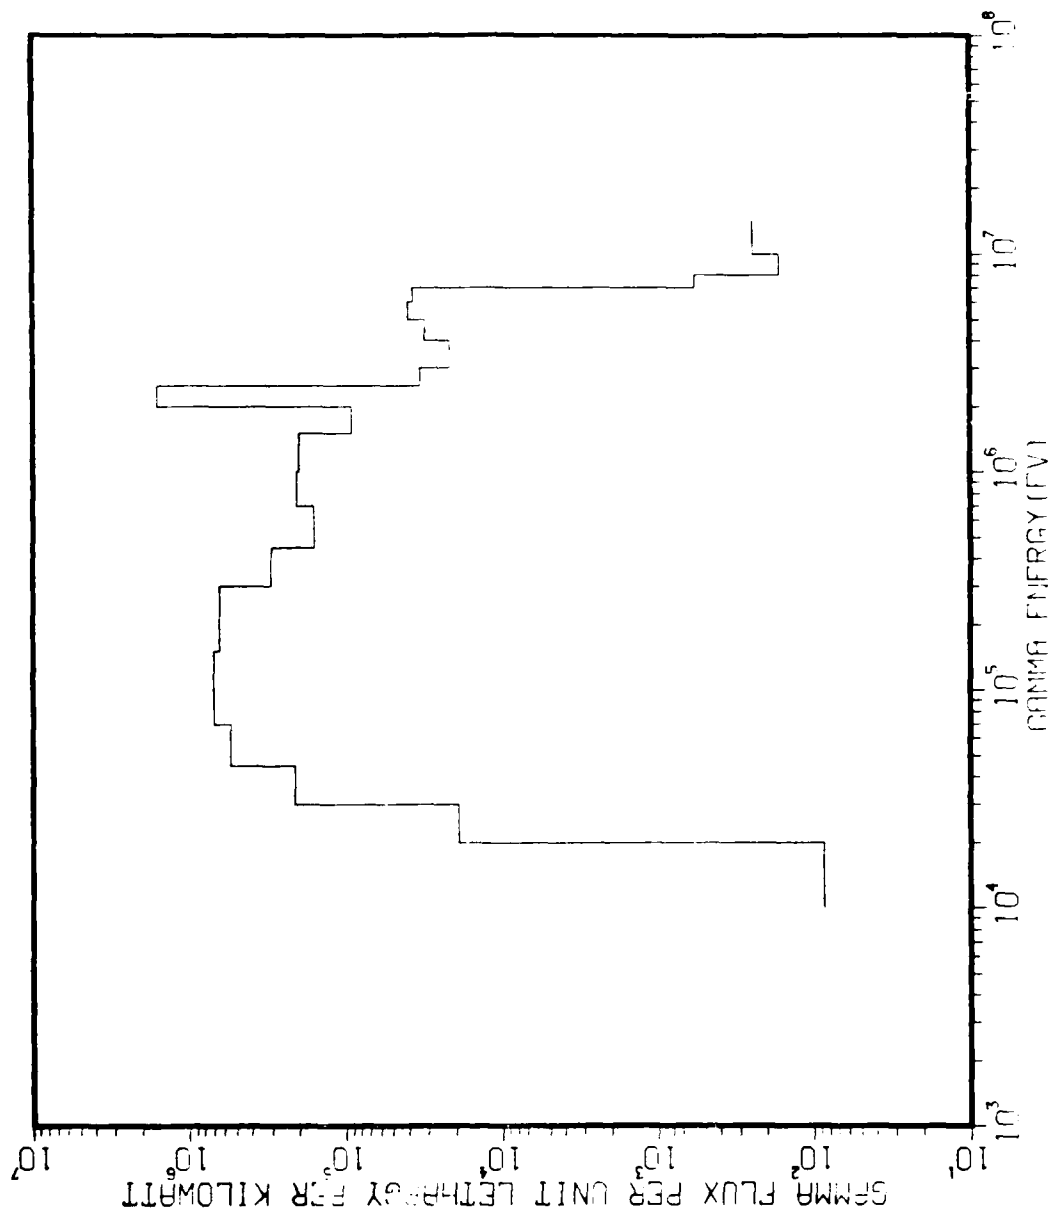


Figure II.3.10. Back Gamma Flux vs Energy ERI With 6" PB.

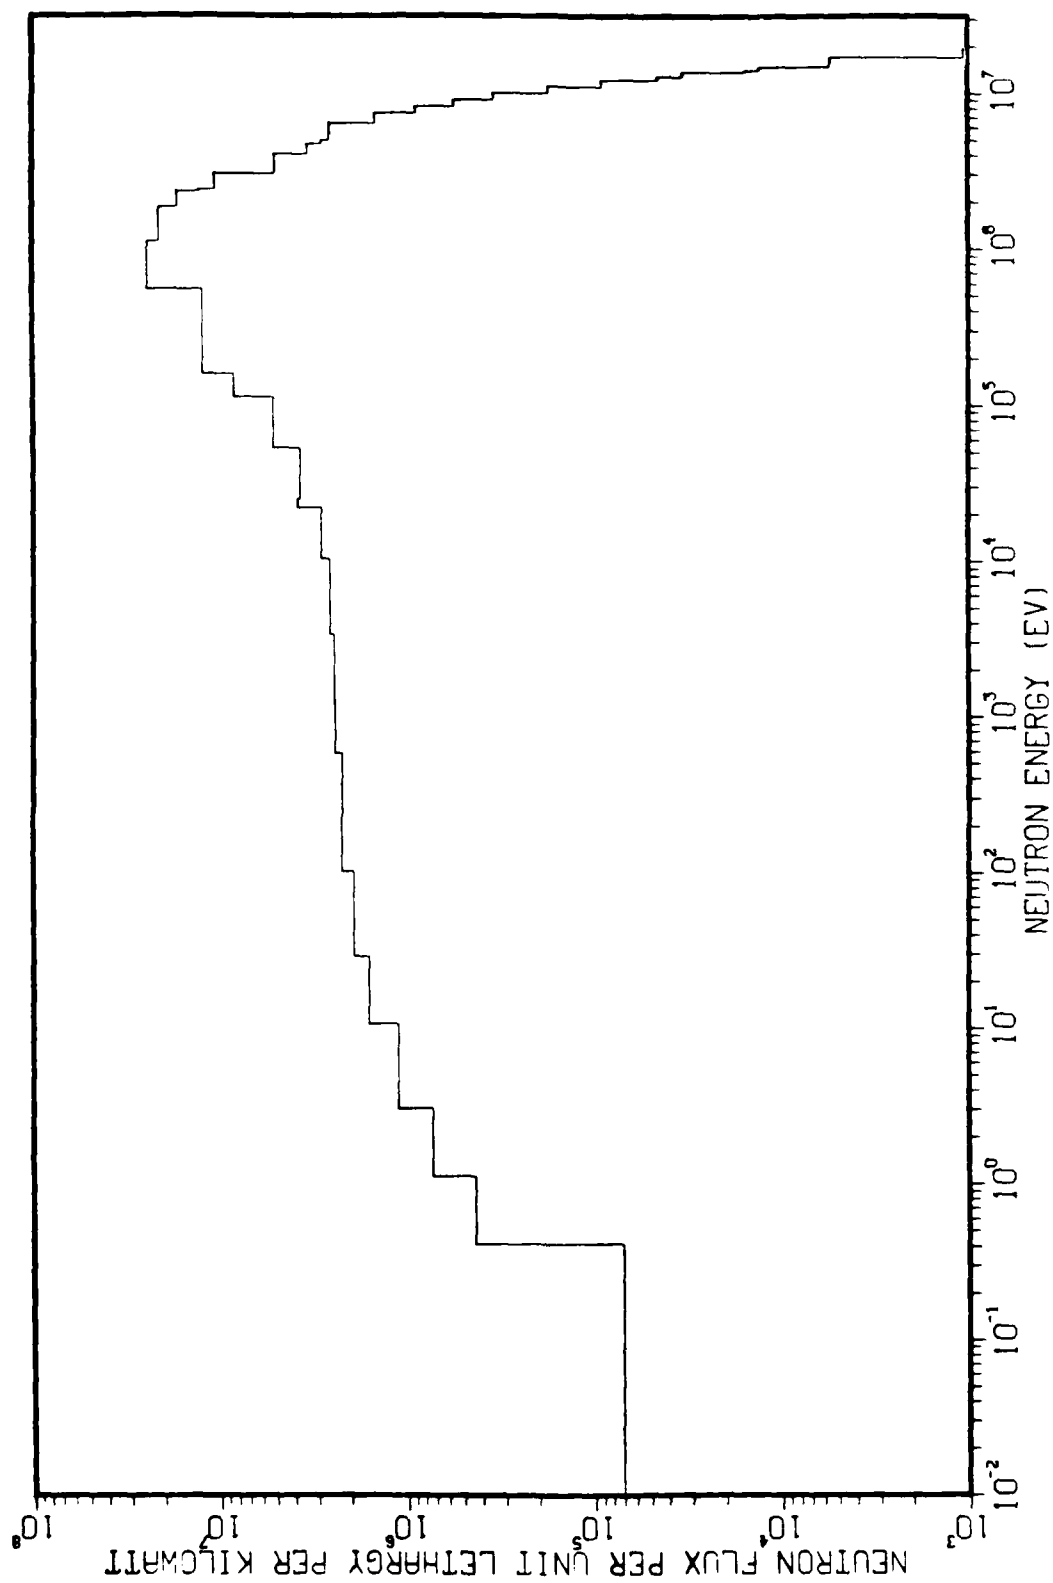


Figure II.3.11. Total (Front+Back, 1-D) Neutron Flux vs Energy ER1 With 6" PB.

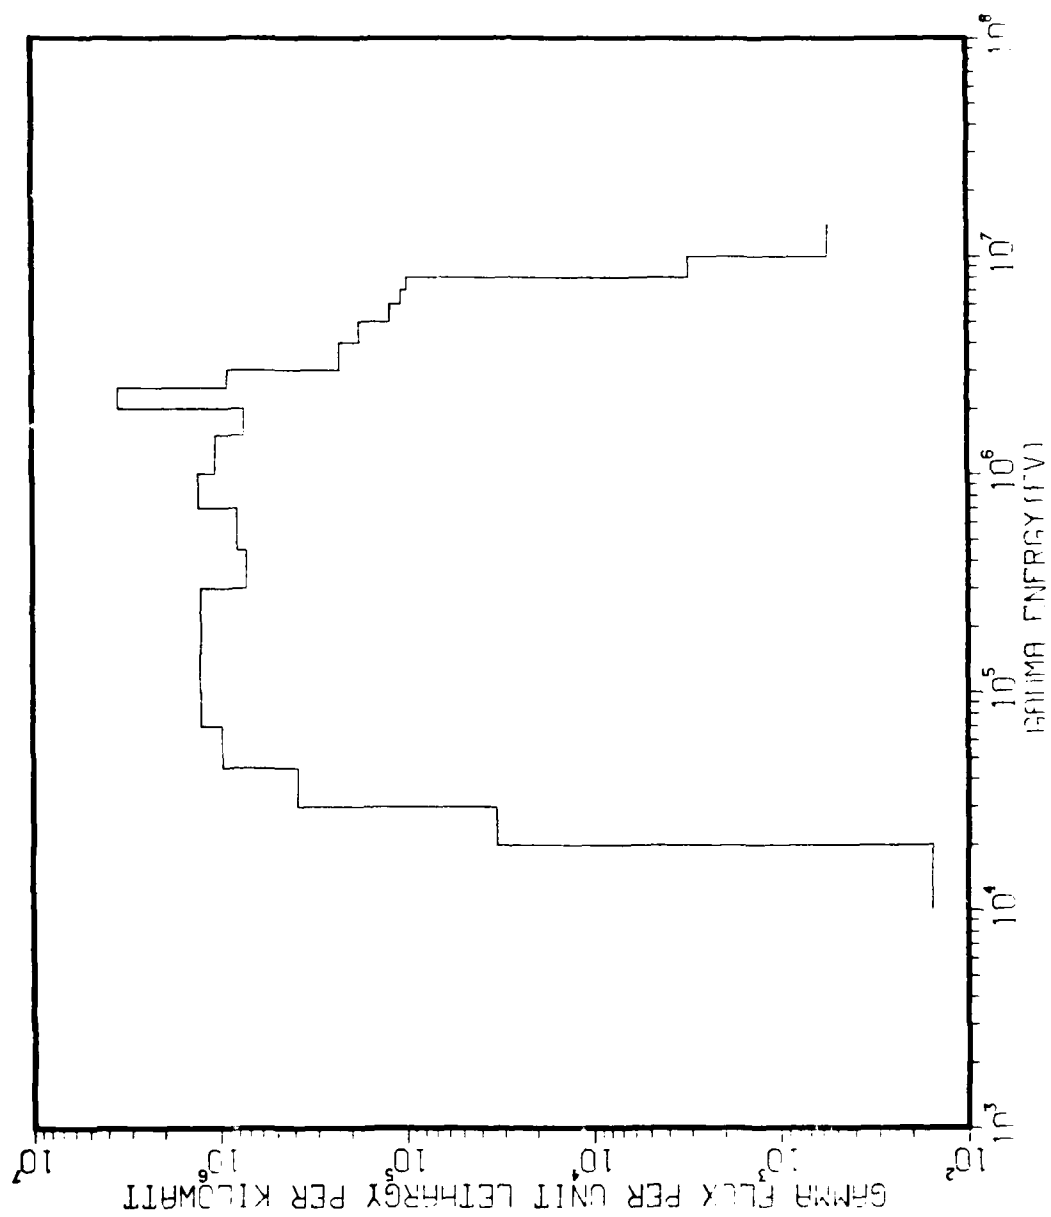


Figure II.3.12. Total (Front+Back) Gamma Flux vs Energy ER1 With 6" PB.

Table II.3.13. Neutron Flux Per Unit Lethargy Per Kilowatt.

GROUP	ENERGY (EV)	ERI WITH 6 IN. PB		TOTAL
		FRONT	BACK	
1	1.960E+07	1.06E+03	0.00E+00	1.06E+03
2	1.690E+07	5.49E+03	0.00E+00	5.49E+03
3	1.490E+07	1.31E+04	0.00E+00	1.31E+04
4	1.420E+07	1.54E+04	0.00E+00	1.54E+04
5	1.380E+07	3.38E+04	0.00E+00	3.38E+04
6	1.280E+07	4.59E+04	0.00E+00	4.59E+04
7	1.220E+07	9.26E+04	0.00E+00	9.26E+04
8	1.110E+07	1.79E+05	0.00E+00	1.79E+05
9	1.000E+07	3.48E+05	0.00E+00	3.48E+05
10	9.050E+06	5.63E+05	0.00E+00	5.63E+05
11	8.190E+06	9.04E+05	0.00E+00	9.04E+05
12	7.410E+06	1.49E+06	4.75E+01	1.49E+06
13	6.380E+06	2.59E+06	4.20E+02	2.59E+06
14	4.970E+06	2.86E+06	1.91E+03	2.86E+06
15	4.720E+06	3.38E+06	5.99E+03	3.39E+06
16	4.070E+06	5.05E+06	1.26E+04	5.06E+06
17	3.010E+06	1.05E+07	5.94E+04	1.06E+07
18	2.390E+06	1.28E+07	5.73E+04	1.28E+07
19	2.310E+06	1.67E+07	6.79E+04	1.68E+07
20	1.830E+06	2.10E+07	1.31E+05	2.11E+07
21	1.110E+06	2.40E+07	2.52E+05	2.42E+07
22	5.500E+05	1.21E+07	2.32E+05	1.23E+07
23	1.580E+05	8.18E+06	2.13E+05	8.40E+06
24	1.110E+05	5.00E+06	1.67E+05	5.17E+06
25	5.250E+04	3.57E+06	1.43E+05	3.71E+06
26	2.480E+04	3.70E+06	1.38E+05	3.84E+06
27	2.190E+04	2.75E+06	1.34E+05	2.89E+06
28	1.030E+04	2.46E+06	1.34E+05	2.59E+06
29	3.350E+03	2.34E+06	1.39E+05	2.43E+06
30	1.230E+03	2.29E+06	1.45E+05	2.43E+06
31	5.830E+02	2.10E+06	1.49E+05	2.25E+06
32	1.010E+02	1.81E+06	1.50E+05	1.96E+06
33	2.900E+01	1.47E+06	1.47E+05	1.61E+06
34	1.070E+01	9.93E+05	1.39E+05	1.13E+06
35	3.060E+00	6.08E+05	1.31E+05	7.39E+05
36	1.130E+00	3.15E+05	1.23E+05	4.38E+05
37	4.140E-01	3.63E+04	3.40E+04	7.04E+04

Table II.3.1'. Gamma Flux Per Unit Lethargy Per Kilowatt

GROUP	ENERGY (EV)	ERI WITH 6 IN. PB		TOTAL
		FRONT	BACK	
1	1.400E+07	3.15E+02	2.40E+02	5.55E+02
2	1.000E+07	2.94E+03	1.63E+02	3.11E+03
3	8.000E+06	9.80E+04	5.77E+02	9.86E+04
4	7.000E+06	6.93E+04	3.68E+04	1.06E+05
5	6.000E+06	8.16E+04	3.99E+04	1.21E+05
6	5.000E+06	1.46E+05	3.09E+04	1.77E+05
7	4.000E+06	2.06E+05	2.14E+04	2.28E+05
8	3.000E+06	8.69E+05	3.33E+04	9.02E+05
9	2.500E+06	1.86E+06	1.60E+06	3.46E+06
10	2.000E+06	6.44E+05	9.27E+04	7.37E+05
11	1.500E+06	8.41E+05	2.00E+05	1.04E+06
12	1.000E+06	1.09E+06	2.09E+05	1.30E+06
13	7.000E+05	6.44E+05	1.61E+05	8.05E+05
14	4.500E+05	4.18E+05	3.04E+05	7.22E+05
15	3.000E+05	6.23E+05	6.39E+05	1.26E+06
16	1.500E+05	5.69E+05	7.01E+05	1.27E+06
17	1.000E+05	5.55E+05	7.01E+05	1.26E+06
18	7.000E+04	4.27E+05	5.50E+05	9.77E+05
19	4.500E+04	1.68E+05	2.15E+05	3.83E+05
20	3.000E+04	1.42E+04	1.89E+04	3.31E+04
21	2.000E+04	6.90E+01	8.71E+01	1.56E+02

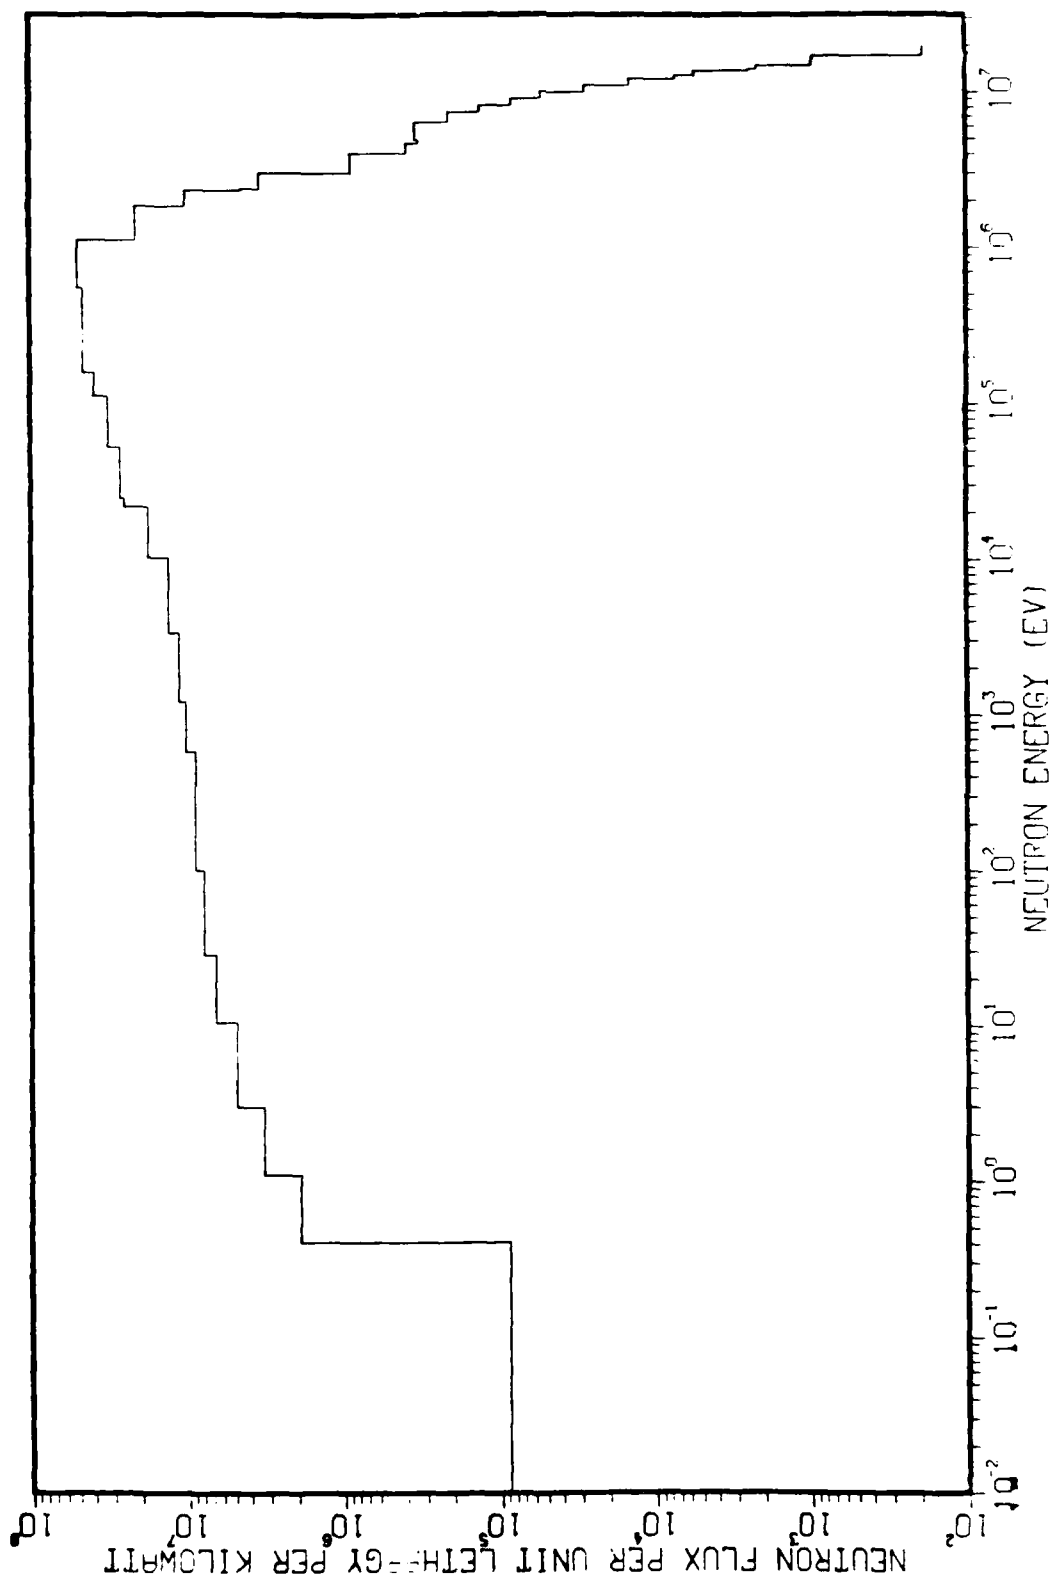


Figure II.3.13. Front (1-D) Neutron Flux vs Energy ERI With 6" PB and 2" Cave.

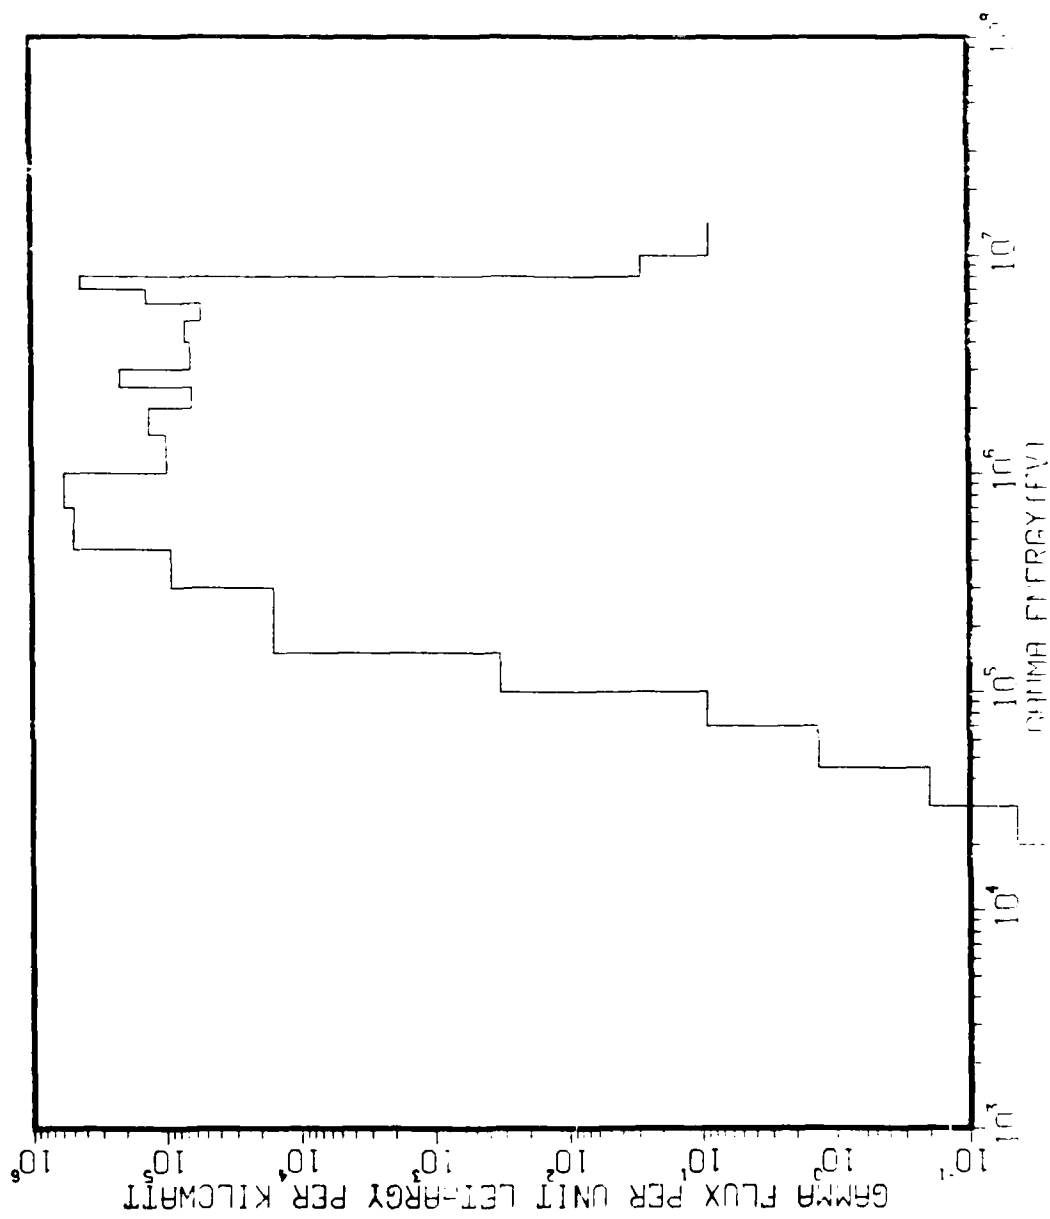


Figure II.3.14. Front Gamma Flux vs Energy ERI With 6" PB and 2" Cave.

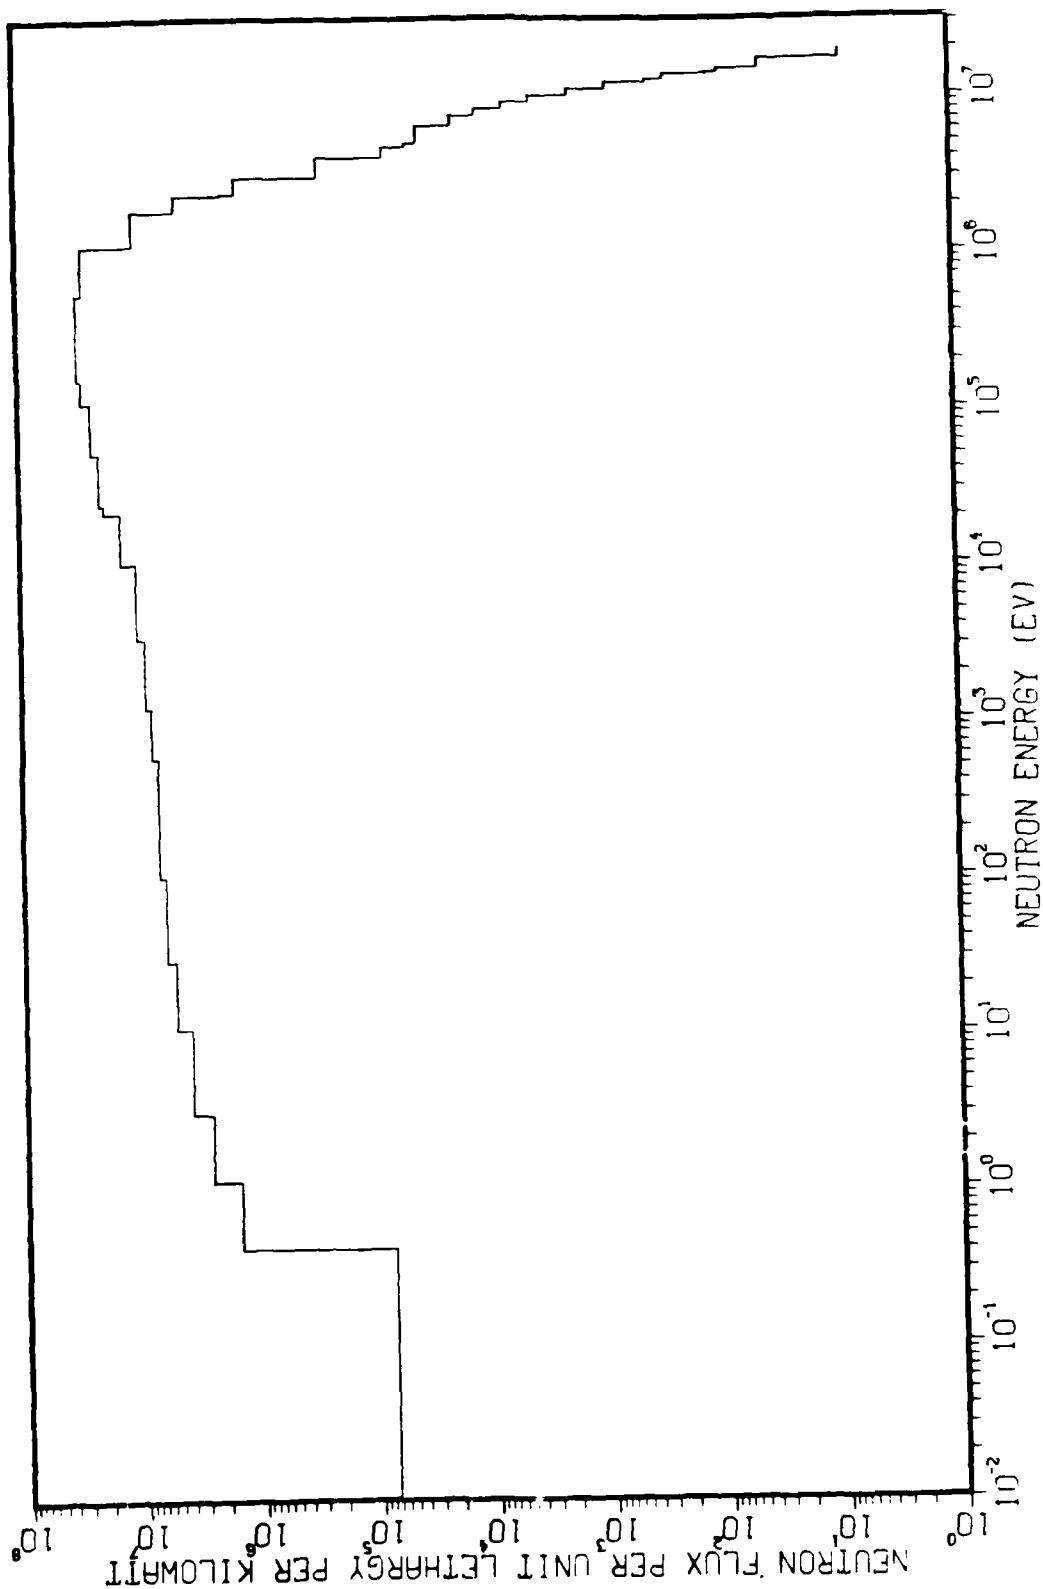


Figure II.3.15. Back (1-D) Neutron Flux vs Energy ER1 With 6" PB and 2" Cave.

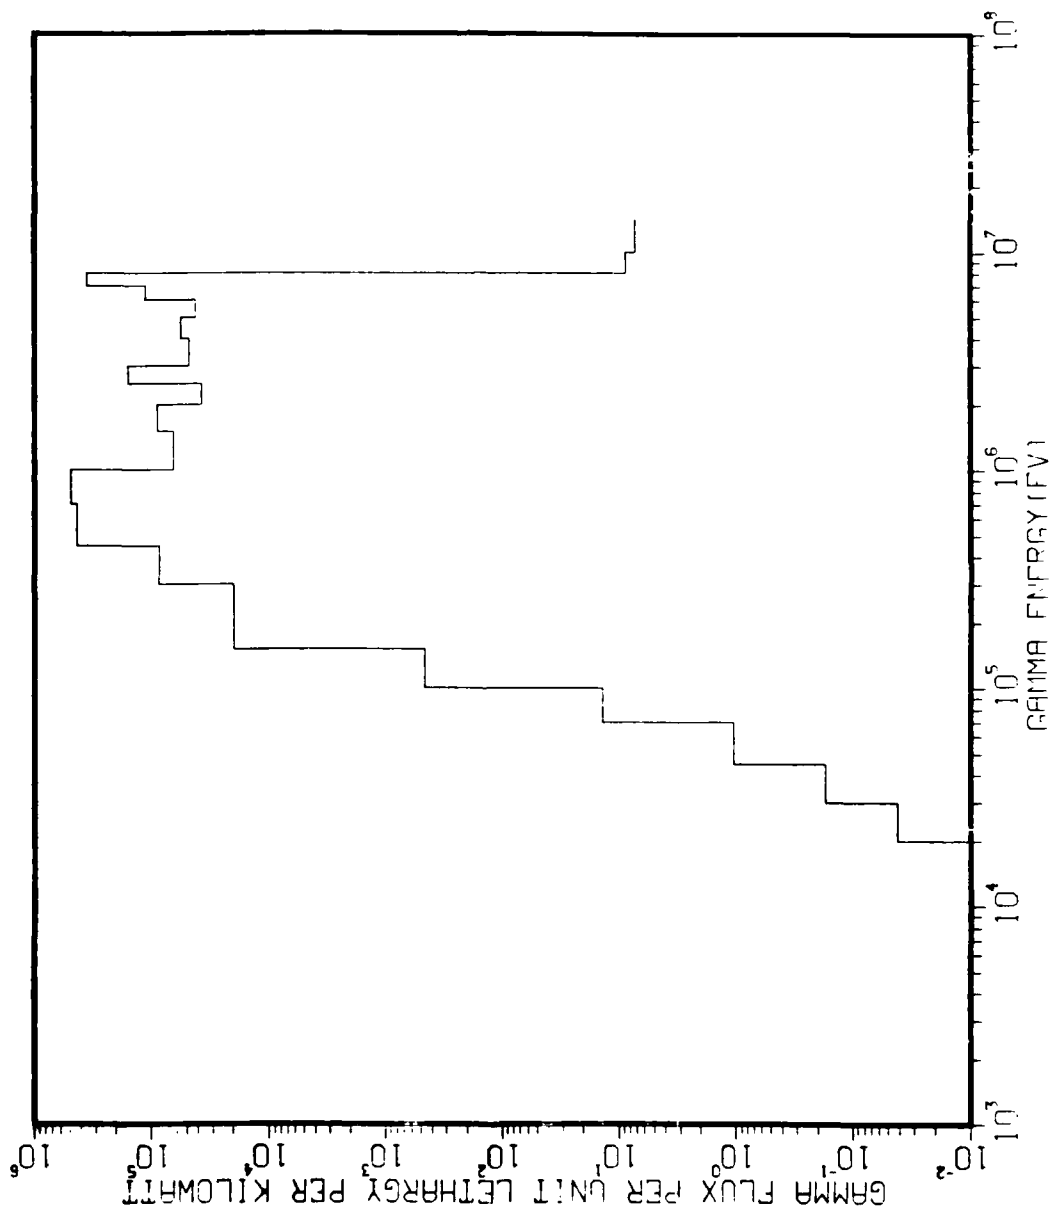


Figure II.3.16. Back Gamma Flux vs Energy ERI With 6" PB and 2" Cave.

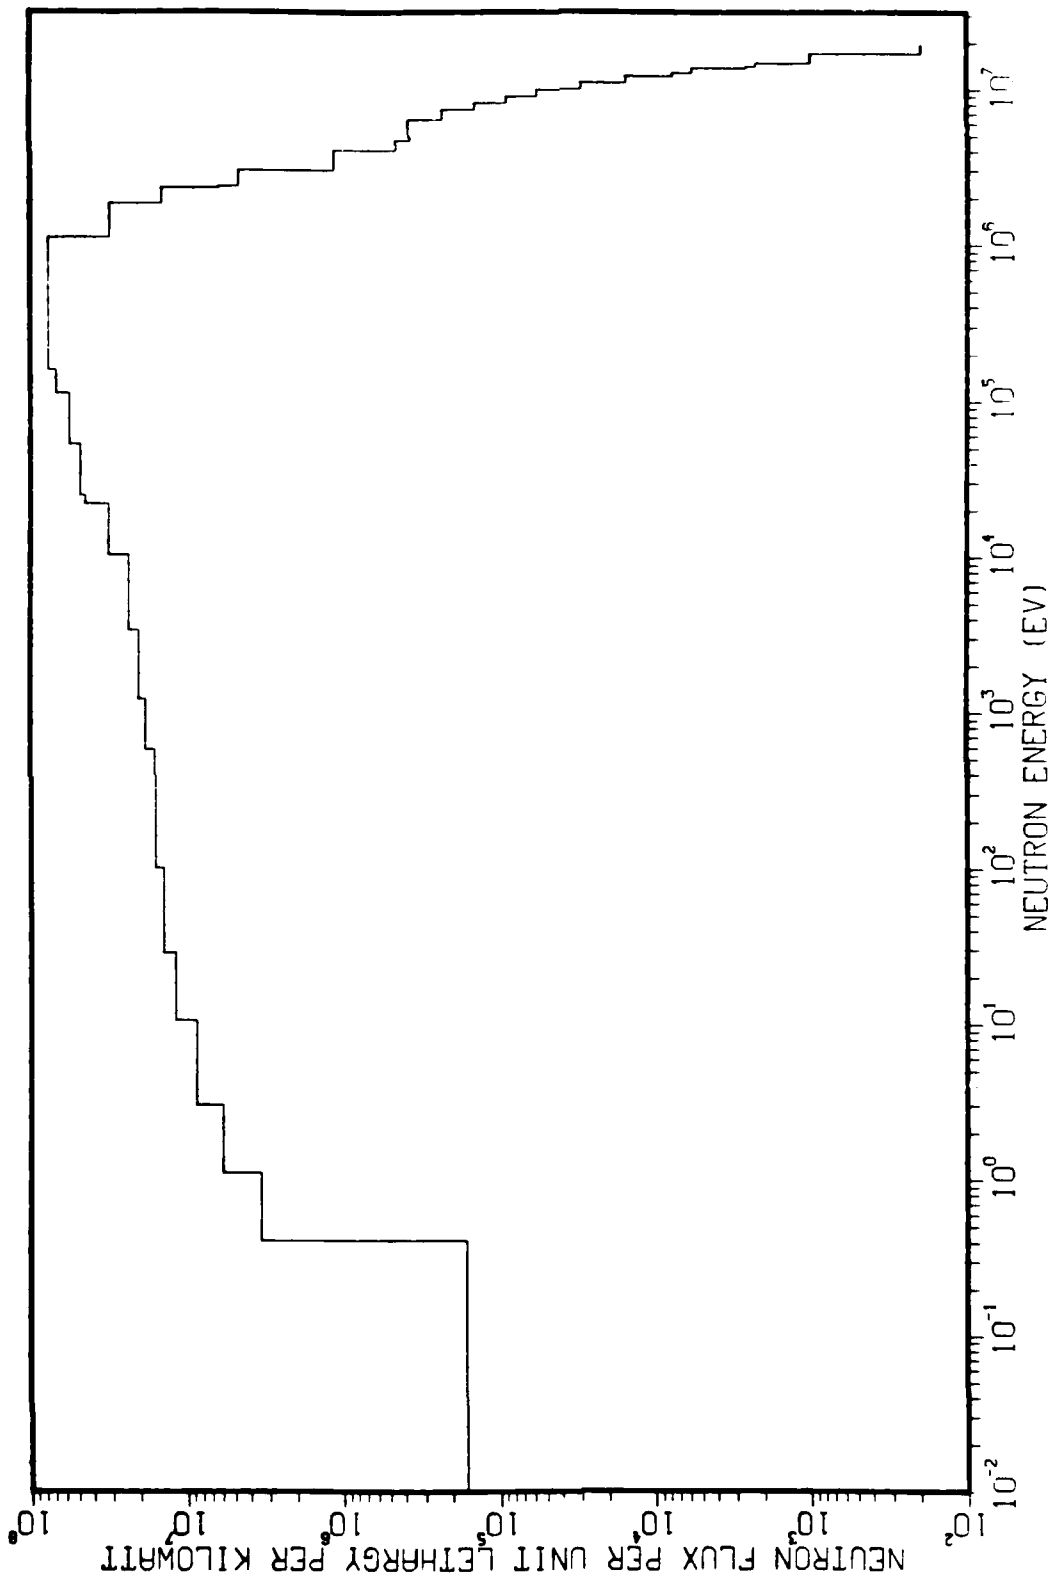


Figure II.3.17. Total (Front+Back, 1-D) Neutron Flux vs Energy ER1 With 6" PB and 2" Cave.

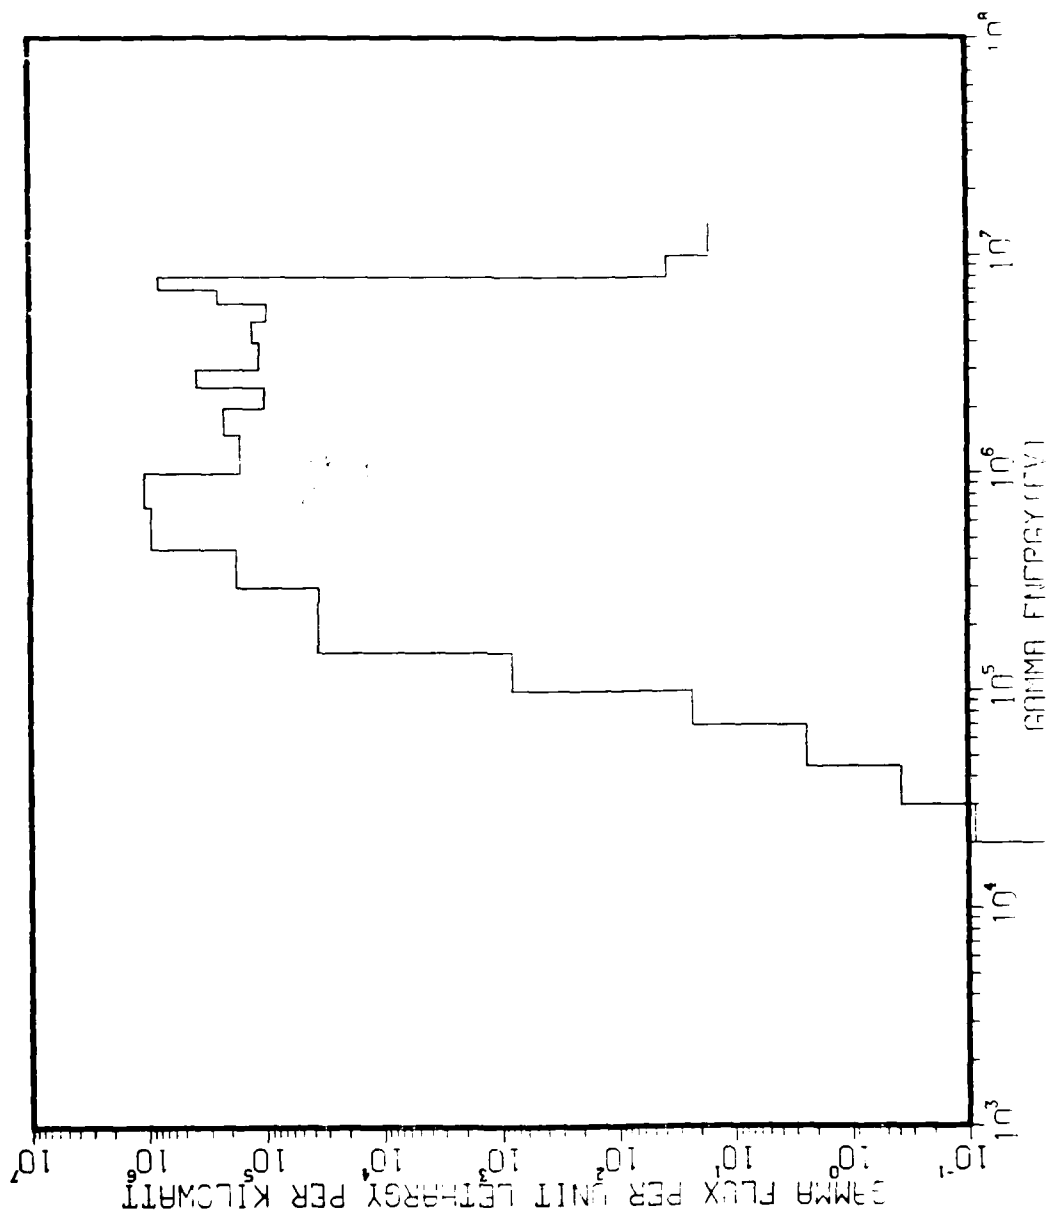


Figure II.3.18. Total (Front+Back) Gamma Flux vs Energy ERI With 6" PB and 2" Cave.

Table II.3.15. Neutron Flux Per Unit Lethargy Per Killowatt

ER1 WITH 6 IN. PB AND 2 IN. CAVE				
GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	1.88E+02	8.82E+00	1.96E+02
2	1.690E+07	9.46E+02	4.31E+01	9.89E+02
3	1.490E+07	2.13E+03	9.50E+01	2.23E+03
4	1.420E+07	2.43E+03	1.19E+02	2.55E+03
5	1.380E+07	5.38E+03	2.74E+02	5.65E+03
6	1.280E+07	7.13E+03	3.87E+02	7.52E+03
7	1.220E+07	1.42E+04	8.56E+02	1.51E+04
8	1.110E+07	2.74E+04	1.82E+03	2.92E+04
9	1.000E+07	5.27E+04	3.91E+03	5.66E+04
10	9.050E+06	8.23E+04	6.64E+03	8.89E+04
11	8.190E+06	1.32E+05	1.11E+04	1.43E+05
12	7.410E+06	2.13E+05	1.83E+04	2.31E+05
13	6.380E+06	3.45E+05	3.60E+04	3.81E+05
14	4.970E+06	3.31E+05	4.42E+04	3.75E+05
15	4.720E+06	3.98E+05	6.96E+04	4.68E+05
16	4.070E+06	9.01E+05	2.55E+05	1.16E+06
17	3.010E+06	3.43E+06	1.29E+06	4.72E+06
18	2.390E+06	4.51E+06	1.70E+06	6.21E+06
19	2.310E+06	1.02E+07	4.27E+06	1.45E+07
20	1.830E+06	2.12E+07	9.81E+06	3.10E+07
21	1.110E+06	4.97E+07	2.73E+07	7.69E+07
22	5.500E+05	4.61E+07	3.08E+07	7.69E+07
23	1.580E+05	3.93E+07	2.89E+07	6.82E+07
24	1.110E+05	3.18E+07	2.42E+07	5.60E+07
25	5.250E+04	2.70E+07	2.07E+07	4.77E+07
26	2.480E+04	2.54E+07	1.90E+07	4.44E+07
27	2.190E+04	1.79E+07	1.38E+07	3.17E+07
28	1.030E+04	1.33E+07	1.02E+07	2.35E+07
29	3.350E+03	1.15E+07	8.83E+06	2.03E+07
30	1.230E+03	1.03E+07	7.89E+06	1.82E+07
31	5.830E+02	9.08E+06	6.91E+06	1.60E+07
32	1.010E+02	8.00E+06	6.10E+06	1.41E+07
33	2.900E+01	6.75E+06	5.16E+06	1.19E+07
34	1.070E+01	4.92E+06	3.78E+06	8.70E+06
35	3.060E+00	3.34E+06	2.59E+06	5.93E+06
36	1.130E+00	1.92E+06	1.80E+06	3.42E+06
37	4.140E-01	8.79E+04	7.45E+04	1.62E+05

Table II.3.16. Gamma Flux Per Unit Lethargy Per Kilowatt.

GROUP	ERI WITH 6 IN. PB AND 2 IN. CAVE			
	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.400E+07	8.65E+00	7.22E+00	1.59E+01
2	1.000E+07	2.80E+01	8.67E+00	3.67E+01
3	8.000E+06	4.28E+05	3.56E+05	7.84E+05
4	7.000E+06	1.38E+05	1.12E+05	2.50E+05
5	6.000E+06	5.39E+04	4.16E+04	9.55E+04
6	5.000E+06	7.18E+04	5.54E+04	1.27E+05
7	4.000E+06	6.50E+04	4.68E+04	1.12E+05
8	3.000E+06	2.20E+05	1.56E+05	3.76E+05
9	2.500E+06	6.32E+04	3.71E+04	1.00E+05
10	2.000E+06	1.32E+05	8.85E+04	2.20E+05
11	1.500E+06	9.86E+04	6.44E+04	1.63E+05
12	1.000E+06	5.75E+05	4.91E+05	1.07E+06
13	7.000E+05	4.86E+05	4.39E+05	9.25E+05
14	4.500E+05	9.04E+04	8.57E+04	1.76E+05
15	3.000E+05	1.58E+04	1.97E+04	3.56E+04
16	1.500E+05	3.25E+02	4.62E+02	7.87E+02
17	1.000E+05	9.14E+00	1.37E+01	2.29E+01
18	7.000E+04	1.36E+00	1.06E+00	2.42E+00
19	4.500E+04	2.01E-01	1.74E-01	3.75E-01
20	3.000E+04	4.48E-02	4.20E-02	8.68E-02
21	2.000E+04	1.15E-02	9.85E-03	2.14E-02

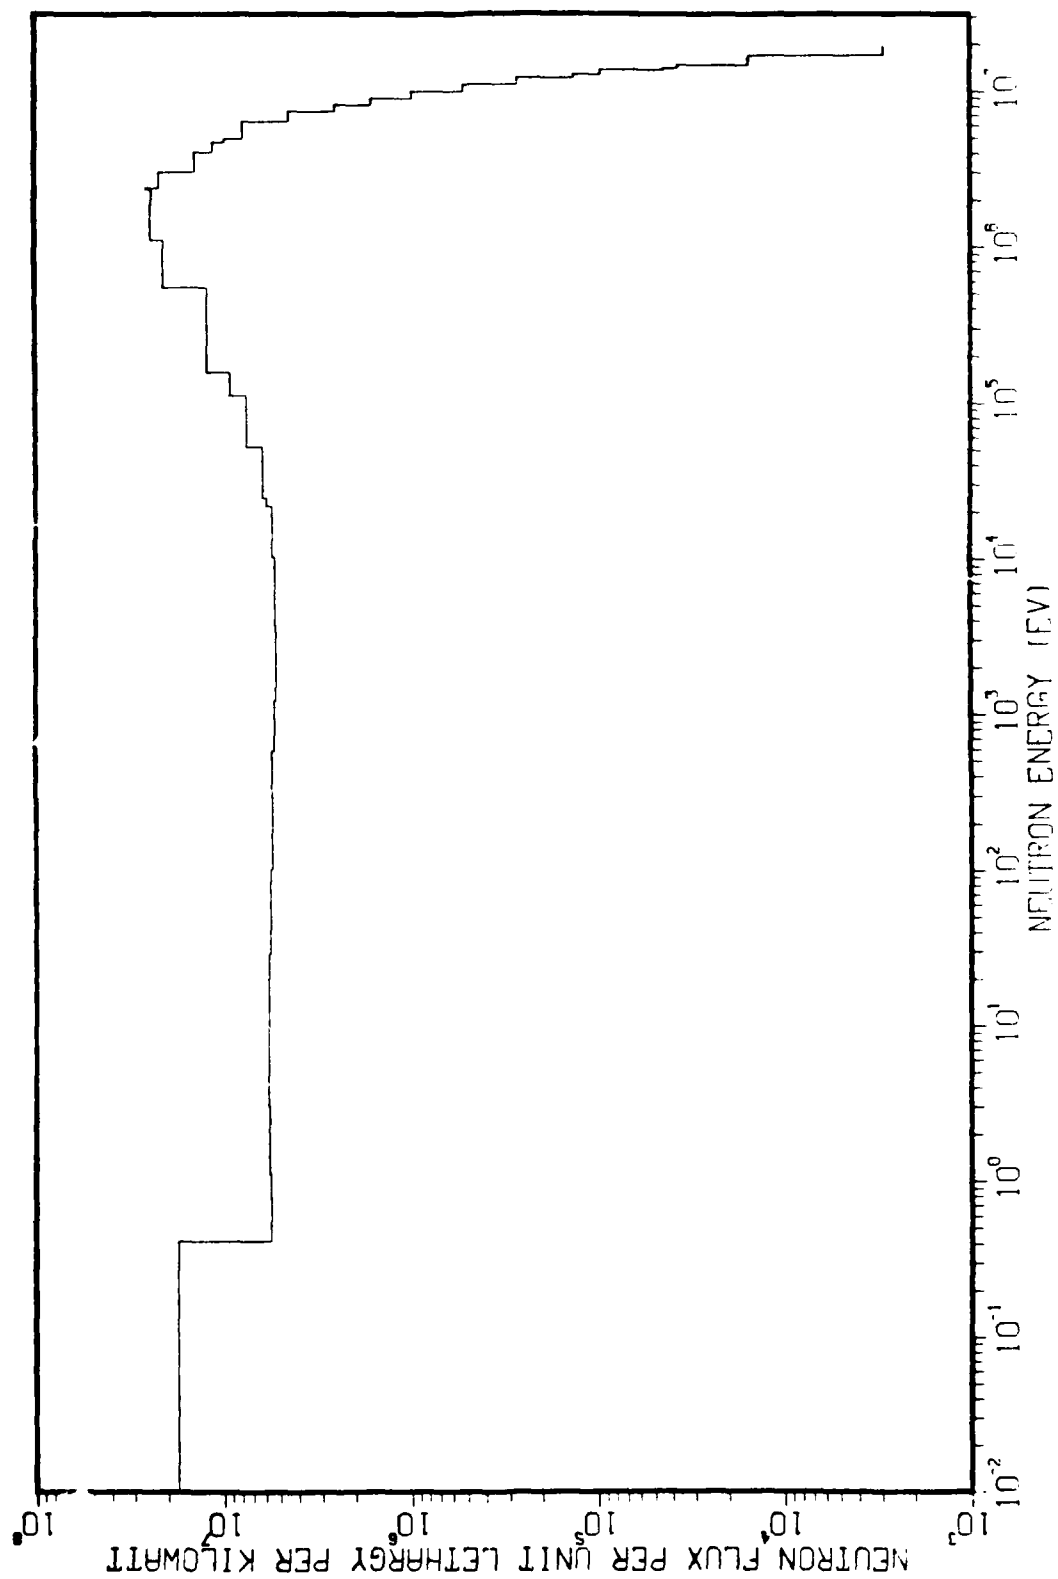


Figure II.3.19. Front (1-0) Neutron Flux vs Energy ERI With 2" PB and Exercise Wheel.

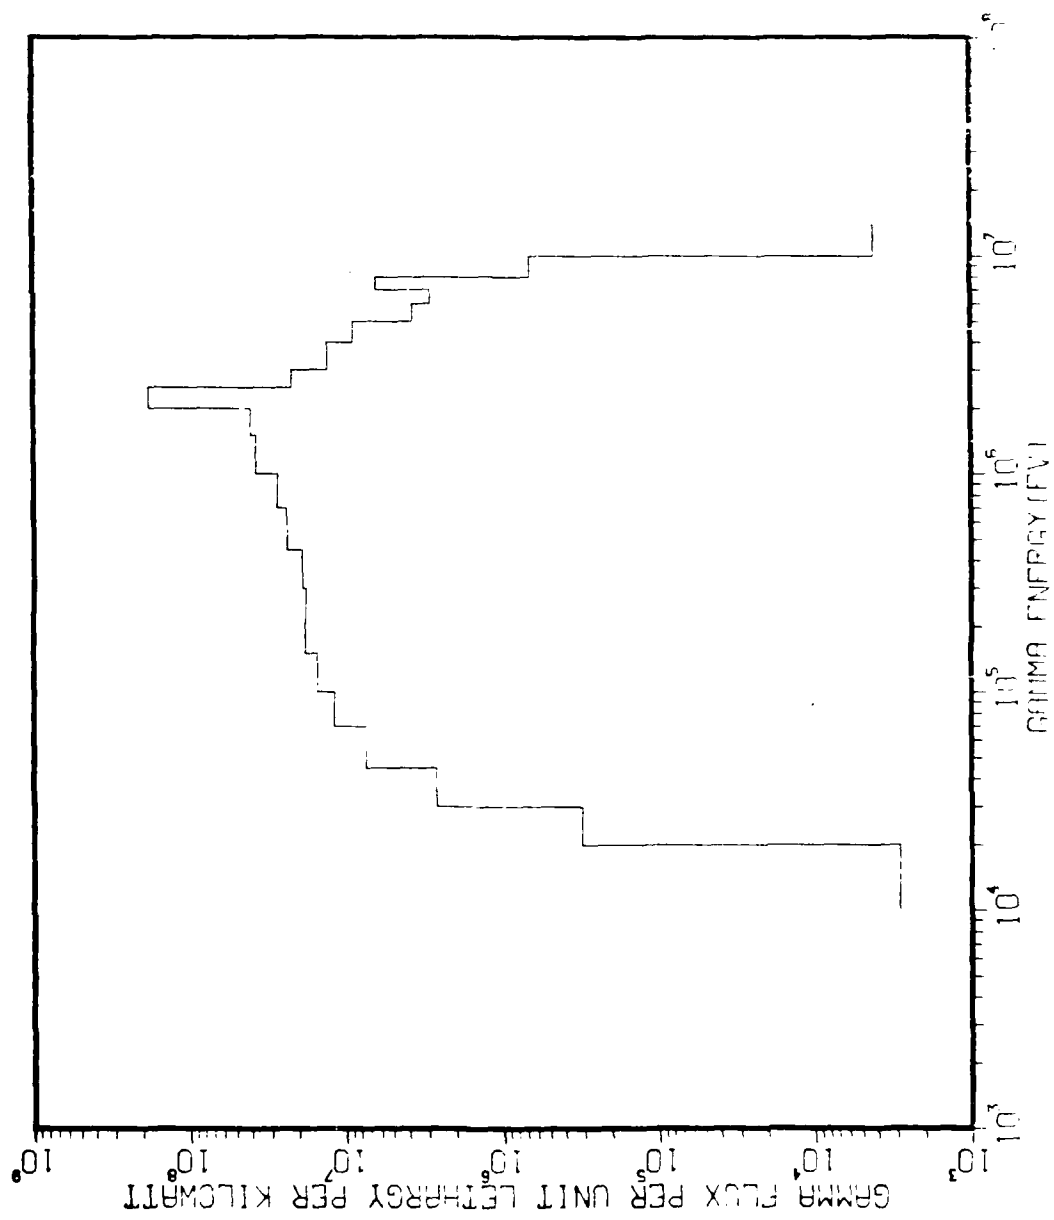


Figure II.3.20. Front Gamma Flux vs Energy ER1 With 2" PB and Exercise Wheel.

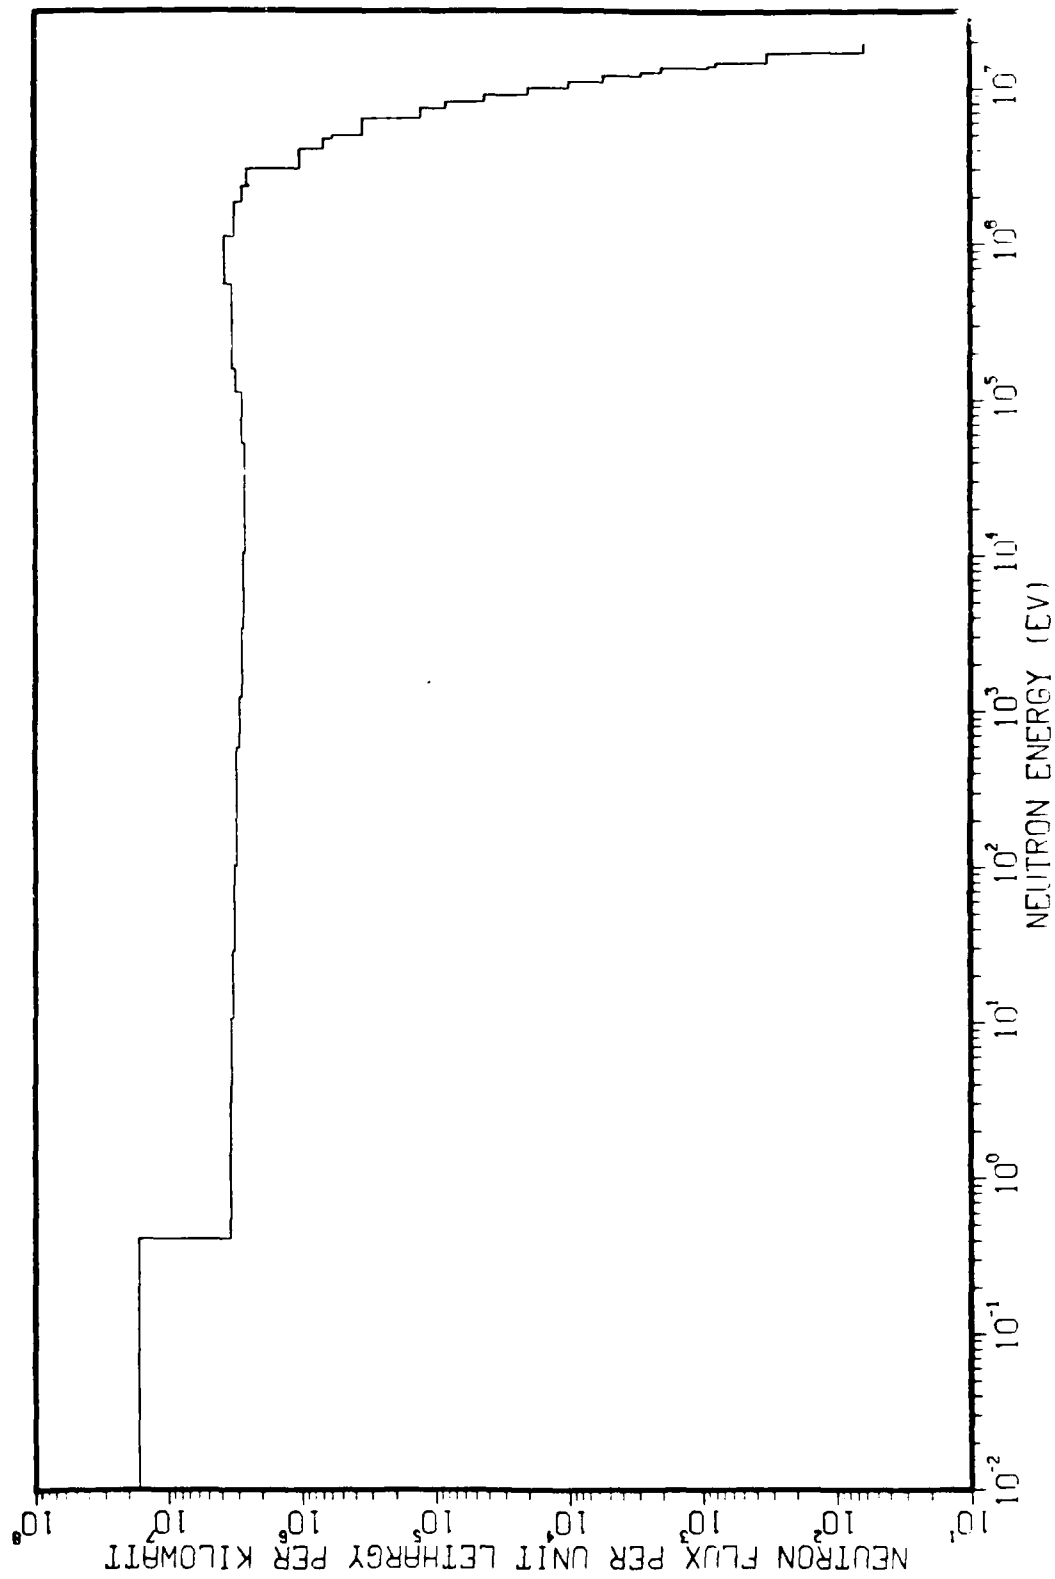


Figure II.3.21. Back (1-D) Neutron Flux vs Energy ERI With 2" PB and Exercise Wheel.

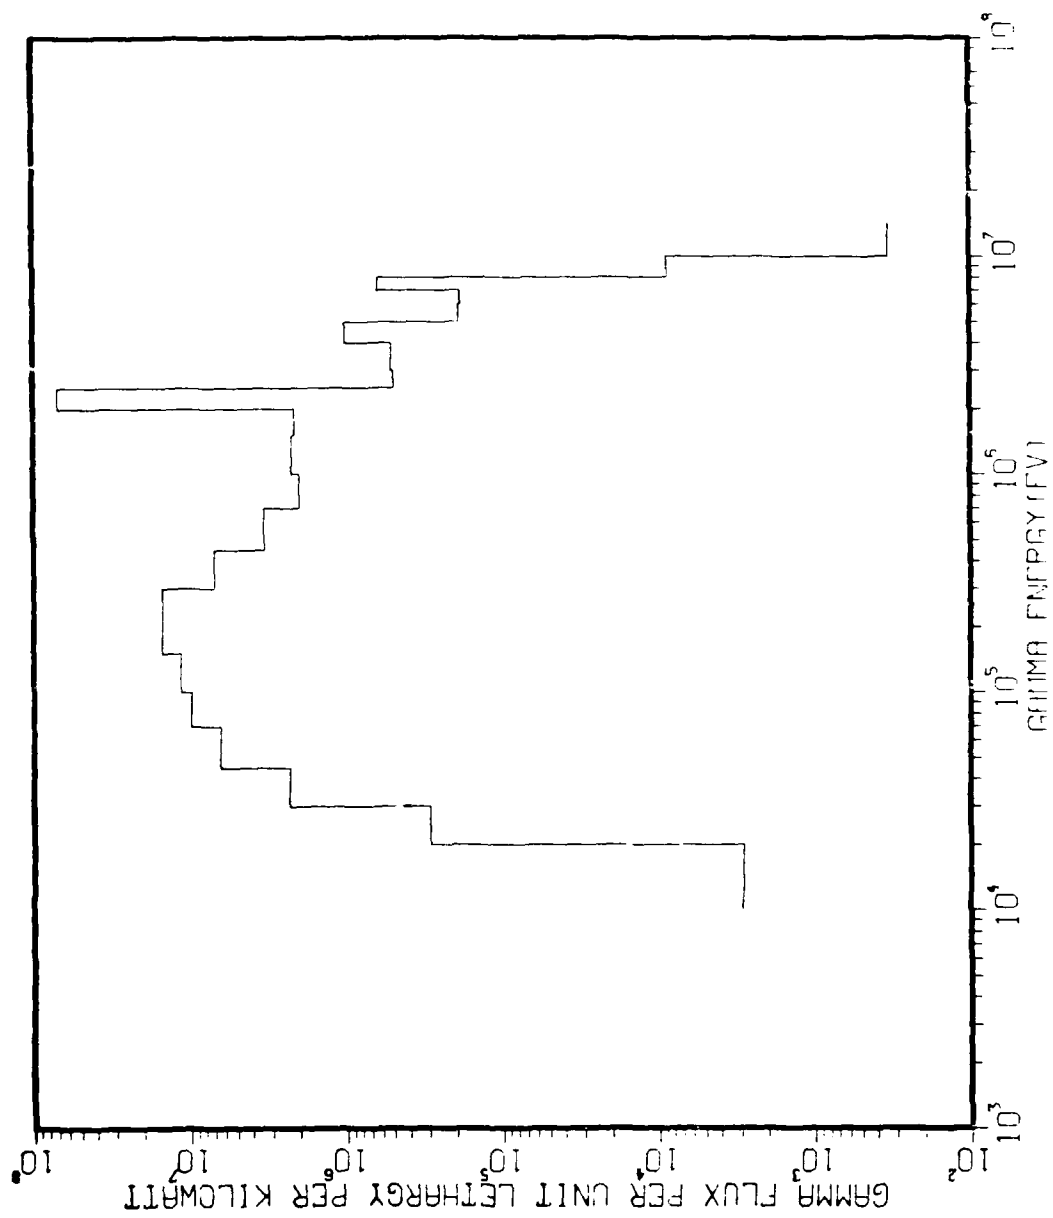


Figure II.3.22. Back Gamma Flux vs Energy ER1 With 2" PB and Exercise Wheel.

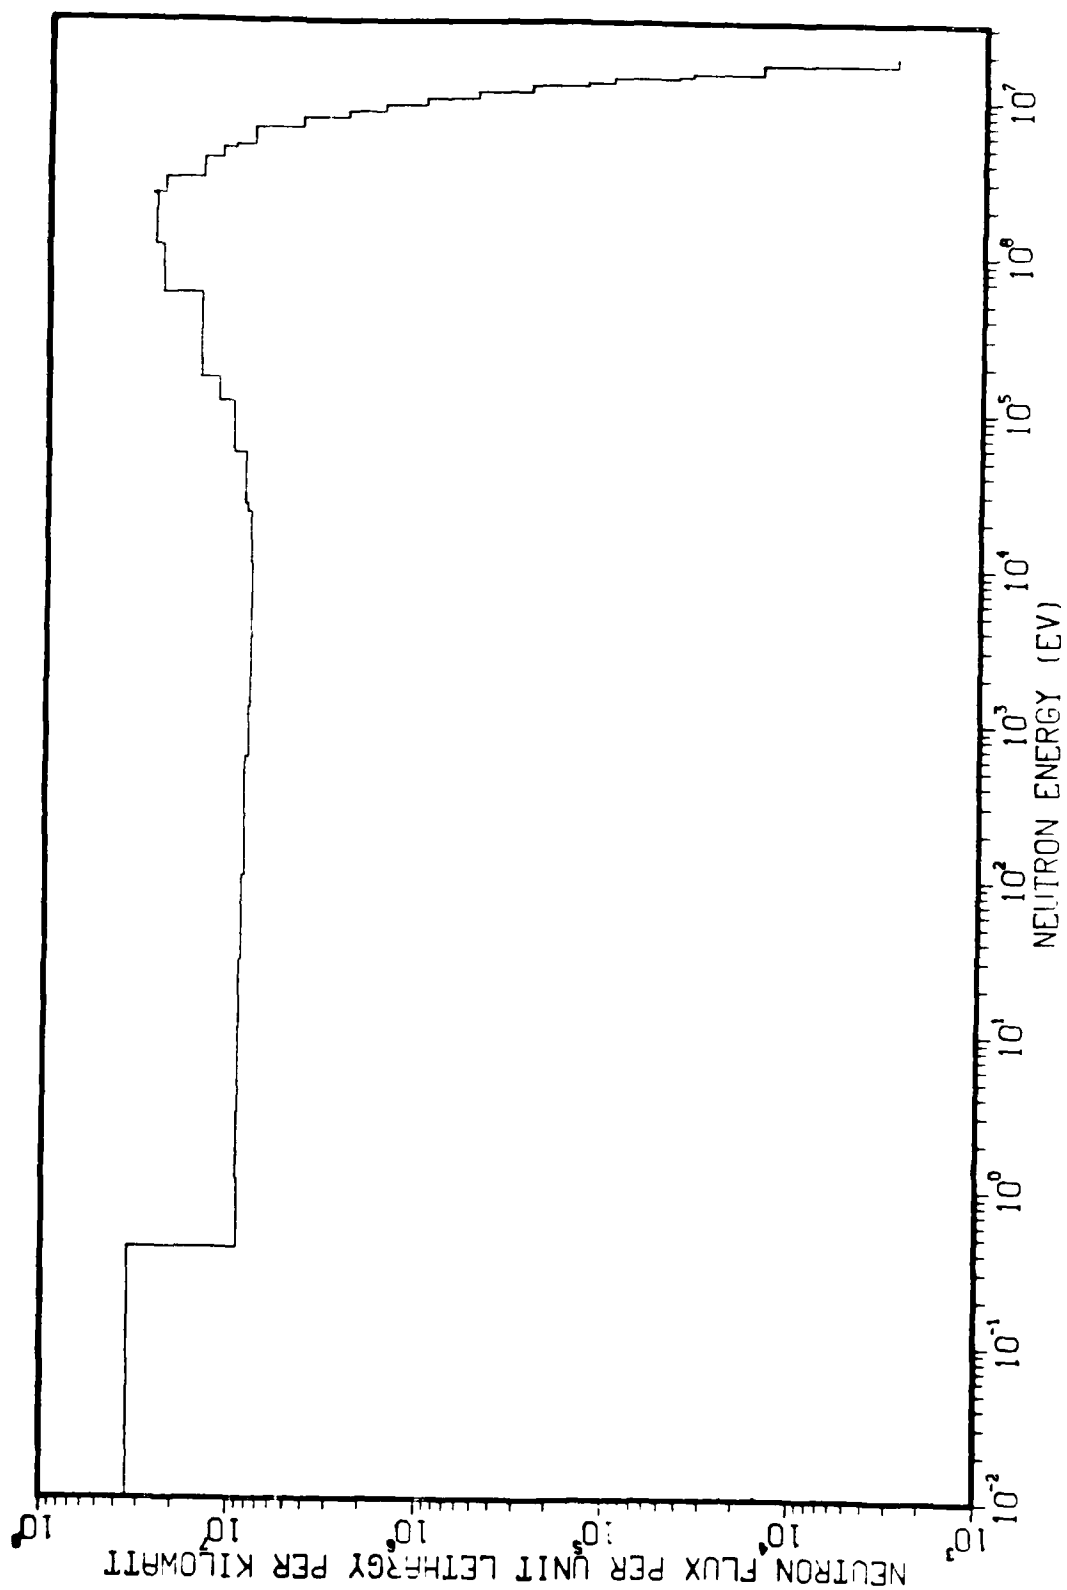


Figure II.3.23. Total (Front+Back, 1-D) Neutron Flux vs Energy ERI With 2" PB and Exercise Wheel.

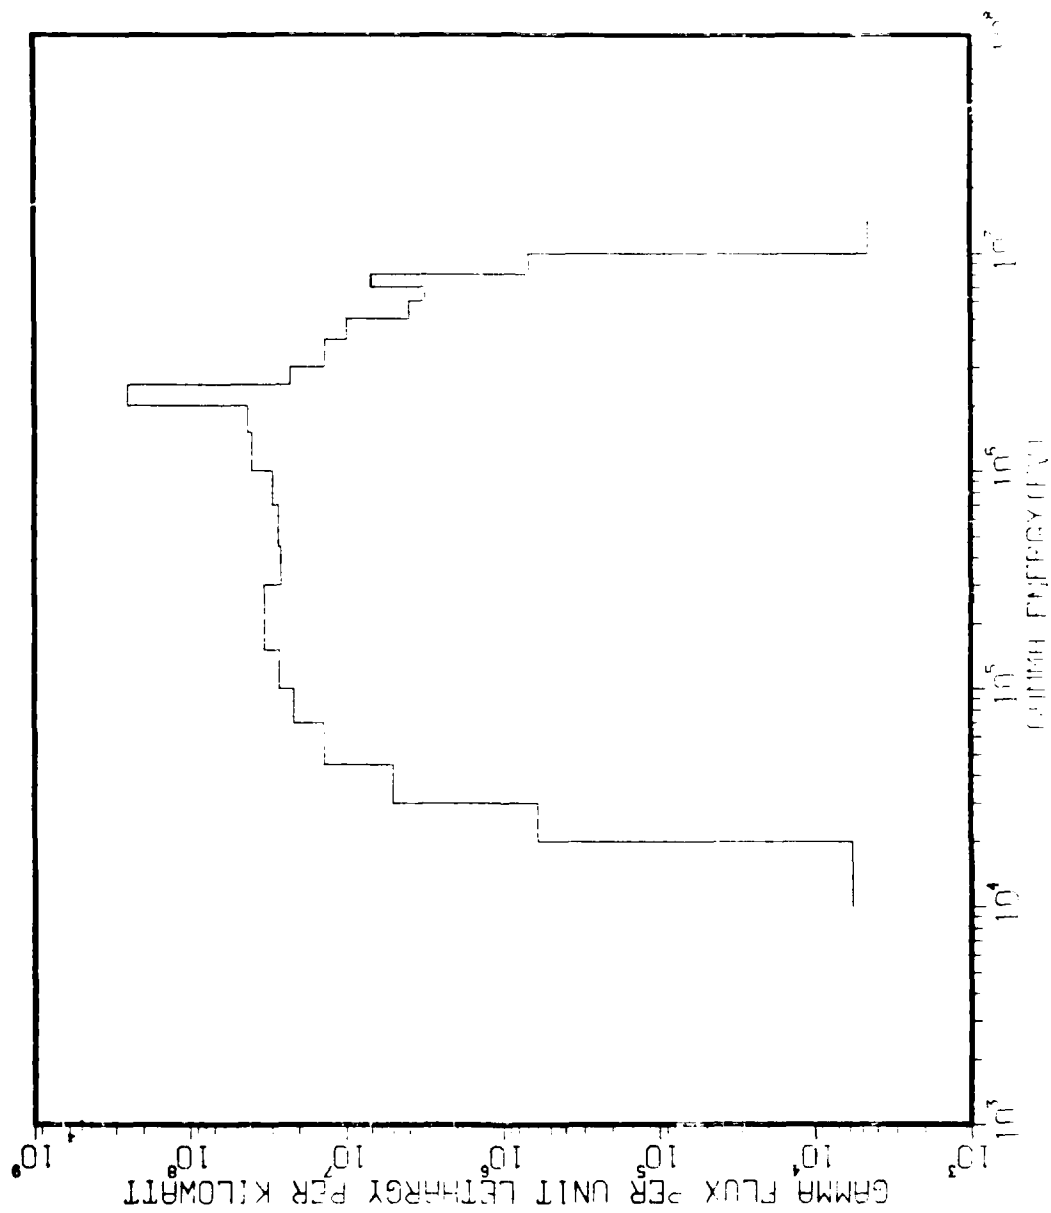


Figure II.3.24. Total (Front+Back) Gamma Flux vs Energy ERI With 2" PB and Exercise Wheel.

Table II.3.17. Neutron Flux Per Unit Lethargy Per Kilowatt.

ER1 WITH 2 IN. PB AND EXERCISE WHEEL				
GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	2.90E+03	6.16E+01	2.96E+03
2	1.690E+07	1.51E+04	3.29E+02	1.54E+04
3	1.490E+07	3.63E+04	8.02E+02	3.71E+04
4	1.420E+07	4.33E+04	9.11E+02	4.42E+04
5	1.380E+07	9.49E+04	2.04E+03	9.69E+04
6	1.280E+07	1.32E+05	2.89E+03	1.35E+05
7	1.220E+07	2.65E+05	5.45E+03	2.70E+05
8	1.110E+07	5.15E+05	9.97E+03	5.25E+05
9	1.000E+07	9.78E+05	1.99E+04	9.98E+05
10	9.050E+06	1.63E+06	4.17E+04	1.67E+06
11	8.190E+06	2.51E+06	8.16E+04	2.59E+06
12	7.410E+06	4.42E+06	1.26E+05	4.55E+06
13	6.380E+06	7.85E+06	3.46E+05	8.20E+06
14	4.970E+06	9.77E+06	5.79E+05	1.04E+07
15	4.720E+06	1.14E+07	6.77E+05	1.21E+07
16	4.070E+06	1.40E+07	1.02E+06	1.50E+07
17	3.010E+06	2.18E+07	2.51E+06	2.43E+07
18	2.390E+06	2.56E+07	2.40E+06	2.80E+07
19	2.310E+06	2.41E+07	2.75E+06	2.69E+07
20	1.830E+06	2.42E+07	3.14E+06	2.73E+07
21	1.110E+06	2.08E+07	3.71E+06	2.45E+07
22	5.500E+05	1.22E+07	3.26E+06	1.54E+07
23	1.580E+05	9.20E+06	3.07E+06	1.23E+07
24	1.110E+05	7.47E+06	2.79E+06	1.03E+07
25	5.250E+04	6.21E+06	2.67E+06	8.88E+06
26	2.480E+04	5.88E+06	2.68E+06	8.56E+06
27	2.190E+04	5.53E+06	2.65E+06	8.18E+06
28	1.030E+04	5.33E+06	2.73E+06	8.07E+06
29	3.350E+03	5.30E+06	2.83E+06	8.13E+06
30	1.230E+03	5.41E+06	2.94E+06	8.35E+06
31	5.830E+02	5.54E+06	3.03E+06	8.61E+06
32	1.010E+02	5.70E+06	3.22E+06	8.92E+06
33	2.900E+01	5.79E+06	3.32E+06	9.11E+06
34	1.070E+01	5.78E+06	3.39E+06	9.17E+06
35	3.060E+00	5.76E+06	3.47E+06	9.22E+06
36	1.130E+00	5.60E+06	3.48E+06	9.08E+06
37	4.140E-01	1.77E+07	1.67E+07	3.44E+07

Table II.3.18. Gamma Flux Per Unit Lethargy Per Kilowatt.

ERI WITH 2 IN. PB AND EXERCISE WHEEL				
GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.400E+07	4.17E+03	3.32E+02	4.51E+03
2	1.000E+07	6.70E+05	8.66E+03	6.79E+05
3	8.000E+06	6.32E+06	6.24E+05	6.95E+06
4	7.000E+06	2.93E+06	1.83E+05	3.12E+06
5	6.000E+06	3.77E+06	1.88E+05	3.96E+06
6	5.000E+06	8.95E+06	1.00E+06	9.95E+06
7	4.000E+06	1.32E+07	5.12E+05	1.37E+07
8	3.000E+06	2.21E+07	4.90E+05	2.26E+07
9	2.500E+06	1.80E+08	6.96E+07	2.50E+08
10	2.000E+06	4.07E+07	2.13E+06	4.29E+07
11	1.500E+06	3.79E+07	2.23E+06	4.02E+07
12	1.000E+06	2.74E+07	1.98E+06	2.94E+07
13	7.000E+05	2.38E+07	3.32E+06	2.71E+07
14	4.500E+05	1.99E+07	6.97E+06	2.60E+07
15	3.900E+05	1.82E+07	1.51E+07	3.32E+07
16	1.500E+05	1.53E+07	1.14E+07	2.67E+07
17	1.000E+05	1.19E+07	9.85E+06	2.17E+07
18	7.000E+04	7.46E+06	6.42E+06	1.39E+07
19	4.500E+04	2.69E+06	2.31E+06	5.01E+06
20	3.000E+04	3.11E+05	2.91E+05	6.02E+05
21	2.000E+04	2.88E+03	2.86E+03	5.74E+03

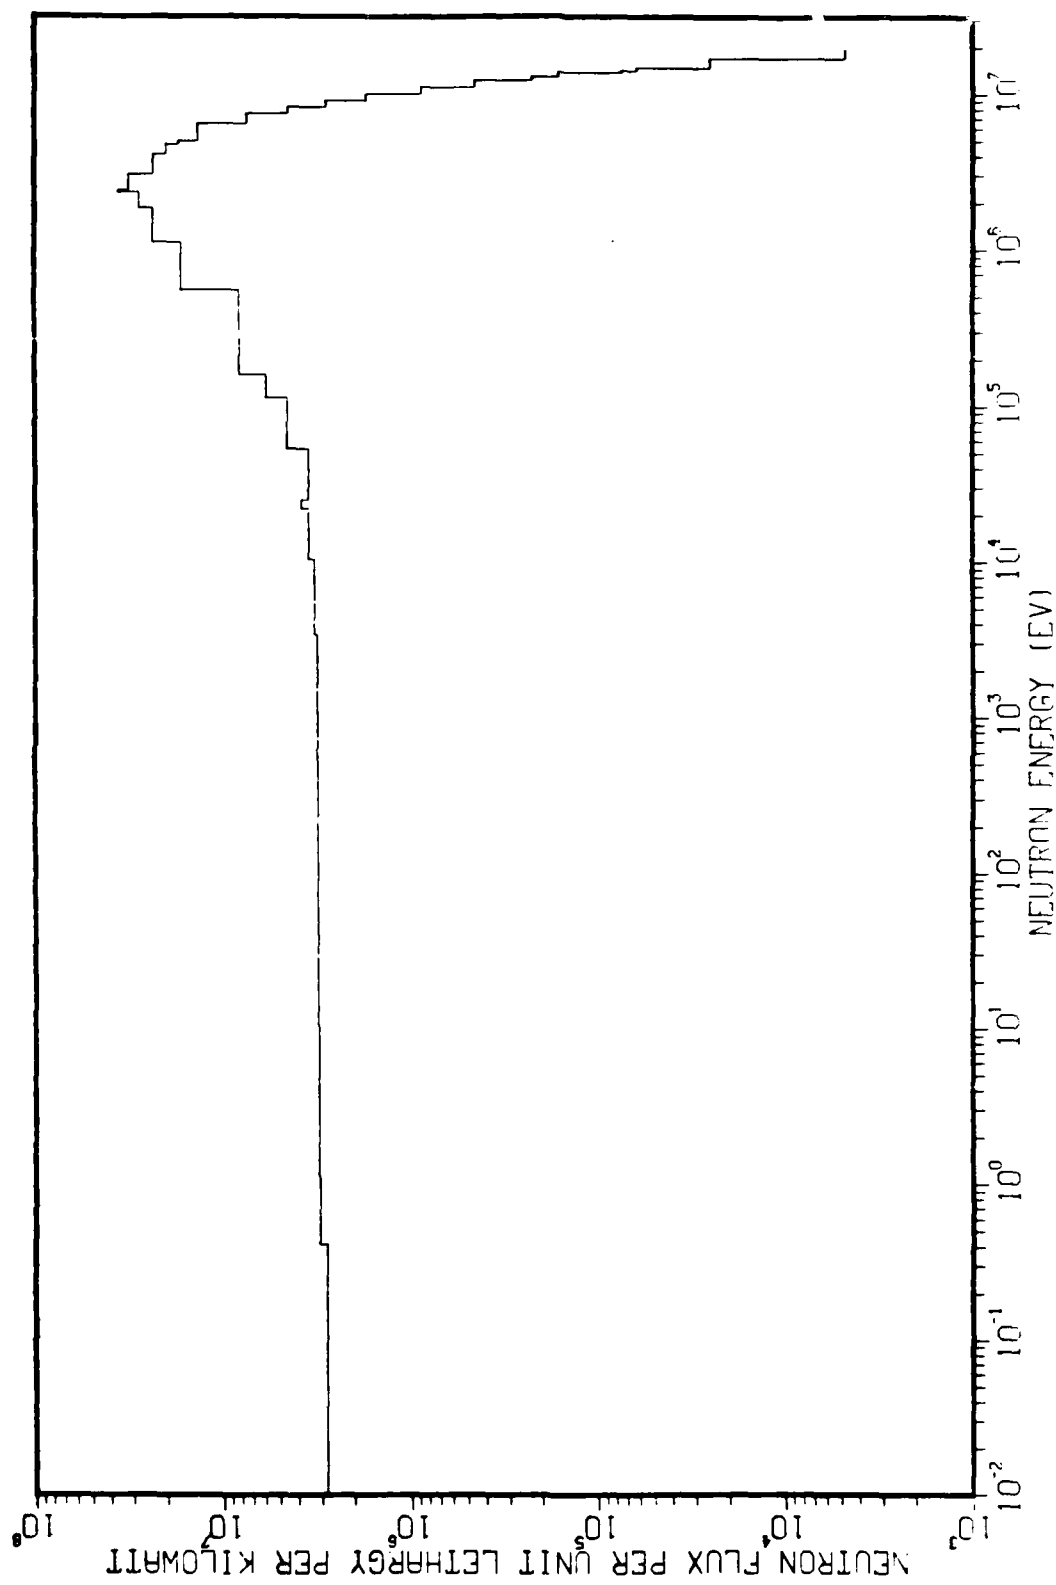


Figure II.3.25. Front (1-D) Neutron Flux vs Energy ER2 Free Field.

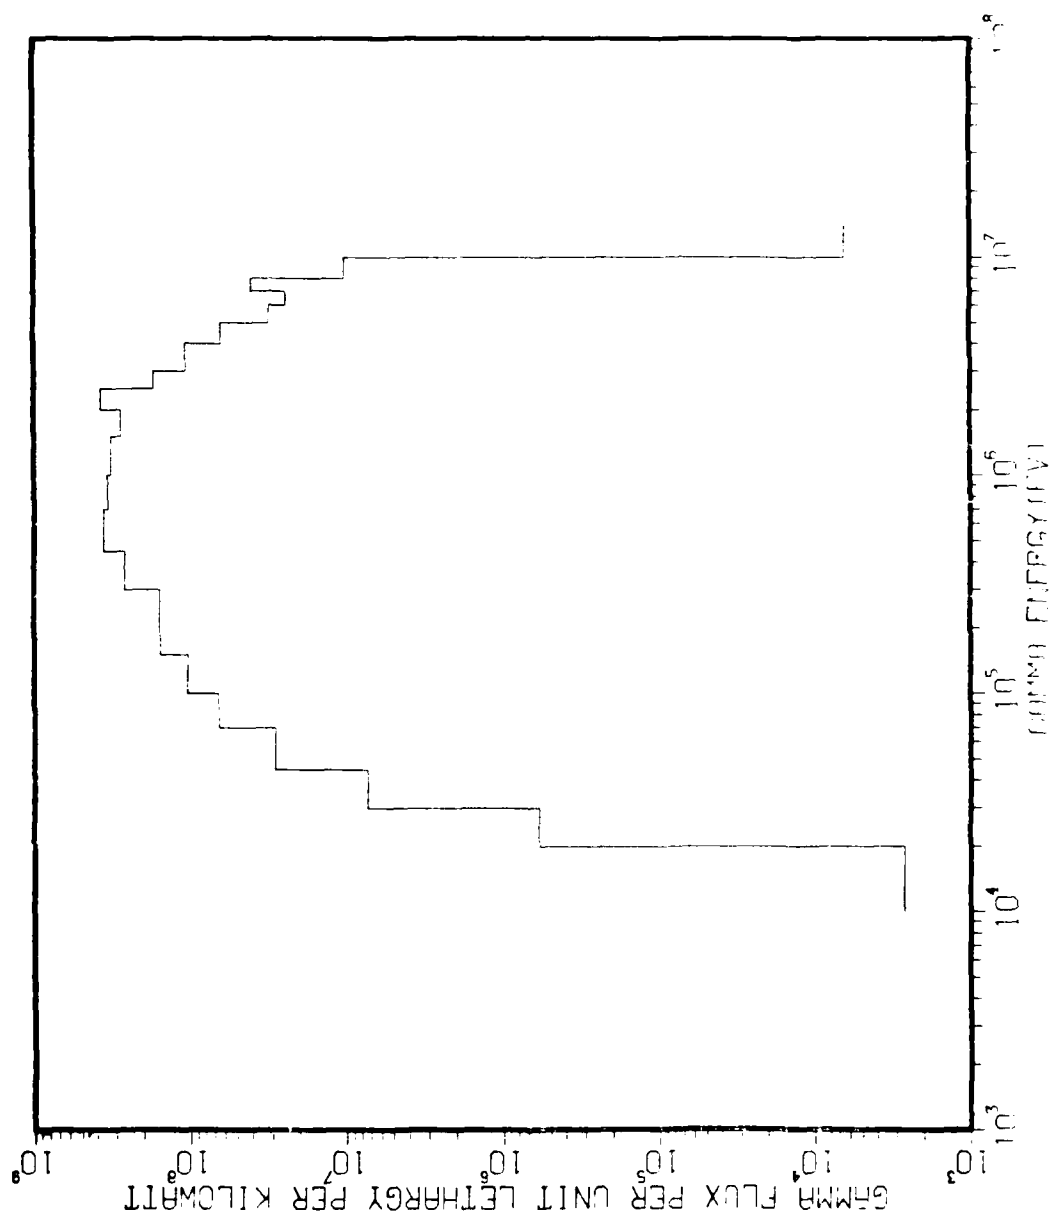


Figure II.3.26. Front Gamma Flux vs Energy ER2 Free Field.

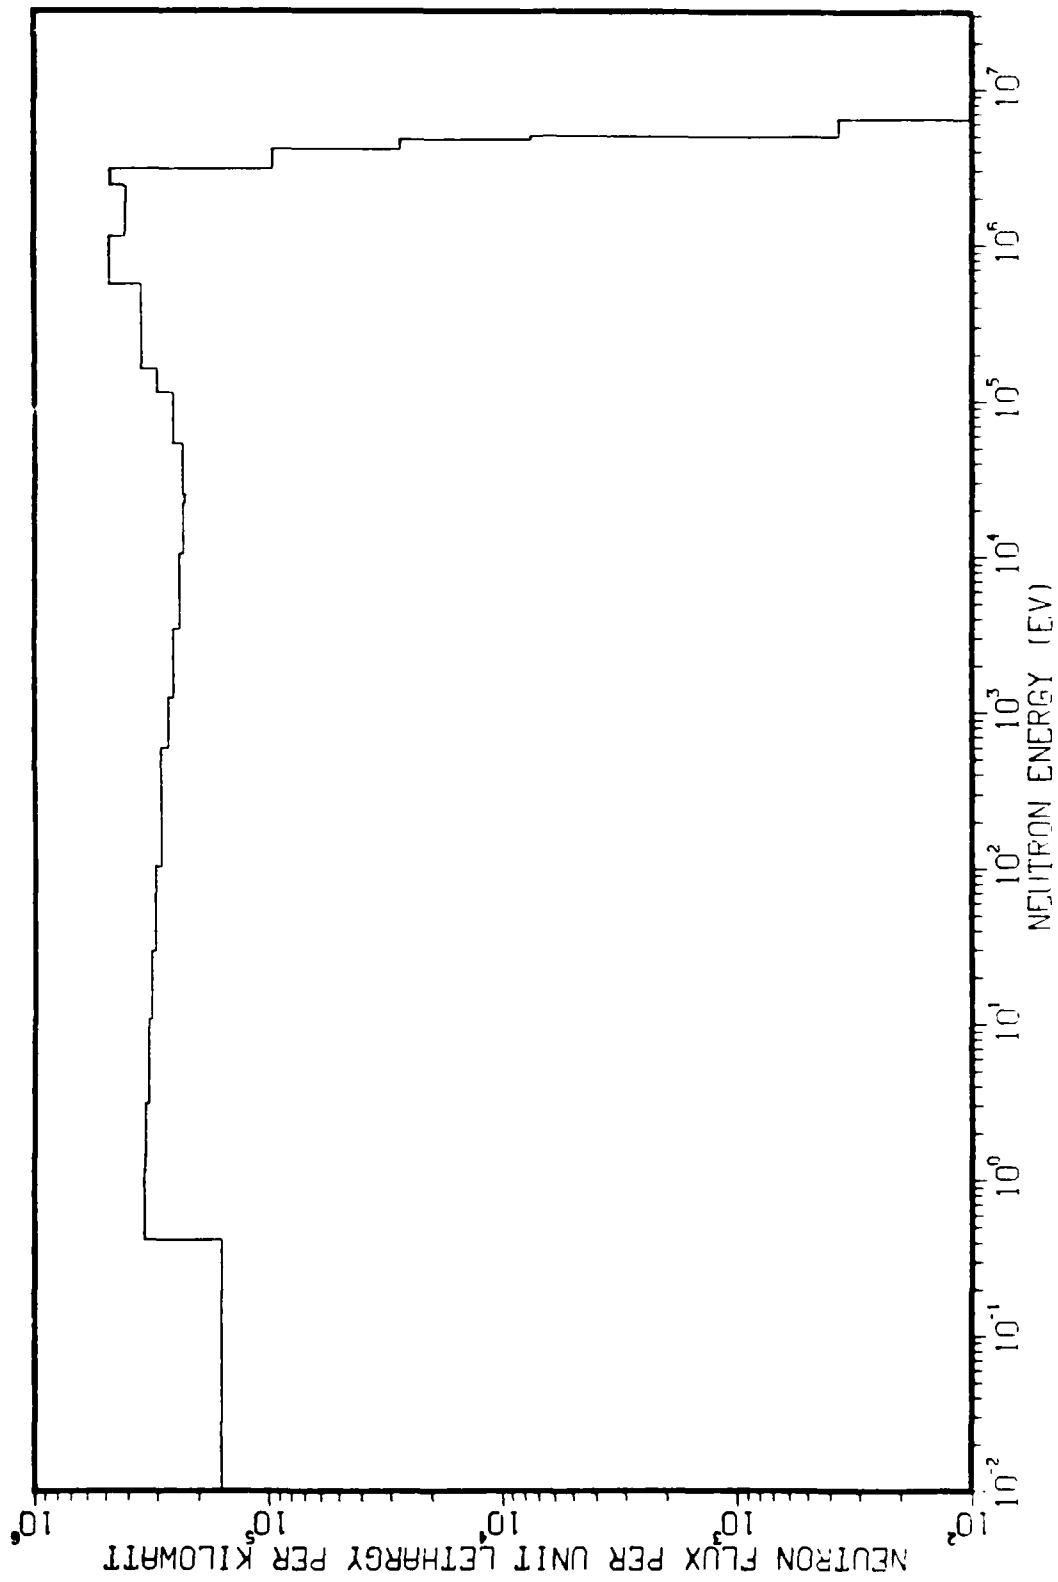


Figure II.3.27. Back (1-D) Neutron Flux vs Energy ER2 Free Field.

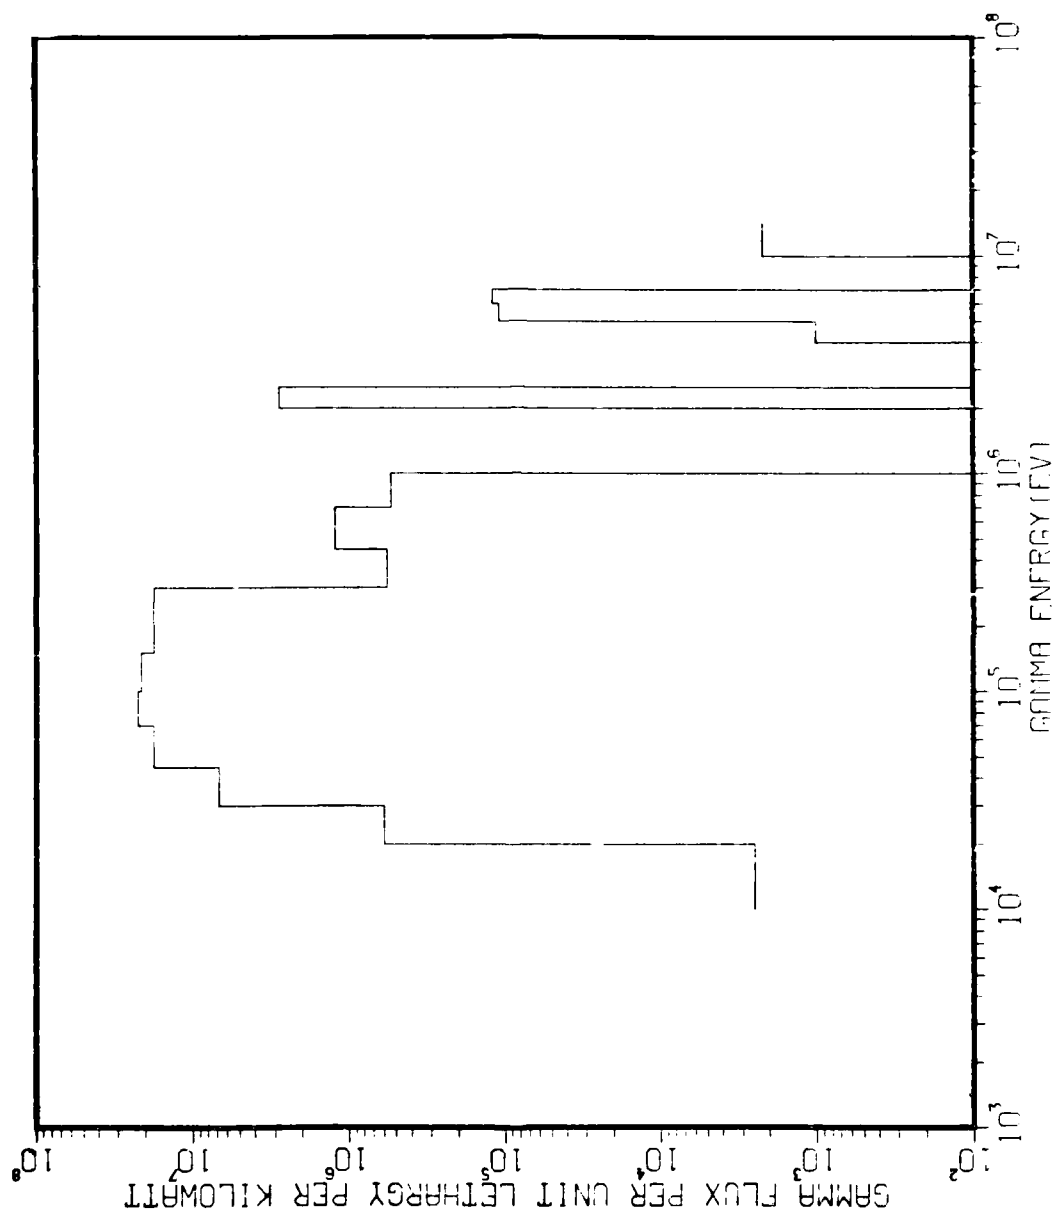


Figure II.3.28. Back Gamma Flux vs Energy ER2 Free Field.

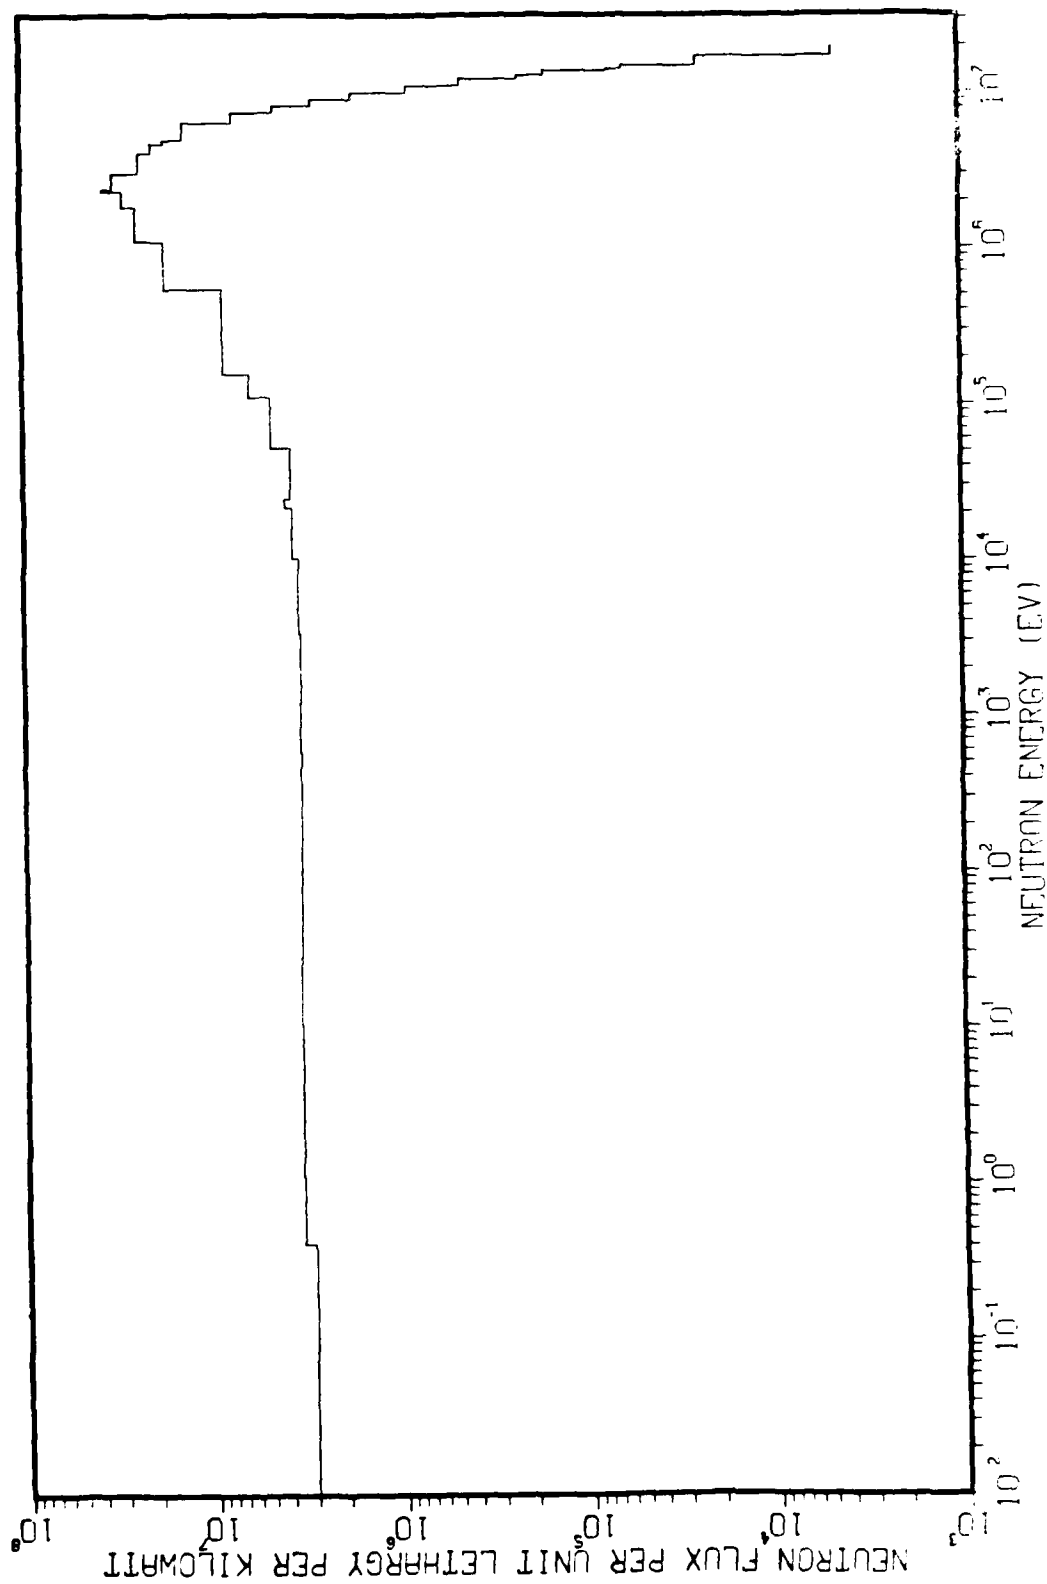


Figure II.3.29. Total (Front+Back, 1-D) Neutron Flux vs Energy ER2 Free Field.

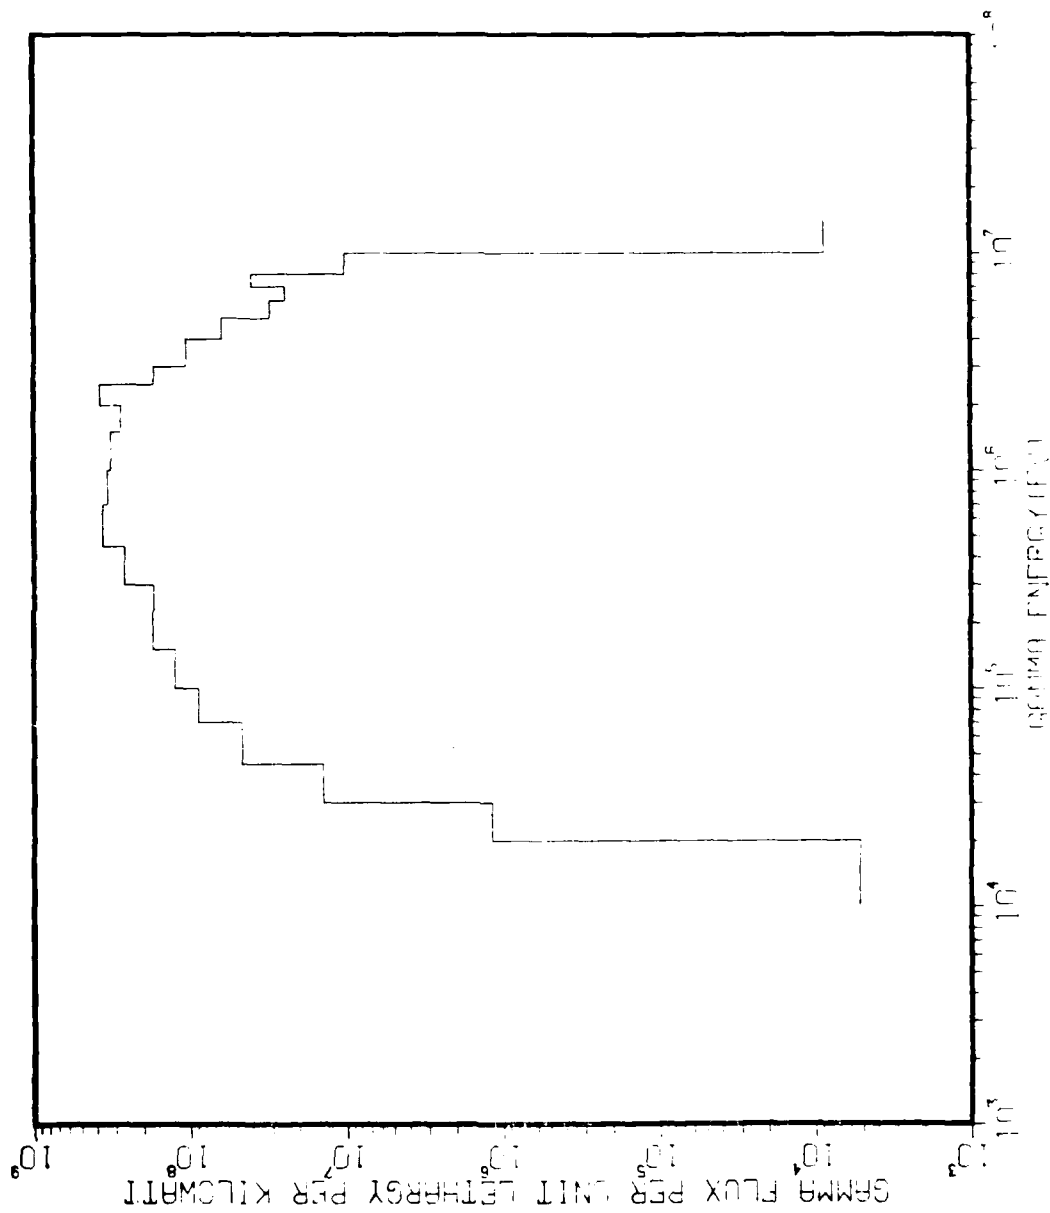


Figure II.3.30. Total (Front+Back) Gamma Flux vs Energy ER2 Free Field.

Table II.3.19. Neutron Flux Per Unit Lethargy Per Kilowatt.

GROUP	ENERGY (EV)	ER2 FREE FIELD		TOTAL
		FRONT	BACK	
1	1.960E+07	4.71E+03	0.00E+00	4.71E+03
2	1.690E+07	2.51E+04	0.00E+00	2.51E+04
3	1.490E+07	6.19E+04	0.00E+00	6.19E+04
4	1.420E+07	7.45E+04	0.00E+00	7.45E+04
5	1.380E+07	1.63E+05	0.00E+00	1.63E+05
6	1.280E+07	2.26E+05	0.00E+00	2.26E+05
7	1.220E+07	4.62E+05	0.00E+00	4.62E+05
8	1.110E+07	8.93E+05	0.00E+00	8.93E+05
9	1.000E+07	1.73E+06	0.00E+00	1.73E+06
10	9.030E+06	2.85E+06	0.00E+00	2.85E+06
11	8.190E+06	4.56E+06	0.00E+00	4.56E+06
12	7.410E+06	7.53E+06	0.00E+00	7.53E+06
13	6.380E+06	1.36E+07	3.71E+02	1.36E+07
14	4.970E+06	1.73E+07	7.51E+03	1.74E+07
15	4.720E+06	2.02E+07	2.74E+04	2.02E+07
16	4.070E+06	2.34E+07	9.56E+04	2.35E+07
17	3.010E+06	3.18E+07	4.73E+05	3.23E+07
18	2.390E+06	3.60E+07	4.17E+05	3.64E+07
19	2.310E+06	2.81E+07	4.04E+05	2.85E+07
20	1.830E+06	2.39E+07	4.08E+05	2.43E+07
21	1.110E+06	1.68E+07	4.80E+05	1.73E+07
22	5.500E+05	8.24E+06	3.49E+05	8.59E+06
23	1.580E+05	5.93E+06	3.00E+05	6.23E+06
24	1.110E+05	4.58E+06	2.55E+05	4.83E+06
25	5.250E+04	3.56E+06	2.33E+05	3.79E+06
26	2.480E+04	3.86E+06	2.29E+05	4.09E+06
27	2.190E+04	3.54E+06	2.32E+05	3.78E+06
28	1.030E+04	3.28E+06	2.43E+05	3.52E+06
29	3.350E+03	3.19E+06	2.53E+05	3.45E+06
30	1.230E+03	3.18E+06	2.69E+05	3.45E+06
31	5.830E+02	3.16E+06	2.88E+05	3.45E+06
32	1.010E+02	3.16E+06	3.06E+05	3.47E+06
33	2.900E+01	3.17E+06	3.18E+05	3.49E+06
34	1.070E+01	3.14E+06	3.29E+05	3.47E+06
35	3.060E+00	3.14E+06	3.38E+05	3.48E+06
36	1.130E+00	3.09E+06	3.42E+05	3.43E+06
37	4.140E-01	2.84E+06	1.60E+05	3.00E+06

Table II.3.20. Gamma Flux Per Unit Lethargy Per Kilowatt.

GROUP	ENERGY (EV)	ER2 FREE FIELD		TOTAL
		FRONT	BACK	
1	1.400E+07	6.48E+03	2.18E+03	8.66E+03
2	1.000E+07	1.03E+07	0.00E+00	1.03E+07
3	8.000E+06	4.00E+07	0.00E+00	4.00E+07
4	7.000E+06	2.46E+07	1.19E+05	2.47E+07
5	6.000E+06	3.10E+07	1.08E+05	3.11E+07
6	5.000E+06	6.28E+07	1.00E+03	6.28E+07
7	4.000E+06	1.07E+08	0.00E+00	1.07E+08
8	3.000E+06	1.70E+08	0.00E+00	1.70E+08
9	2.500E+06	3.70E+08	2.79E+06	3.73E+08
10	2.000E+06	2.76E+08	0.00E+00	2.76E+08
11	1.500E+06	3.20E+08	0.00E+00	3.20E+08
12	1.000E+06	3.34E+08	5.33E+05	3.35E+08
13	7.000E+05	3.58E+08	1.22E+06	3.60E+08
14	4.500E+05	2.62E+08	5.70E+05	2.63E+08
15	3.000E+05	1.55E+08	1.76E+07	1.73E+08
16	1.500E+05	1.04E+08	2.13E+07	1.25E+08
17	1.000E+05	6.56E+07	2.24E+07	8.80E+07
18	7.000E+04	2.88E+07	1.76E+07	4.64E+07
19	4.500E+04	7.40E+06	6.82E+06	1.42E+07
20	3.000E+04	5.93E+05	5.98E+05	1.19E+06
21	2.000E+04	2.68E+03	2.53E+03	5.21E+03

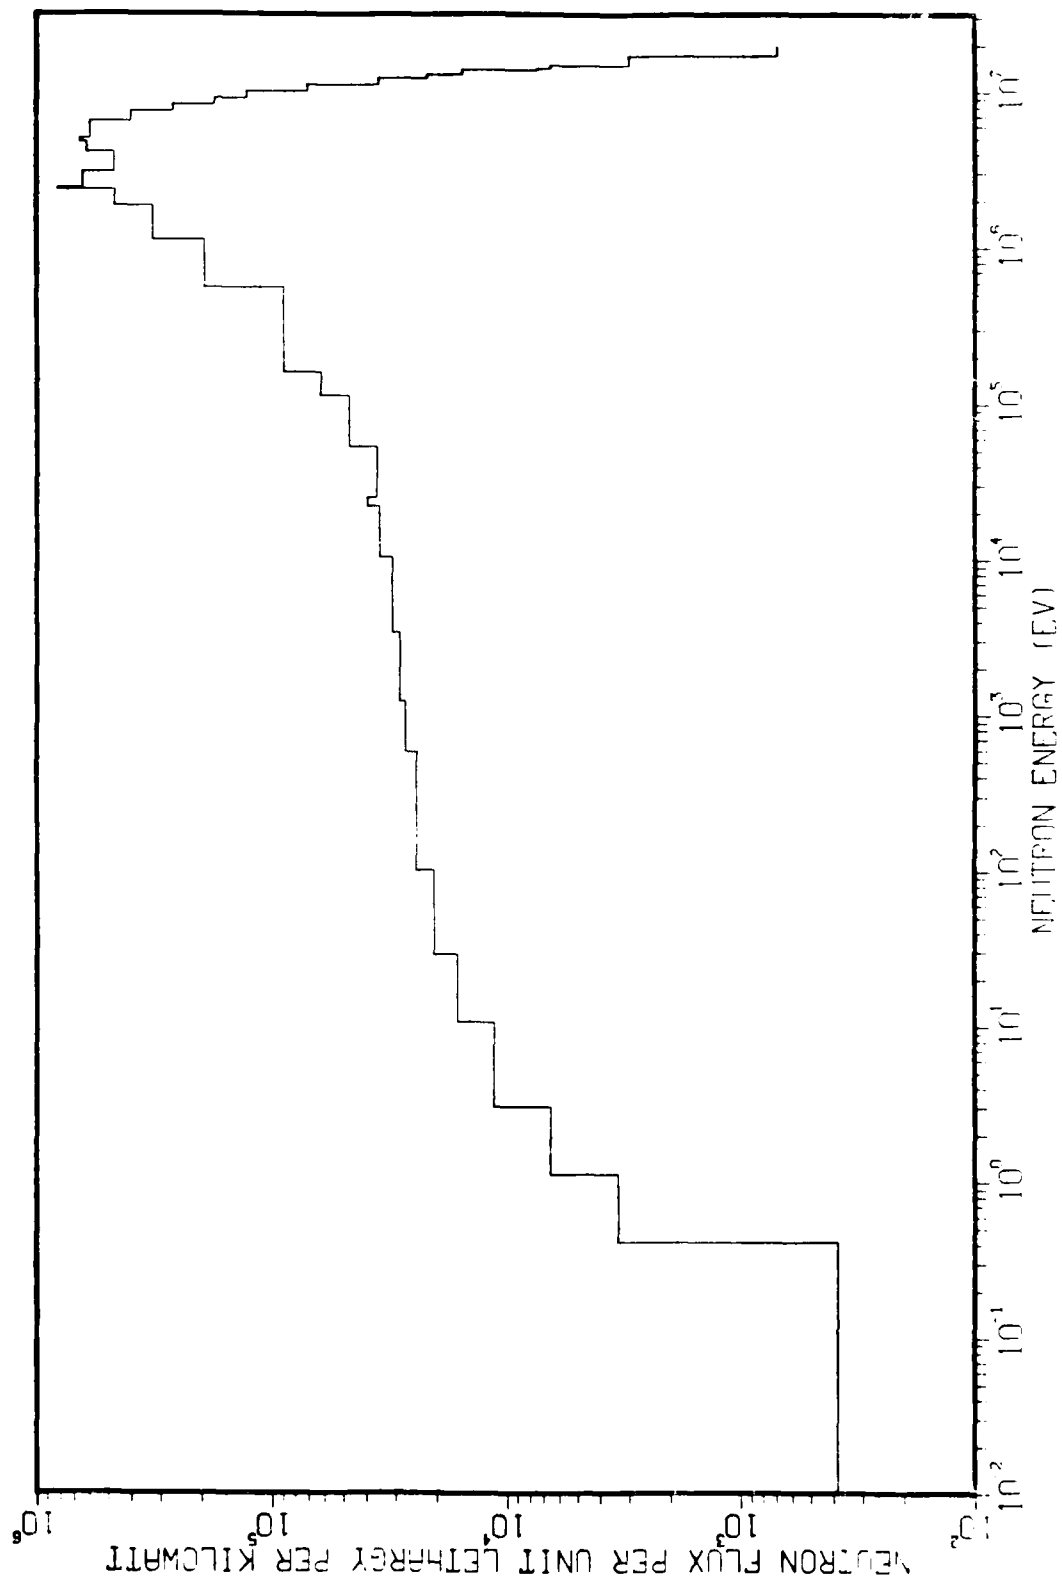


Figure 11.3.31. Front (1-D) Neutron Flux vs Energy ERI Free Field With 12" Water.

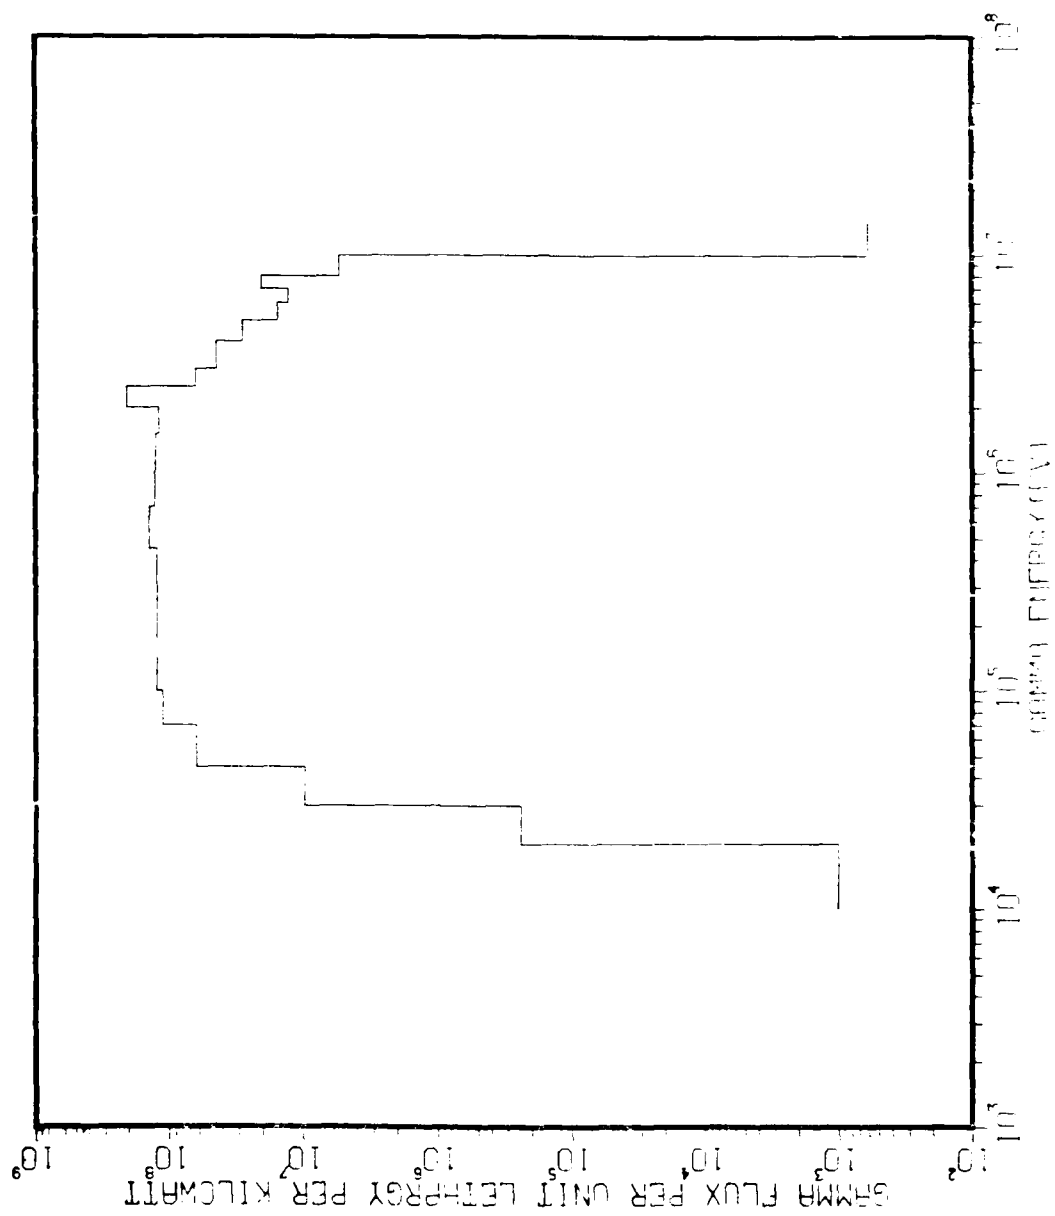


Figure II.3.32. Front Gamma Flux vs Energy ER1 Free Field With 12" Water.

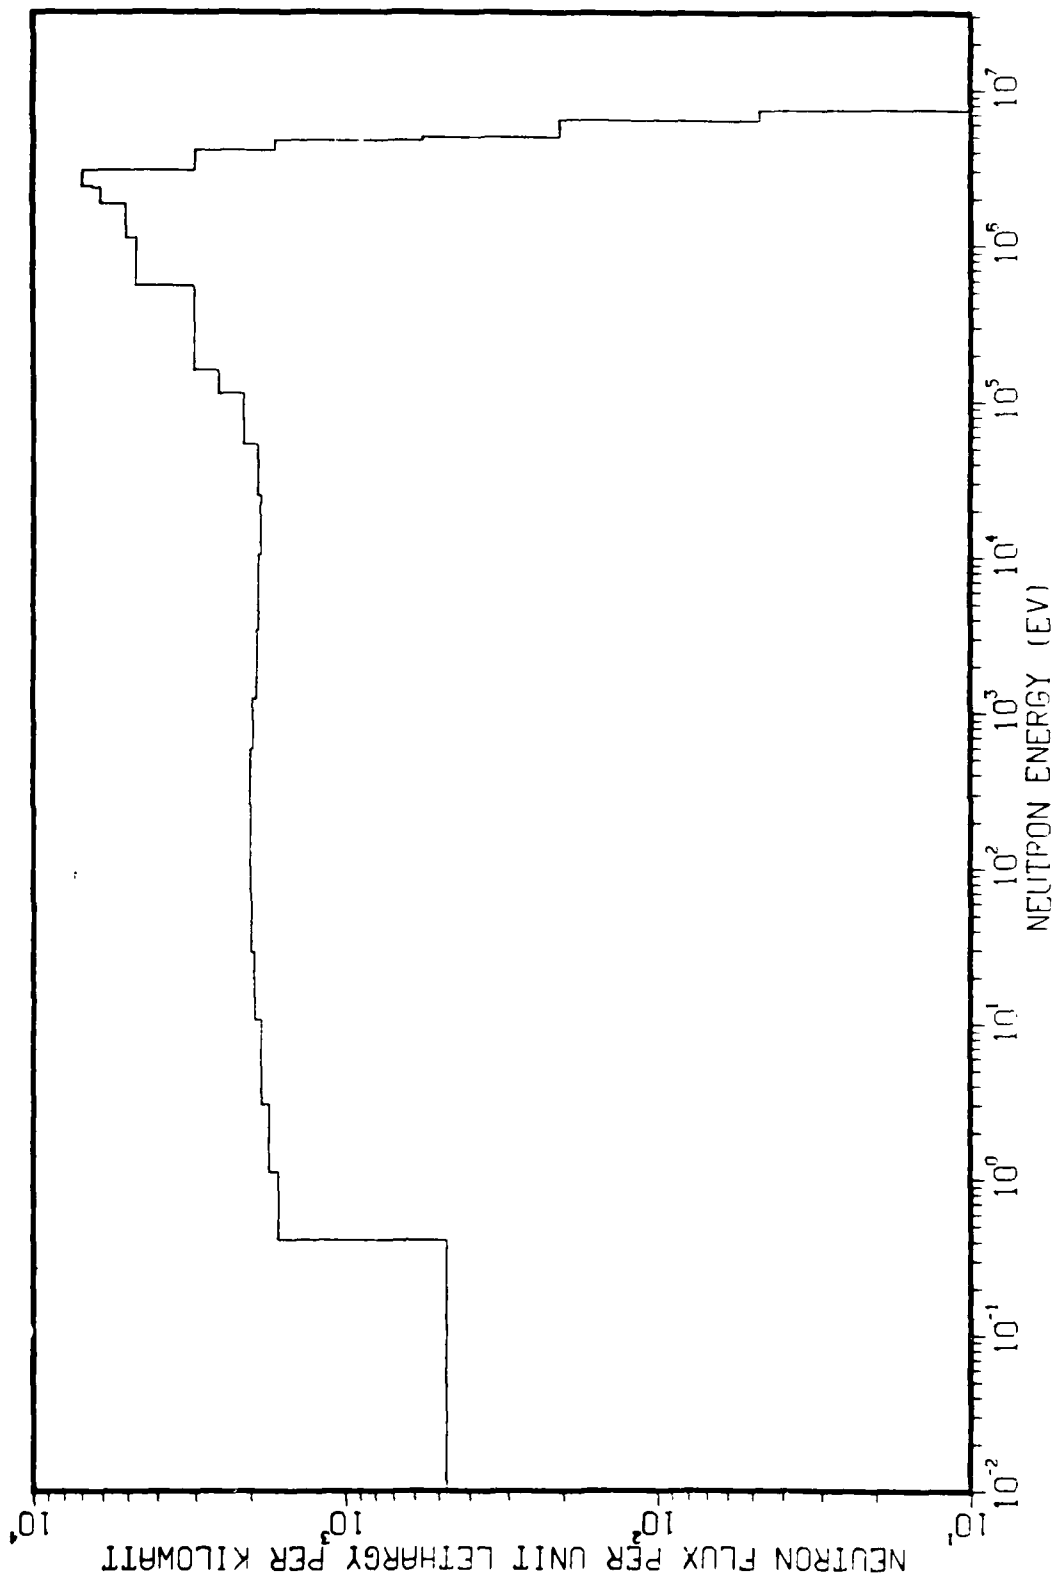


Figure II.3.33. Back (1-D) Neutron Flux vs Energy ERI Free Field With 12" Water.

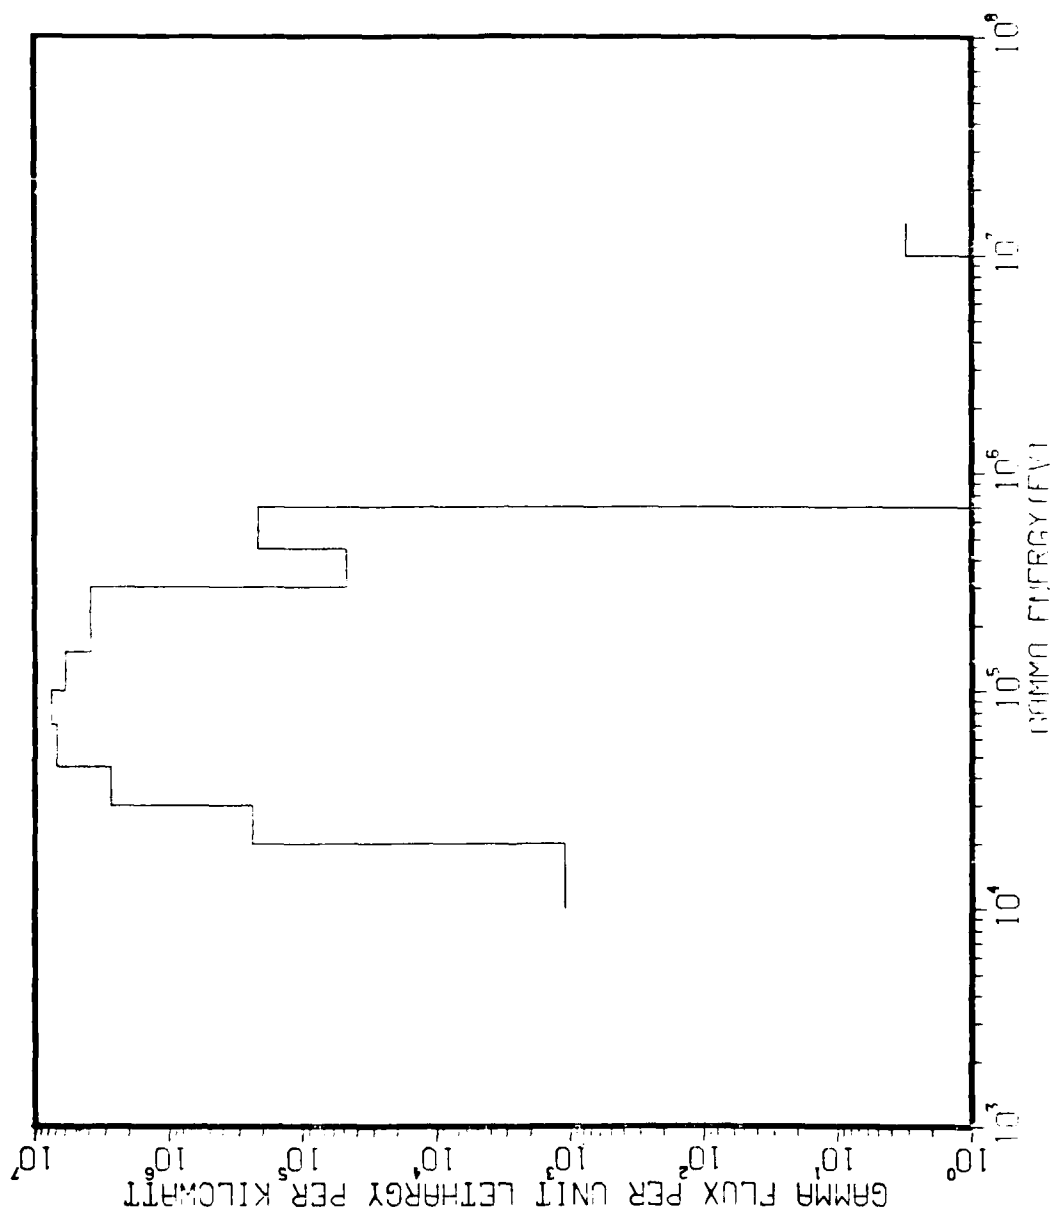


Figure II.3.34. Back Gamma Flux vs Energy ERI Free Field With 12" Water.

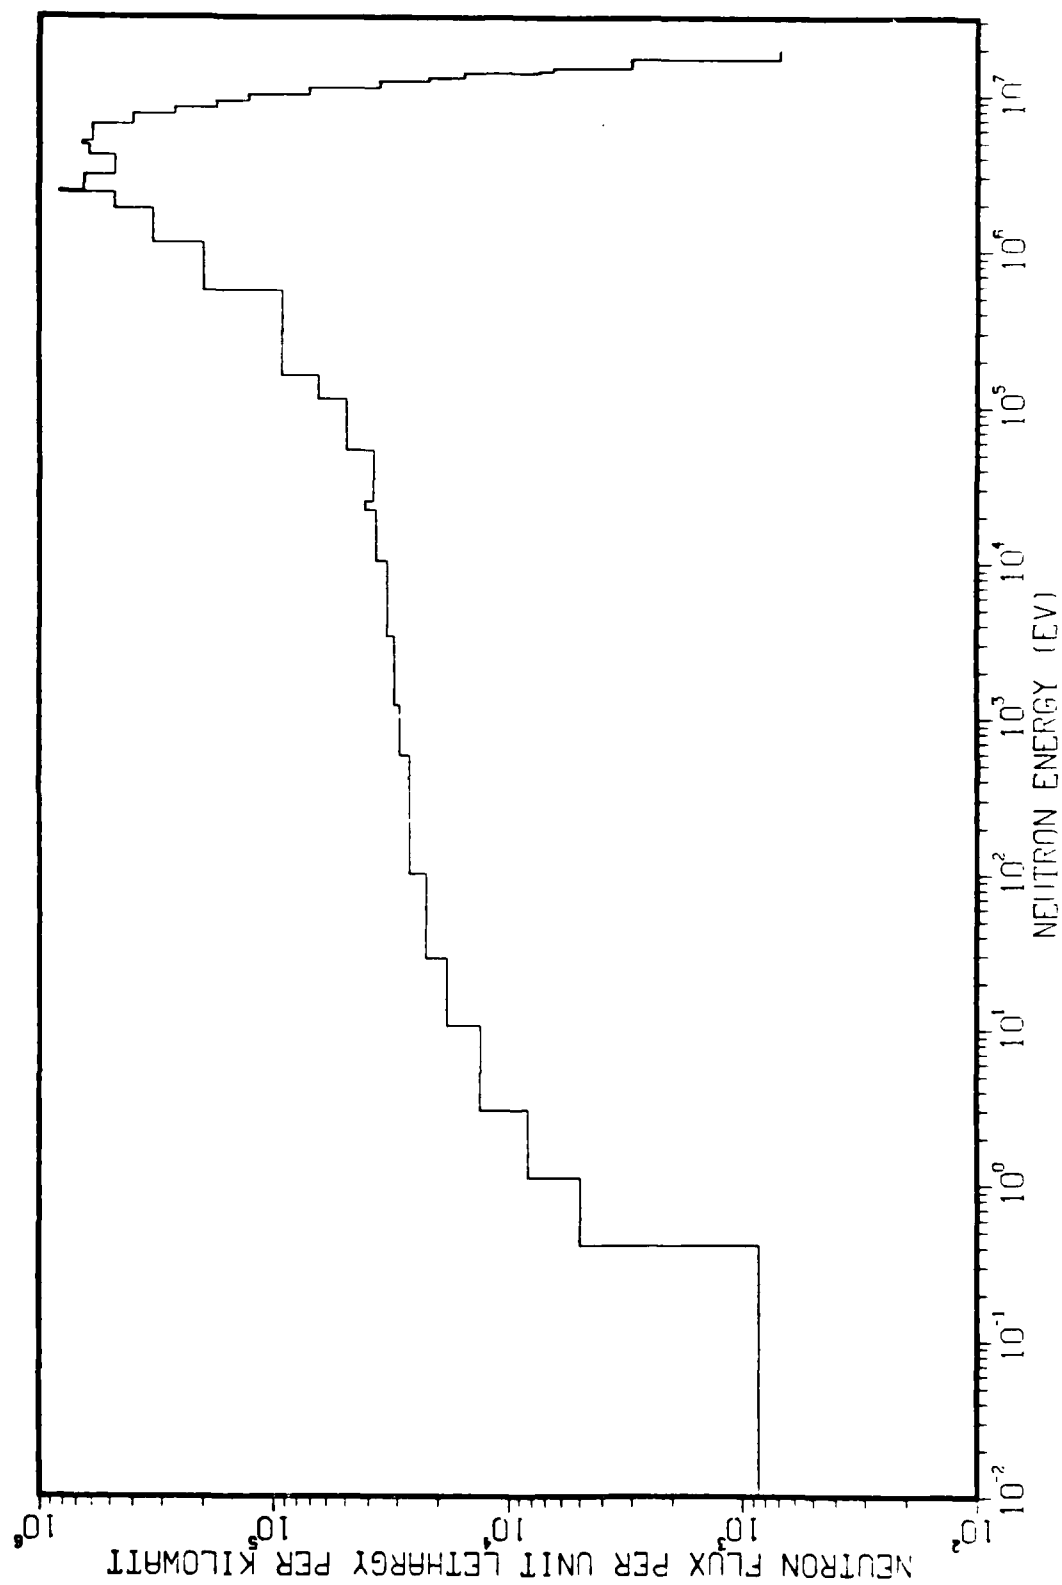


Figure II.3.35. Total (Front+Back, 1-0) Neutron Flux vs Energy ER1 Free Field With 12" Water.

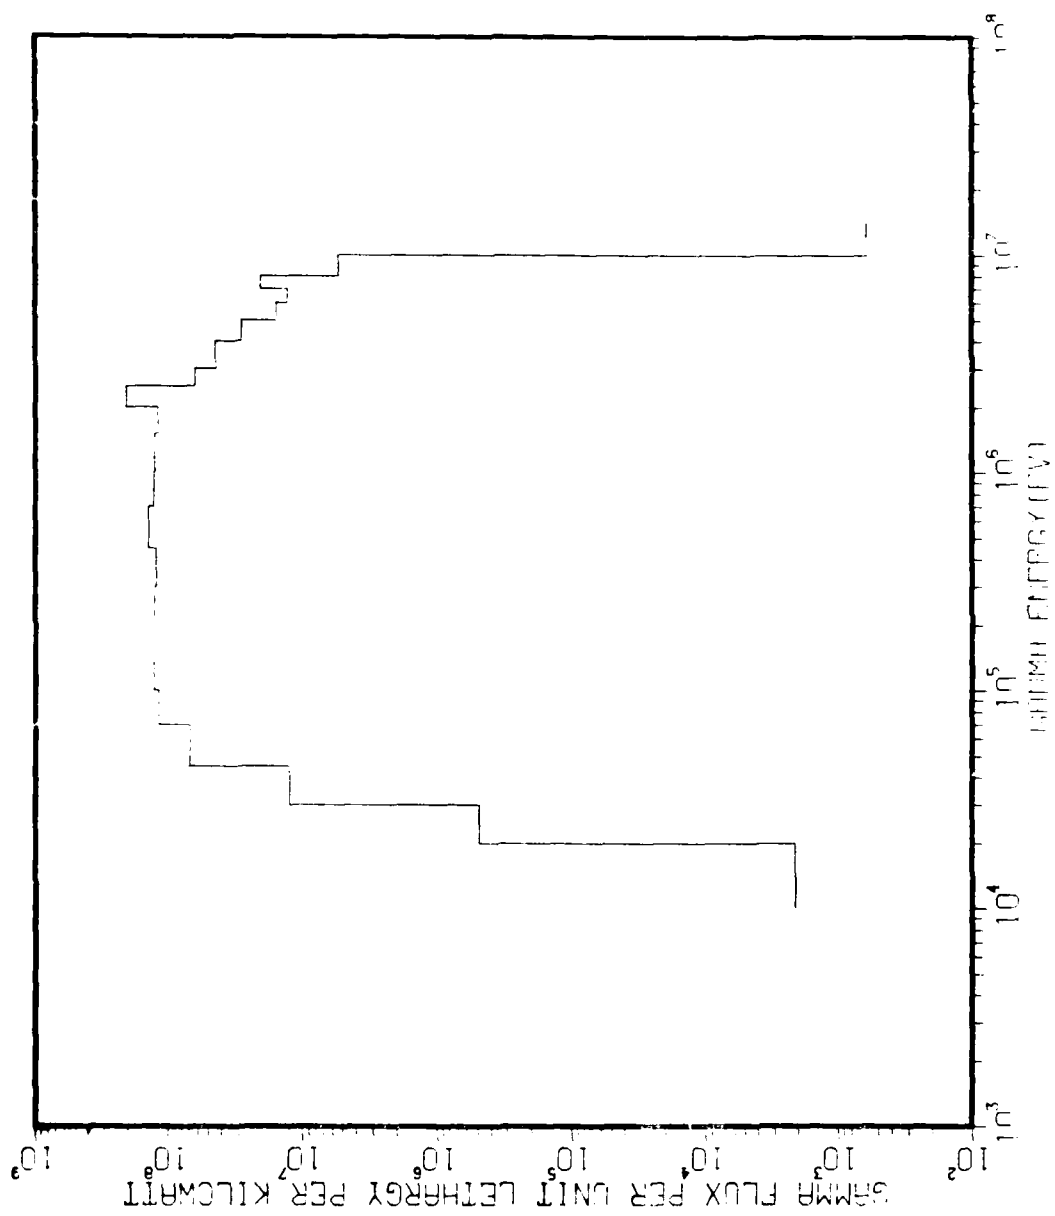


Figure II.3.36. Total (Front+Back) Gamma Flux vs Energy ER1 Free Field With 12" Water.

Table II.3.21. Neutron Flux Per Unit Lethargy Per Kilowatt.

GROUP	ENERGY (EV)	ERI FREE FIELD WITH 12 IN. WATER		
		FRONT	BACK	TOTAL
1	1.960E+07	6.97E+02	0.00E+00	6.97E+02
2	1.690E+07	3.03E+03	0.00E+00	3.03E+03
3	1.490E+07	6.56E+03	0.00E+00	6.56E+03
4	1.420E+07	7.46E+03	0.00E+00	7.46E+03
5	1.380E+07	1.57E+04	0.00E+00	1.57E+04
6	1.280E+07	2.22E+04	0.00E+00	2.22E+04
7	1.220E+07	3.59E+04	0.00E+00	3.59E+04
8	1.110E+07	7.12E+04	0.00E+00	7.12E+04
9	1.000E+07	1.29E+05	0.00E+00	1.29E+05
10	9.050E+06	1.77E+05	0.00E+00	1.77E+05
11	8.190E+06	2.65E+05	0.00E+00	2.65E+05
12	7.410E+06	3.99E+05	4.74E+01	3.99E+05
13	6.380E+06	5.91E+05	2.04E+02	5.91E+05
14	4.970E+06	6.55E+05	5.62E+02	6.55E+05
15	4.720E+06	6.11E+05	1.67E+03	6.13E+05
16	4.070E+06	4.71E+05	3.01E+03	4.74E+05
17	3.010E+06	6.38E+05	6.97E+03	6.45E+05
18	2.390E+06	8.11E+05	6.41E+03	8.17E+05
19	2.310E+06	4.68E+05	6.07E+03	4.74E+05
20	1.830E+06	3.21E+05	5.06E+03	3.27E+05
21	1.110E+06	1.96E+05	4.66E+03	2.00E+05
22	5.500E+05	9.02E+04	3.02E+03	9.32E+04
23	1.580E+05	6.27E+04	2.53E+03	6.52E+04
24	1.110E+05	4.76E+04	2.10E+03	4.97E+04
25	5.250E+04	3.62E+04	1.89E+03	3.81E+04
26	2.480E+04	3.96E+04	1.85E+03	4.15E+04
27	2.190E+04	3.55E+04	1.86E+03	3.73E+04
28	1.030E+04	3.14E+04	1.89E+03	3.33E+04
29	3.350E+03	2.91E+04	1.92E+03	3.10E+04
30	1.230E+03	2.76E+04	1.97E+03	2.96E+04
31	5.830E+02	2.47E+04	2.01E+03	2.67E+04
32	1.010E+02	2.07E+04	2.00E+03	2.27E+04
33	2.900E+01	1.65E+04	1.96E+03	1.84E+04
34	1.070E+01	1.14E+04	1.86E+03	1.33E+04
35	3.060E+00	6.55E+03	1.75E+03	8.31E+03
36	1.130E+00	3.33E+03	1.65E+03	4.99E+03
37	4.140E-01	3.86E+02	4.73E+02	8.59E+02

Table II.3.22. Gamma Flux Per Unit Lethargy Per Kilowatt.

ER1 FREE FIELD WITH 12 IN. WATER				
GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.400E+07	6.08E+02	3.05E+00	6.11E+02
2	1.000E+07	5.41E+06	0.00E+00	5.41E+06
3	8.000E+06	2.04E+07	0.00E+00	2.04E+07
4	7.000E+06	1.28E+07	0.00E+00	1.28E+07
5	6.000E+06	1.53E+07	0.00E+00	1.53E+07
6	5.000E+06	2.83E+07	0.00E+00	2.83E+07
7	4.000E+06	4.43E+07	0.00E+00	4.43E+07
8	3.000E+06	6.36E+07	0.00E+00	6.36E+07
9	2.500E+06	2.06E+08	0.00E+00	2.06E+08
10	2.000E+06	1.19E+08	0.00E+00	1.19E+08
11	1.500E+06	1.26E+03	0.00E+00	1.26E+03
12	1.000E+06	1.29E+03	0.00E+00	1.29E+03
13	7.000E+05	1.40E+03	2.14E+05	1.40E+03
14	4.500E+05	1.23E+03	4.77E+04	1.23E+03
15	3.000E+05	1.23E+03	3.82E+06	1.27E+03
16	1.500E+05	1.22E+03	5.80E+06	1.26E+03
17	1.000E+05	1.11E+03	7.48E+06	1.18E+03
18	7.000E+04	6.22E+07	6.84E+06	6.91E+07
19	4.500E+04	9.76E+06	2.72E+06	1.25E+07
20	3.000E+04	2.43E+03	2.40E+03	4.83E+03
21	2.000E+04	1.02E+03	1.10E+03	2.12E+03

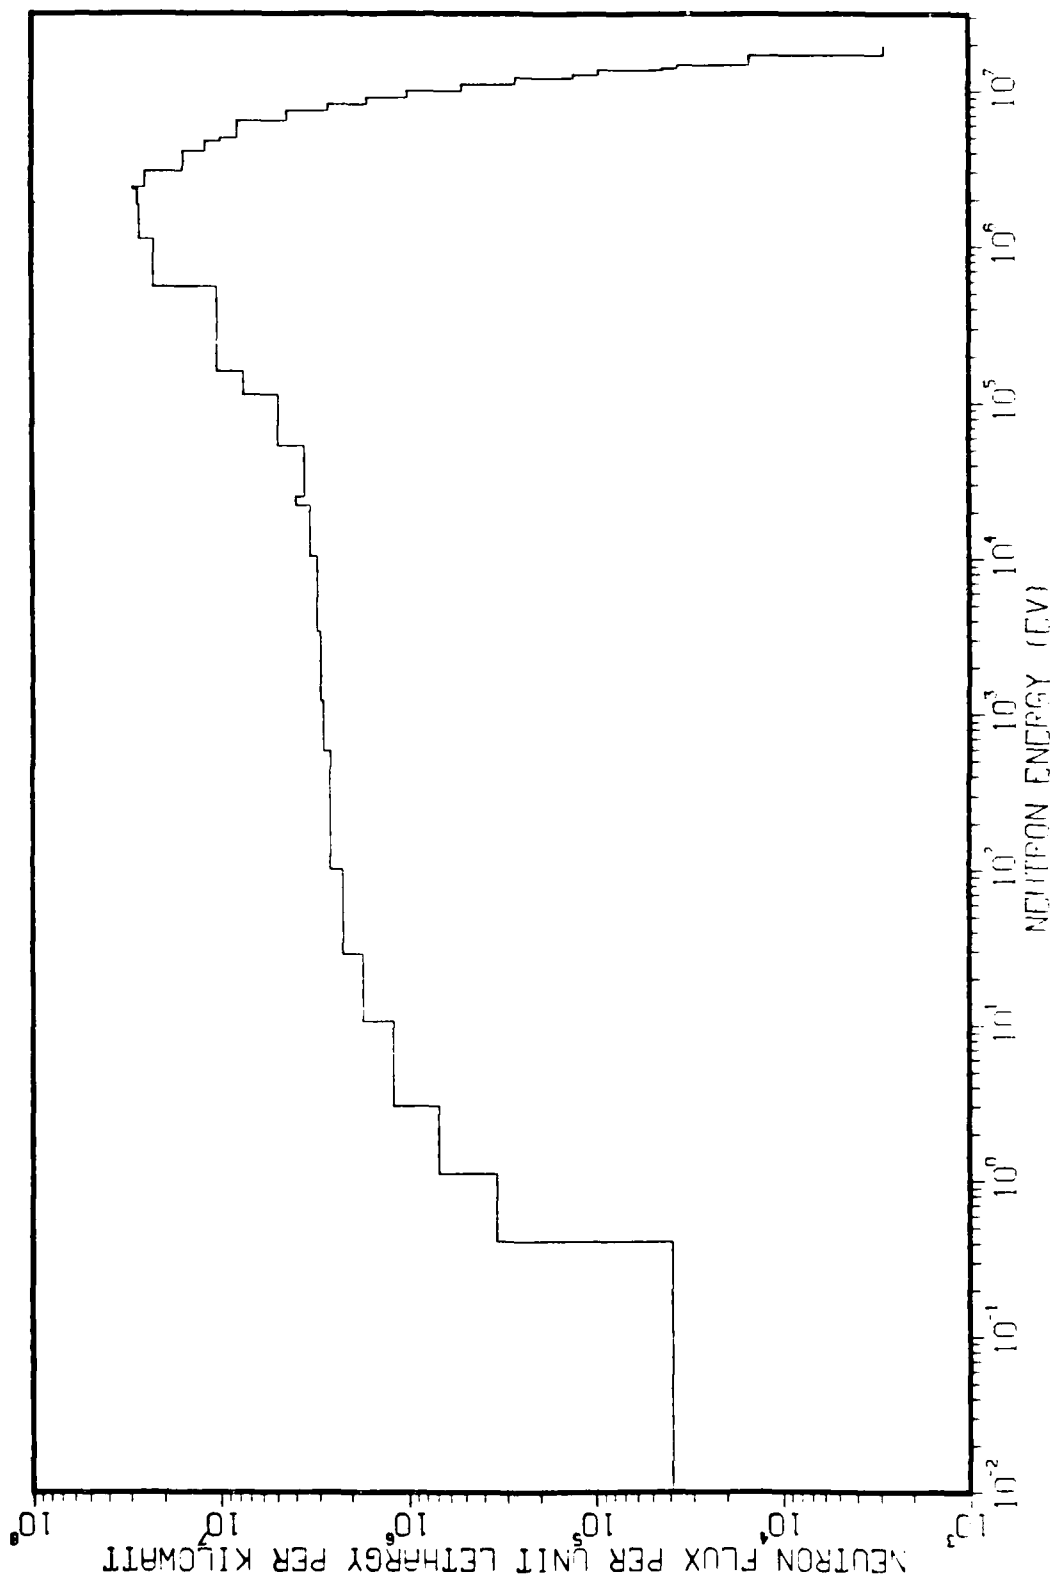


Figure II.3.37. Front (1-D) Neutron Flux vs Energy ER1 With 2" PB.

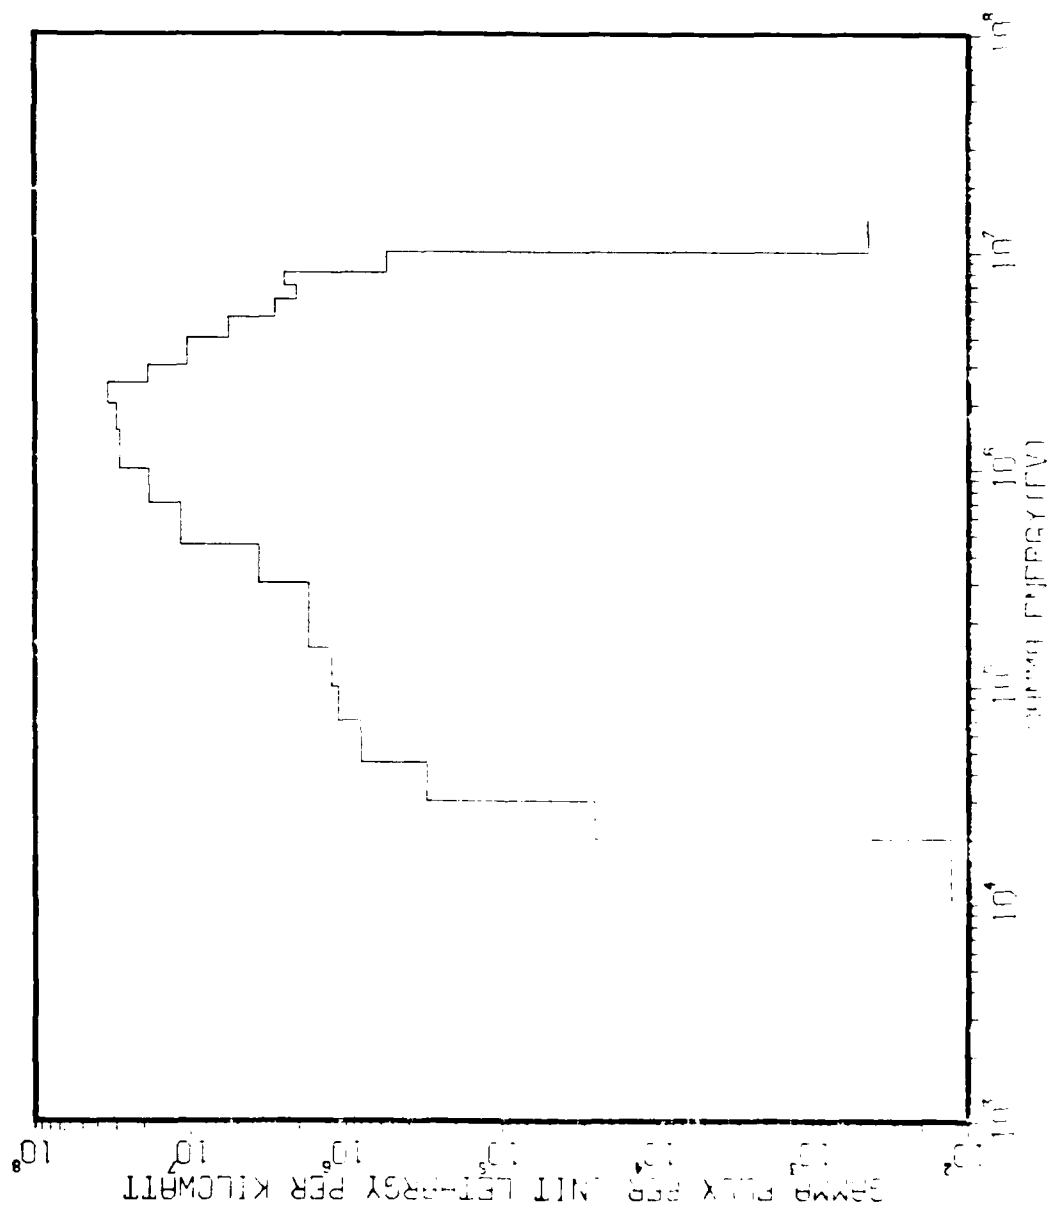


Figure II.3.38. Front Gamma Flux vs Energy ERI With 2" PB.

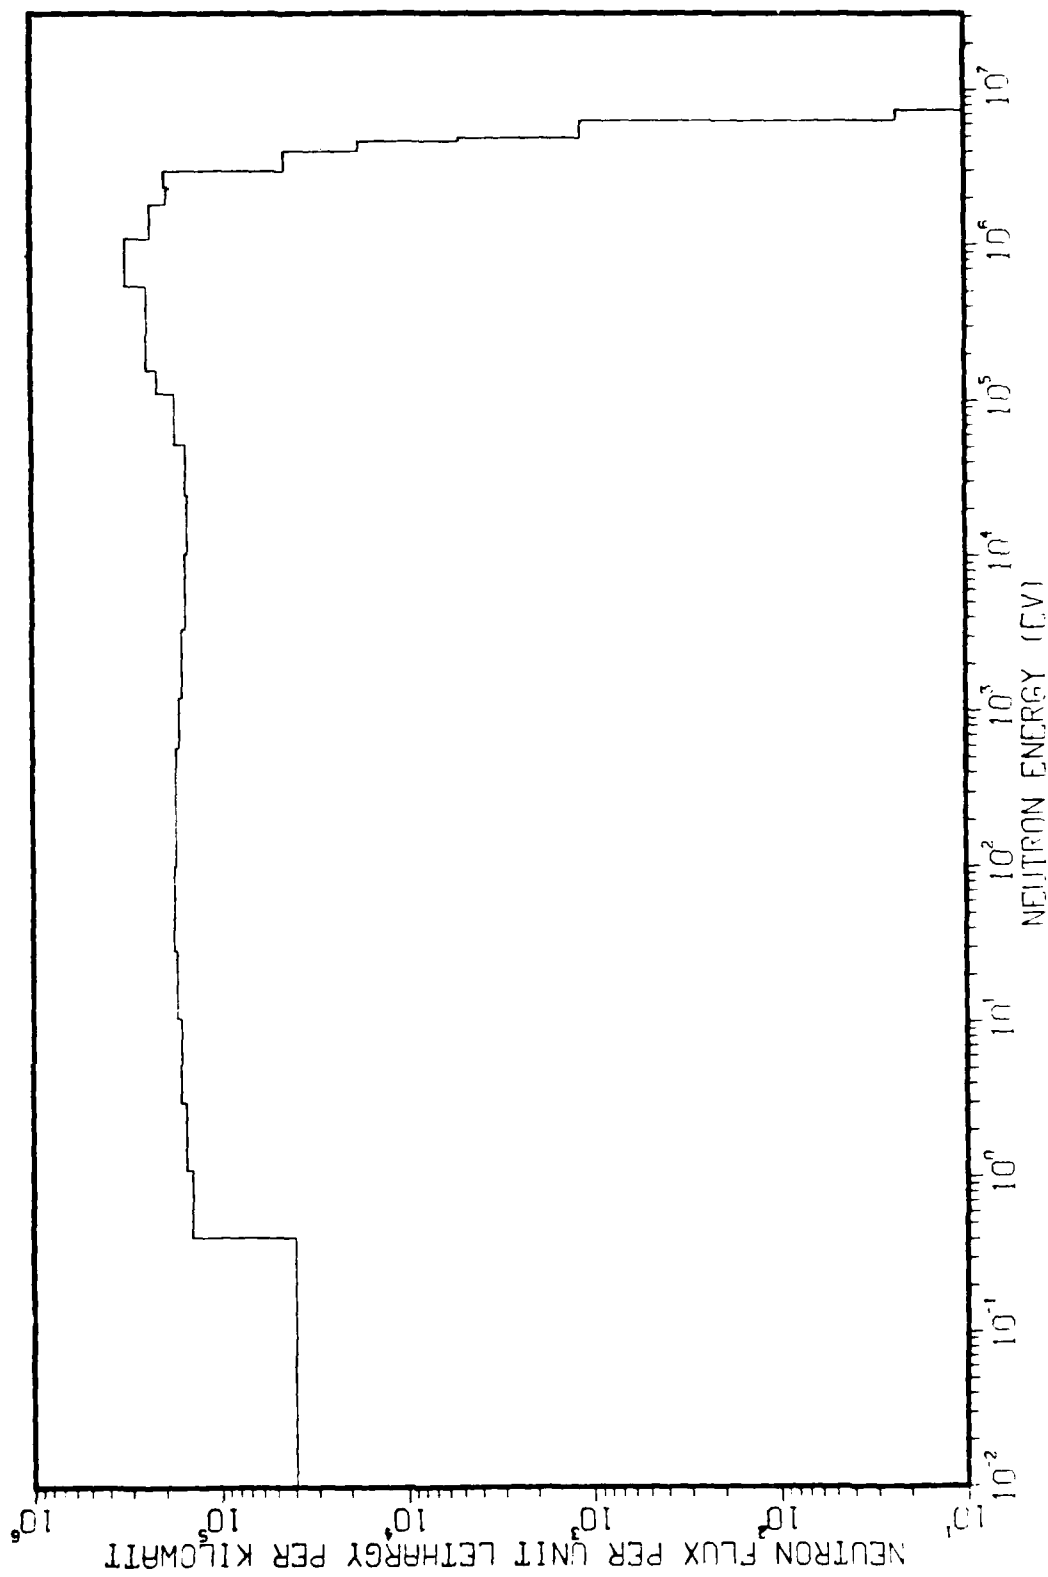


Figure II.3.39. Back (1-D) Neutron Flux vs Energy ERI With 2" PB.

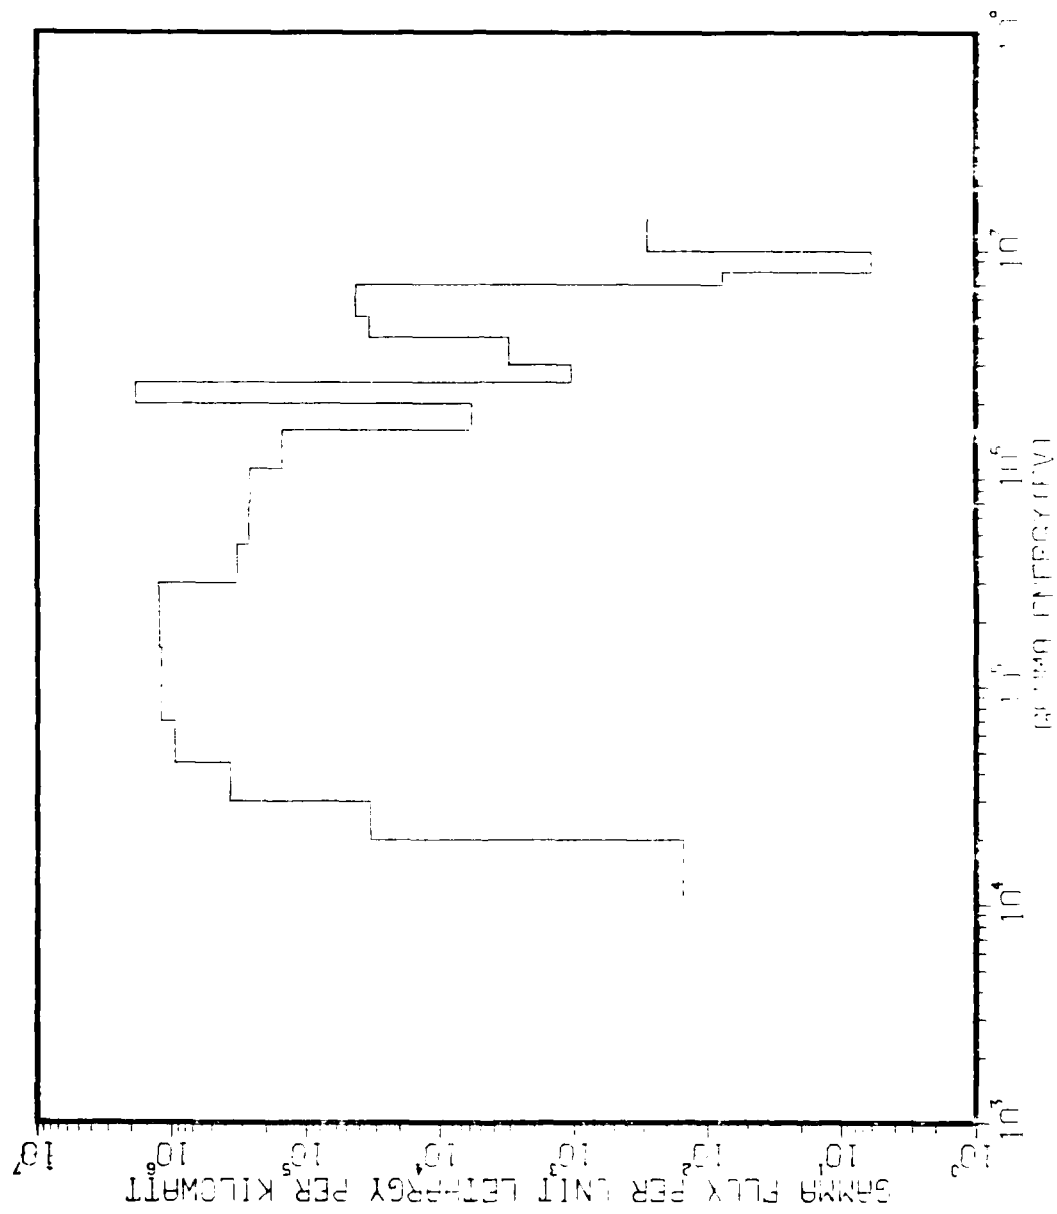


Figure II.3.40. Back Gamma Flux vs Energy ER) With 2" PB.

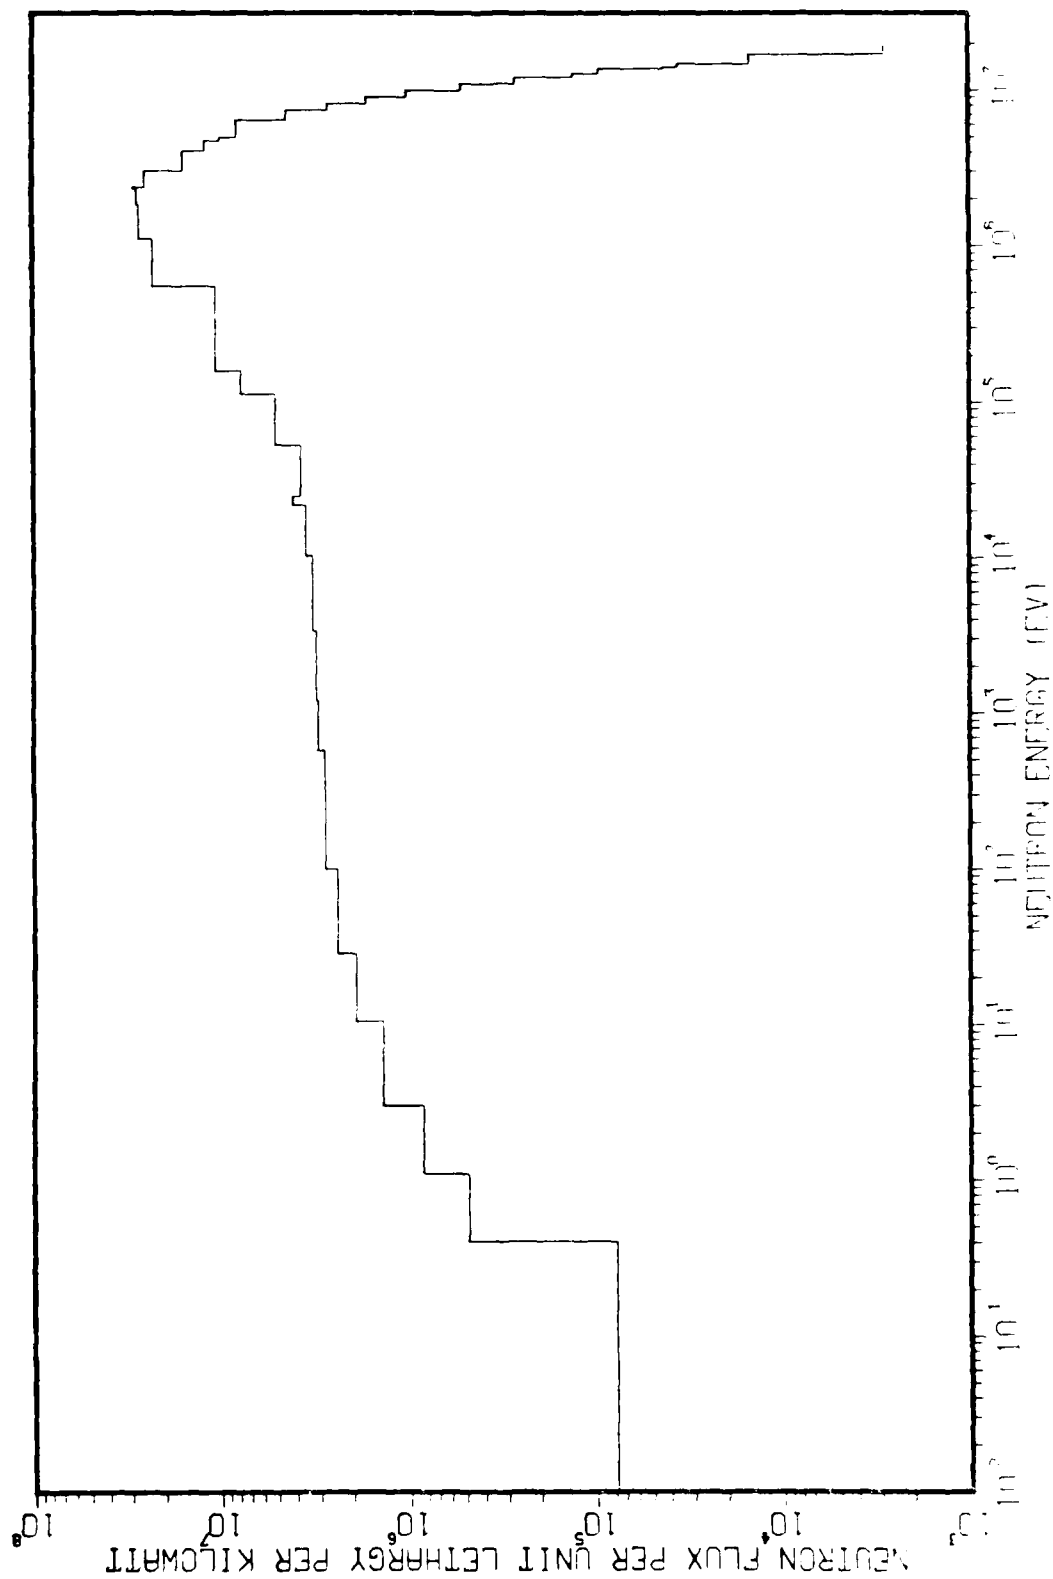


Figure 11.3.41. Total (Front+Back, 1-D) Neutron Flux vs Energy ERI With 2" PB.

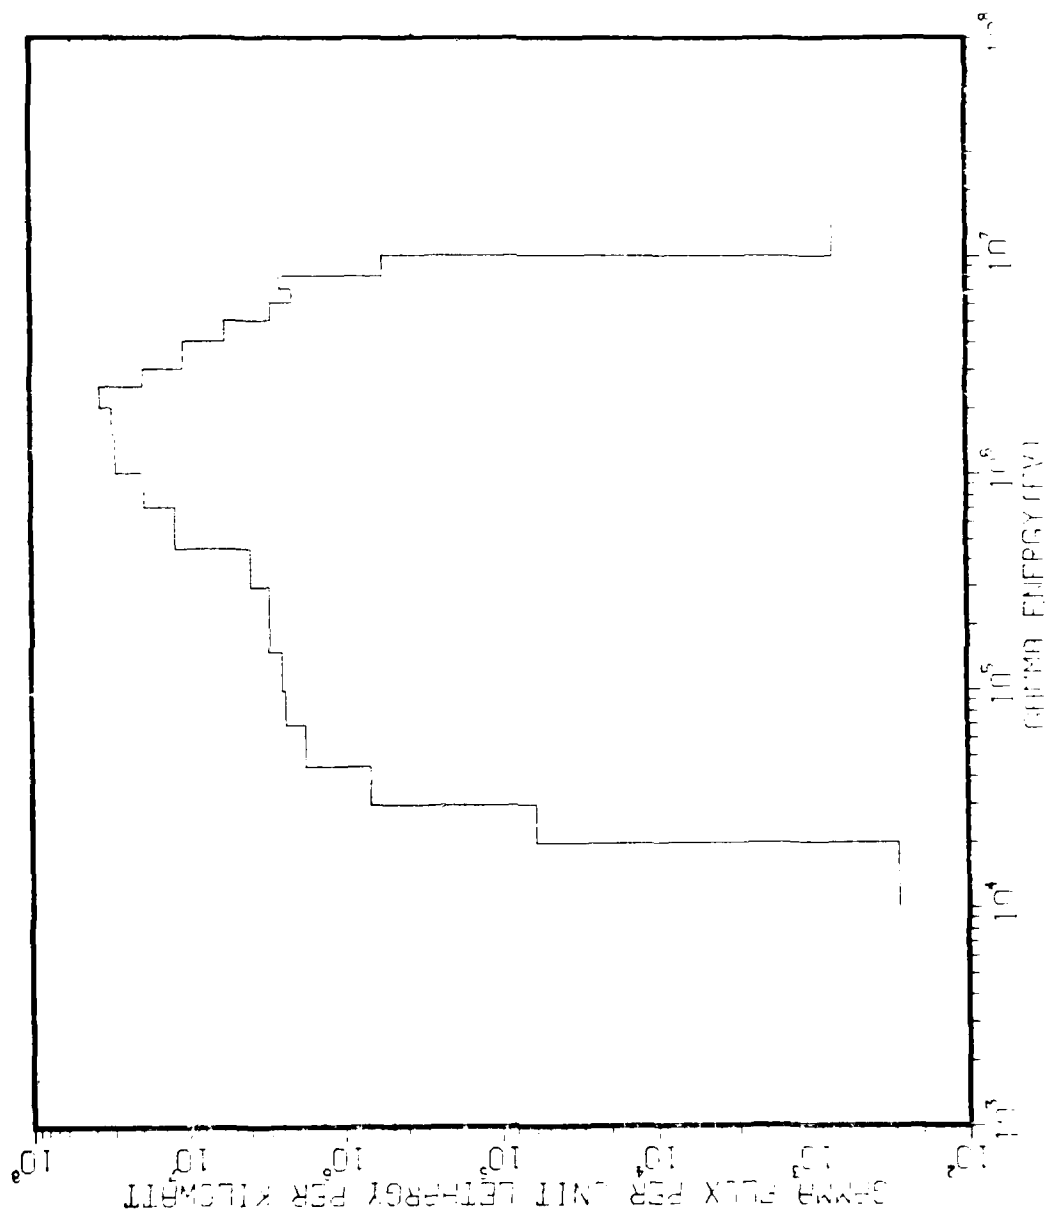


Figure II.3.42. Total (Front+Back) Gamma Flux vs Energy ERI With 2" PB.

Table II.3.23. Neutron Flux Per Unit Lethargy Per Kilowatt.

GROUP	ENERGY (EV)	ER1 WITH 2 IN. PB		TOTAL
		FRONT	BACK	
1	1.960E+07	2.82E+03	0.00E+00	2.82E+03
2	1.690E+07	1.48E+04	0.00E+00	1.48E+04
3	1.490E+07	3.61E+04	0.00E+00	3.61E+04
4	1.420E+07	4.32E+04	0.00E+00	4.32E+04
5	1.380E+07	9.51E+04	0.00E+00	9.51E+04
6	1.280E+07	1.31E+05	0.00E+00	1.31E+05
7	1.220E+07	2.68E+05	0.00E+00	2.68E+05
8	1.110E+07	5.18E+05	0.00E+00	5.18E+05
9	1.000E+07	1.01E+06	0.00E+00	1.01E+06
10	9.050E+06	1.66E+06	0.00E+00	1.66E+06
11	8.190E+06	2.66E+06	0.00E+00	2.66E+06
12	7.410E+06	4.42E+06	2.32E+01	4.42E+06
13	6.380E+06	8.05E+06	1.12E+03	8.05E+06
14	4.970E+06	9.95E+06	5.05E+03	9.96E+06
15	4.720E+06	1.19E+07	1.76E+04	1.19E+07
16	4.070E+06	1.55E+07	4.39E+04	1.55E+07
17	3.010E+06	2.48E+07	1.94E+05	2.50E+07
18	2.390E+06	2.86E+07	1.82E+05	2.87E+07
19	2.310E+06	2.72E+07	1.87E+05	2.74E+07
20	1.830E+06	2.67E+07	2.30E+05	2.69E+07
21	1.110E+06	2.24E+07	3.15E+05	2.27E+07
22	5.500E+05	1.03E+07	2.43E+05	1.05E+07
23	1.580E+05	7.51E+06	2.14E+05	7.72E+06
24	1.110E+05	4.91E+06	1.73E+05	5.08E+06
25	5.250E+04	3.57E+06	1.52E+05	3.72E+06
26	2.480E+04	3.95E+06	1.47E+05	4.10E+06
27	2.190E+04	3.34E+06	1.49E+05	3.49E+06
28	1.030E+04	3.07E+06	1.53E+05	3.22E+06
29	3.350E+03	2.93E+06	1.60E+05	3.09E+06
30	1.230E+03	2.86E+06	1.67E+05	3.03E+06
31	5.830E+02	2.61E+06	1.72E+05	2.79E+06
32	1.010E+02	2.24E+06	1.76E+05	2.42E+06
33	2.900E+01	1.76E+06	1.71E+05	1.93E+06
34	1.070E+01	1.22E+06	1.63E+05	1.38E+06
35	3.060E+00	6.94E+05	1.52E+05	8.46E+05
36	1.130E+00	3.43E+05	1.42E+05	4.85E+05
37	4.140E-01	3.89E+04	3.96E+04	7.84E+04

Table II.3.24. Gamma Flux Per Unit Lethargy Per Kilowatt.

GROUP	ENERGY (EV)	ERI WITH 2 IN. PB		TOTAL
		FRONT	BACK	
1	1.400E+07	4.44E+02	2.78E+02	7.22E+02
2	1.000E+07	5.45E+05	5.96E+00	5.45E+05
3	8.000E+06	2.48E+06	7.79E+01	2.48E+06
4	7.000E+06	2.05E+06	4.21E+04	2.09E+06
5	6.000E+06	2.82E+06	4.23E+04	2.86E+06
6	5.000E+06	5.66E+06	3.33E+04	5.69E+06
7	4.000E+06	1.05E+07	3.04E+03	1.05E+07
8	3.000E+06	1.88E+07	1.04E+03	1.88E+07
9	2.500E+06	3.39E+07	1.83E+06	3.52E+07
10	2.000E+06	3.01E+07	5.74E+03	3.02E+07
11	1.500E+06	2.86E+07	1.52E+05	2.88E+07
12	1.000E+06	1.85E+07	2.64E+05	1.83E+07
13	7.000E+05	1.16E+07	2.68E+05	1.18E+07
14	4.500E+05	3.61E+06	3.24E+05	3.94E+06
15	3.000E+05	1.73E+06	1.26E+06	2.99E+06
16	1.500E+05	1.24E+06	1.29E+06	2.44E+06
17	1.000E+05	1.12E+06	1.21E+06	2.33E+06
18	7.000E+04	8.01E+05	9.54E+05	1.75E+06
19	4.500E+04	3.06E+05	3.74E+05	6.79E+05
20	3.000E+04	2.61E+04	3.30E+04	5.90E+04
21	2.000E+04	1.29E+02	1.53E+02	2.82E+02

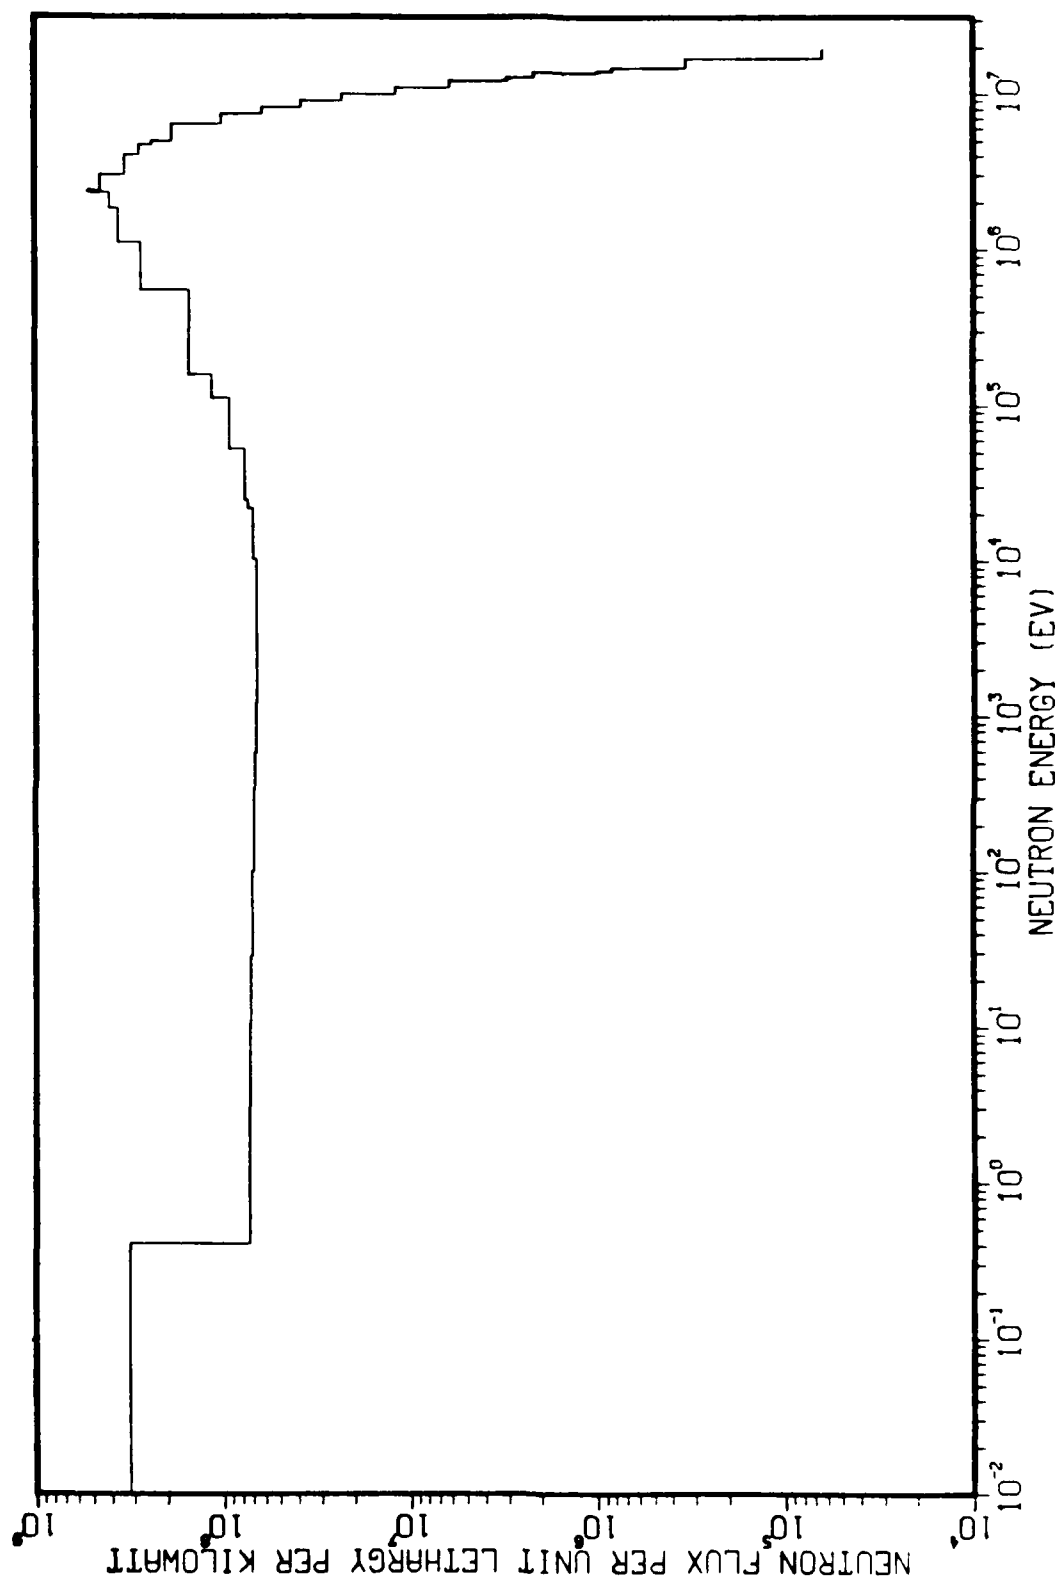


Figure II.3.43. Front (1-D) Neutron Flux vs Energy at Center of Pneumatic Tubes.

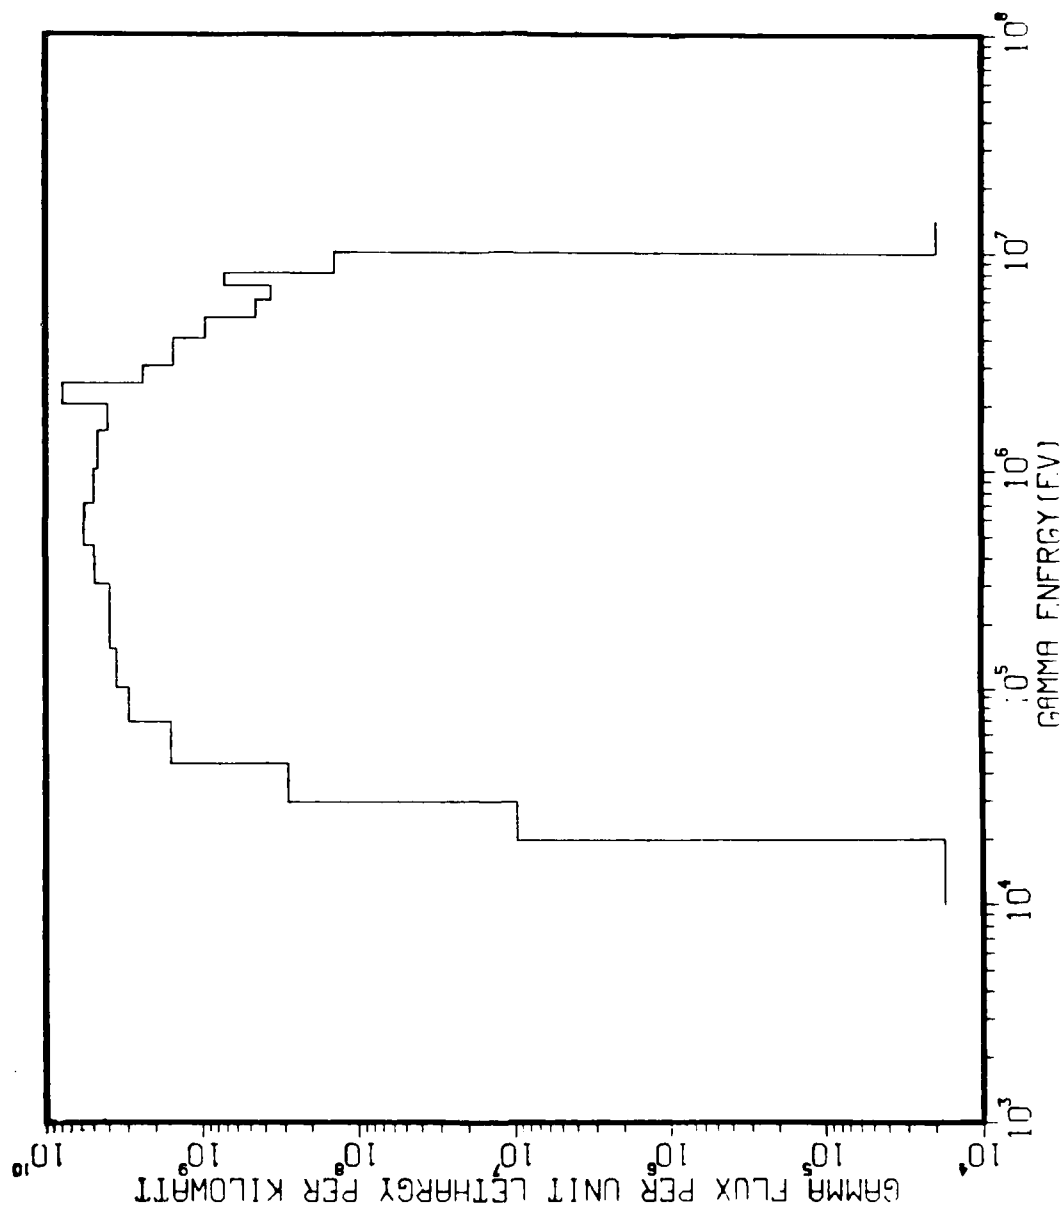


Figure II.3.44. Front Gamma Flux vs Energy at Center of Pneumatic Tubes.

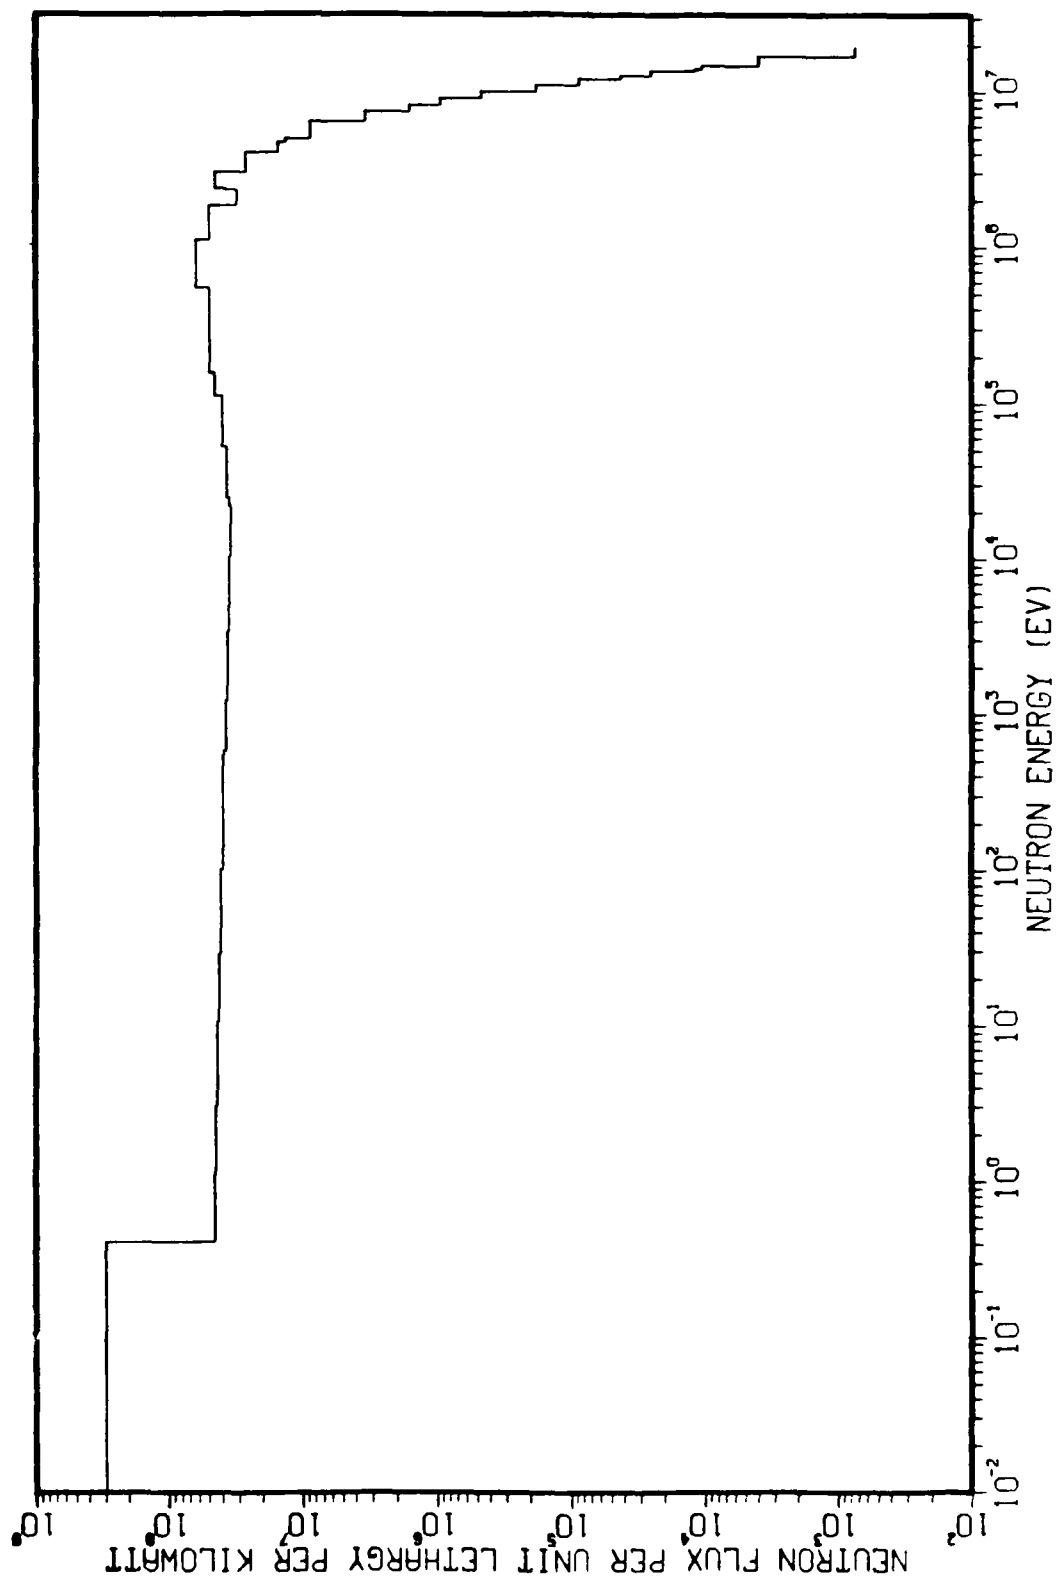


Figure II.3.45. Back (1-D) Neutron Flux vs Energy at Center of Pneumatic Tubes.

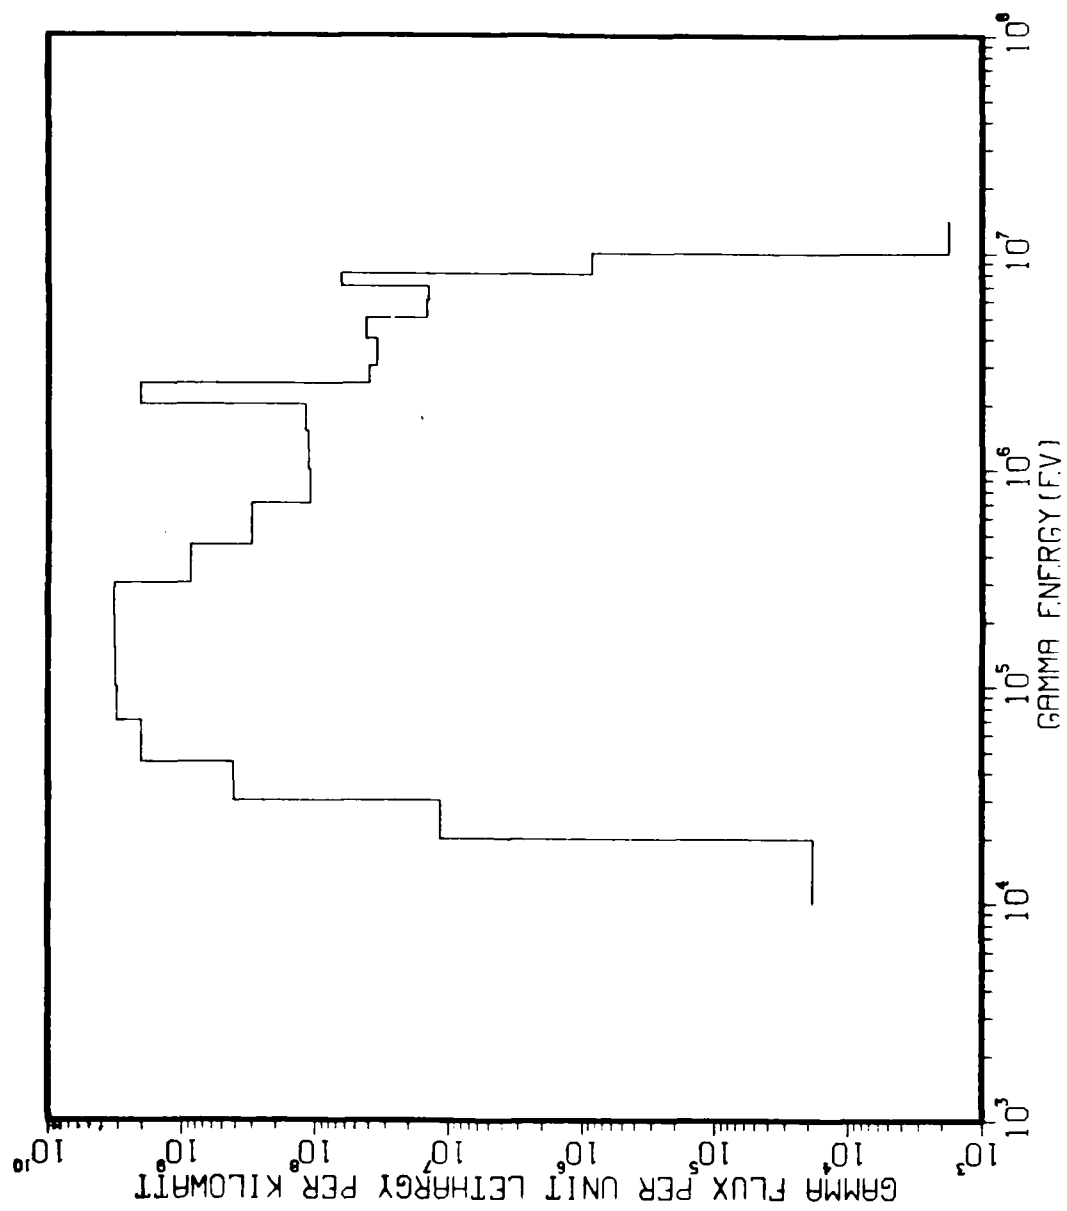


Figure II.3.46. Back Gamma Flux vs Energy at Center of Pneumatic Tubes.

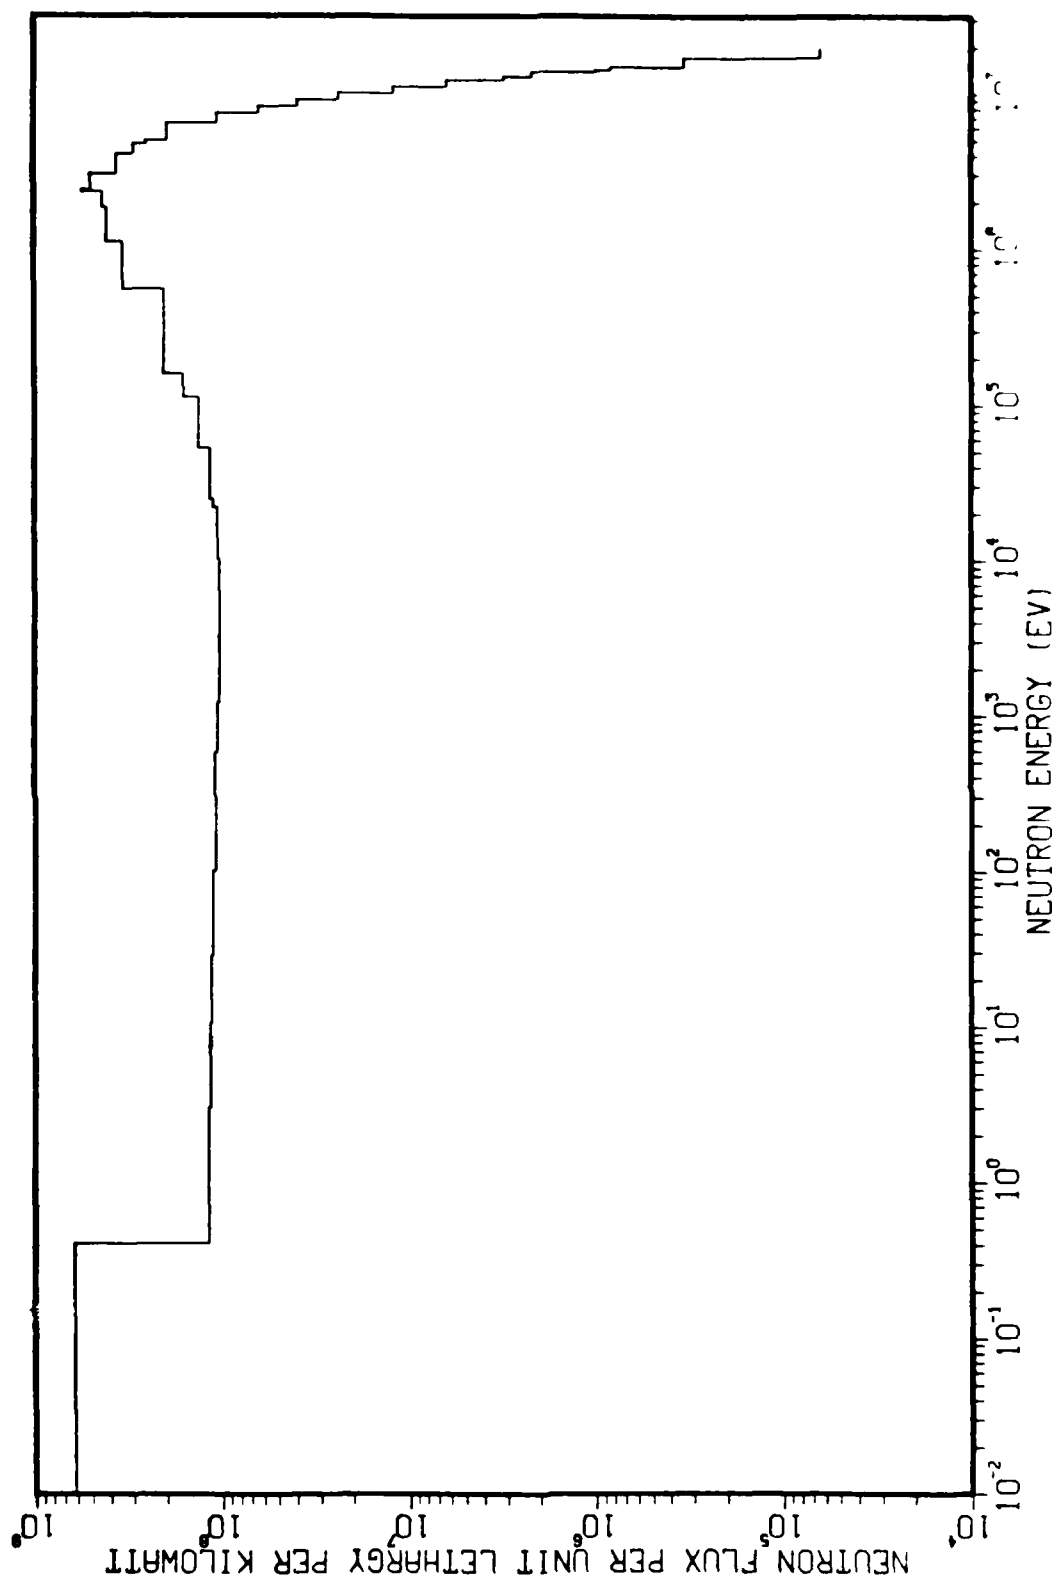


Figure II.3.47. Total (Front+Back, 1-D) Neutron Flux vs Energy at Center of Pneumatic Tubes

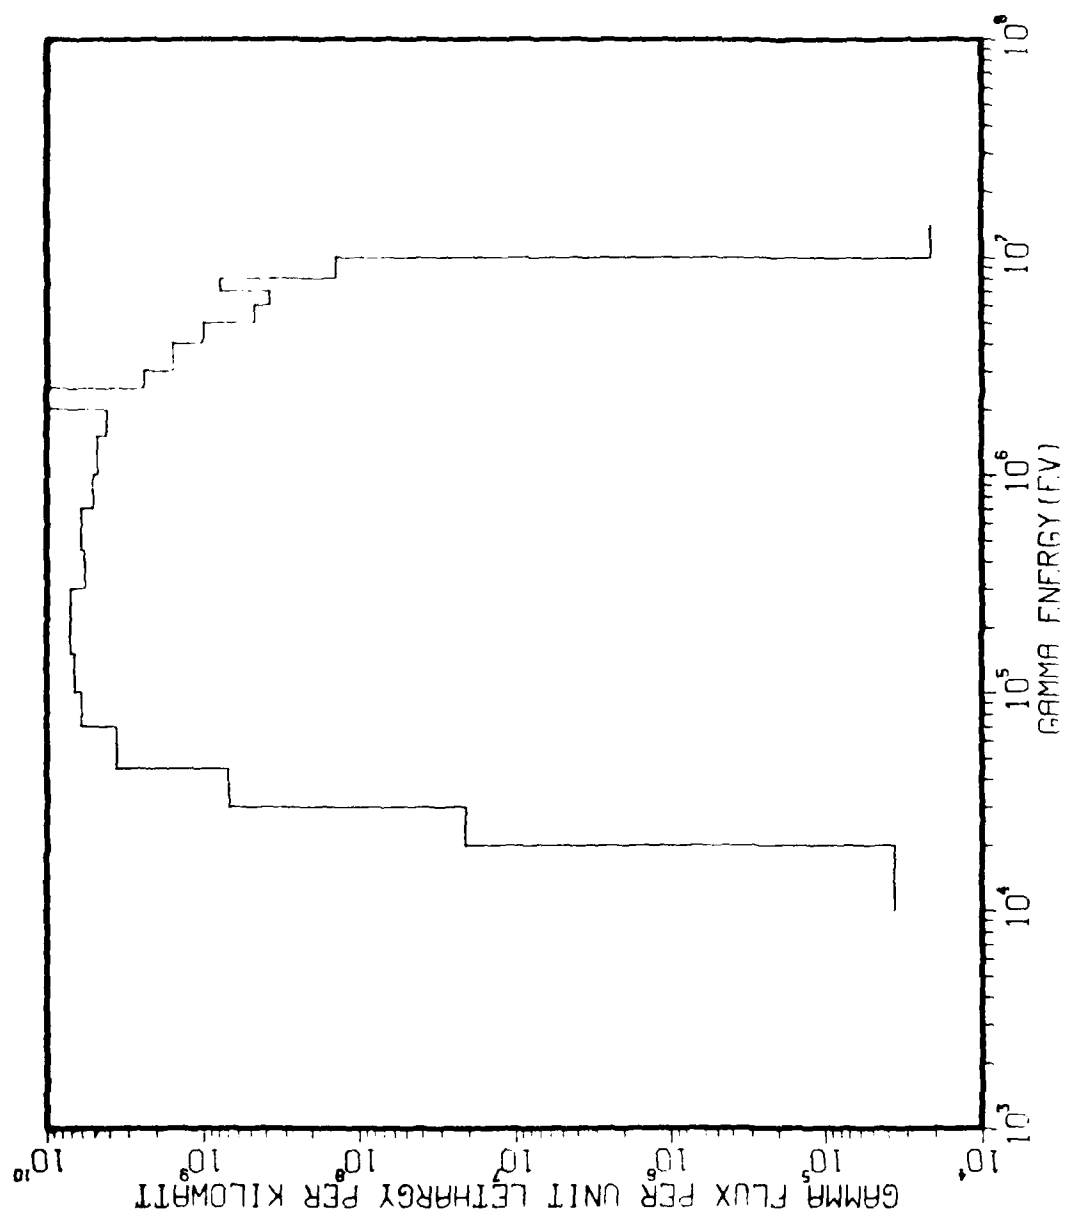


Figure II.3.48. Total (Front+Back) Gamma Flux vs Energy at Center of Pneumatic Tubes.

Table II.3.25. Neutron Flux Per Unit Lethargy Per Kilowatt.

GROUP	ENERGY (EV)	PNEUMATIC TUBES NEAR ER2		
		FRONT	BACK	TOTAL
1	1.960E+07	6.26E+04	7.35E+02	6.34E+04
2	1.690E+07	3.35E+05	3.95E+03	3.38E+05
3	1.490E+07	8.25E+05	1.05E+04	8.36E+05
4	1.420E+07	9.91E+05	1.17E+04	1.00E+06
5	1.380E+07	2.17E+06	2.52E+04	2.20E+06
6	1.280E+07	3.03E+06	4.24E+04	3.07E+06
7	1.220E+07	6.18E+06	8.75E+04	6.27E+06
8	1.110E+07	1.19E+07	1.83E+05	1.21E+07
9	1.000E+07	2.32E+07	4.65E+05	2.37E+07
10	9.050E+06	3.83E+07	9.37E+05	3.92E+07
11	8.190E+06	6.15E+07	1.61E+06	6.31E+07
12	7.410E+06	1.02E+08	3.39E+06	1.06E+08
13	6.380E+06	1.88E+08	8.71E+06	1.96E+08
14	4.970E+06	2.40E+08	1.34E+07	2.54E+08
15	4.720E+06	2.80E+08	1.52E+07	2.95E+08
16	4.070E+06	3.36E+08	2.65E+07	3.62E+08
17	3.010E+06	4.52E+08	4.52E+07	4.97E+08
18	2.390E+06	5.13E+08	3.83E+07	5.52E+08
19	2.310E+06	4.00E+08	3.15E+07	4.32E+08
20	1.830E+06	3.61E+08	4.99E+07	4.11E+08
21	1.110E+06	2.74E+08	6.32E+07	3.37E+08
22	5.500E+05	1.53E+08	5.01E+07	2.03E+08
23	1.580E+05	1.15E+08	4.58E+07	1.61E+08
24	1.110E+05	9.36E+07	4.02E+07	1.34E+08
25	5.250E+04	7.75E+07	3.77E+07	1.15E+08
26	2.480E+04	7.45E+07	3.59E+07	1.10E+08
27	2.190E+04	7.01E+07	3.52E+07	1.05E+08
28	1.030E+04	6.73E+07	3.60E+07	1.03E+08
29	3.350E+03	6.67E+07	3.70E+07	1.04E+08
30	1.230E+03	6.76E+07	3.84E+07	1.06E+08
31	5.830E+02	6.88E+07	4.00E+07	1.09E+08
32	1.010E+02	7.06E+07	4.18E+07	1.12E+08
33	2.900E+01	7.19E+07	4.31E+07	1.15E+08
34	1.070E+01	7.27E+07	4.41E+07	1.17E+08
35	3.060E+00	7.39E+07	4.53E+07	1.19E+08
36	1.130E+00	7.38E+07	4.58E+07	1.20E+08
37	4.140E-01	8.17E+08	8.00E+08	6.17E+08

Table II.3.26. Gamma Flux Per Unit Lethargy Per Kilowatt.

GROUP	ENERGY (EV)	PNEUMATIC TUBES NEAR ER2		
		FRONT	BACK	TOTAL
1	1.400E+07	1.94E+04	1.78E+03	2.12E+04
2	1.000E+07	1.41E+08	8.34E+05	1.42E+08
3	8.000E+06	7.16E+08	6.29E+07	7.79E+08
4	7.000E+06	3.65E+08	1.42E+07	3.79E+08
5	6.000E+06	4.55E+08	1.46E+07	4.69E+08
6	5.000E+06	9.56E+08	4.17E+07	9.98E+08
7	4.000E+06	1.52E+09	3.42E+07	1.55E+09
8	3.000E+06	2.38E+09	3.91E+07	2.42E+09
9	2.500E+06	7.77E+09	2.03E+09	9.80E+09
10	2.000E+06	4.01E+09	1.18E+08	4.12E+09
11	1.500E+06	4.64E+09	1.12E+08	4.76E+09
12	1.000E+06	4.95E+09	1.10E+08	5.06E+09
13	7.000E+05	5.67E+09	3.01E+08	5.97E+09
14	4.500E+05	4.84E+09	8.56E+08	5.70E+09
15	3.000E+05	3.88E+09	3.18E+09	7.06E+09
16	1.500E+05	3.52E+09	3.14E+09	6.65E+09
17	1.000E+05	2.92E+09	3.08E+09	5.99E+09
18	7.000E+04	1.57E+09	2.01E+09	3.58E+09
19	4.500E+04	2.83E+08	4.04E+08	6.87E+08
20	3.000E+04	9.69E+06	1.15E+07	2.12E+07
21	2.000E+04	1.73E+04	1.87E+04	3.60E+04

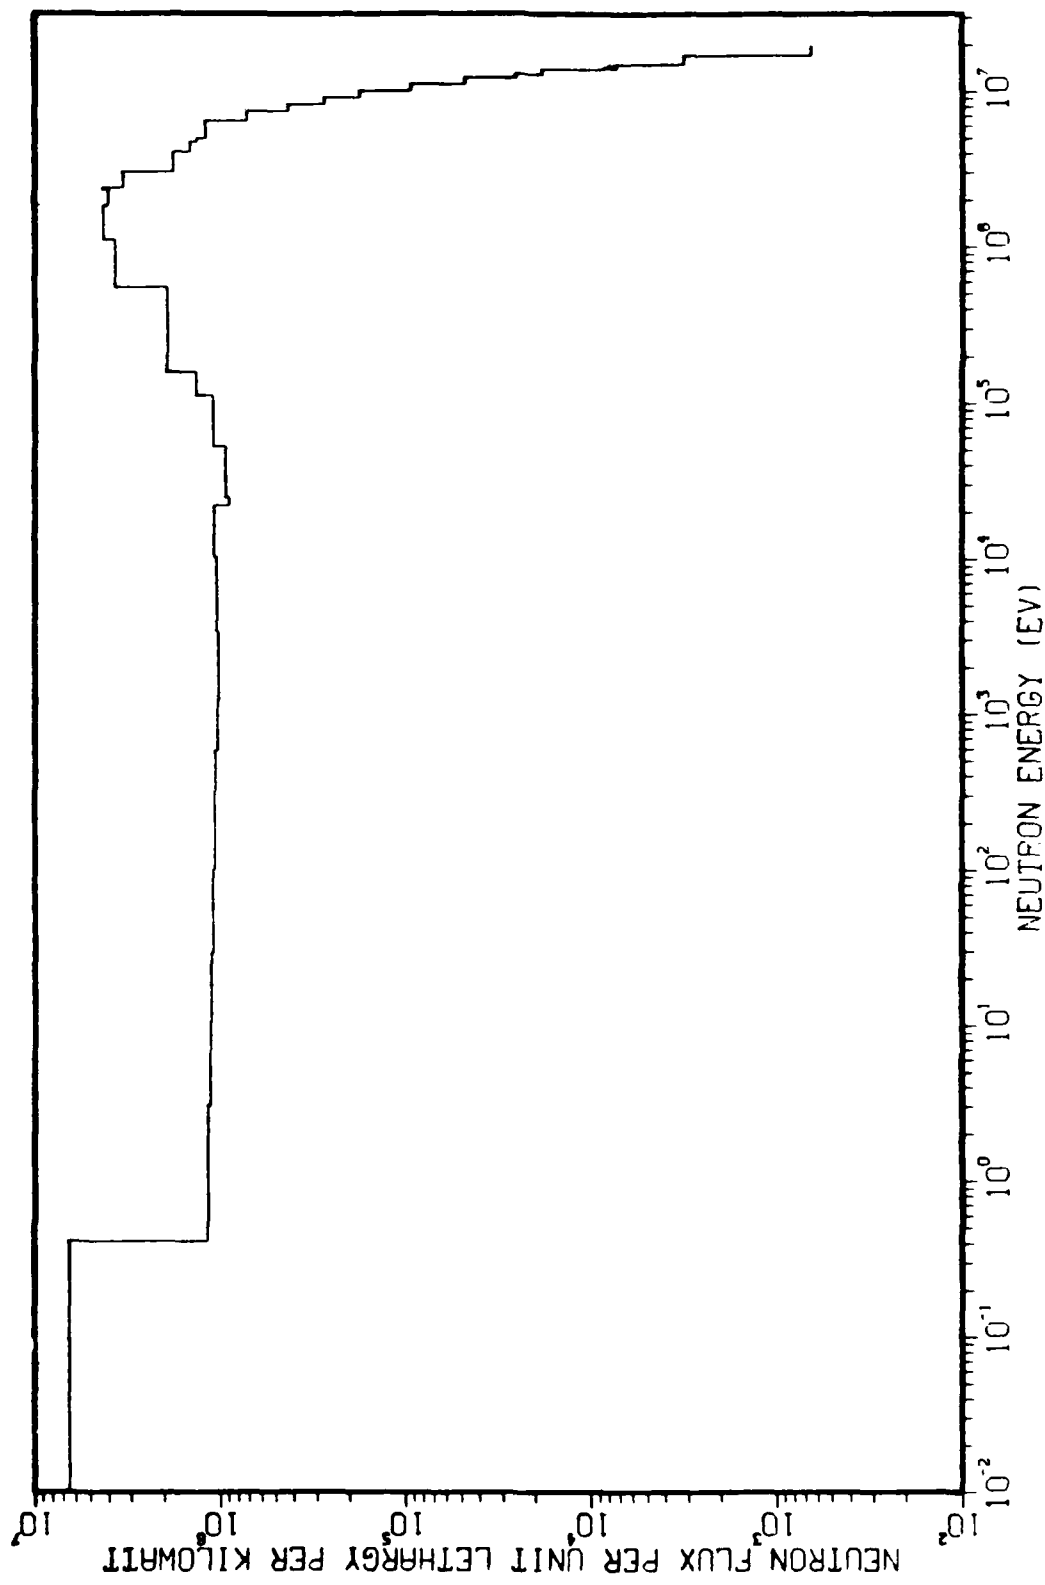


Figure II.3.49. Front (1-D) Neutron Flux vs Energy ER1 With 6" PB and Phantom.

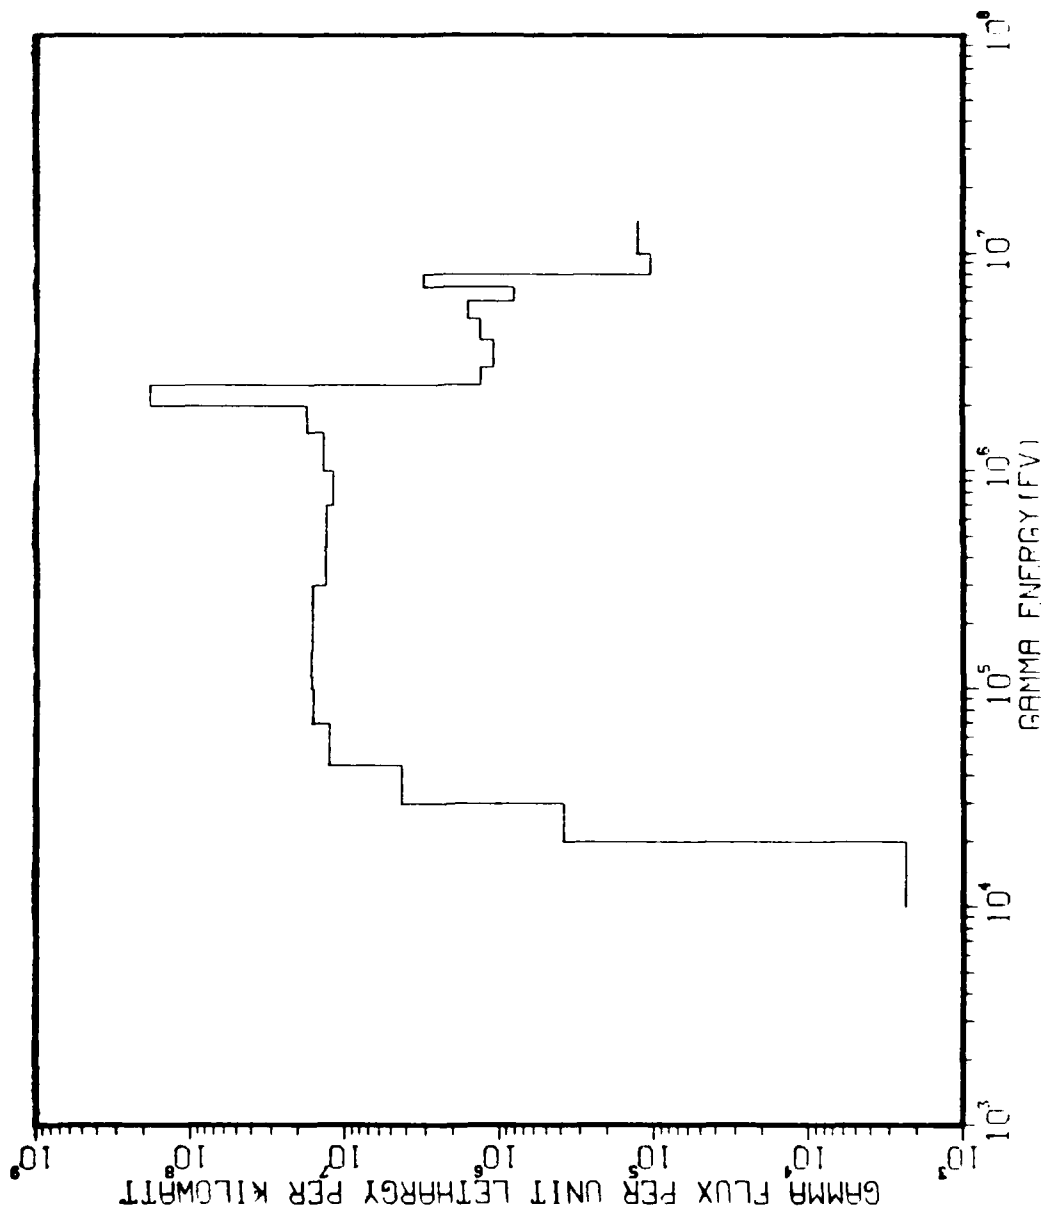


Figure II.3.50. Front Gamma Flux vs Energy ER1 With 6" PB and Phantom.

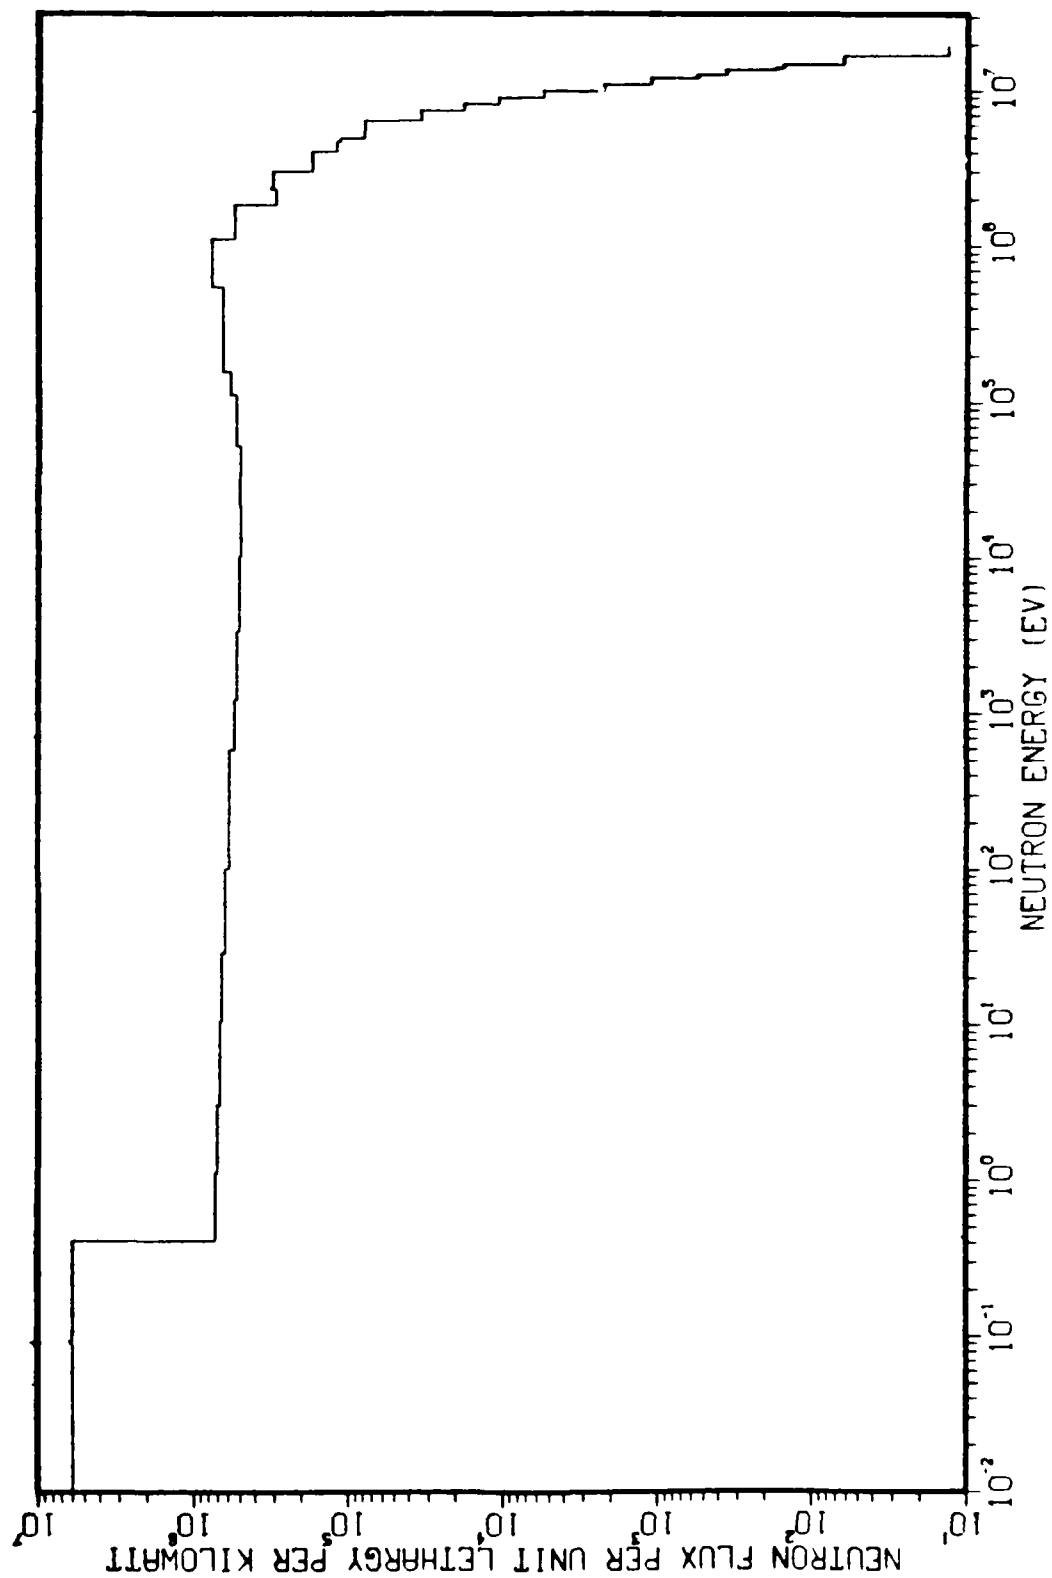


Figure II.3.51. Back (1-D) Neutron Flux vs Energy ERI With 6" PB and Phantom.

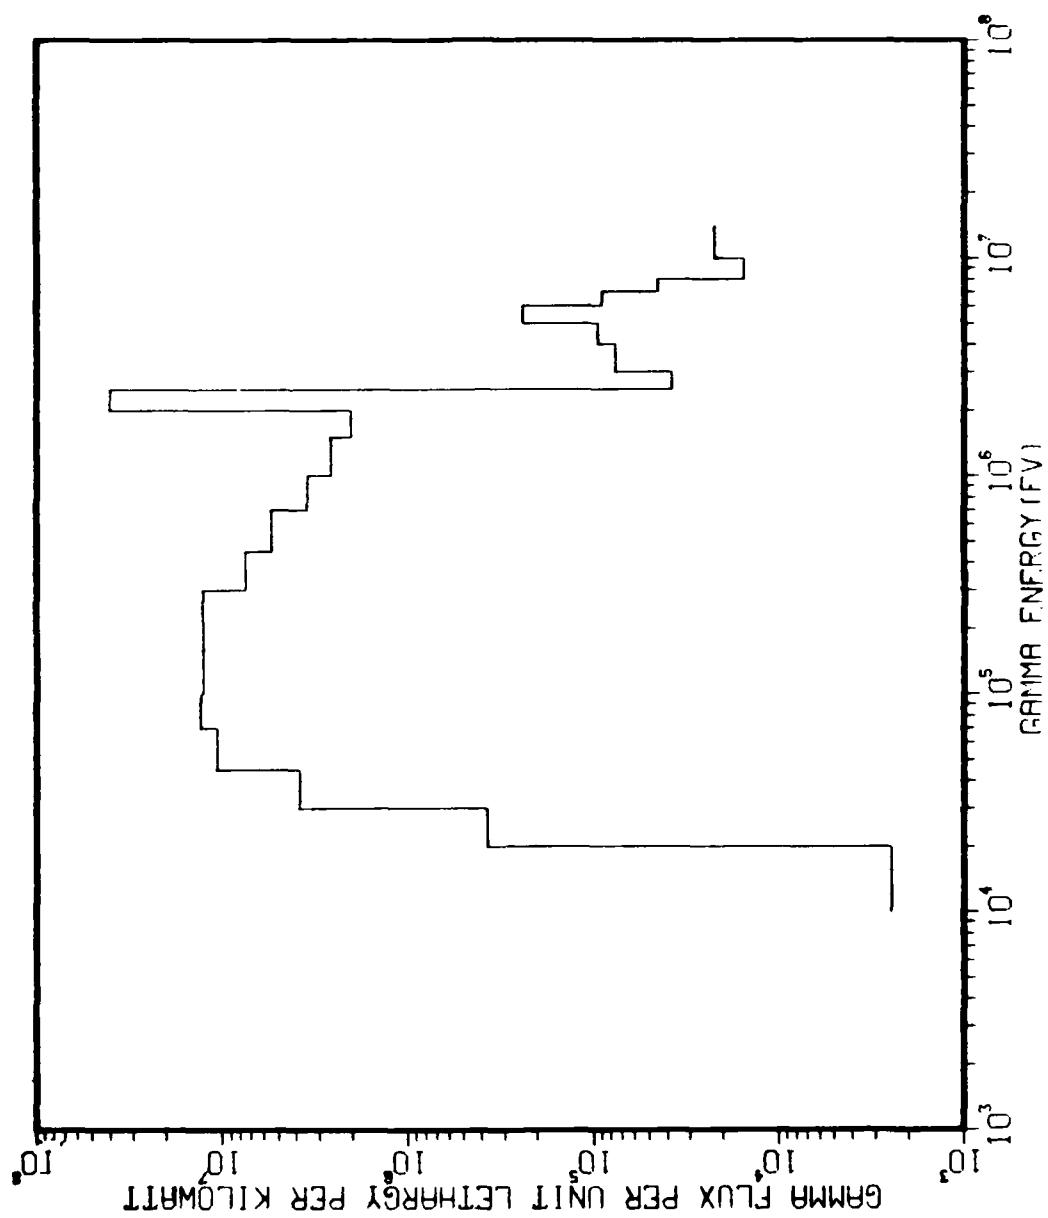


Figure II.3.52. Back Gamma Flux vs Energy ERI With 6" PB and Phantom.

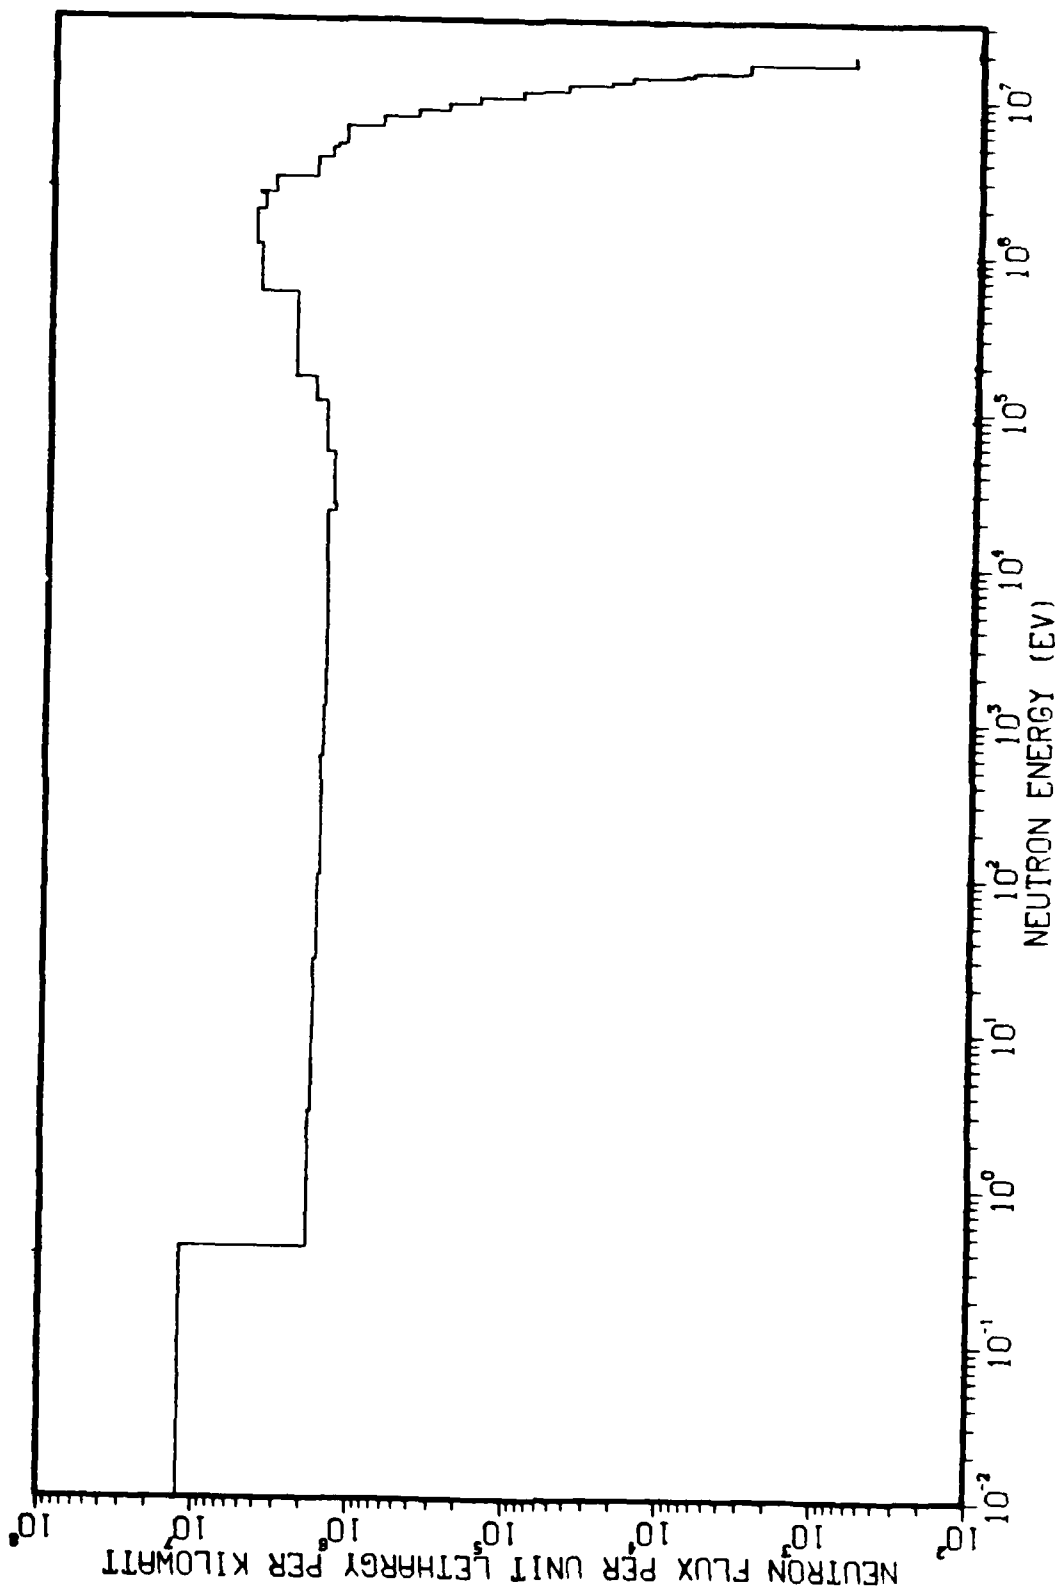


Figure II.3.53. Total (Front+Back, 1-D) Neutron Flux vs Energy ER1 With 6" PB and Phantom.

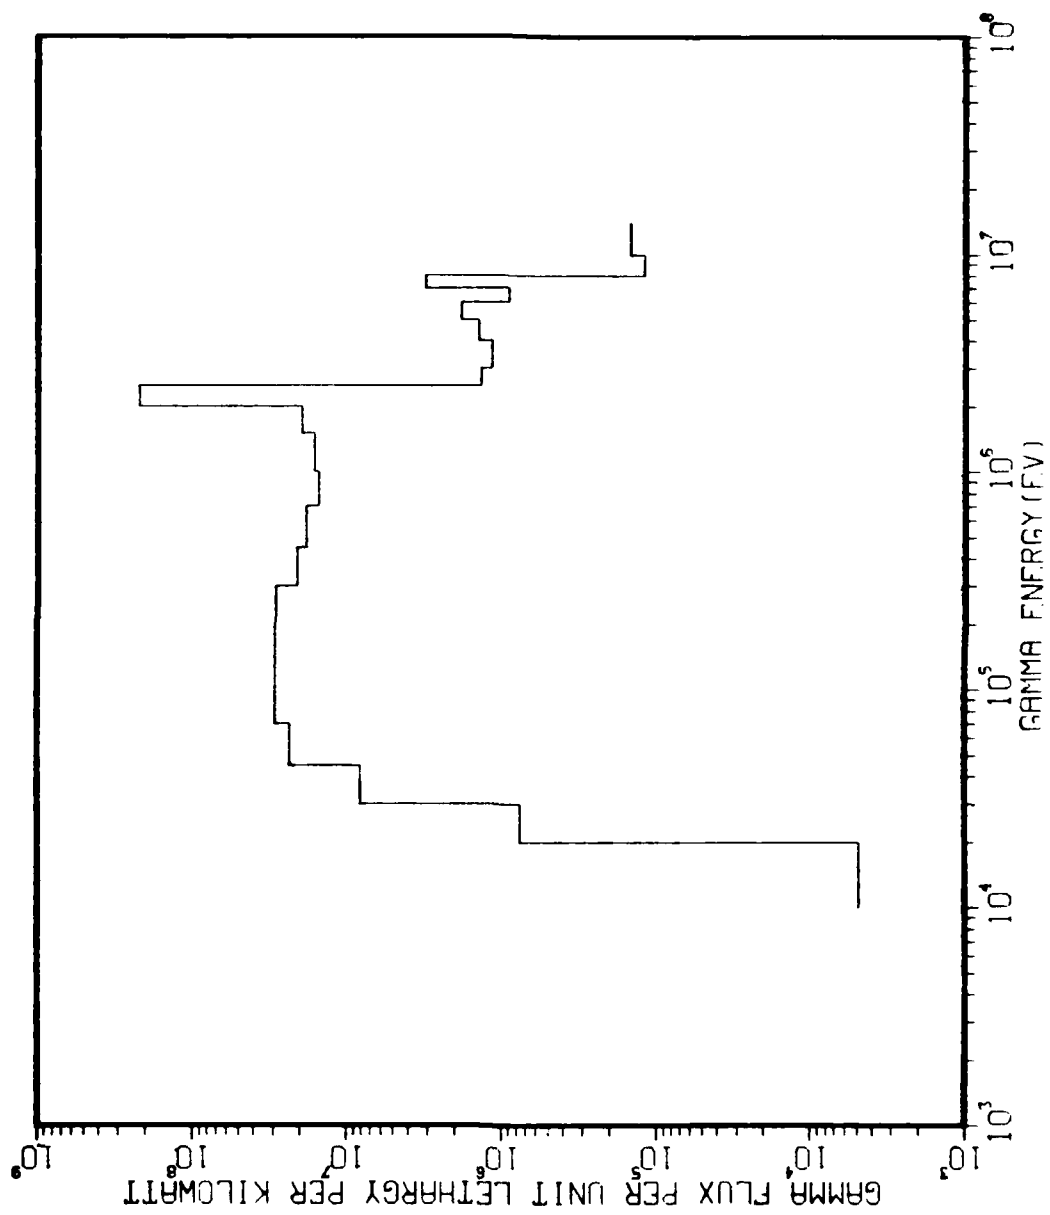


Figure II.3.54. Total (Front+Back) Gamma Flux vs Energy ERI With 6" in PB and Phantom.

Table II.3.27. Neutron Flux Per Unit LEthargy Per Kilowatt.

ER1 With 6" Pb and Phantom

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.968E+07	6.55E+02	1.35E+01	6.68E+02
2	1.698E+07	3.28E+03	6.27E+01	3.26E+03
3	1.498E+07	7.37E+03	1.63E+02	7.63E+03
4	1.428E+07	8.51E+03	1.78E+02	8.68E+03
5	1.388E+07	1.05E+04	3.59E+02	1.08E+04
6	1.288E+07	2.54E+04	5.49E+02	2.60E+04
7	1.228E+07	4.01E+04	1.18E+03	4.92E+04
8	1.118E+07	9.38E+04	2.24E+03	9.60E+04
9	1.088E+07	1.77E+05	5.52E+03	1.82E+05
10	9.858E+06	2.77E+05	1.88E+04	2.87E+05
11	8.198E+06	4.32E+05	1.88E+04	4.50E+05
12	7.418E+06	7.22E+05	3.41E+04	7.66E+05
13	6.388E+06	1.28E+06	7.96E+04	1.28E+06
14	4.978E+06	1.96E+06	1.14E+05	1.47E+06
15	4.728E+06	1.46E+06	1.19E+05	1.58E+06
16	4.078E+06	1.08E+06	1.73E+05	1.98E+06
17	3.018E+06	3.33E+06	3.12E+05	3.64E+06
18	2.398E+06	4.33E+06	3.28E+05	4.65E+06
19	2.318E+06	4.81E+06	2.96E+05	4.31E+06
20	1.838E+06	4.38E+06	5.52E+05	4.85E+06
21	1.118E+06	3.69E+06	7.71E+05	4.46E+06
22	5.588E+05	1.93E+06	6.54E+05	2.58E+06
23	1.588E+05	1.35E+06	5.88E+05	1.94E+06
24	1.118E+05	1.18E+06	5.36E+05	1.64E+06
25	5.258E+04	9.43E+05	5.87E+05	1.45E+06
26	2.488E+04	9.81E+05	5.85E+05	1.41E+06
27	2.198E+04	1.89E+06	4.99E+05	1.58E+06
28	1.838E+04	1.85E+06	5.14E+05	1.56E+06
29	3.358E+03	1.83E+06	5.33E+05	1.57E+06
30	1.238E+03	1.85E+06	5.54E+05	1.68E+06
31	5.838E+02	1.87E+06	5.94E+05	1.66E+06
32	1.818E+02	1.18E+06	6.33E+05	1.74E+06
33	2.988E+01	1.12E+06	6.61E+05	1.78E+06
34	1.878E+01	1.14E+06	6.84E+05	1.82E+06
35	3.868E+00	1.16E+06	7.18E+05	1.87E+06
36	1.138E+00	1.17E+06	7.24E+05	1.98E+06
37	4.148E-01	6.68E+06	6.81E+06	1.25E+07

Table II.3.28. Gamma Flux Per Unit Lethargy Per Kilowatt.

ERI With 6" Pb and Phantom

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.400E+07	1.26E+05	2.21E+04	1.48E+05
2	1.000E+07	1.05E+05	1.55E+04	1.20E+05
3	8.000E+06	3.06E+06	4.52E+04	3.11E+06
4	7.000E+06	8.13E+05	9.01E+04	9.04E+05
5	6.000E+06	1.60E+06	2.39E+05	1.83E+06
6	5.000E+06	1.32E+06	9.47E+04	1.41E+06
7	4.000E+06	1.08E+06	7.64E+04	1.16E+06
8	3.000E+06	1.31E+06	3.78E+04	1.35E+06
9	2.500E+06	1.82E+08	4.02E+07	2.22E+08
10	2.000E+06	1.76E+07	2.03E+06	1.96E+07
11	1.500E+06	1.36E+07	2.60E+06	1.62E+07
12	1.000E+06	1.18E+07	3.52E+06	1.53E+07
13	7.000E+05	1.30E+07	5.49E+06	1.85E+07
14	4.500E+05	1.34E+07	7.56E+06	2.10E+07
15	3.000E+05	1.62E+07	1.27E+07	2.89E+07
16	1.500E+05	1.64E+07	1.27E+07	2.91E+07
17	1.000E+05	1.60E+07	1.31E+07	2.91E+07
18	7.000E+04	1.25E+07	1.07E+07	2.32E+07
19	4.500E+04	4.30E+06	3.05E+06	8.16E+06
20	3.000E+04	3.86E+05	3.71E+05	7.57E+05
21	2.000E+04	2.36E+03	2.48E+03	4.83E+03

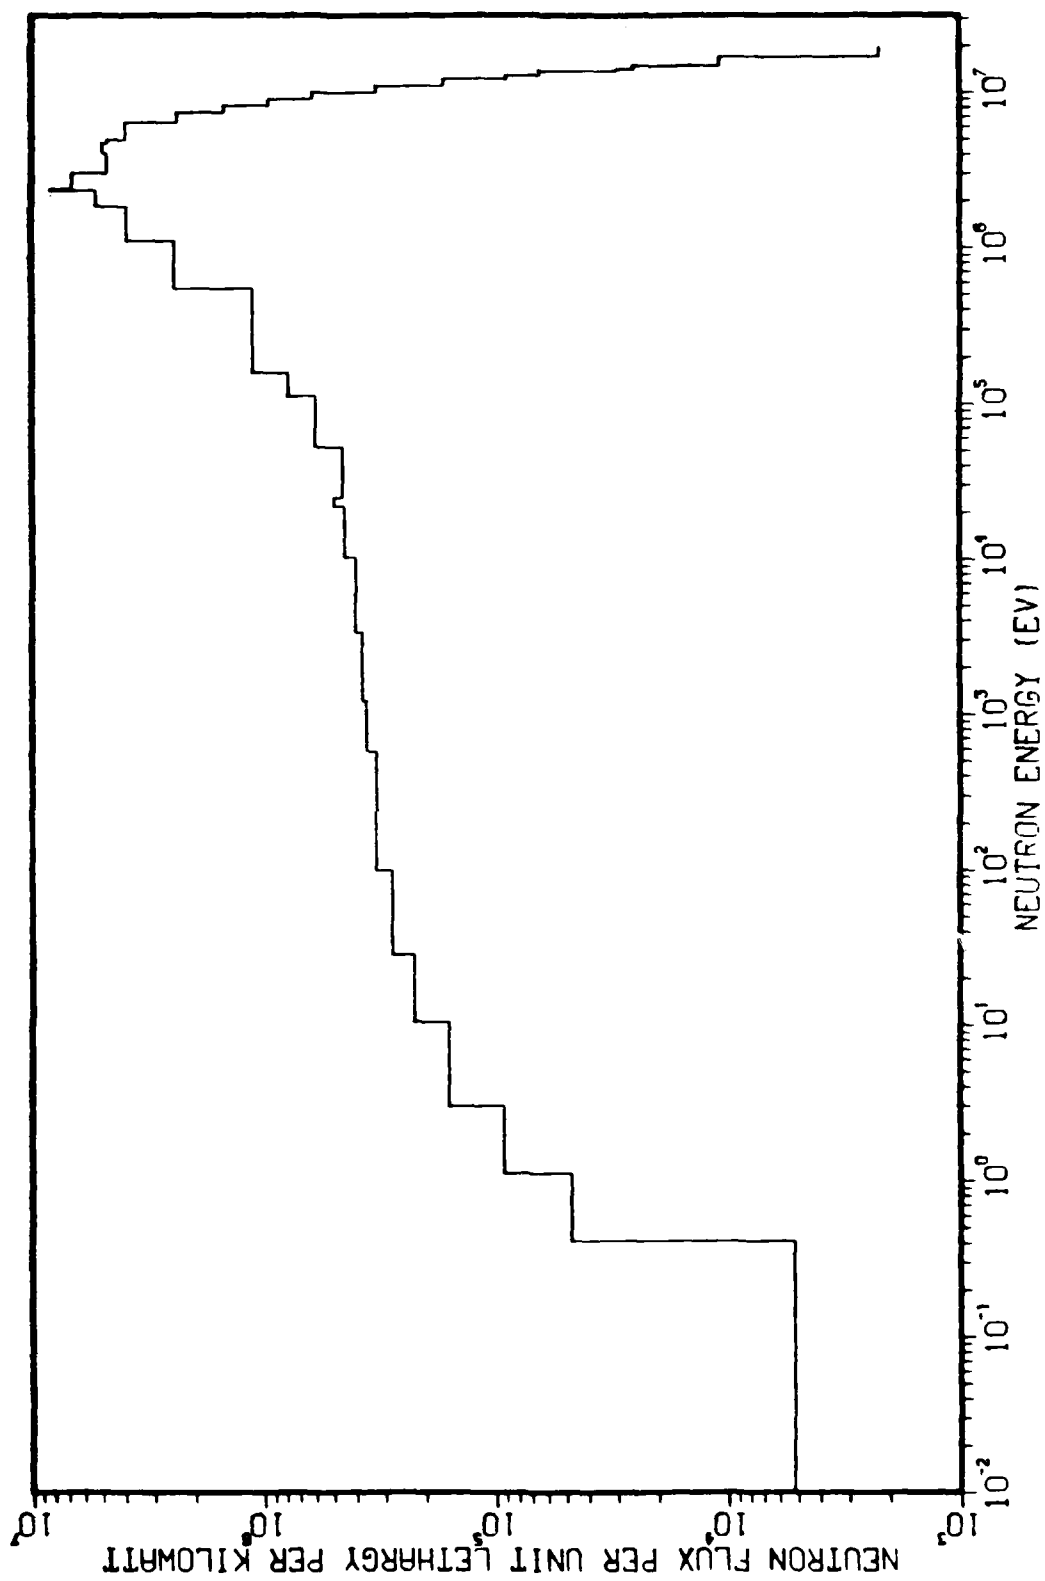


Figure 11.3.55. Front (1-D) Neutron Flux vs Energy ERI With 5" Water.

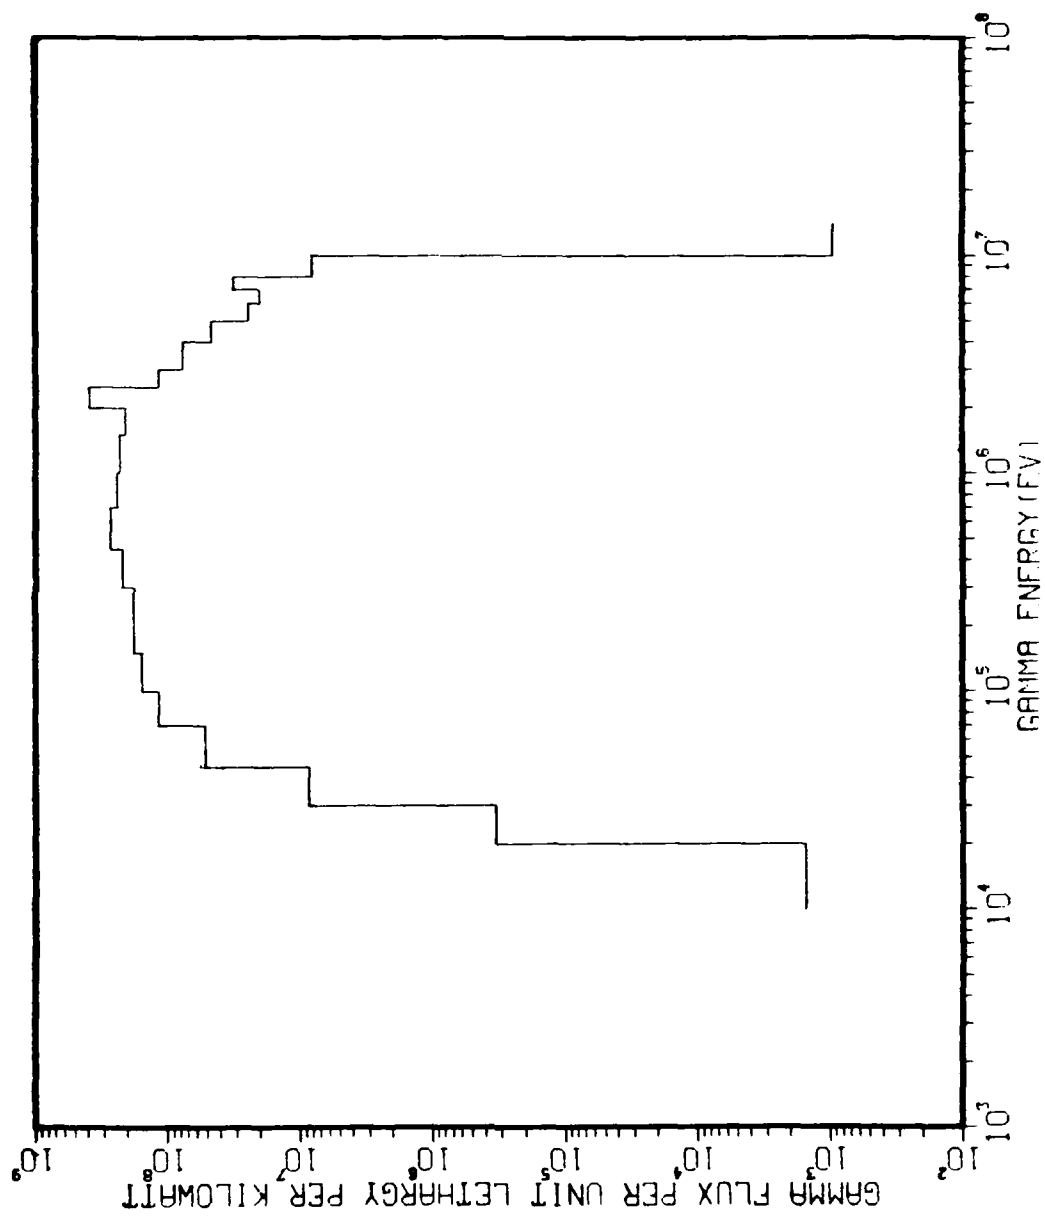


Figure II.3.56. Front Gamma Flux vs Energy ER1 With 5" Water.

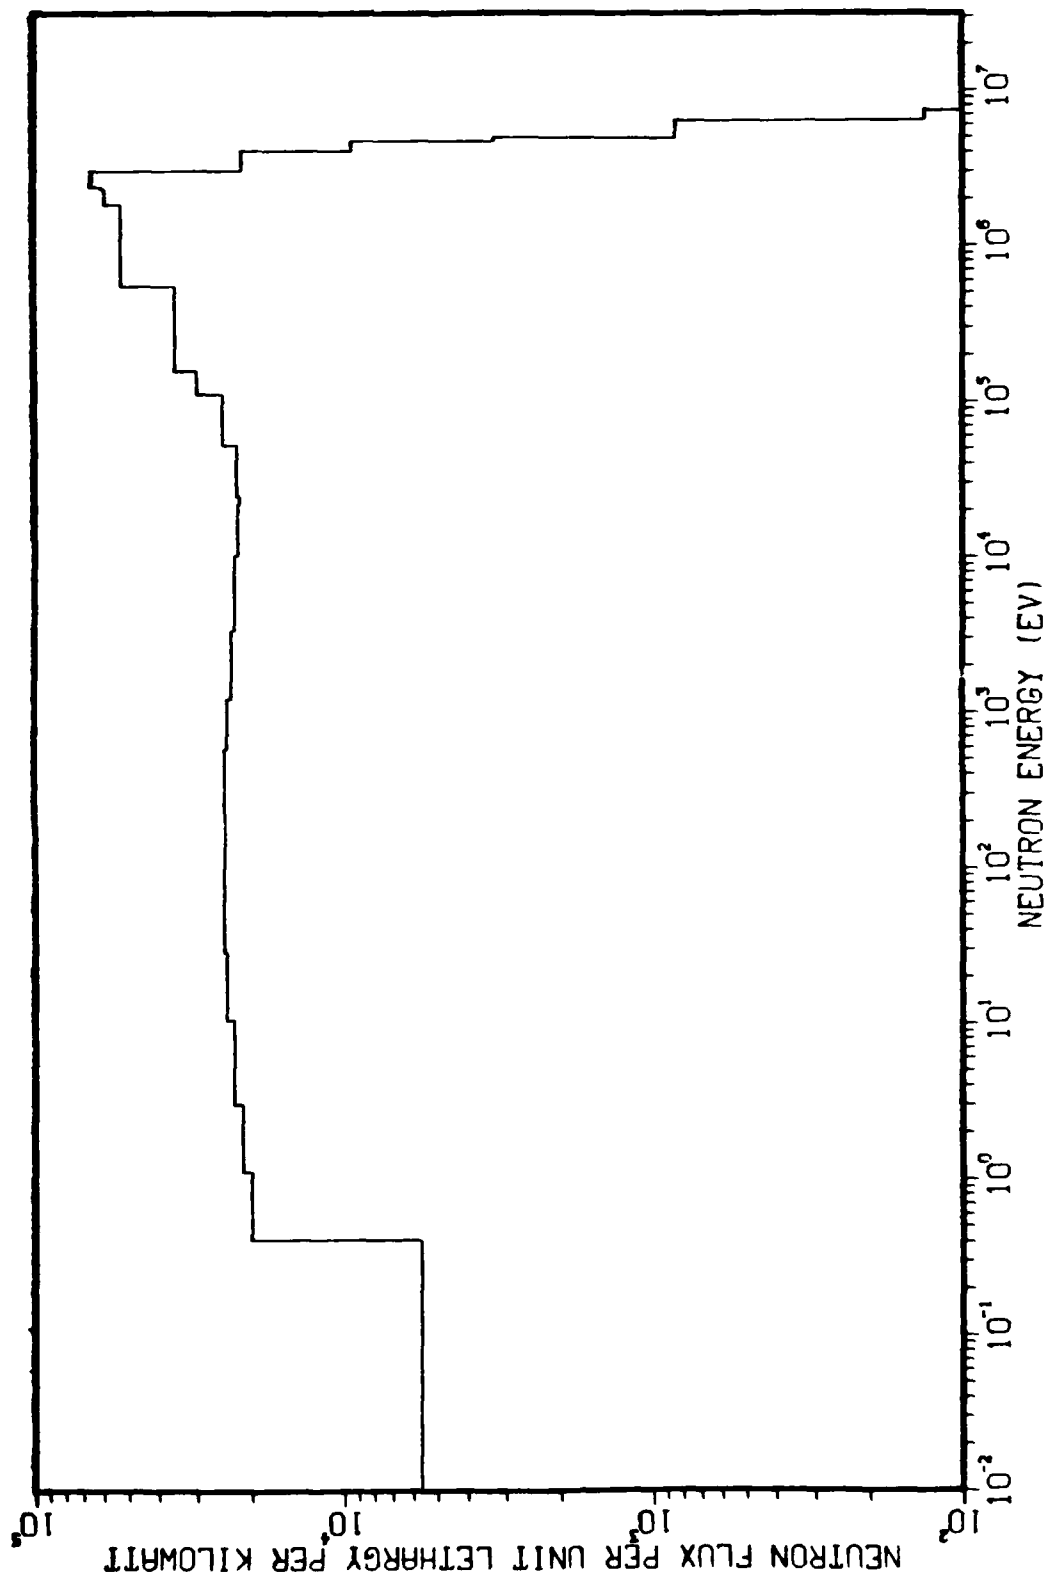


Figure 11.3.57. Back (1-D) Neutron Flux vs Energy ER1 With 5" Water.

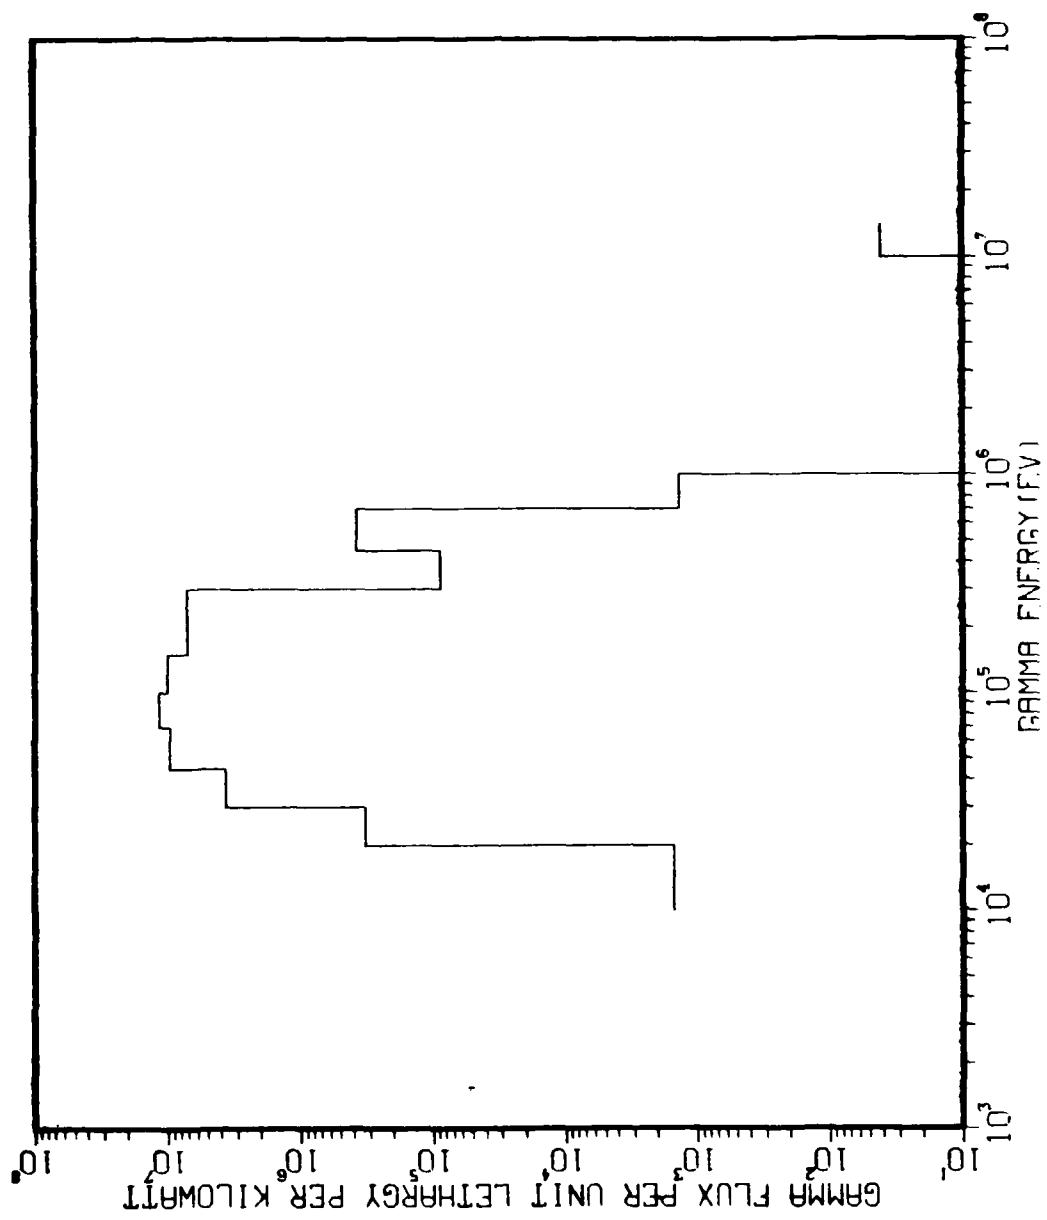


Figure II.3.58. Back Gamma Flux vs Energy ER1 With 5" Water.

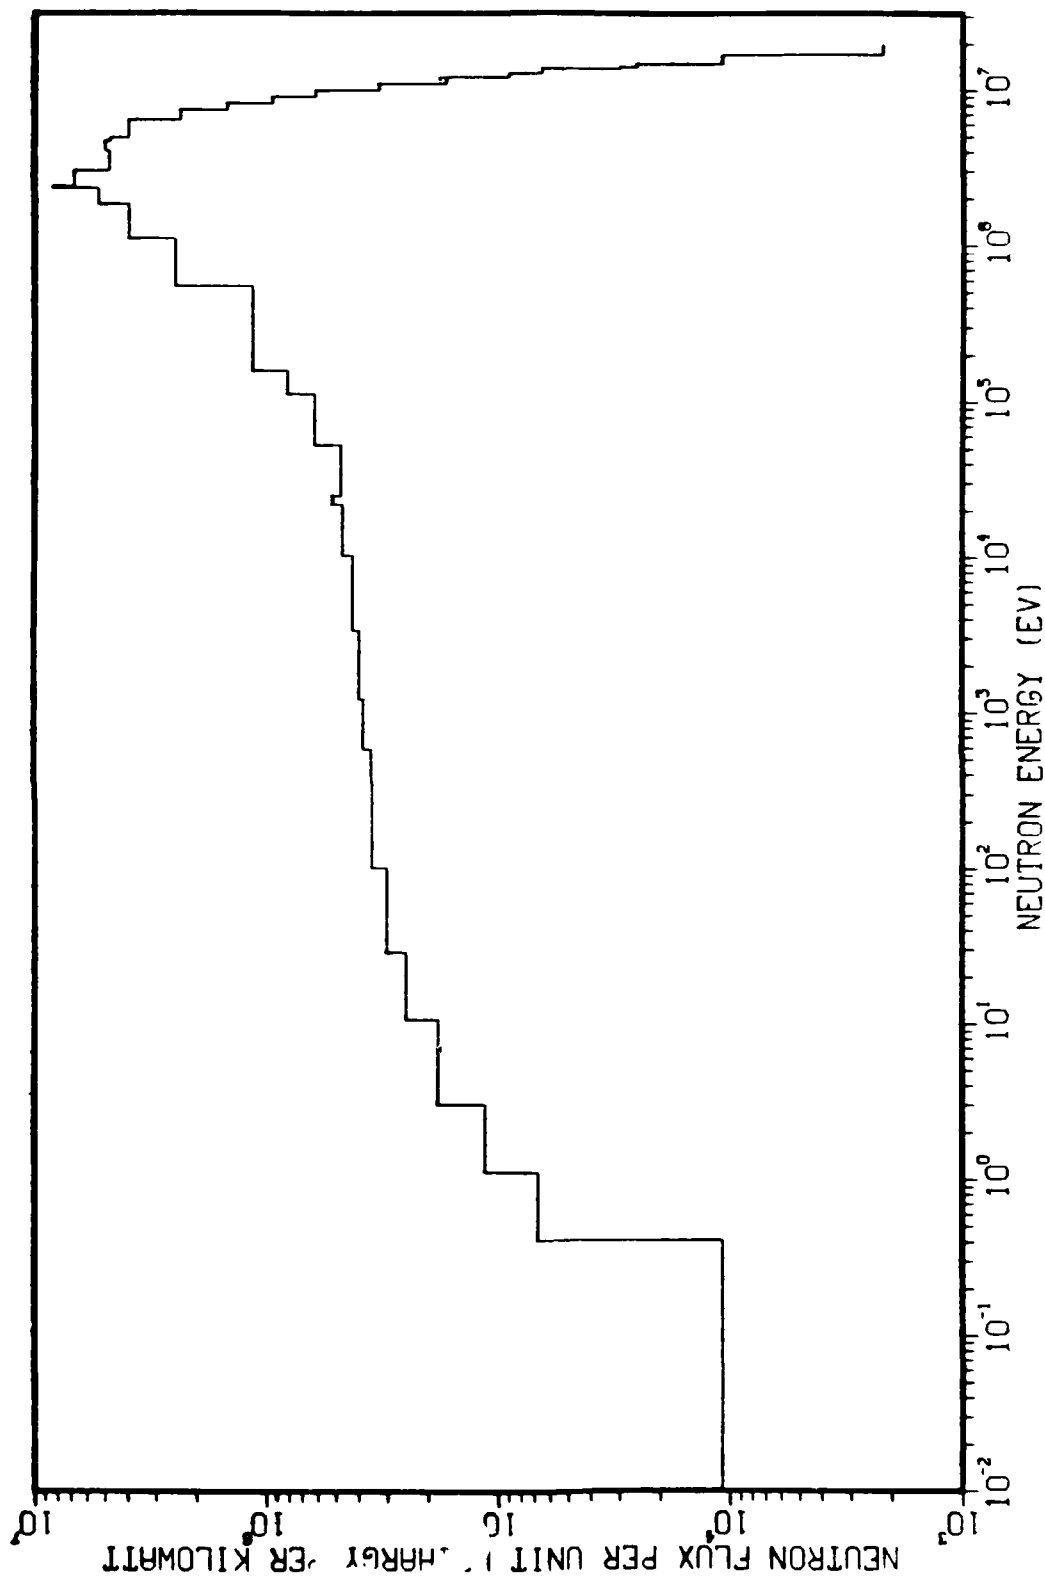


Figure 11.3.59. Total (Front+Back, 1-D) Neutron Flux vs Energy ERI With 5" Water.

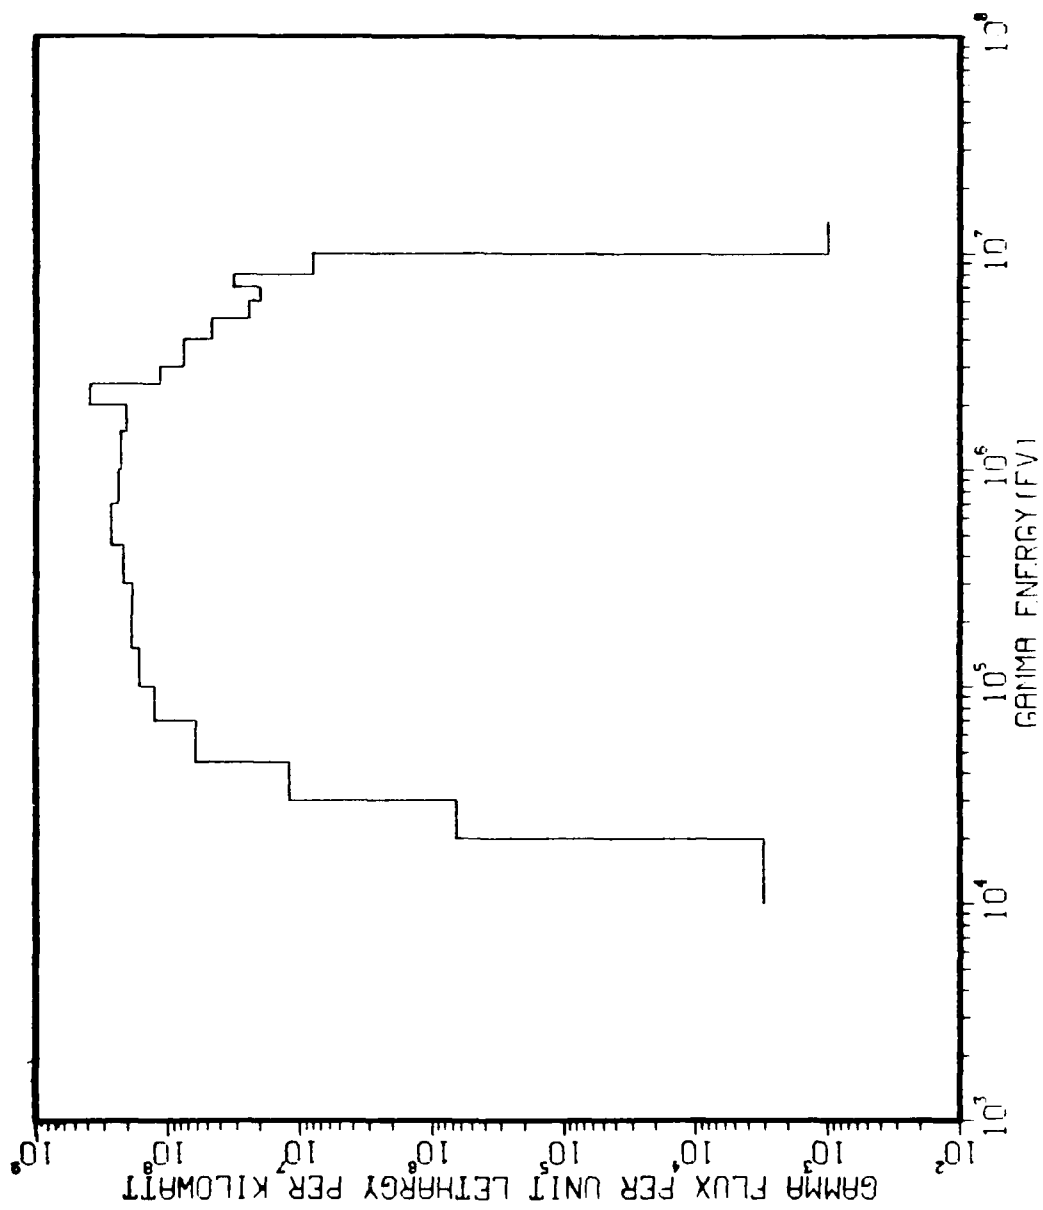


Figure II.3.60. Total (Front+Back) Gamma Flux vs Energy ERI With 5" Water.

Table II.3.29. Neutron Flux Per Unit Lethargy Per Kilowatt.

Free Field in ER1 With Core Moved Back 5 Inches

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	2.22E+03	0.00E+00	2.22E+03
2	1.690E+07	1.09E+04	0.00E+00	1.09E+04
3	1.490E+07	2.55E+04	0.00E+00	2.55E+04
4	1.420E+07	2.99E+04	0.00E+00	2.99E+04
5	1.380E+07	6.47E+04	0.00E+00	6.47E+04
6	1.280E+07	9.07E+04	0.00E+00	9.07E+04
7	1.220E+07	1.68E+05	0.00E+00	1.68E+05
8	1.110E+07	3.38E+05	0.00E+00	3.38E+05
9	1.000E+07	6.23E+05	0.00E+00	6.23E+05
10	9.050E+06	9.50E+05	0.00E+00	9.50E+05
11	8.190E+06	1.48E+06	0.00E+00	1.48E+06
12	7.410E+06	2.37E+06	1.32E+02	2.37E+06
13	6.380E+06	3.96E+06	0.47E+02	3.97E+06
14	4.970E+06	4.73E+06	3.26E+03	4.74E+06
15	4.720E+06	4.97E+06	9.42E+03	4.98E+06
16	4.070E+06	4.76E+06	2.14E+04	4.78E+06
17	3.010E+06	6.72E+06	6.50E+04	6.78E+06
18	2.390E+06	8.28E+06	6.03E+04	8.34E+06
19	2.310E+06	5.29E+06	5.09E+04	5.35E+06
20	1.830E+06	3.09E+06	5.26E+04	3.94E+06
21	1.110E+06	2.44E+06	5.24E+04	2.49E+06
22	5.500E+05	1.13E+06	3.51E+04	1.16E+06
23	1.580E+05	7.90E+05	2.98E+04	8.20E+05
24	1.110E+05	6.02E+05	2.46E+04	6.27E+05
25	5.250E+04	4.59E+05	2.23E+04	4.81E+05
26	2.480E+04	4.98E+05	2.18E+04	5.20E+05
27	2.190E+04	4.50E+05	2.21E+04	4.72E+05
28	1.030E+04	4.04E+05	2.26E+04	4.27E+05
29	3.350E+03	3.78E+05	2.32E+04	4.02E+05
30	1.230E+03	3.62E+05	2.39E+04	3.86E+05
31	5.030E+02	3.29E+05	2.44E+04	3.53E+05
32	1.010E+02	2.02E+05	2.46E+04	3.06E+05
33	2.900E+01	2.28E+05	2.41E+04	2.52E+05
34	1.070E+01	1.61E+05	2.28E+04	1.84E+05
35	3.060E+00	9.33E+04	2.14E+04	1.15E+05
36	1.130E+00	4.77E+04	2.00E+04	6.77E+04
37	4.140E-01	5.22E+03	5.63E+03	1.09E+04

Table II.3.30. Gamma Flux Per Unit Lethargy Per Kilowatt.

Free Field in ER1 With Core Moved Back 5 Inches

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.488E+07	9.57E+02	4.88E+01	9.98E+02
2	1.888E+07	8.88E+06	8.88E+00	8.88E+06
3	8.888E+06	3.17E+07	8.88E+00	3.17E+07
4	7.888E+06	2.88E+07	8.88E+00	2.88E+07
5	6.888E+06	2.44E+07	8.88E+00	2.44E+07
6	5.888E+06	4.69E+07	8.88E+00	4.69E+07
7	4.888E+06	7.63E+07	8.88E+00	7.63E+07
8	3.888E+06	1.17E+08	8.88E+00	1.17E+08
9	2.588E+06	3.91E+08	8.88E+00	3.91E+08
10	2.888E+06	2.86E+08	8.88E+00	2.86E+08
11	1.588E+06	2.31E+08	8.88E+00	2.31E+08
12	1.888E+06	2.39E+08	1.38E+03	2.39E+08
13	7.888E+05	2.68E+08	3.79E+05	2.68E+08
14	4.588E+05	2.18E+08	8.78E+04	2.18E+08
15	3.888E+05	1.79E+08	7.16E+06	1.86E+08
16	1.588E+05	1.54E+08	9.99E+06	1.64E+08
17	1.888E+05	1.16E+08	1.16E+07	1.27E+08
18	7.888E+04	5.22E+07	9.58E+06	6.18E+07
19	4.588E+04	8.49E+06	3.78E+06	1.22E+07
20	3.888E+04	3.34E+05	3.24E+05	6.59E+05
21	2.888E+04	1.54E+03	1.54E+03	3.07E+03

Table II.3.31. Front Response Per Kilowatt for ANIAN (1-D) Results.

RESPONSE	CASE 1	CASE 2	CASE 3	CASE 4	CASE 5	CASE 6	CASE 7	CASE 8	CASE 9	CASE 10
SULFUR ACTIVATION ACTS/CC-S/ATOM/BN-CM/KW	5.70E+06	1.22E+06	3.03E+05	3.16E+06	5.19E+06	1.66E+05	3.40E+06	7.26E+07	4.60E+05	1.28E+06
SILICON DAMAGE 1 MEV EQUIVALENT N/CM2/S/KW	9.10E+07	5.45E+07	1.03E+08	9.16E+07	8.47E+07	1.73E+06	7.50E+07	1.56E+09	1.85E+07	1.61E+07
NEUTRON DOSE RAD/S/KW	2.91E-01	1.73E-01	3.47E-01	3.93E-01	2.89E-01	5.44E-03	2.39E-01	6.68E+00	9.38E-02	5.08E-02
GAMMA DOSE RAD/S/KW	4.81E-01	1.39E-03	4.77E-04	7.82E-02	4.53E-01	2.08E-01	3.53E-02	7.45E+00	5.16E-02	3.66E-01
NEUTRON DOSE REM/S/KW	2.55E+00	1.62E+00	3.01E+00	2.34E+00	2.32E+00	4.53E-02	2.16E+00	3.90E+01	4.34E-01	4.36E-01
TOTAL DOSE RAD/S/KW	7.72E-01	1.74E-01	3.48E-01	4.71E-01	7.42E-01	2.13E-01	2.74E-01	1.41E+01	1.45E-01	4.17E-01
TOTAL DOSE REM/S/KW	3.03E+00	1.62E+00	3.02E+00	2.42E+00	2.77E+00	2.53E-01	2.20E+00	4.65E+01	4.85E-01	8.02E-01
TOTAL NEUTRON FLUX N/CM2/S/KW	1.11E+08	8.11E+07	2.61E+08	3.67E+08	1.46E+08	1.56E+06	9.79E+07	6.06E+09	1.08E+08	1.64E+07
NEUTRON FLUX > 1 MEV N/CM2/S/KW	5.13E+07	2.39E+07	2.14E+07	3.62E+07	4.60E+07	1.02E+06	3.98E+07	6.66E+08	5.86E+06	9.48E+06

Table II.3.32. Back Response Per Kilowatt For ANISN (1-D) Results.

RESPONSE	CASE 1	CASE 2	CASE 3	CASE 4	CASE 5	CASE 6	CASE 7	CASE 8	CASE 9	CASE 10
SULFUR ACTIVATION ACTS/CC-S/ATOM/BN-CM/KW	1.68E+04	3.13E+03	9.63E+04	2.18E+05	2.19E+04	4.96E+02	9.87E+03	4.65E+06	3.57E+04	3.87E+03
SILICON DAMAGE 1 MEV EQUIVALENT N/CM2/S/KW	1.03E+06	6.70E+05	6.21E+07	2.89E+07	1.63E+06	1.71E+04	9.01E+05	4.92E+08	8.18E+06	1.77E+05
NEUTRON DOSE RAD/S/KW	4.04E-03	2.77E-03	2.16E-01	1.85E-01	6.95E-03	6.22E-05	3.59E-03	3.13E+00	5.77E-02	6.58E-04
GAMMA DOSE RAD/S/KW	1.86E-03	5.90E-04	3.83E-04	1.84E-02	3.60E-03	7.74E-04	6.99E-04	1.03E+00	1.26E-02	1.29E-03
NEUTRON DOSE REM/S/KW	2.82E-02	1.81E-02	1.80E+00	5.66E-01	4.29E-02	4.75E-04	2.46E-02	9.51E+00	1.44E-01	4.90E-03
TOTAL DOSE RAD/S/KW	5.90E-03	3.36E-03	2.17E-01	2.04E-01	1.05E-02	8.36E-04	4.29E-03	4.21E+00	7.03E-02	1.95E-03
TOTAL DOSE REM/S/KW	3.01E-02	1.86E-02	1.80E+00	5.85E-01	4.65E-02	1.25E-03	2.53E-02	1.05E+01	1.56E-01	6.19E-03
TOTAL NEUTRON FLUX N/CM2/S/KW	3.58E+06	2.86E+06	1.81E+08	2.66E+08	6.99E+06	4.49E+04	3.36E+06	4.56E+09	8.74E+07	5.18E+05
NEUTRON FLUX > 1 MEV N/CM2/S/KW	3.67E+05	1.37E+05	1.02E+07	3.95E+06	5.22E+05	7.67E+03	2.70E+05	6.69E+07	6.41E+05	7.27E+04

Table 11.3.33. Total Response Per Kilowatt For ANISN (1-D) Results.

RESPONSE	CASE 1	CASE 2	CASE 3	CASE 4	CASE 5	CASE 6	CASE 7	CASE 8	CASE 9	CASE 10
SULFUR ACTIVATION ACTS/CC-S/ATOM/BN-CM/KV	5.72E+06	1.22E+06	3.99E+05	3.38E+06	5.21E+06	1.66E+05	3.41E+06	7.73E+07	4.96E+05	1.28E+06
SILICON DAMAGE 1 MEV EQUIVALENT R/CM2/S/KV	9.20E+07	5.52E+07	1.65E+08	1.21E+08	8.63E+07	1.75E+06	7.59E+07	2.05E+09	2.67E+07	1.63E+07
NEUTRON DOSE RAD/S/KV	2.98E-01	1.76E-01	5.63E-01	5.78E-01	2.96E-01	5.50E-03	2.43E-01	9.86E+00	1.51E-01	5.18E-02
GAMMA DOSE RAD/S/KV	4.83E-01	1.98E-03	8.60E-04	9.66E-02	4.57E-01	2.09E-01	3.60E-02	8.48E+00	6.42E-02	3.67E-01
NEUTRON DOSE REM/S/KV	2.58E+00	1.64E+00	4.81E+00	2.91E+00	2.36E+00	4.58E-02	2.18E+00	4.85E+01	5.78E-01	4.41E-01
TOTAL DOSE RAD/S/KV	7.78E-01	1.77E-01	5.65E-01	6.75E-01	7.52E-01	2.14E-01	2.78E-01	1.83E+01	2.15E-01	4.19E-01
TOTAL DOSE REM/S/KV	3.06E+00	1.64E+00	4.82E+00	3.00E+00	2.82E+00	2.54E-01	2.23E+00	5.70E+01	6.41E-01	8.08E-01
TOTAL NEUTRON FLUX R/CM2/S/KV	1.15E+08	8.40E+07	4.42E+08	6.33E+08	1.53E+08	1.60E+06	1.01E+08	1.06E+10	1.95E+08	1.69E+07
NEUTRON FLUX > 1 MEV R/CM2/S/KV	5.17E+07	2.40E+07	3.16E+07	4.02E+07	4.68E+07	1.03E+06	4.01E+07	7.33E+08	6.50E+06	9.55E+06

4. THREE-DIMENSIONAL CALCULATIONS

4.1. Three-Dimensional Models

Three-dimensional calculations were performed for eight of the ten reactor/room configurations described in chapter II.1. On the basis of these eight calculations, it was decided that no new information would be gained by doing the 3-D calculations for the remaining two cases. See Tables II.1.1 and II.1.2 for descriptions of the cases and location of the detectors.

In the case of the MORSE calculations, the modeling of the physical configuration includes all the important components in their proper location and shape. Therefore, the drawings of the experimental arrangements contained in Volume I of this report serve equally well to display the calculational configuration for the MORSE runs.

Since the geometric modeling is fairly exact, the major concerns in MORSE models are associated more with the source description, transport approximations, and variance reduction biasing techniques. The source for these MORSE calculations was the output from an ANISN run. Past work^{12,13} has shown that the coupling of discrete ordinates and Monte Carlo codes can lead to very efficient uses of the advantages of each technique. In this case, ANISN was run from the core to the outside surface of the reactor tank and shield. At this point a boundary leakage tape was written which is then used as a source for the MORSE runs. This approach allows use of the flexible, but time consuming, 3-D modeling capability of MORSE in the room itself (where it is needed) without having to recalculate the core region every time. Thus, when the room configuration changes, only the part of the calculation which has been changed has to be rerun. When the core configuration is changed, as in the case of moving the core back 12 inches, or moving the core to ER2, a new ANISN leakage source must be prepared. By noting the cases which were considered, one can see that only three leakage source were needed: one for ER1 with the core all the way in, one for ER2 with the core all the way in, and one for ER1 with the core moved back 12 inches. As will be seen later, the 1-D and 3-D results agree for ER1 free field with the core moved all the way in and with it moved back 12 inches, so it was not necessary to do a 3-D calculation of the free field in ER1 with the core moved back 5 inches. If it had been necessary, then another leakage source would have been generated.

With the leakage spectrum and angular distribution at the surface of the reactor tank supplied by the ANISN runs, a spatial distribution must be applied to allow the selection of starting positions for the source neutrons. This was derived from information supplied by AFRRRI personnel¹¹. Sulfur buttons were placed on the face of the reactor tank and irradiated. Use of the $^{32}\text{S}(n,p)$ reaction allows the calculation of the fluence of neutrons above 3 Mev at the position of each sulfur button. The buttons were placed on a vertical line on the part of the tank which extends the farthest into the room (the measurement was performed in ER1 with the core moved all the way in) and on a horizontal line along the circumference of the tank at the core midplane. The buttons were placed one inch apart along each line. Figure II.4.1 shows the sulfur fluence as a function of axial and azimuthal position on the tank face. These distributions were used to select, in the standard Monte Carlo fashion, the starting positions of the source neutrons. Due to lack of any data for ER2 and other positions of the core for ER1, this same spatial distribution was used for all the MORSE calculations. This assumption is not expected to adversely affect the results.

Several transport approximations were made which considerably enhanced the running time of the MORSE calculations without impairing the accuracy of the results. All of these approximations are the result of the presence of the wood on the walls, ceiling, and floor of the exposure rooms. The problem which the wood presents is that neutrons tend to scatter in the wood without being absorbed or contributing to the detector response. Neutrons will enter the wood, become thermalized, and then bounce around for a long time before stopping by absorption or escaping from the system. This problem was overcome by taking advantage of the presence of the gadolinium paint on the walls and ceiling. This paint is fairly thick to thermal neutrons (several mean free paths). If a neutron becomes thermalized in the wood behind the paint, it has very little chance of penetrating the paint and re-entering the room. Therefore, once a neutron becomes thermalized in the walls or the ceiling it is killed and the history is terminated. The floor does not have any gadolinium paint on it and in most cases the floor is only four feet from the detector location, so neutrons are allowed to scatter in the floor until they are absorbed, re-enter the room, or escape the system.

This approximation should not affect the neutron spectra significantly, but it will have an effect on the gamma-ray spectra. This gamma-ray effect comes from the fact that some of the gamma rays which are produced in the wood and

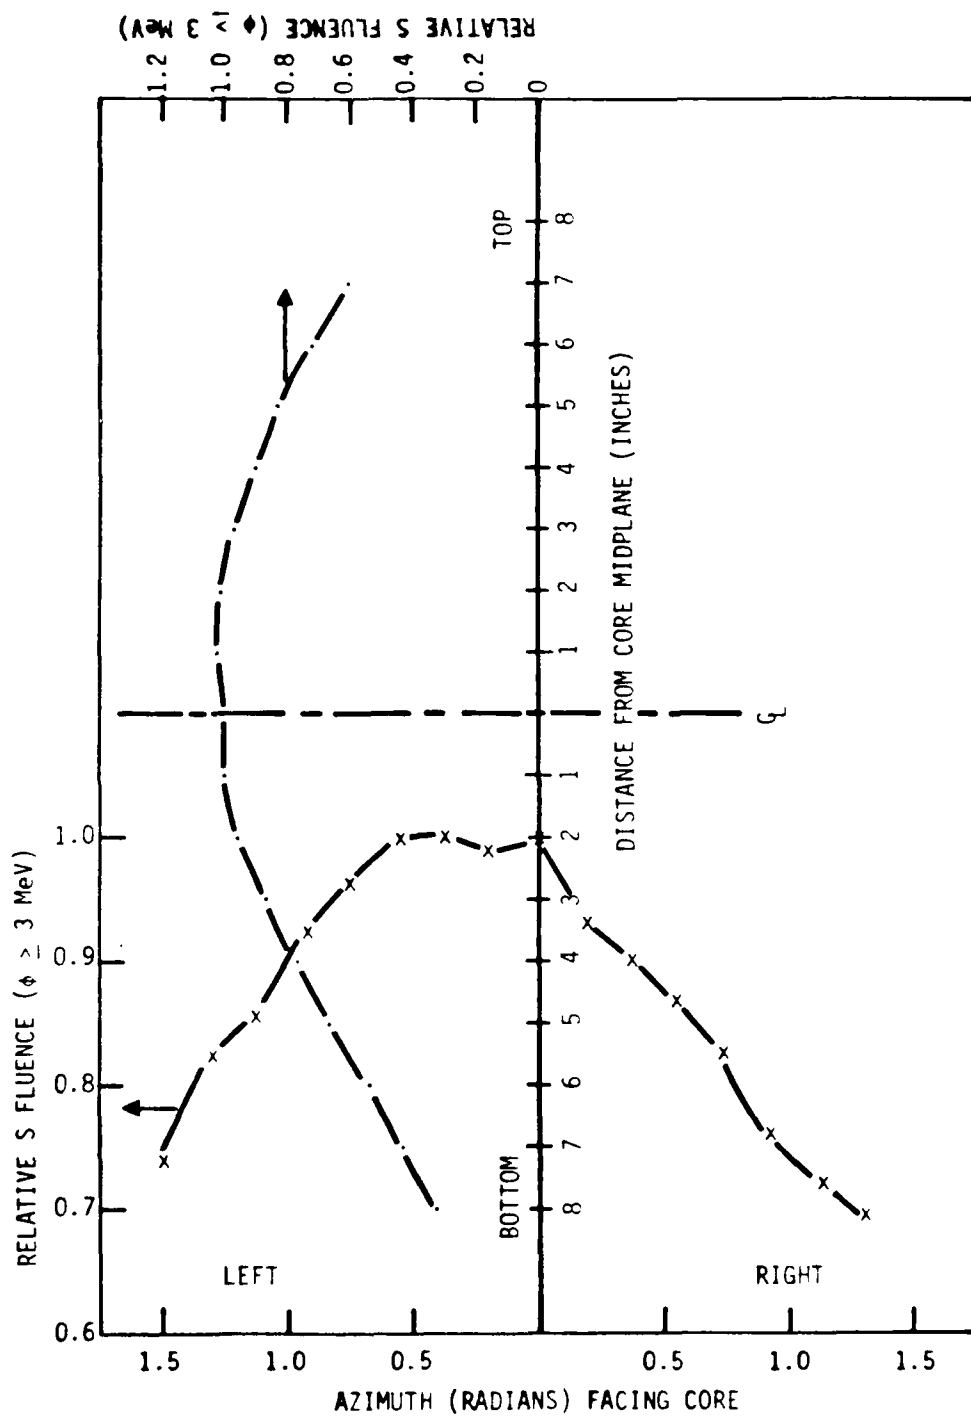


Figure II.4.1. Axial and Azimuthal Dependence of Leakage on the Reactor Tank Surface.

gadolinium paint come from the absorption of thermal neutrons. This fact resulted in the decision not to calculate the gamma-ray spectra in three dimensions. Note that this limitation does not apply to the one-dimensional gamma-ray results.

Finally, several variance reduction techniques were applied including Russian roulette, mild path length stretching to the center of the room, and splitting. These techniques are not approximations but should be mentioned for completeness. They serve to reduce the statistical uncertainty associated with the results. As can be seen from the 1-D results the spectra fall off rapidly at high energy. This rapid falloff induces a scarcity of source neutrons in the high energy region. As a result, the statistical uncertainty of this part of the spectrum can become intolerable. Source energy biasing was tried to the point of overbiasing, but the problem persisted. The resolution became apparent when the good agreement between the 1-D and 3-D results was observed. This agreement, plus the fact that high energy neutrons are less affected by complex geometries than the low energy neutrons due to a smaller scattering cross section, resulted in the idea of splicing the 1-D and 3-D results together. Thus, 1-D results will be shown for energies greater than 4 Mev and 3-D results will be shown for energies less than 4 Mev. The smoothness of the curves (independently normalized) in the 4 Mev region further strengthens the validity of this approach. For completeness, tabulated spectra and responses will be reported for the unspliced 3-D spectra and then plots of the spliced spectra follow.

4.2. Three-Dimension Results

The results of the unspliced MORSE calculations are shown in Tables II.4.1 through II.4.8. These tables show tabulated front, back, and total spectra. Tables II.4.9 through II.4.11 show front, back, and total components of the same nine integral responses calculated for the 1-D runs. These quantities are useful measures of comparing the 1-D and 3-D results. The other major mode of comparison is, of course, the spectral shapes. Due to the dearth of high energy neutrons mentioned earlier, the spliced 1-D/3-D spectra represent the best 3-D spectra and should be used to compare 1-D and 3-D results. These spectra are presented in Figures II.4.2 through II.4.25 and Tables II.4.12 through II.4.19.

Table II.4.1. 3-D Neutron Flux Per Unit Lethargy Per Kilowatt.

ER1 FREE FIELD				
GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
2	1.690E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
3	1.490E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
4	1.420E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
5	1.380E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
6	1.280E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
7	1.220E+07	2.10E+04 1.00	0.00E+00 0.00	2.10E+04 1.00
8	1.110E+07	2.89E+04 0.93	0.00E+00 0.00	2.89E+04 0.93
9	1.000E+07	5.65E+06 0.59	0.00E+00 0.00	5.65E+06 0.59
10	9.050E+06	3.01E+06 0.64	0.00E+00 0.00	3.01E+06 0.64
11	8.190E+06	1.50E+07 0.33	0.00E+00 0.00	1.50E+07 0.33
12	7.410E+06	1.37E+07 0.28	0.00E+00 0.00	1.37E+07 0.28
13	6.380E+06	1.99E+07 0.16	0.00E+00 0.00	1.99E+07 0.16
14	4.970E+06	5.15E+07 0.24	0.00E+00 0.00	5.15E+07 0.24
15	4.720E+06	3.56E+07 0.20	1.49E+04 1.00	3.56E+07 0.20
16	4.070E+06	4.78E+07 0.11	6.52E+04 0.69	4.79E+07 0.11
17	3.010E+06	5.37E+07 0.10	3.39E+05 0.29	5.41E+07 0.10
18	2.390E+06	8.80E+07 0.29	4.43E+05 0.30	8.84E+07 0.29
19	2.310E+06	8.36E+07 0.10	4.97E+05 0.34	8.41E+07 0.10

Table II.4.1. 3-D Neutron Flux Per Unit Lethargy Per Kilowatt (continued).

ERI FREE FIELD

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
20	1.830E+06	3.47E+07 0.07	2.68E+05 0.12	3.49E+07 0.07
21	1.110E+06	2.45E+07 0.07	3.64E+05 0.11	2.49E+07 0.07
22	5.500E+05	1.12E+07 0.06	2.89E+05 0.10	1.15E+07 0.06
23	1.580E+05	8.97E+06 0.13	2.11E+05 0.15	9.18E+06 0.13
24	1.110E+05	5.68E+06 0.11	2.18E+05 0.17	5.90E+06 0.10
25	5.250E+04	4.40E+06 0.13	1.03E+05 0.15	4.55E+06 0.12
26	2.480E+04	5.57E+06 0.28	1.03E+05 0.49	5.68E+06 0.28
27	2.190E+04	5.01E+06 0.13	1.62E+05 0.17	5.17E+06 0.13
28	1.030E+04	4.55E+06 0.11	1.58E+05 0.12	4.70E+06 0.11
29	3.350E+03	3.82E+06 0.13	1.89E+05 0.25	4.01E+06 0.15
30	1.230E+03	3.93E+06 0.15	1.77E+05 0.20	4.11E+06 0.14
31	5.830E+02	4.16E+06 0.10	1.67E+05 0.10	4.33E+06 0.09
32	1.010E+02	3.18E+06 0.15	1.80E+05 0.12	3.36E+06 0.14
33	2.900E+01	2.87E+06 0.18	1.99E+05 0.16	3.06E+06 0.17
34	1.070E+01	1.39E+06 0.23	1.72E+05 0.12	1.56E+06 0.20
35	3.060E+00	1.11E+06 0.36	1.38E+05 0.13	1.25E+06 0.32
36	1.130E+00	7.36E+05 0.45	1.57E+05 0.16	8.93E+05 0.37
37	4.140E-01	3.78E+04 0.48	9.83E+04 0.33	1.36E+05 0.28

Table II.4.2. 3-D Neutron Flux Per Unit Lethargy Per Kilowatt.

ER1 WITH 6" PB

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
2	1.690E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
3	1.490E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
4	1.420E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
5	1.380E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
6	1.280E+07	9.64E+01 1.00	0.00E+00 0.00	9.64E+01 1.00
7	1.220E+07	3.02E+05 0.61	0.00E+00 0.00	3.02E+05 0.61
8	1.110E+07	1.11E+05 0.87	0.00E+00 0.00	1.11E+05 0.87
9	1.000E+07	3.61E+05 0.65	0.00E+00 0.00	3.61E+05 0.65
10	9.050E+06	1.95E+06 0.63	0.00E+00 0.00	1.95E+06 0.63
11	8.190E+06	9.39E+05 0.64	0.00E+00 0.00	9.39E+05 0.64
12	7.410E+06	4.29E+06 0.44	0.00E+00 0.00	4.29E+06 0.44
13	6.380E+06	3.35E+06 0.27	0.00E+00 0.00	3.35E+06 0.27
14	4.970E+06	4.33E+06 0.47	0.00E+00 0.00	4.33E+06 0.47
15	4.720E+06	7.71E+06 0.36	4.64E+03 1.00	7.72E+06 0.36
16	4.070E+06	6.54E+06 0.12	7.63E+03 0.77	6.55E+06 0.12
17	3.010E+06	1.16E+07 0.13	7.57E+04 0.22	1.17E+07 0.13
18	2.390E+06	2.21E+07 0.36	3.21E+04 0.75	2.21E+07 0.36
19	2.310E+06	1.70E+07 0.09	5.23E+04 0.23	1.70E+07 0.09

Table II.4.2. 3-D Neutron Flux Per Unit Lethargy Per Kilowatt (continued).

ERI WITH 6" PB				
GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
20	1.830E+06	2.33E+07	1.20E+05	2.34E+07
		0.08	0.12	0.08
21	1.110E+06	2.22E+07	2.18E+05	2.24E+07
		0.08	0.09	0.08
22	5.500E+05	9.81E+06	1.72E+05	9.98E+06
		0.09	0.10	0.09
23	1.580E+05	6.53E+06	1.18E+05	6.65E+06
		0.20	0.15	0.19
24	1.110E+05	4.82E+06	2.21E+05	5.04E+06
		0.26	0.50	0.25
25	5.250E+04	2.96E+06	1.07E+05	3.07E+06
		0.27	0.13	0.26
26	2.480E+04	1.54E+06	1.15E+05	1.65E+06
		0.38	0.21	0.36
27	2.190E+04	1.61E+06	6.93E+04	1.68E+06
		0.23	0.12	0.22
28	1.030E+04	2.13E+06	1.12E+05	2.24E+06
		0.22	0.16	0.20
29	8.350E+03	9.68E+05	9.49E+04	1.06E+06
		0.25	0.12	0.23
30	1.230E+03	1.52E+06	1.06E+05	1.63E+06
		0.32	0.20	0.30
31	5.830E+02	1.10E+06	9.59E+04	1.20E+06
		0.28	0.10	0.26
32	1.010E+02	1.51E+06	8.51E+04	1.60E+06
		0.30	0.12	0.28
33	2.900E+01	8.92E+05	8.96E+04	9.82E+05
		0.25	0.12	0.22
34	1.070E+01	7.71E+05	8.49E+04	8.56E+05
		0.38	0.09	0.34
35	3.060E+00	5.55E+05	7.99E+04	6.35E+05
		0.71	0.14	0.62
36	1.130E+00	2.89E+05	7.78E+04	3.67E+05
		0.46	0.12	0.36
37	4.140E-01	8.09E+04	2.15E+04	8.25E+04
		0.35	0.19	0.22

Table II.4.3. 3-D Neutron Flux Per Unit Lethargy Per Kilowatt.

ERI WITH 6" PB AND CAVE				
GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
2	1.690E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
3	1.490E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
4	1.420E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
5	1.380E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
6	1.280E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
7	1.220E+07	1.79E+03 0.93	0.00E+00 0.00	1.79E+03 0.93
8	1.110E+07	2.09E+03 0.67	0.00E+00 0.00	2.09E+03 0.67
9	1.000E+07	2.85E+03 0.82	0.00E+00 0.00	2.85E+03 0.82
10	9.050E+06	1.85E+06 0.66	0.00E+00 0.00	1.85E+06 0.66
11	8.190E+06	1.33E+06 0.74	0.00E+00 0.00	1.33E+06 0.74
12	7.410E+06	5.74E+06 0.73	2.54E+05 1.00	6.00E+06 0.70
13	6.380E+06	3.03E+06 0.26	2.44E+02 1.00	3.03E+06 0.26
14	4.970E+06	5.27E+06 0.56	5.83E+03 0.66	5.28E+06 0.56
15	4.720E+06	2.49E+06 0.46	2.12E+04 0.56	2.51E+06 0.45
16	4.070E+06	7.28E+06 0.20	5.48E+05 0.41	7.83E+06 0.19
17	3.010E+06	1.18E+07 0.16	1.66E+06 0.48	1.35E+07 0.16
18	2.390E+06	1.02E+07 0.39	2.06E+06 0.93	1.30E+07 0.36
19	2.310E+06	1.95E+07 0.13	1.58E+07 0.75	3.53E+07 0.34

Table II.4.3. 3-D Neutron Flux Per Unit Lethargy Per Kilowatt (continued).

ERI WITH 6" PB AND CAVE				
GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
20	1.830E+06	2.44E+07 0.11	2.68E+06 0.49	2.71E+07 0.11
21	1.110E+06	2.84E+07 0.11	6.82E+06 0.34	3.52E+07 0.11
22	5.500E+05	1.85E+07 0.14	3.40E+06 0.26	2.19E+07 0.13
23	1.580E+05	9.45E+06 0.22	2.61E+06 0.52	1.21E+07 0.21
24	1.110E+05	3.83E+06 0.24	1.38E+06 0.56	5.21E+06 0.23
25	5.250E+04	1.10E+06 0.21	5.82E+05 0.74	1.68E+06 0.29
26	2.480E+04	5.44E+06 0.77	3.18E+05 0.82	6.26E+06 0.68
27	2.190E+04	1.92E+06 0.30	8.65E+05 0.55	2.78E+06 0.27
28	1.030E+04	1.19E+06 0.21	3.98E+05 0.45	1.59E+06 0.19
29	3.350E+03	2.18E+06 0.62	2.22E+06 0.72	4.40E+06 0.48
30	1.230E+03	1.23E+06 0.42	2.50E+05 0.78	1.48E+06 0.37
31	5.830E+02	1.14E+06 0.28	3.77E+06 0.79	4.91E+06 0.61
32	1.010E+02	1.87E+06 0.58	8.48E+06 0.97	1.03E+07 0.80
33	2.900E+01	1.81E+06 0.39	3.19E+05 0.95	2.13E+06 0.36
34	1.070E+01	1.41E+06 0.35	2.75E+05 0.89	1.69E+06 0.33
35	3.060E+00	6.01E+05 0.60	3.77E+05 0.68	9.78E+05 0.45
36	1.130E+00	1.15E+06 0.60	1.71E+06 0.95	2.86E+06 0.62
37	4.140E-01	5.25E+04 0.61	7.90E+03 0.61	6.04E+04 0.71

Table II.4.4. 3-D Neutron Flux Per Unit lethargy Per Kilowatt.

ERI WITH 2" PB AND EXERCISE WHEEL

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.900E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
2	1.690E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
3	1.490E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
4	1.420E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
5	1.380E+07	2.99E+04 0.65	0.00E+00 0.00	2.99E+04 0.65
6	1.280E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
7	1.220E+07	2.23E+05 1.00	0.00E+00 0.00	2.23E+05 1.00
8	1.110E+07	6.27E+05 0.64	0.00E+00 0.00	6.27E+05 0.64
9	1.000E+07	1.07E+06 0.62	0.00E+00 0.00	1.07E+06 0.62
10	9.050E+06	8.60E+06 0.49	0.00E+00 0.00	8.60E+06 0.49
11	8.190E+06	2.89E+06 0.36	2.00E+05 0.96	3.09E+06 0.34
12	7.410E+06	1.10E+07 0.25	6.37E+05 1.00	1.16E+07 0.25
13	6.380E+06	1.18E+07 0.20	1.02E+06 0.98	1.29E+07 0.20
14	4.970E+06	2.73E+07 0.55	0.00E+00 0.00	2.73E+07 0.55
15	4.720E+06	3.57E+07 0.25	1.15E+05 1.00	3.58E+07 0.25
16	4.070E+06	2.62E+07 0.15	1.35E+06 0.60	2.75E+07 0.14
17	3.010E+06	3.27E+07 0.12	7.54E+05 0.60	3.34E+07 0.11
18	2.390E+06	4.53E+07 0.31	2.24E+06 0.66	4.75E+07 0.30
19	2.310E+06	8.41E+07 0.12	2.03E+04 1.00	3.41E+07 0.12

Table II.4.4. 3-D Neutron Flux Per Unit Lethargy Per Kilowatt (continued).

ERI WITH 2" PB AND EXERCISE WHEEL

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
20	1.830E+06	3.05E+07 0.08	3.44E+06 0.23	3.39E+07 0.08
21	1.110E+06	2.62E+07 0.10	3.99E+06 0.36	3.01E+07 0.10
22	5.500E+05	1.32E+07 0.12	3.07E+06 0.26	1.62E+07 0.11
23	1.580E+05	7.82E+06 0.25	3.08E+06 0.48	1.09E+07 0.23
24	1.110E+05	5.08E+06 0.18	2.02E+06 0.33	7.10E+06 0.16
25	5.250E+04	5.01E+06 0.34	9.17E+05 0.35	5.93E+06 0.30
26	2.480E+04	3.66E+06 0.35	1.16E+06 1.00	4.82E+06 0.86
27	2.190E+04	2.53E+06 0.19	1.14E+06 0.30	3.67E+06 0.16
28	1.030E+04	3.70E+06 0.27	1.61E+06 0.42	5.31E+06 0.23
29	3.350E+03	2.31E+06 0.32	1.19E+06 0.36	3.50E+06 0.24
30	1.230E+03	3.48E+06 0.27	2.41E+06 0.48	5.89E+06 0.25
31	5.830E+02	2.84E+06 0.15	1.43E+06 0.38	4.26E+06 0.16
32	1.010E+02	2.31E+06 0.20	1.18E+06 0.31	3.49E+06 0.17
33	2.900E+01	3.23E+06 0.30	9.07E+05 0.30	4.13E+06 0.24
34	1.070E+01	2.39E+06 0.19	1.15E+06 0.39	3.54E+06 0.18
35	3.060E+00	2.00E+06 0.41	8.26E+05 0.29	2.83E+06 0.30
36	1.130E+00	2.43E+06 0.57	9.99E+05 0.57	3.43E+06 0.42
37	4.140E-01	2.49E+06 0.81	2.71E+06 0.34	5.20E+06 0.23

Table II.4.5. 3-D Neutron Flux Per Unit Lethargy Per Kilowatt.

ER2 FREE FIELD				
GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
2	1.690E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
3	1.490E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
4	1.420E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
5	1.380E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
6	1.280E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
7	1.220E+07	1.23E+06 0.86	0.00E+00 0.00	1.23E+06 0.86
8	1.110E+07	2.29E+04 1.00	5.19E+03 1.00	2.81E+04 0.84
9	1.000E+07	8.14E+06 0.70	0.00E+00 0.00	8.14E+06 0.70
10	9.050E+06	8.42E+06 0.55	0.00E+00 0.00	8.42E+06 0.55
11	8.190E+06	1.58E+07 0.56	0.00E+00 0.00	1.58E+07 0.56
12	7.410E+06	1.08E+07 0.32	0.00E+00 0.00	1.08E+07 0.32
13	6.380E+06	2.04E+07 0.20	0.00E+00 0.00	2.04E+07 0.20
14	4.970E+06	3.42E+07 0.33	0.00E+00 0.00	3.42E+07 0.33
15	4.720E+06	3.15E+07 0.26	0.00E+00 0.00	3.15E+07 0.26
16	4.070E+06	4.16E+07 0.12	7.79E+04 0.86	4.17E+07 0.12
17	3.010E+06	4.69E+07 0.15	4.76E+05 0.20	4.73E+07 0.15
18	2.390E+06	4.99E+07 0.42	2.72E+05 0.61	5.02E+07 0.42
19	2.310E+06	4.64E+07 0.12	3.58E+05 0.23	4.67E+07 0.12

Table II.4.5. 3-D Neutron Flux Per Unit Lethargy Per Kilowatt (continued).

K ₂ FREE FIELD				
GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
20	1.830E+06	4.19E+07 0.10	4.80E+05 0.16	4.24E+07 0.09
21	1.110E+06	2.82E+07 0.08	7.26E+05 0.12	2.39E+07 0.08
22	5.500E+05	9.71E+06 0.07	3.65E+05 0.09	1.01E+07 0.07
23	1.580E+05	7.15E+06 0.19	3.65E+05 0.19	7.52E+06 0.18
24	1.110E+05	7.81E+06 0.12	3.82E+05 0.29	8.19E+06 0.12
25	5.250E+04	3.77E+06 0.16	2.61E+05 0.16	4.03E+06 0.15
26	2.480E+04	7.23E+06 0.29	1.97E+05 0.31	7.43E+06 0.28
27	2.190E+04	5.20E+06 0.14	2.31E+05 0.20	5.44E+06 0.14
28	1.030E+04	3.80E+06 0.14	3.90E+05 0.19	4.19E+06 0.13
29	3.350E+03	3.49E+06 0.16	2.98E+05 0.14	3.79E+06 0.15
30	1.230E+03	3.27E+06 0.22	7.42E+05 0.67	4.01E+06 0.22
31	5.830E+02	4.13E+06 0.10	2.21E+05 0.10	4.35E+06 0.10
32	1.010E+02	3.44E+06 0.12	2.47E+05 0.11	3.69E+06 0.11
33	2.900E+01	3.64E+06 0.17	2.76E+05 0.17	3.92E+06 0.16
34	1.070E+01	4.22E+06 0.13	3.64E+05 0.16	4.59E+06 0.12
35	3.060E+00	4.29E+06 0.15	3.34E+05 0.15	4.62E+06 0.14
36	1.130E+00	4.26E+06 0.12	2.83E+05 0.12	4.54E+06 0.11
37	4.140E-01	4.14E+06 0.07	2.01E+05 0.13	4.34E+06 0.07

Table II.4.6. 3-D Neutron Flux Per Unit Lethargy Per Kilowatt.

ERI FREE FIELD WITH 12" WATER

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
2	1.690E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
3	1.490E+07	7.53E+03 1.00	0.00E+00 0.00	7.53E+03 1.00
4	1.420E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
5	1.380E+07	2.18E+02 1.00	0.00E+00 0.00	2.18E+02 1.00
6	1.280E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
7	1.220E+07	1.58E+03 0.64	0.00E+00 0.00	1.58E+03 0.64
8	1.110E+07	8.51E+04 0.51	0.00E+00 0.00	8.51E+04 0.51
9	1.000E+07	2.40E+05 0.42	0.00E+00 0.00	2.40E+05 0.42
10	9.050E+06	1.78E+05 0.40	0.00E+00 0.00	1.78E+05 0.40
11	8.190E+06	1.92E+05 0.34	0.00E+00 0.00	1.92E+05 0.34
12	7.410E+06	3.98E+05 0.19	0.00E+00 0.00	3.98E+05 0.19
13	6.380E+06	4.46E+05 0.13	0.00E+00 0.00	4.46E+05 0.13
14	4.970E+06	1.69E+05 0.36	0.00E+00 0.00	1.69E+05 0.36
15	4.720E+06	3.16E+05 0.18	4.04E+02 0.79	3.16E+05 0.18
16	4.070E+06	2.11E+05 0.11	2.07E+03 0.57	2.14E+05 0.11
17	3.010E+06	3.09E+05 0.10	2.23E+03 0.14	3.12E+05 0.10
18	2.390E+06	4.80E+05 0.25	2.34E+03 0.30	4.82E+05 0.24
19	2.310E+06	2.19E+05 0.11	1.62E+03 0.14	2.20E+05 0.11

Table II.4.6. 3-D Neutron Flux Per Unit Lethargy Per Kilowatt (continued).

ER1 FREE FIELD WITH 12" WATER

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
20	1.830E+06	1.18E+05 0.07	1.50E+03 0.09	1.19E+05 0.07
21	1.110E+06	6.83E+04 0.08	1.49E+03 0.08	6.48E+04 0.08
22	5.500E+05	2.52E+04 0.07	9.69E+02 0.08	2.61E+04 0.07
23	1.580E+05	2.50E+04 0.24	7.86E+02 0.16	2.58E+04 0.23
24	1.110E+05	1.45E+04 0.13	5.63E+02 0.13	1.51E+04 0.12
25	5.250E+04	9.62E+03 0.15	5.79E+02 0.18	1.02E+04 0.14
26	2.480E+04	2.27E+04 0.29	1.23E+03 0.32	2.39E+04 0.28
27	2.190E+04	1.08E+04 0.15	3.16E+02 0.14	1.11E+04 0.14
28	1.030E+04	8.19E+03 0.16	6.23E+02 0.17	8.81E+03 0.15
29	3.350E+03	9.84E+03 0.14	5.64E+02 0.15	1.04E+04 0.13
30	1.230E+03	7.02E+03 0.22	6.07E+02 0.15	7.63E+03 0.20
31	5.830E+02	5.85E+03 0.13	4.24E+02 0.15	6.27E+03 0.12
32	1.010E+02	6.71E+03 0.18	9.27E+02 0.28	7.63E+03 0.16
33	2.900E+01	5.39E+03 0.25	5.29E+02 0.15	5.92E+03 0.23
34	1.070E+01	5.42E+03 0.36	5.17E+02 0.16	5.93E+03 0.33
35	3.060E+00	3.06E+03 0.40	4.35E+02 0.14	3.50E+03 0.35
36	1.180E+00	1.46E+03 0.68	4.78E+02 0.15	1.94E+03 0.52
37	4.140E-01	3.99E+01 0.29	1.24E+02 0.26	1.64E+02 0.21

Table II.4.7. 3-D Neutron Flux Per Unit Lethargy Per Kilowatt.

ER1 WITH 2" PB

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
2	1.690E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
3	1.490E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
4	1.420E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
5	1.380E+07	1.83E+04 1.00	0.00E+00 0.00	1.83E+04 1.00
6	1.280E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
7	1.220E+07	6.99E+05 0.98	0.00E+00 0.00	6.99E+05 0.98
8	1.110E+07	1.93E+04 0.71	0.00E+00 0.00	1.93E+04 0.71
9	1.000E+07	6.07E+05 0.60	0.00E+00 0.00	6.07E+05 0.60
10	9.050E+06	3.24E+06 0.72	0.00E+00 0.00	3.24E+06 0.72
11	8.190E+06	4.08E+06 0.81	0.00E+00 0.00	4.08E+06 0.81
12	7.410E+06	6.69E+06 0.37	0.00E+00 0.00	6.69E+06 0.37
13	6.380E+06	2.00E+07 0.22	3.03E+03 1.00	2.00E+07 0.22
14	4.970E+06	2.27E+07 0.26	0.00E+00 0.00	2.27E+07 0.26
15	4.720E+06	1.57E+07 0.16	2.56E+03 1.00	1.57E+07 0.16
16	4.070E+06	2.43E+07 0.14	3.55E+04 0.67	2.43E+07 0.14
17	3.010E+06	2.44E+07 0.10	1.01E+05 0.18	2.45E+07 0.10
18	2.390E+06	4.38E+07 0.17	8.96E+04 0.43	4.39E+07 0.17
19	2.310E+06	2.94E+07 0.10	1.09E+05 0.22	2.95E+07 0.10

Table II.4.7. 3-D Neutron Flux Per Unit Lethargy Per Kilowatt (continued).

ERI WITH 2" PB				
GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
20	1.830E+06	3.32E+07 0.07	8.70E+04 0.12	3.33E+07 0.07
21	1.110E+06	2.28E+07 0.06	1.97E+05 0.13	2.30E+07 0.06
22	5.500E+05	9.03E+06 0.07	1.06E+05 0.13	9.14E+06 0.07
23	1.580E+05	5.54E+06 0.15	5.57E+04 0.15	5.60E+06 0.15
24	1.110E+05	3.41E+06 0.16	1.21E+05 0.53	3.53E+06 0.16
25	5.250E+04	3.76E+06 0.19	9.78E+04 0.28	3.85E+06 0.19
26	2.480E+04	2.77E+06 0.21	4.44E+05 0.67	3.22E+06 0.20
27	2.190E+04	2.92E+06 0.16	5.14E+04 0.24	2.97E+06 0.16
28	1.030E+04	2.24E+06 0.14	7.53E+04 0.16	2.32E+06 0.14
29	3.350E+03	2.28E+06 0.22	4.12E+04 0.13	2.32E+06 0.21
30	1.230E+03	1.60E+06 0.18	7.51E+04 0.27	1.67E+06 0.17
31	5.830E+02	2.35E+06 0.15	9.62E+04 0.40	2.45E+06 0.15
32	1.010E+02	1.47E+06 0.20	6.23E+04 0.26	1.53E+06 0.19
33	2.900E+01	1.30E+06 0.18	4.56E+04 0.16	1.35E+06 0.18
34	1.070E+01	7.37E+05 0.22	5.94E+04 0.17	7.97E+05 0.20
35	3.060E+00	6.33E+05 0.33	5.93E+04 0.28	6.92E+05 0.30
36	1.130E+00	5.81E+05 0.31	4.22E+04 0.15	5.73E+05 0.29
37	4.140E-01	6.76E+02 0.41	7.26E+02 0.23	1.40E+03 0.23

Table II.4.8. 3-D Neutron Flux Per Unit lethargy Per Kilowatt.

ER1 WITH 6" PB AND PHANTOM

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
2	1.690E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
3	1.490E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
4	1.420E+07	2.41E+10 1.00	0.00E+00 0.00	2.41E+10 1.00
5	1.380E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
6	1.280E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
7	1.220E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
8	1.110E+07	1.88E+09 1.00	0.00E+00 0.00	1.88E+09 1.00
9	1.000E+07	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
10	9.050E+06	0.00E+00 0.00	0.00E+00 0.00	0.00E+00 0.00
11	8.190E+06	9.59E+09 1.00	0.00E+00 0.00	9.59E+09 1.00
12	7.410E+06	4.77E+10 0.31	0.00E+00 0.00	4.77E+10 0.31
13	6.380E+06	5.06E+10 0.27	0.00E+00 0.00	5.06E+10 0.27
14	4.970E+06	5.01E+10 0.52	0.00E+00 0.00	5.01E+10 0.52
15	4.720E+06	6.52E+10 0.28	5.64E+09 1.00	7.08E+10 0.27
16	4.070E+06	1.10E+11 0.16	4.60E+09 0.81	1.15E+11 0.16
17	3.010E+06	1.55E+11 0.18	8.26E+09 0.70	1.63E+11 0.17
18	2.390E+06	2.41E+11 0.29	5.31E+10 0.78	2.95E+11 0.28
19	2.310E+06	2.55E+11 0.14	2.69E+10 0.44	2.82E+11 0.14

Table II.4.8. 3-D Neutron Flux Per Unit Lethargy Per Kilowatt (continued).

ERI WITH 6° PB AND PHANTOM

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
20	1.830E+06	3.22E+11	1.90E+10	3.41E+11
		0.08	0.36	0.08
21	1.110E+06	2.73E+11	4.00E+10	3.13E+11
		0.08	0.21	0.07
22	5.500E+05	1.56E+11	4.22E+10	1.98E+11
		0.08	0.16	0.07
23	1.580E+05	1.19E+11	3.32E+10	1.52E+11
		0.18	0.35	0.16
24	1.110E+05	1.09E+11	3.08E+10	1.40E+11
		0.11	0.23	0.10
25	5.250E+04	7.47E+10	2.70E+10	1.02E+11
		0.14	0.23	0.12
26	2.480E+04	9.14E+10	1.53E+10	1.07E+11
		0.38	0.72	0.34
27	2.190E+04	6.51E+10	3.32E+10	9.82E+10
		0.16	0.24	0.13
28	1.030E+04	5.57E+10	2.83E+10	8.39E+10
		0.15	0.18	0.12
29	3.350E+03	7.85E+10	2.91E+10	1.03E+11
		0.14	0.18	0.11
30	1.230E+03	7.51E+10	2.29E+10	9.81E+10
		0.19	0.23	0.16
31	5.830E+02	5.31E+10	2.89E+10	8.21E+10
		0.12	0.19	0.10
32	1.010E+02	6.30E+10	3.35E+10	9.65E+10
		0.13	0.16	0.10
33	2.900E+01	7.08E+10	3.54E+10	1.06E+11
		0.13	0.17	0.10
34	1.070E+01	6.26E+10	3.05E+10	9.31E+10
		0.10	0.21	0.10
35	3.060E+00	5.72E+10	2.17E+10	7.89E+10
		0.15	0.24	0.13
36	1.130E+00	5.82E+10	3.99E+10	9.80E+10
		0.14	0.17	0.11
37	4.140E-01	2.73E+11	2.54E+11	5.28E+11
		0.11	0.10	0.08

Table II.4.9. Front Response Per Kilowatt For MORSE (3-D) Results.

RESPONSE	CASE 1	CASE 2	CASE 3	CASE 4	CASE 5	CASE 6	CASE 7	CASE 8	CASE 9	CASE 10
SULFUR ACTIVATION ACTS/CC-S/ATON/BN-CM/KW	9.56E+06 (.07)	1.81E+06 (.11)	1.67E+06 (.15)	6.40E+06 (.09)	8.86E+06 (.08)	1.12E+05 (.06)	5.31E+06 (.08)	N/A	4.13E+05 (.09)	N/A
SILICON DAMAGE 1 MEV EQUIVALENT N/CM2/S/KW	1.35E+08 (.04)	6.44E+07 (.04)	7.94E+07 (.06)	1.07E+08 (.05)	1.33E+08 (.05)	9.64E+05 (.05)	8.99E+07 (.04)	N/A	6.25E+07 (.07)	N/A
NEUTRON DOSE RAD/S/KW	4.29E-01 (.04)	1.77E-01 (.05)	2.10E-01 (.06)	3.52E-01 (.05)	4.46E-01 (.04)	3.01E-03 (.05)	2.86E-01 (.04)	N/A	8.25E-02 (.04)	N/A
GAMMA DOSE RAD/S/KW	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NEUTRON DOSE REM/S/KW	3.73E+00 (.04)	1.66E+00 (.05)	2.00E+00 (.06)	2.98E+00 (.05)	3.65E+00 (.04)	2.42E-02 (.04)	2.58E+00 (.04)	N/A	4.81E-01 (.03)	N/A
TOTAL DOSE RAD/S/KW	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	8.25E-02 (.04)	N/A
TOTAL DOSE REM/S/KW	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	4.81E-01 (.03)	N/A
TOTAL NEUTRON FLUX N/CM2/S/KW	1.52E+08 (.03)	7.29E+07 (.04)	9.15E+07 (.07)	1.55E+08 (.07)	2.01E+08 (.03)	7.32E+05 (.03)	1.01E+08 (.03)	N/A	8.18E-07 (.07)	N/A
NEUTRON FLUX > 1 MEV N/CM2/S/KW	7.86E+07 (.04)	2.73E+07 (.03)	2.86E+07 (.07)	5.67E+07 (.05)	7.66E+07 (.05)	5.66E+05 (.04)	5.14E+07 (.03)	N/A	6.74E+06 (.05)	N/A

Table II.4.10. Back Response Per Kilowatt For MORSE (3-D) Results.

RESPONSE	CASE 1	CASE 2	CASE 3	CASE 4	CASE 5	CASE 6	CASE 7	CASE 8	CASE 9	CASE 10
SULFUR ACTIVATION ACTS/CC-S/ATON BR-CM/KV	1.29E+04 (.40)	1.60E+03 (.37)	2.24E+03 (.46)	2.16E+03 (.51)	1.51E+04 (.37)	1.35E+02 (.55)	5.22E+03 (.35)	N/A	2.00E+04 (.41)	N/A
SILICON DAMAGE 1 MEV EQUIVALENT N/CM2-S/KV	1.10E+06 (.08)	1.34E+06 (.05)	3.30E+07 (.31)	1.22E+07 (.15)	1.84E+06 (.07)	5.13E+03 (.10)	4.33E+03 (.07)	N/A	4.31E+07 (.09)	N/A
NEUTRON DOSE RAD/S/KV	4.62E-03 (.07)	2.05E-03 (.06)	5.91E-02 (.27)	5.39E-02 (.16)	7.71E-03 (.06)	1.86E-05 (.10)	1.59E-03 (.07)	N/A	3.92E-02 (.08)	N/A
CADRIA DOSE RAD/S/KV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NEUTRON DOSE REM/S/KV	3.18E-02 (.03)	1.45E-02 (.06)	4.70E-01 (.20)	3.23E-01 (.16)	4.98E-02 (.07)	1.46E-04 (.10)	1.22E-02 (.07)	N/A	1.10E-01 (.07)	N/A
TOTAL DOSE RAD/S/KV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	3.92E-02 (.08)	N/A
TOTAL DOSE REM/S/KV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	1.10E-01 (.07)	N/A
TOTAL NEUTRON FLUX N/CM2-S/KV	4.21E+06 (.09)	1.97E+06 (.07)	4.09E+07 (.31)	5.55E+07 (.21)	7.71E+06 (.07)	1.30E+04 (.07)	1.31E+06 (.08)	N/A	5.81E+07 (.09)	N/A
NEUTRON FLUX > 1 MEV N/CM2-S/KV	4.01E+03 (.14)	1.20E+03 (.08)	6.68E+06 (.50)	3.33E+06 (.22)	5.55E+03 (.11)	2.37E+03 (.16)	1.33E+03 (.10)	N/A	4.97E+03 (.21)	N/A

Table II.4.11. Total Response Per Kilowatt For MORSE (3-D) Results.

RESPONSE	CASE 1	CASE 2	CASE 3	CASE 4	CASE 5	CASE 6	CASE 7	CASE 8	CASE 9	CASE 10
SULFUR ACTIVATION ACTS/CC-S/ATOM/BN-CM/KW	9.57E+06 (.07)	1.81E+06 (.11)	1.90E+06 (.14)	6.61E+06 (.09)	8.88E+06 (.08)	1.12E+05 (.06)	5.31E+06 (.08)	N/A	4.33E+05 (.09)	N/A
SILICON DAMAGE 1 MEV EQUIVALENT N/CM2/S/KW	1.36E+08 (.04)	6.57E+07 (.04)	1.12E+08 (.10)	1.20E+08 (.05)	1.35E+08 (.05)	9.69E+05 (.05)	9.63E+07 (.04)	N/A	1.06E+08 (.06)	N/A
NEUTRON DOSE RAD/S/KW	4.34E-01 (.04)	1.79E-01 (.05)	2.69E-01 (.08)	4.06E-01 (.03)	4.54E-01 (.04)	3.03E-03 (.05)	2.88E-01 (.04)	N/A	1.22E-01 (.04)	N/A
GAMMA DOSE RAD/S/KW	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NEUTRON DOSE REM/S/KW	3.76E+00 (.04)	1.68E+00 (.05)	2.47E+00 (.07)	3.30E+00 (.05)	3.70E+00 (.04)	2.43E-02 (.04)	2.60E+00 (.04)	N/A	5.91E-01 (.03)	N/A
TOTAL DOSE RAD/S/KW	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	1.22E-01 (.04)	N/A
TOTAL DOSE REM/S/KW	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	5.90E-01 (.03)	N/A
TOTAL NEUTRON FLUX N/CM2/S/KW	1.56E+08 (.03)	7.49E+07 (.04)	1.32E+08 (.11)	2.10E+08 (.08)	2.00E+08 (.03)	7.45E+05 (.03)	1.02E+08 (.03)	N/A	1.40E+08 (.06)	N/A
NEUTRON FLUX > 1 MEV N/CM2/S/KW	7.90E+07 (.04)	2.75E+07 (.05)	3.51E+07 (.11)	6.00E+07 (.05)	7.71E+07 (.05)	5.69E+05 (.04)	5.16E+07 (.05)	N/A	7.23E+06 (.05)	N/A

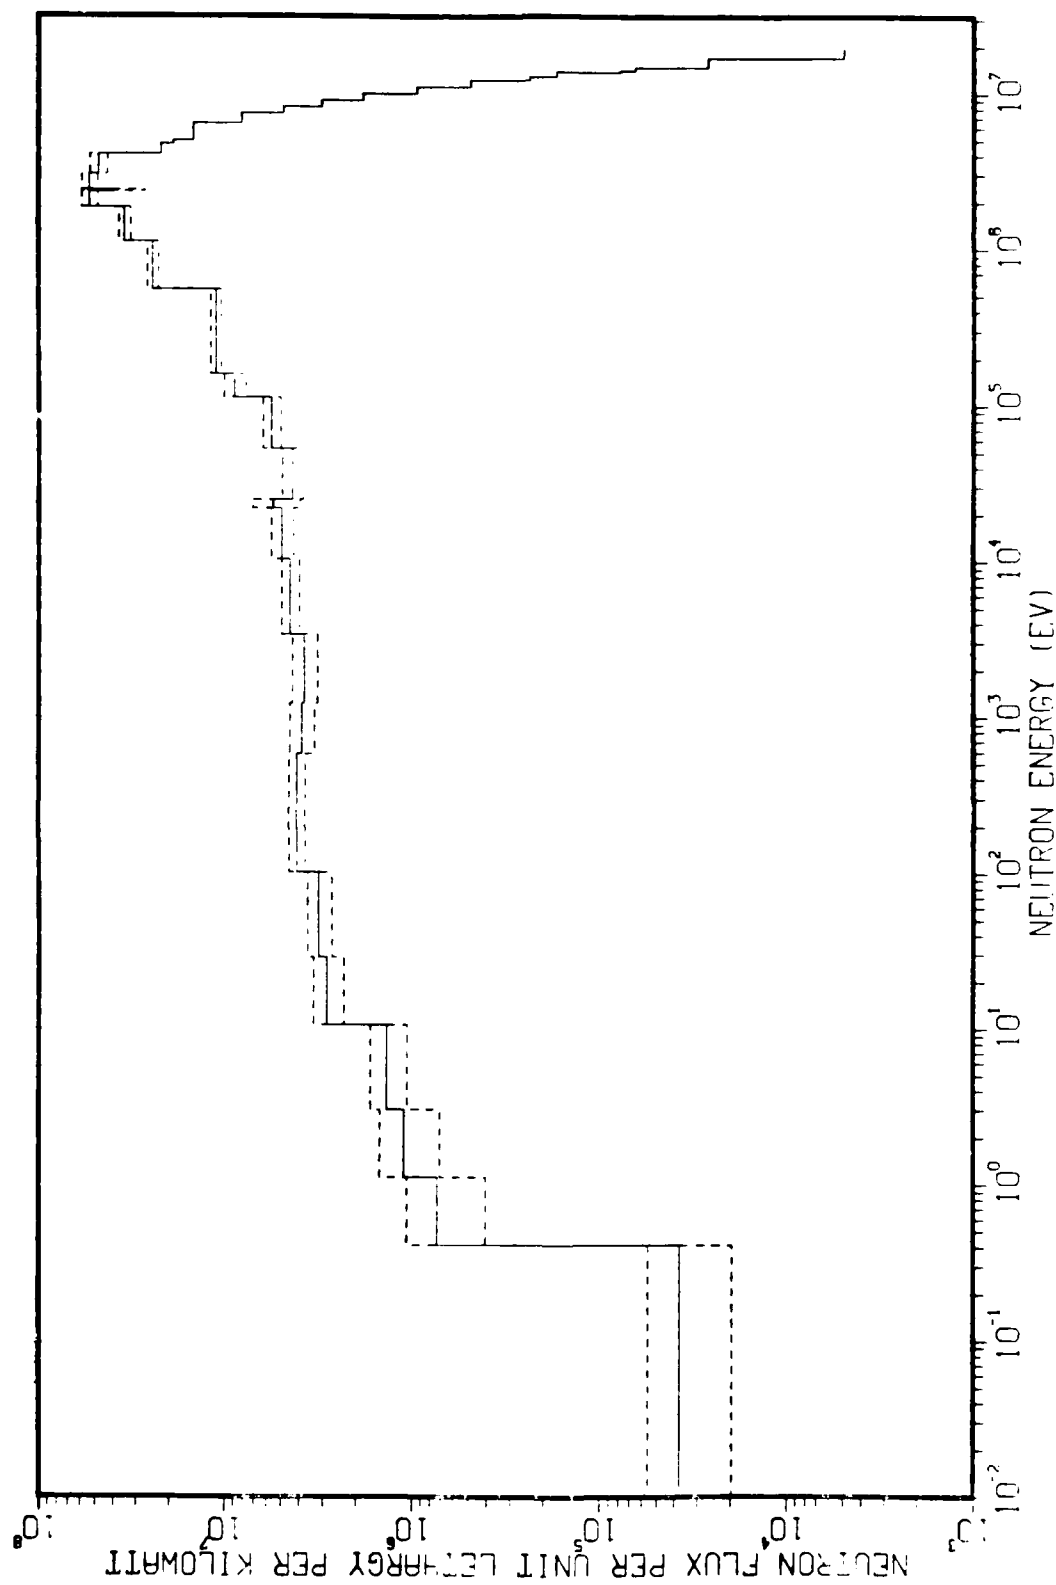


Figure II.4.2. Front Neutron Flux vs Energy ERI Free Field.

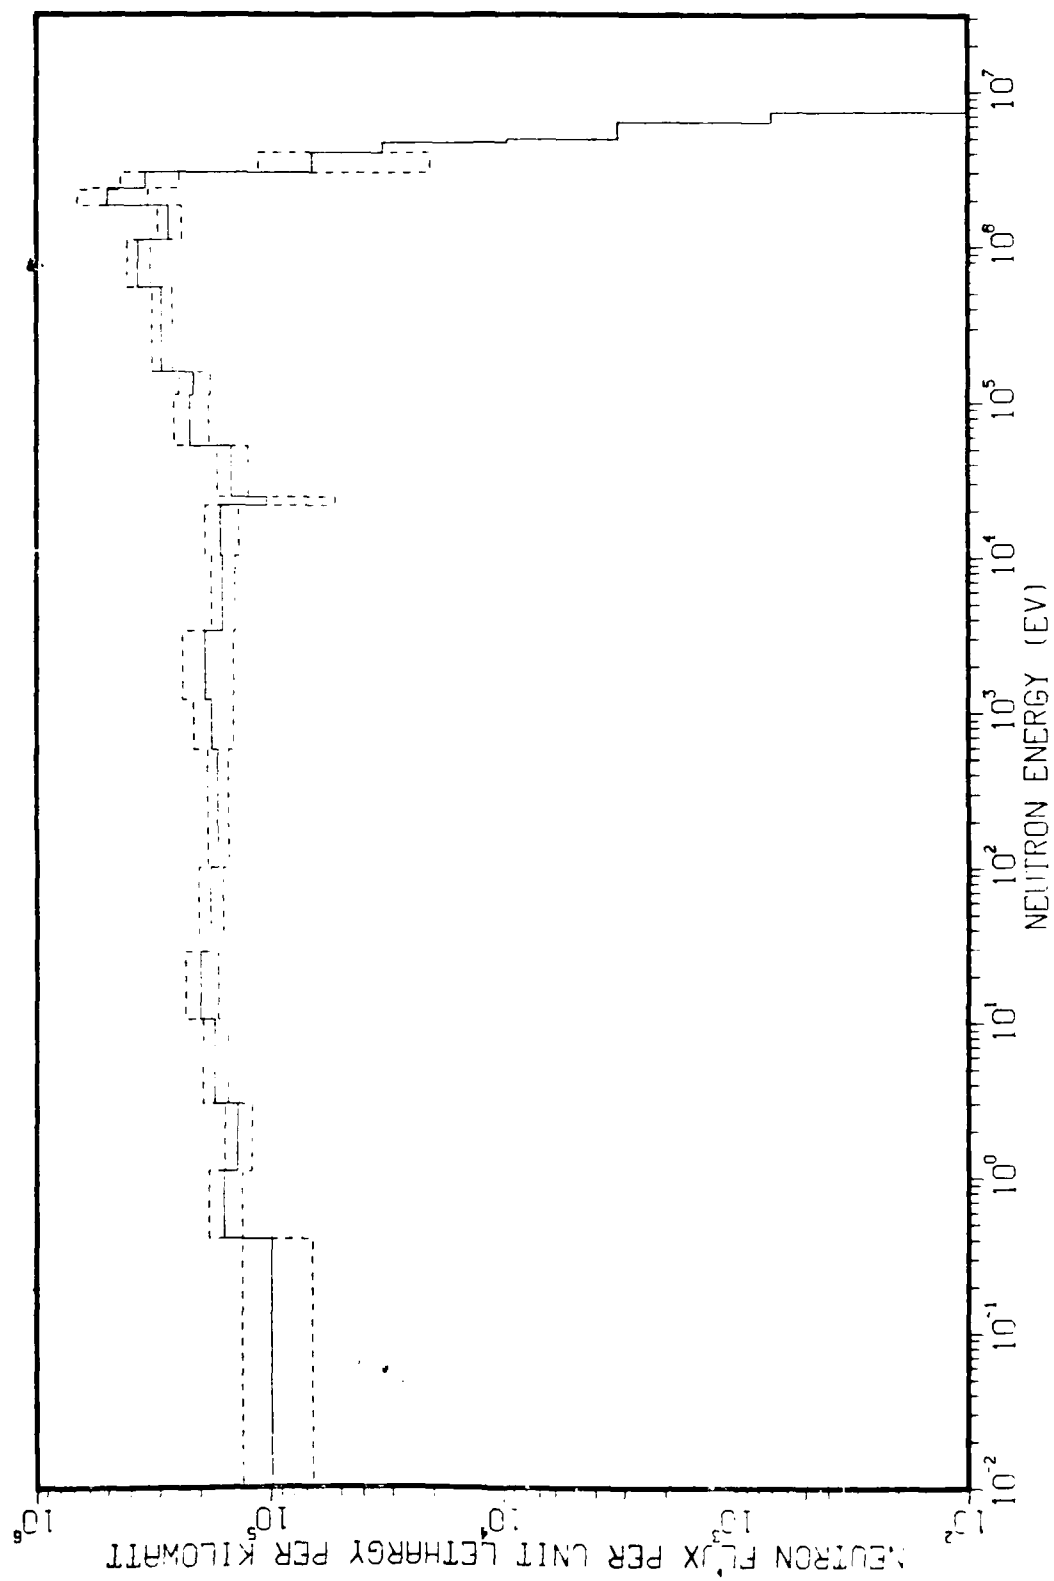


Figure II.4.3. Back Neutron Flux vs Energy ER1 Free Field.

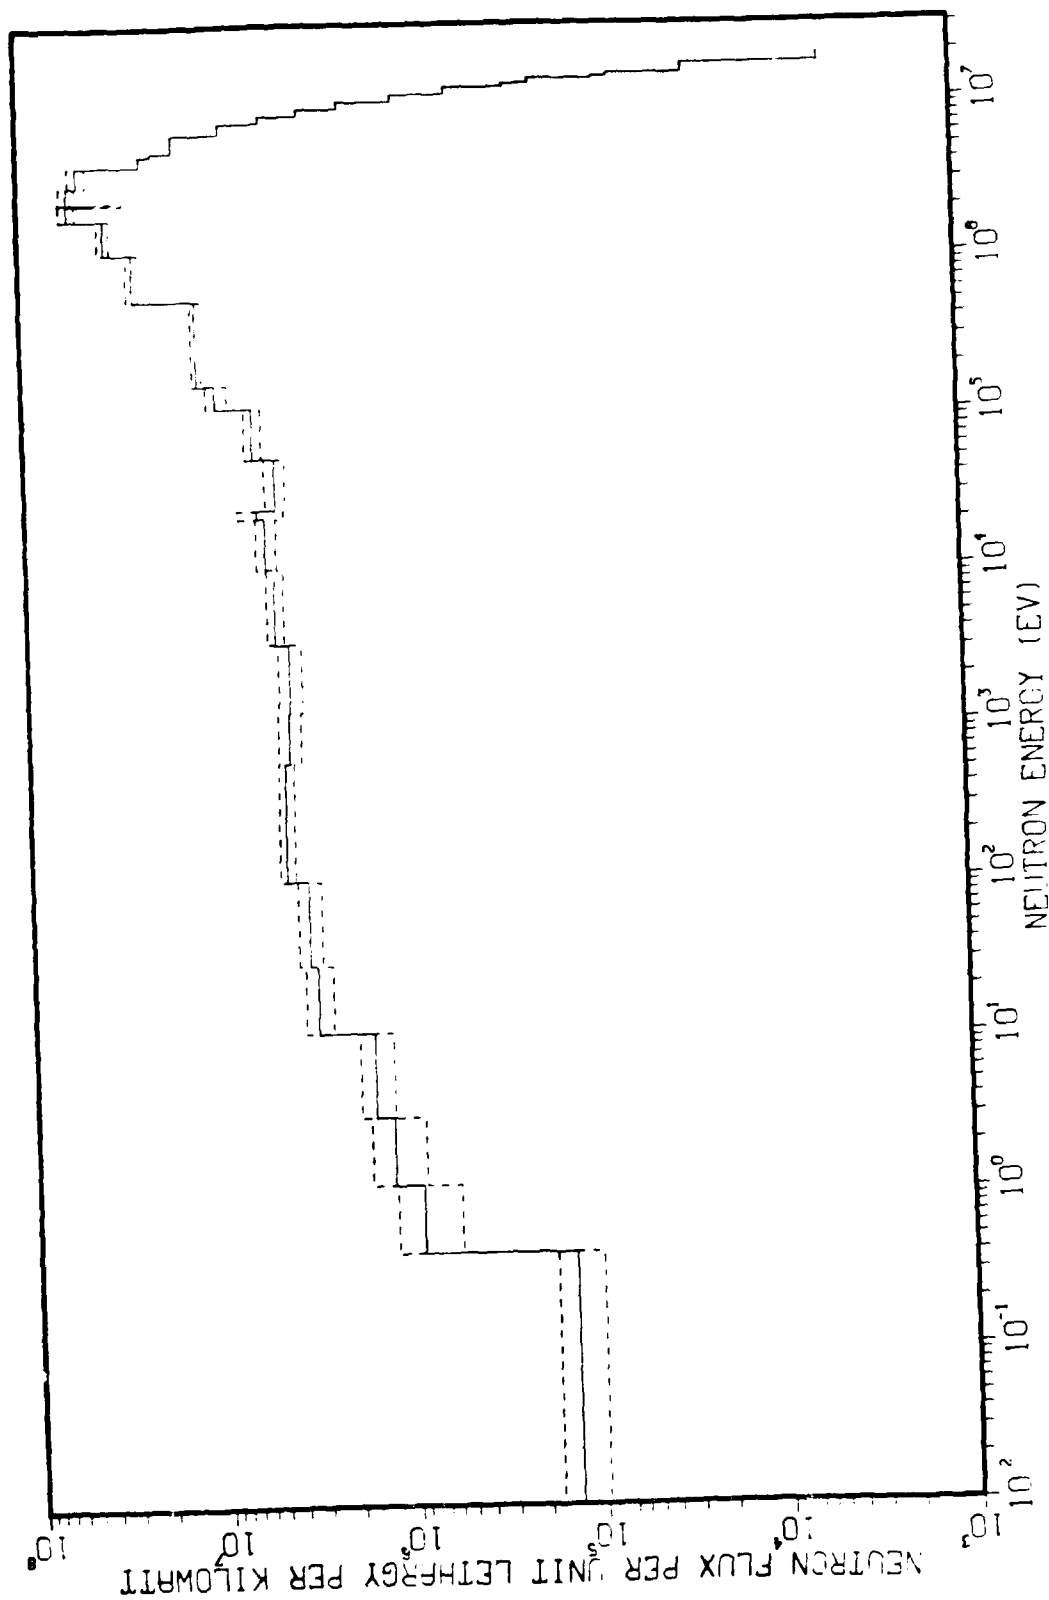


Figure 11.4.4. Total (Front+Back) Neutron Flux vs Energy ERI Free Field.

Table II.4.12. Neutron Flux per Unit Lethargy per Kilowatt.

ERI FREE FIELD

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	4.97E+03	0.00E+00	4.97E+03
2	1.690E+07	2.66E+03	0.00E+00	2.66E+03
3	1.490E+07	6.56E+04	0.00E+00	6.56E+04
4	1.420E+07	7.91E+04	0.00E+00	7.91E+04
5	1.380E+07	1.74E+05	0.00E+00	1.74E+05
6	1.280E+07	2.41E+05	0.00E+00	2.41E+05
7	1.220E+07	4.93E+05	0.00E+00	4.93E+05
8	1.110E+07	9.53E+05	0.00E+00	9.53E+05
9	1.000E+07	1.86E+06	0.00E+00	1.86E+06
10	9.030E+06	3.07E+06	0.00E+00	3.07E+06
11	8.190E+06	4.91E+06	0.00E+00	4.91E+06
12	7.410E+06	8.13E+06	7.06E+02	8.13E+06
13	6.380E+06	1.48E+07	3.20E+03	1.48E+07
14	4.970E+06	1.89E+07	9.47E+03	1.89E+07
15	4.720E+06	2.22E+07	3.22E+04	2.22E+07
16	4.070E+06	4.78E+07	6.52E+04	4.79E+07
		0.11	0.69	0.11
17	3.010E+06	5.37E+07	3.39E+05	5.41E+07
		0.10	0.29	0.10
18	2.390E+06	3.80E+07	4.43E+05	3.84E+07
		0.29	0.30	0.29
19	2.310E+06	5.36E+07	4.97E+05	5.41E+07
		0.10	0.34	0.10
20	1.830E+06	3.47E+07	2.68E+05	3.49E+07
		0.07	0.12	0.07
21	1.110E+06	2.45E+07	3.64E+05	2.47E+07
		0.07	0.11	0.07
22	5.500E+05	1.12E+07	2.89E+05	1.15E+07
		0.06	0.10	0.06
23	1.580E+05	8.97E+06	2.11E+05	9.18E+06
		0.13	0.15	0.13
24	1.110E+05	5.68E+06	2.18E+05	5.90E+06
		0.11	0.17	0.10
25	5.250E+04	4.40E+06	1.45E+05	4.55E+06
		0.13	0.15	0.12
26	2.480E+04	5.57E+06	1.06E+05	5.68E+06
		0.28	0.49	0.28
27	2.190E+04	5.01E+06	1.62E+05	5.17E+06
		0.13	0.17	0.13
28	1.030E+04	4.55E+06	1.58E+05	4.70E+06
		0.11	0.12	0.11
29	3.350E+03	3.82E+06	1.89E+05	4.01E+06
		0.15	0.25	0.13
30	1.230E+03	3.93E+06	1.77E+05	4.11E+06
		0.15	0.20	0.14
31	5.830E+02	4.16E+06	1.67E+05	4.33E+06
		0.10	0.10	0.09
32	1.010E+02	3.18E+06	1.80E+05	3.36E+06
		0.15	0.12	0.14
33	2.900E+01	2.87E+06	1.99E+05	3.06E+06
		0.18	0.16	0.17
34	1.070E+01	1.39E+06	1.72E+05	1.56E+06
		0.23	0.12	0.20
35	3.060E+00	1.11E+06	1.38E+05	1.25E+06
		0.36	0.13	0.32
36	1.130E+00	7.36E+05	1.57E+05	8.93E+05
		0.45	0.16	0.37
37	4.140E-01	3.78E+04	9.83E+04	1.36E+05
		0.48	0.33	0.28

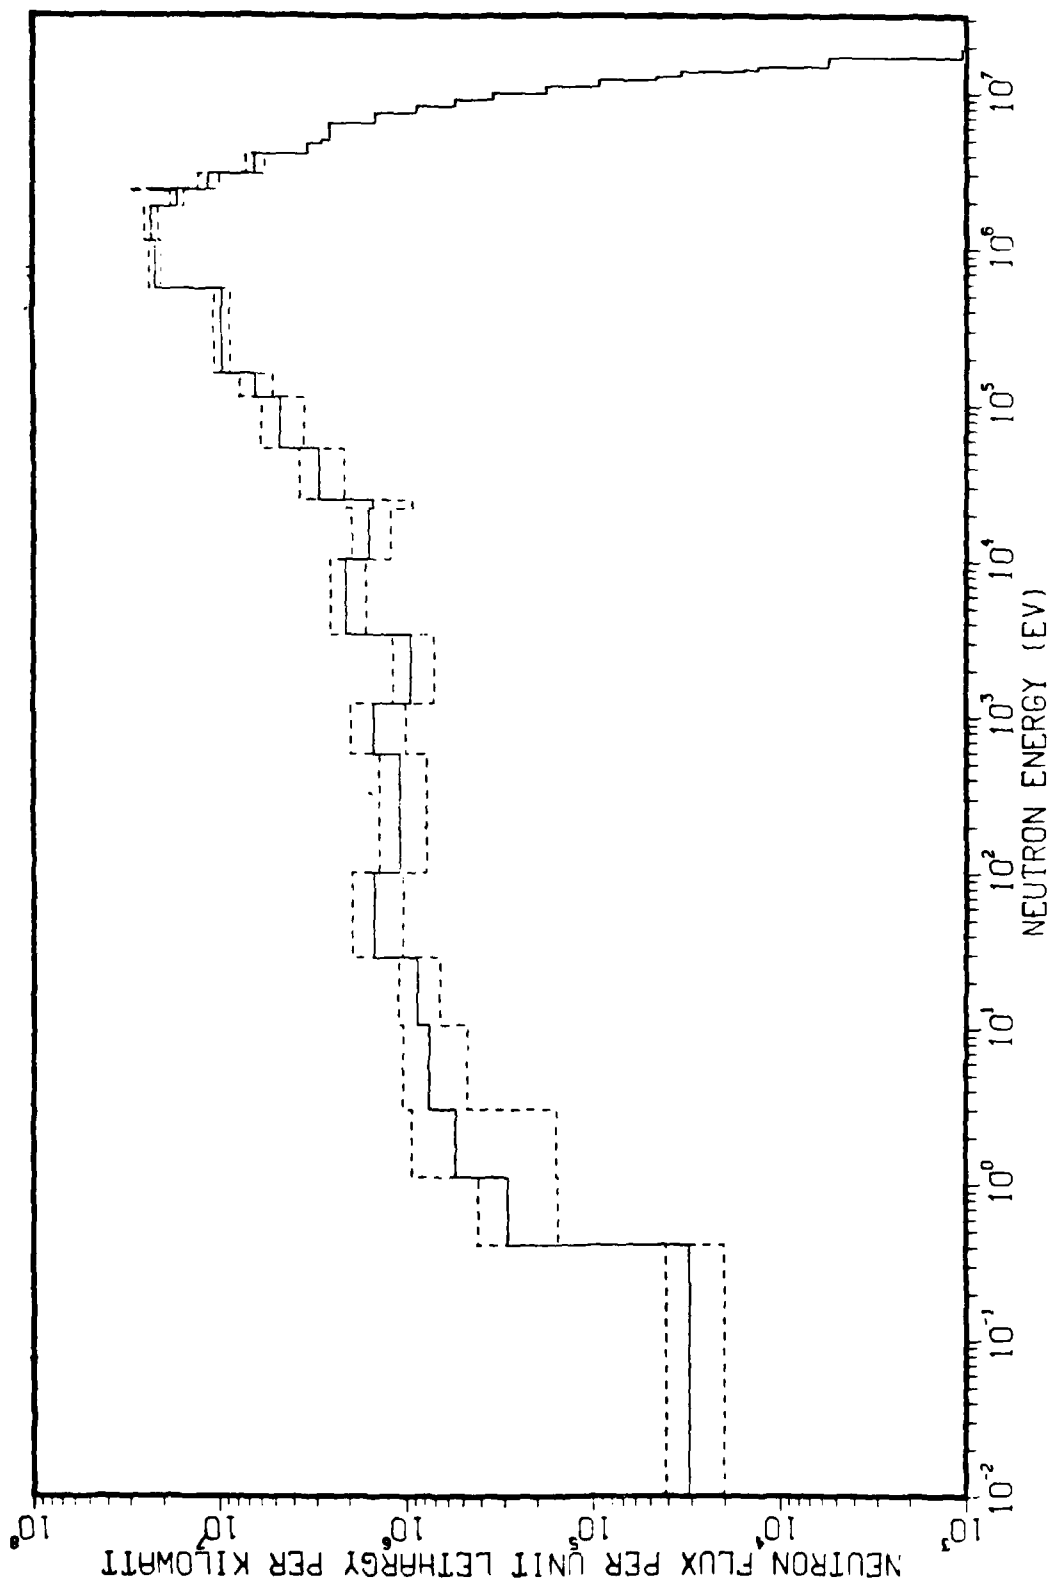


Figure 11.4.5. Front Neutron Flux vs Energy ER1 with 6" Pb.

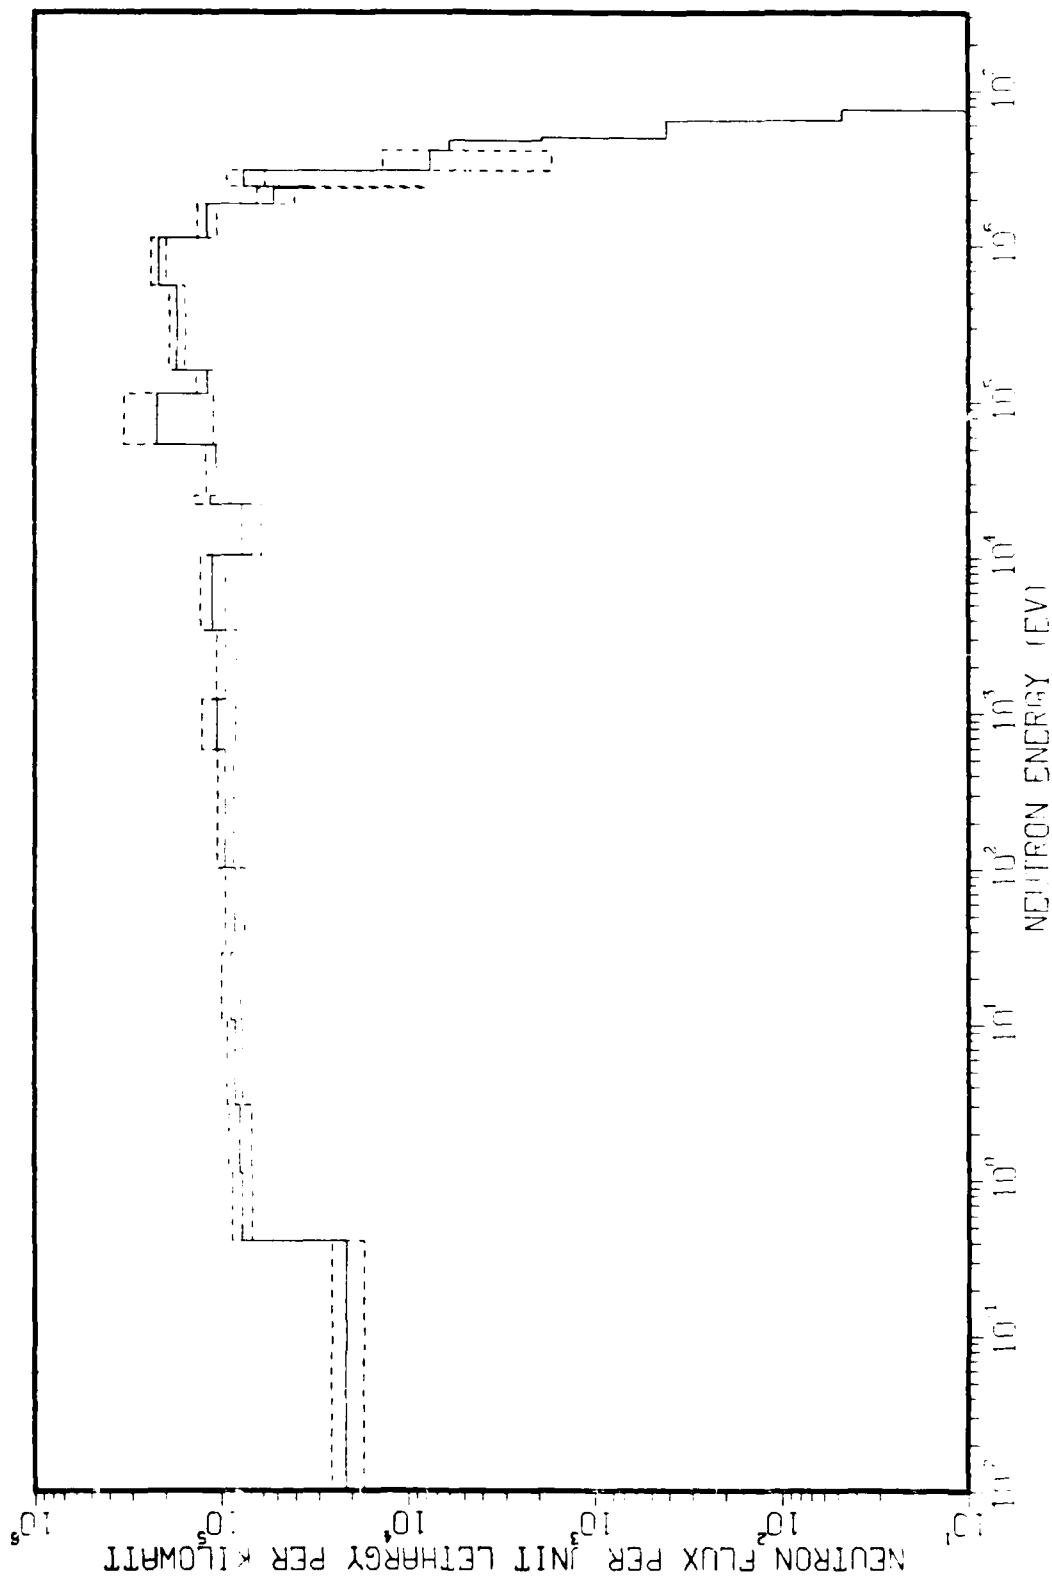


Figure II.4.6. Back Neutron Flux vs Energy ER1 with 6" Pb.

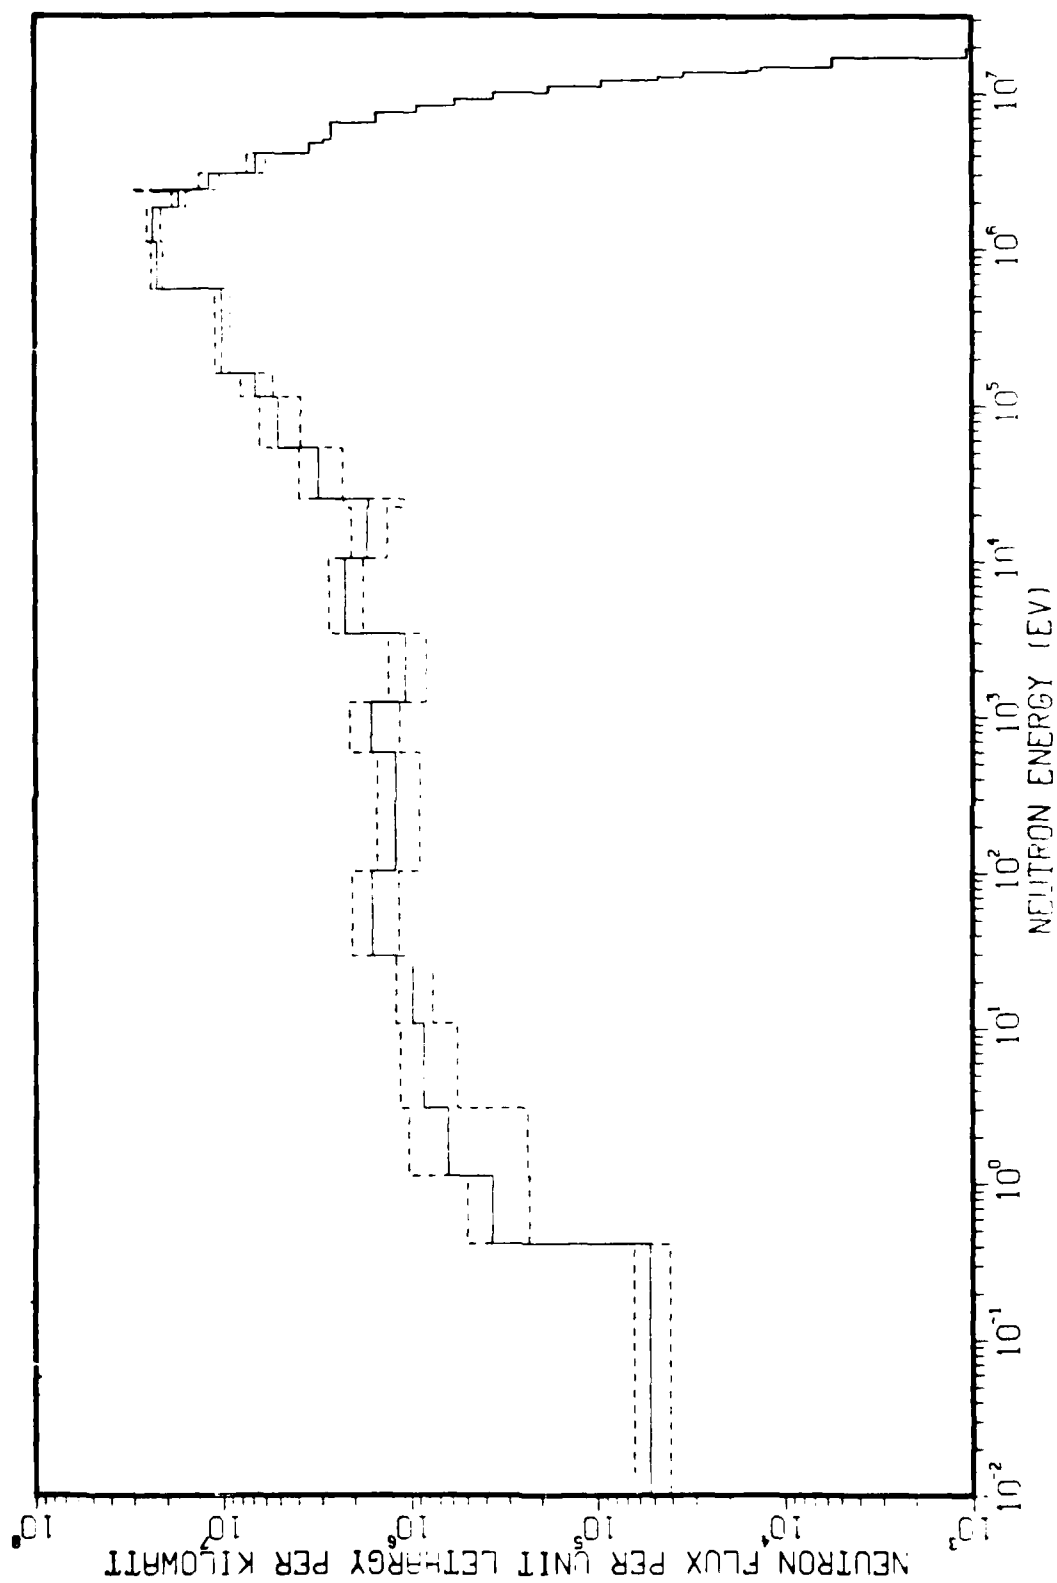


Figure 11.4.7. Total (Front+Back) Neutron Flux vs Energy ERI with 6" Pb.

Table II.4.13. Neutron Flux per Unit Lethargy per Kilowatt.

ERI WITH 6 IN. PB

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	1.06E+03	0.00E+00	1.06E+03
2	1.690E+07	5.49E+03	0.00E+00	5.49E+03
3	1.490E+07	1.31E+04	0.00E+00	1.31E+04
4	1.420E+07	1.54E+04	0.00E+00	1.54E+04
5	1.380E+07	3.38E+04	0.00E+00	3.38E+04
6	1.280E+07	4.59E+04	0.00E+00	4.59E+04
7	1.220E+07	9.26E+04	0.00E+00	9.26E+04
8	1.110E+07	1.79E+05	0.00E+00	1.79E+05
9	1.000E+07	3.48E+05	0.00E+00	3.48E+05
10	9.050E+06	5.63E+05	0.00E+00	5.63E+05
11	8.190E+06	9.04E+05	0.00E+00	9.04E+05
12	7.410E+06	1.49E+06	4.75E+01	1.49E+06
13	6.380E+06	2.59E+06	4.20E+02	2.59E+06
14	4.970E+06	2.86E+06	1.91E+03	2.86E+06
15	4.720E+06	3.38E+06	5.99E+03	3.38E+06
16	4.070E+06	6.54E+06	7.63E+03	6.55E+06
		0.12	0.77	0.12
17	3.010E+06	1.16E+07	7.57E+04	1.17E+07
		0.13	0.22	0.13
18	2.390E+06	2.21E+07	3.21E+04	2.21E+07
		0.36	0.75	0.36
19	2.310E+06	1.70E+07	5.23E+04	1.70E+07
		0.09	0.23	0.09
20	1.830E+06	2.33E+07	1.20E+05	2.34E+07
		0.08	0.12	0.08
21	1.110E+06	2.22E+07	2.18E+05	2.24E+07
		0.03	0.09	0.03
22	5.500E+05	9.81E+06	1.72E+05	9.98E+06
		0.09	0.10	0.09
23	1.580E+05	6.53E+06	1.18E+05	6.65E+06
		0.20	0.15	0.19
24	1.110E+05	4.82E+06	2.21E+05	5.04E+06
		0.26	0.50	0.25
25	5.250E+04	2.96E+06	1.07E+05	3.07E+06
		0.27	0.13	0.26
26	2.480E+04	1.54E+06	1.15E+05	1.65E+06
		0.53	0.21	0.30
27	2.190E+04	1.61E+06	6.93E+04	1.68E+06
		0.23	0.12	0.22
28	1.030E+04	2.13E+06	1.12E+05	2.24E+06
		0.22	0.16	0.20
29	3.350E+03	9.68E+05	9.49E+04	1.06E+06
		0.25	0.12	0.23
30	1.230E+03	1.52E+06	1.06E+05	1.63E+06
		0.32	0.20	0.30
31	5.830E+02	1.10E+06	9.59E+04	1.20E+06
		0.28	0.10	0.26
32	1.010E+02	1.51E+06	8.51E+04	1.60E+06
		0.30	0.12	0.28
33	2.900E+01	8.92E+05	8.96E+04	9.82E+05
		0.25	0.12	0.22
34	1.070E+01	7.71E+05	8.49E+04	8.56E+05
		0.38	0.09	0.34
35	3.060E+00	5.55E+05	7.99E+04	6.35E+05
		0.71	0.14	0.62
36	1.130E+00	2.89E+05	7.70E+04	3.67E+05
		0.46	0.12	0.36
37	4.140E-01	3.09E+04	2.15E+04	5.25E+04
		0.35	0.19	0.22

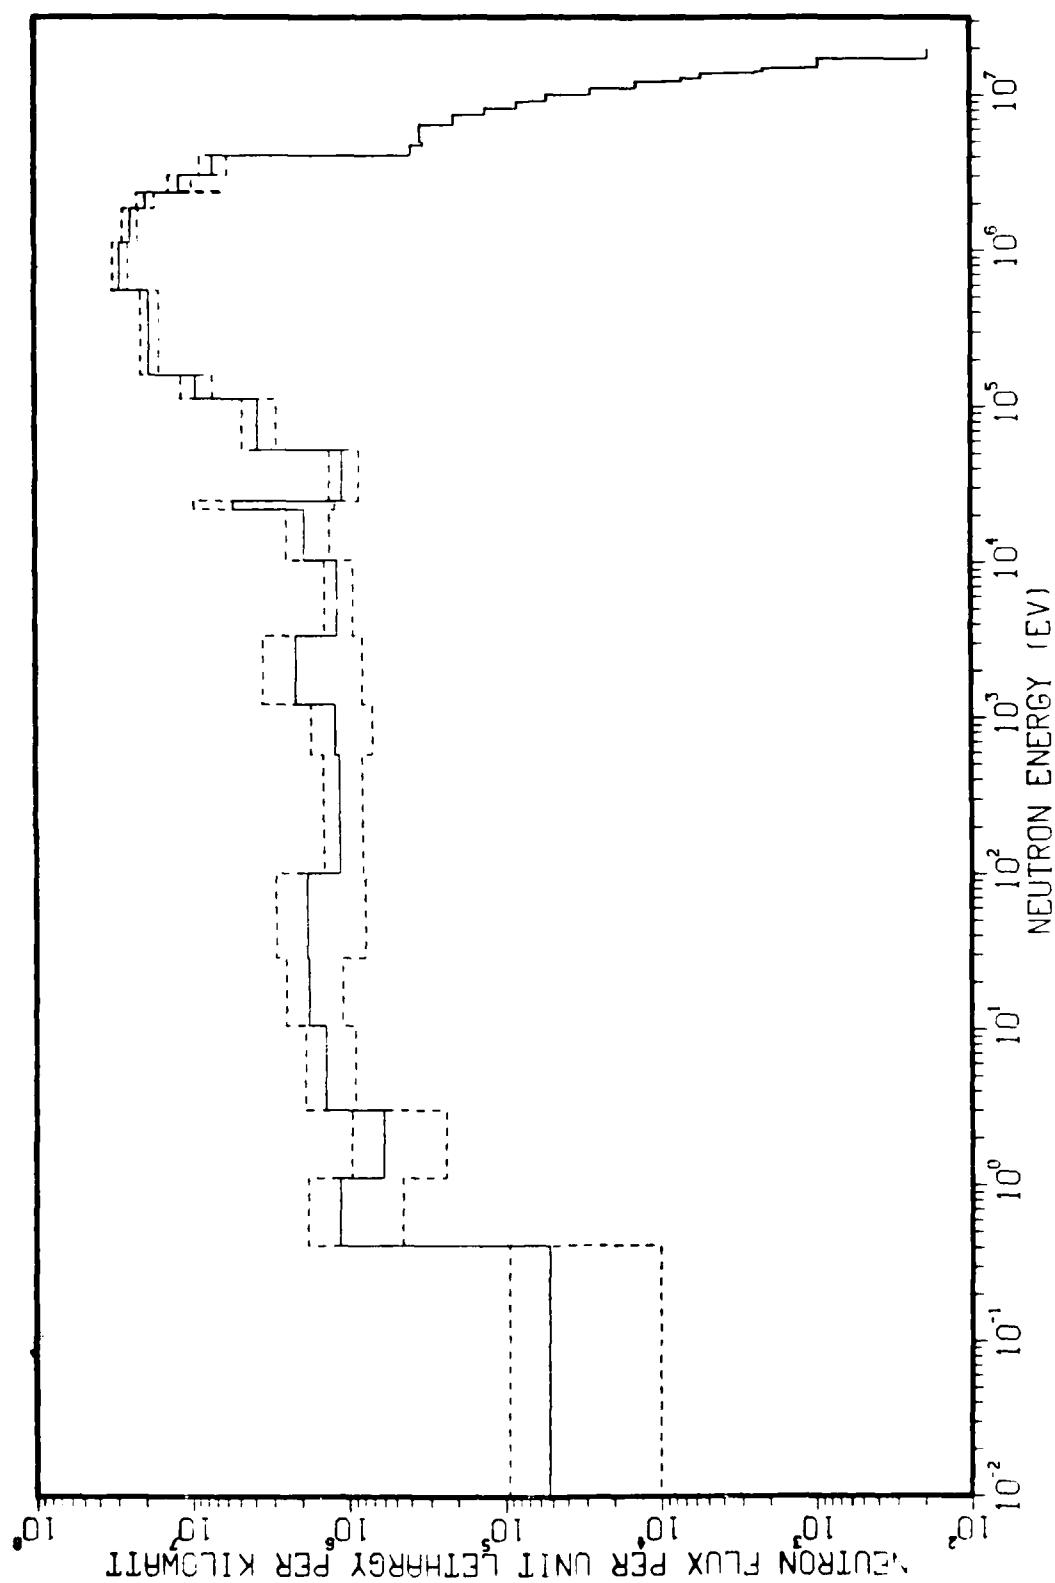


Figure 11.4.8. Front Neutron Flux vs Energy ERI with 6" Pb and 2" Cave.

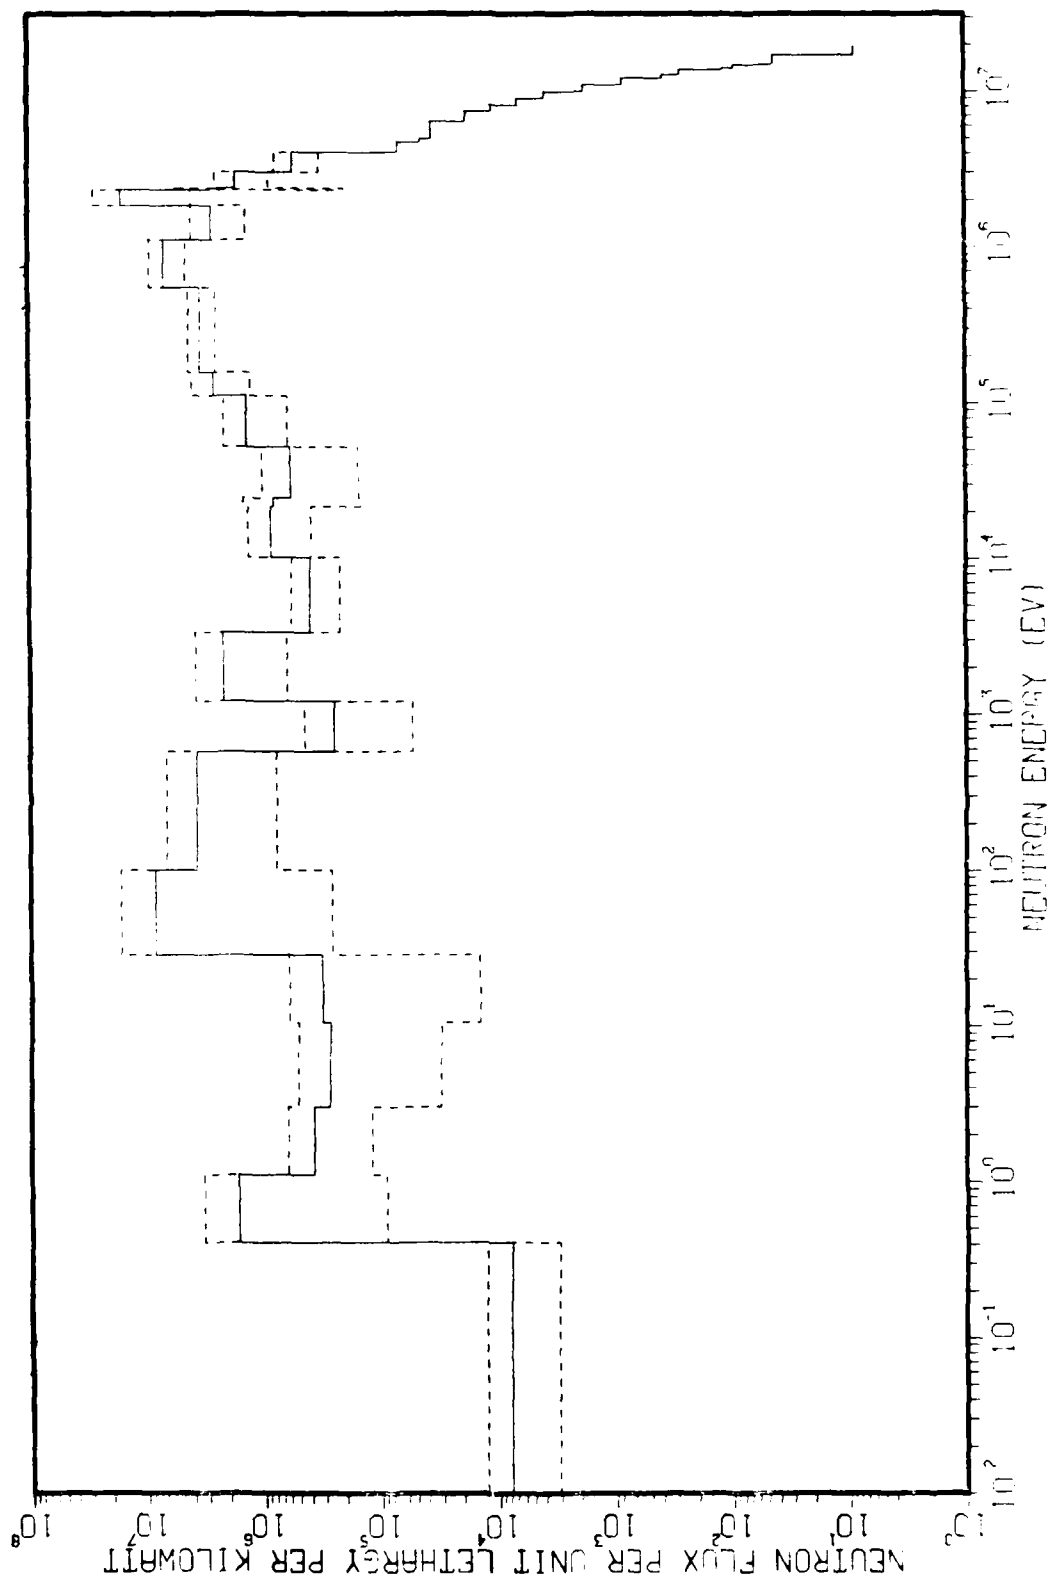


Figure II.4.9. Back Neutron Flux vs Energy ER1 with 6" Pb and 2" Cave.

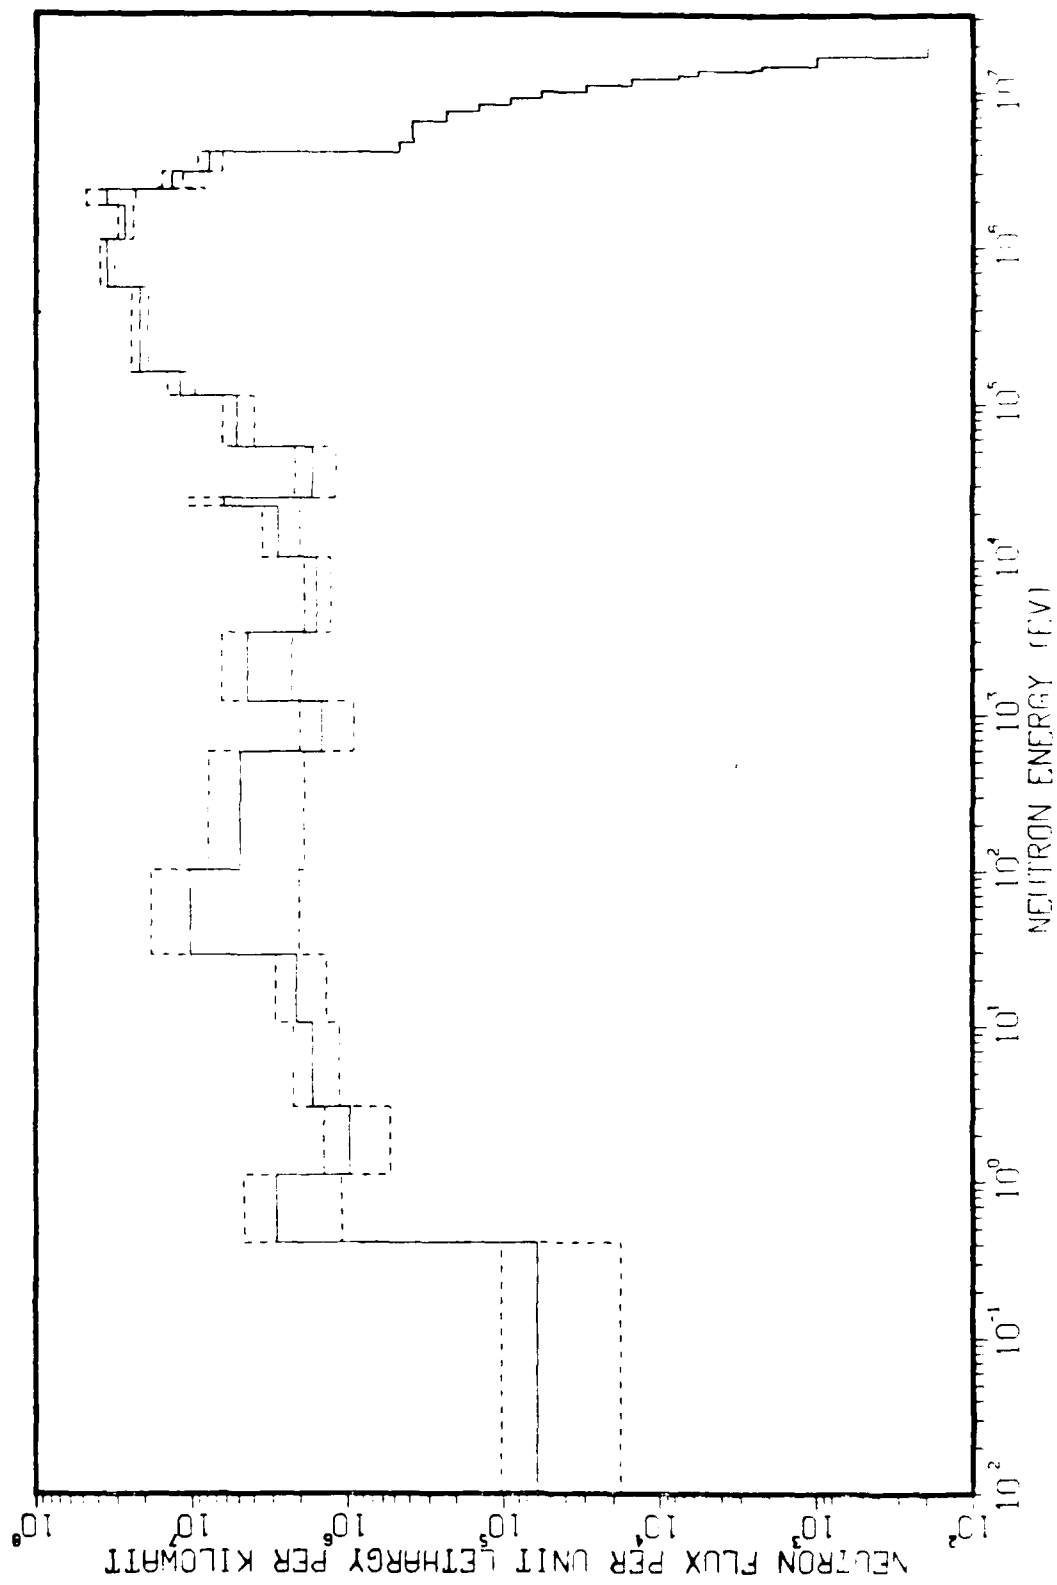


Figure 11.4.10. Total (Front+Back) Neutron Flux vs Energy ER1 with 6" Pb and 2" Cave.

Table II.4.14. Neutron Flux per Unit Lethargy per Kilowatt.

ERI WITH 6 IN. PB AND 2 IN. CAVE

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	1.88E+02	8.82E+00	1.96E+02
2	1.690E+07	9.46E+02	4.31E+01	9.89E+02
3	1.490E+07	2.13E+03	9.50E+01	2.23E+03
4	1.420E+07	2.43E+03	1.19E+02	2.55E+03
5	1.380E+07	5.38E+03	2.74E+02	5.65E+03
6	1.280E+07	7.13E+03	3.87E+02	7.52E+03
7	1.220E+07	1.42E+04	8.50E+02	1.51E+04
8	1.110E+07	2.74E+04	1.82E+03	2.92E+04
9	1.000E+07	5.27E+04	3.91E+03	5.66E+04
10	9.050E+06	8.23E+04	6.64E+03	8.89E+04
11	8.190E+06	1.32E+05	1.11E+04	1.43E+05
12	7.410E+06	2.13E+05	1.83E+04	2.31E+05
13	6.380E+06	3.45E+05	3.60E+04	3.81E+05
14	4.970E+06	3.31E+05	4.42E+04	3.75E+05
15	4.720E+06	3.98E+05	6.96E+04	4.68E+05
16	4.070E+06	7.28E+06	5.48E+05	7.83E+06
		0.20	0.41	0.19
17	3.010E+06	1.18E+07	1.66E+06	1.35E+07
		0.16	0.48	0.16
18	2.390E+06	1.02E+07	2.86E+06	1.30E+07
		0.39	0.93	0.36
19	2.310E+06	1.95E+07	1.58E+07	3.53E+07
		0.13	0.75	0.34
20	1.830E+06	2.44E+07	2.68E+06	2.71E+07
		0.11	0.49	0.11
21	1.110E+06	2.84E+07	6.82E+06	3.52E+07
		0.11	0.34	0.11
22	5.500E+05	1.85E+07	3.40E+06	2.19E+07
		0.14	0.26	0.13
23	1.580E+05	9.45E+06	2.61E+06	1.21E+07
		0.22	0.52	0.21
24	1.110E+05	3.83E+06	1.38E+06	5.21E+06
		0.24	0.56	0.23
25	5.250E+04	1.10E+06	5.82E+05	1.68E+06
		0.21	0.74	0.29
26	2.480E+04	5.44E+06	8.18E+05	6.26E+06
		0.77	0.62	0.68
27	2.190E+04	1.92E+06	8.65E+05	2.78E+06
		0.30	0.55	0.27
28	1.030E+04	1.19E+06	3.98E+05	1.59E+06
		0.21	0.45	0.19
29	3.350E+03	2.18E+06	2.22E+06	4.40E+06
		0.62	0.72	0.40
30	1.230E+03	1.23E+06	2.50E+05	1.48E+06
		0.42	0.78	0.37
31	5.830E+02	1.14E+06	3.77E+06	4.91E+06
		0.28	0.79	0.61
32	1.010E+02	1.87E+06	8.48E+06	1.03E+07
		0.58	0.97	0.80
33	2.900E+01	1.81E+06	3.19E+05	2.13E+06
		0.39	0.95	0.36
34	1.070E+01	1.41E+06	2.75E+05	1.69E+06
		0.35	0.89	0.33
35	3.060E+00	6.01E+05	3.77E+05	9.78E+05
		0.60	0.68	0.45
36	1.130E+00	1.15E+06	1.71E+06	2.86E+06
		0.60	0.95	0.62
37	4.140E-01	5.25E+04	7.90E+03	6.04E+04
		0.81	0.61	0.71

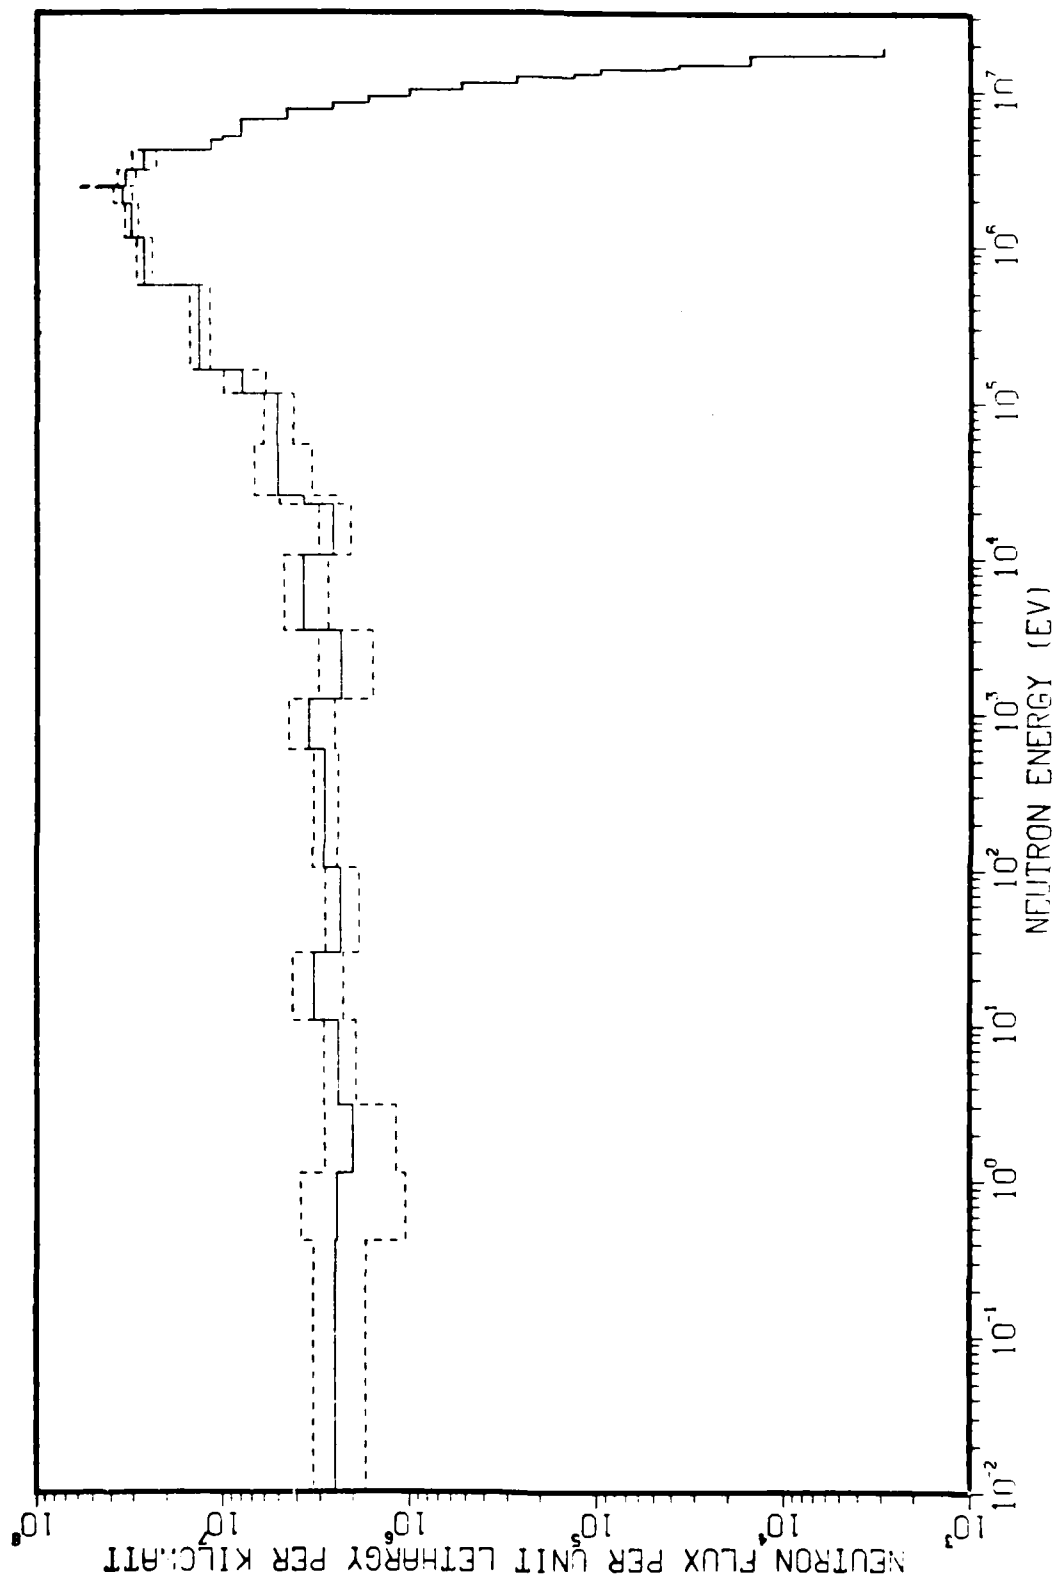


Figure II.4.11. Front Neutron Flux vs Energy ER1 with Exercise Wheel.

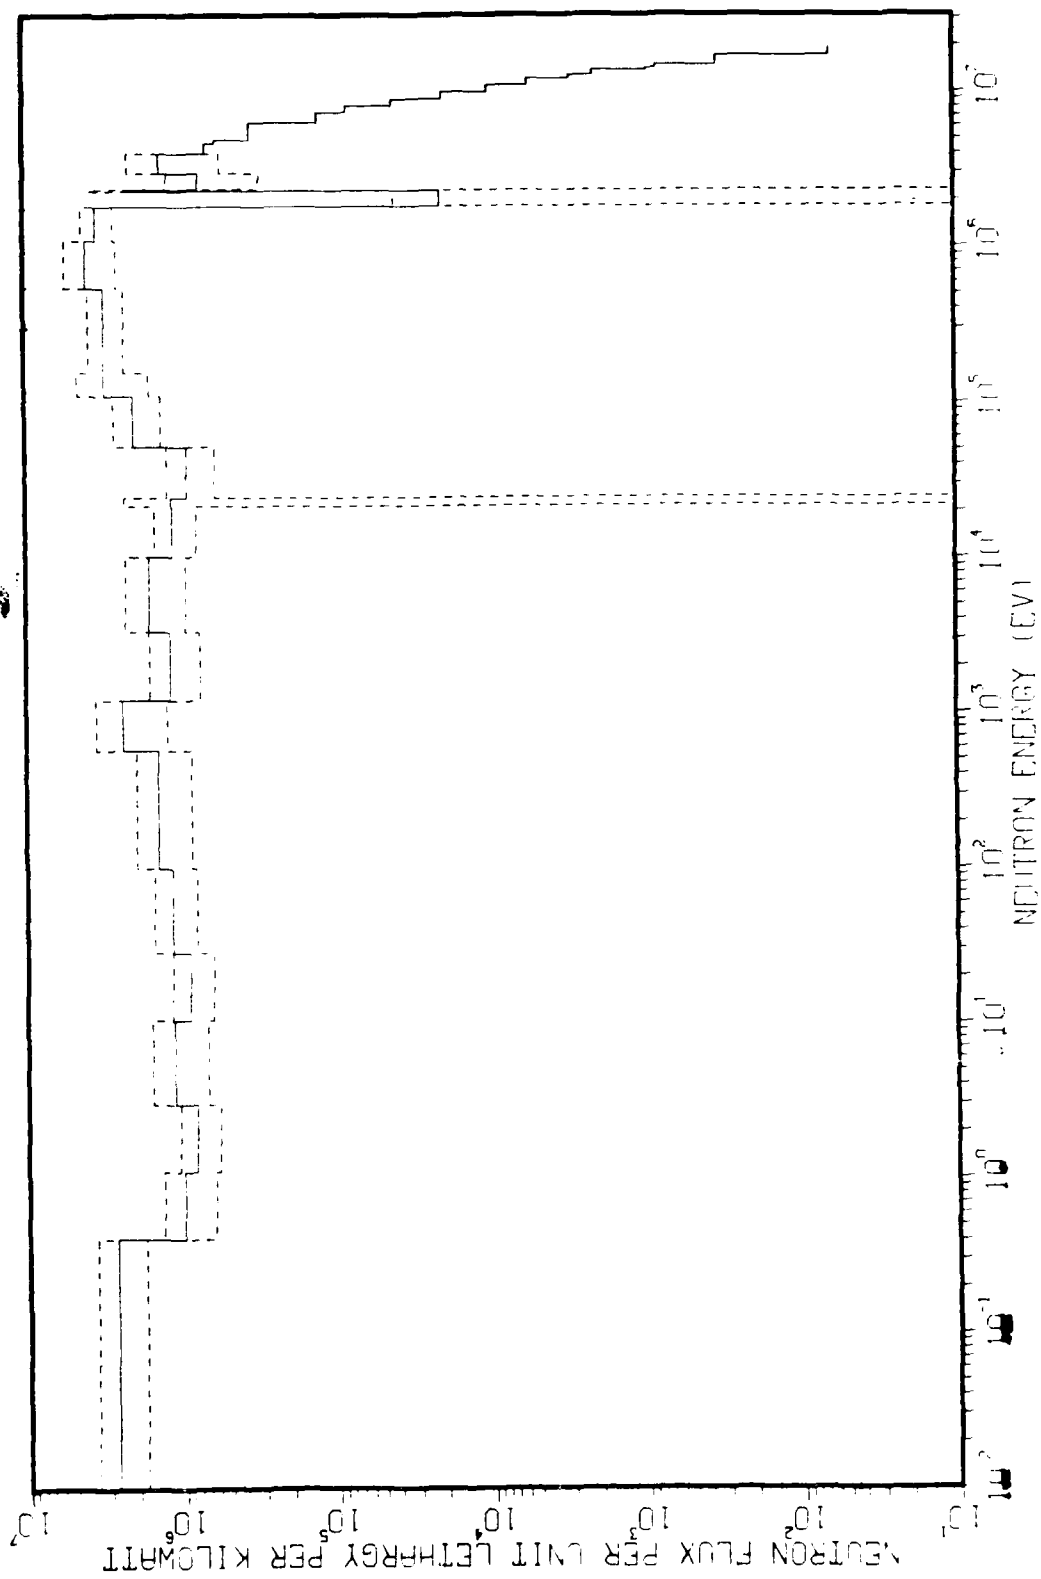


Figure II.4.12. Back Neutron Flux vs Energy ER1 with Exercise Wheel.

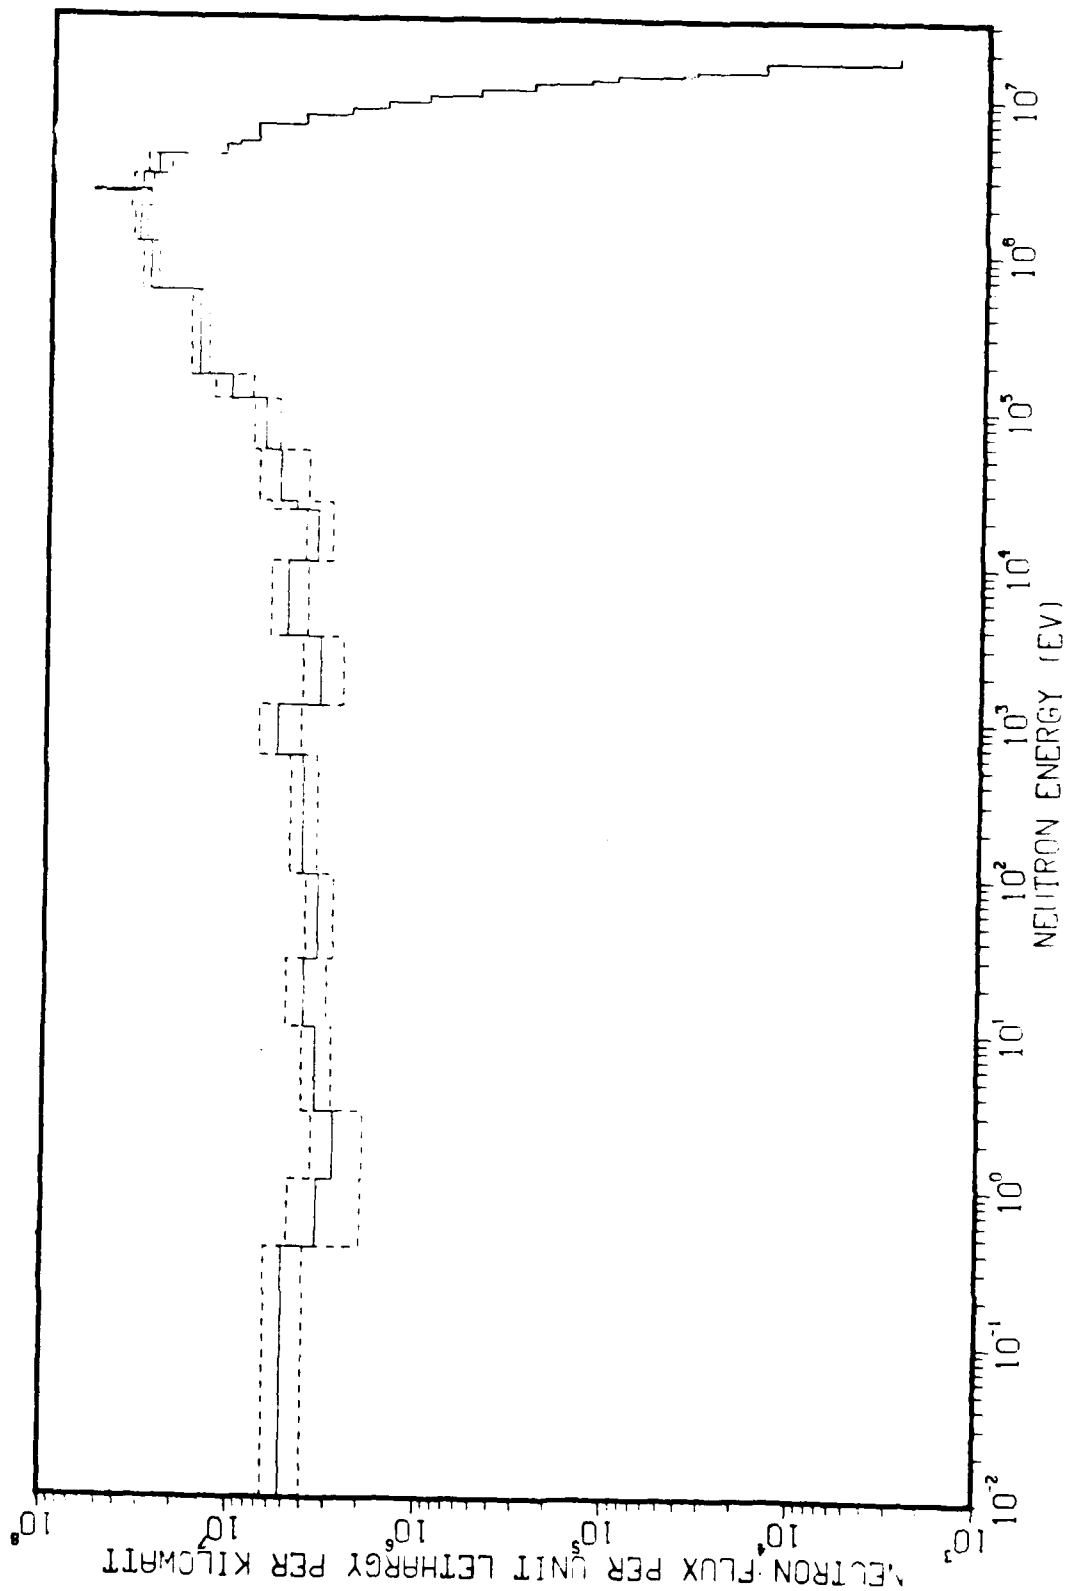


Figure 11.4.13. Total (Front+Back) Neutron Flux vs Energy ERI with Exercise Wheel.

Table II.4.15. Neutron Flux per Unit Lethargy per Kilowatt.

ERI WITH EXERCISE WHEEL

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.900E+07	2.90E+03	6.16E-01	2.96E+03
2	1.690E+07	1.51E+04	3.29E-02	1.54E+04
3	1.490E+07	3.63E+04	8.02E-02	3.71E+04
4	1.420E+07	4.33E+04	9.11E-02	4.42E+04
5	1.380E+07	9.49E+04	2.04E+03	9.69E+04
6	1.280E+07	1.32E+05	2.89E+03	1.35E+05
7	1.220E+07	2.65E+05	5.43E+03	2.70E+05
8	1.110E+07	5.15E+05	9.97E+03	5.25E+05
9	1.000E+07	9.78E+05	1.99E+04	9.98E+05
10	9.050E+06	1.63E+06	4.17E+04	1.67E+06
11	8.190E+06	2.51E+06	8.16E+04	2.59E+06
12	7.410E+06	4.42E+06	1.2E+05	4.55E+06
13	6.380E+06	7.85E+06	3.46E+05	8.20E+06
14	4.970E+06	9.77E+06	5.79E+05	1.04E+07
15	4.720E+06	1.14E+07	6.77E+05	1.21E+07
16	4.070E+06	2.62E+07	1.35E+06	2.75E+07
		0.15	0.60	0.14
17	3.010E+06	3.27E+07	7.54E+05	3.34E+07
		0.12	0.60	0.11
18	2.390E+06	4.53E+07	2.24E+06	4.75E+07
		0.31	0.66	0.30
19	2.310E+06	3.41E+07	2.03E+04	3.41E+07
		0.12	1.00	0.12
20	1.830E+06	3.05E+07	3.44E+06	3.39E+07
		0.08	0.23	0.08
21	1.110E+06	2.62E+07	3.99E+06	3.01E+07
		0.10	0.36	0.10
22	5.500E+05	1.32E+07	3.07E+06	1.62E+07
		0.12	0.26	0.11
23	1.580E+05	7.82E+06	3.03E+06	1.09E+07
		0.25	0.48	0.23
24	1.110E+05	5.08E+06	2.02E+06	7.10E+06
		0.18	0.33	0.16
25	5.250E+04	5.01E+06	9.17E+05	5.93E+06
		0.34	0.35	0.30
26	2.480E+04	3.66E+06	1.16E+06	4.82E+06
		0.35	1.60	0.36
27	2.190E+04	2.53E+06	1.14E+06	3.67E+06
		0.19	0.30	0.16
28	1.030E+04	3.70E+06	1.61E+06	5.31E+06
		0.27	0.42	0.23
29	3.350E+03	2.31E+06	1.19E+06	3.50E+06
		0.32	0.36	0.24
30	1.230E+03	3.48E+06	2.41E+06	5.89E+06
		0.27	0.48	0.25
31	5.830E+02	2.84E+06	1.43E+06	4.26E+06
		0.15	0.33	0.16
32	1.010E+02	2.31E+06	1.18E+06	3.49E+06
		0.20	0.31	0.17
33	2.900E+01	3.23E+06	9.07E-05	4.13E+06
		0.30	0.30	0.24
34	1.070E+01	2.39E+06	1.15E+06	3.54E+06
		0.19	0.3	0.18
35	3.060E+00	2.00E+06	8.2E+05	2.83E+06
		0.41	0.29	0.30
36	1.130E+00	2.43E+06	9.99E+05	3.43E+06
		0.57	0.37	0.42
37	4.140E-01	2.49E+06	2.71E+06	5.20E+06
		0.31	0.34	0.23

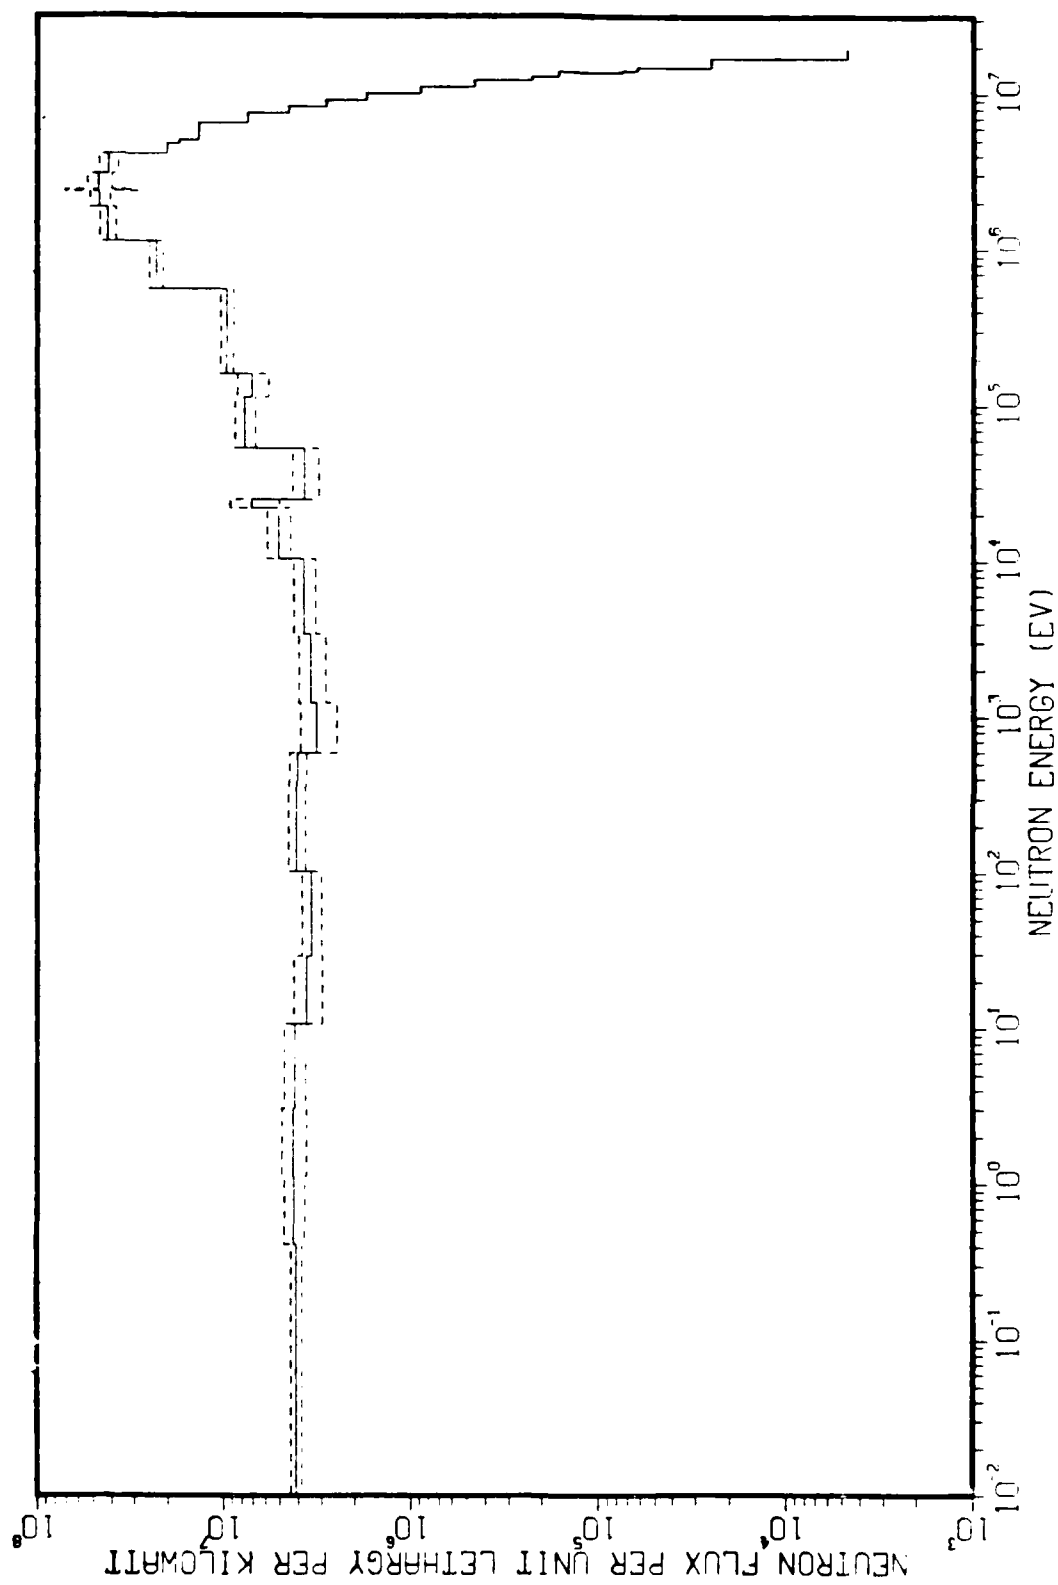


Figure II.4.14. Front Neutron Flux vs Energy ER2 Free Field.

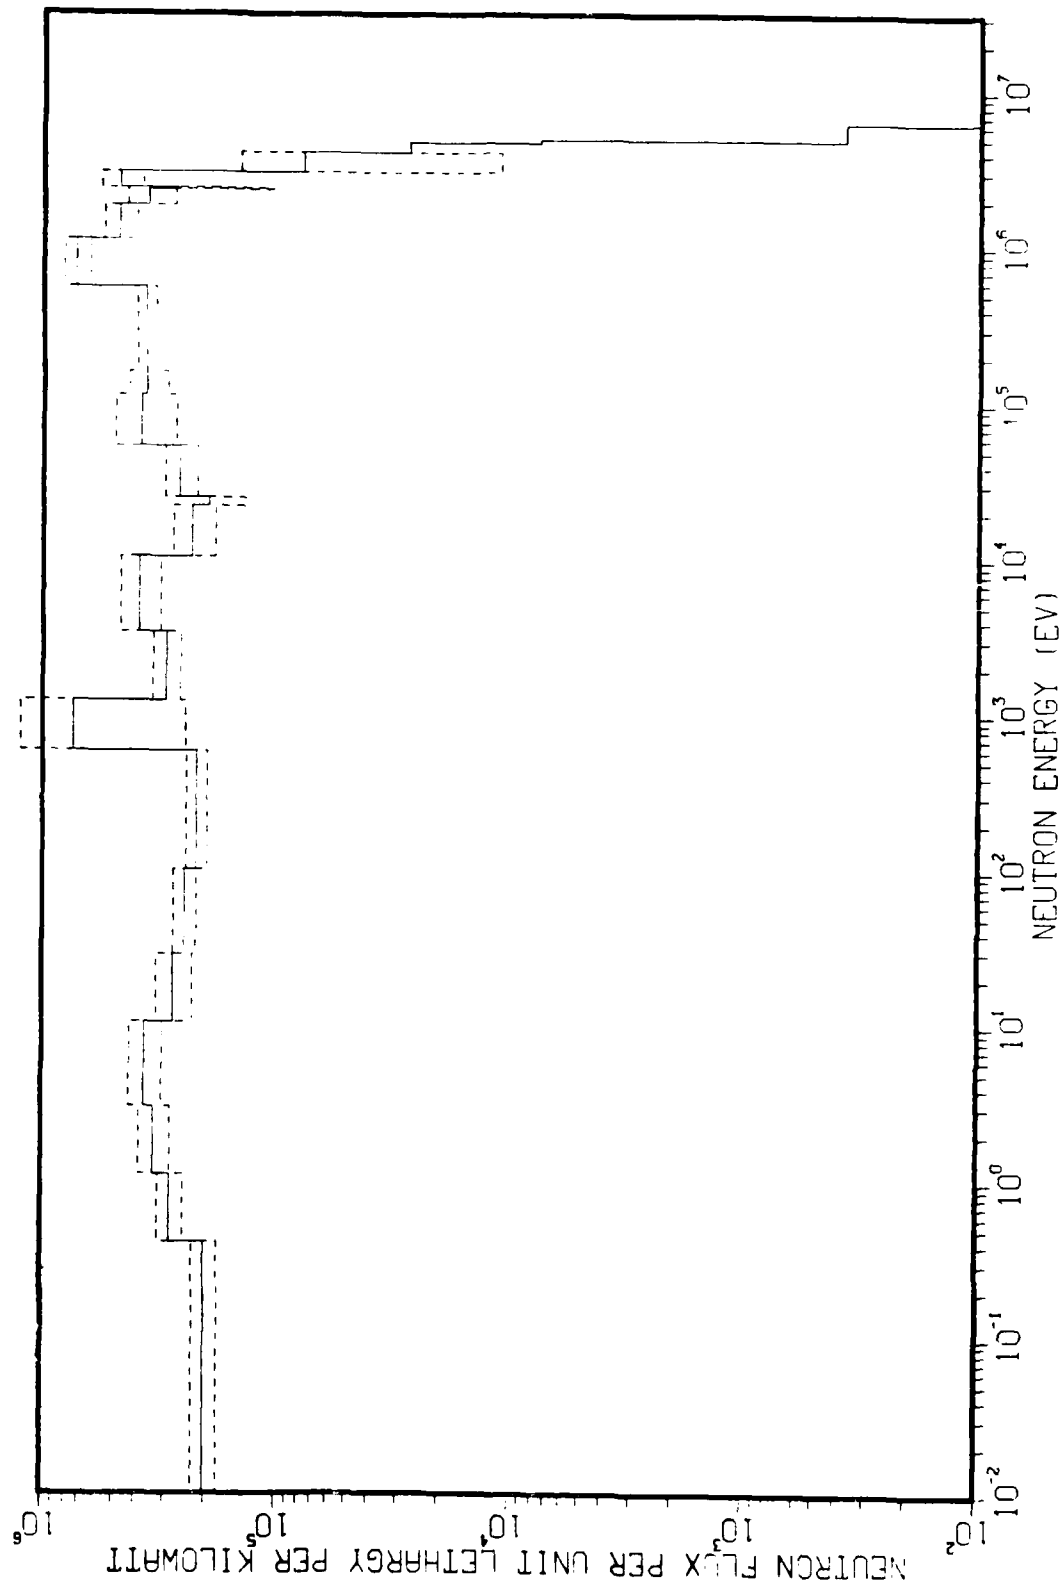


Figure II.4.15. Back Neutron Flux vs Energy ER2 Free Field.

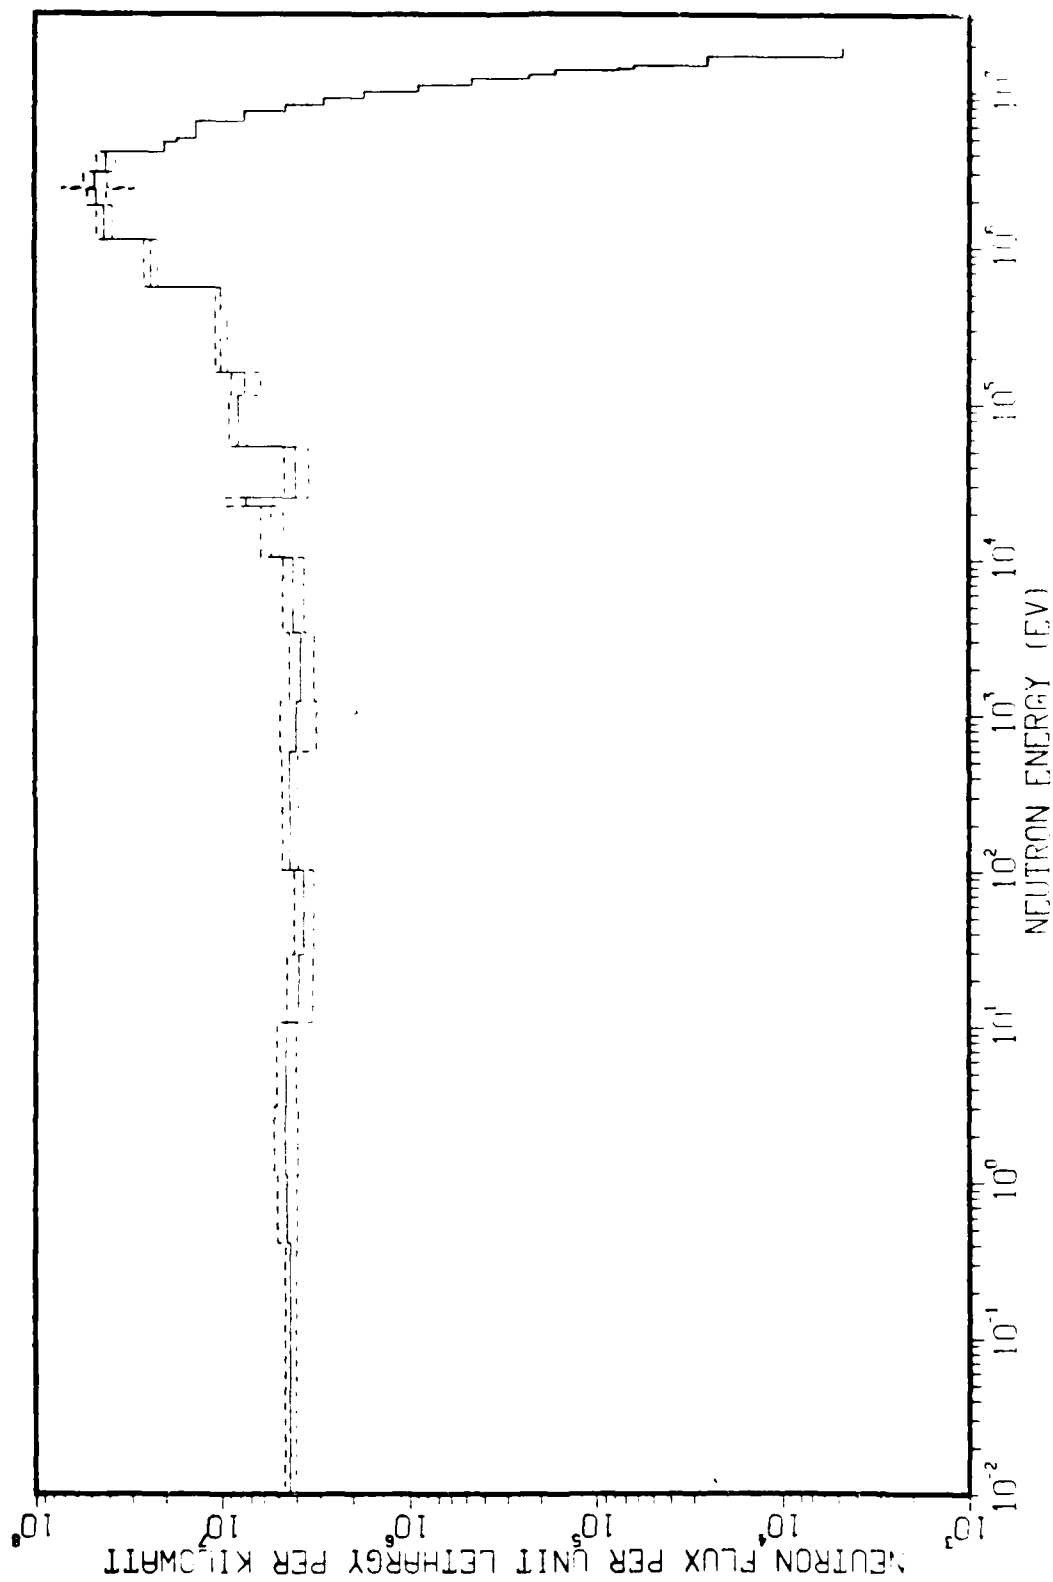


Figure II.4.16. Total (Front+Back) Neutron Flux vs Energy ER2 Free Field.

Table II.4.16. Neutron Flux per Unit Lethargy per Kilowatt.

ER2 FREE FIELD				
GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	4.71E+03	0.00E+00	4.71E+03
2	1.690E+07	2.51E+04	0.00E+00	2.51E+04
3	1.490E+07	6.19E+04	0.00E+00	6.19E+04
4	1.420E+07	7.45E+04	0.00E+00	7.45E+04
5	1.380E+07	1.63E+05	0.00E+00	1.63E+05
6	1.280E+07	2.26E+05	0.00E+00	2.26E+05
7	1.220E+07	4.62E+05	0.00E+00	4.62E+05
8	1.110E+07	8.93E+05	0.00E+00	8.93E+05
9	1.000E+07	1.73E+06	0.00E+00	1.73E+06
10	9.050E+06	2.85E+06	0.00E+00	2.85E+06
11	8.190E+06	4.56E+06	0.00E+00	4.56E+06
12	7.410E+06	7.53E+06	0.00E+00	7.53E+06
13	6.380E+06	1.36E+07	3.71E+02	1.36E+07
14	4.970E+06	1.73E+07	7.51E+03	1.74E+07
15	4.720E+06	2.02E+07	2.74E+04	2.02E+07
16	4.070E+06	4.16E+07	7.79E+04	4.17E+07
		0.12	0.86	0.12
17	3.010E+06	4.69E+07	4.76E+05	4.73E+07
		0.15	0.20	0.15
18	2.390E+06	4.99E+07	2.72E+05	5.02E+07
		0.42	0.61	0.42
19	2.310E+06	4.64E+07	3.58E+05	4.67E+07
		0.12	0.23	0.12
20	1.830E+06	4.19E+07	4.80E+05	4.24E+07
		0.10	0.16	0.09
21	1.110E+06	2.32E+07	7.20E+05	2.39E+07
		0.08	0.12	0.08
22	5.500E+05	9.71E+06	3.65E+05	1.01E+07
		0.07	0.09	0.07
23	1.580E+05	7.15E+06	3.65E+05	7.52E+06
		0.19	0.19	0.18
24	1.110E+05	7.81E+06	3.82E+05	8.19E+06
		0.12	0.29	0.12
25	5.250E+04	3.77E+06	2.61E+05	4.03E+06
		0.16	0.16	0.15
26	2.480E+04	7.23E+06	1.97E+05	7.43E+06
		0.29	0.31	0.28
27	2.190E+04	5.20E+06	2.31E+05	5.44E+06
		0.14	0.20	0.14
28	1.030E+04	3.80E+06	3.90E+05	4.19E+06
		0.14	0.19	0.13
29	3.350E+03	3.49E+06	2.98E+05	3.79E+06
		0.16	0.14	0.15
30	1.230E+03	3.27E+06	7.42E+05	4.01E+06
		0.22	0.67	0.22
31	5.830E+02	4.13E+06	2.21E+05	4.35E+06
		0.10	0.10	0.10
32	1.010E+02	3.44E+06	2.47E+05	3.69E+06
		0.12	0.11	0.11
33	2.900E+01	3.64E+06	2.76E+05	3.92E+06
		0.17	0.17	0.16
34	1.070E+01	4.22E+06	3.64E+05	4.59E+06
		0.13	0.16	0.12
35	3.060E+00	4.29E+06	3.34E+05	4.62E+06
		0.15	0.15	0.14
36	1.130E+00	4.26E+06	2.83E+05	4.54E+06
		0.12	0.12	0.11
37	4.140E-01	4.14E+06	2.01E+05	4.34E+06
		0.07	0.13	0.07

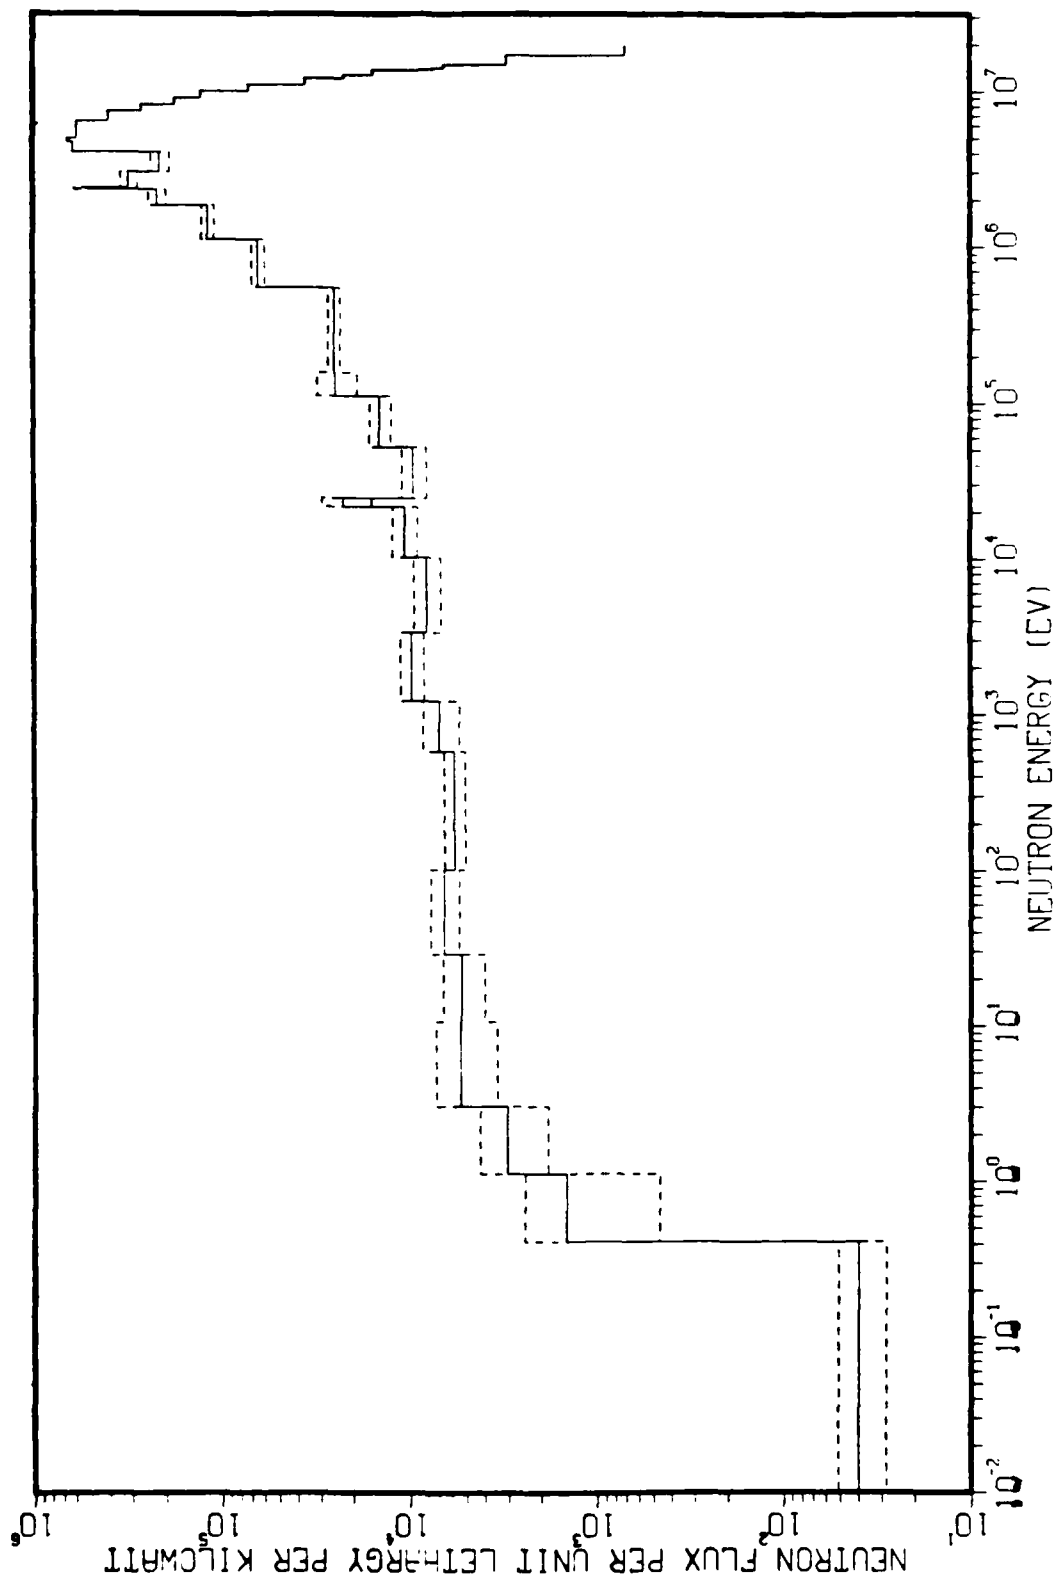


Figure II.4.17. Front Neutron Flux vs Energy ERI Free Field with 12" Water.

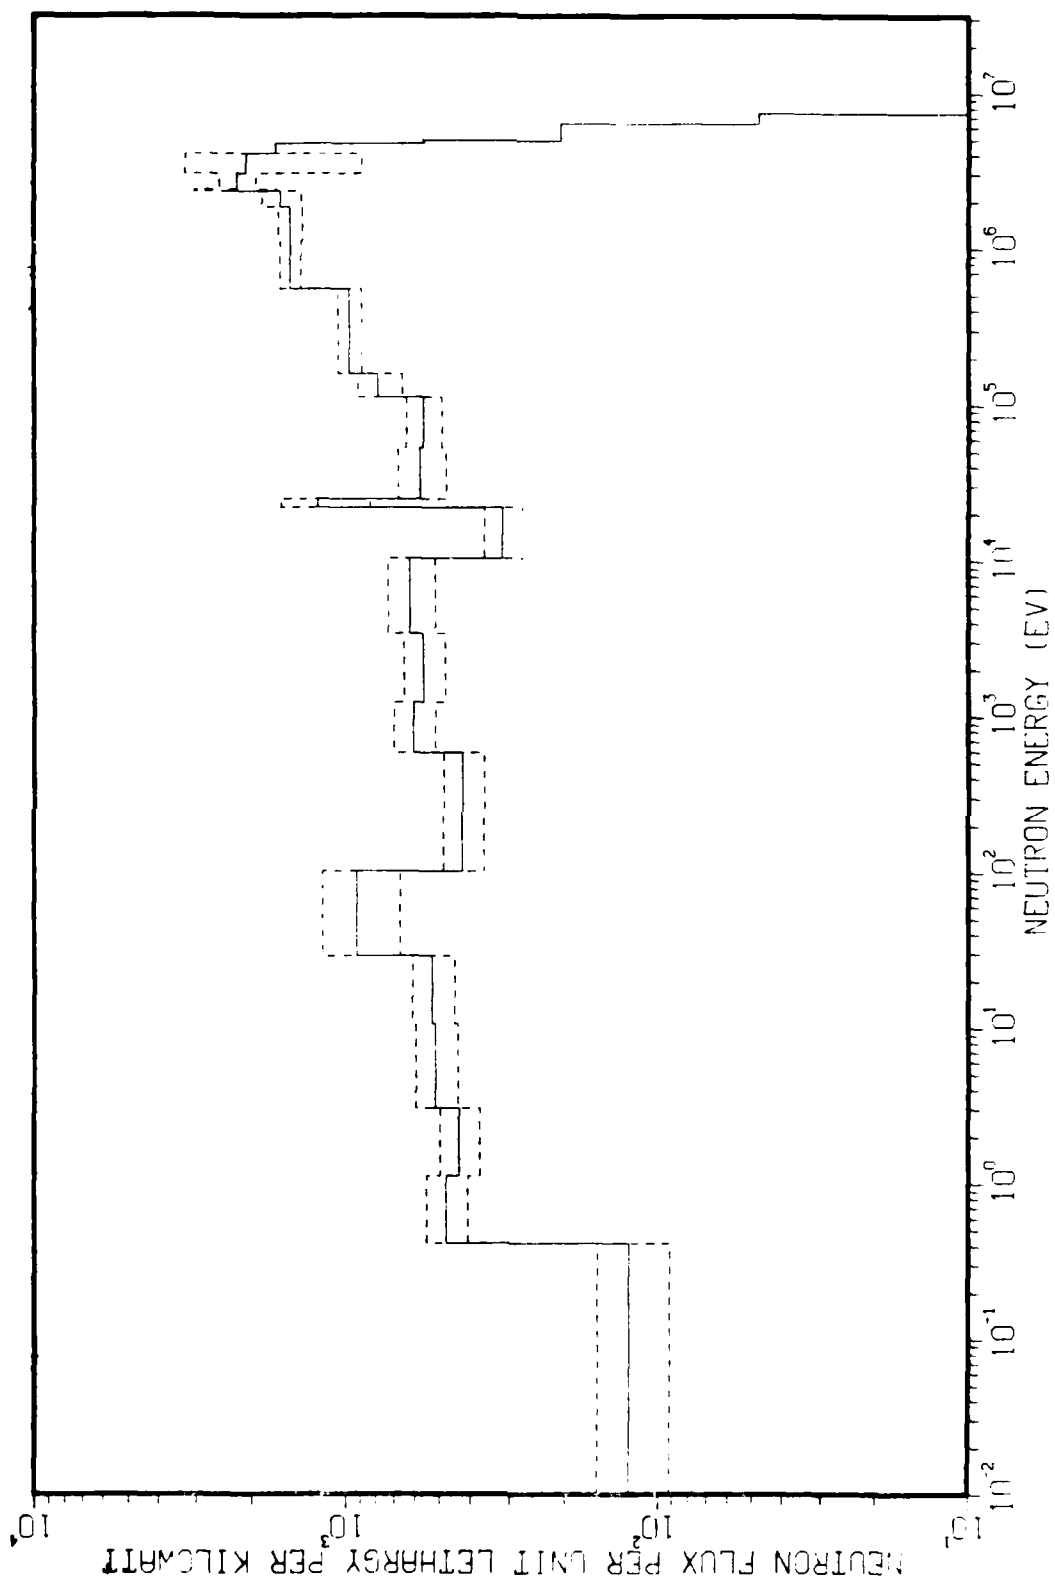


Figure 11.4.18. Back Neutron Flux vs Energy ER1 Free Field with 12" Water.

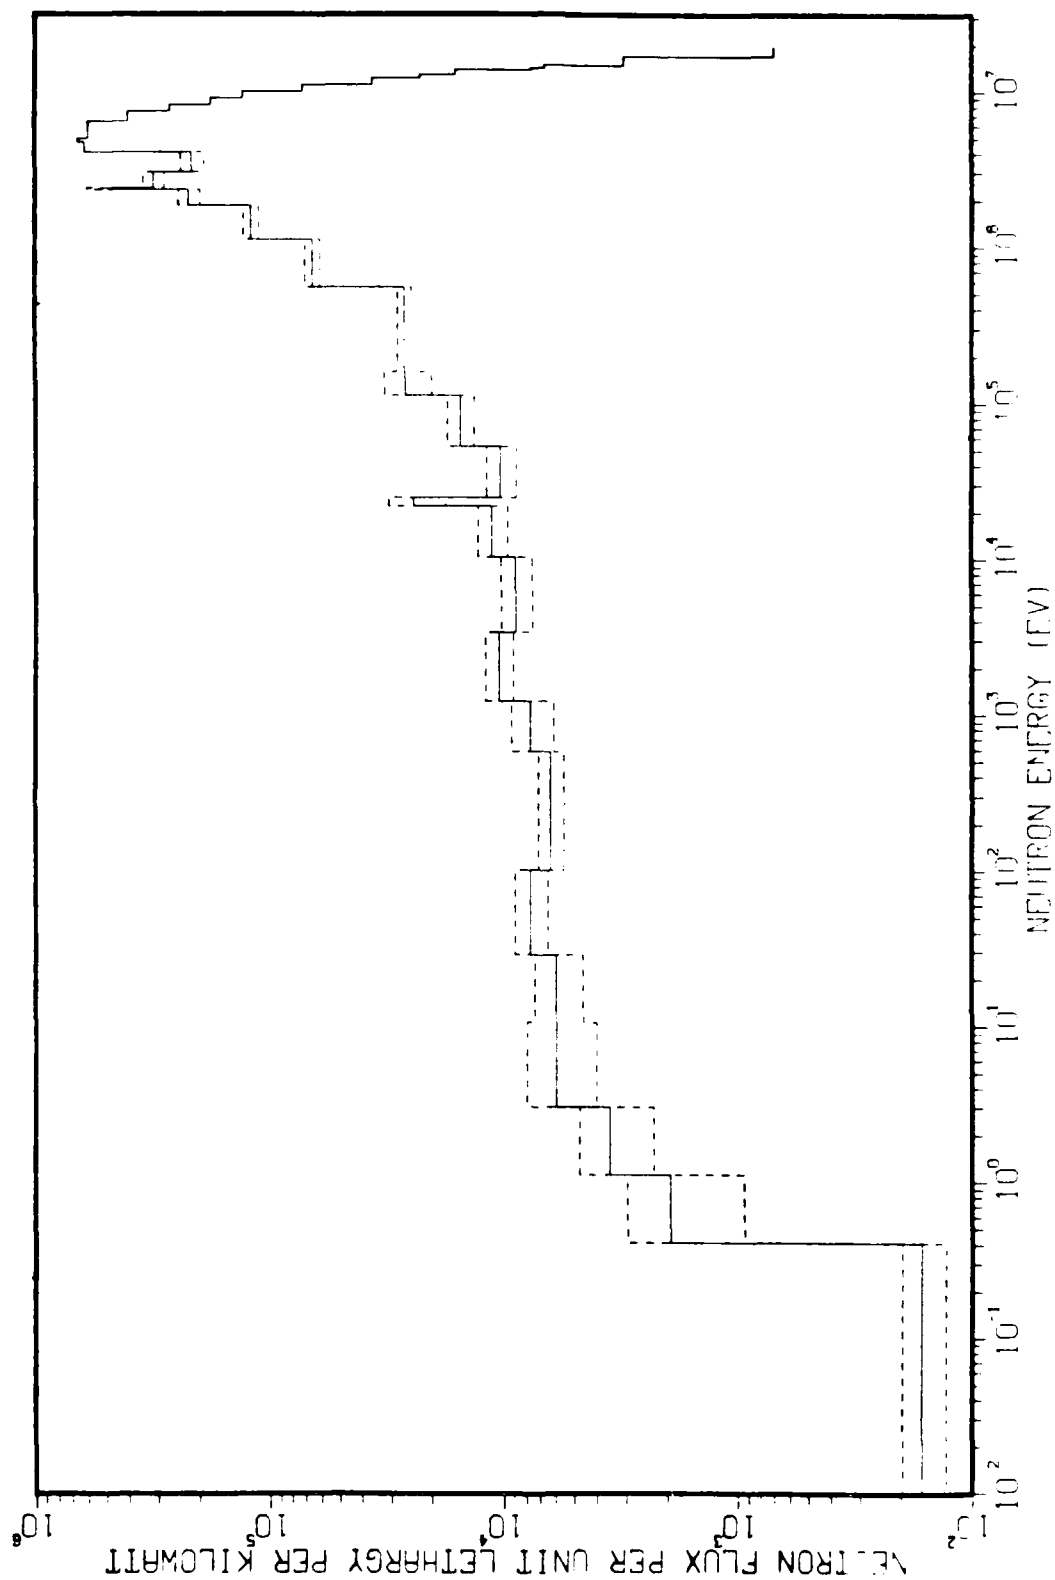


Figure 11.4.19. Total (Front+Back) Neutron Flux vs Energy ER1 Free Field with 12" Water.

Table II.4.17- Neutron Flux per Unit lethargy per Kilowatt.

ERI FREE FIELD WITH 12 IN. WATER

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	6.97E+02	0.00E+00	6.97E+02
2	1.690E+07	3.03E+03	0.00E+00	3.03E+03
3	1.490E+07	6.56E+03	0.00E+00	6.56E+03
4	1.420E+07	7.46E+03	0.00E+00	7.46E+03
5	1.380E+07	1.57E+04	0.00E+00	1.57E+04
6	1.280E+07	2.22E+04	0.00E+00	2.22E+04
7	1.220E+07	3.59E+04	0.00E+00	3.59E+04
8	1.110E+07	7.12E+04	0.00E+00	7.12E+04
9	1.000E+07	1.29E+05	0.00E+00	1.29E+05
10	9.050E+06	1.77E+05	0.00E+00	1.77E+05
11	8.190E+06	2.65E+05	0.00E+00	2.65E+05
12	7.410E+06	3.99E+05	4.74E-01	3.99E+05
13	6.380E+06	5.91E+05	2.04E+02	5.91E+05
14	4.970E+06	6.55E+05	5.62E+02	6.55E+05
15	4.720E+06	6.11E+05	1.67E+03	6.13E+05
16	4.070E+06	2.11E+05	2.07E+03	2.14E+05
		0.11	0.57	0.11
17	3.010E+06	3.09E+05	2.23E+03	3.12E+05
		0.10	0.14	0.10
18	2.390E+06	4.80E+05	2.34E+03	4.82E+05
		0.25	0.30	0.24
19	2.310E+06	2.19E+05	1.62E+03	2.20E+05
		0.11	0.14	0.11
20	1.830E+06	1.18E+05	1.50E+03	1.19E+05
		0.07	0.09	0.07
21	1.110E+06	6.33E+04	1.49E+03	6.46E+04
		0.03	0.03	0.08
22	5.500E+05	2.52E+04	9.69E+02	2.61E+04
		0.07	0.08	0.07
23	1.580E+05	2.50E+04	7.86E+02	2.56E+04
		0.24	0.16	0.23
24	1.110E+05	1.45E+04	5.65E+02	1.51E+04
		0.13	0.13	0.12
25	5.250E+04	9.62E+03	5.79E+02	1.02E+04
		0.15	0.18	0.14
26	2.480E+04	2.27E+04	1.22E+03	2.39E+04
		0.29	0.32	0.28
27	2.190E+04	1.08E+04	3.16E+02	1.11E+04
		0.15	0.14	0.14
28	1.030E+04	8.19E+03	6.23E+02	8.81E+03
		0.16	0.17	0.15
29	3.350E+03	9.84E+03	5.64E+02	1.04E+04
		0.14	0.15	0.13
30	1.230E+03	7.02E+03	6.07E+02	7.63E+03
		0.22	0.15	0.20
31	5.830E+02	5.85E+03	4.24E+02	6.27E+03
		0.13	0.15	0.12
32	1.010E+02	6.71E+03	9.27E+02	7.63E+03
		0.18	0.23	0.16
33	2.900E+01	5.39E+03	5.29E+02	5.92E+03
		0.25	0.15	0.23
34	1.070E+01	5.42E+03	5.17E+02	5.93E+03
		0.36	0.16	0.33
35	3.060E+00	3.06E+03	4.35E+02	3.50E+03
		0.40	0.14	0.35
36	1.130E+00	1.46E+03	4.78E+02	1.94E+03
		0.68	0.15	0.52
37	4.140E-01	3.99E+01	1.24E+02	1.64E+02
		0.29	0.26	0.21

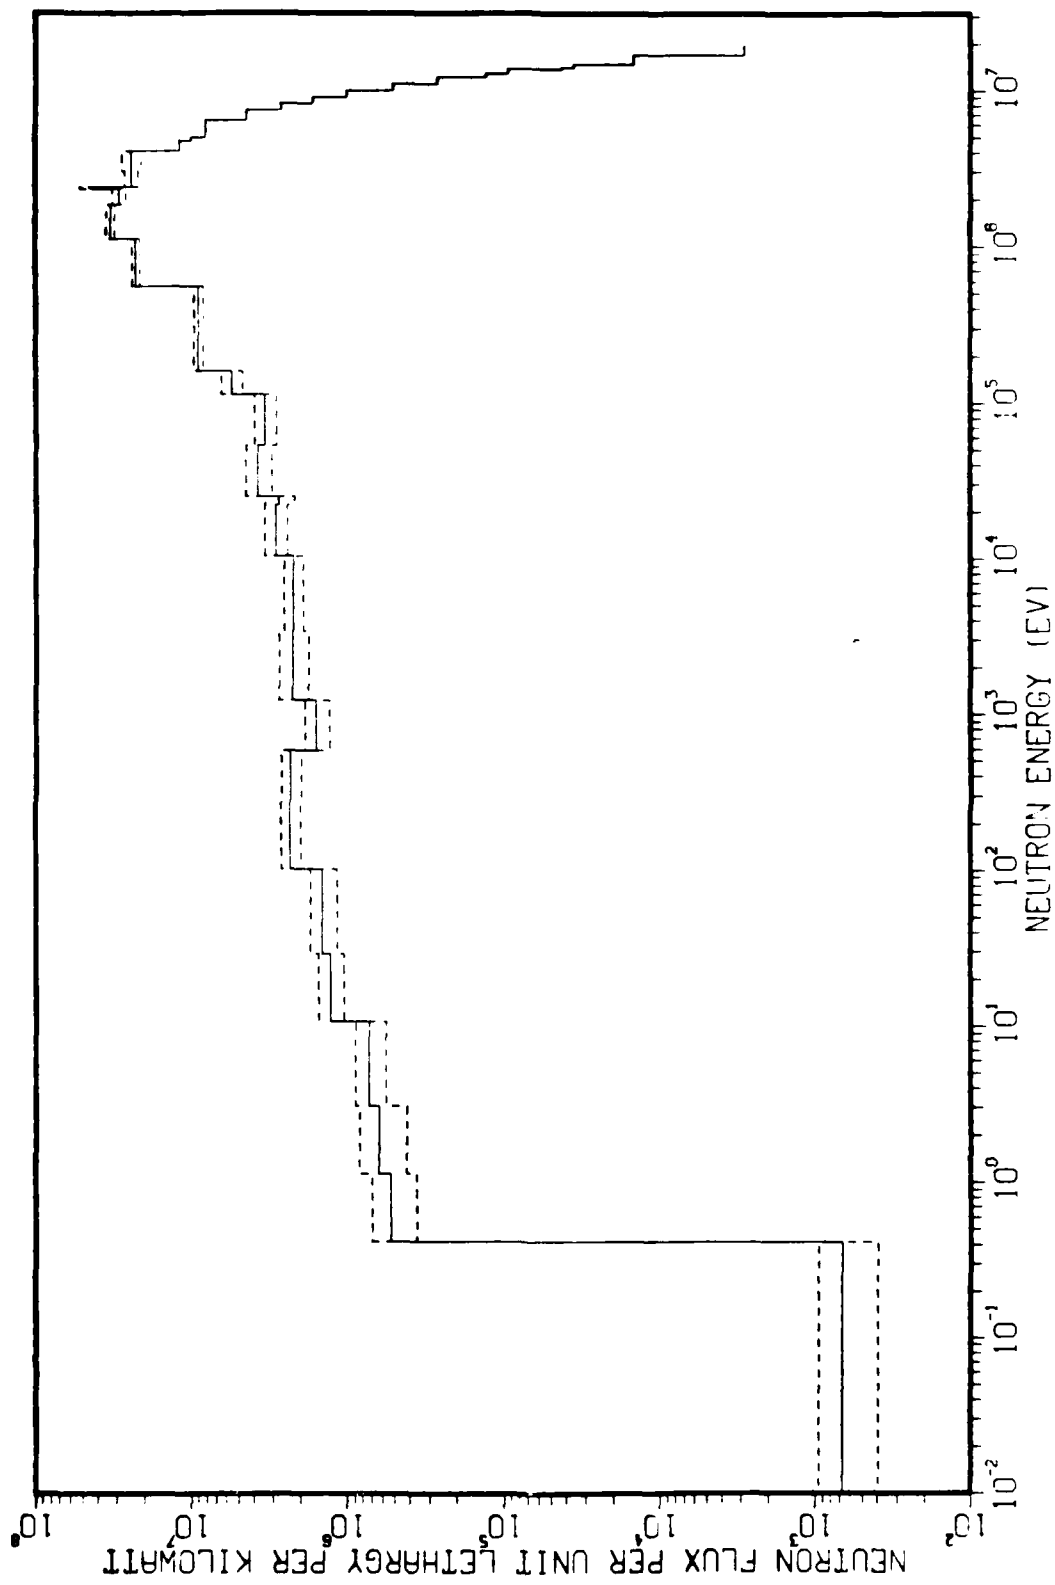


Figure 11.4.20. Front Neutron Flux vs Energy ER1 with 2" Pb.

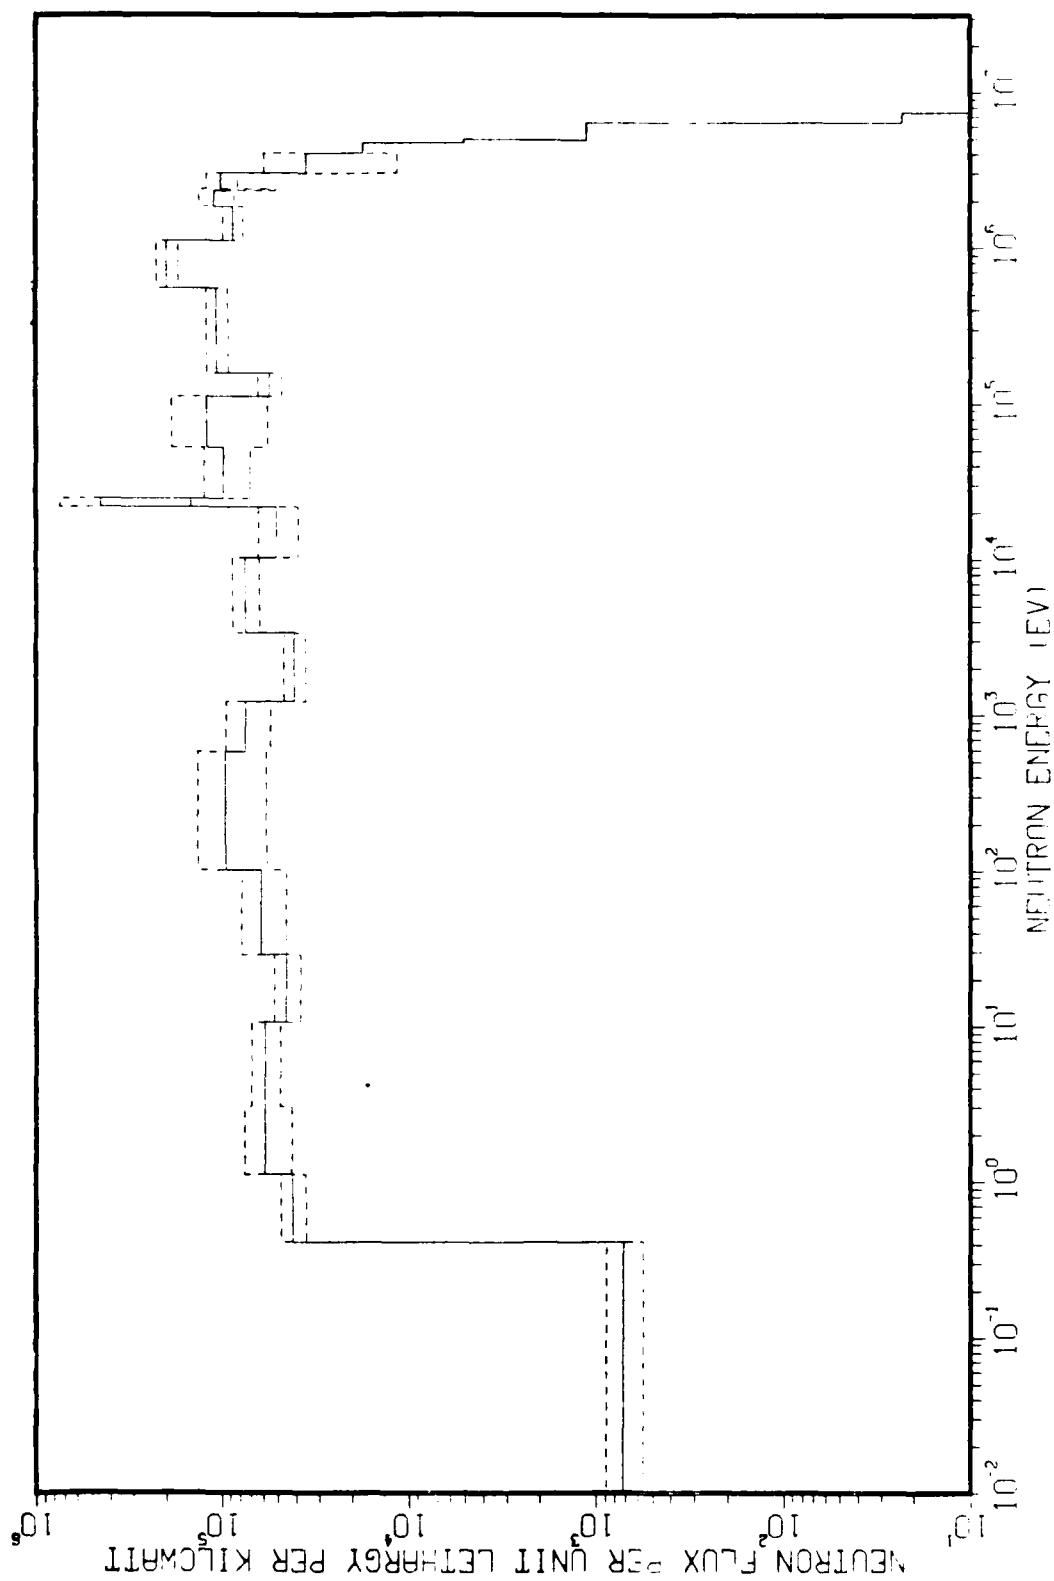


Figure II.4.21. Back Neutron Flux vs Energy ER1 with 2" Pb.

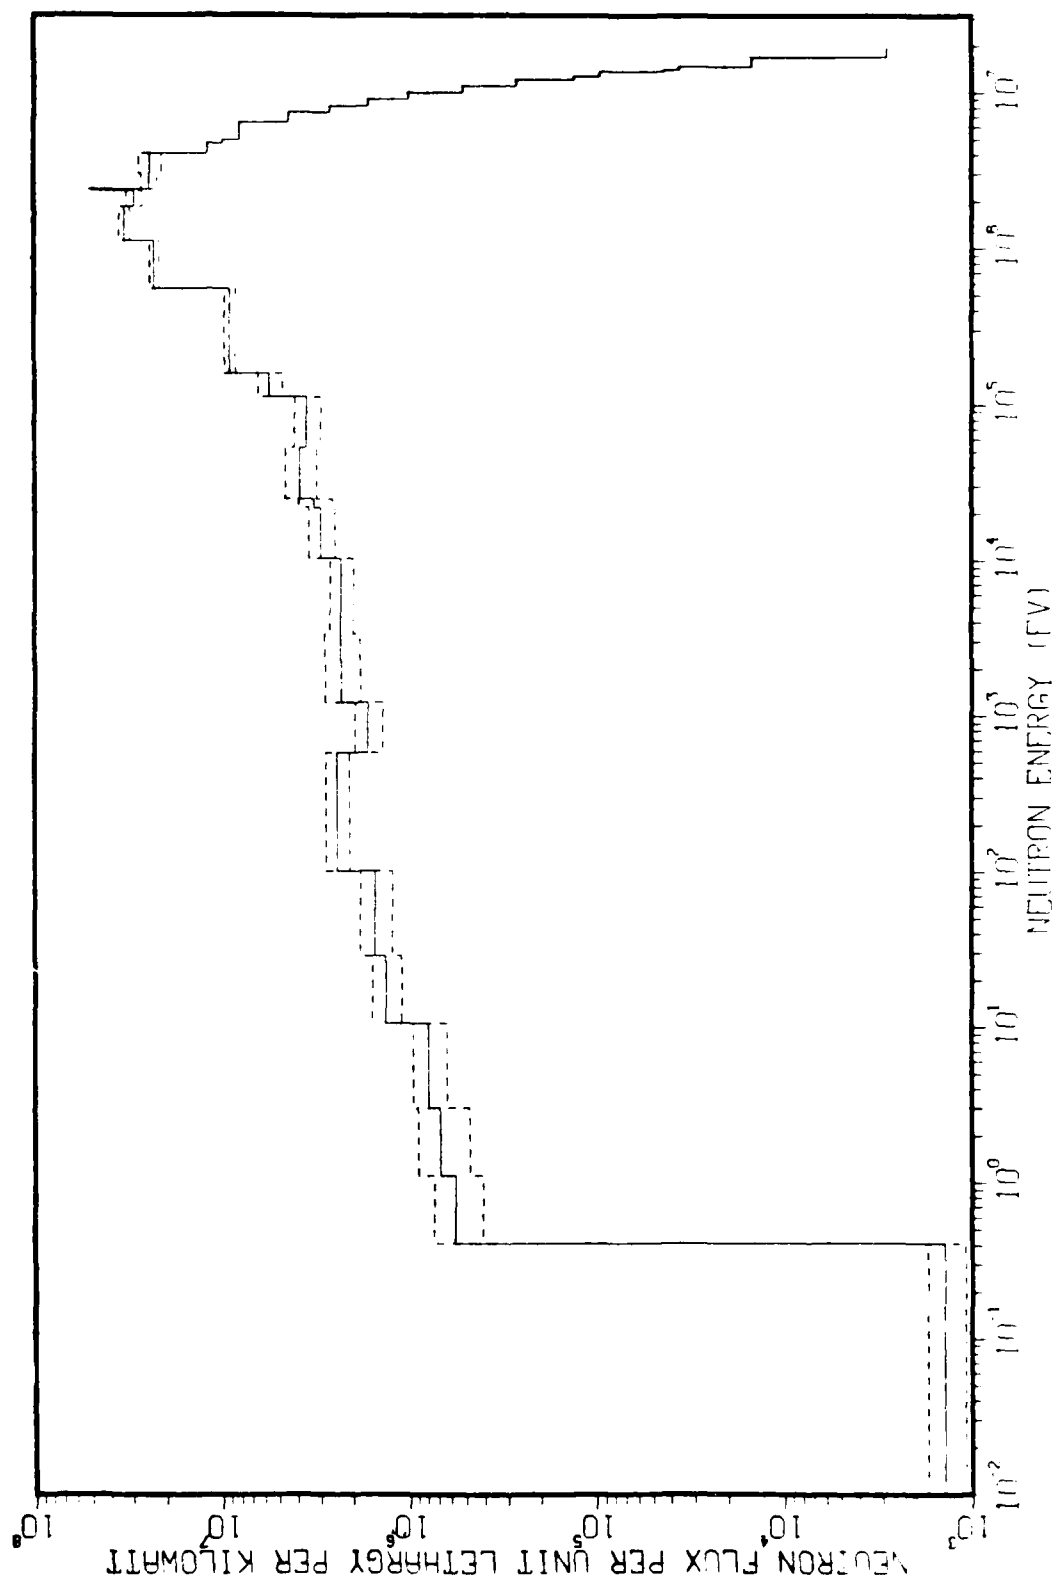


Figure II.4.22. Total (Front+Back) Neutron Flux vs Energy ERI with 2" Pb.

Table II.4.18. Neutron Flux per Unit Lethargy per Kilowatt.

ERI WITH 2 IN. PB

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	2.82E+03	0.00E+00	2.82E+03
2	1.690E+07	1.48E+04	0.00E+00	1.48E+04
3	1.490E+07	3.61E+04	0.00E+00	3.61E+04
4	1.420E+07	4.32E+04	0.00E+00	4.32E+04
5	1.380E+07	9.51E+04	0.00E+00	9.51E+04
6	1.280E+07	1.31E+05	0.00E+00	1.31E+05
7	1.220E+07	2.68E+05	0.00E+00	2.68E+05
8	1.110E+07	5.18E+05	0.00E+00	5.18E+05
9	1.000E+07	1.01E+06	0.00E+00	1.01E+06
10	9.050E+06	1.66E+06	0.00E+00	1.66E+06
11	8.190E+06	2.66E+06	0.00E+00	2.66E+06
12	7.410E+06	4.42E+06	2.32E+01	4.42E+06
13	6.360E+06	8.05E+06	1.12E+03	8.05E+06
14	4.970E+06	9.95E+06	5.05E+03	9.96E+06
15	4.720E+06	1.19E+07	1.76E+04	1.19E+07
16	4.070E+06	2.43E+07	3.55E+04	2.43E+07
		0.14	0.67	0.14
17	3.010E+06	2.44E+07	1.01E+05	2.45E+07
		0.10	0.18	0.10
18	2.390E+06	4.38E+07	8.96E+04	4.39E+07
		0.17	0.43	0.17
19	2.310E+06	2.94E+07	1.09E+05	2.95E+07
		0.10	0.22	0.10
20	1.830E+06	3.32E+07	8.70E+04	3.33E+07
		0.07	0.12	0.07
21	1.110E+06	2.28E+07	1.97E+05	2.30E+07
		0.06	0.13	0.06
22	5.500E+05	9.03E+06	1.06E+05	9.14E+06
		0.07	0.13	0.07
23	1.580E+05	5.54E+06	5.57E+04	5.60E+06
		0.15	0.15	0.15
24	1.110E+05	3.41E+06	1.21E+05	3.53E+06
		0.16	0.53	0.16
25	5.250E+04	3.76E+06	9.78E+04	3.85E+06
		0.19	0.28	0.19
26	2.480E+04	2.77E+06	4.44E+05	3.22E+06
		0.21	0.67	0.20
27	2.190E+04	2.92E+06	5.14E+04	2.97E+06
		0.16	0.24	0.16
28	1.030E+04	2.24E+06	7.53E+04	2.32E+06
		0.14	0.16	0.14
29	3.350E+03	2.28E+06	4.12E+04	2.32E+06
		0.22	0.13	0.21
30	1.230E+03	1.60E+06	7.51E+04	1.67E+06
		0.18	0.27	0.17
31	5.830E+02	2.35E+06	9.62E+04	2.45E+06
		0.15	0.40	0.15
32	1.010E+02	1.47E+06	6.23E+04	1.53E+06
		0.20	0.26	0.19
33	2.900E+01	1.30E+06	4.56E+04	1.35E+06
		0.18	0.16	0.18
34	1.070E+01	7.37E+05	5.94E+04	7.97E+05
		0.22	0.17	0.20
35	3.060E+00	6.33E+05	5.93E+04	6.92E+05
		0.33	0.28	0.30
36	1.130E+00	5.31E+05	4.22E+04	5.70E+05
		0.31	0.15	0.29
37	4.140E-01	6.76E+02	7.26E+02	1.40E+03
		0.41	0.23	0.23

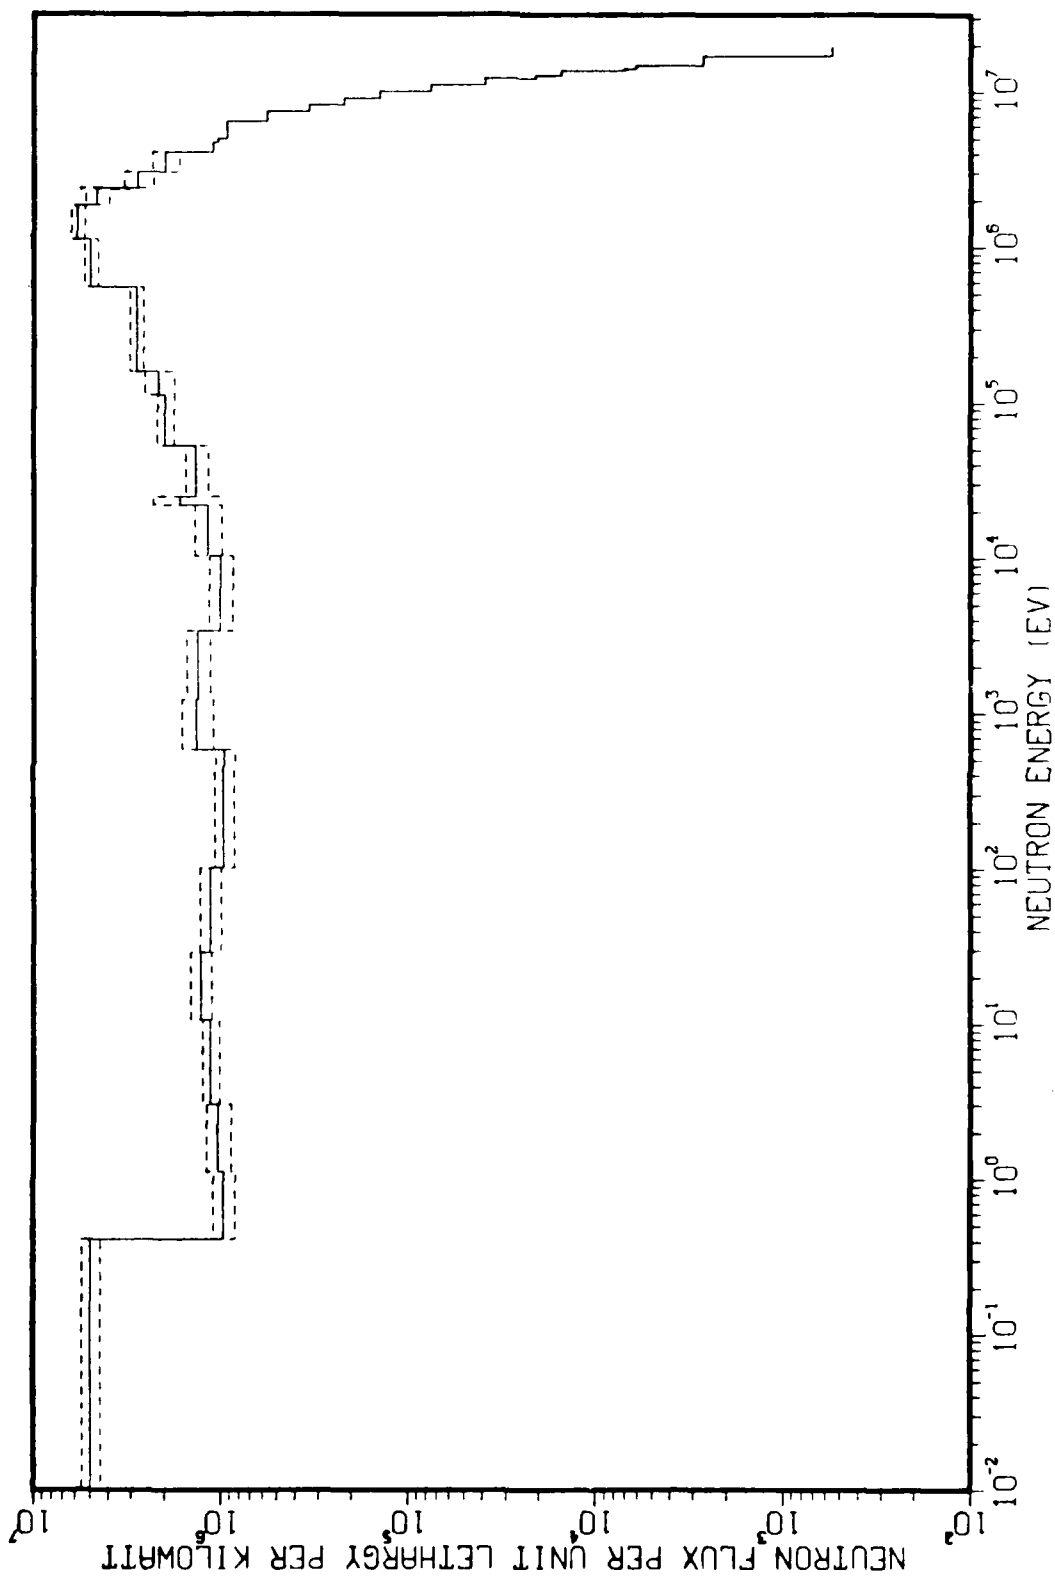


Figure II.4.23. Front (3-D) Neutron Flux vs Energy ERI with 6" Pb and Phantom.

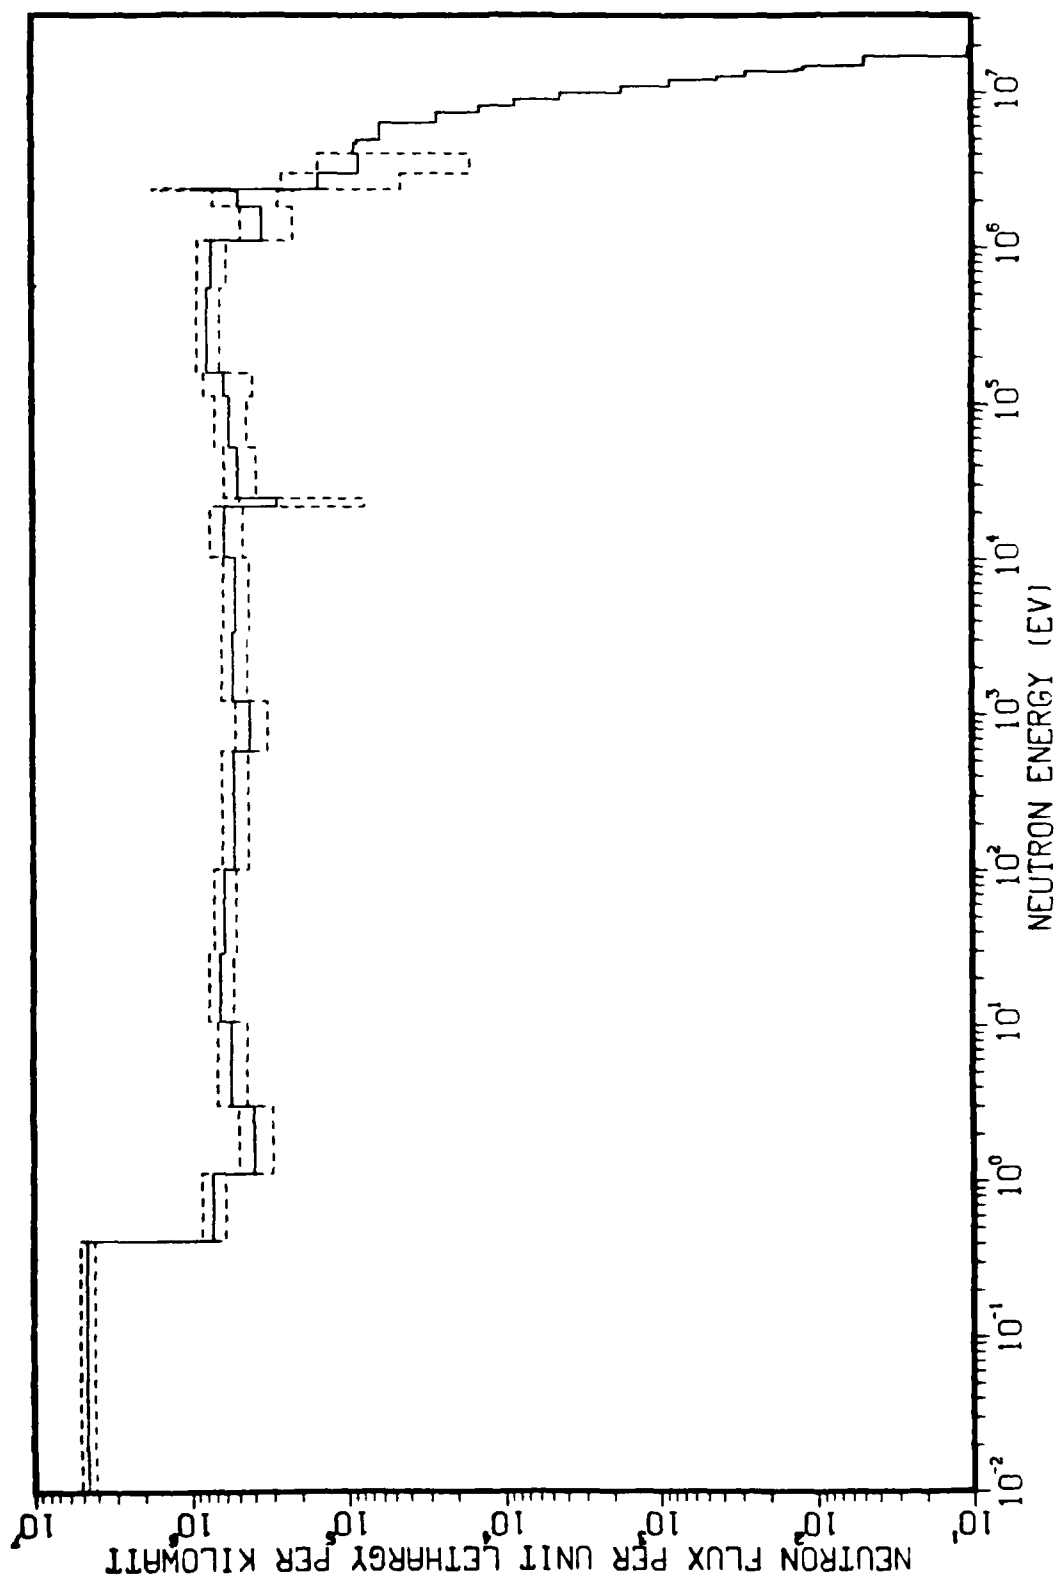


Figure 11.4.24. Back (3-D) Neutron Flux vs Energy ER1 with 6" Pb and Phantom.

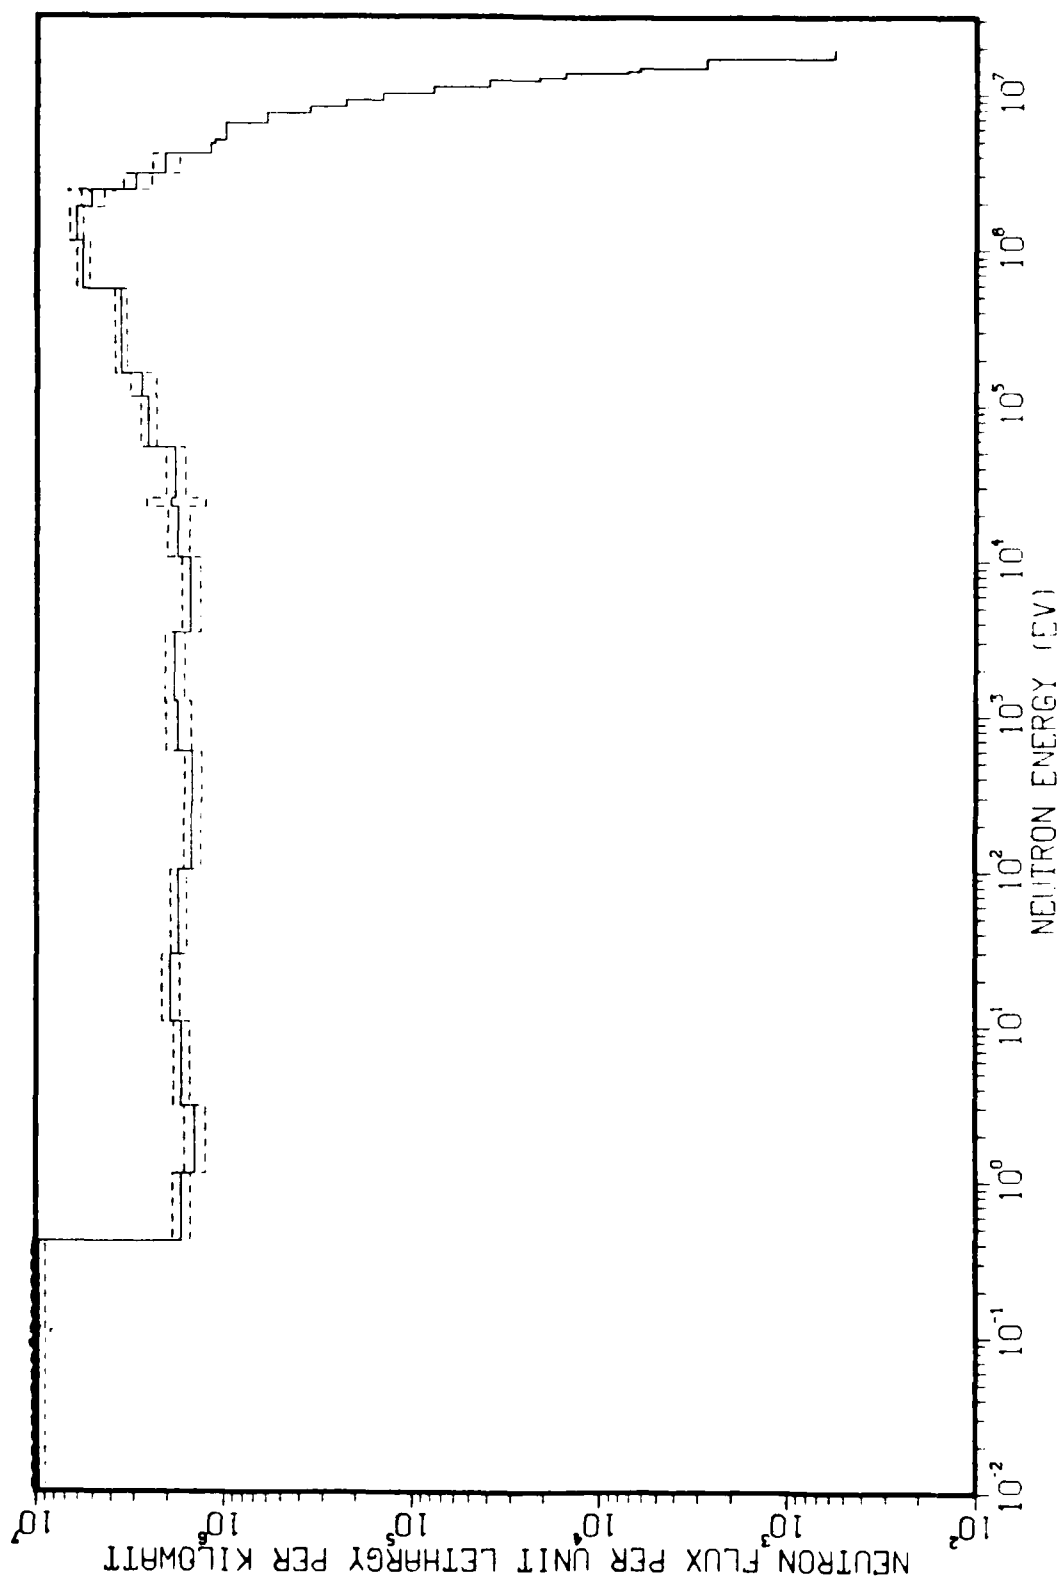


Figure 11.4.25. Total (Front+Back) Neutron Flux vs Energy ER1 with 6" Pb and Phantom.

Table II.4.19. Neutron Flux per Unit Lethargy per Kilowatt.

PHANTOM BEHIND 6" Pb WALL				
GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	5.52E+02	1.04E+01	5.62E+02
2	1.690E+07	2.65E+03	4.85E+01	2.70E+03
3	1.490E+07	6.08E+03	1.18E+02	6.19E+03
4	1.420E+07	6.99E+03	1.31E+02	7.12E+03
5	1.380E+07	1.51E+04	2.76E+02	1.54E+04
6	1.280E+07	2.08E+04	4.20E+02	2.13E+04
7	1.220E+07	3.88E+04	8.42E+02	3.97E+04
8	1.110E+07	7.59E+04	1.72E+03	7.76E+04
9	1.000E+07	1.42E+05	4.25E+03	1.46E+05
10	9.050E+06	2.20E+05	8.29E+03	2.28E+05
11	8.190E+06	3.41E+05	1.38E+04	3.55E+05
12	7.410E+06	5.69E+05	2.60E+04	5.95E+05
13	6.380E+06	9.32E+05	6.03E+04	9.92E+05
14	4.970E+06	1.05E+06	8.56E+04	1.13E+06
15	4.720E+06	1.11E+06	8.97E+04	1.20E+06
16	4.070E+06	2.01E+06	8.36E+04	2.09E+06
		0.16	0.81	0.16
17	3.010E+06	2.82E+06	1.50E+05	2.97E+06
		0.18	0.70	0.17
18	2.390E+06	4.39E+06	9.67E+05	5.36E+06
		0.29	0.78	0.28
19	2.310E+06	4.64E+06	4.90E+05	5.13E+06
		0.14	0.44	0.14
20	1.830E+06	5.87E+06	3.45E+05	6.21E+06
		0.08	0.36	0.08
21	1.110E+06	4.97E+06	7.28E+05	5.70E+06
		0.08	0.21	0.07
22	5.500E+05	2.84E+06	7.68E+05	3.61E+06
		0.08	0.16	0.07
23	1.580E+05	2.17E+06	6.04E+05	2.77E+06
		0.18	0.35	0.16
24	1.110E+05	1.99E+06	5.60E+05	2.55E+06
		0.11	0.23	0.10
25	5.250E+04	1.36E+06	4.90E+05	1.85E+06
		0.14	0.23	0.12
26	2.480E+04	1.66E+06	2.78E+05	1.94E+06
		0.38	0.72	0.34
27	2.190E+04	1.18E+06	6.03E+05	1.79E+06
		0.16	0.24	0.13
28	1.030E+04	1.01E+06	5.14E+05	1.53E+06
		0.15	0.18	0.12
29	3.350E+03	1.34E+06	5.29E+05	1.87E+06
		0.14	0.18	0.11
30	1.230E+03	1.37E+06	4.18E+05	1.78E+06
		0.19	0.23	0.16
31	5.830E+02	9.67E+05	5.26E+05	1.49E+06
		0.12	0.19	0.10
32	1.010E+02	1.15E+06	6.10E+05	1.76E+06
		0.13	0.16	0.10
33	2.900E+01	1.29E+06	6.45E+05	1.93E+06
		0.13	0.17	0.10
34	1.070E+01	1.14E+06	5.55E+05	1.69E+06
		0.10	0.21	0.10
35	8.060E+00	1.04E+06	3.96E+05	1.44E+06
		0.15	0.24	0.13
36	1.130E+00	9.68E+05	7.25E+05	1.69E+06
		0.14	0.17	0.11
37	4.140E-01	4.98E+06	4.63E+06	9.60E+06
		0.11	0.10	0.08

5. COMPARISON OF 1-D AND 3-D RESULTS

The rather laborious task of comparing the 1-D and 3-D spectra and responses, group by group and case by case is left to the reader. It is, however, worth mentioning that the 1-D and 3-D results agree remarkably well for all but two cases. Considering the far from spherical nature of some of these configurations, it is extraordinary to find the ANISN results agreeing well not only in spectral shape but magnitude as well. The cases which did not agree quite as well, as ascertained by visual inspection as well as differences in the unfolding process, were the ones which one would expect. Namely the cases with exercise wheel and the phantom, both of which contain complex shapes (from a spherical modeling point of view) of hydrogenous material in which neutrons scatter readily. In both of these cases, the unfolding process indicated that the spliced spectra were more correct than the 1-D spectra. This is as one would hope and expect, since the 3-D model should more accurately reflect the true physical configuration. One may therefore conclude that 1-D calculations are adequate except in cases where complex shapes of hydrogenous material are located near the detector(s).

6. FREE FIELD SPECTRA AS A FUNCTION OF DISTANCE FROM THE REACTOR IN ER1 AND ER2

In addition to knowing the neutron and gamma-ray spectra near the reactor tank it is of interest to know the radiation fields further away. The knowledge of the effects on the free field fluxes from perturbations in the room and reactor configuration, coupled with the knowledge of the dependence of the free field flux as a function of position in the room, should allow reasonable estimates to be made of the flux for a wide variety of experimental arrangements. Thus, an effort was made to calculate the free field flux in ER1 and ER2 as a function of distance from the reactor center.

From the agreement between the 1-D and 3-D results for the free field cases it was clear that this could be done using the ANISN model. It was not clear, however, that this would hold for cases very deep in the room where wall effects could be important. Therefore a MORSE run was made with the detector located 290 cms from the reactor center in ER2 and the results compared with a similar ANISN calculation. The spectra resulting from these two calculations are shown in Figures II.6.1 through II.6.6. The good agreement in shape and magnitude, even at this depth in the room (1.37 meters from the back wall), indicates that 3-D runs are not necessary.

The results for ER1 are shown in Figures II.6.7 through II.6.42 and Tables II.6.1 through II.6.12 for distances of 50, 100, 200, 300, 400, and 500 cms into ER1. In addition, Tables II.6.13 through II.6.15 show the front, back, and total components of the nine integral responses as a function of distance into the room. The results for ER2 are shown in Figures II.6.43 through II.6.66 and Tables II.6.16 through II.6.23 for distances of 50, 100, 200, and 300 cms from the reactor. Tables II.6.24 through II.6.26 show the responses as a function of distance into ER2.

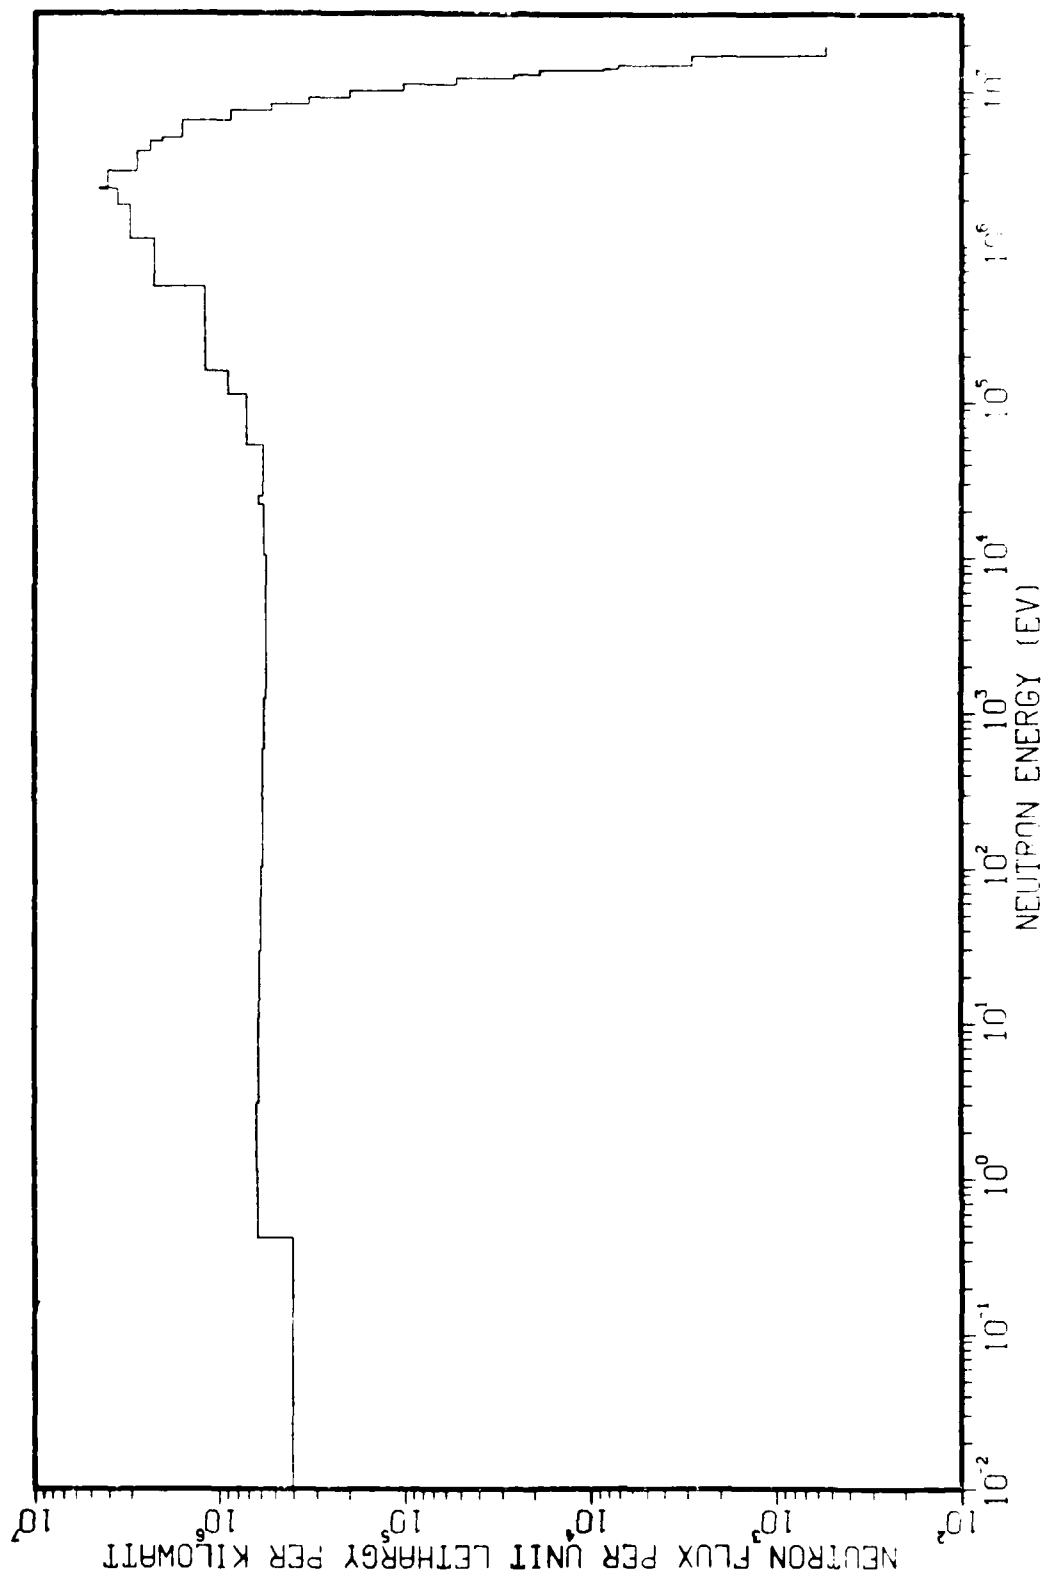


Figure II.6.1. Front Neutron Flux vs Energy - Free Field ER1 290.51 CMS from Reactor (1-D).

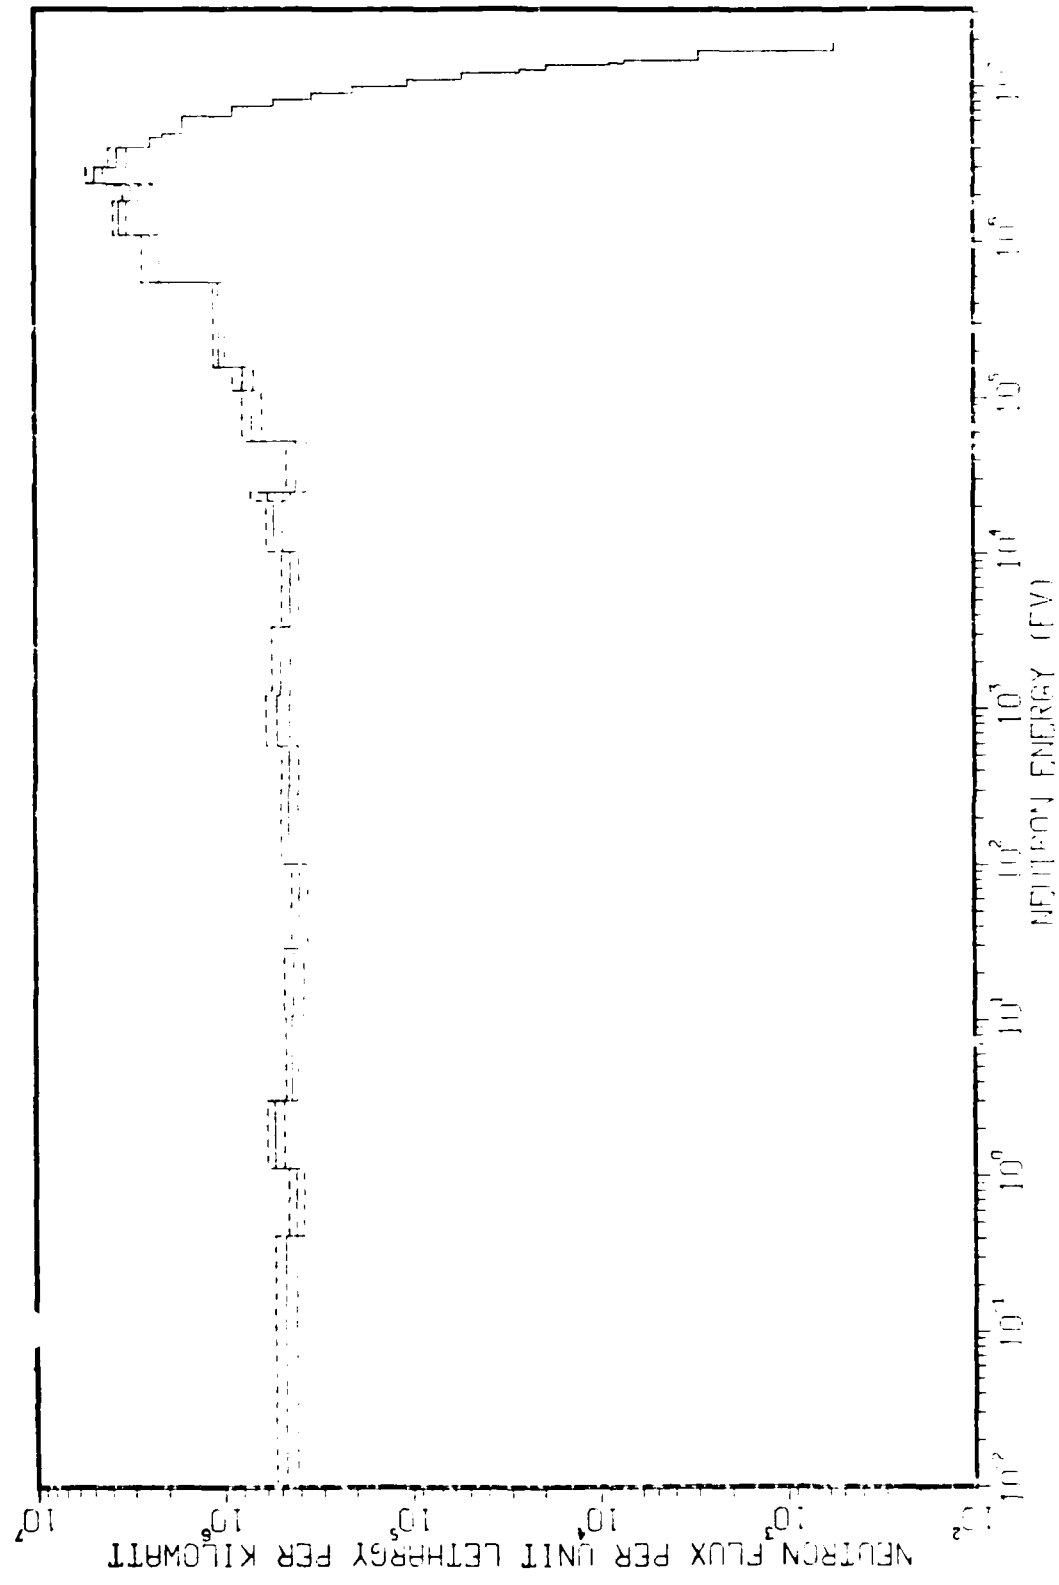


Figure 11.6.2. Front Neutron Flux vs Energy - Free Field ER1 290.51 CMS from Reactor (3-D).

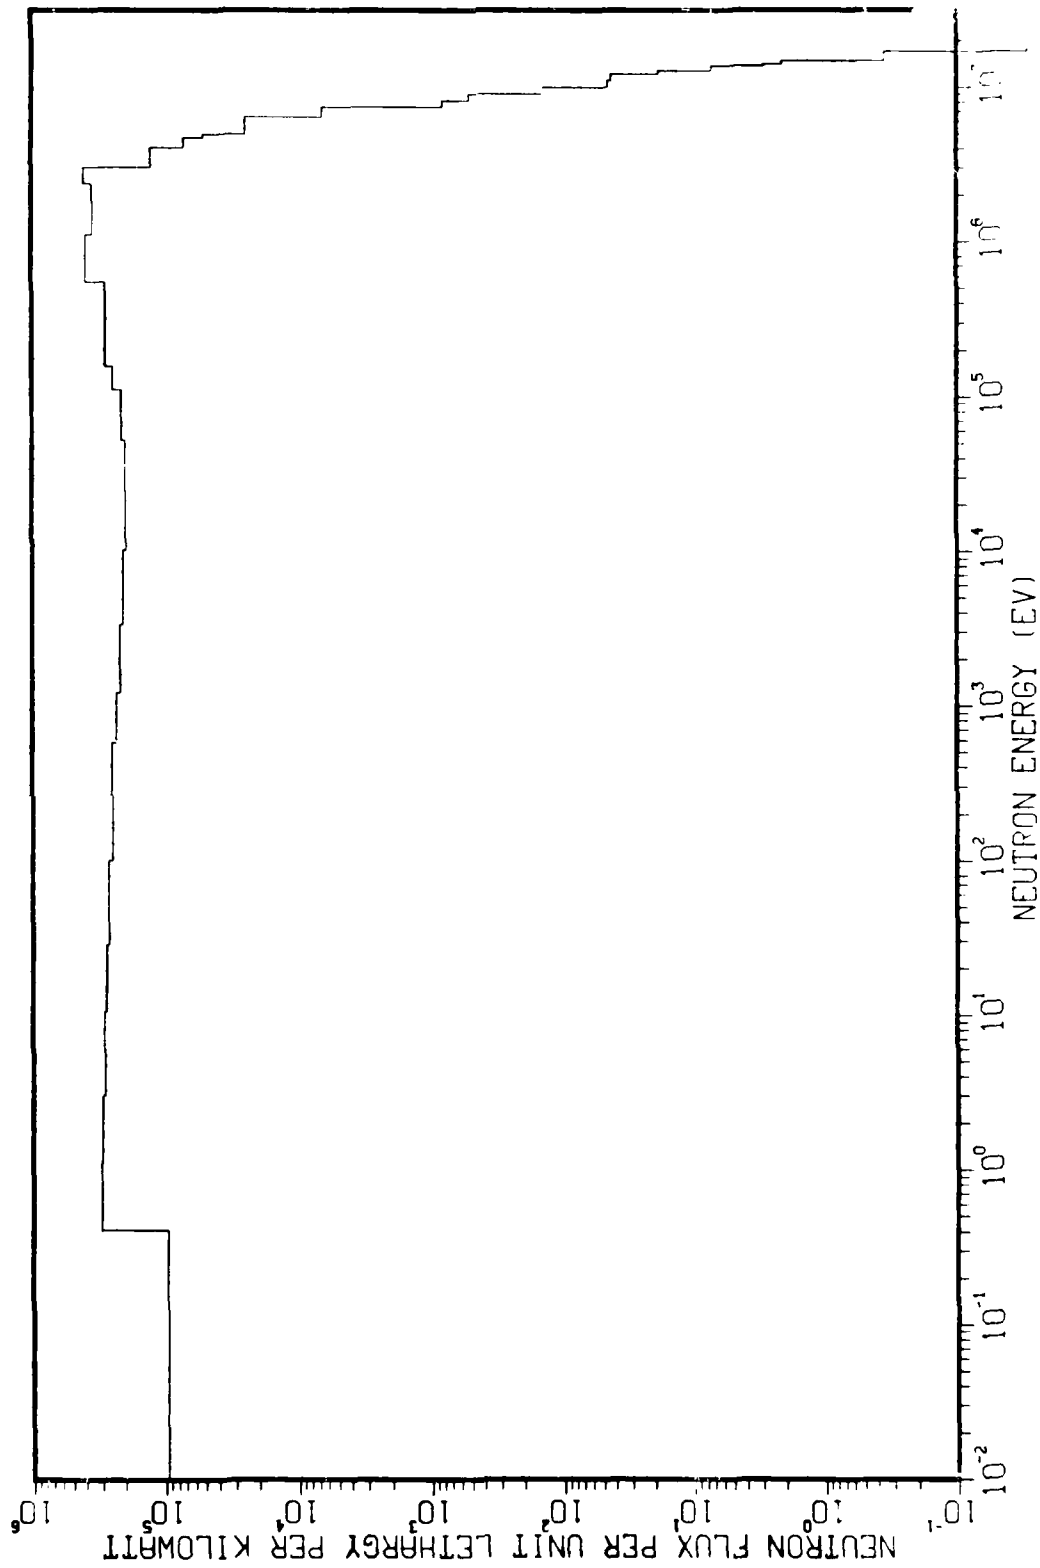


Figure II.6.3. Back Neutron Flux vs Energy - Free Field ERI 290.51 CMS from Reactor (1-D).

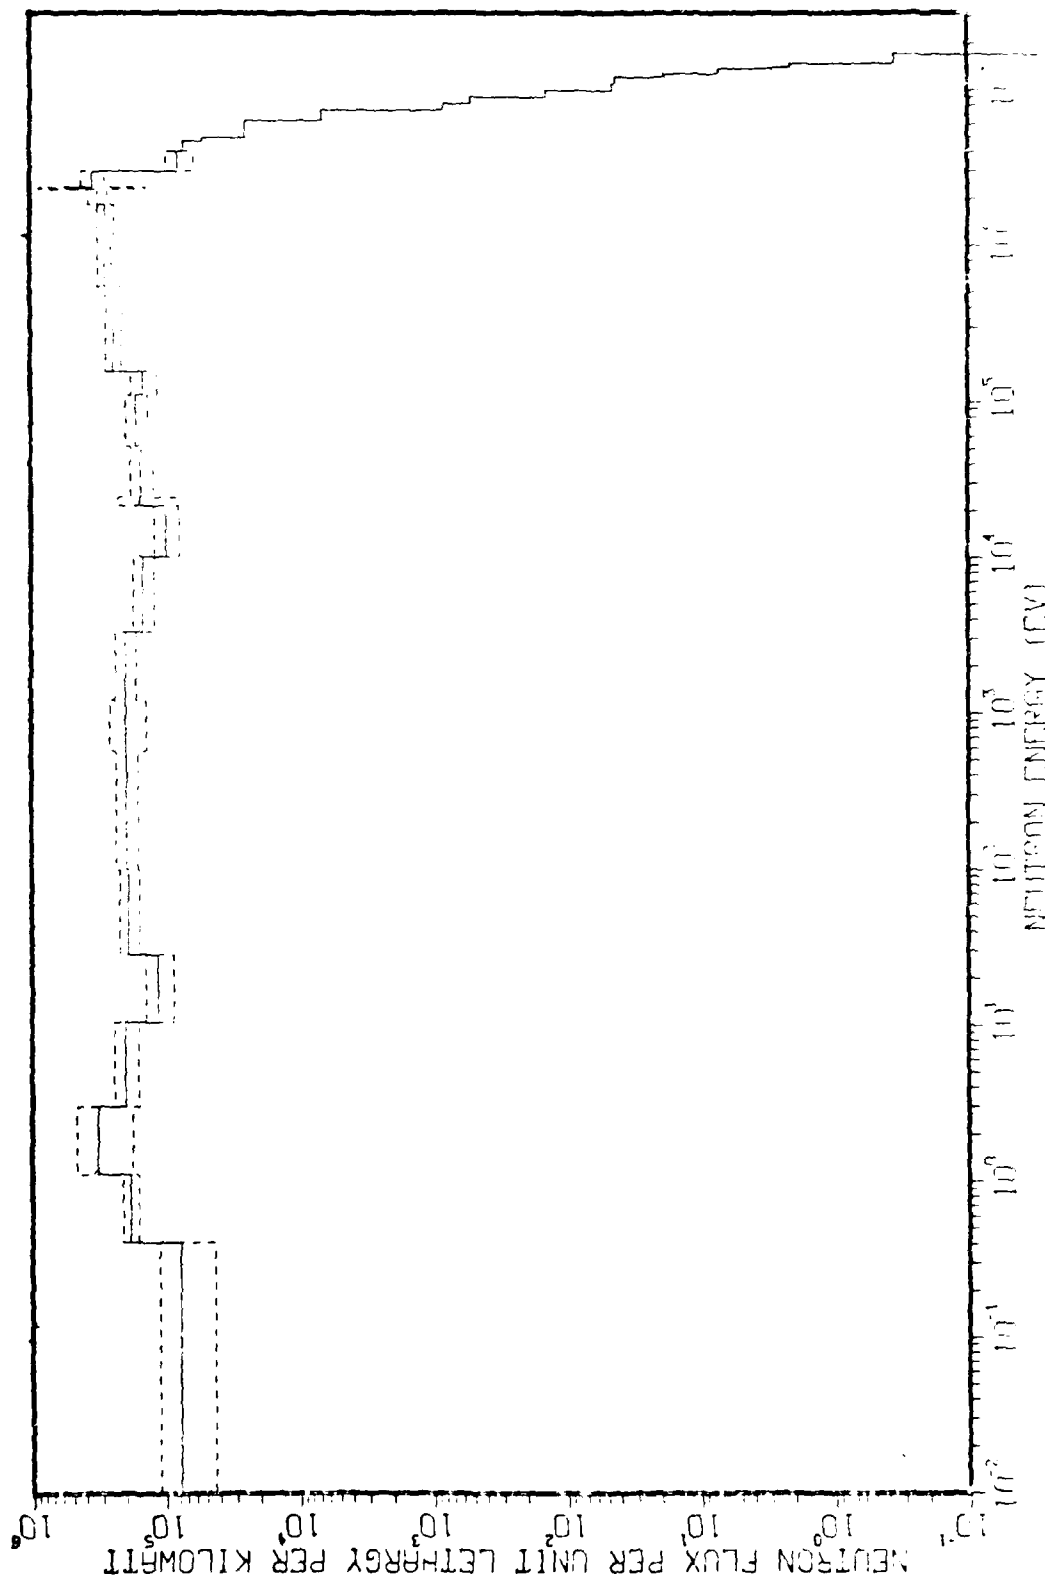


Figure 11.6.4. Back Neutron Flux vs Energy - Free Field ER1 290.51 CMS from Reactor (3-D).

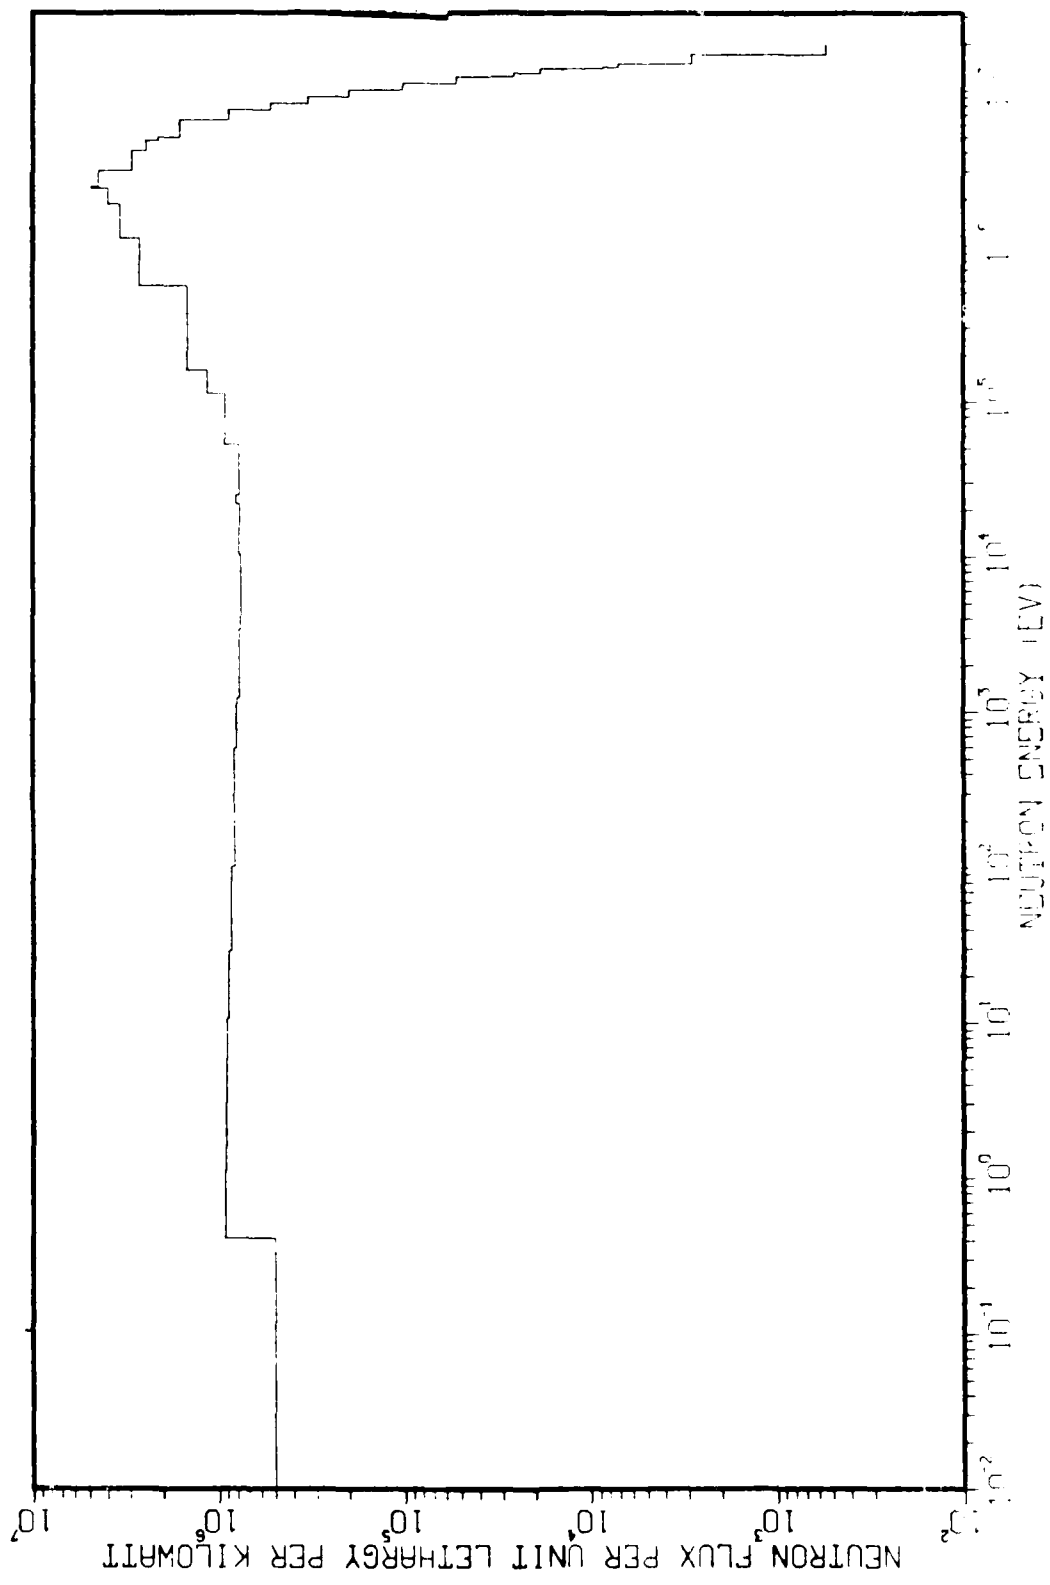


Figure 11.6.5. Total Neutron Flux vs Energy - Free Field ER1 290.51 CMS from Reactor (1-D).

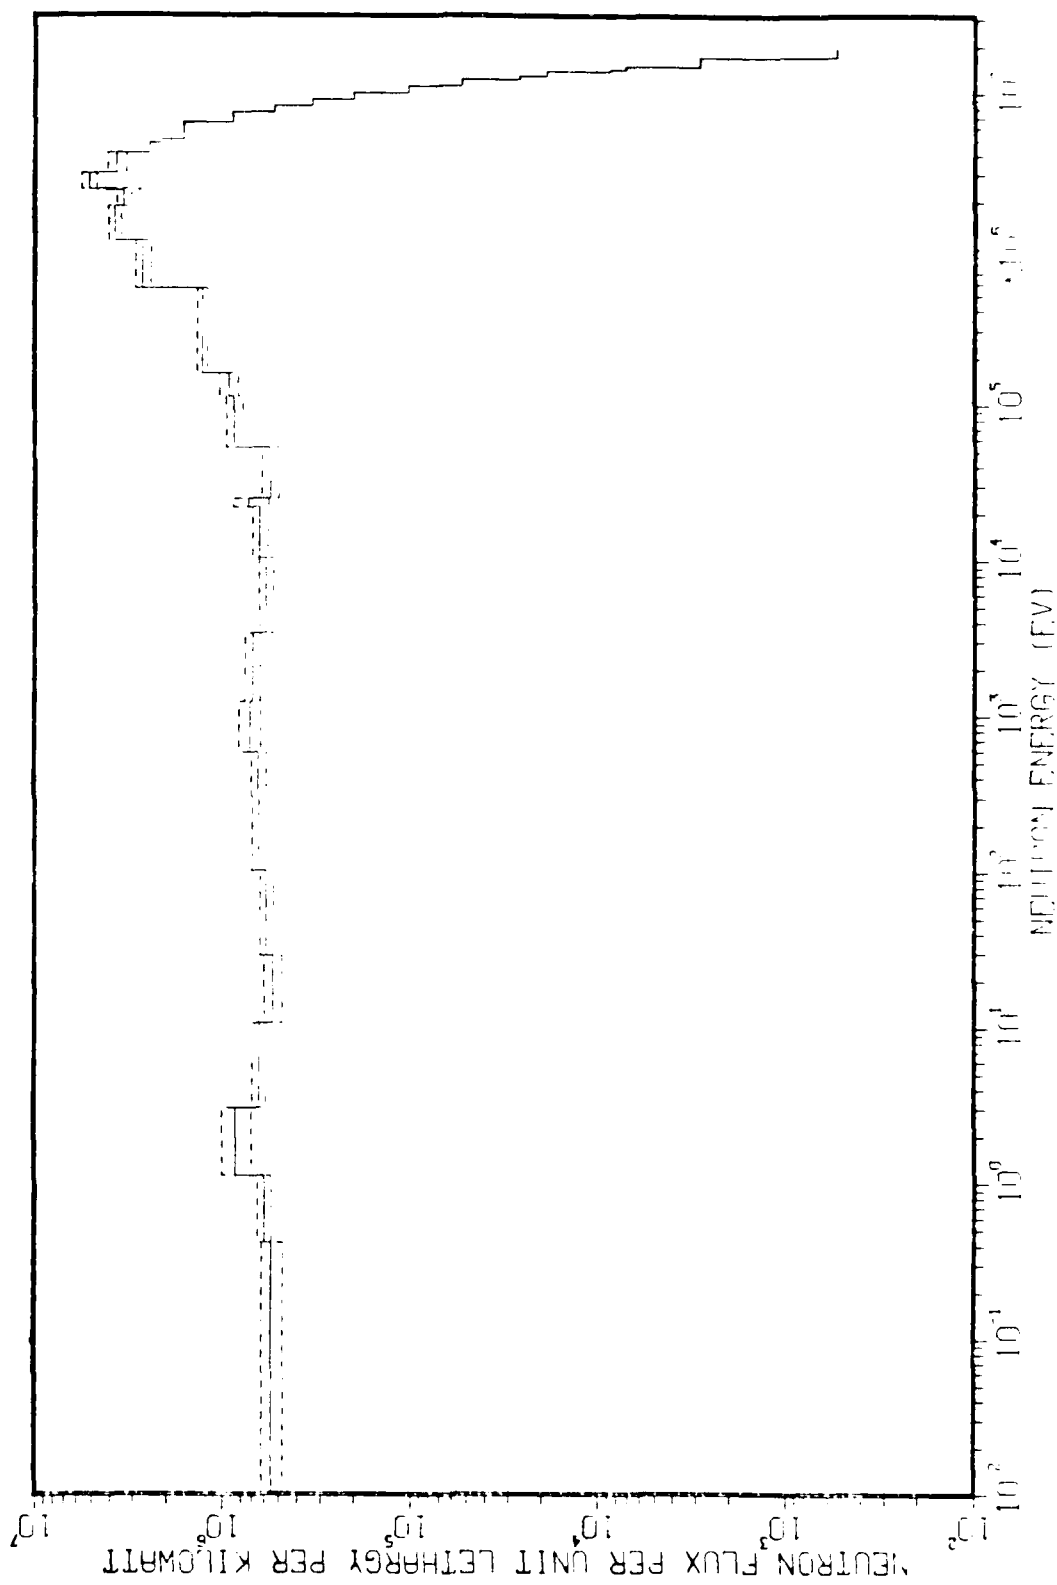


Figure II.6.6. Total Neutron Flux vs Energy - Free Field ERI 290.51 CMS from Reactor (3-D).

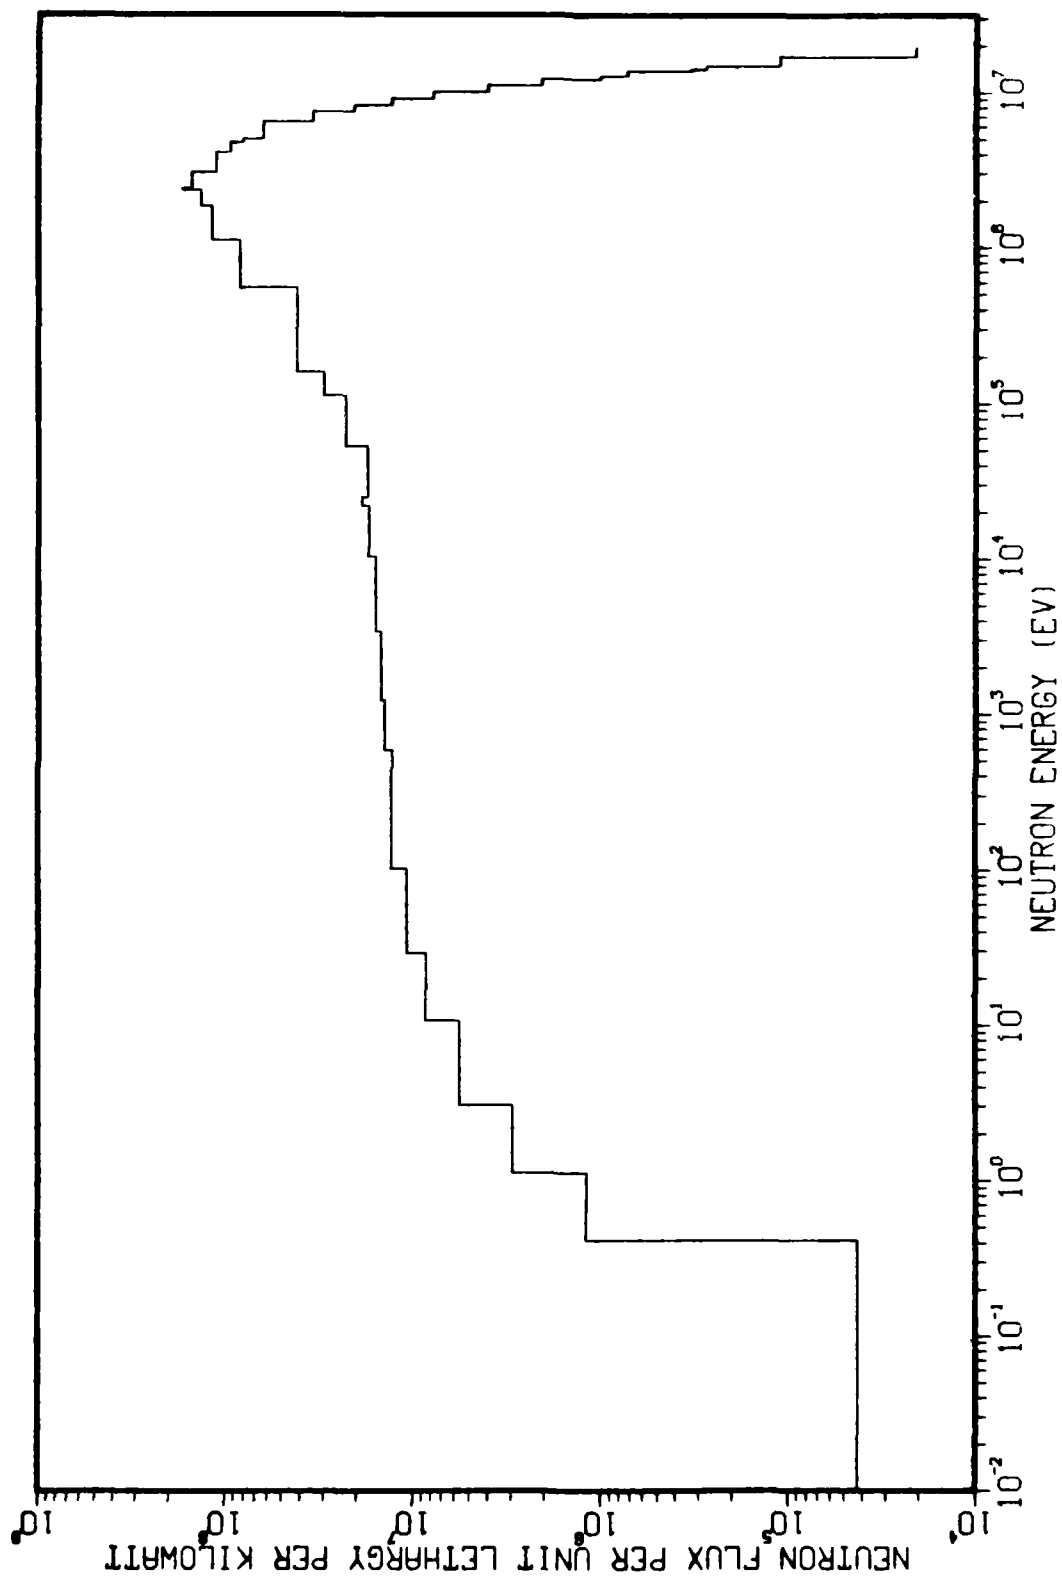


Figure II.6.7. Front Neutron Flux vs Energy Free Field ERI 50 CMS from Reactor.

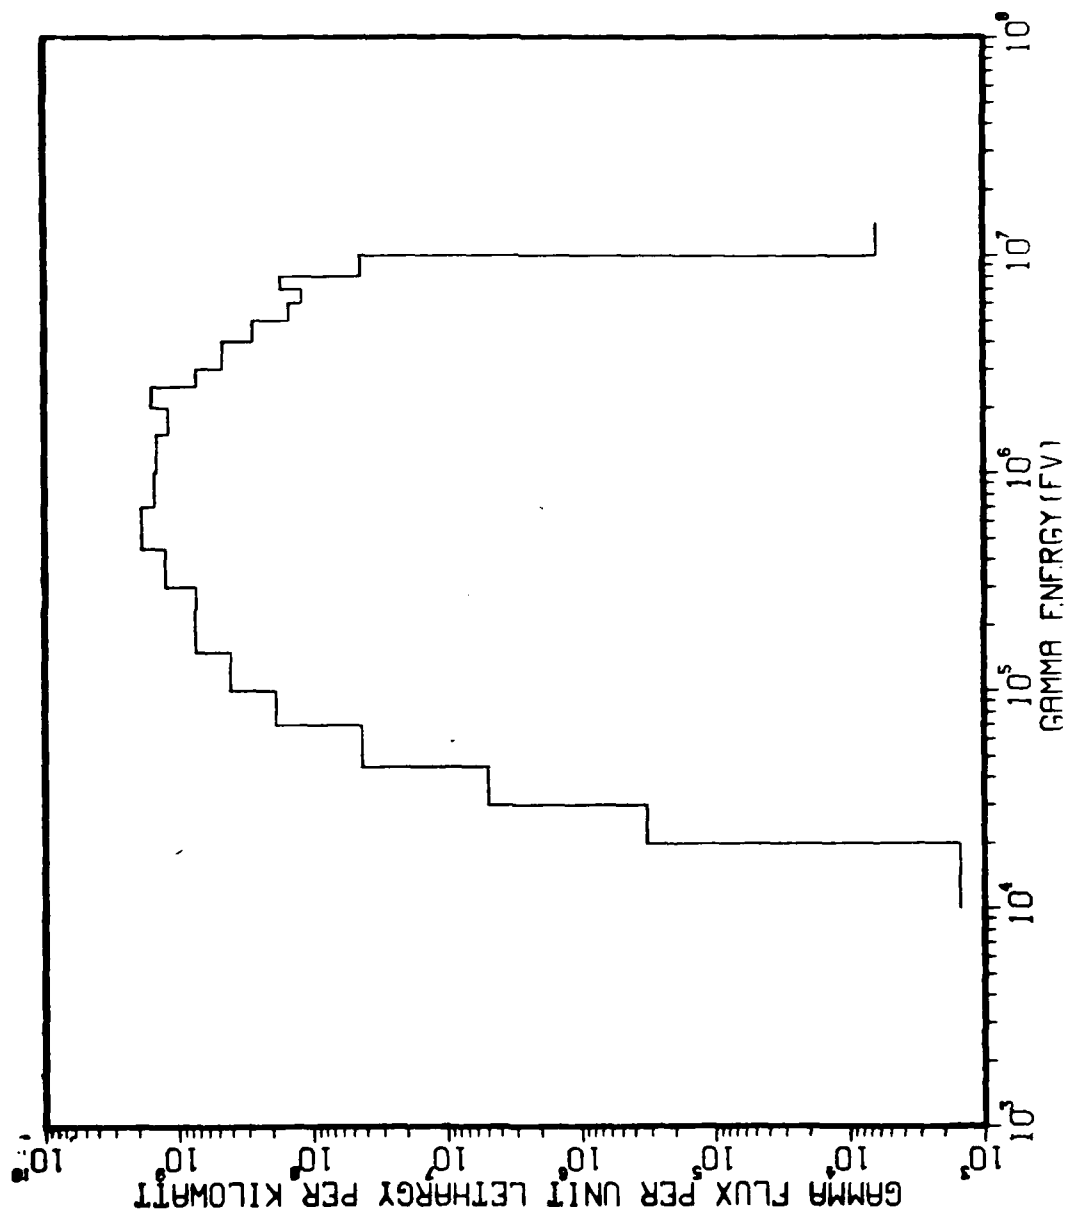


Figure II.6.8. Front Gamma Flux vs Energy Free Field ERI 50 CMS from Reactor.

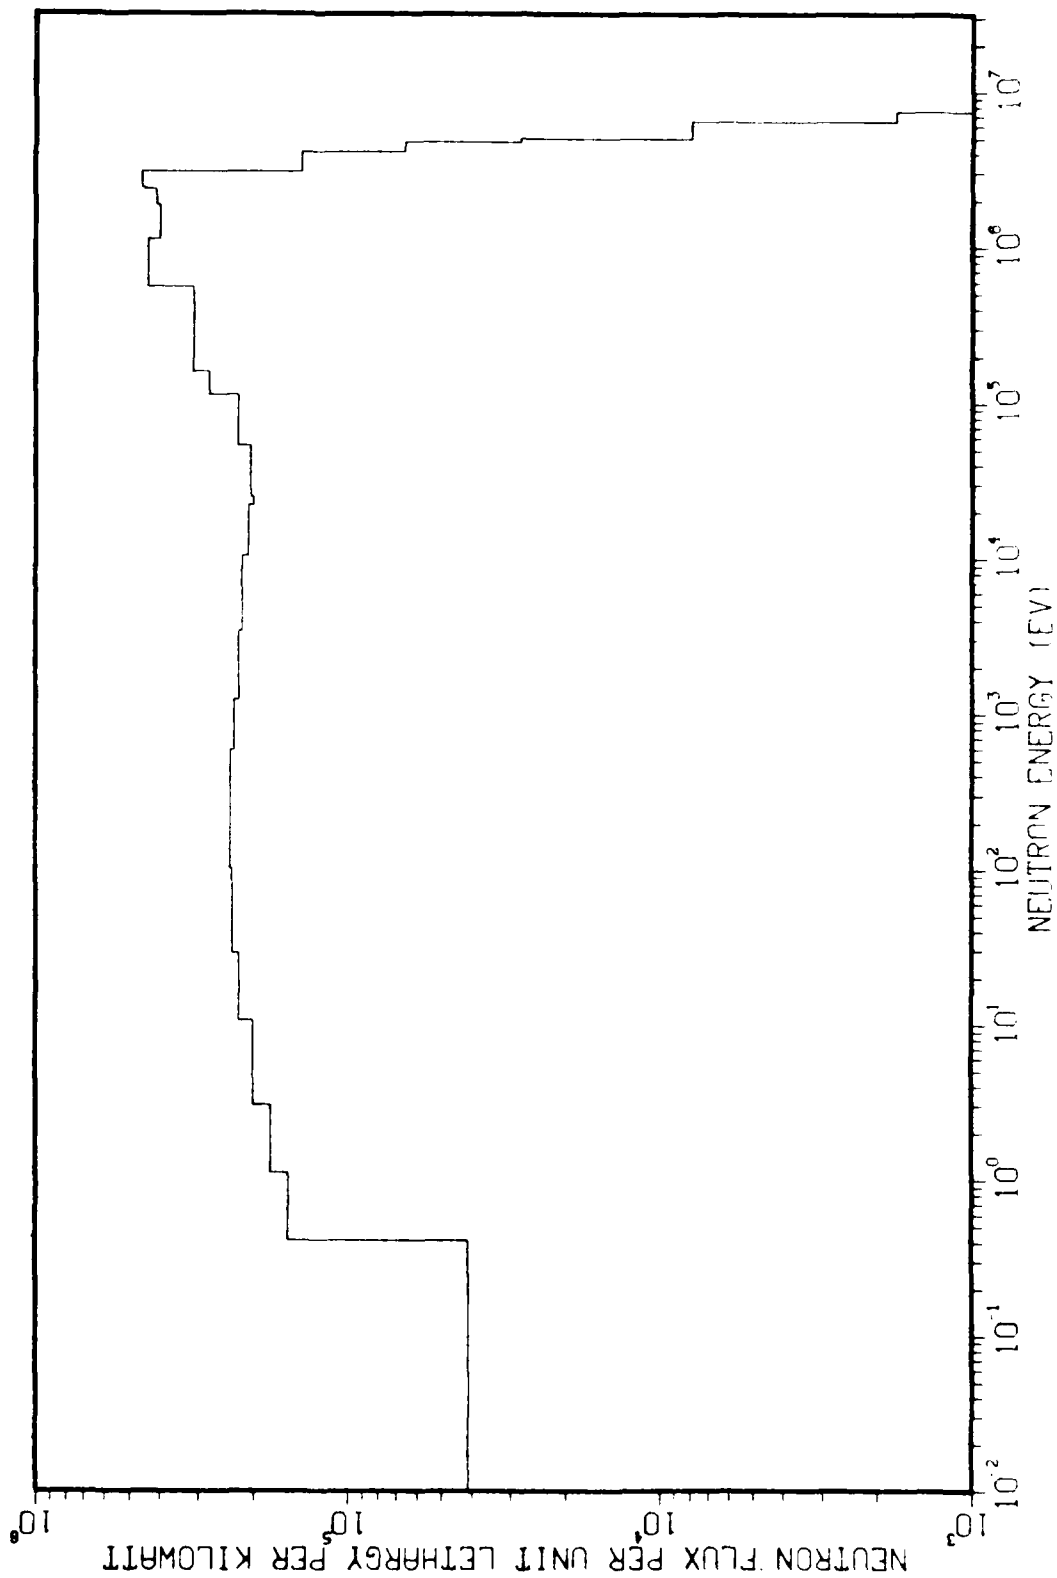


Figure II.6.9. Back Neutron Flux vs Energy Free Field ER1 50 CMS from Reactor.

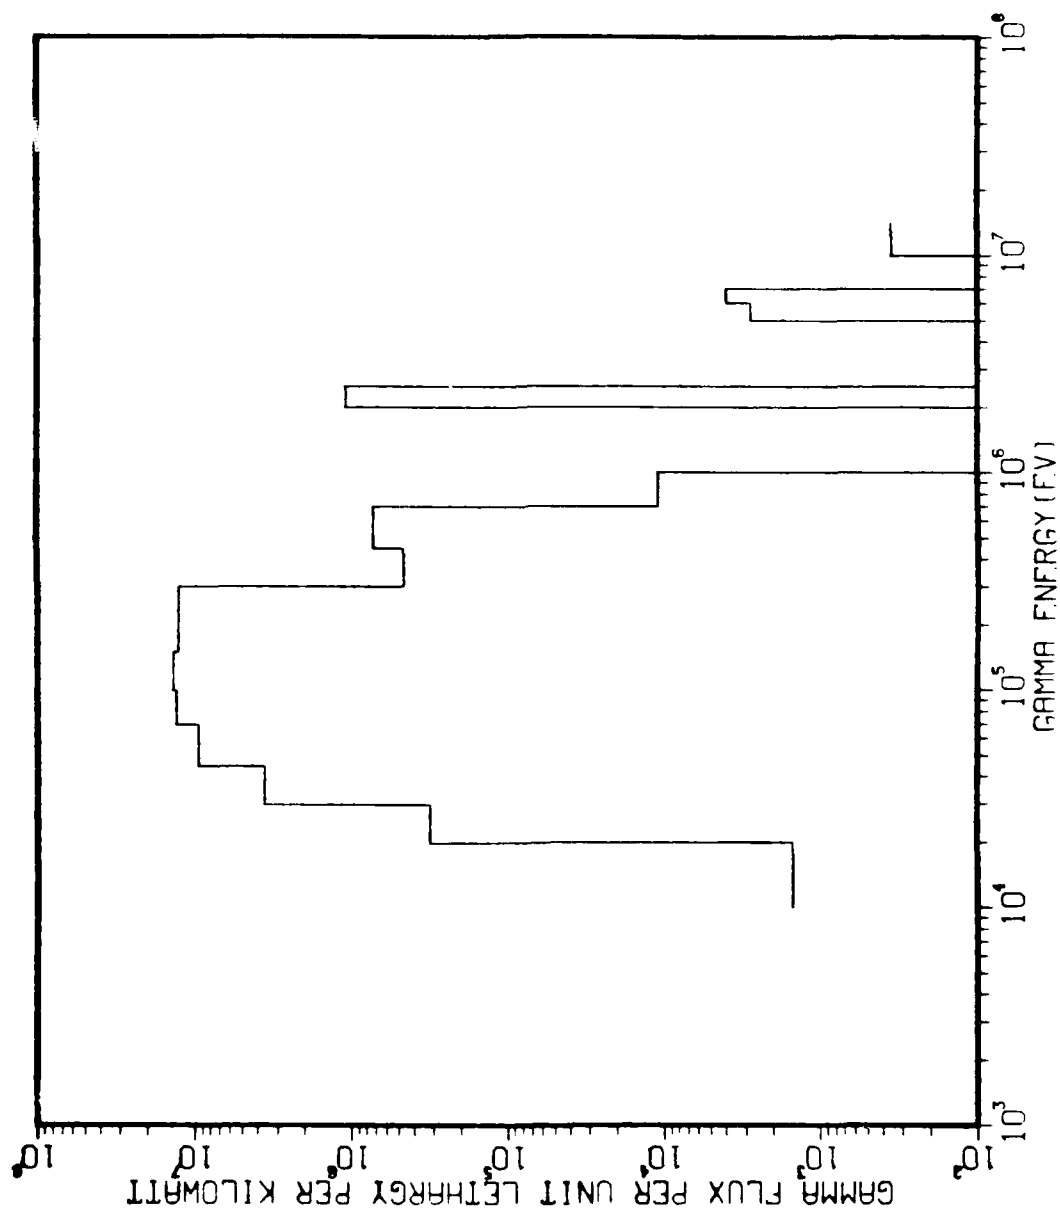


Figure II.6.10. Back Gamma Flux vs Energy Free Field ER1 50 CMS from Reactor.

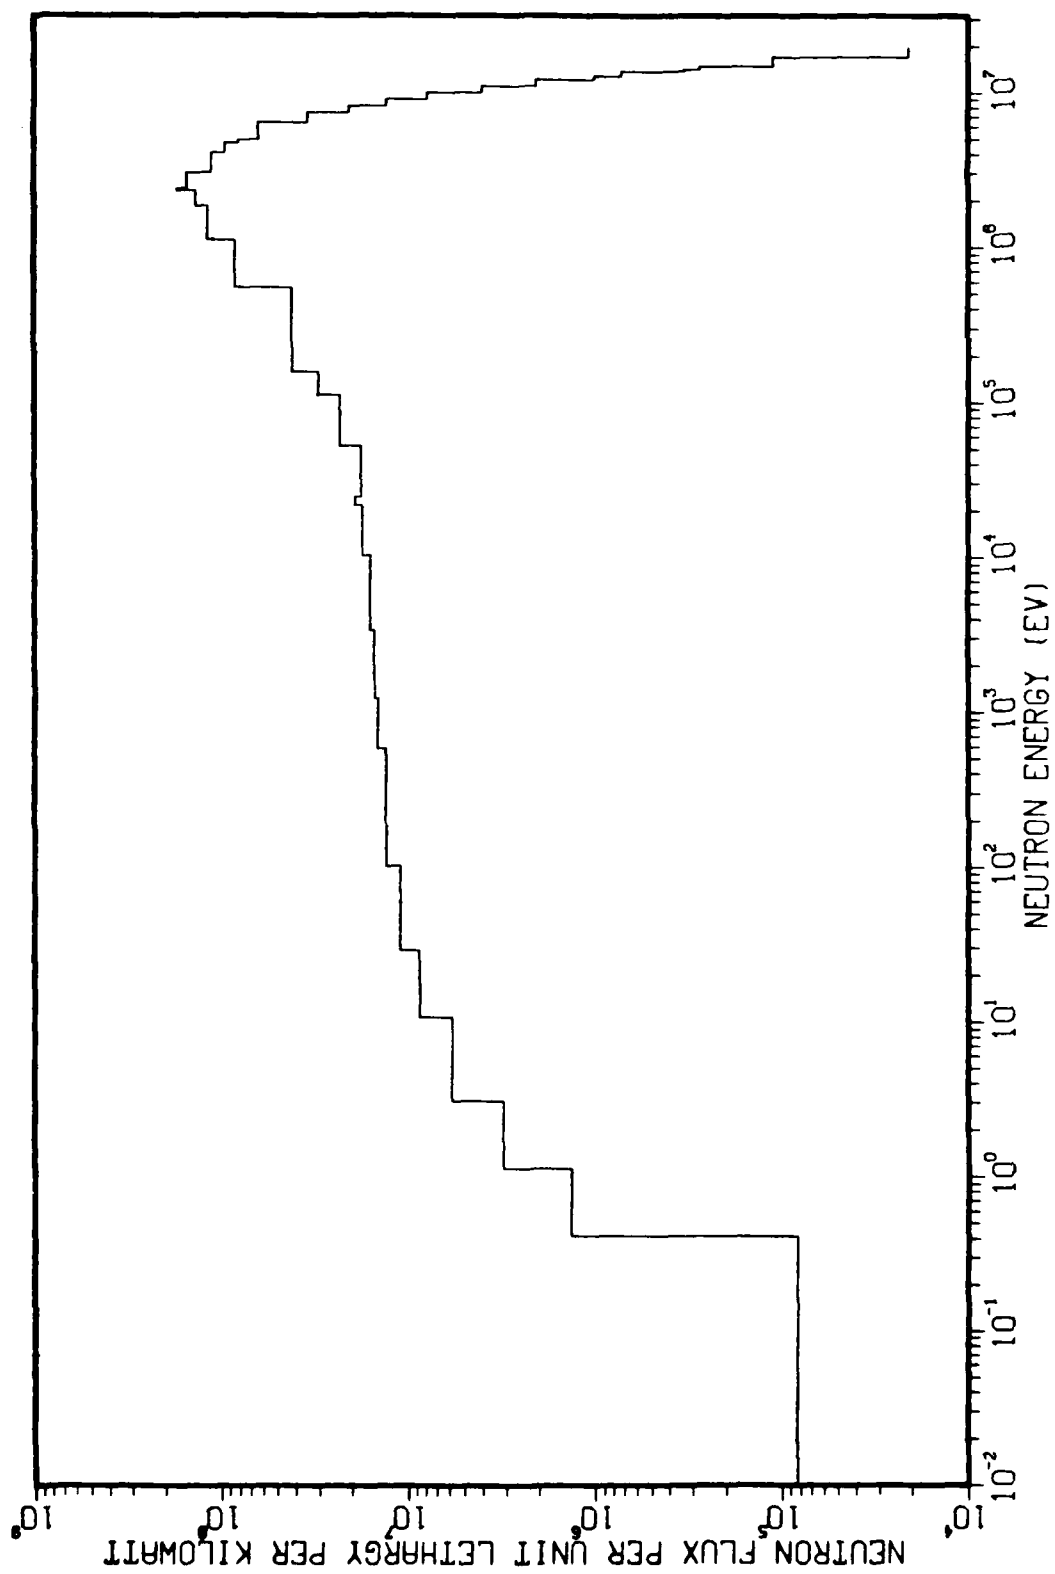


Figure II.6.11. Total Neutron Flux vs Energy Free Field ERI 50 CMS from Reactor.

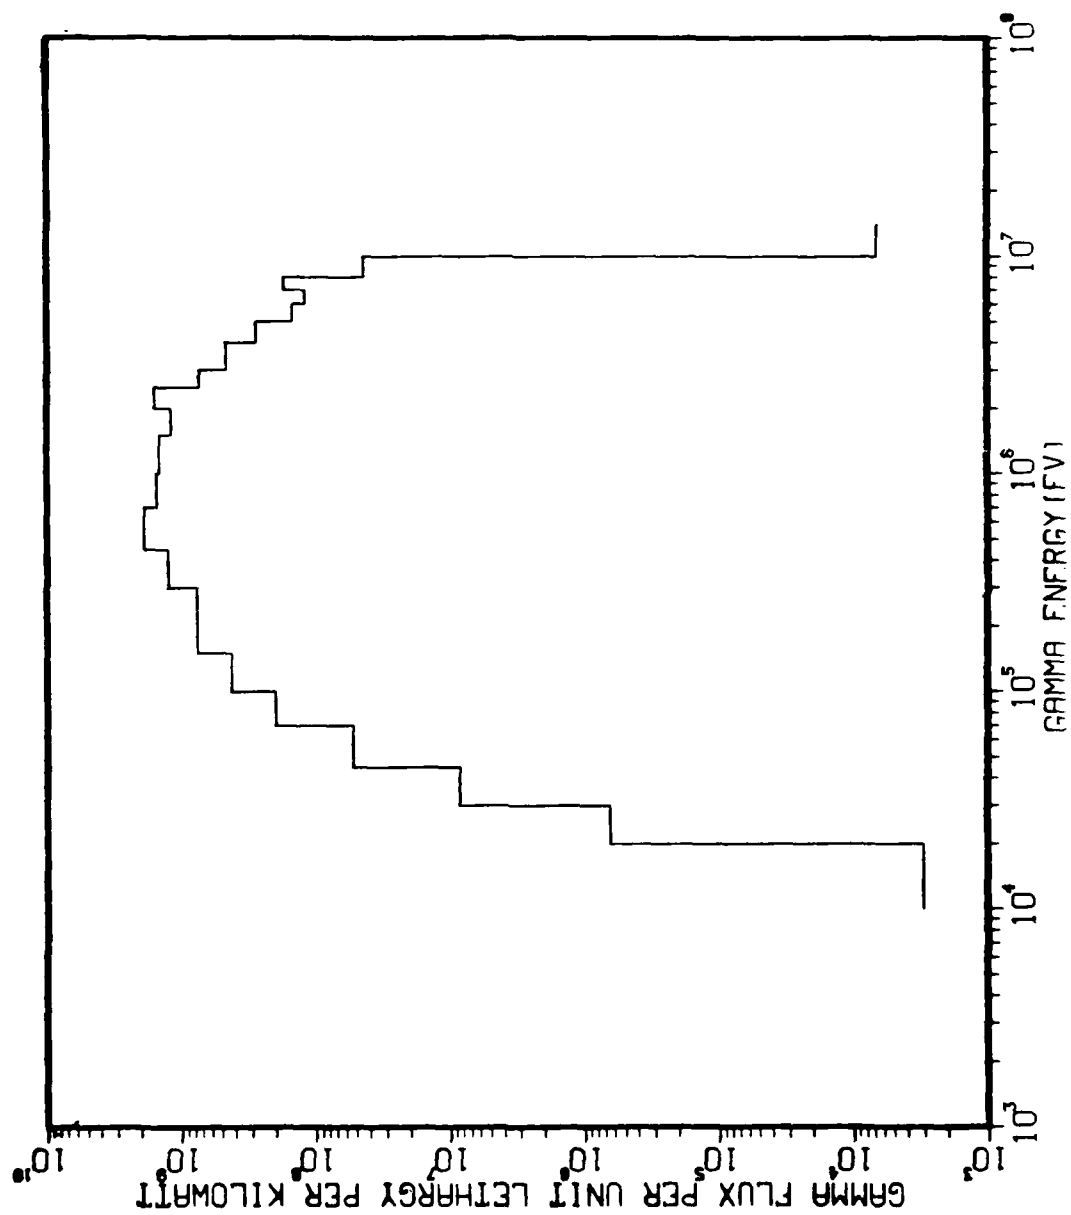


Figure II.6.12. Total Gamma Flux vs Energy Free Field ERI 50 CMS from Reactor.

Table II.6.1. Neutron Flux per Unit Lethargy per Kilowatt.

ERI FREE FIELD 50 CMS FROM REACTOR

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	2.10E+04	0.00E+00	2.10E+04
2	1.690E+07	1.12E+05	0.00E+00	1.12E+05
3	1.490E+07	2.77E+05	0.00E+00	2.77E+05
4	1.420E+07	3.33E+05	0.00E+00	3.33E+05
5	1.380E+07	7.32E+05	0.00E+00	7.32E+05
6	1.280E+07	1.02E+06	0.00E+00	1.02E+06
7	1.220E+07	2.08E+06	0.00E+00	2.08E+06
8	1.110E+07	4.03E+06	0.00E+00	4.03E+06
9	1.000E+07	7.85E+06	0.00E+00	7.85E+06
10	9.050E+06	1.30E+07	0.00E+00	1.30E+07
11	8.190E+06	2.08E+07	0.00E+00	2.08E+07
12	7.410E+06	3.44E+07	1.76E+03	3.44E+07
13	6.380E+06	6.30E+07	7.94E+03	6.30E+07
14	4.970E+06	8.06E+07	2.81E+04	8.06E+07
15	4.720E+06	9.47E+07	6.56E+04	9.47E+07
16	4.070E+06	1.12E+08	1.41E+05	1.12E+08
17	3.010E+06	1.51E+08	4.54E+05	1.51E+08
18	2.390E+06	1.70E+08	4.45E+05	1.71E+08
19	2.310E+06	1.35E+08	4.10E+05	1.36E+08
20	1.830E+06	1.17E+08	3.98E+05	1.18E+08
21	1.110E+06	8.40E+07	4.34E+05	8.45E+07
22	5.500E+05	4.16E+07	3.12E+05	4.19E+07
23	1.580E+05	3.02E+07	2.77E+05	3.04E+07
24	1.110E+05	2.30E+07	2.25E+05	2.33E+07
25	5.250E+04	1.76E+07	2.05E+05	1.78E+07
26	2.480E+04	1.90E+07	2.02E+05	1.92E+07
27	2.190E+04	1.75E+07	2.09E+05	1.77E+07
28	1.030E+04	1.58E+07	2.17E+05	1.61E+07
29	3.350E+03	1.49E+07	2.24E+05	1.52E+07
30	1.230E+03	1.44E+07	2.32E+05	1.46E+07
31	5.830E+02	1.30E+07	2.37E+05	1.32E+07
32	1.010E+02	1.08E+07	2.34E+05	1.11E+07
33	2.900E+01	8.52E+06	2.23E+05	8.74E+06
34	1.070E+01	5.65E+06	2.01E+05	5.85E+06
35	3.060E+00	2.96E+06	1.77E+05	3.13E+06
36	1.130E+00	1.19E+06	1.53E+05	1.35E+06
37	4.140E-01	4.25E+04	4.10E+04	8.35E+04

Table II.6.2. Gamma Flux per Unit Lethargy per Kilowatt.

ERI FREE FIELD 60 CMS FROM REACTOR

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.400E+07	6.81E+03	8.53E+02	6.66E+03
2	1.000E+07	4.42E+07	0.00E+00	4.42E+07
3	8.000E+06	1.74E+08	0.00E+00	1.74E+08
4	7.000E+06	1.22E+08	4.02E+03	1.22E+08
5	6.000E+06	1.50E+08	2.79E+03	1.50E+08
6	5.000E+06	2.81E+08	0.00E+00	2.81E+08
7	4.000E+06	4.69E+08	0.00E+00	4.69E+08
8	3.000E+06	7.49E+08	0.00E+00	7.49E+08
9	2.500E+06	1.59E+09	1.08E+06	1.59E+09
10	2.000E+06	1.21E+09	0.00E+00	1.21E+09
11	1.500E+06	1.46E+09	0.00E+00	1.46E+09
12	1.000E+06	1.54E+09	1.09E+04	1.54E+09
13	7.000E+05	1.89E+09	7.23E+05	1.89E+09
14	4.500E+05	1.27E+09	4.69E+05	1.27E+09
15	3.000E+05	7.56E+08	1.27E+07	7.68E+08
16	1.500E+05	4.11E+08	1.35E+07	4.25E+08
17	1.000E+05	1.88E+08	1.30E+07	2.01E+08
18	7.000E+04	4.35E+07	9.45E+06	5.30E+07
19	4.500E+04	4.96E+06	3.57E+06	8.54E+06
20	3.000E+04	3.26E+05	8.14E+05	6.40E+05
21	2.000E+04	1.51E+03	1.51E+03	3.02E+03

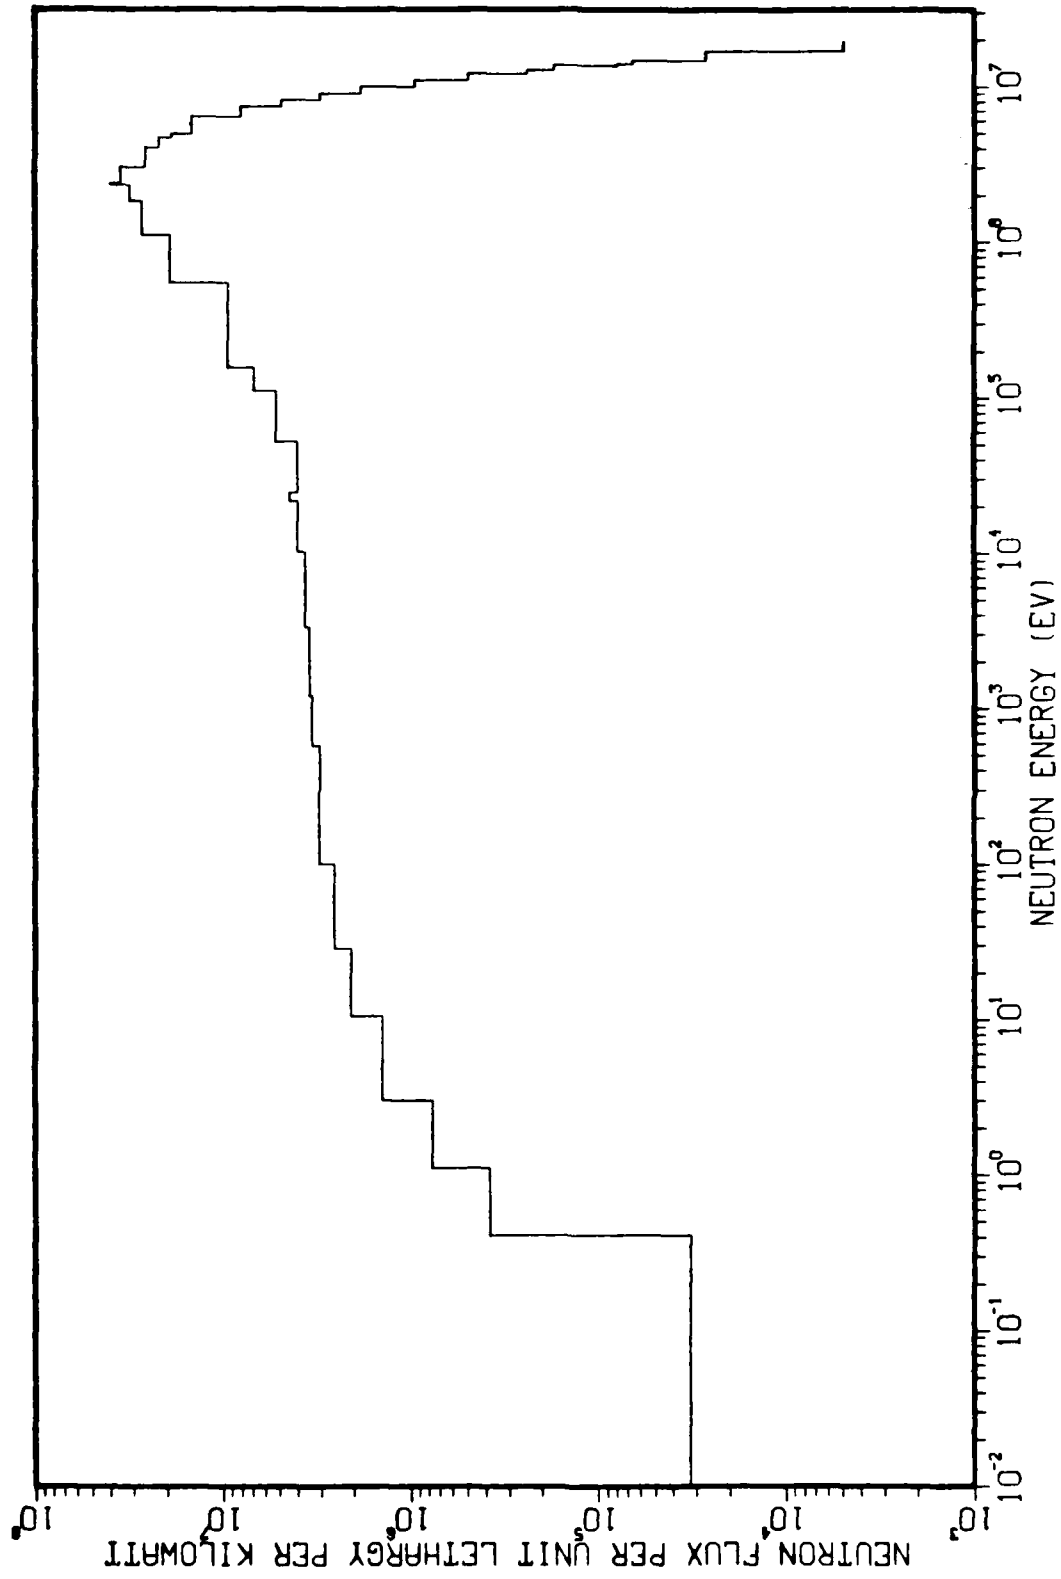


Figure II.6.13. Front Neutron Flux vs Energy Free Field ERI 100 CMS from Reactor.

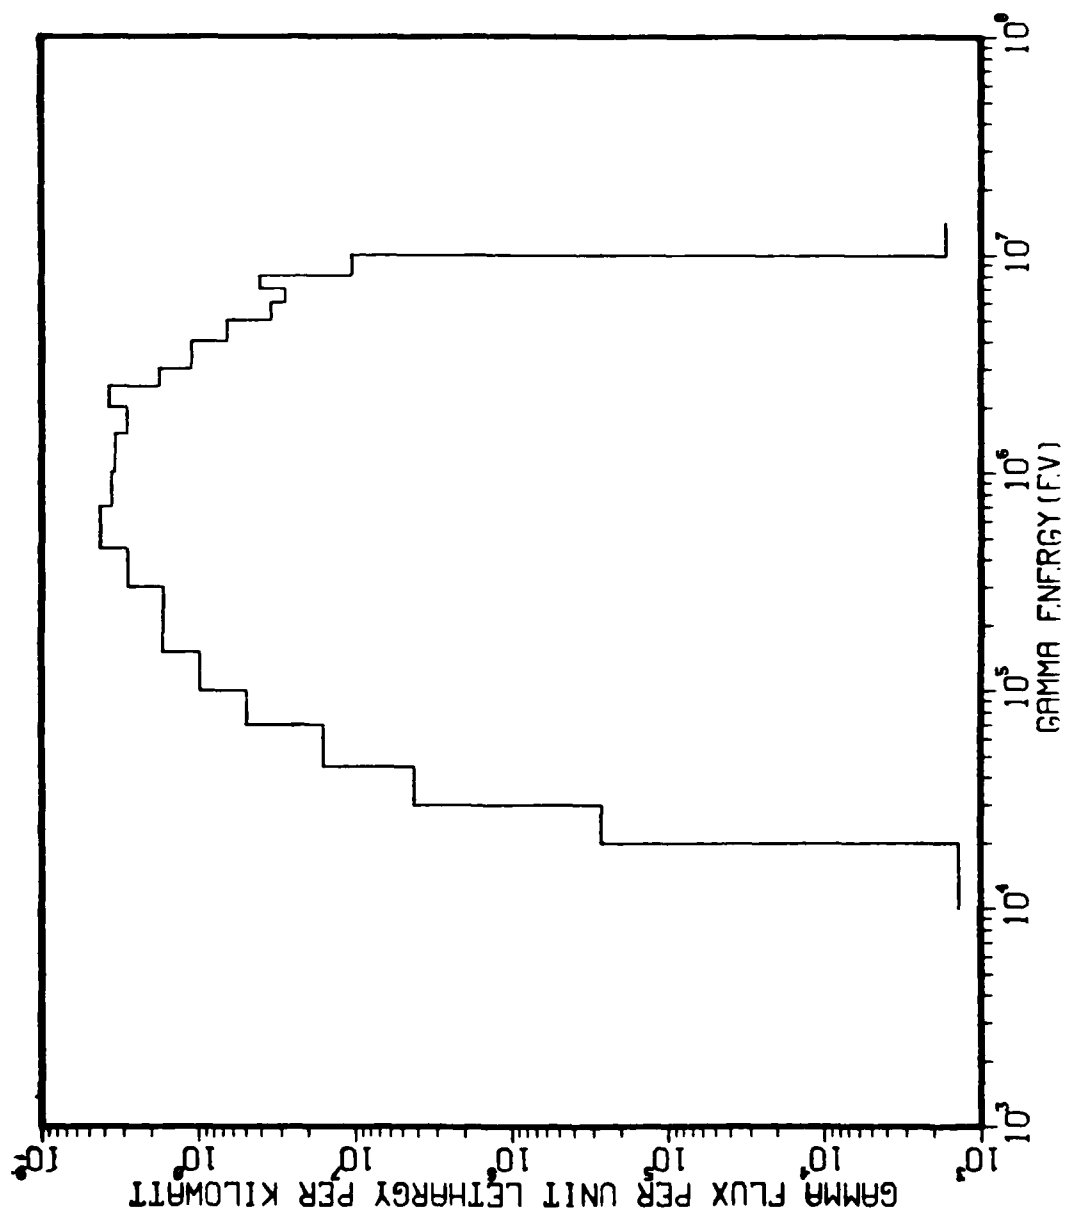


Figure II.6.14. Front Gamma Flux vs Energy Free Field ER1 100 CMS from Reactor.

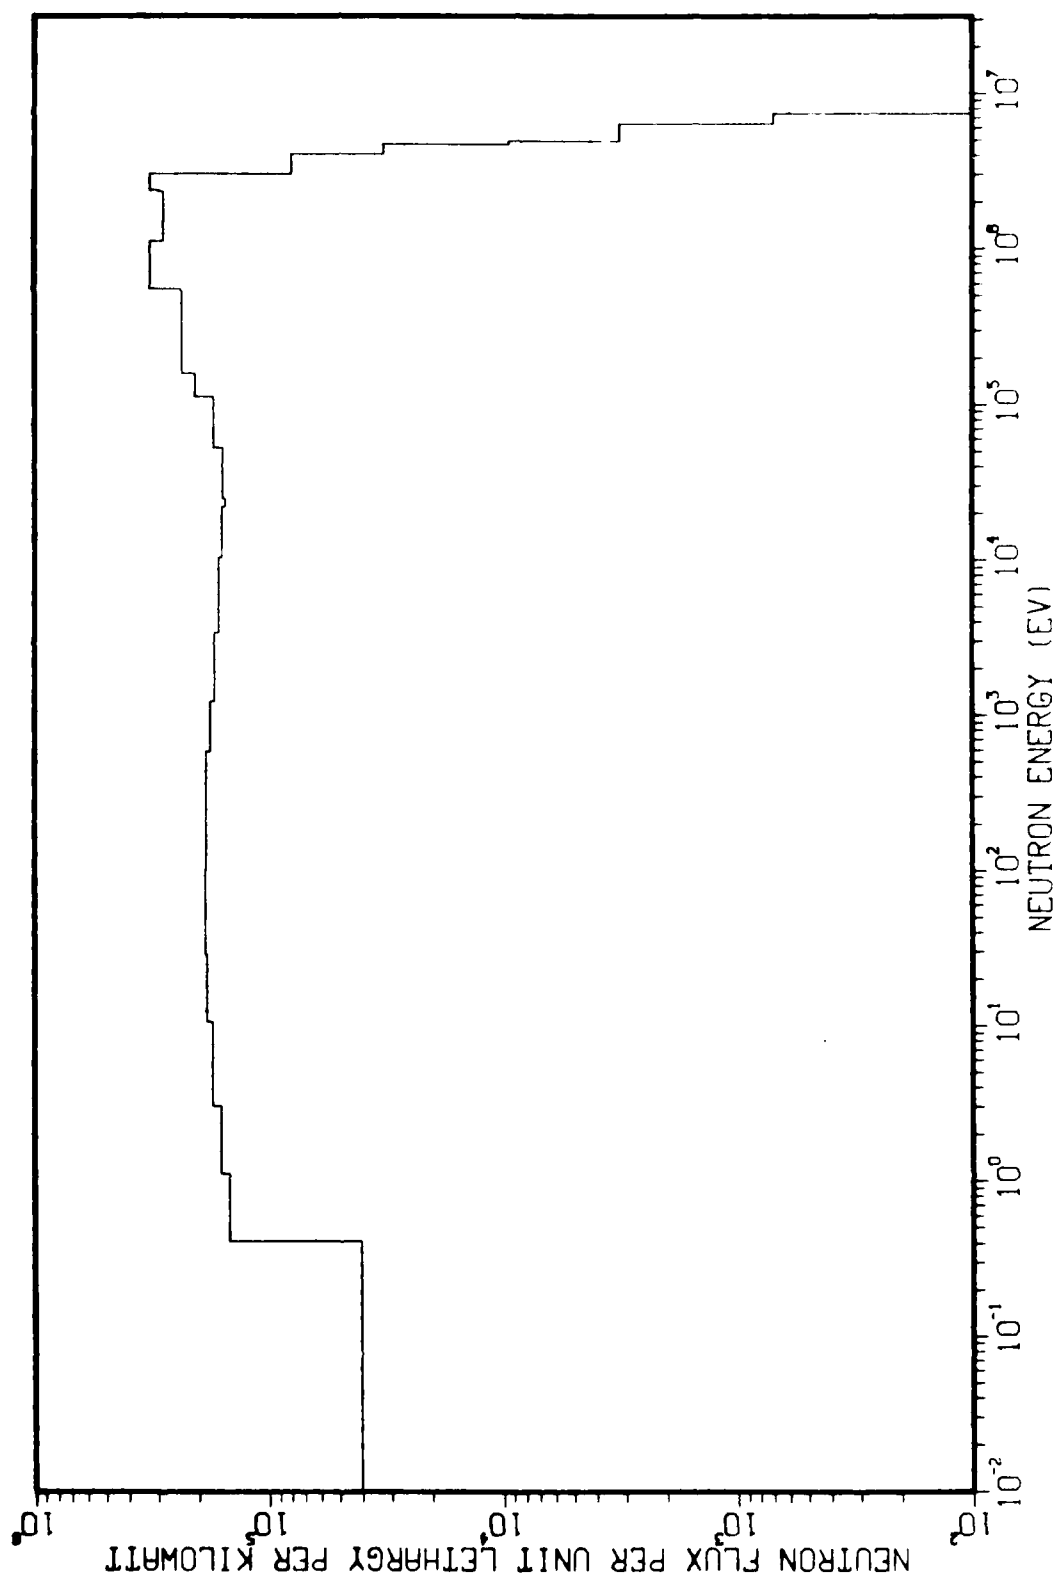


Figure 11.6.15. Back Neutron Flux vs Energy Free Field ERI 100 CMS from Reactor.

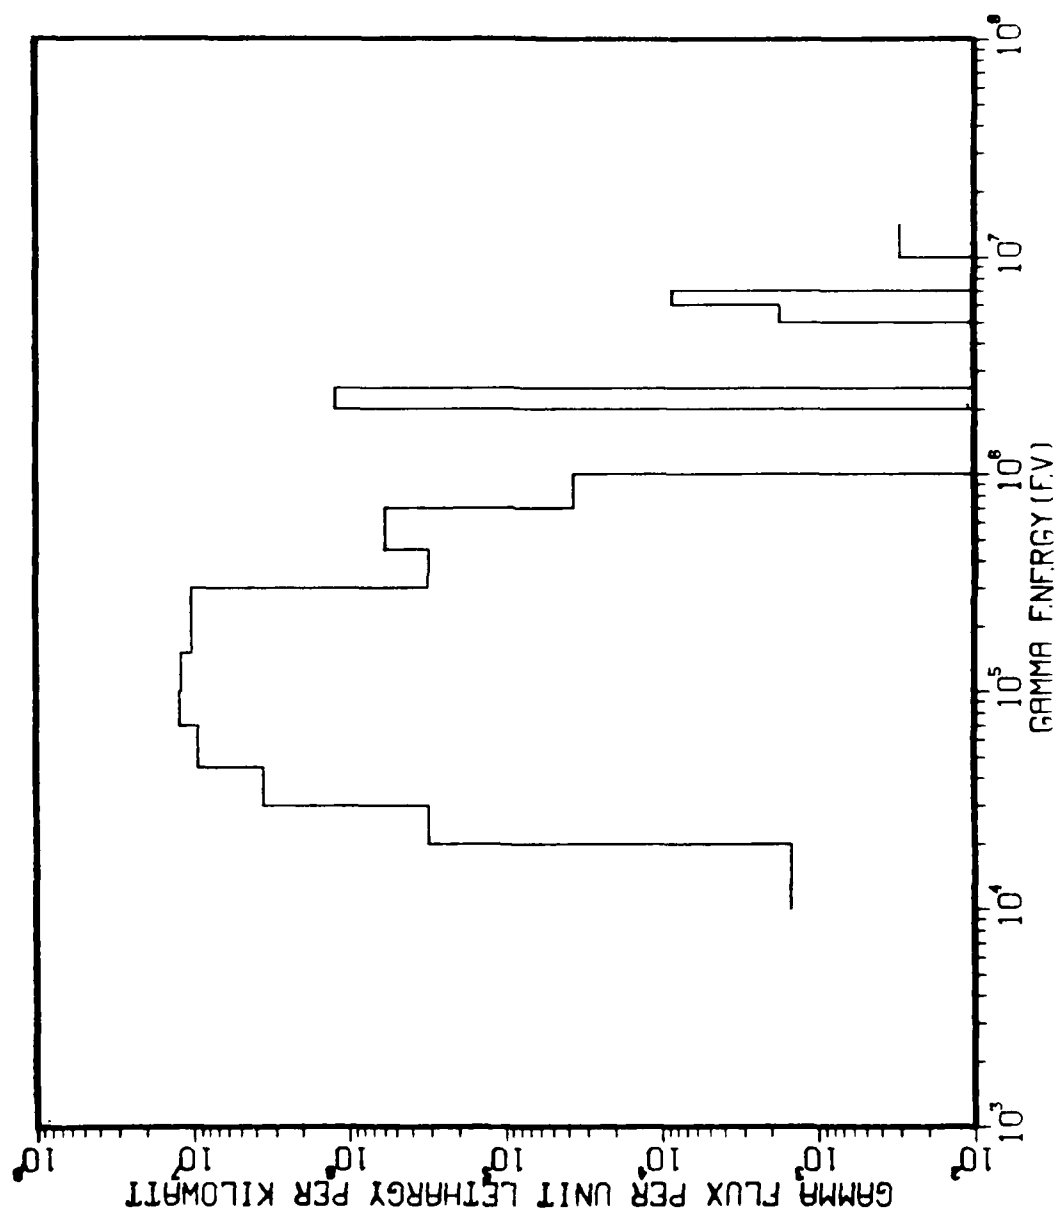


Figure II.6.16. Back Gamma Flux vs Energy Free Field ERI 100 CMS from Reactor.

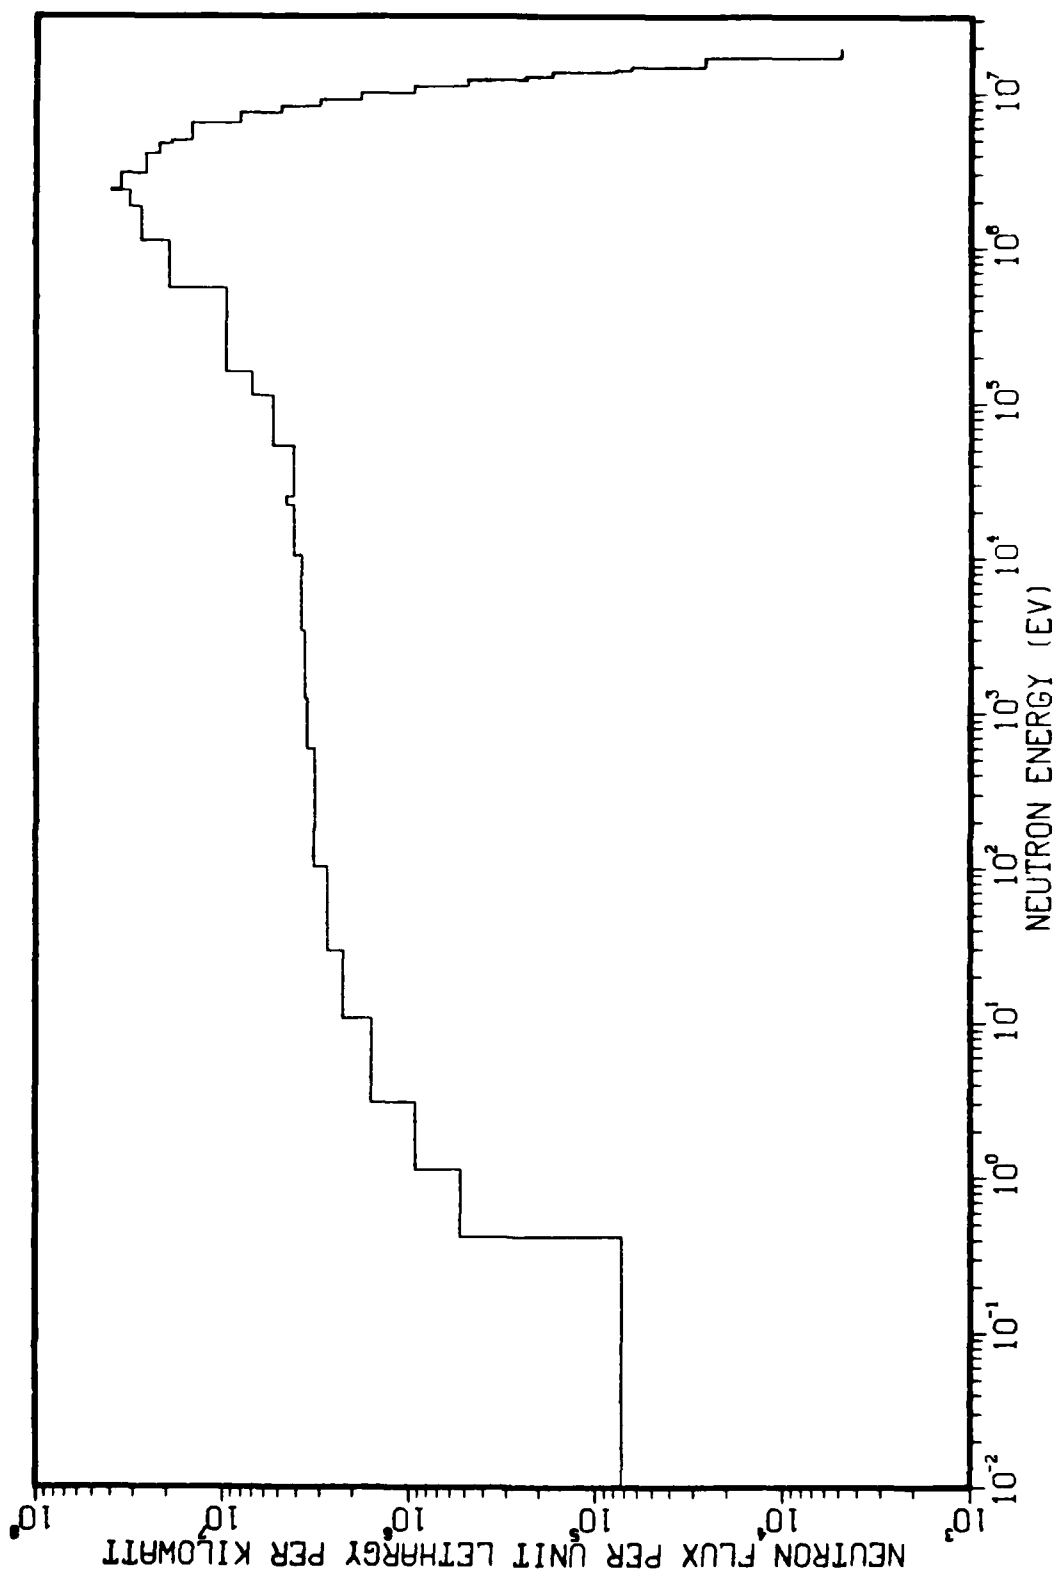


Figure II.6.17. Total Neutron Flux vs Energy Free Field ER1 100 CMS from Reactor.

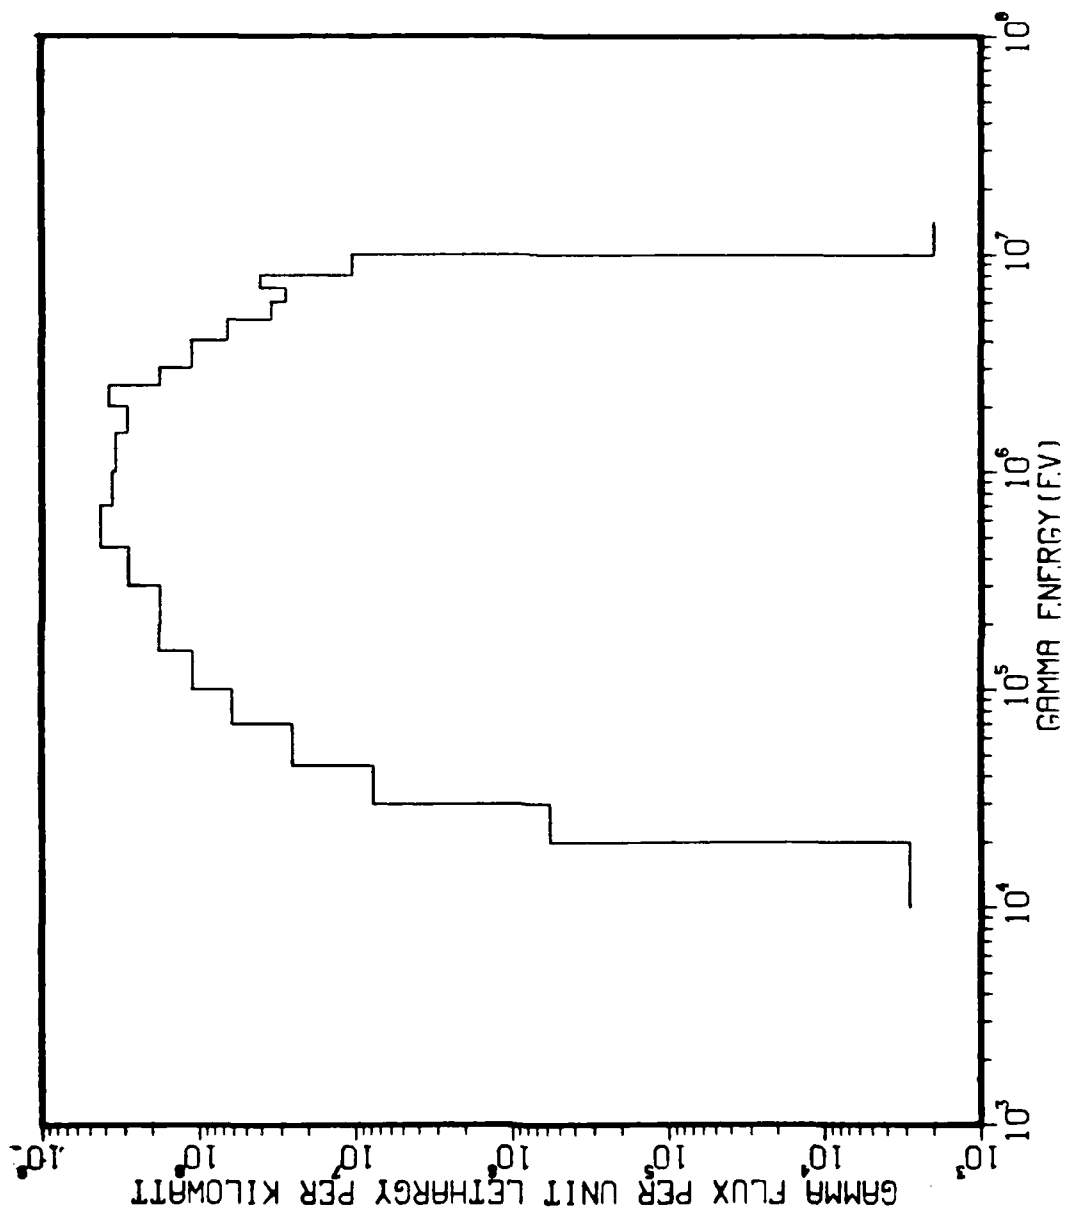


Figure 11.6.18. Total Gamma Flux vs Energy Free Field ERT 100 CMS from Reactor.

Table II.6.3. Neutron Flux per Unit Lethargy per Kilowatt.

ERI FREE FIELD 100 CMS FROM REACTOR

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	4.97E+03	0.00E+00	4.97E+03
2	1.690E+07	2.66E+04	0.00E+00	2.66E+04
3	1.490E+07	6.56E+04	0.00E+00	6.56E+04
4	1.420E+07	7.91E+04	0.00E+00	7.91E+04
5	1.380E+07	1.74E+05	0.00E+00	1.74E+05
6	1.280E+07	2.41E+05	0.00E+00	2.41E+05
7	1.220E+07	4.93E+05	0.00E+00	4.93E+05
8	1.110E+07	9.53E+05	0.00E+00	9.53E+05
9	1.000E+07	1.86E+06	0.00E+00	1.86E+06
10	9.050E+06	3.07E+06	0.00E+00	3.07E+06
11	8.190E+06	4.91E+06	0.00E+00	4.91E+06
12	7.410E+06	8.13E+06	7.06E+02	8.13E+06
13	6.380E+06	1.48E+07	3.20E+03	1.48E+07
14	4.970E+06	1.89E+07	9.47E+03	1.89E+07
15	4.720E+06	2.22E+07	3.23E+04	2.22E+07
16	4.070E+06	2.61E+07	8.05E+04	2.62E+07
17	3.010E+06	3.52E+07	3.21E+05	3.56E+07
18	2.390E+06	3.97E+07	2.98E+05	4.00E+07
19	2.310E+06	3.15E+07	2.83E+05	3.18E+07
20	1.830E+06	2.71E+07	2.82E+05	2.74E+07
21	1.110E+06	1.93E+07	3.23E+05	1.96E+07
22	5.500E+05	9.52E+06	2.35E+05	9.75E+06
23	1.580E+05	6.87E+06	2.06E+05	7.08E+06
24	1.110E+05	5.27E+06	1.72E+05	5.44E+06
25	5.250E+04	4.05E+06	1.57E+05	4.21E+06
26	2.480E+04	4.48E+06	1.54E+05	4.63E+06
27	2.190E+04	4.05E+06	1.58E+05	4.20E+06
28	1.030E+04	3.69E+06	1.64E+05	3.85E+06
29	3.350E+03	3.50E+06	1.71E+05	3.67E+06
30	1.230E+03	3.38E+06	1.79E+05	3.56E+06
31	5.830E+02	3.09E+06	1.85E+05	3.27E+06
32	1.010E+02	2.58E+06	1.87E+05	2.77E+06
33	2.900E+01	2.09E+06	1.85E+05	2.27E+06
34	1.070E+01	1.44E+06	1.74E+05	1.61E+06
35	3.060E+00	7.69E+05	1.60E+05	9.29E+05
36	1.130E+00	3.82E+05	1.48E+05	5.30E+05
37	4.140E-01	3.24E+04	4.05E+04	7.29E+04

Table II.6.4. Gamma Flux per Unit Lethargy per Kilowatt.

ERI FREE FIELD 100 CMS FROM REACTOR				
GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.400E+07	1.68E+03	3.01E+02	1.98E+03
2	1.000E+07	1.05E+07	0.00E+00	1.05E+07
3	8.000E+06	4.07E+07	0.00E+00	4.07E+07
4	7.000E+06	2.81E+07	8.57E+03	2.81E+07
5	6.000E+06	3.48E+07	1.75E+03	3.48E+07
6	5.000E+06	6.61E+07	0.00E+00	6.61E+07
7	4.000E+06	1.11E+08	0.00E+00	1.11E+08
8	3.000E+06	1.77E+08	0.00E+00	1.77E+08
9	2.500E+06	3.73E+08	1.22E+06	3.74E+08
10	2.000E+06	2.85E+08	0.00E+00	2.85E+08
11	1.500E+06	3.41E+08	0.00E+00	3.41E+08
12	1.000E+06	3.58E+08	3.67E+04	3.58E+08
13	7.000E+05	4.24E+08	5.95E+05	4.25E+08
14	4.500E+05	2.84E+08	3.12E+05	2.84E+08
15	3.000E+05	1.69E+08	1.02E+07	1.79E+08
16	1.500E+05	9.78E+07	1.19E+07	1.10E+08
17	1.000E+05	4.93E+07	1.21E+07	6.14E+07
18	7.000E+04	1.60E+07	9.24E+06	2.52E+07
19	4.500E+04	4.22E+06	3.54E+06	7.76E+06
20	3.000E+04	2.68E+05	3.12E+05	5.79E+05
21	2.000E+04	1.38E+03	1.49E+03	2.87E+03

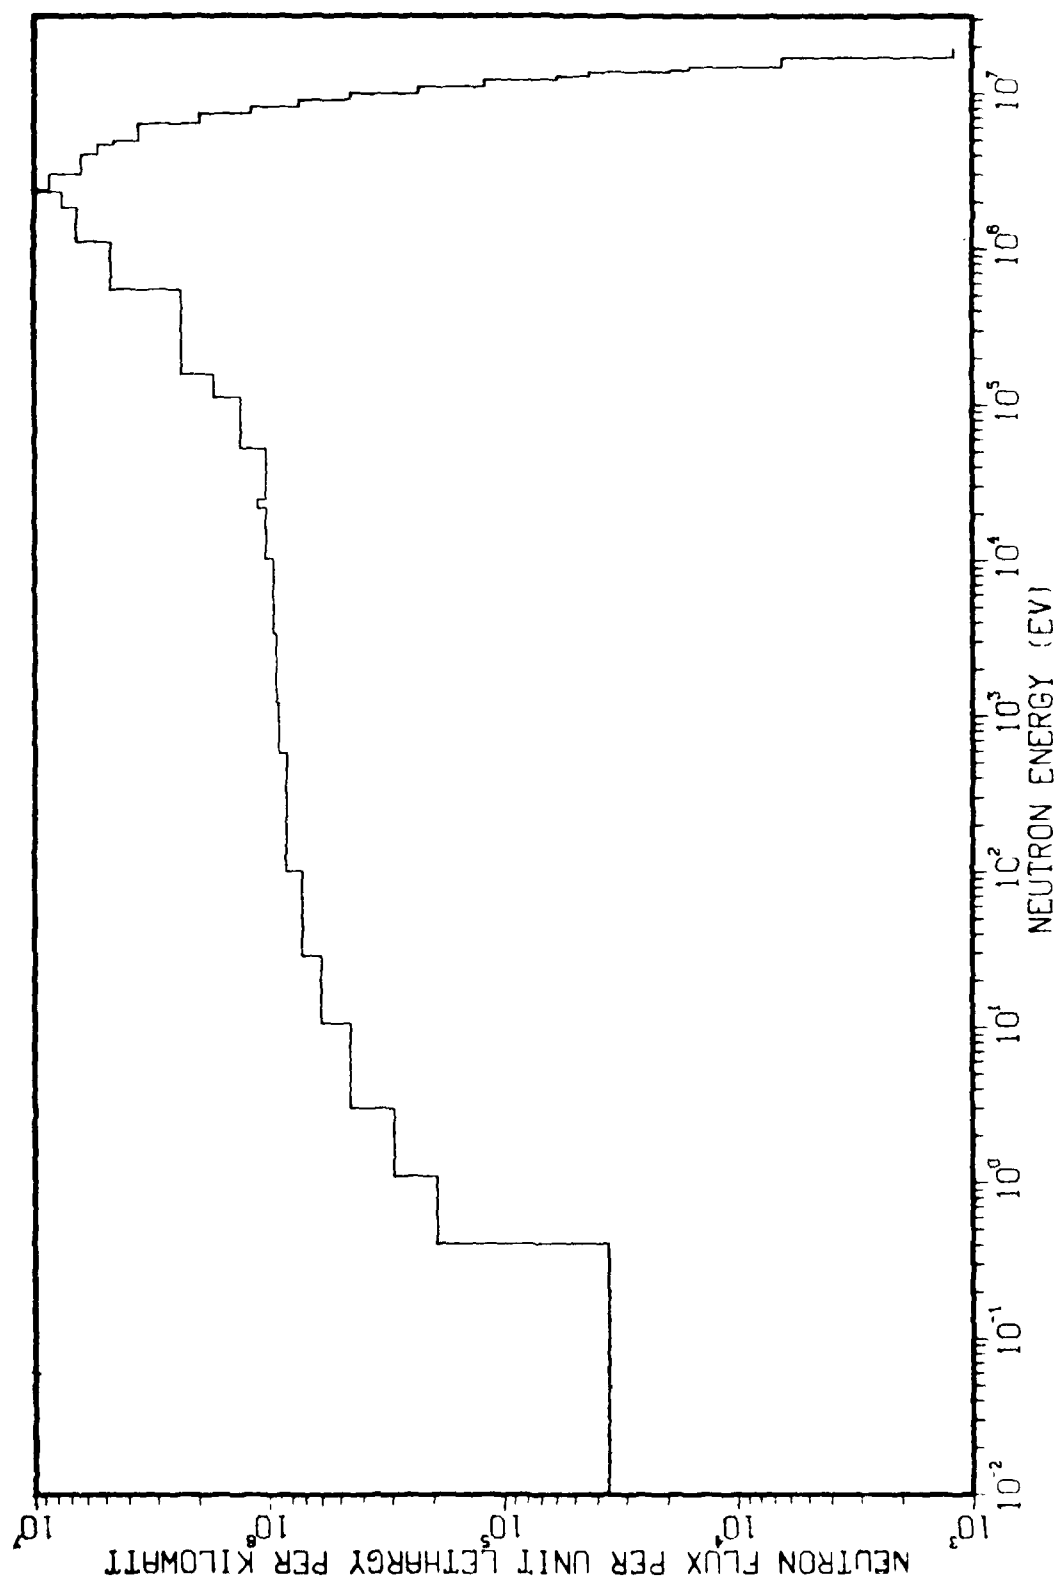


Figure II.6.19. Front Neutron Flux vs Energy Free Field ERI 200 CMS from Reactor.

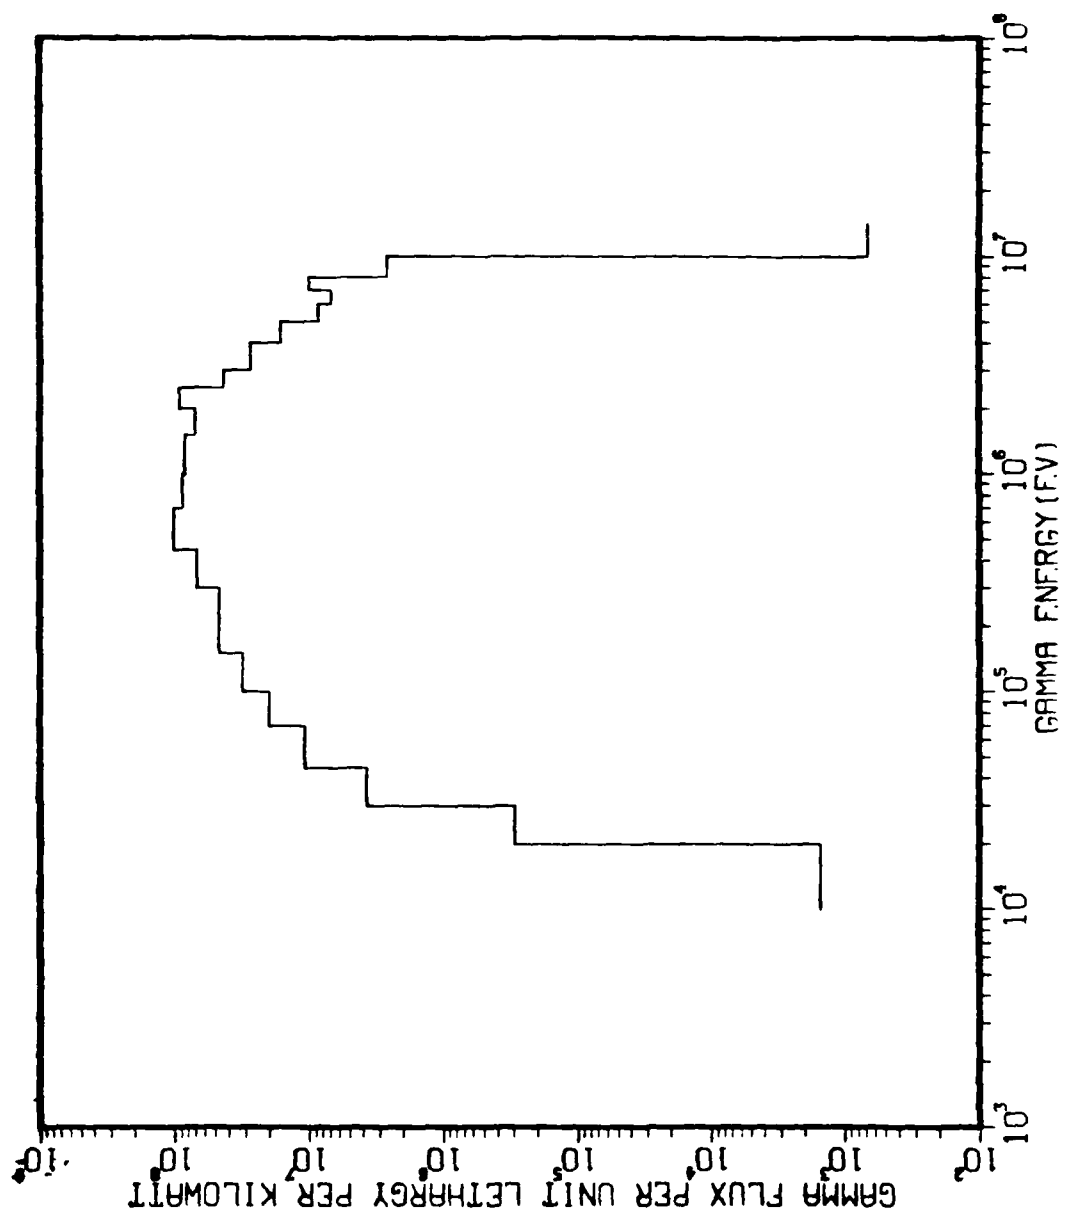


Figure II.6.20. Front Gamma Flux vs Energy Free Field ERI 200 CMS from Reactor.

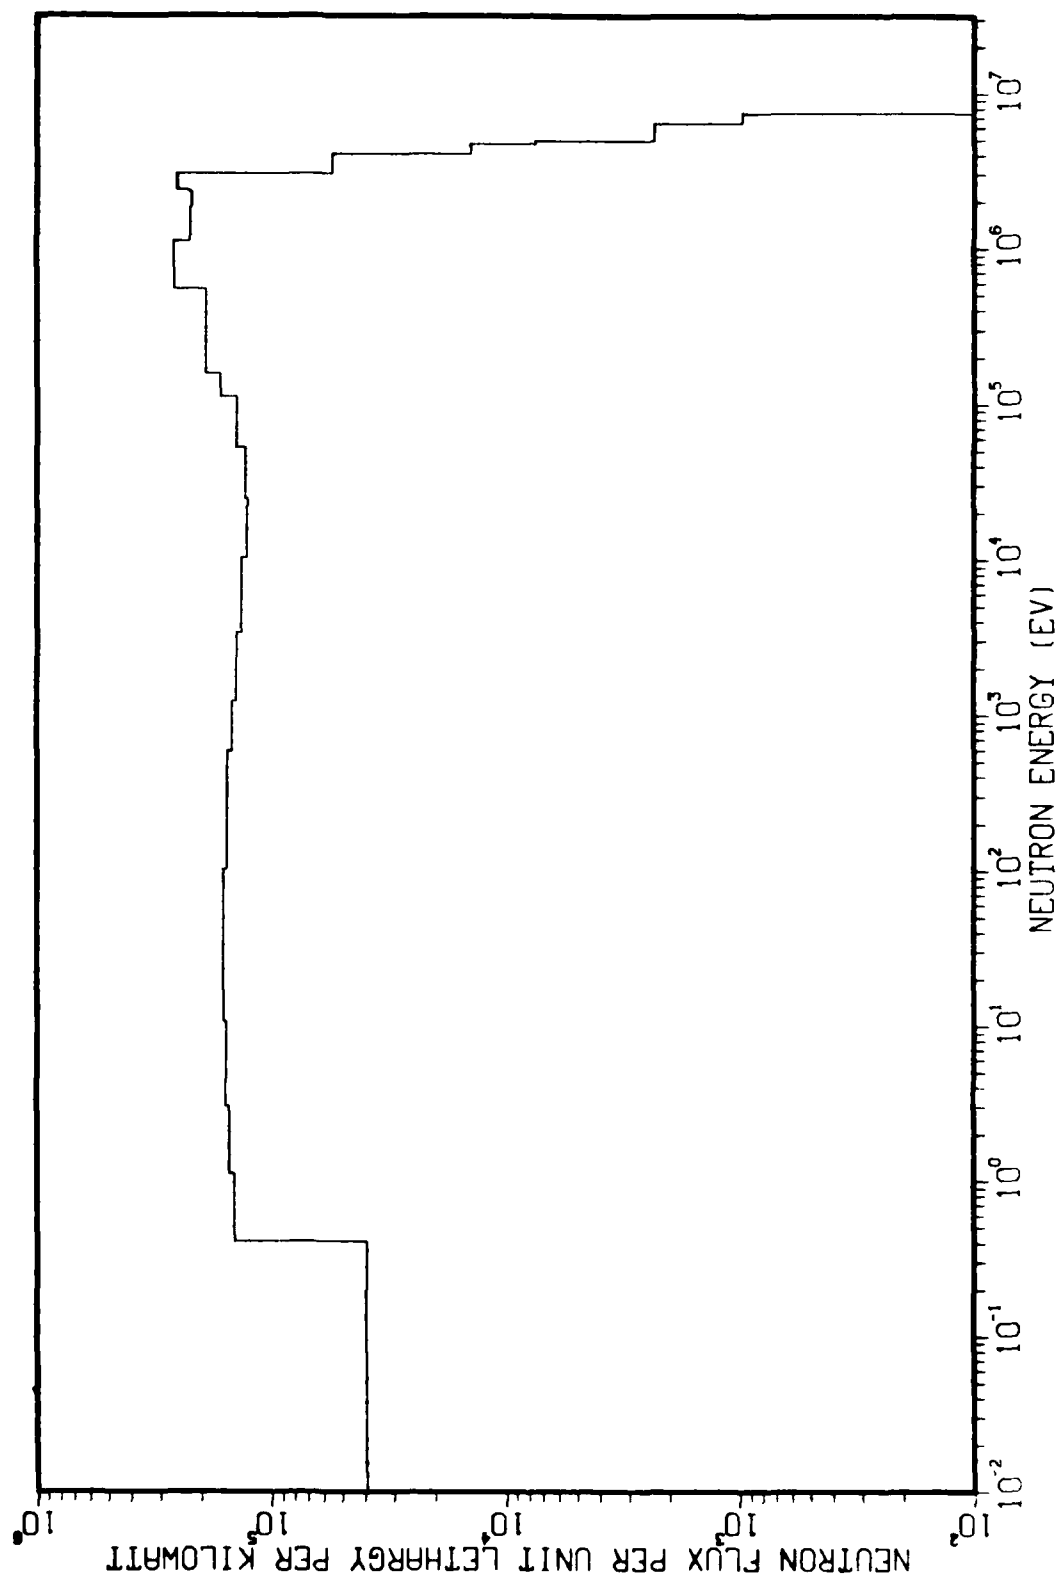


Figure II.6.21. Back Neutron Flux vs Energy Free Field ER1 200 CMS from Reactor.

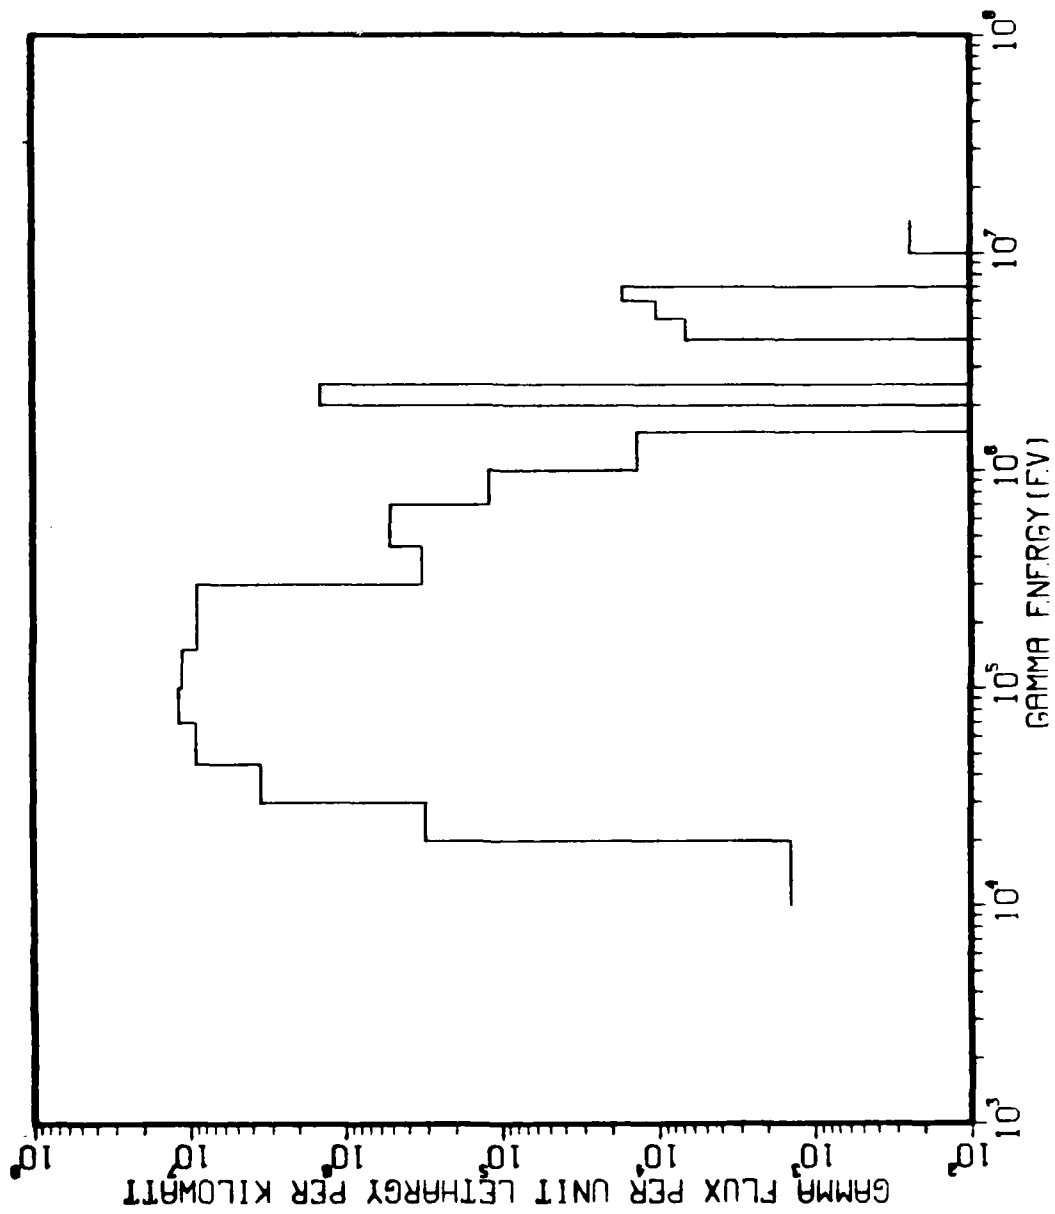


Figure 11.6.22. Back Gamma Flux vs Energy Free Field ERI 200 CMS from Reactor.

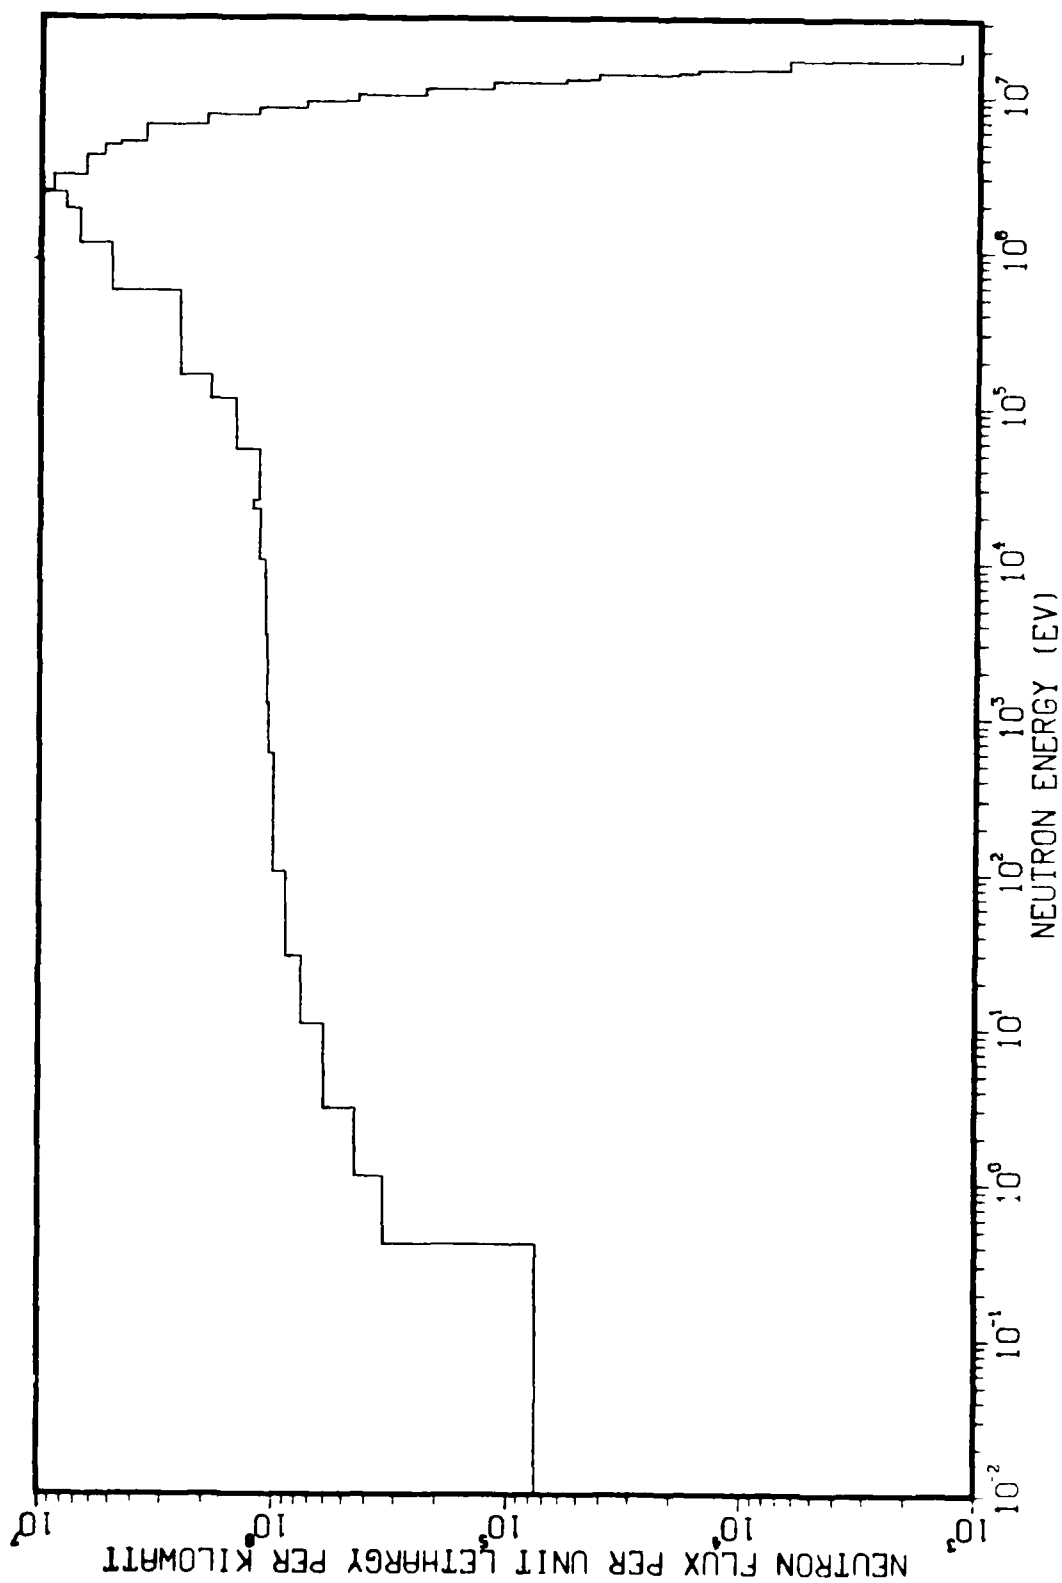


Figure II.6.23. Total Neutron Flux vs Energy Free Field ER1 200 CMS from Reactor.

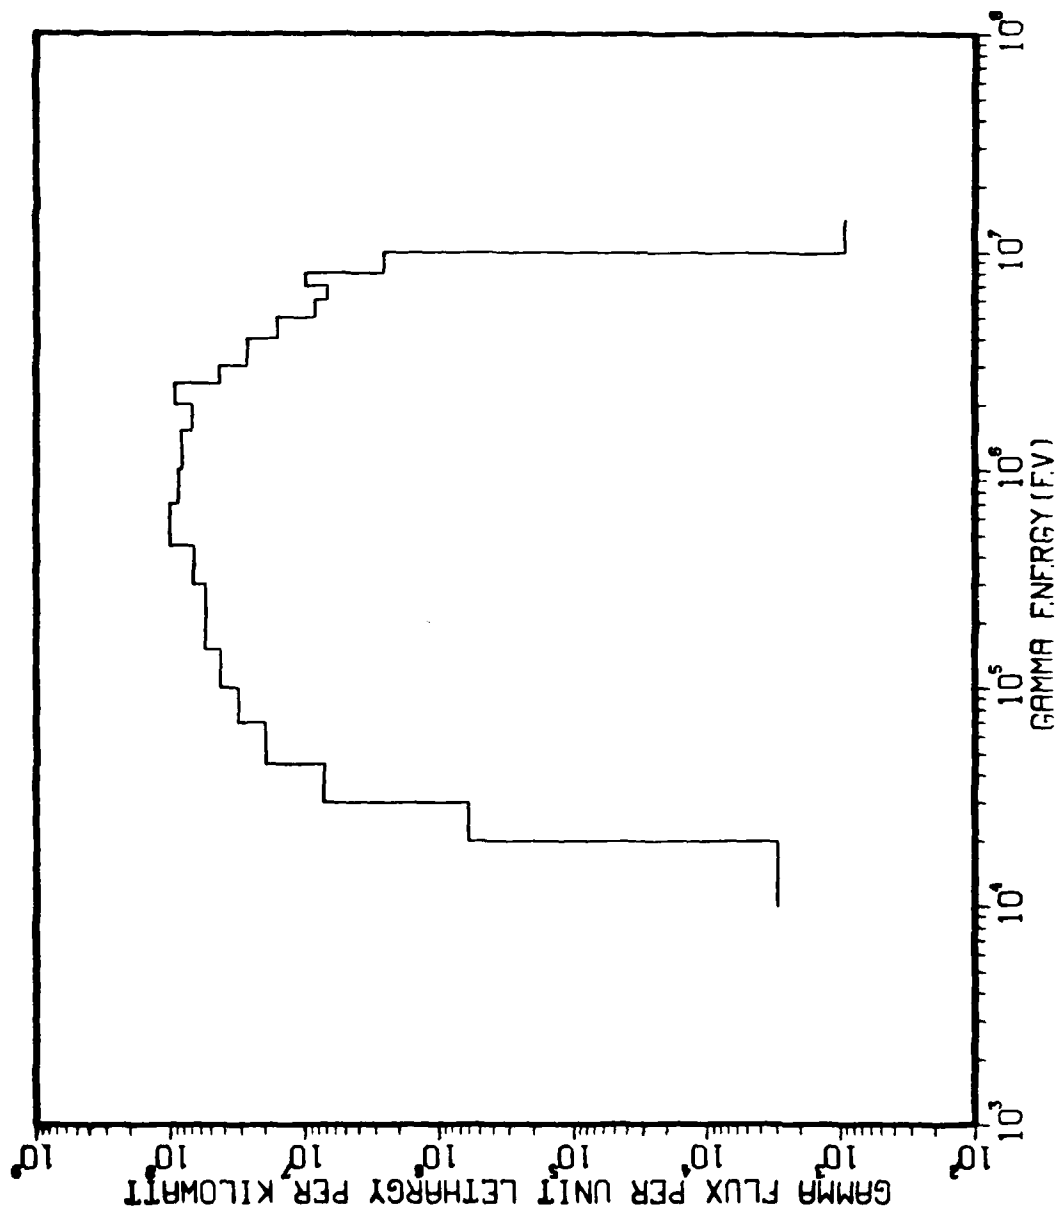


Figure II.6.24. Total Gamma Flux vs Energy Free Field ER1 200 CMS from Reactor.

Table II.6.5. Neutron Flux per Unit Lethargy per Kilowatt.

ERI FREE FIELD 200 CMS FROM REACTOR

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	1.21E+03	0.00E+00	1.21E+03
2	1.690E+07	6.46E+03	0.00E+00	6.46E+03
3	1.490E+07	1.59E+04	0.00E+00	1.59E+04
4	1.420E+07	1.92E+04	0.00E+00	1.92E+04
5	1.380E+07	4.22E+04	0.00E+00	4.22E+04
6	1.280E+07	5.84E+04	0.00E+00	5.84E+04
7	1.220E+07	1.20E+05	0.00E+00	1.20E+05
8	1.110E+07	2.32E+05	0.00E+00	2.32E+05
9	1.000E+07	4.51E+05	0.00E+00	4.51E+05
10	9.050E+06	7.46E+05	0.00E+00	7.46E+05
11	8.190E+06	1.19E+06	0.00E+00	1.19E+06
12	7.410E+06	1.97E+06	9.80E+02	1.98E+06
13	6.380E+06	3.59E+06	2.31E+03	3.60E+06
14	4.970E+06	4.59E+06	7.54E+03	4.60E+06
15	4.720E+06	5.37E+06	1.42E+04	5.38E+06
16	4.070E+06	6.31E+06	5.52E+04	6.36E+06
17	3.010E+06	8.63E+06	2.54E+05	8.88E+06
18	2.390E+06	9.68E+06	2.24E+05	9.90E+06
19	2.310E+06	7.66E+06	2.18E+05	7.88E+06
20	1.830E+06	6.58E+06	2.22E+05	6.80E+06
21	1.110E+06	4.72E+06	2.61E+05	4.98E+06
22	5.500E+05	2.36E+06	1.91E+05	2.55E+06
23	1.580E+05	1.72E+06	1.65E+05	1.88E+06
24	1.110E+05	1.33E+06	1.41E+05	1.47E+06
25	5.250E+04	1.04E+06	1.29E+05	1.17E+06
26	2.480E+04	1.12E+06	1.26E+05	1.25E+06
27	2.190E+04	1.04E+06	1.28E+05	1.16E+06
28	1.030E+04	9.58E+05	1.34E+05	1.09E+06
29	3.350E+03	9.38E+05	1.41E+05	1.08E+06
30	1.230E+03	9.13E+05	1.48E+05	1.06E+06
31	5.830E+02	8.51E+05	1.55E+05	1.01E+06
32	1.010E+02	7.28E+05	1.60E+05	8.88E+05
33	2.900E+01	6.05E+05	1.60E+05	7.65E+05
34	1.070E+01	4.55E+05	1.56E+05	6.11E+05
35	3.060E+00	2.96E+05	1.51E+05	4.47E+05
36	1.130E+00	1.94E+05	1.44E+05	3.38E+05
37	4.140E-01	3.58E+04	3.94E+04	7.52E+04

Table II.6.6. Gamma Flux per Unit Lethargy per Kilowatt.

KR1 FREE FIELD 200 CMS FROM REACTOR

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.400E+07	6.70E+02	2.44E+02	9.14E+02
2	1.000E+07	2.57E+06	0.00E+00	2.57E+06
3	8.000E+06	9.86E+06	0.00E+00	9.86E+06
4	7.000E+06	6.78E+06	1.69E+04	6.79E+06
5	6.000E+06	8.40E+06	1.03E+04	8.41E+06
6	5.000E+06	1.60E+07	6.70E+03	1.60E+07
7	4.000E+06	2.70E+07	0.00E+00	2.70E+07
8	3.000E+06	4.31E+07	0.00E+00	4.31E+07
9	2.500E+06	9.08E+07	1.41E+06	9.22E+07
10	2.000E+06	6.93E+07	0.00E+00	6.93E+07
11	1.500E+06	8.26E+07	1.36E+04	8.26E+07
12	1.000E+06	8.64E+07	1.20E+05	8.65E+07
13	7.000E+05	1.00E+08	5.19E+05	1.01E+08
14	4.500E+05	6.71E+07	3.22E+05	6.74E+07
15	3.000E+05	4.61E+07	8.94E+06	5.51E+07
16	1.500E+05	3.15E+07	1.11E+07	4.26E+07
17	1.000E+05	1.97E+07	1.16E+07	3.13E+07
18	7.000E+04	1.08E+07	9.07E+06	1.99E+07
19	4.500E+04	3.69E+06	3.52E+06	7.21E+06
20	3.000E+04	2.92E+05	3.08E+05	6.01E+05
21	2.000E+04	1.52E+03	1.42E+03	2.94E+03

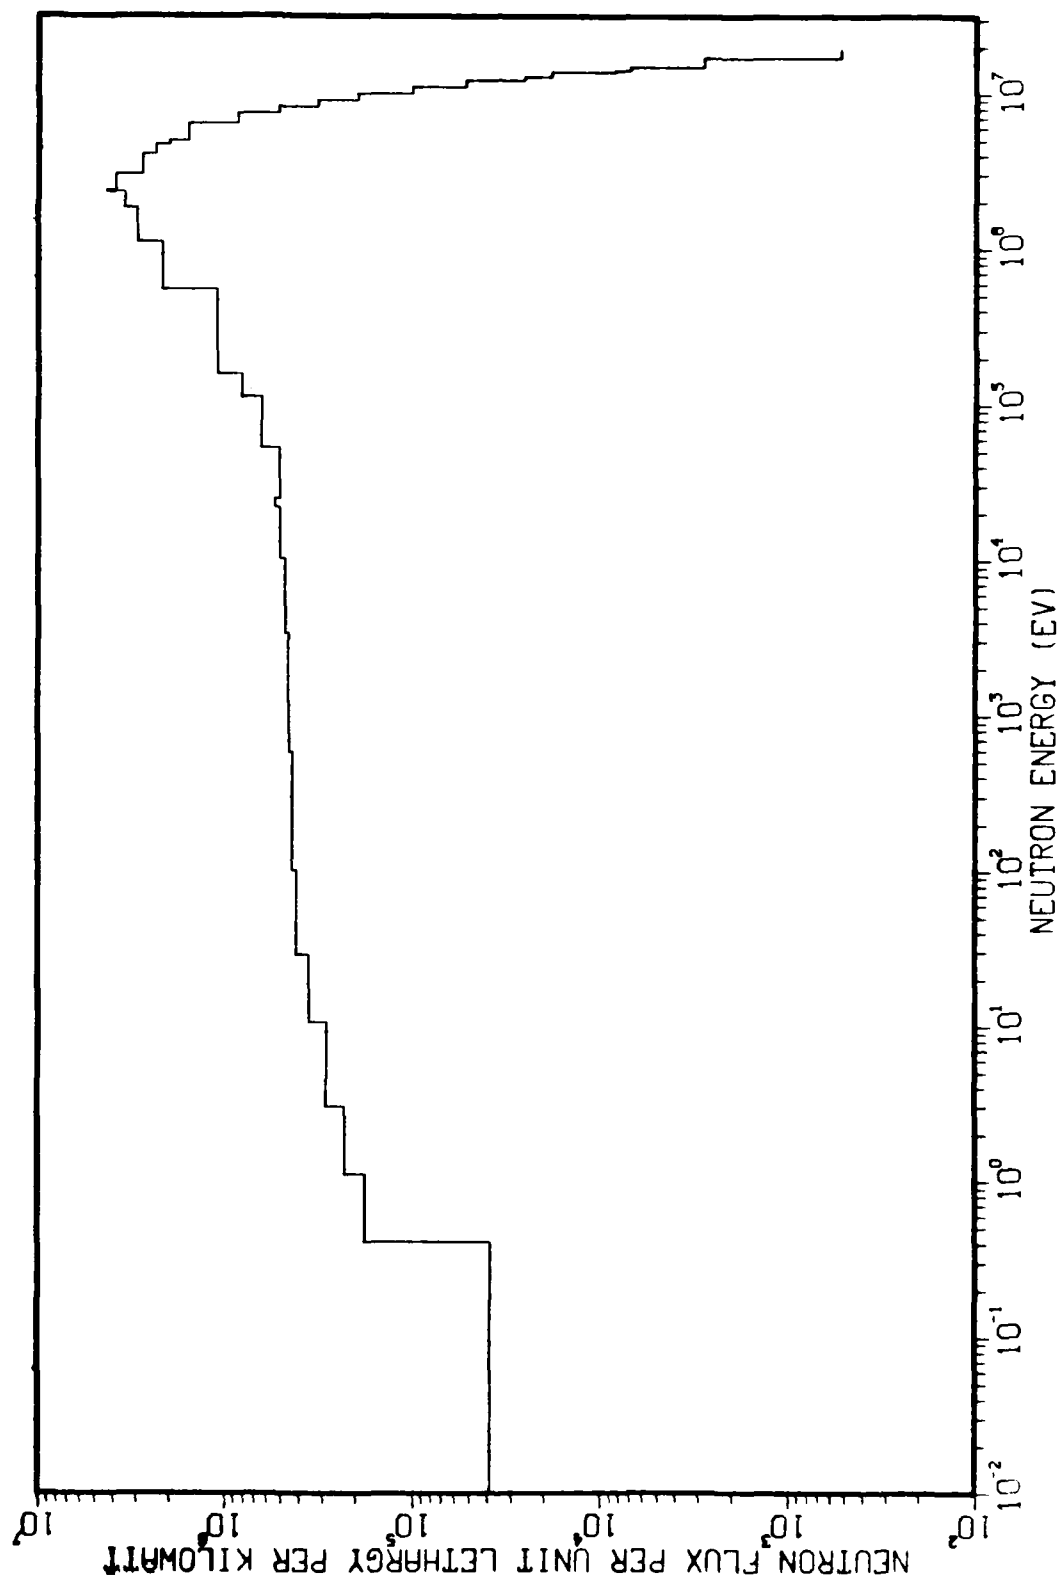


Figure II.6.25. Front Neutron Flux vs Energy Free Field ERI 300 CMS from Reactor.

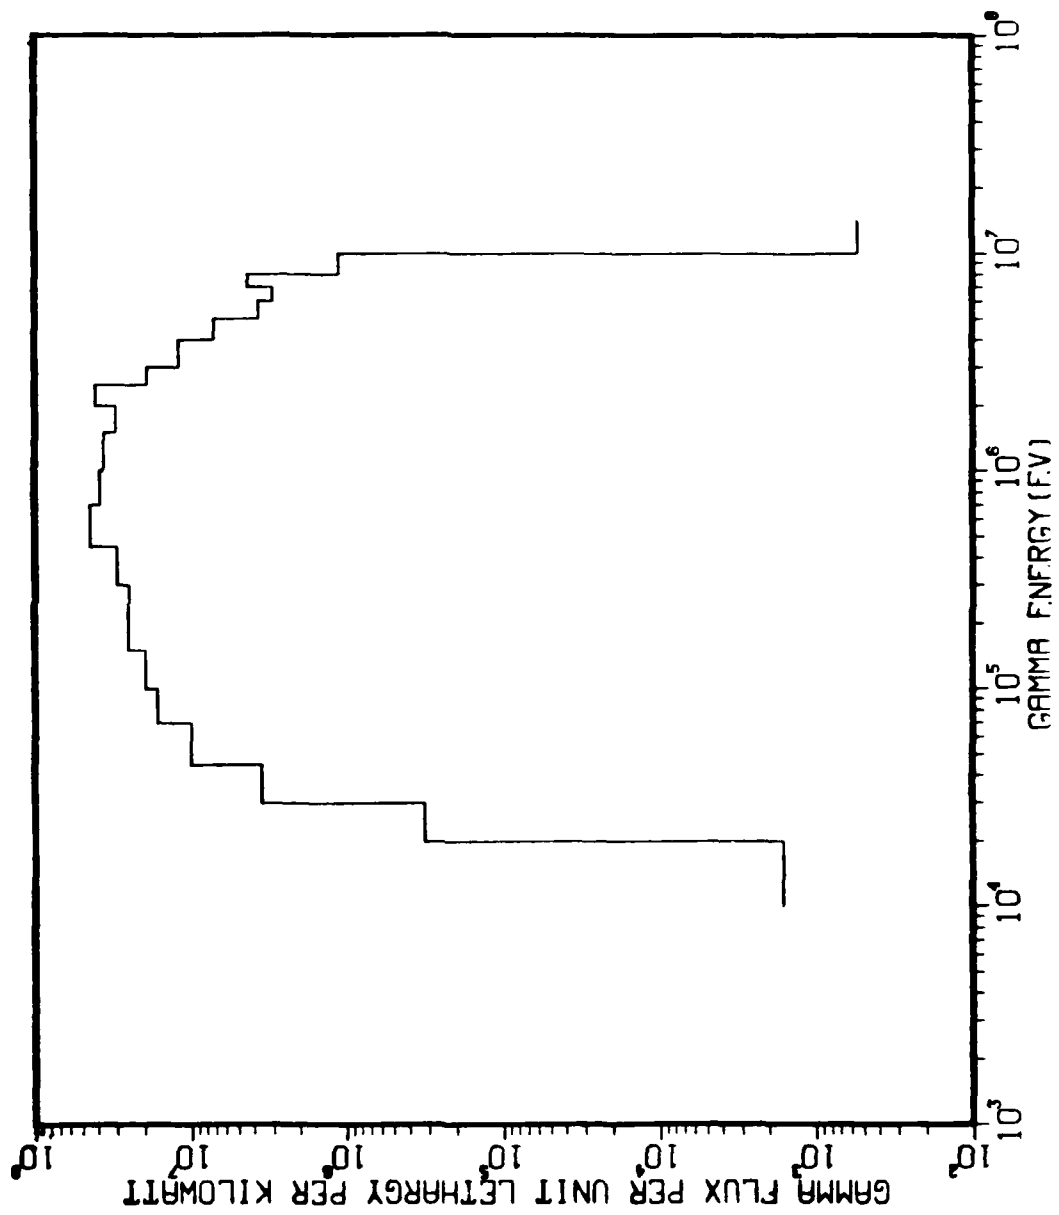


Figure 11.6.26. Front Gamma Flux vs Energy Free Field ER1 300 CMS from Reactor.

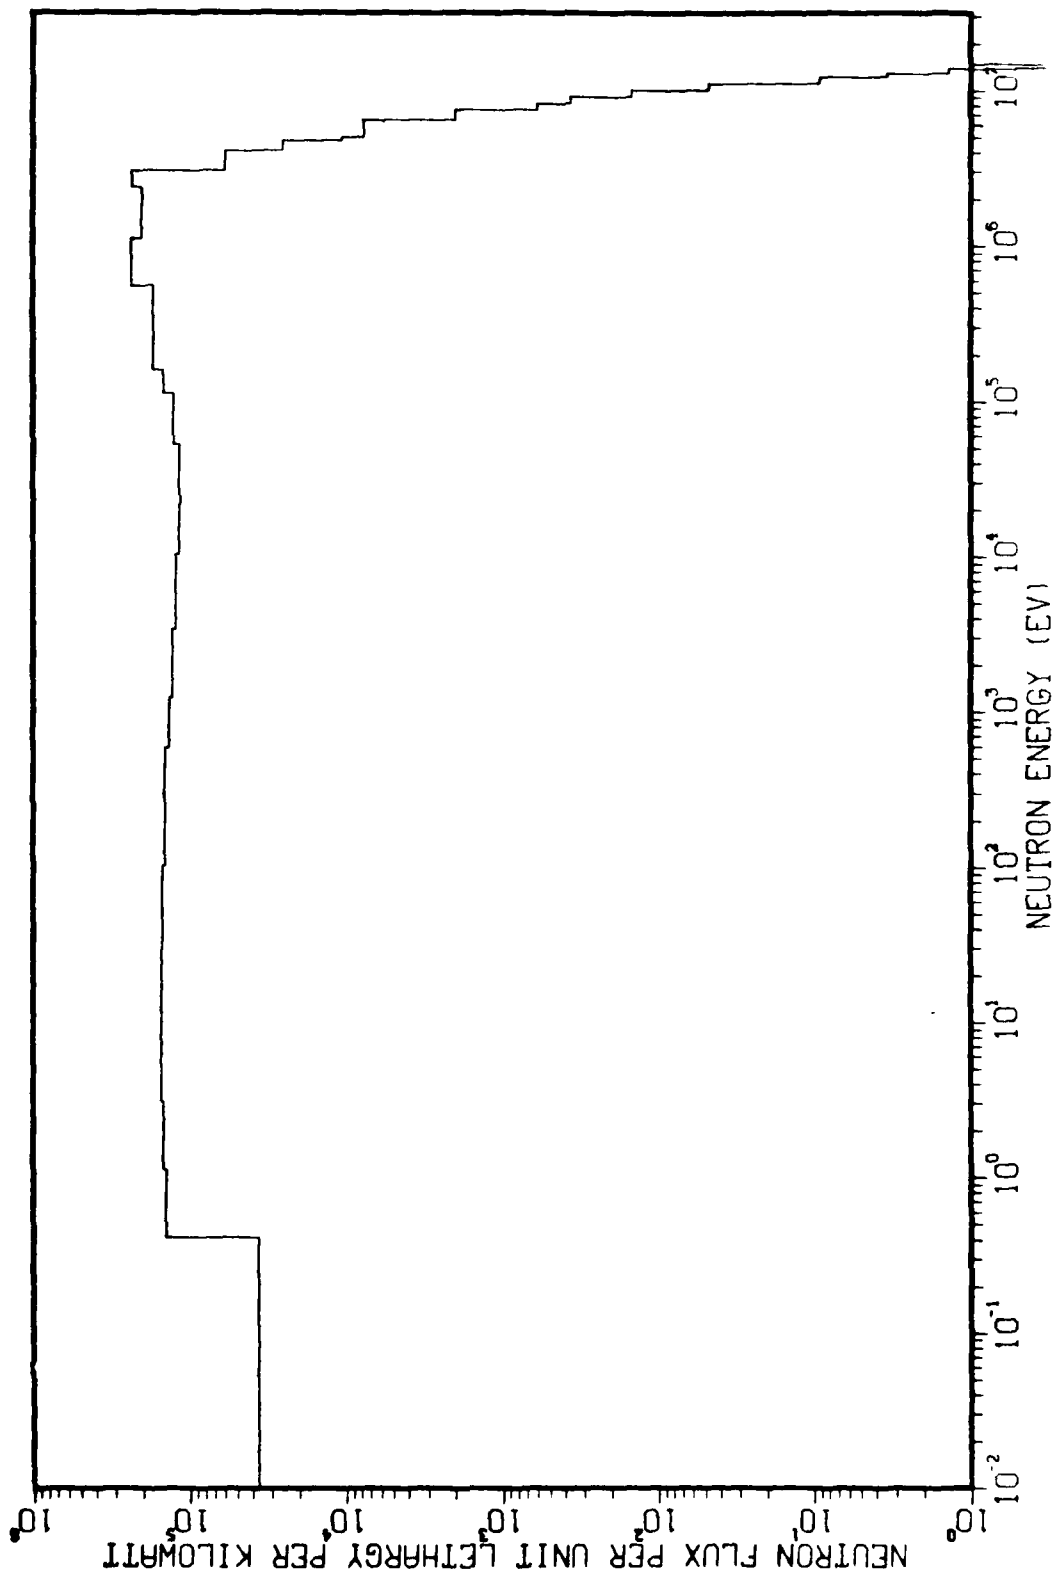


Figure II.6.27. Back Neutron Flux vs Energy Free Field ER1 300 CMS from Reactor.

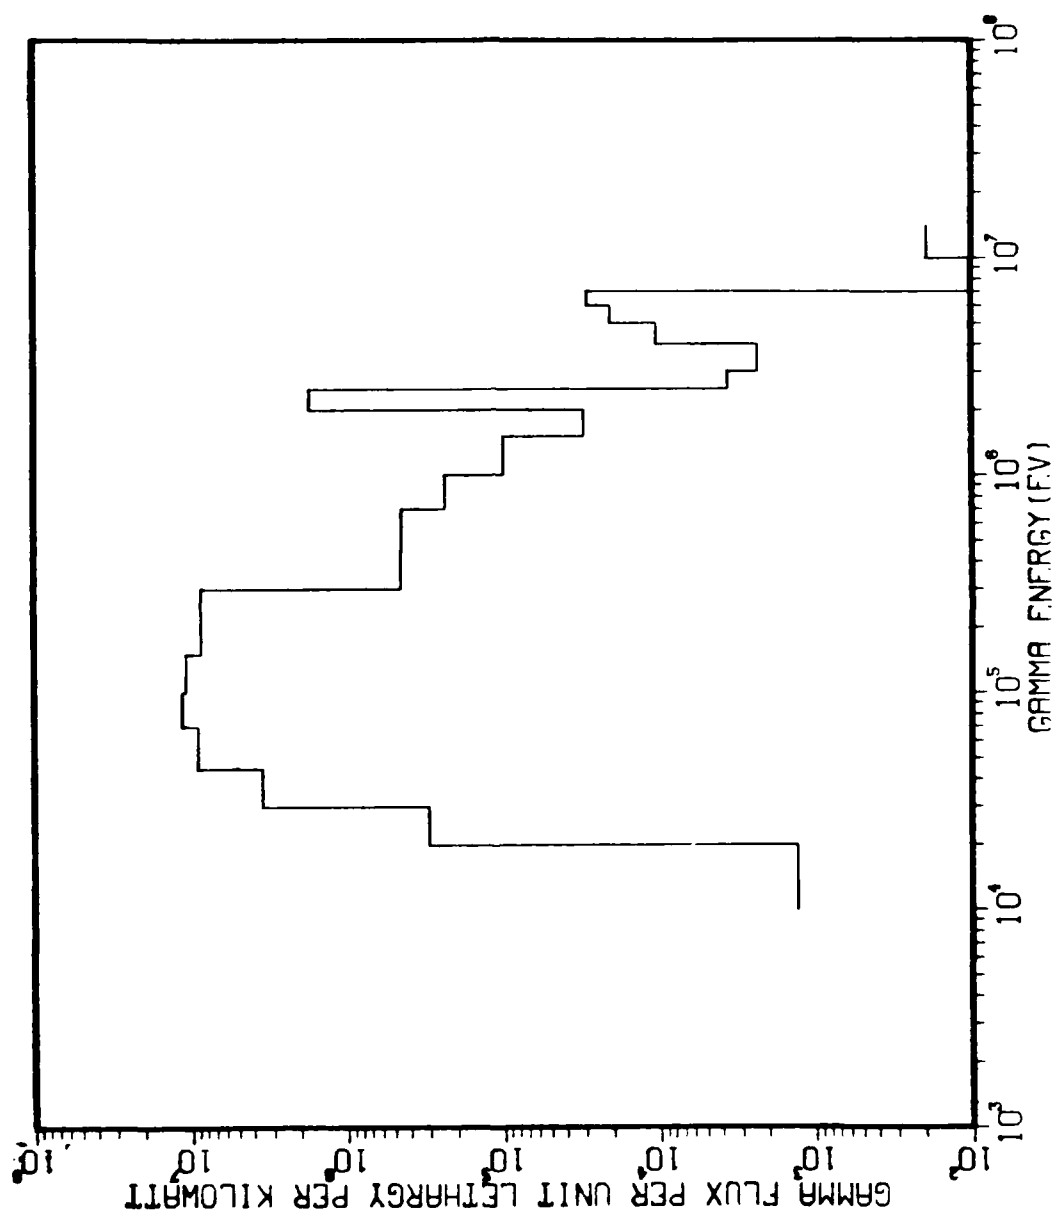


Figure II.6.28. Back Gamma Flux vs Energy Free Field ERI 300 CMS from Reactor.

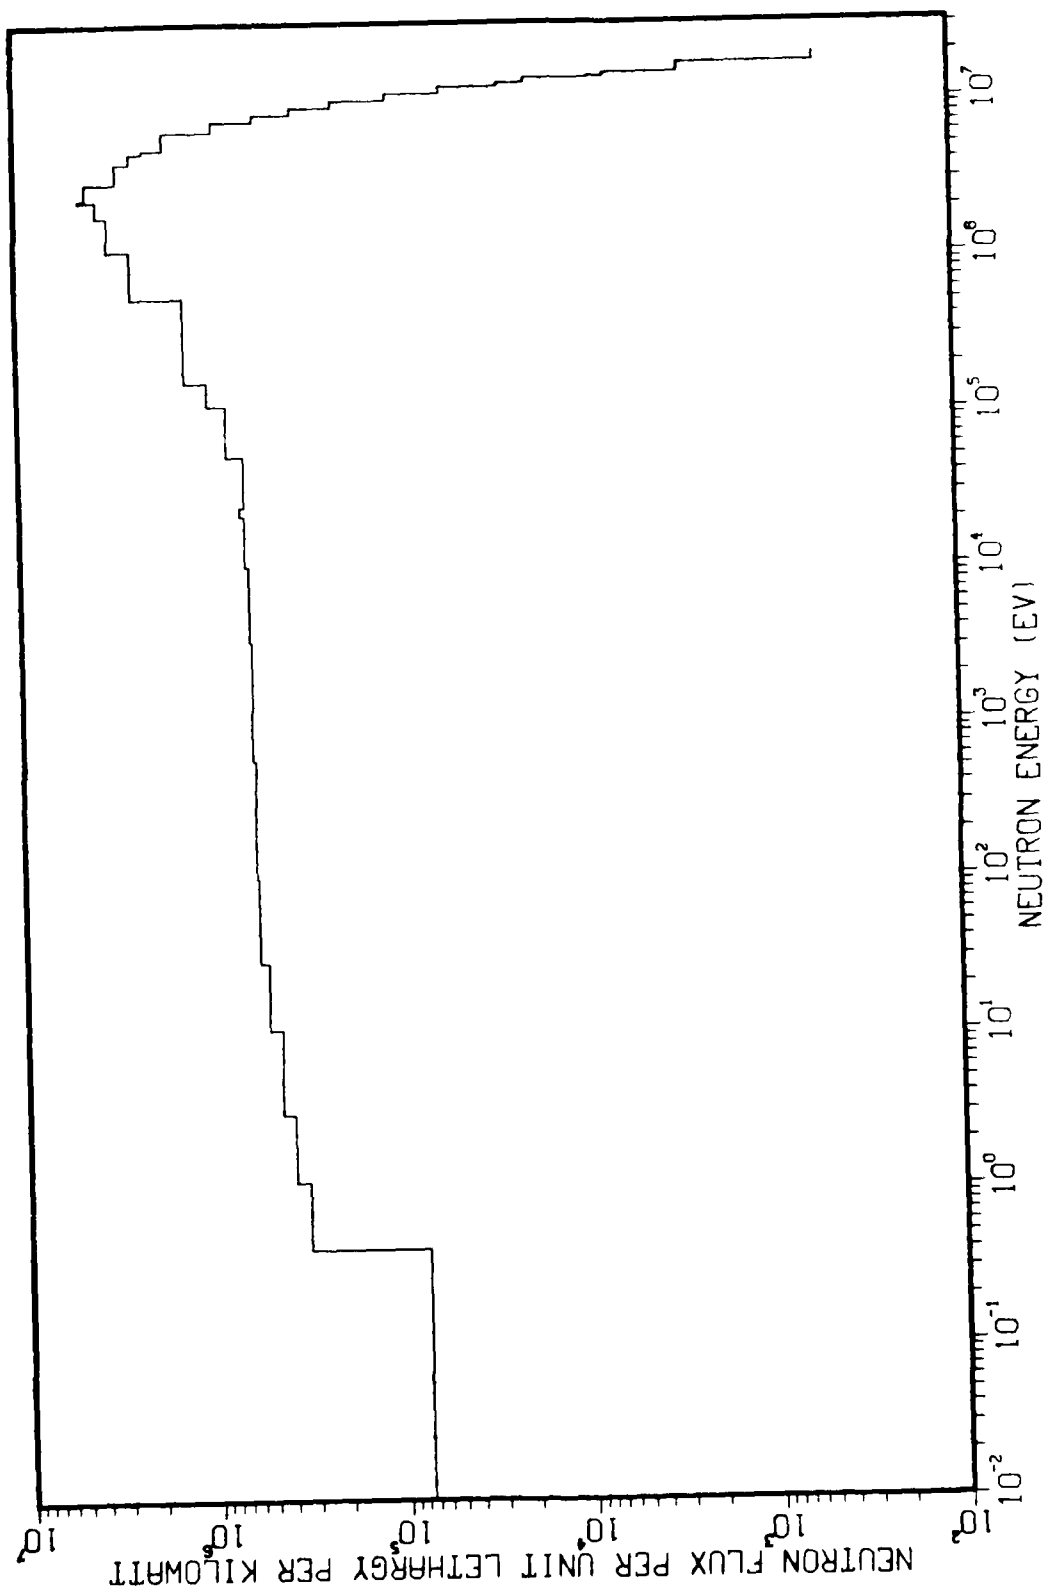


Figure 11.6.29. Total Neutron Flux vs Energy Free Field ER1 300 CMS from Reactor.

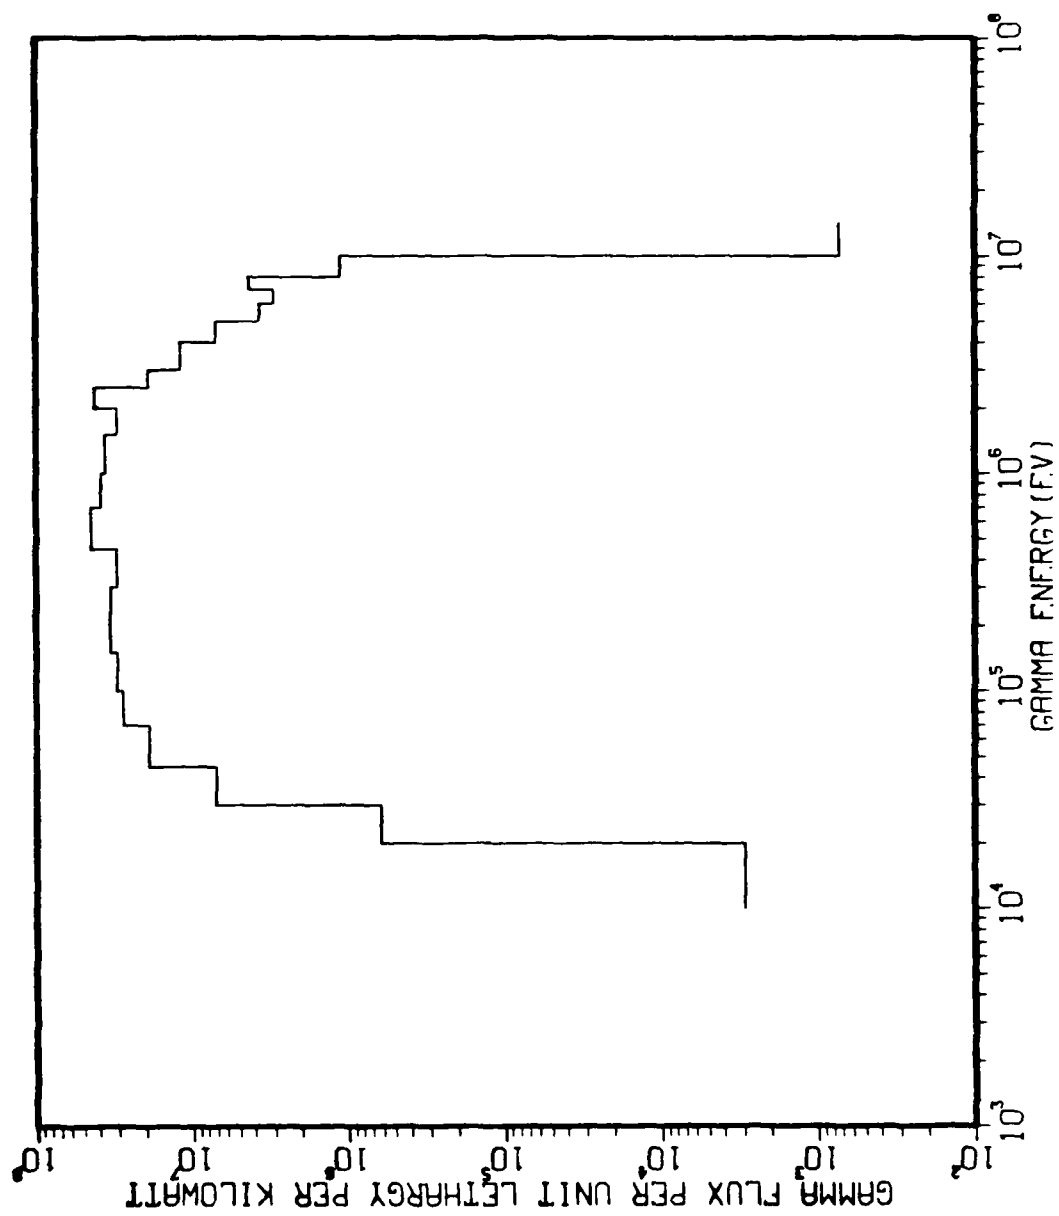


Figure 11.6.30. Total Gamma Flux vs Energy Free Field ER1 300 CMS from Reactor.

Table II.6.7. Neutron Flux per Unit Lethargy per Kilowatt.

ERI FREE FIELD 800 CMS FROM REACTOR

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	5.29E+02	0.00E+00	5.29E+02
2	1.690E+07	2.83E+03	0.00E+00	2.83E+03
3	1.490E+07	6.98E+03	1.85E-01	6.98E+03
4	1.420E+07	8.42E+03	5.14E-01	8.42E+03
5	1.380E+07	1.85E+04	1.38E+00	1.85E+04
6	1.280E+07	2.56E+04	3.41E+00	2.56E+04
7	1.220E+07	5.25E+04	9.26E+00	5.25E+04
8	1.110E+07	1.02E+05	4.72E+01	1.02E+05
9	1.000E+07	1.98E+05	1.47E+02	1.98E+05
10	9.050E+06	3.27E+05	3.63E+02	3.28E+05
11	8.190E+06	5.22E+05	5.96E+02	5.23E+05
12	7.410E+06	8.69E+05	1.99E+03	8.70E+05
13	6.380E+06	1.58E+06	7.77E+03	1.59E+06
14	4.970E+06	2.03E+06	1.07E+04	2.04E+06
15	4.720E+06	2.38E+06	2.56E+04	2.40E+06
16	4.070E+06	2.81E+06	5.94E+04	2.87E+06
17	3.010E+06	3.90E+06	2.35E+05	4.14E+06
18	2.390E+06	4.35E+06	2.04E+05	4.56E+06
19	2.310E+06	3.47E+06	2.02E+05	3.67E+06
20	1.830E+06	3.00E+06	2.04E+05	3.20E+06
21	1.110E+06	2.19E+06	2.36E+05	2.43E+06
22	5.500E+05	1.11E+06	1.72E+05	1.29E+06
23	1.580E+05	8.24E+05	1.49E+05	9.73E+05
24	1.110E+05	6.44E+05	1.28E+05	7.72E+05
25	5.250E+04	5.11E+05	1.18E+05	6.29E+05
26	2.480E+04	5.47E+05	1.16E+05	6.63E+05
27	2.190E+04	5.12E+05	1.17E+05	6.29E+05
28	1.030E+04	4.81E+05	1.23E+05	6.04E+05
29	3.350E+03	4.65E+05	1.30E+05	5.95E+05
30	1.230E+03	4.60E+05	1.36E+05	5.96E+05
31	5.830E+02	4.39E+05	1.44E+05	5.83E+05
32	1.010E+02	4.15E+05	1.50E+05	5.66E+05
33	2.900E+01	3.59E+05	1.53E+05	5.12E+05
34	1.070E+01	2.90E+05	1.51E+05	4.41E+05
35	3.060E+00	2.30E+05	1.49E+05	3.79E+05
36	1.130E+00	1.80E+05	1.44E+05	3.23E+05
37	4.140E-01	3.85E+04	3.68E+04	7.53E+04

Table II.6.8. Gamma Flux per Unit Lethargy per Kilowatt.

ERI FREE FIELD 300 CMS FROM REACTOR				
GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.400E+07	5.40E+02	1.93E+02	7.33E+02
2	1.000E+07	1.13E+06	0.00E+00	1.13E+06
3	8.000E+06	4.33E+06	0.00E+00	4.33E+06
4	7.000E+06	2.99E+06	2.90E+04	3.02E+06
5	6.000E+06	3.70E+06	2.04E+04	3.72E+06
6	5.000E+06	7.05E+06	1.05E+04	7.06E+06
7	4.000E+06	1.19E+07	2.33E+03	1.19E+07
8	3.000E+06	1.89E+07	3.61E+03	1.89E+07
9	2.500E+06	4.09E+07	1.72E+06	4.26E+07
10	2.000E+06	3.04E+07	3.04E+04	3.04E+07
11	1.500E+06	3.62E+07	9.92E+04	3.63E+07
12	1.000E+06	3.80E+07	2.37E+05	3.83E+07
13	7.000E+05	4.42E+07	4.50E+05	4.47E+07
14	4.500E+05	2.98E+07	4.58E+05	3.03E+07
15	3.000E+05	2.48E+07	8.67E+06	3.35E+07
16	1.500E+05	1.95E+07	1.08E+07	3.04E+07
17	1.000E+05	1.63E+07	1.15E+07	2.78E+07
18	7.000E+04	1.00E+07	9.03E+06	1.90E+07
19	4.500E+04	3.54E+06	3.51E+06	7.05E+06
20	3.000E+04	3.20E+05	3.04E+05	6.24E+05
21	2.000E+04	1.63E+03	1.32E+03	2.95E+03

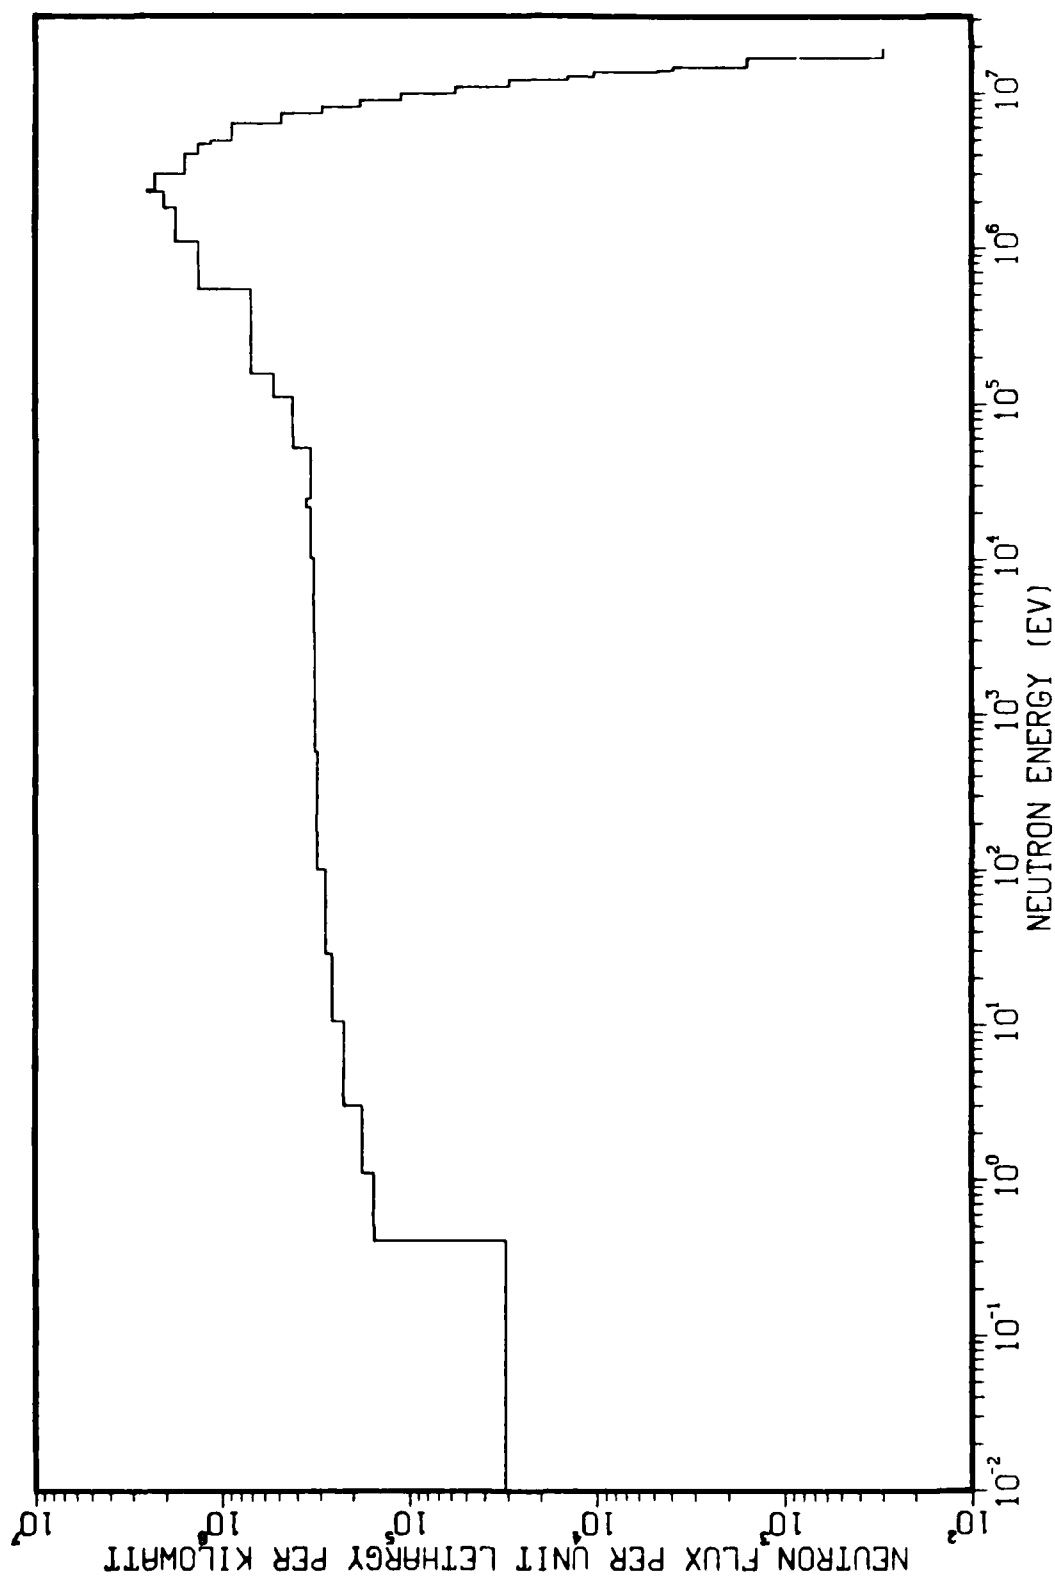


Figure II.6.31. Front Neutron Flux vs Energy Free Field ER1 400 CMS from Reactor.

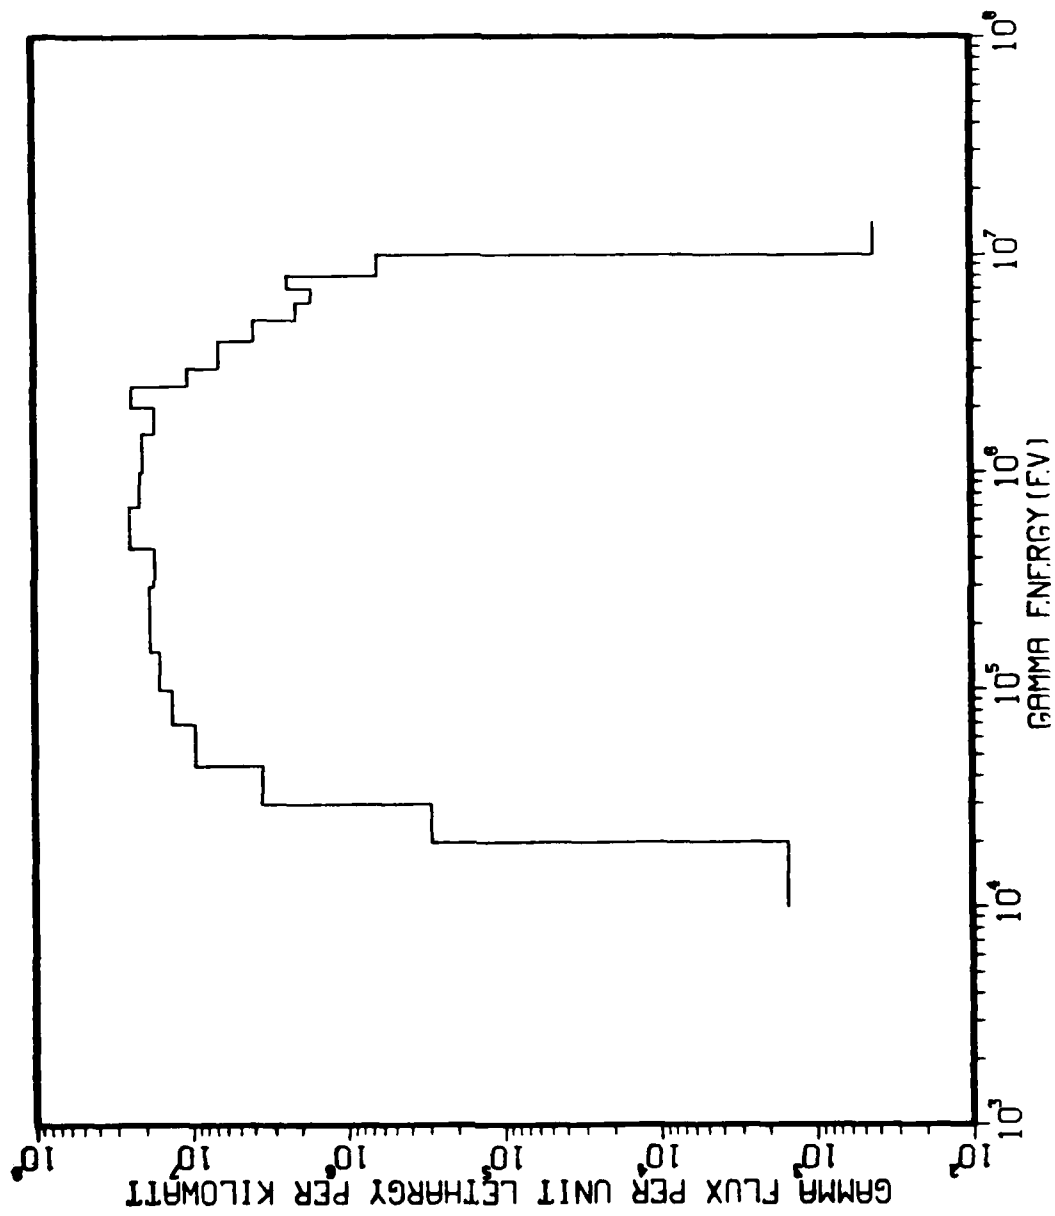


Figure II.6.32. Front Gamma Flux vs Energy Free Field ER1 400 CMS from Reactor.

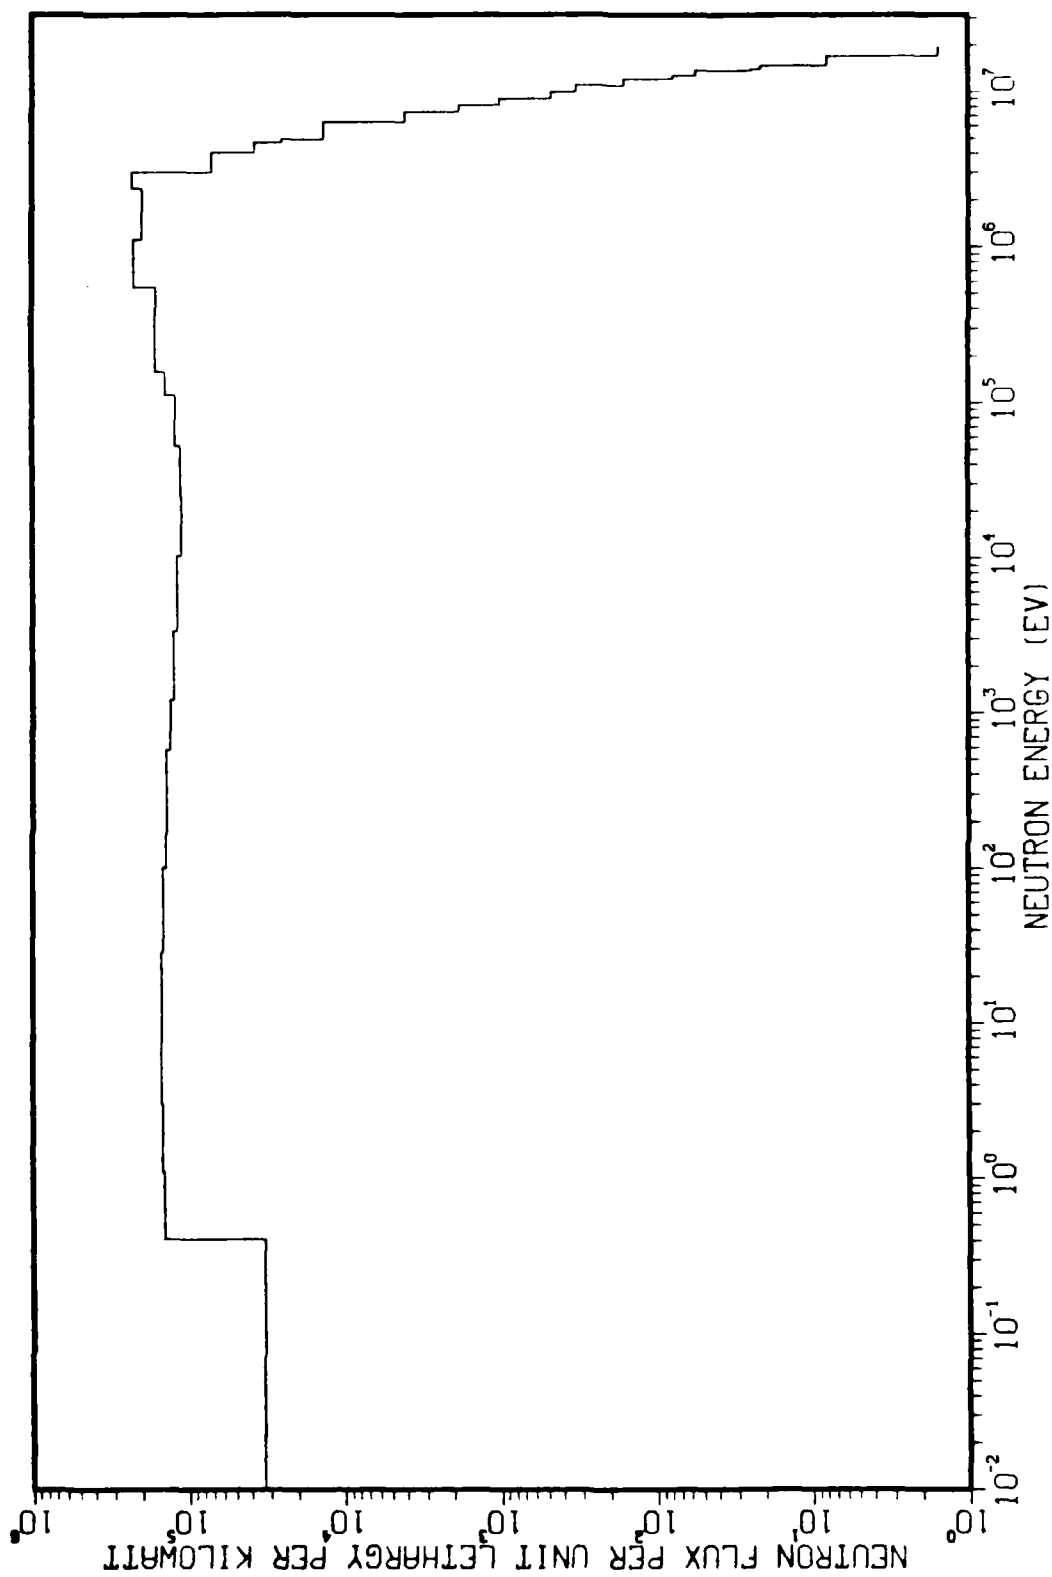


Figure II.6.33. Back Neutron Flux vs Energy Free Field ER1 400 CMS from Reactor.

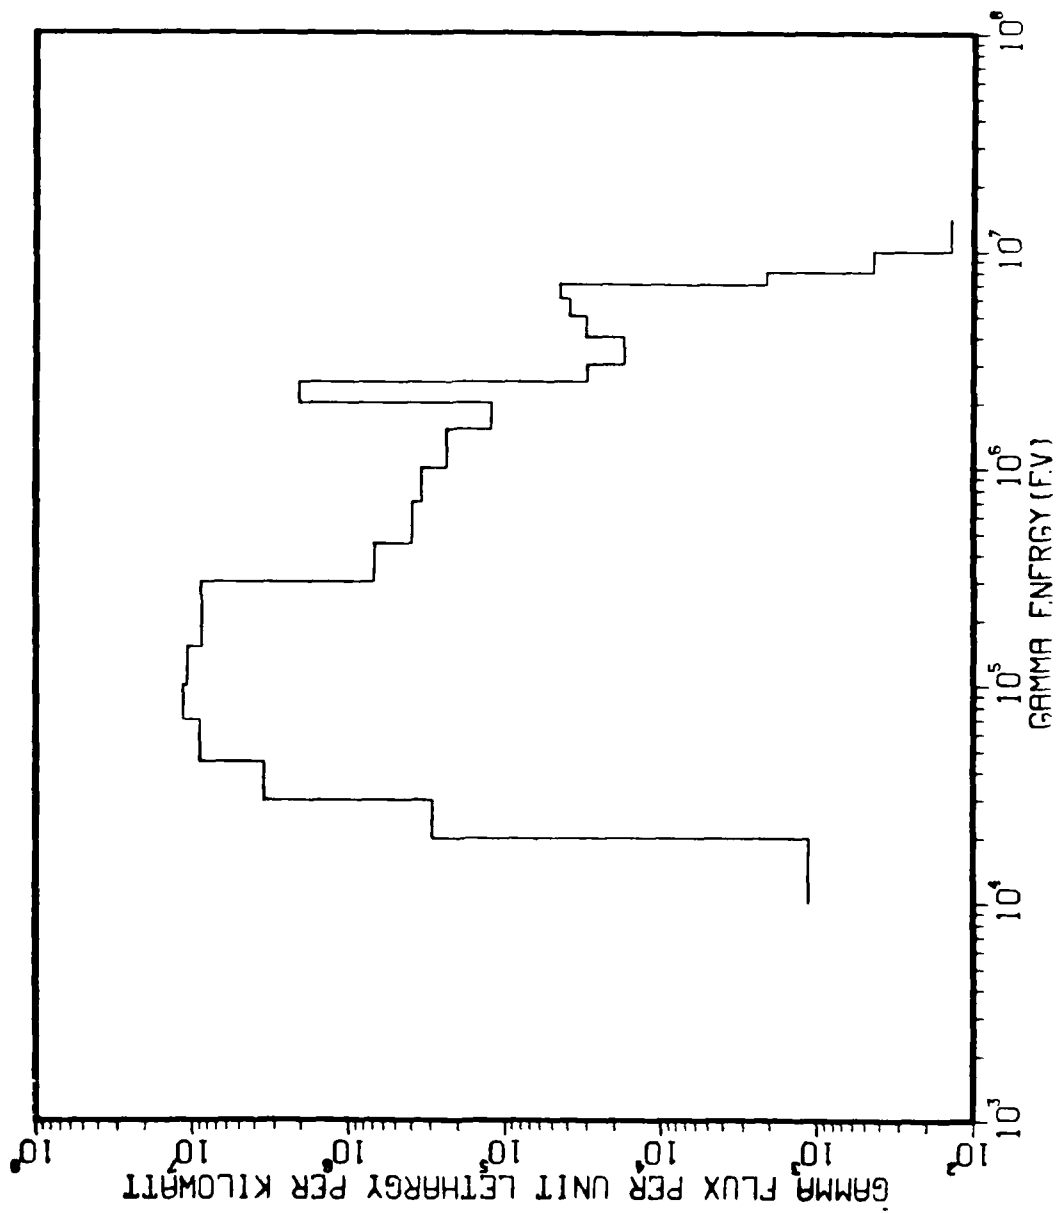


Figure II.6.34. Back Gamma Flux vs Energy Free Field ER1 400 CMS from Reactor.

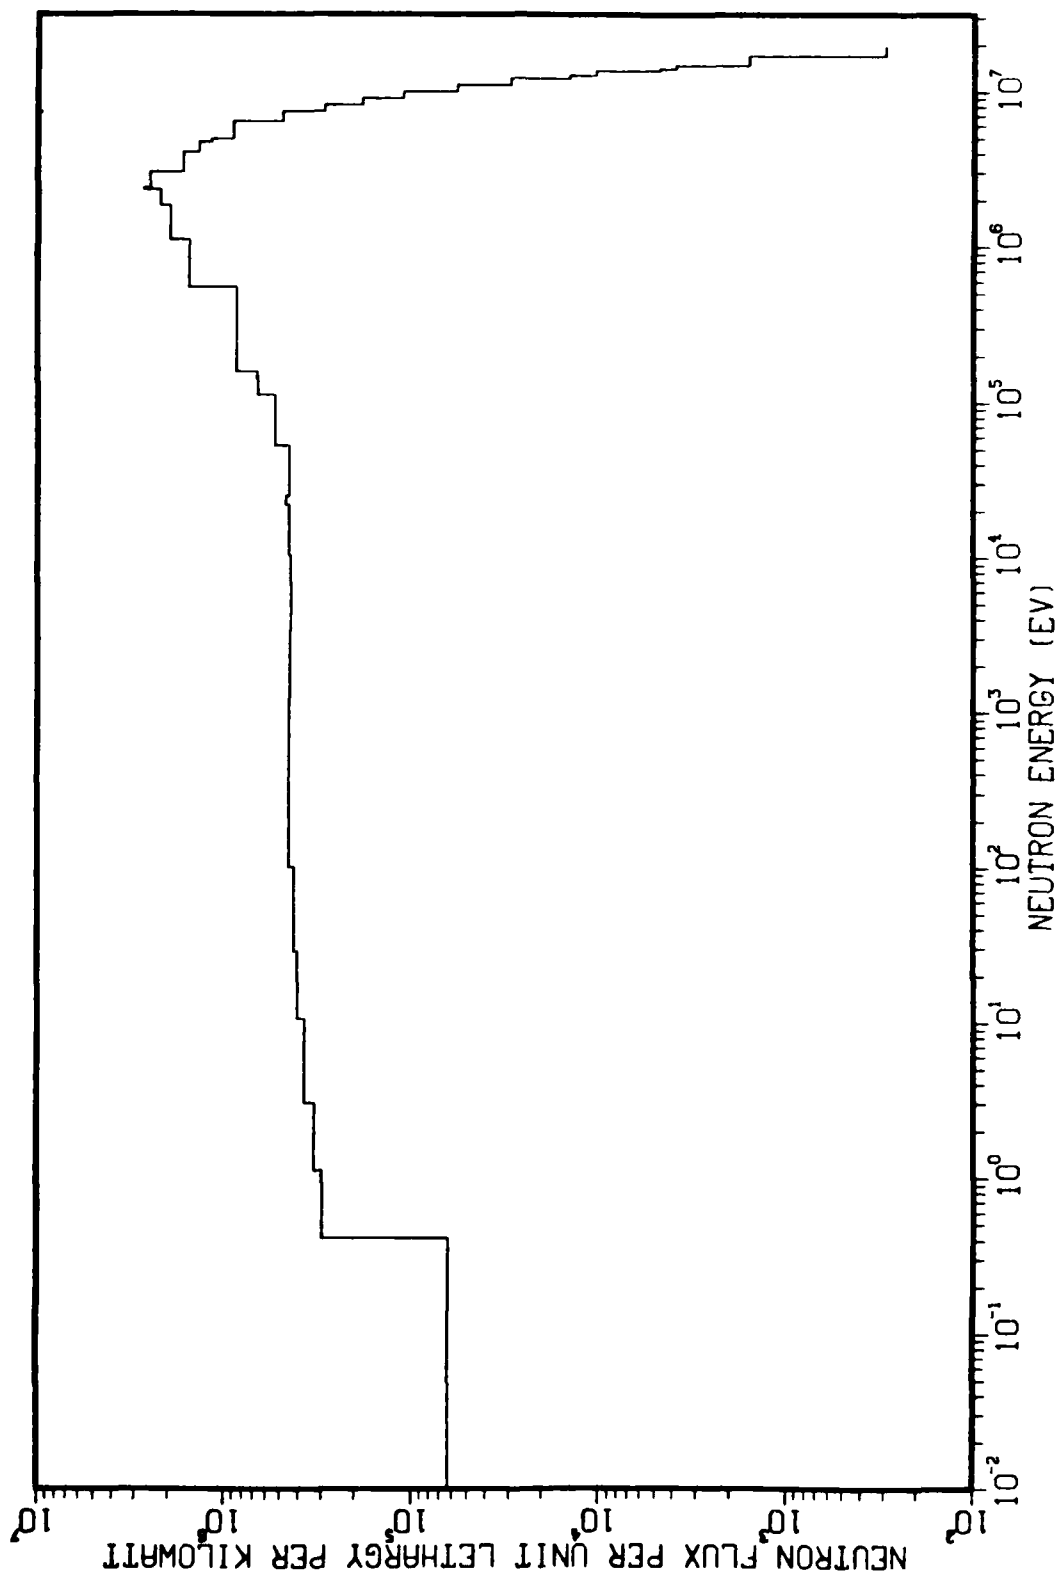


Figure 11.6.35. Total Neutron Flux vs Energy Free Field ER1 400 CMS from Reactor.

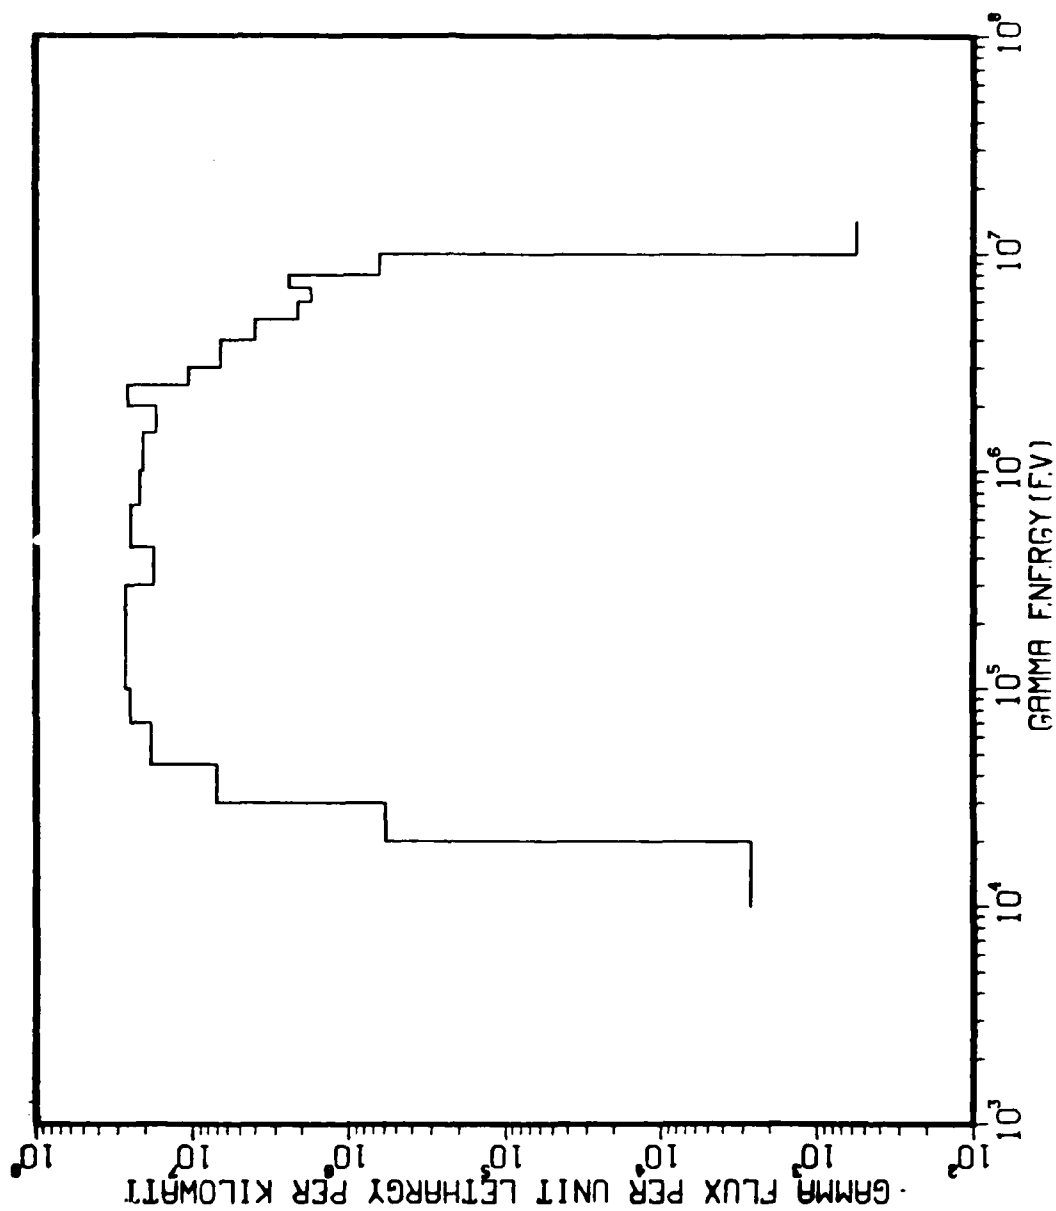


Figure II.6.36. Total Gamma Flux vs Energy Free Field ER1 400 CMS from Reactor.

Table II.6.9. Neutron Flux Per Unit Lethargy per Kilowatt.

ERI FREE FIELD 400 CMS FROM REACTOR

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	2.95E+02	1.55E+00	2.97E+02
2	1.690E+07	1.58E+03	8.02E+00	1.59E+03
3	1.490E+07	3.89E+03	2.12E+01	3.92E+03
4	1.420E+07	4.69E+03	2.46E+01	4.72E+03
5	1.380E+07	1.03E+04	5.57E+01	1.04E+04
6	1.280E+07	1.43E+04	7.83E+01	1.44E+04
7	1.220E+07	2.93E+04	1.62E+02	2.95E+04
8	1.110E+07	5.67E+04	3.27E+02	5.71E+04
9	1.000E+07	1.11E+05	4.72E+02	1.12E+05
10	9.050E+06	1.84E+05	1.02E+03	1.85E+05
11	8.190E+06	2.93E+05	1.84E+03	2.95E+05
12	7.410E+06	4.86E+05	4.09E+03	4.91E+05
13	6.380E+06	8.91E+05	1.35E+04	9.05E+05
14	4.970E+06	1.15E+06	2.51E+04	1.18E+06
15	4.720E+06	1.35E+06	3.78E+04	1.38E+06
16	4.070E+06	1.60E+06	7.03E+04	1.67E+06
17	3.010E+06	2.29E+06	2.27E+05	2.52E+06
18	2.390E+06	2.54E+06	1.99E+05	2.74E+06
19	2.310E+06	2.05E+06	1.97E+05	2.24E+06
20	1.830E+06	1.78E+06	1.97E+05	1.98E+06
21	1.110E+06	1.34E+06	2.22E+05	1.56E+06
22	5.500E+05	7.04E+05	1.62E+05	8.66E+05
23	1.580E+05	5.33E+05	1.41E+05	6.74E+05
24	1.110E+05	4.20E+05	1.22E+05	5.42E+05
25	5.250E+04	3.41E+05	1.13E+05	4.54E+05
26	2.480E+04	3.59E+05	1.12E+05	4.71E+05
27	2.190E+04	3.40E+05	1.12E+05	4.53E+05
28	1.030E+04	3.26E+05	1.18E+05	4.44E+05
29	3.350E+03	3.22E+05	1.25E+05	4.47E+05
30	1.230E+03	3.22E+05	1.32E+05	4.54E+05
31	5.830E+02	3.13E+05	1.40E+05	4.53E+05
32	1.010E+02	2.82E+05	1.47E+05	4.28E+05
33	2.900E+01	2.60E+05	1.50E+05	4.10E+05
34	1.070E+01	2.24E+05	1.50E+05	3.74E+05
35	3.060E+00	1.80E+05	1.48E+05	3.28E+05
36	1.130E+00	1.55E+05	1.44E+05	2.99E+05
37	4.140E-01	3.08E+04	3.30E+04	6.37E+04

Table II.6.10. Gamma Flux per Unit Lethargy per Kilowatt.

ERI FREE FIELD 400 CMS FROM REACTOR

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.400E+07	4.19E+02	1.39E+02	5.58E+02
2	1.000E+07	6.32E+03	4.41E+02	6.33E+03
3	8.000E+06	2.42E+06	2.13E+03	2.42E+06
4	7.000E+06	1.70E+06	4.54E+04	1.74E+06
5	6.000E+06	2.10E+06	3.96E+04	2.14E+06
6	5.000E+06	3.96E+06	3.10E+04	3.99E+06
7	4.000E+06	6.62E+06	1.77E+04	6.64E+06
8	3.000E+06	1.06E+07	3.06E+04	1.06E+07
9	2.500E+06	2.38E+07	2.08E+06	2.59E+07
10	2.000E+06	1.71E+07	1.25E+05	1.72E+07
11	1.500E+06	2.04E+07	2.41E+05	2.06E+07
12	1.000E+06	2.14E+07	3.49E+05	2.17E+07
13	7.000E+05	2.47E+07	3.97E+05	2.51E+07
14	4.500E+05	1.72E+07	6.95E+05	1.79E+07
15	3.000E+05	1.82E+07	8.69E+06	2.69E+07
16	1.500E+05	1.60E+07	1.08E+07	2.68E+07
17	1.000E+05	1.33E+07	1.15E+07	2.49E+07
18	7.000E+04	9.49E+06	8.99E+06	1.85E+07
19	4.500E+04	3.55E+06	8.49E+06	7.04E+06
20	3.000E+04	2.91E+05	2.96E+05	5.87E+05
21	2.000E+04	1.50E+03	1.16E+03	2.66E+03

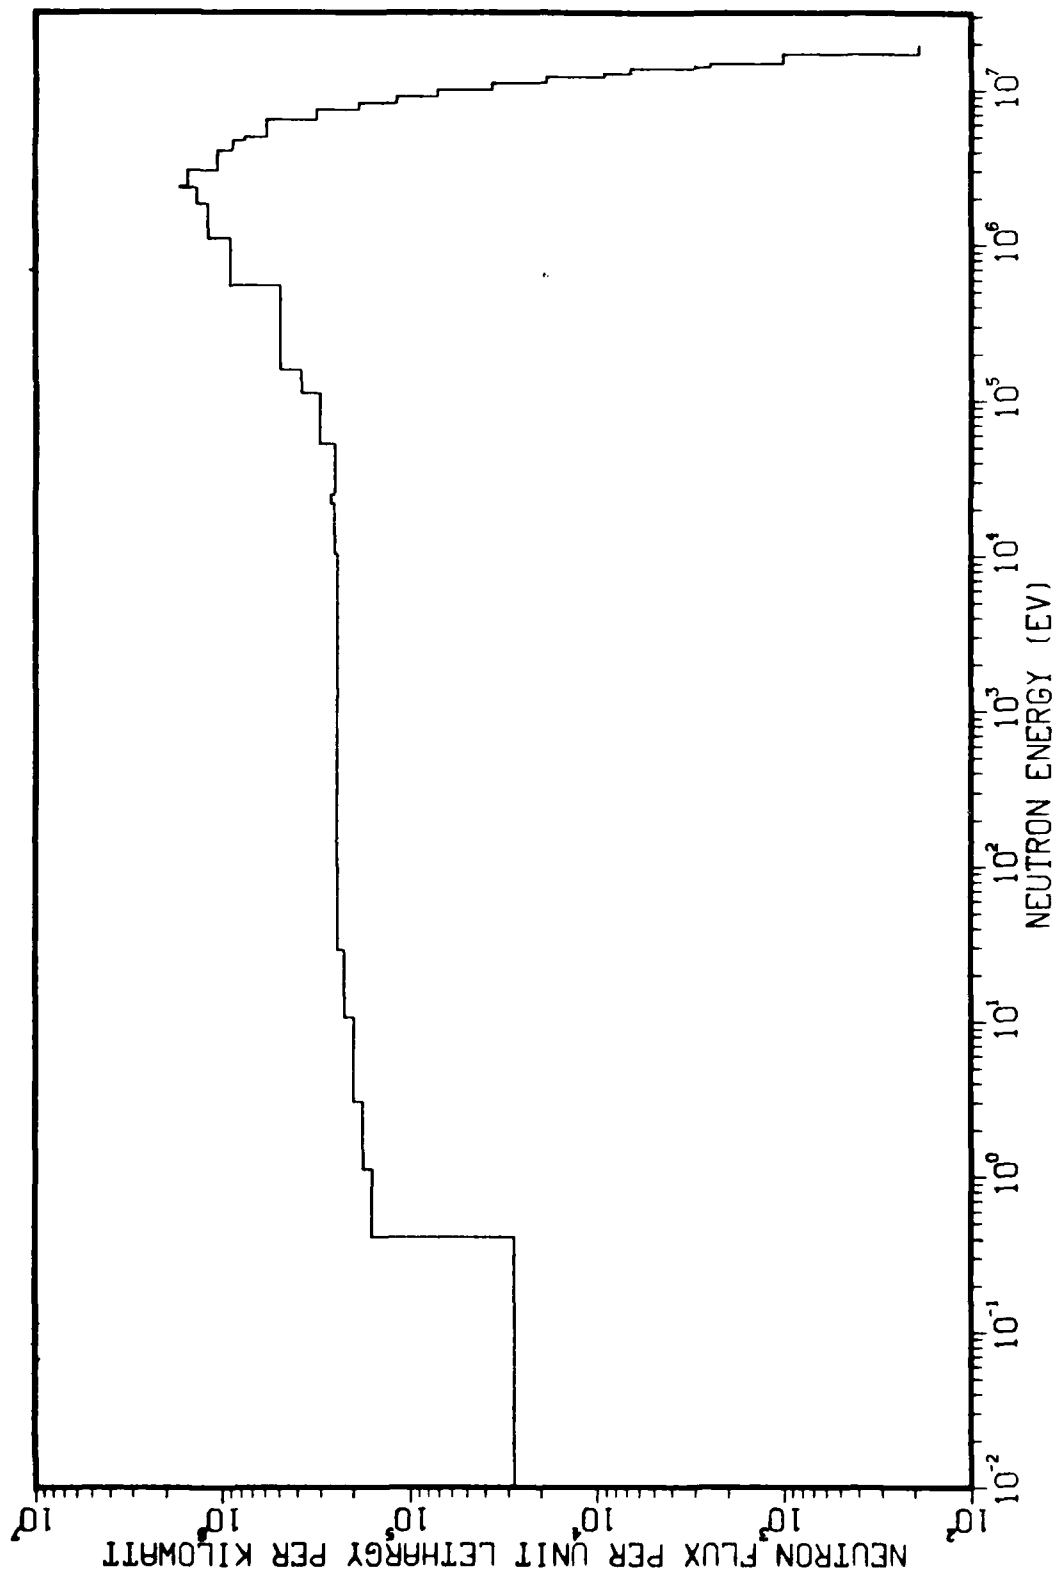


Figure II.6.37. Front Neutron Flux vs Energy Free Field ER1 500 CMS from Reactor.

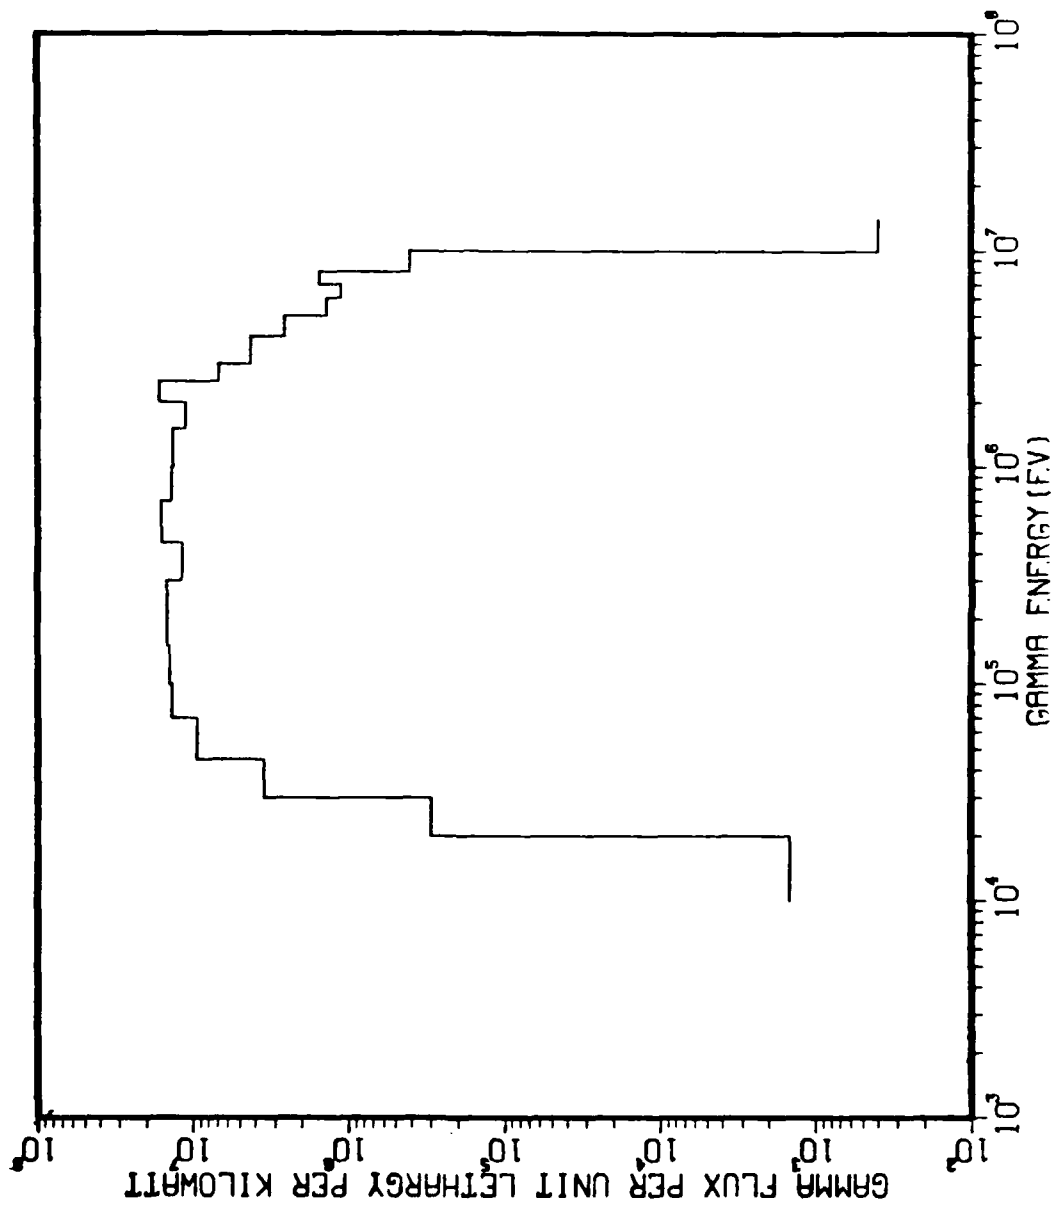


Figure II.6.38. Front Gamma Flux vs Energy Free Field ER1 500 CMS from Reactor.

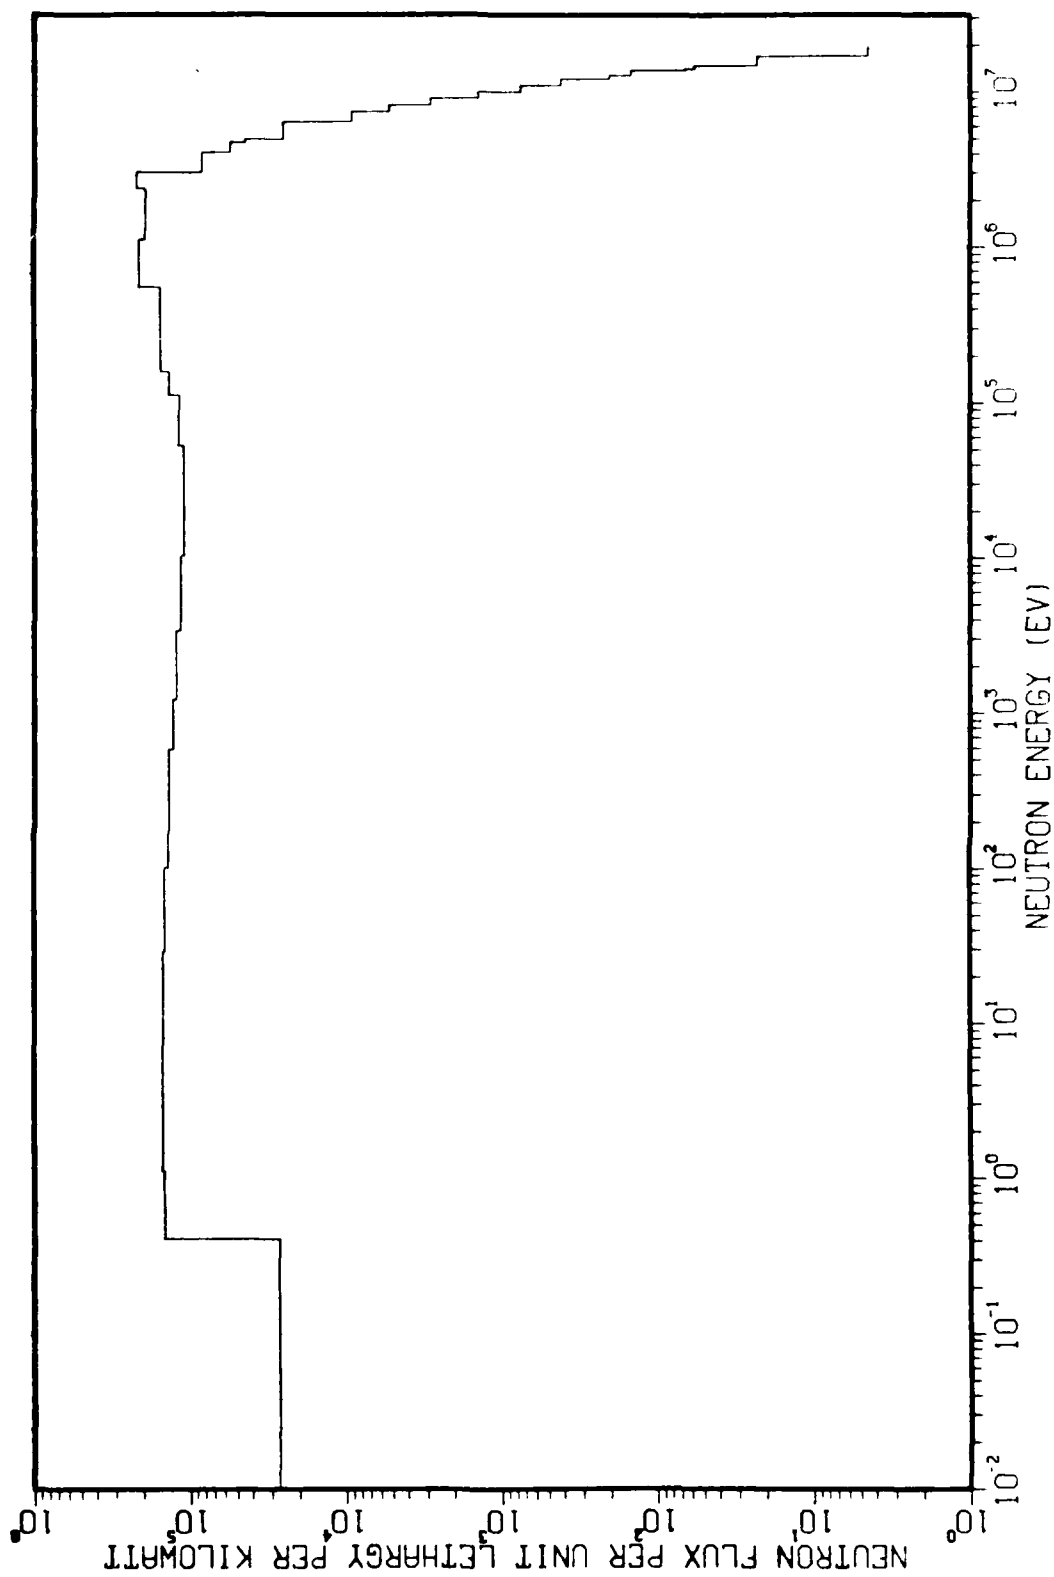


Figure II.6.39. Back Neutron Flux vs Energy Free Field ERT 500 CMS from Reactor.

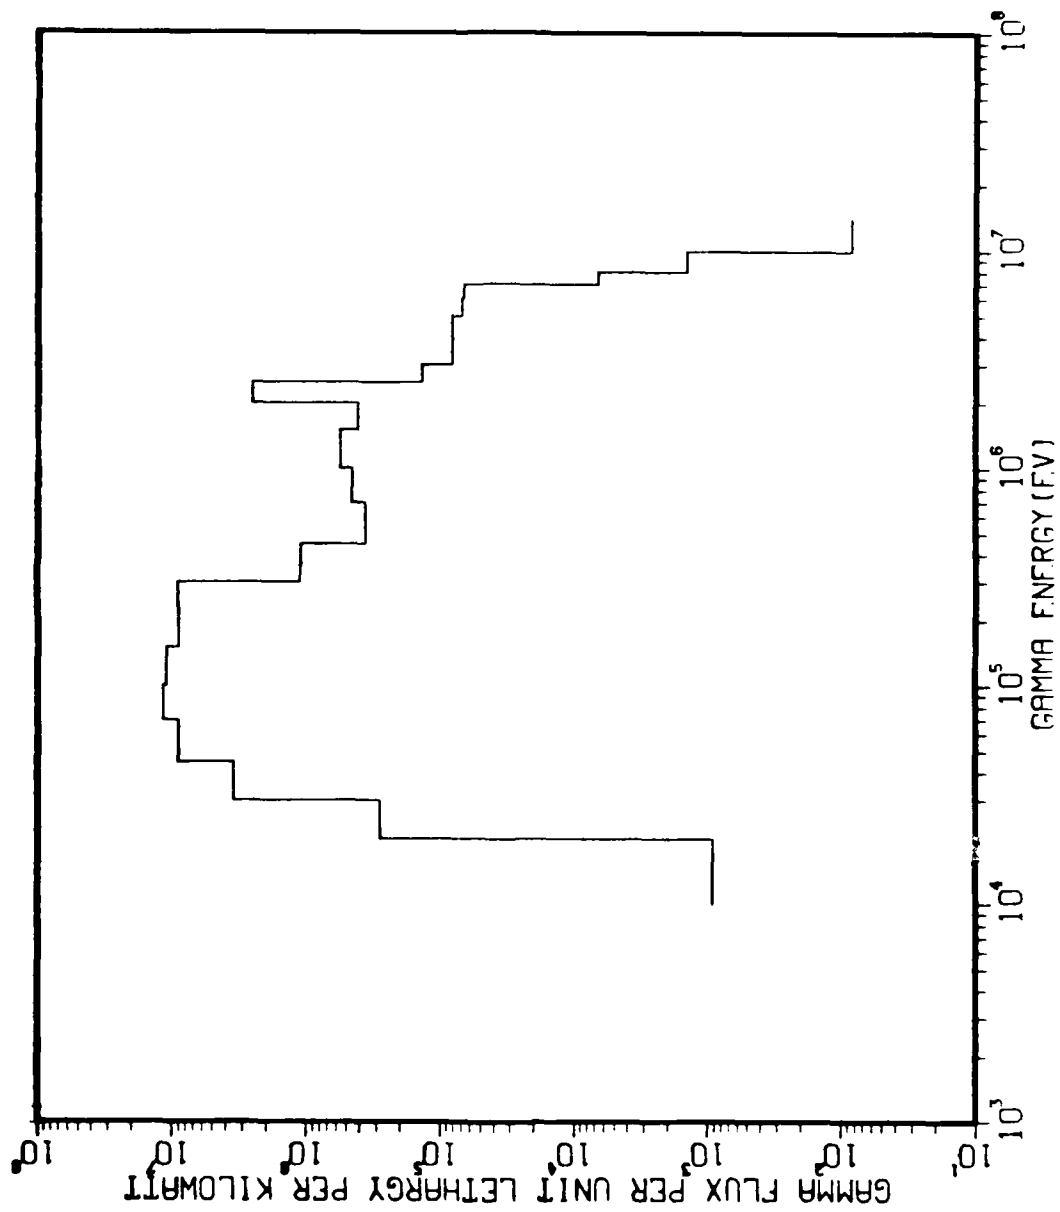


Figure II.6.40. Back Gamma Flux vs Energy Free Field ER1 500 CMS from Reactor.

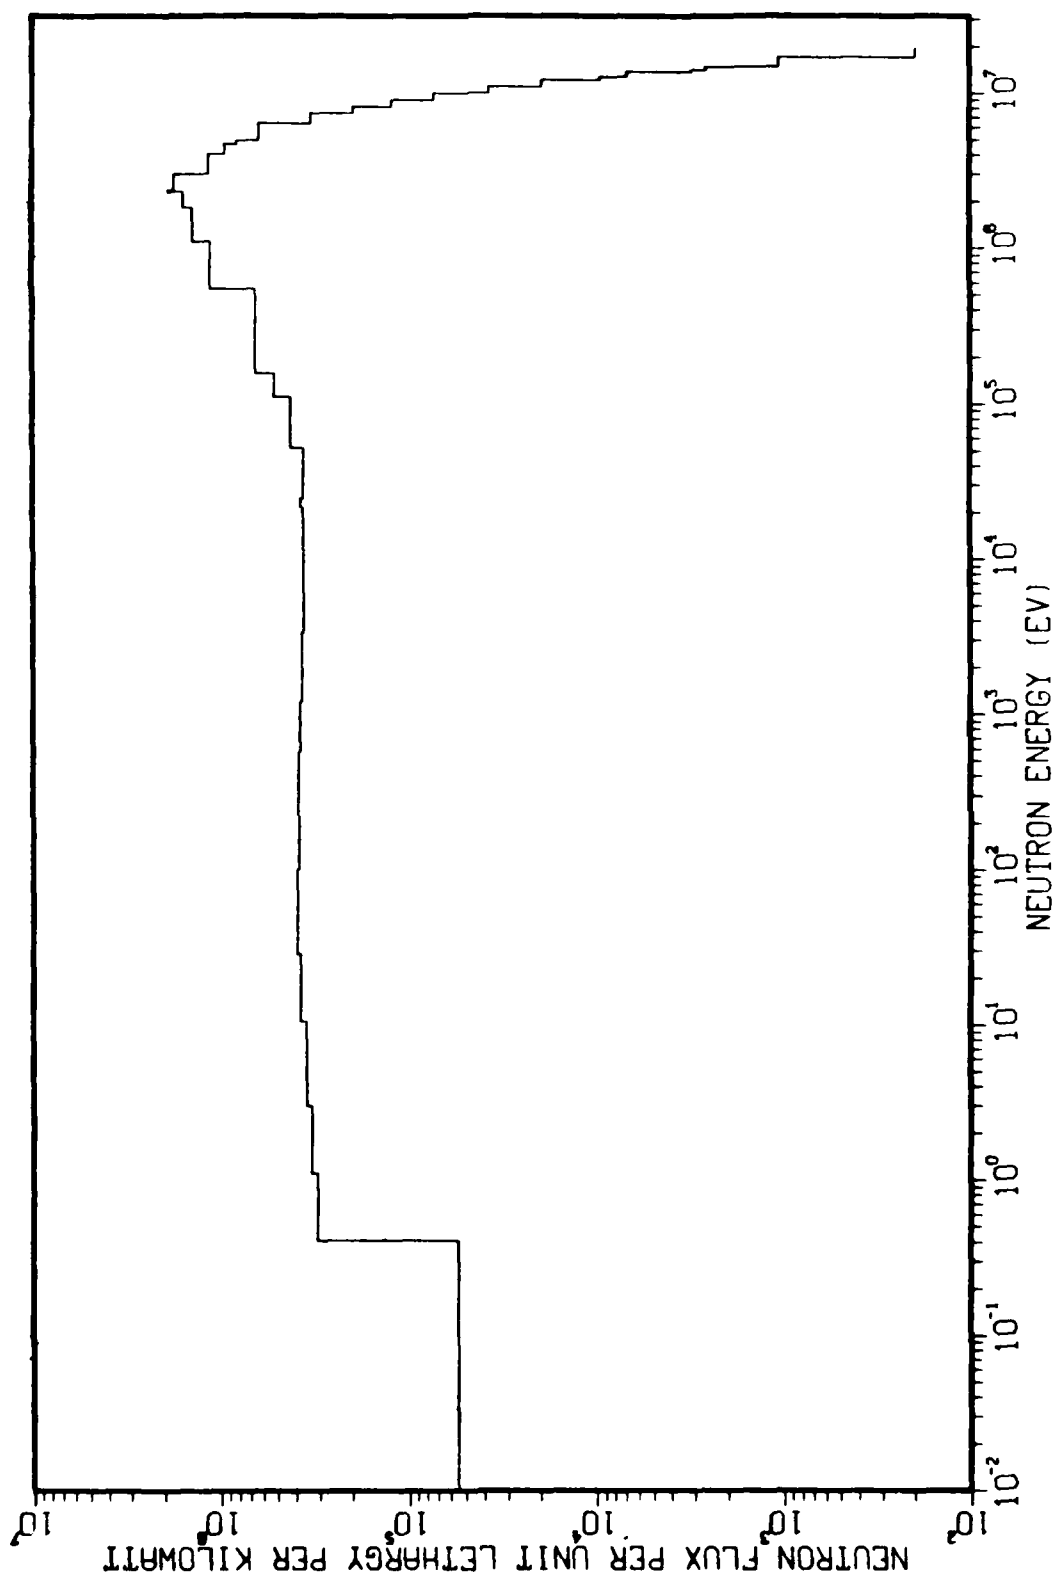


Figure II.6.41. Total Neutron Flux vs Energy Free Field ER1 500 CMS from Reactor.

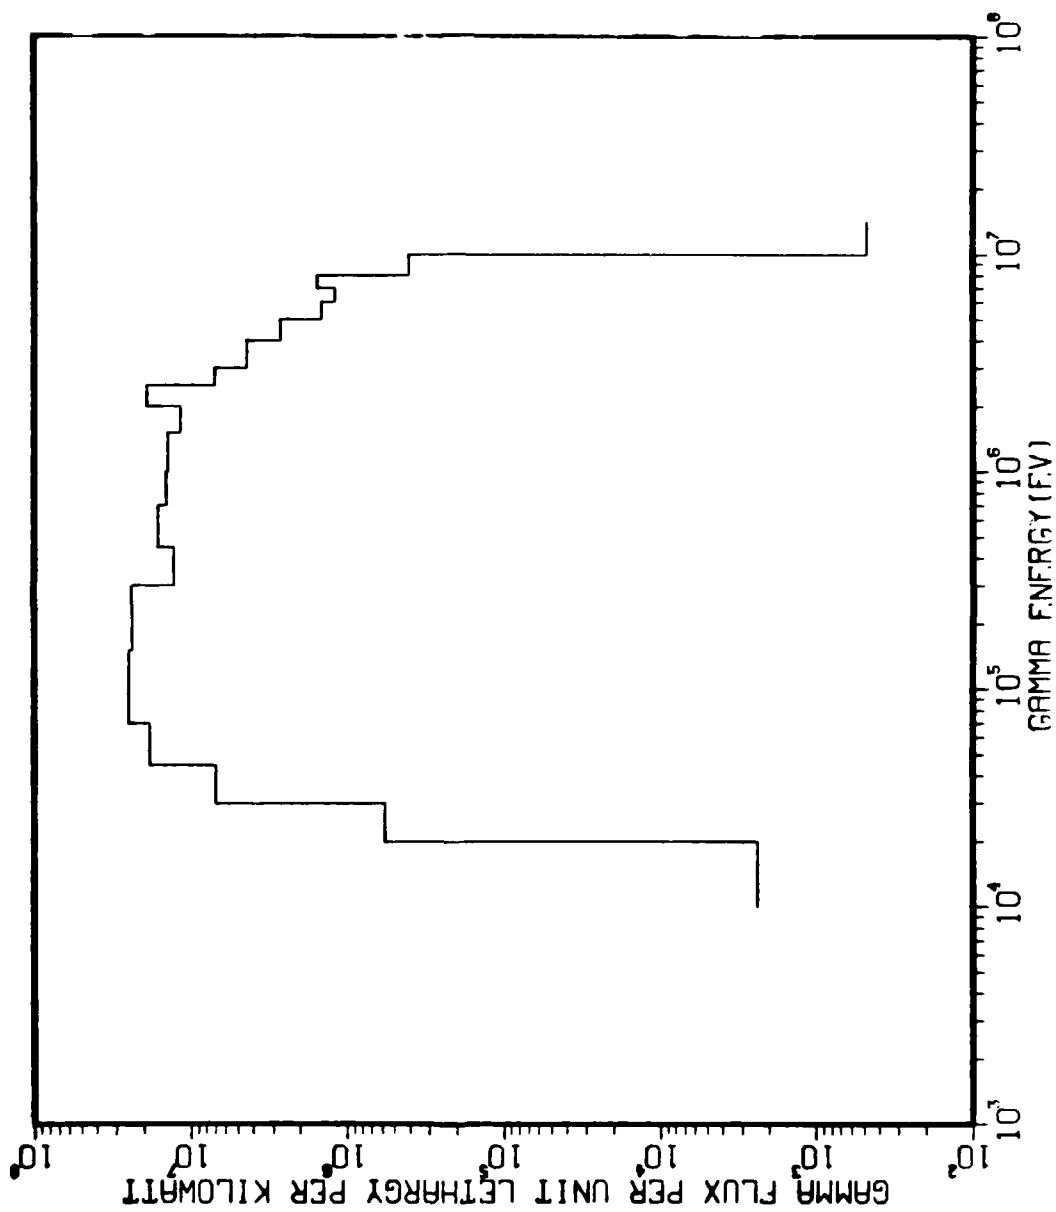


Figure II.6.42. Total Gamma Flux vs Energy Free Field ER1 500 CMS from Reactor.

Table II.6.11. Neutron Flux per Unit Lethargy per Kilowatt.

ERI FREE FIELD 500 CMS FROM REACTOR

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	1.90E+02	4.51E+00	1.95E+02
2	1.690E+07	1.02E+03	2.29E+01	1.04E+03
3	1.490E+07	2.51E+03	5.76E+01	2.56E+03
4	1.420E+07	3.02E+03	6.59E+01	3.08E+03
5	1.380E+07	6.63E+03	1.48E+02	6.78E+03
6	1.280E+07	9.20E+03	2.06E+02	9.41E+03
7	1.220E+07	1.89E+04	4.20E+02	1.93E+04
8	1.110E+07	3.66E+04	7.58E+02	3.73E+04
9	1.000E+07	7.15E+04	1.42E+03	7.29E+04
10	9.050E+06	1.19E+05	2.88E+03	1.22E+05
11	8.190E+06	1.90E+05	5.37E+03	1.95E+05
12	7.410E+06	3.17E+05	9.35E+03	3.27E+05
13	6.380E+06	5.88E+05	2.58E+04	6.14E+05
14	4.970E+06	7.64E+05	4.47E+04	8.09E+05
15	4.720E+06	8.90E+05	5.58E+04	9.46E+05
16	4.070E+06	1.06E+06	8.56E+04	1.15E+06
17	3.010E+06	1.53E+06	2.22E+05	1.75E+06
18	2.390E+06	1.68E+06	1.99E+05	1.88E+06
19	2.310E+06	1.36E+06	1.95E+05	1.56E+06
20	1.830E+06	1.19E+06	1.95E+05	1.39E+06
21	1.110E+06	9.12E+05	2.13E+05	1.12E+06
22	5.500E+05	4.95E+05	1.55E+05	6.50E+05
23	1.580E+05	3.81E+05	1.37E+05	5.18E+05
24	1.110E+05	3.05E+05	1.19E+05	4.23E+05
25	5.250E+04	2.52E+05	1.10E+05	3.62E+05
26	2.480E+04	2.64E+05	1.10E+05	3.74E+05
27	2.190E+04	2.52E+05	1.10E+05	3.63E+05
28	1.030E+04	2.45E+05	1.16E+05	3.61E+05
29	3.350E+03	2.45E+05	1.23E+05	3.68E+05
30	1.230E+03	2.48E+05	1.30E+05	3.78E+05
31	5.830E+02	2.46E+05	1.38E+05	3.84E+05
32	1.010E+02	2.45E+05	1.46E+05	3.90E+05
33	2.900E+01	2.26E+05	1.49E+05	3.75E+05
34	1.070E+01	2.01E+05	1.50E+05	3.51E+05
35	3.060E+00	1.80E+05	1.49E+05	3.29E+05
36	1.130E+00	1.61E+05	1.46E+05	3.07E+05
37	4.140E-01	2.79E+04	2.71E+04	5.49E+04

Table II.6.12. Gamma Flux per Unit Lethargy per Kilowatt.

IR1 FREE FIELD 500 CMS FROM REACTOR

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.400E+07	3.92E+02	8.40E+01	4.76E+02
2	1.000E+07	4.03E+05	1.46E+03	4.05E+05
3	8.000E+06	1.54E+06	6.73E+03	1.55E+06
4	7.000E+06	1.12E+06	6.76E+04	1.19E+06
5	6.000E+06	1.38E+06	7.00E+04	1.45E+06
6	5.000E+06	2.58E+06	8.30E+04	2.67E+06
7	4.000E+06	4.28E+06	8.30E+04	4.36E+06
8	3.000E+06	6.83E+06	1.40E+05	6.97E+06
9	2.500E+06	1.64E+07	2.65E+06	1.89E+07
10	2.000E+06	1.11E+07	4.18E+05	1.15E+07
11	1.500E+06	1.34E+07	5.66E+05	1.40E+07
12	1.000E+06	1.39E+07	4.63E+05	1.43E+07
13	7.000E+05	1.59E+07	8.66E+05	1.63E+07
14	4.500E+05	1.17E+07	1.11E+06	1.28E+07
15	3.000E+05	1.47E+07	8.92E+06	2.36E+07
16	1.500E+05	1.41E+07	1.09E+07	2.51E+07
17	1.000E+05	1.36E+07	1.16E+07	2.51E+07
18	7.000E+04	9.35E+06	8.92E+06	1.83E+07
19	4.500E+04	3.48E+06	8.45E+06	6.93E+06
20	3.000E+04	2.96E+05	2.82E+05	5.79E+05
21	2.000E+04	1.47E+03	9.26E+02	2.40E+03

Table II.6.13. Front Response as a Function of Distance in ERI.

Response	Distance from Reactor in ERI (cms)				
	50	100	200	300	500
Sulfur Activation (acts/cc-s/atom/bn-cm/kW)	2.44+7	5.70+6	1.38+6	6.15+5	2.32+5
Silicon Damage (1 MeV Equivalent n/cm ² -s/kW)	3.92+8	9.10+7	2.23+7	1.02+7	4.11+6
Neutron Dose (rads/s/kW)	1.25+0	2.91-1	7.17-2	3.32-2	1.37-2
Gamma Dose (rad/s/kW)	2.06+0	4.81-1	1.17-1	5.24-2	2.03-2
Neutron Dose (rem/s/kW)	1.10+1	2.55+0	6.22-1	2.84-1	1.14-1
Total Dose (rad/s/kW)	3.32+0	7.72-1	1.89-1	8.56-2	3.41-2
Total Dose (rem/s/kW)	1.30+1	3.03+0	7.39-1	3.37-1	1.35-1
Total Neutron Flux (n/cm ² -s/kW)	4.76+8	1.11+8	2.86+7	1.41+7	6.71+6
Neutron Flux >1 MeV (n/cm ² -s/kW)	2.20+8	5.13+7	1.25+7	5.62+6	2.18+6

Table II.6.14. Back Response as a Function of Distance in ER1.

Response	Distance from Reactor in ER1 (cms)				
	50	100	200	300	500
Sulfur Activation (acts/cc-s/atom/bn-cm/kW)	2.69+4	1.68+4	1.22+4	1.28+4	1.77+4
Silicon Damage (1 MeV Equivalent n/cm ² -s/kW)	1.41+6	1.03+6	8.35+5	7.77+5	7.55+5
Neutron Dose (rads/s/kW)	5.34-3	4.04-3	3.33-3	3.11-3	3.00-3
Gamma Dose (rad/s/kW)	2.11-3	1.86-3	1.79-3	1.87-3	2.41-3
Neutron Dose (rem/s/kW)	3.89-2	2.82-2	2.26-2	2.09-2	2.03-2
Total Dose (rad/s/kW)	7.45-3	5.90-3	5.12-3	4.98-3	5.41-3
Total Dose (rem/s/kW)	4.10-2	3.01-2	2.44-2	2.28-2	2.27-2
Total Neutron Flux (n/cm ² -s/kW)	4.46+6	3.58+6	3.08+6	2.87+6	2.66+6
Neutron Flux >1 MeV (n/cm ² -s/kW)	5.32+5	3.67+5	2.84+5	2.68+5	2.76+5

Table II.6.15. Total Response as a Function of Distance in ERI.

Response	Distance from Reactor in ERI (cms)				
	50	100	200	300	500
Sulfur Activation (acts/cc-s/atom/bn-cm/kW)	2.44+7	5.72+6	1.40+6	6.28+5	2.49+5
Silicon Damage (1 MeV Equivalent n/cm ² -s/kW)	3.93+8	9.20+7	2.31+7	1.10+7	4.87+6
Neutron Dose (rads/s/kW)	1.26+0	2.95-1	7.51-2	3.63-2	1.67-2
Gamma Dose (rad/s/kW)	2.07+0	4.83-1	1.19-1	5.43-2	2.28-2
Neutron Dose (rem/s/kW)	1.10+1	2.58+0	6.45-1	3.05-1	1.35-1
Total Dose (rad/s/kW)	3.32+0	7.78-1	1.94-1	9.06-2	3.95-2
Total Dose (rem/s/kW)	1.31+1	3.06+0	7.64-1	3.59-1	1.57-1
Total Neutron Flux (n/cm ² -s/kW)	4.81+8	1.15+8	3.17+7	1.70+7	9.37+6
Neutron Flux >1 MeV (n/cm ² -s/kW)	2.21+8	5.17+7	1.28+7	5.89+6	2.46+6

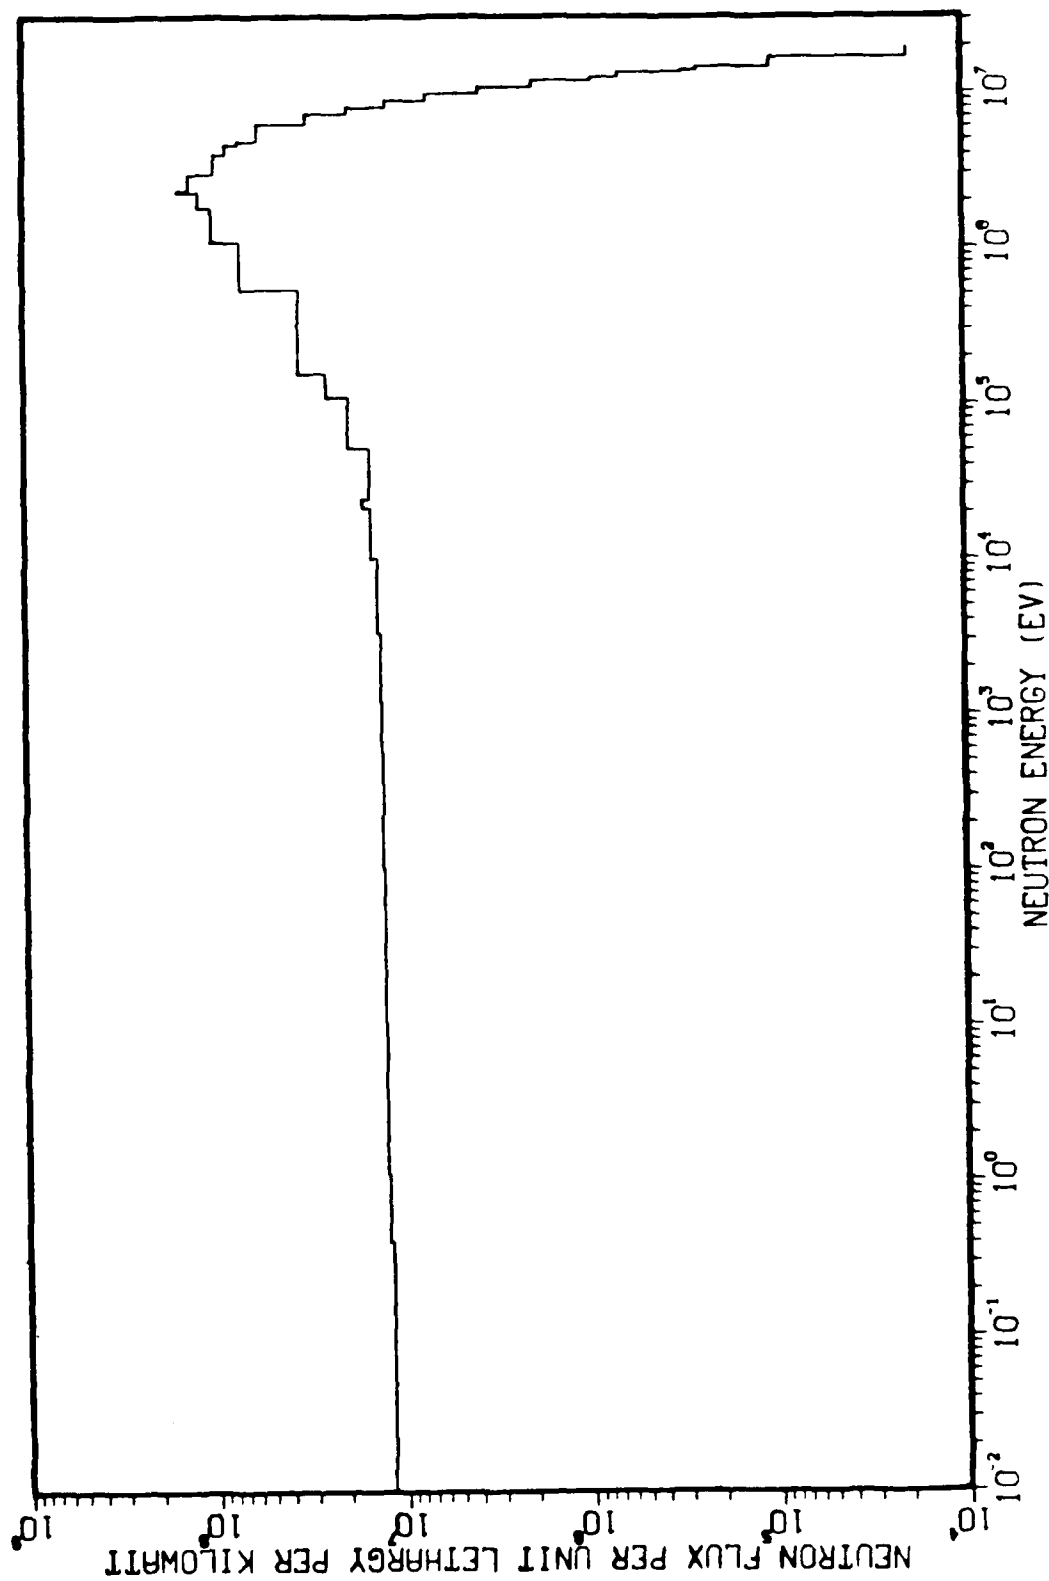


Figure II.6.43. Front (1-D) Neutron Flux vs Energy Free Field ER2 50 cms from Reactor.

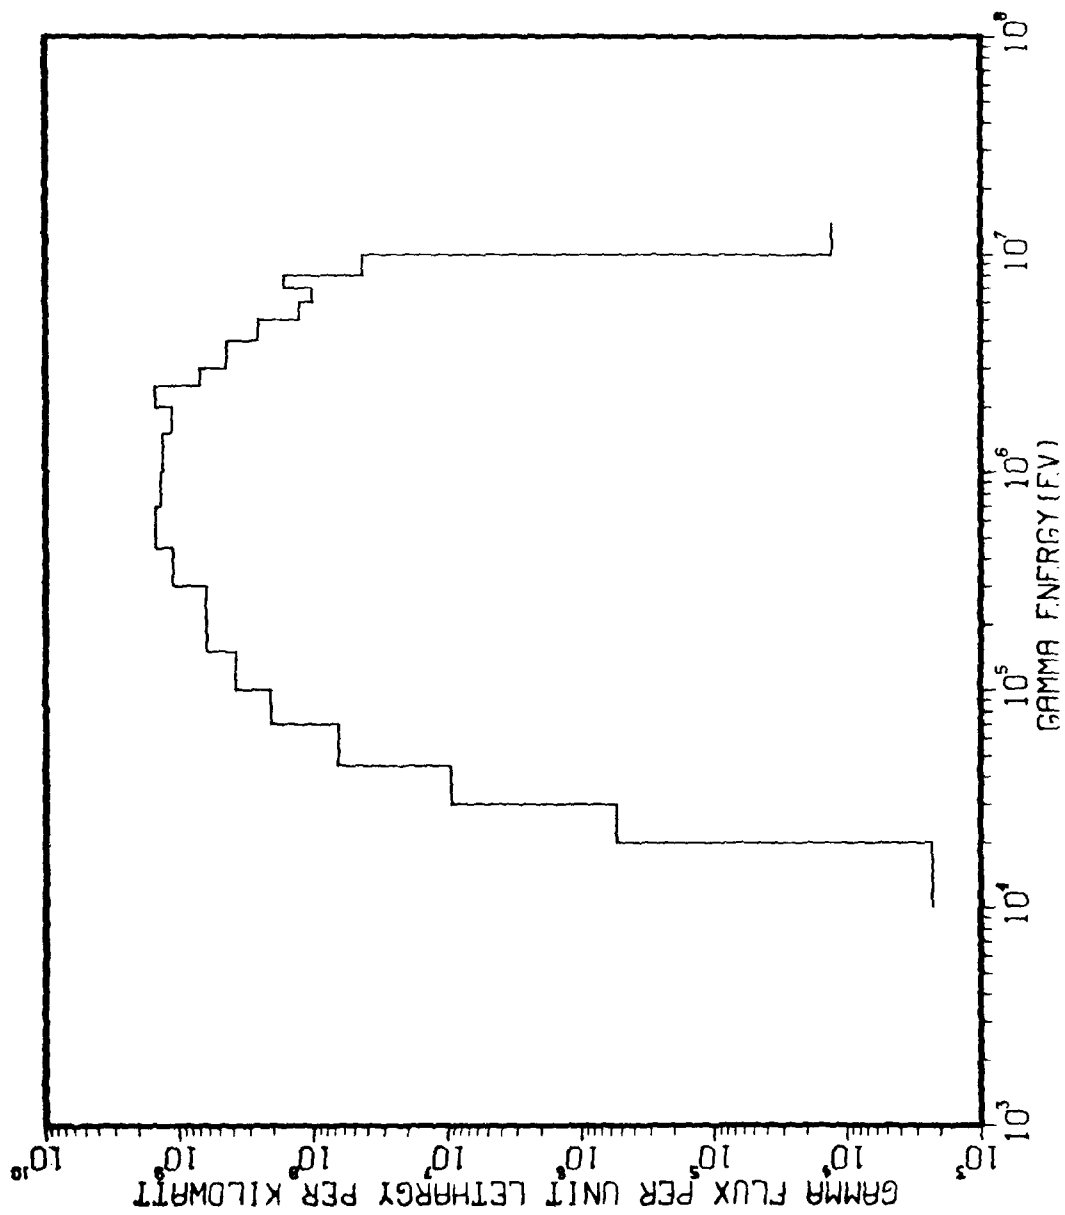


Figure II.6.44. Front Gamma Flux vs Energy Free Field ER2 50 cms from Reactor.

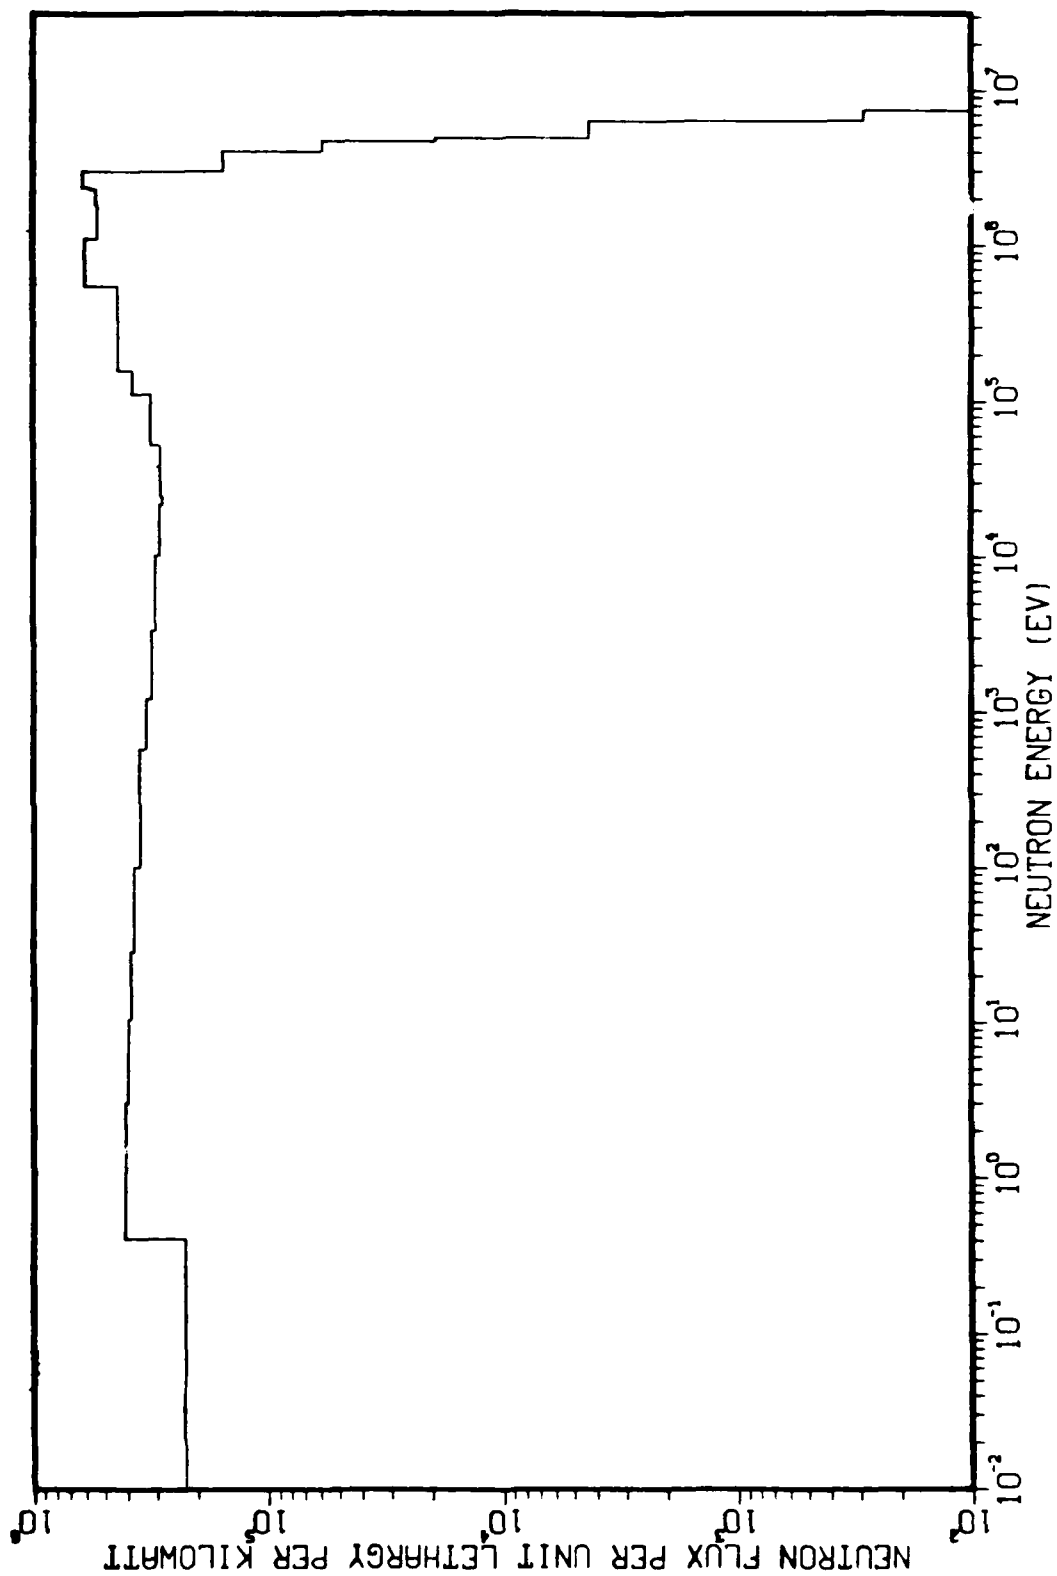


Figure II.6.45. Back (1-D) Neutron Flux vs Energy Free Field ER2 50 cms from Reactor.

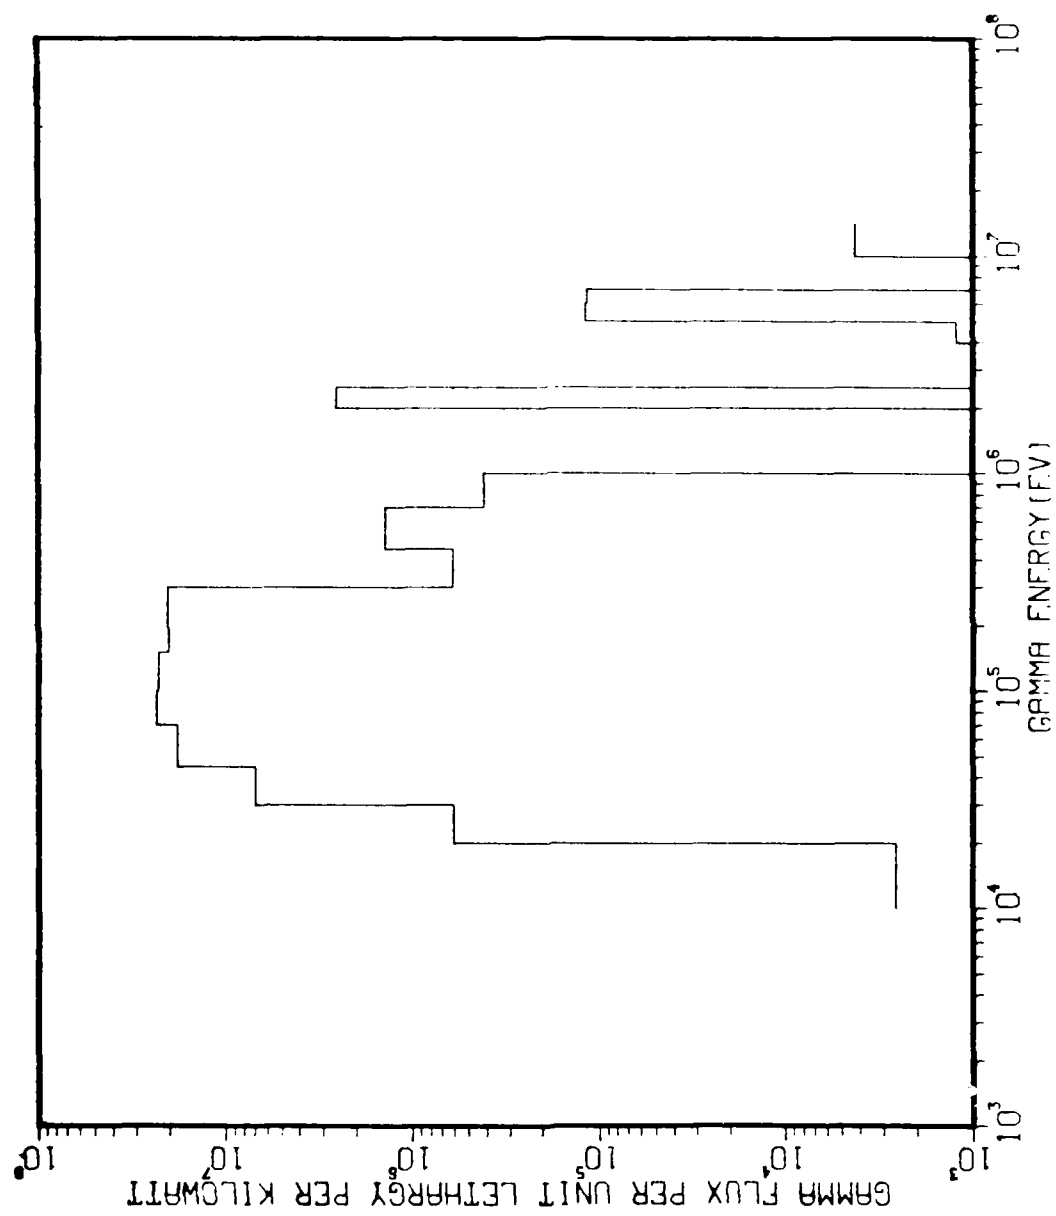


Figure II.6.46. Back Gamma Flux vs Energy Free Field ER2 50 cms from Reactor.

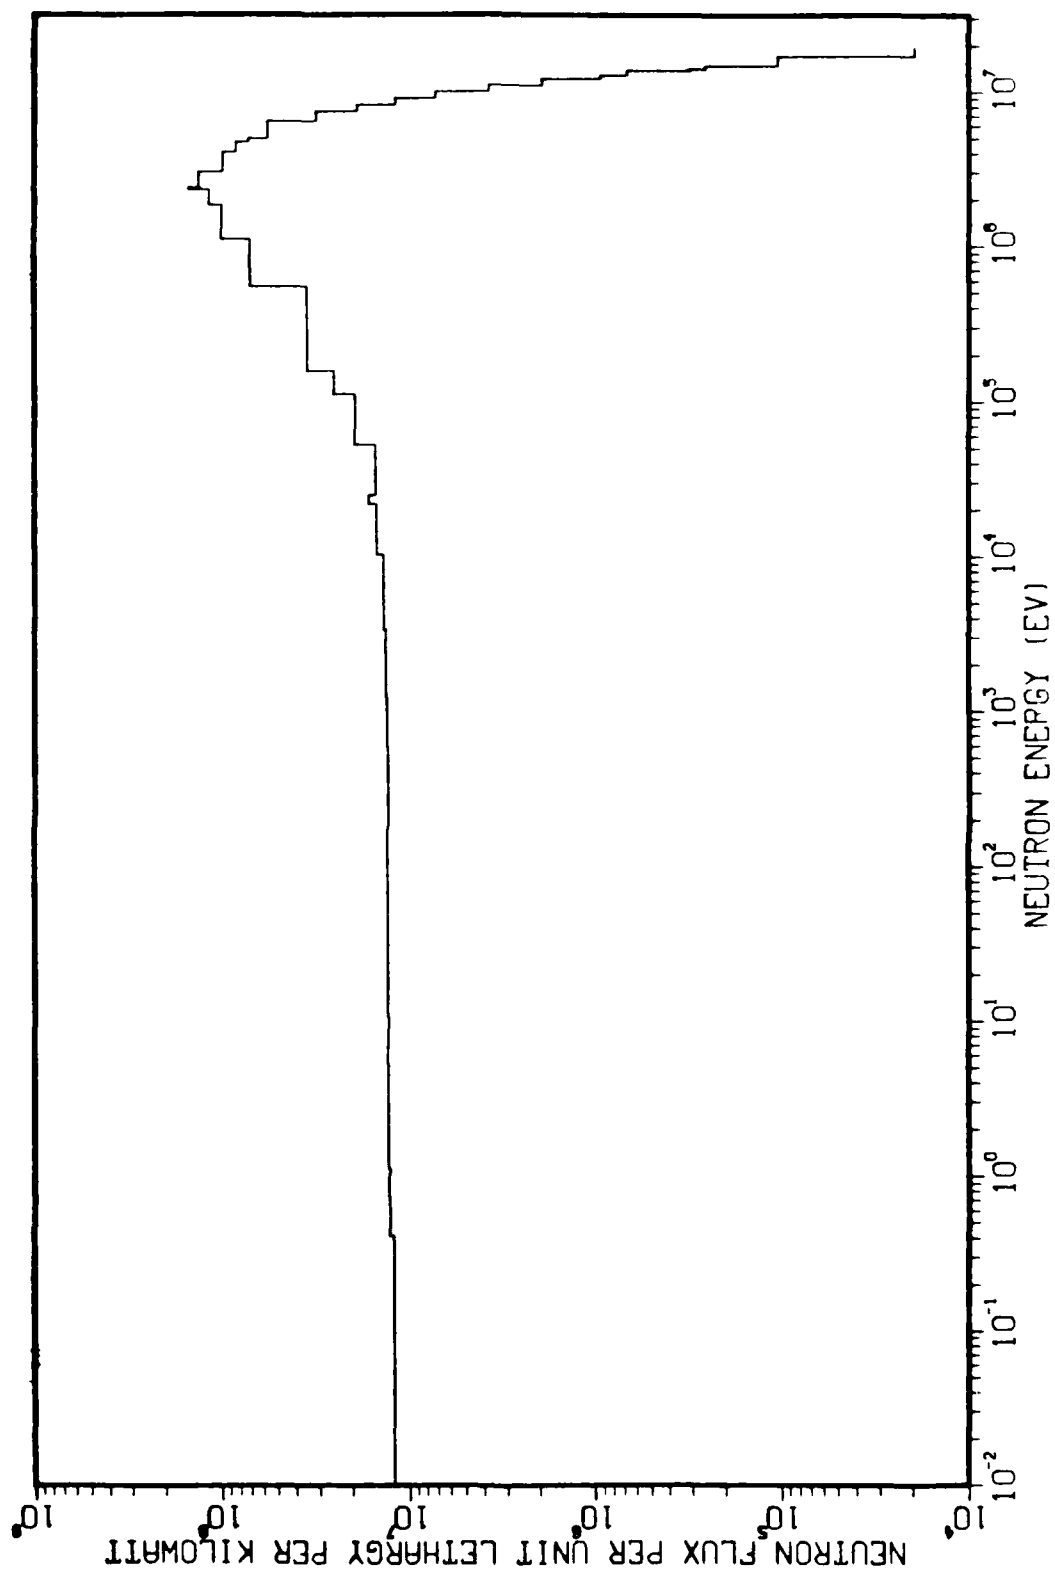


Figure 11.6.47. Total (Front+Back, 1-D) Neutron Flux vs Energy Free Field ER2 50 cms from Reactor.

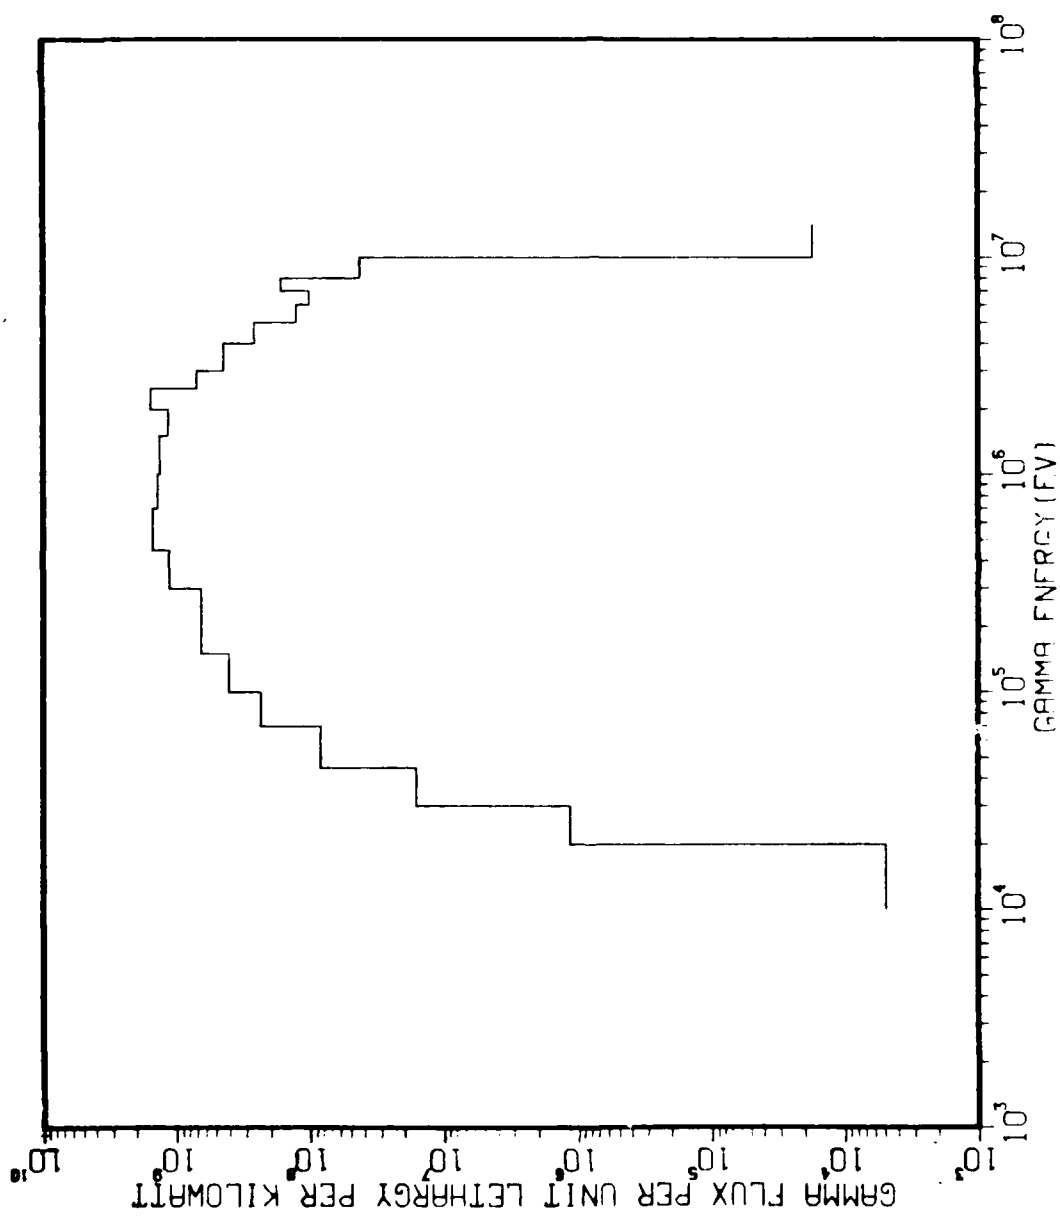


Figure II.6.48. Total (Front+Back) Gamma Flux vs Energy Free Field ER2 50 cms from Reactor.

Table II.6.16. Neutron Flux per Unit Lethargy per Kilowatt.

ER2 FREE FIELD 50 CMS FROM REACTOR				
GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	1.95E+04	0.00E+00	1.95E+04
2	1.690E+07	1.04E+05	0.00E+00	1.04E+05
3	1.490E+07	2.56E+05	0.00E+00	2.56E+05
4	1.420E+07	3.08E+05	0.00E+00	3.08E+05
5	1.380E+07	6.75E+05	0.00E+00	6.75E+05
6	1.280E+07	9.36E+05	0.00E+00	9.36E+05
7	1.220E+07	1.91E+06	0.00E+00	1.91E+06
8	1.110E+07	3.70E+06	0.00E+00	3.70E+06
9	1.000E+07	7.18E+06	0.00E+00	7.18E+06
10	9.050E+06	1.18E+07	0.00E+00	1.18E+07
11	8.190E+06	1.89E+07	0.00E+00	1.89E+07
12	7.410E+06	3.11E+07	2.89E+02	3.11E+07
13	6.380E+06	5.65E+07	4.27E+03	5.65E+07
14	4.970E+06	7.19E+07	1.92E+04	7.19E+07
15	4.720E+06	8.39E+07	5.83E+04	8.39E+07
16	4.070E+06	9.75E+07	1.53E+05	9.77E+07
17	3.010E+06	1.32E+08	6.11E+05	1.32E+08
18	2.390E+06	1.50E+08	5.71E+05	1.50E+08
19	2.310E+06	1.17E+08	5.36E+05	1.17E+08
20	1.830E+06	9.98E+07	5.28E+05	1.00E+08
21	1.110E+06	7.04E+07	5.98E+05	7.10E+07
22	5.500E+05	3.46E+07	4.32E+05	3.51E+07
23	1.580E+05	2.49E+07	3.78E+05	2.53E+07
24	1.110E+05	1.92E+07	3.14E+05	1.95E+07
25	5.250E+04	1.48E+07	2.87E+05	1.51E+07
26	2.480E+04	1.60E+07	2.81E+05	1.63E+07
27	2.190E+04	1.46E+07	2.89E+05	1.49E+07
28	1.030E+04	1.34E+07	3.01E+05	1.37E+07
29	3.350E+03	1.30E+07	3.15E+05	1.33E+07
30	1.230E+03	1.29E+07	3.32E+05	1.32E+07
31	5.830E+02	1.27E+07	3.53E+05	1.31E+07
32	1.010E+02	1.27E+07	3.74E+05	1.31E+07
33	2.900E+01	1.27E+07	3.86E+05	1.30E+07
34	1.070E+01	1.25E+07	3.96E+05	1.29E+07
35	3.060E+00	1.25E+07	4.05E+05	1.29E+07
36	1.130E+00	1.22E+07	4.08E+05	1.26E+07
37	4.140E-01	1.18E+07	2.27E+05	1.21E+07

Table II.6.17. Gamma Flux per Unit Lethargy per Kilowatt.

EP2 FREE FIELD 50 CMS FROM REACTOR

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.400E+07	1.30E+04	4.27E+03	1.73E+04
2	1.000E+07	4.26E+07	0.00E+00	4.26E+07
3	8.000E+06	1.66E+08	0.00E+00	1.66E+08
4	7.000E+06	1.01E+08	1.15E+05	1.01E+08
5	6.000E+06	1.28E+08	1.17E+05	1.28E+08
6	5.000E+06	2.60E+08	1.22E+03	2.60E+08
7	4.000E+06	4.40E+08	0.00E+00	4.40E+08
8	3.000E+06	7.03E+08	0.00E+00	7.03E+08
9	2.500E+06	1.54E+09	2.53E+06	1.54E+09
10	2.000E+06	1.14E+09	0.00E+00	1.14E+09
11	1.500E+06	1.33E+09	0.00E+00	1.33E+09
12	1.000E+06	1.39E+09	4.13E+05	1.39E+09
13	7.000E+05	1.50E+09	1.39E+06	1.50E+09
14	4.500E+05	1.12E+09	6.02E+05	1.12E+09
15	3.000E+05	6.33E+08	2.02E+07	6.53E+08
16	1.500E+05	3.82E+08	2.29E+07	4.05E+08
17	1.000E+05	2.10E+08	2.34E+07	2.33E+08
18	7.000E+04	6.59E+07	1.80E+07	8.38E+07
19	4.500E+04	9.43E+06	6.89E+06	1.63E+07
20	3.000E+04	5.40E+05	6.03E+05	1.14E+06
21	2.000E+04	2.31E+03	2.57E+03	4.88E+03

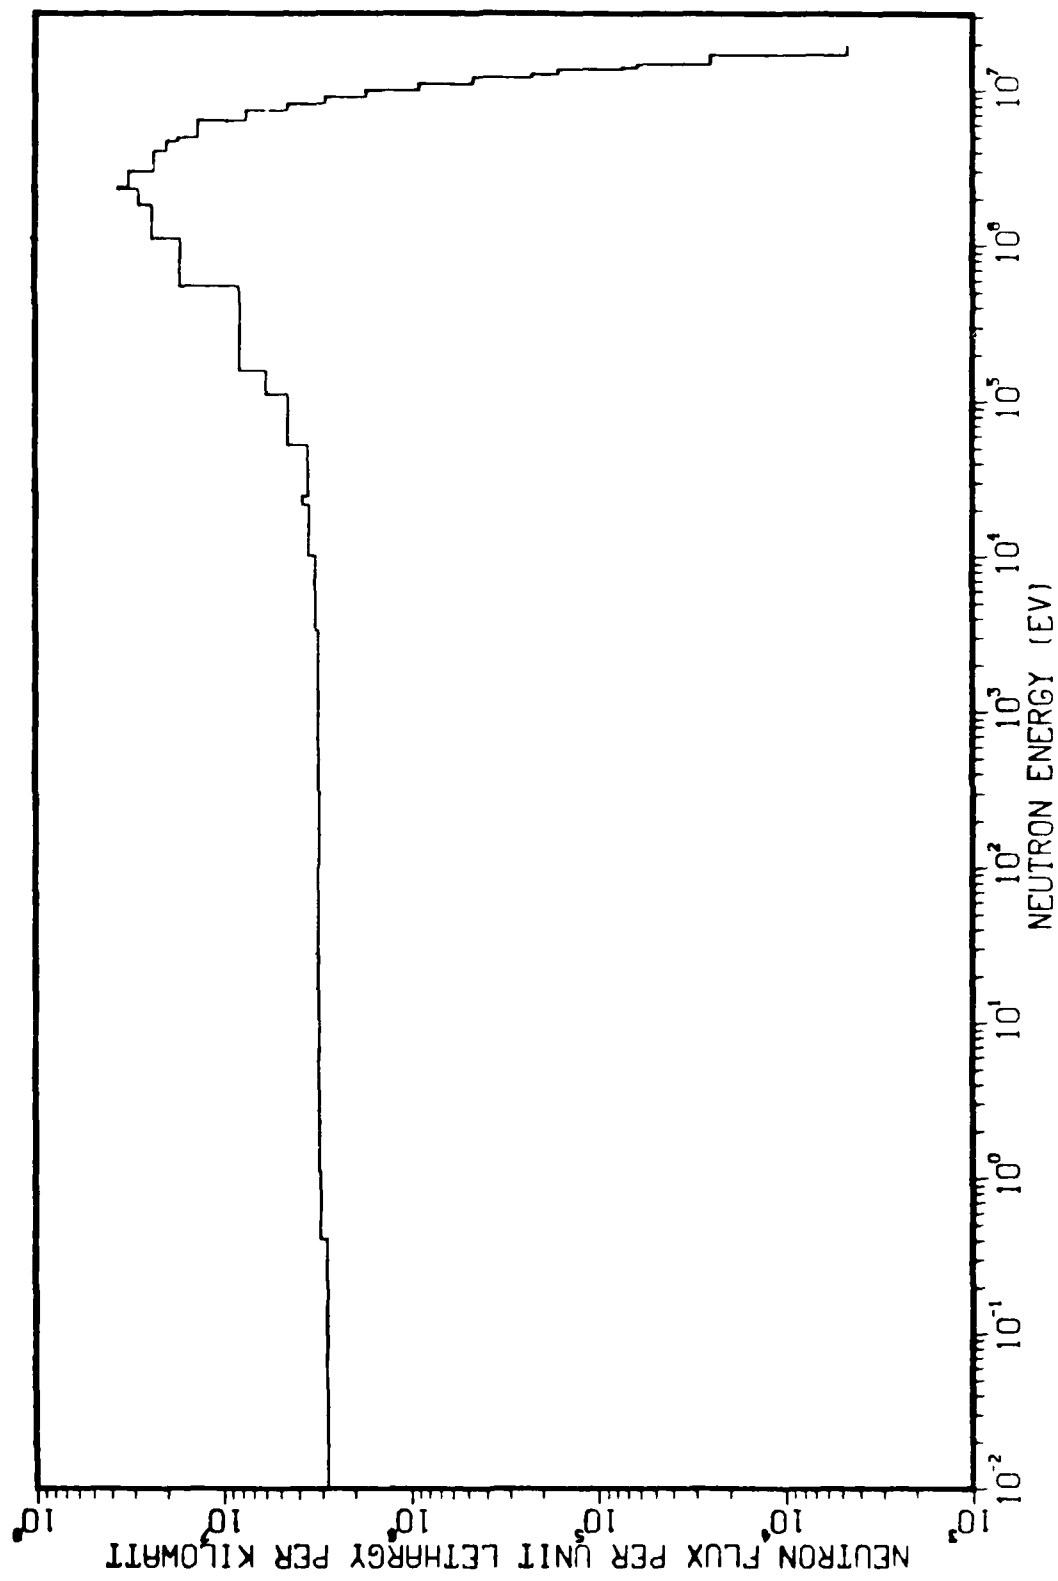


Figure II.6.49. Front (1-D) Neutron Flux vs Energy Free Field ER2 100 cms from Reactor.

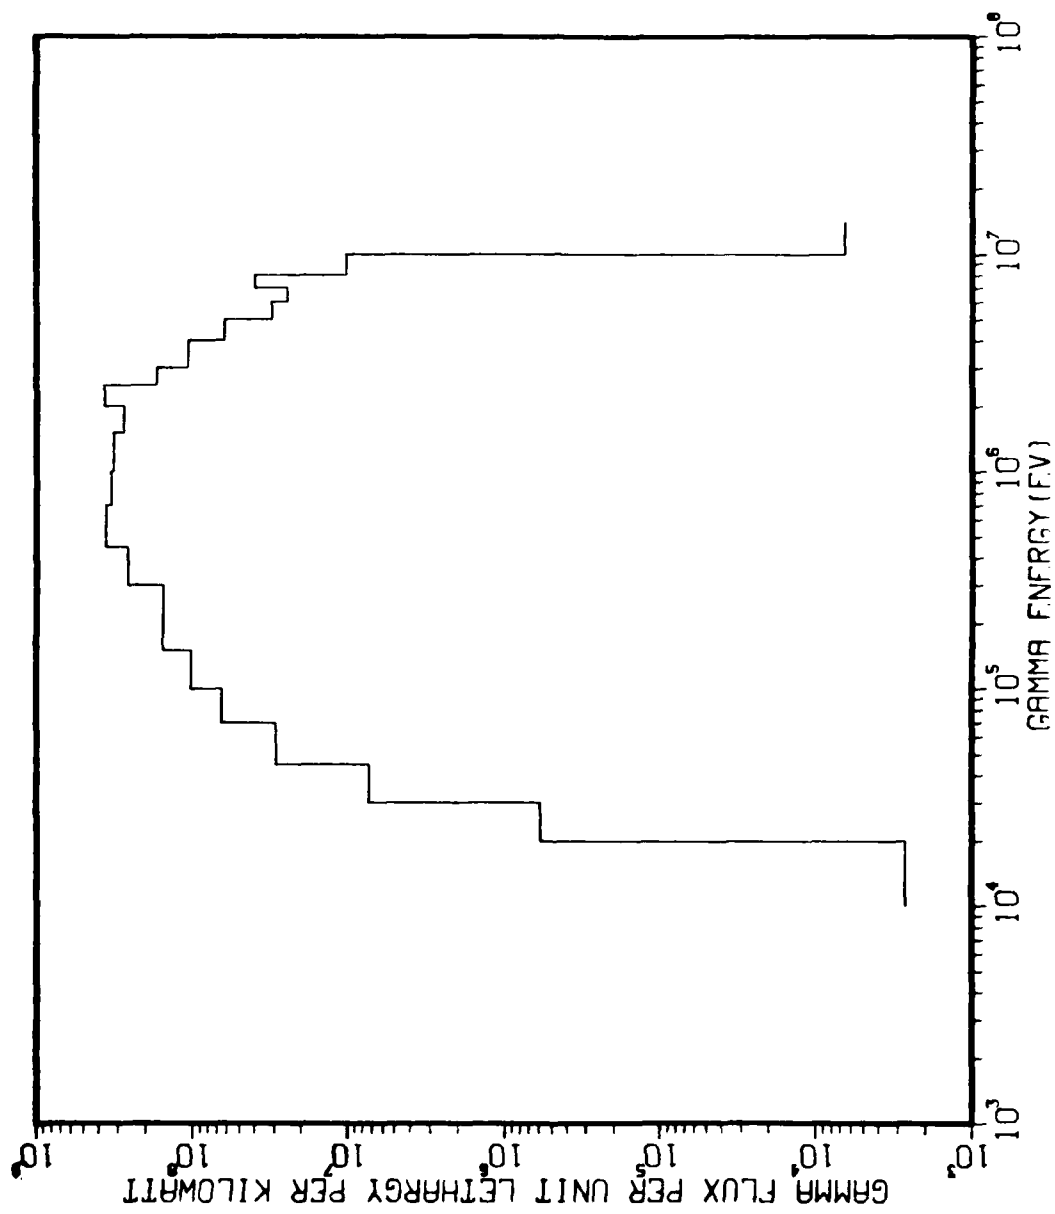


Figure II.6.50. Front Gamma Flux vs Energy Free Field ER2 100 cms from Reactor.

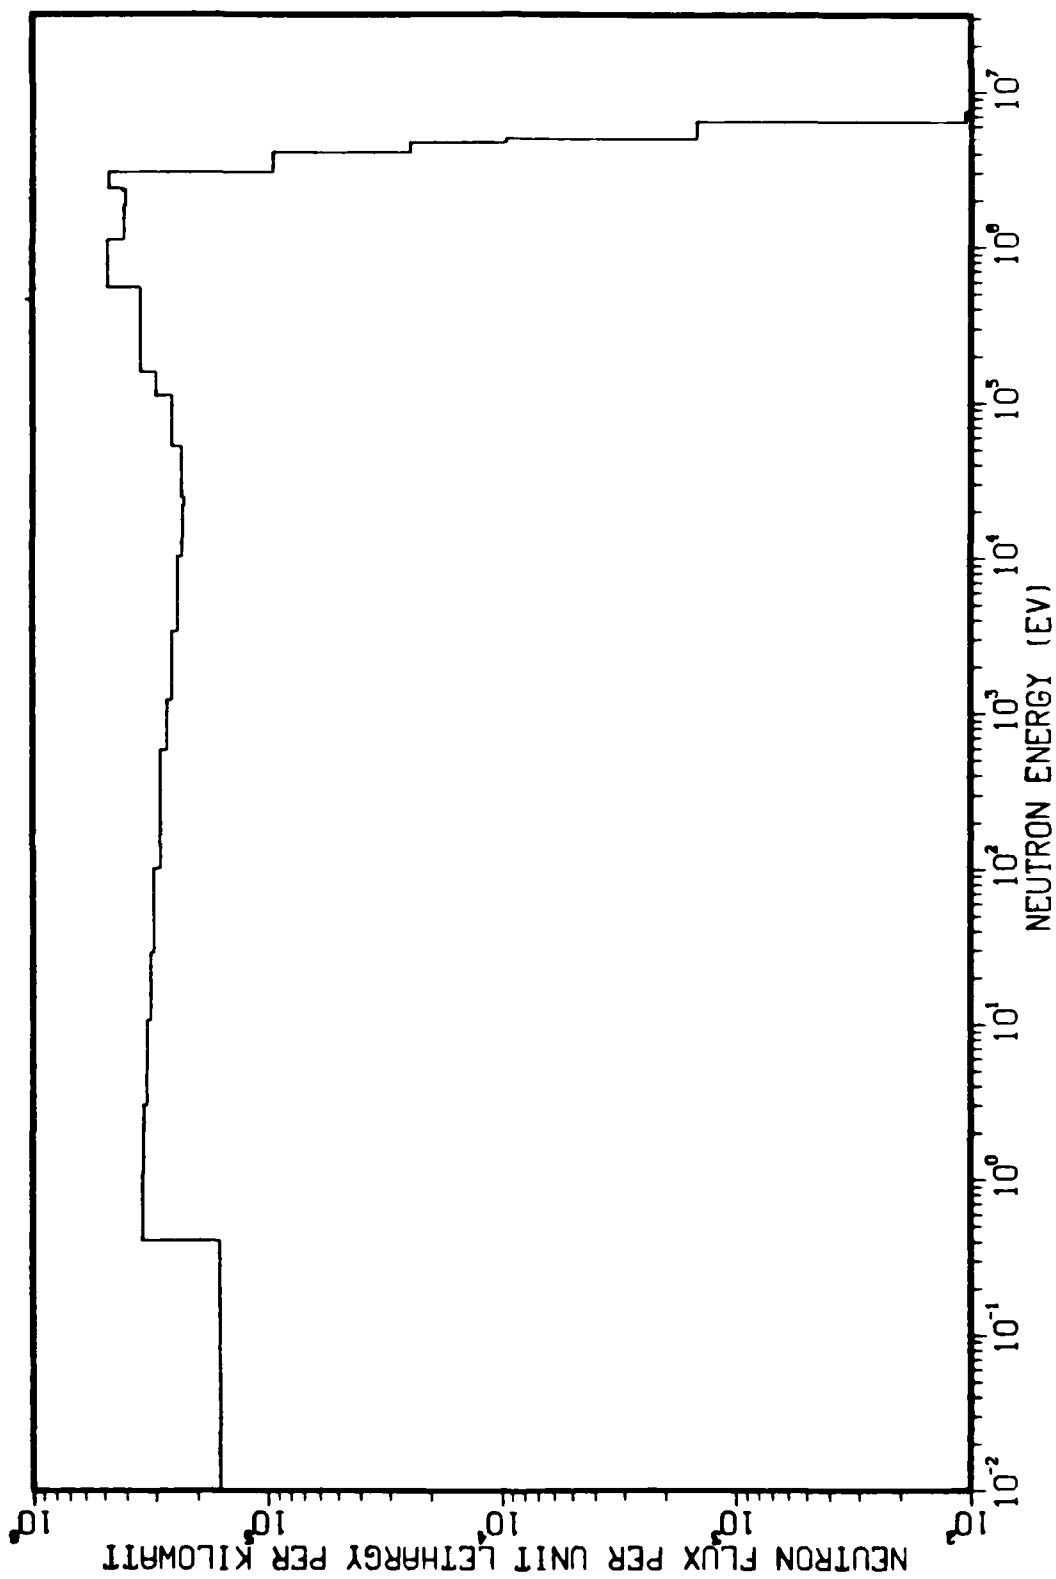


Figure 11.6.51. Back (1-D) Neutron Flux vs Energy Free Field ER2 100 cms from Reactor.

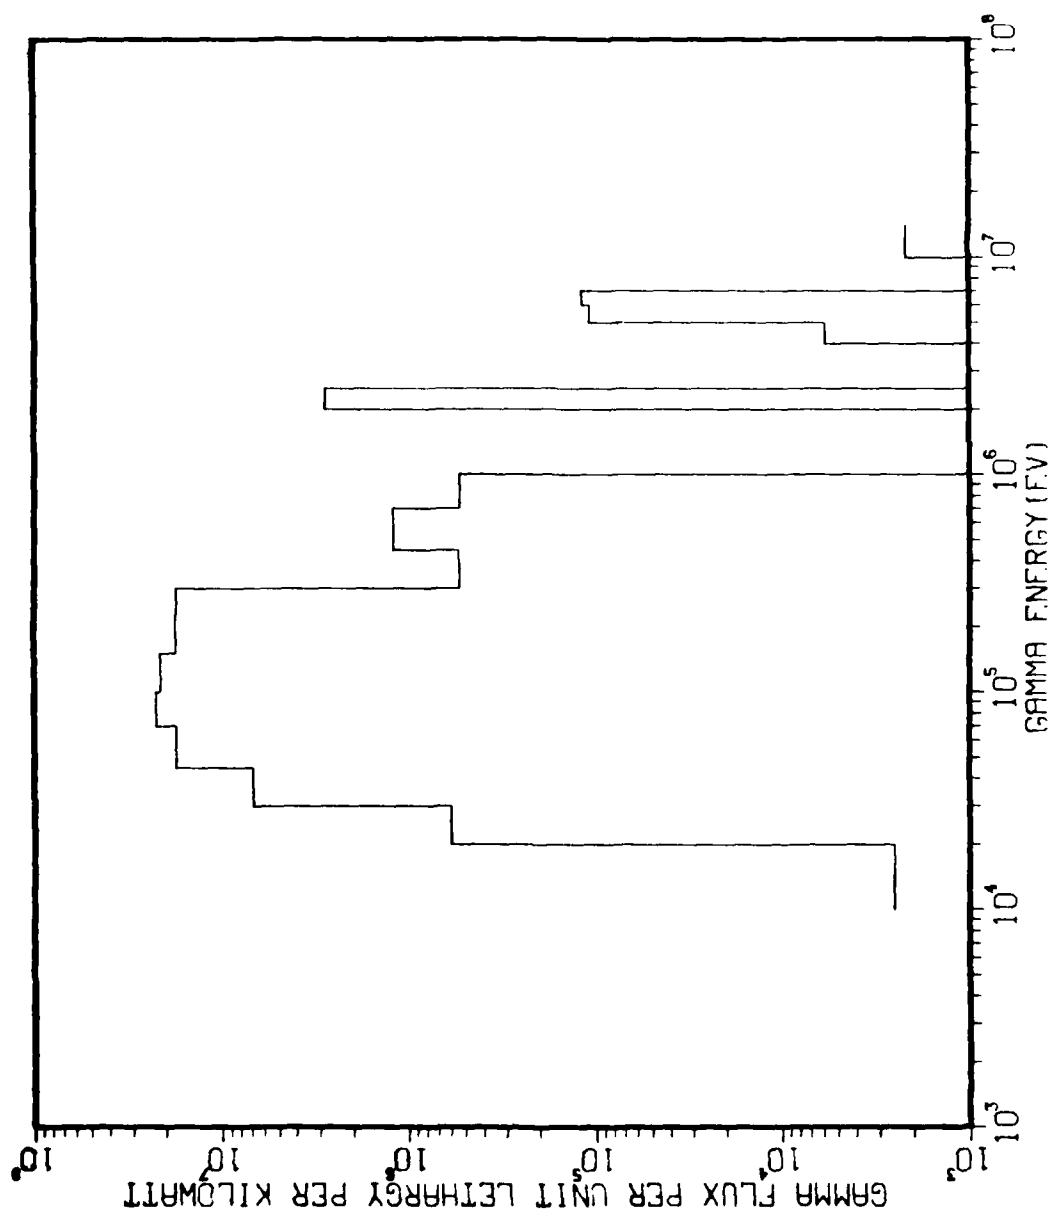


Figure II.6.52. Back Gamma Flux vs Energy Free Field ER2 100 cms from Reactor.

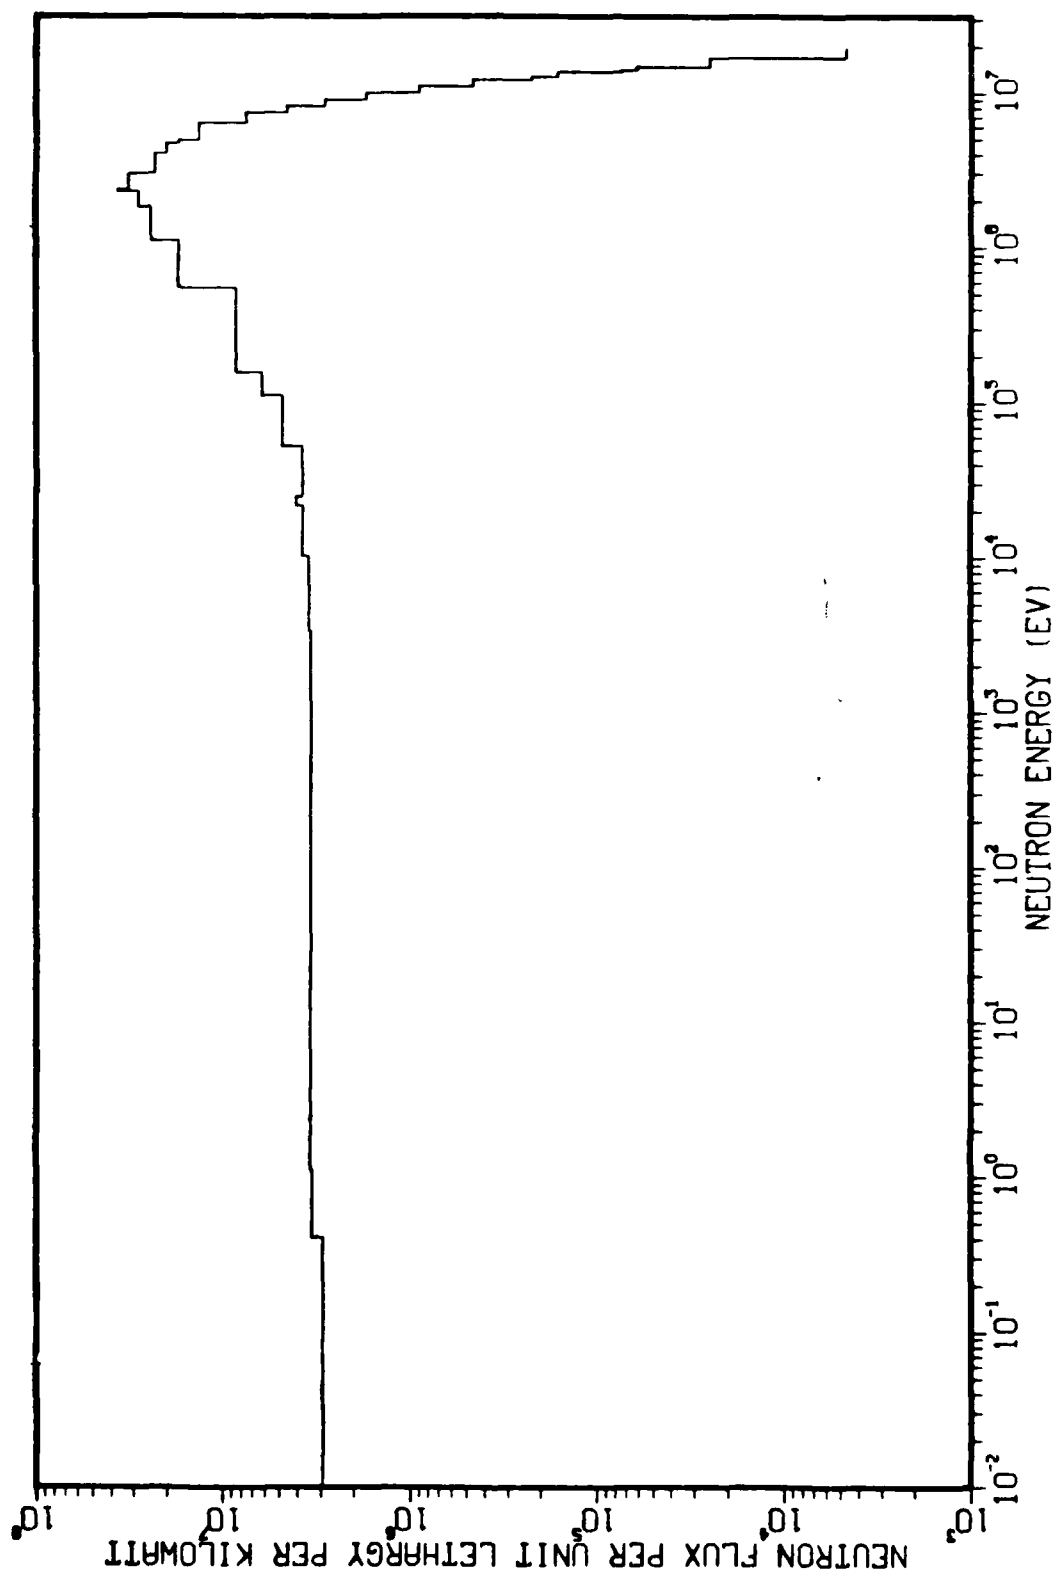


Figure 11.6.53. Total (Front+Back, 1-D) Neutron Flux vs Energy Free Field ER2
100 cms from Reactor.

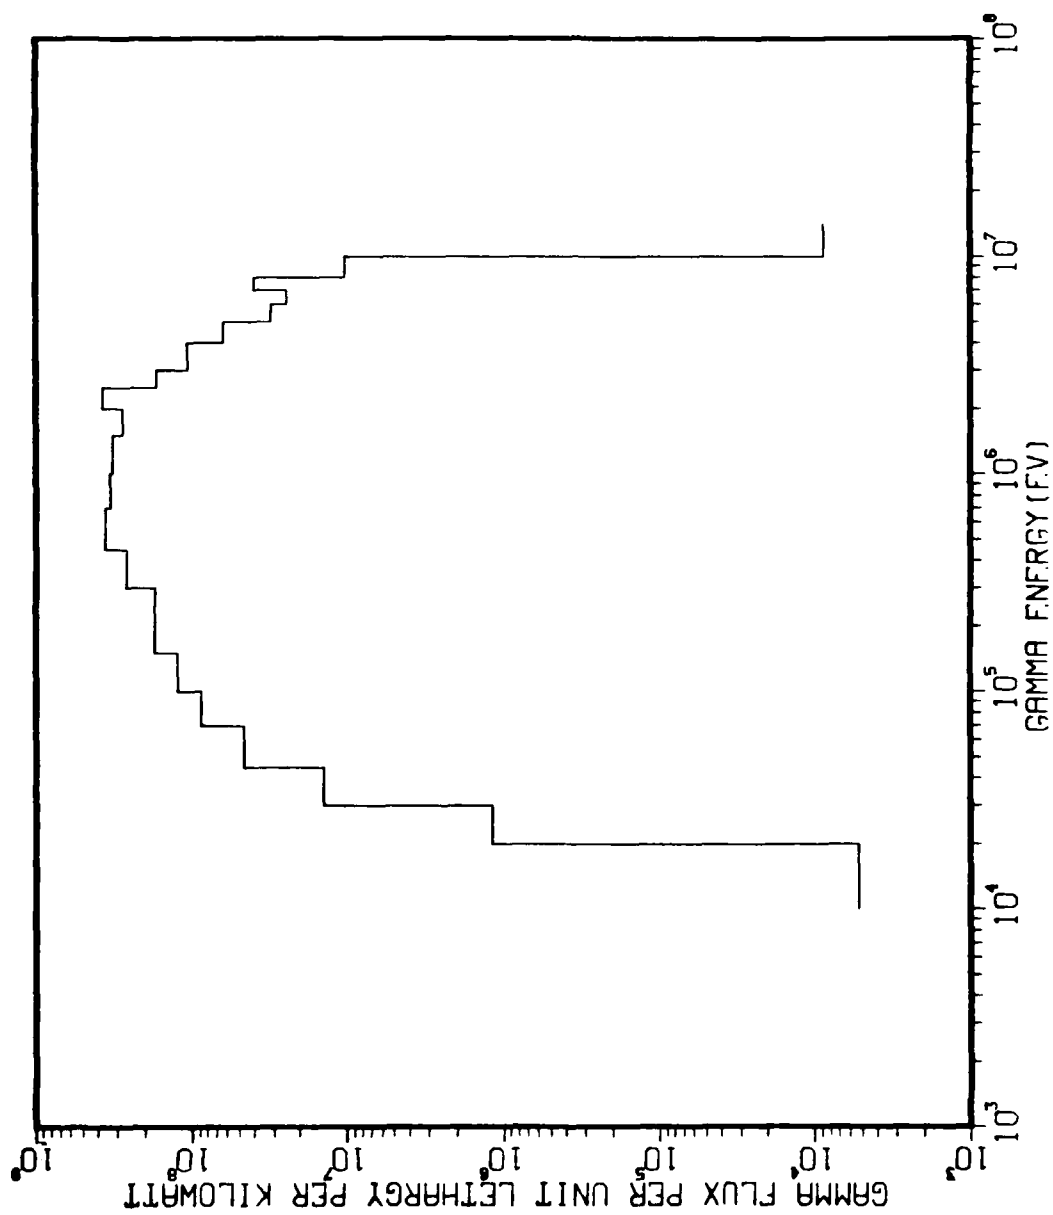


Figure II.6.54. Total (Back+Front) Gamma Flux vs Energy Free Field ER2 100 cms from Reactor.

Table II.6.18. Neutron Flux per Unit Lethargy per Kilowatt.

ERG FREE FIELD 100 CMS FROM REACTOR

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	4.68E+03	0.00E+00	4.68E+03
2	1.690E+07	2.50E+04	0.00E+00	2.50E+04
3	1.490E+07	6.15E+04	0.00E+00	6.15E+04
4	1.420E+07	7.41E+04	0.00E+00	7.41E+04
5	1.380E+07	1.62E+05	0.00E+00	1.62E+05
6	1.280E+07	2.25E+05	0.00E+00	2.25E+05
7	1.220E+07	4.59E+05	0.00E+00	4.59E+05
8	1.110E+07	8.88E+05	0.00E+00	8.88E+05
9	1.000E+07	1.73E+06	0.00E+00	1.73E+06
10	9.050E+06	2.84E+06	0.00E+00	2.84E+06
11	8.190E+06	4.53E+06	0.00E+00	4.53E+06
12	7.410E+06	7.49E+06	1.06E+02	7.49E+06
13	6.380E+06	1.36E+07	1.47E+03	1.36E+07
14	4.970E+06	1.72E+07	9.53E+03	1.73E+07
15	4.720E+06	2.01E+07	2.47E+04	2.01E+07
16	4.070E+06	2.32E+07	9.54E+04	2.33E+07
17	3.010E+06	3.17E+07	4.73E+05	3.21E+07
18	2.390E+06	3.60E+07	4.17E+05	3.64E+07
19	2.310E+06	2.80E+07	4.04E+05	2.84E+07
20	1.830E+06	2.38E+07	4.08E+05	2.43E+07
21	1.110E+06	1.68E+07	4.80E+05	1.73E+07
22	8.500E+05	8.19E+06	3.48E+05	8.54E+06
23	1.580E+05	5.89E+06	3.00E+05	6.19E+06
24	1.110E+05	4.55E+06	2.55E+05	4.81E+06
25	8.250E+04	3.54E+06	2.33E+05	3.77E+06
26	2.480E+04	3.80E+06	2.29E+05	4.02E+06
27	2.190E+04	3.49E+06	2.31E+05	3.72E+06
28	1.030E+04	3.23E+06	2.42E+05	3.47E+06
29	3.350E+03	3.14E+06	2.55E+05	3.39E+06
30	1.230E+03	3.13E+06	2.69E+05	3.40E+06
31	8.830E+02	3.10E+06	2.88E+05	3.39E+06
32	1.010E+02	3.11E+06	3.06E+05	3.42E+06
33	2.900E+01	3.12E+06	3.18E+05	3.43E+06
34	1.070E+01	3.09E+06	3.28E+05	3.42E+06
35	3.060E+00	3.09E+06	3.37E+05	3.43E+06
36	1.130E+00	3.04E+06	3.42E+05	3.38E+06
37	4.140E-01	2.79E+06	1.89E+05	2.95E+06

Table II.6.19. Gamma Flux per Unit Lethargy per Kilowatt.

KR2 FREE FIELD 100 CMS FROM REACTOR

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.400E+07	6.62E+03	2.17E+03	8.79E+03
2	1.000E+07	1.03E+07	0.00E+00	1.03E+07
3	8.900E+06	3.98E+07	0.00E+00	3.98E+07
4	7.000E+06	2.44E+07	1.19E+05	2.45E+07
5	6.000E+06	3.08E+07	1.08E+05	3.09E+07
6	5.000E+06	6.26E+07	5.84E+03	6.26E+07
7	4.000E+06	1.06E+08	0.00E+00	1.06E+08
8	3.000E+06	1.69E+08	0.00E+00	1.69E+08
9	2.500E+06	3.68E+08	2.78E+06	3.71E+08
10	2.000E+06	2.74E+08	0.00E+00	2.74E+08
11	1.500E+06	3.18E+08	0.00E+00	3.18E+08
12	1.000E+06	3.33E+08	5.38E+05	3.33E+08
13	7.000E+05	3.55E+08	1.22E+06	3.57E+08
14	4.500E+05	2.60E+08	5.42E+05	2.61E+08
15	3.000E+05	1.55E+08	1.76E+07	1.72E+08
16	1.500E+05	1.03E+08	2.13E+07	1.24E+08
17	1.000E+05	6.48E+07	2.24E+07	8.72E+07
18	7.000E+04	2.91E+07	1.76E+07	4.66E+07
19	4.500E+04	7.41E+06	6.82E+06	1.42E+07
20	3.000E+04	5.93E+05	5.98E+05	1.19E+06
21	2.000E+04	2.68E+03	2.52E+03	5.20E+03

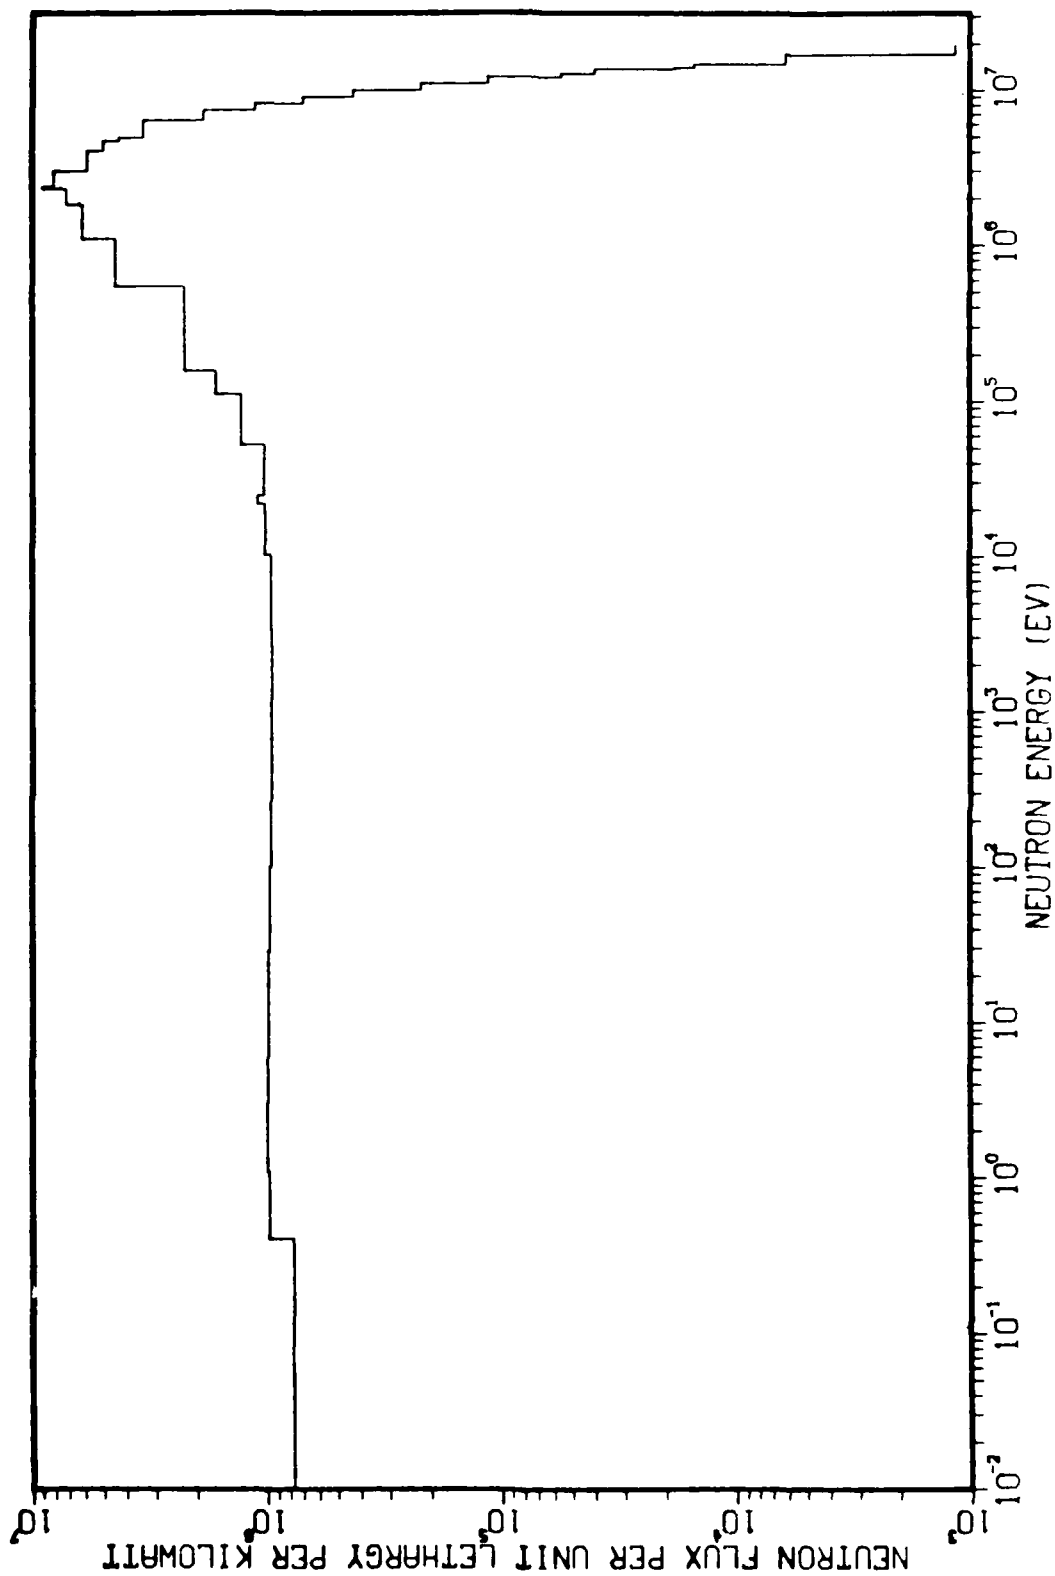


Figure II.6.55. Front (1-D) Neutron Flux vs Energy Free Field ER2 200 cms from Reactor.

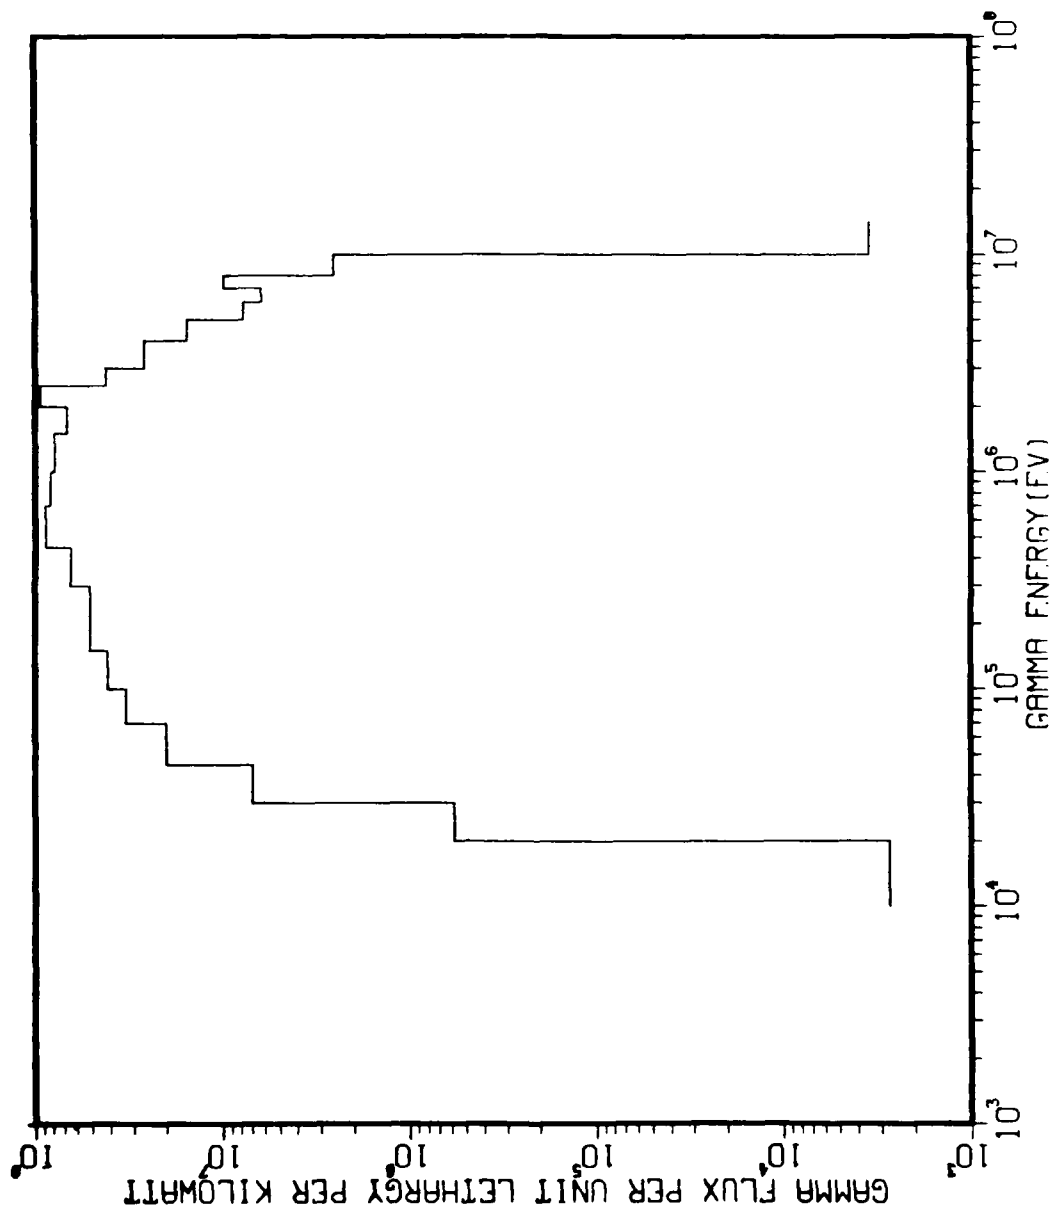


Figure II.6.56. Front Gamma Flux vs Energy Free Field ER2 200 cms from Reactor.

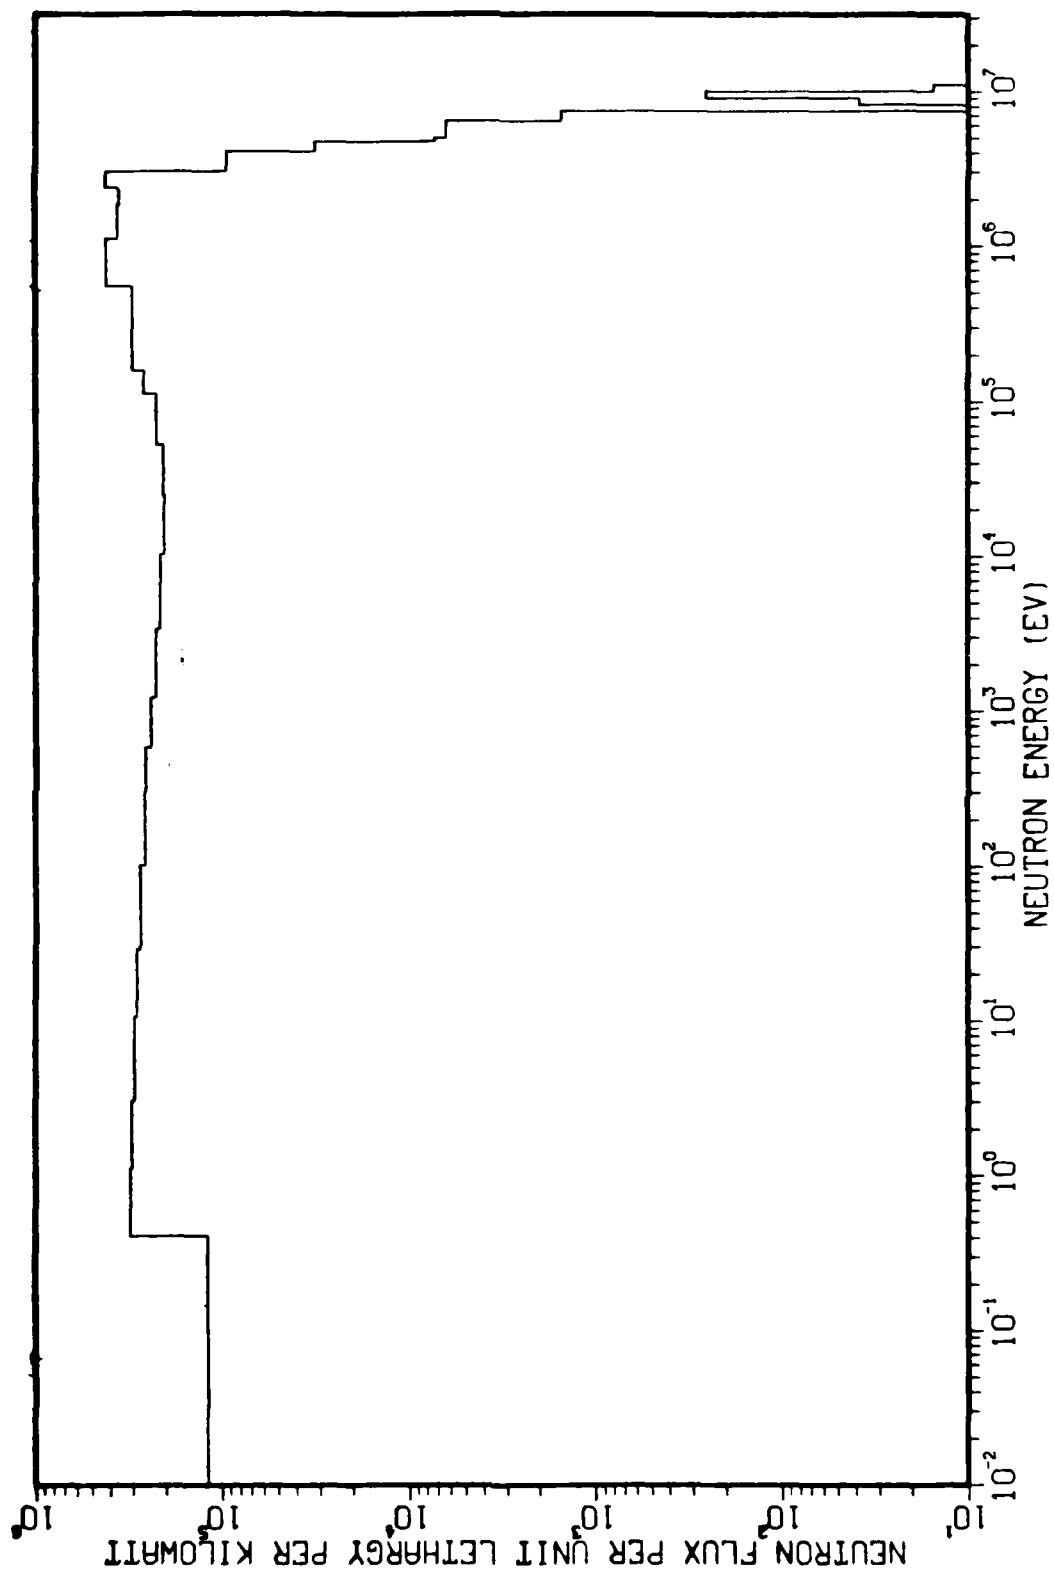


Figure II.6.57. Back (1-D) Neutron Flux vs Energy Free Field ER2 200 cms from Reactor.

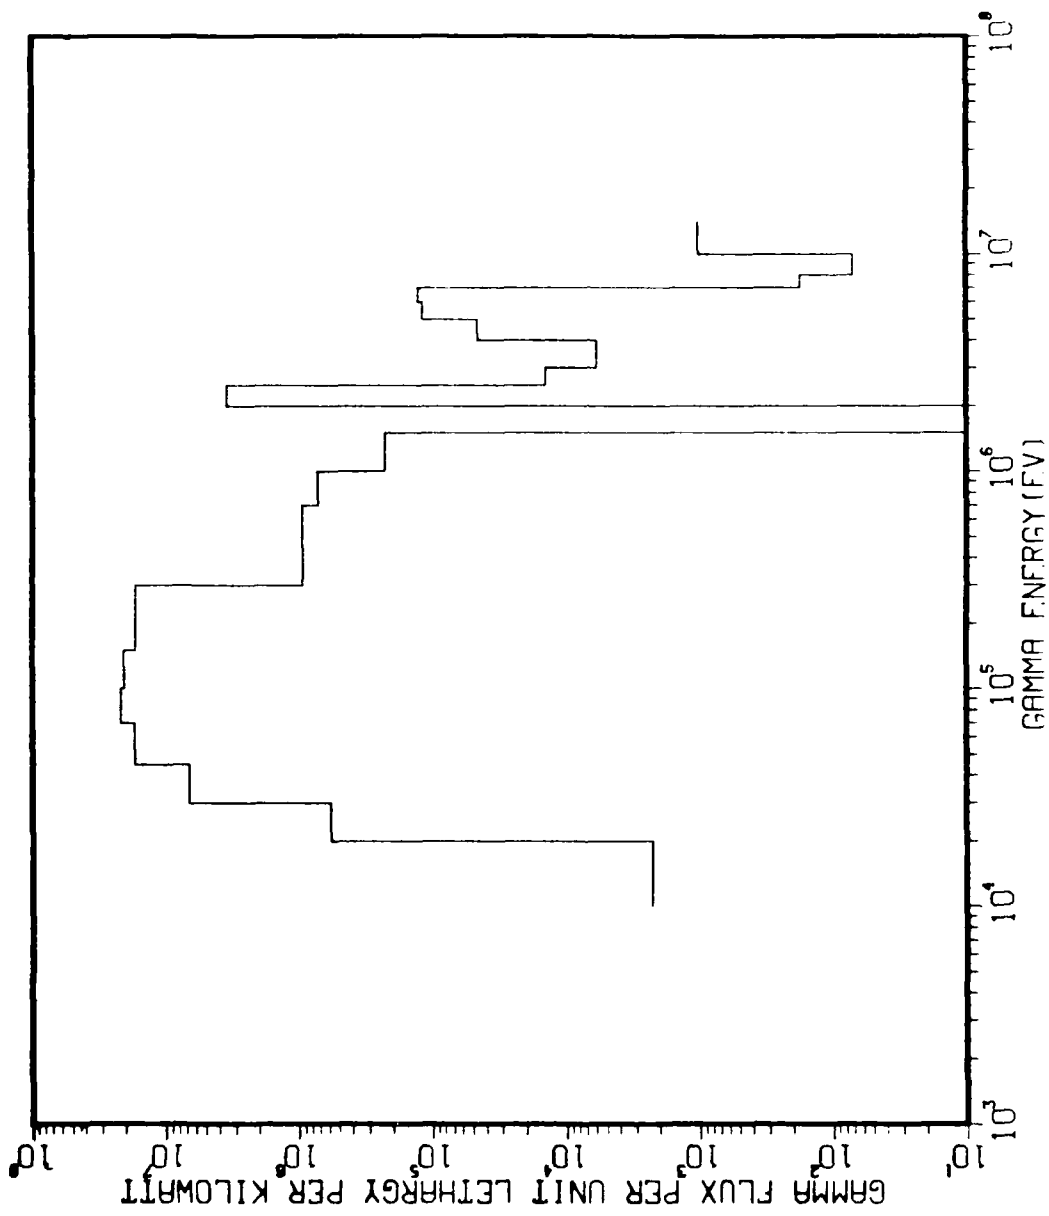


Figure II.6.58. Back Gamma Flux vs Energy Free Field ER2 200 cms from Reactor.

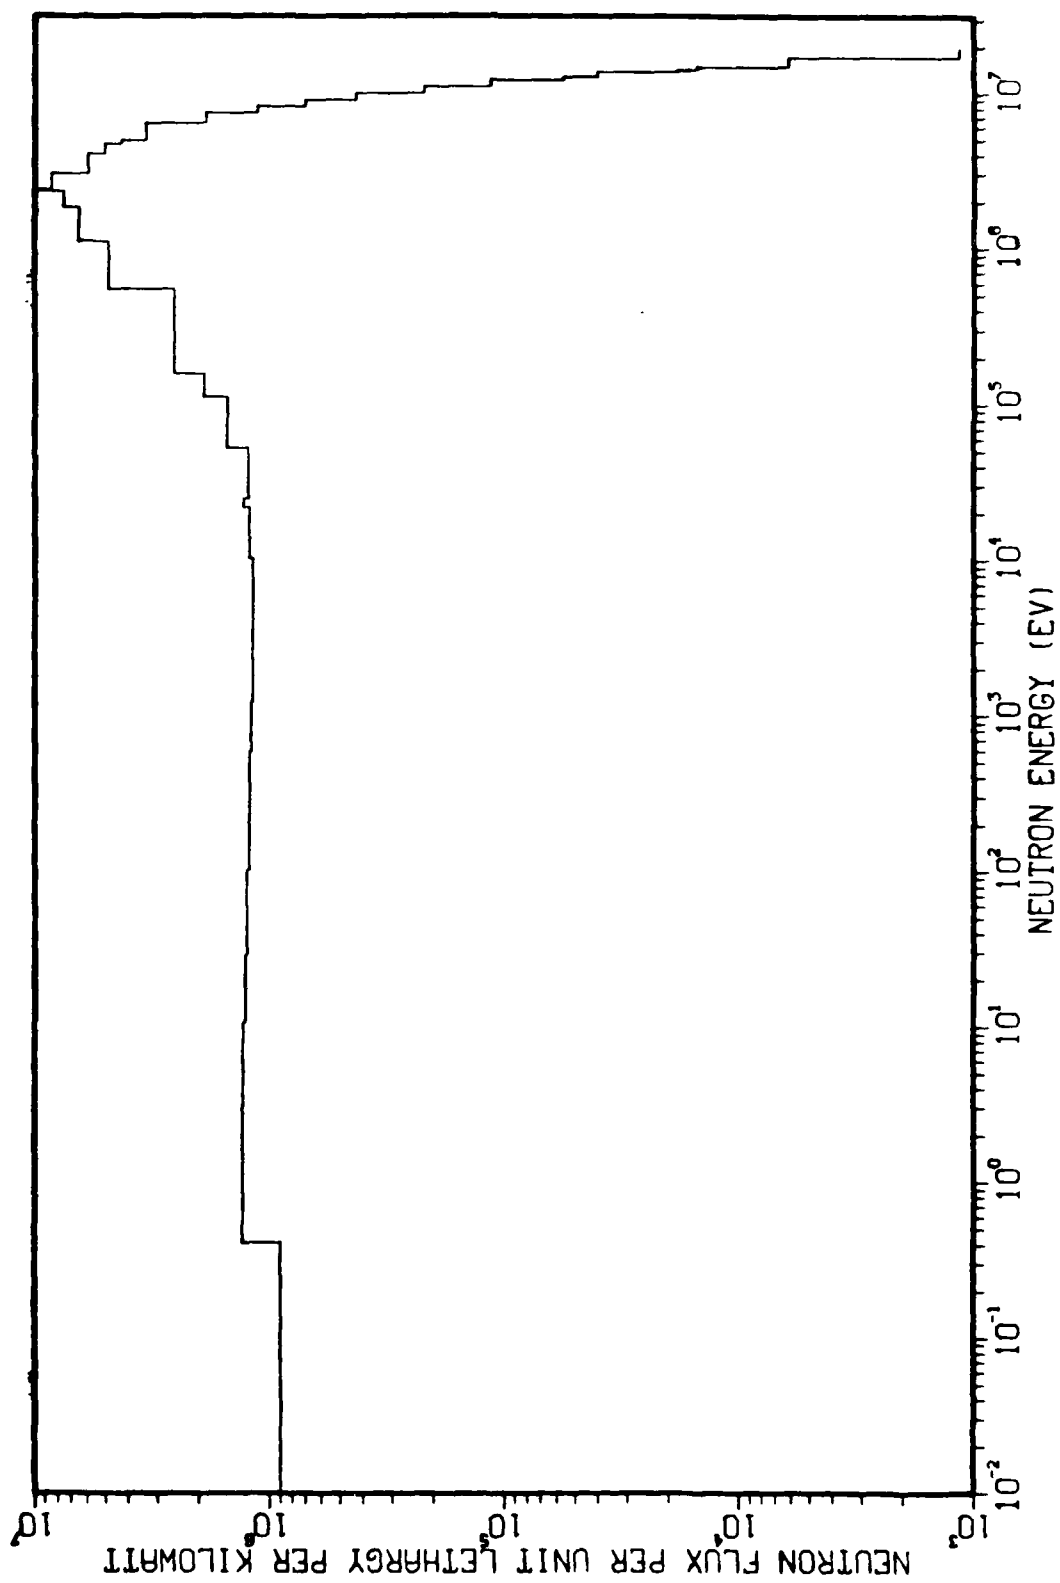


Figure 11.6.59. Total (Front+Back, 1-D) Neutron Flux vs Energy Free Field
ER2 200 cms from Reactor.

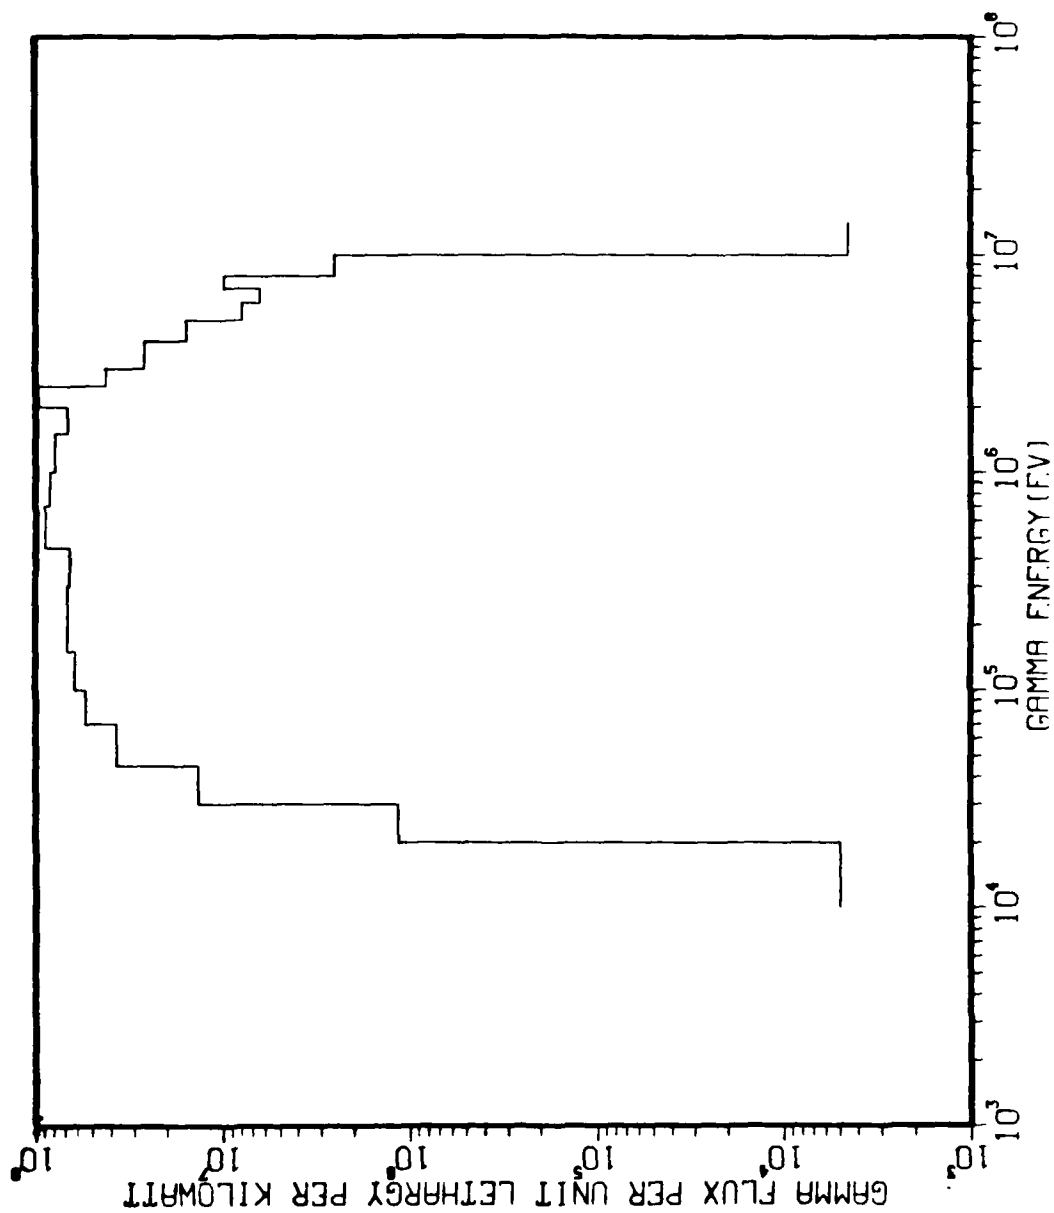


Figure II.6.60. Total (Front+Back) Gamma Flux vs Energy Free Field ER2 200 cms from Reactor.

Table II.6.20. Neutron Flux per Unit Lethargy per Kilowatt.

EP2 FREE FIELD 200 CMS FROM REACTOR

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	1.16E+03	0.00E+00	1.16E+03
2	1.690E+07	6.16E+03	0.00E+00	6.16E+03
3	1.490E+07	1.52E+04	0.00E+00	1.52E+04
4	1.420E+07	1.83E+04	0.00E+00	1.83E+04
5	1.380E+07	4.00E+04	0.00E+00	4.00E+04
6	1.280E+07	5.55E+04	0.00E+00	5.55E+04
7	1.220E+07	1.13E+05	0.00E+00	1.13E+05
8	1.110E+07	2.19E+05	1.54E+01	2.19E+05
9	1.000E+07	4.26E+05	2.56E+02	4.27E+05
10	9.050E+06	7.01E+05	3.84E+01	7.01E+05
11	8.190E+06	1.12E+06	0.00E+00	1.12E+06
12	7.410E+06	1.85E+06	1.54E+03	1.85E+06
13	6.380E+06	3.35E+06	6.32E+03	3.36E+06
14	4.970E+06	4.27E+06	7.34E+03	4.27E+06
15	4.720E+06	4.98E+06	3.18E+04	5.01E+06
16	4.070E+06	5.81E+06	9.44E+04	5.90E+06
17	3.010E+06	8.11E+06	4.16E+05	8.53E+06
18	2.390E+06	9.11E+06	3.57E+05	9.46E+06
19	2.310E+06	7.16E+06	3.53E+05	7.52E+06
20	1.830E+06	6.12E+06	3.57E+05	6.48E+06
21	1.110E+06	4.42E+06	4.17E+05	4.84E+06
22	5.500E+05	2.24E+06	3.03E+05	2.55E+06
23	1.580E+05	1.65E+06	2.60E+05	1.91E+06
24	1.110E+05	1.29E+06	2.24E+05	1.51E+06
25	5.250E+04	1.02E+06	2.06E+05	1.23E+06
26	2.480E+04	1.09E+06	2.03E+05	1.30E+06
27	2.190E+04	1.02E+06	2.03E+05	1.22E+06
28	1.030E+04	9.63E+05	2.14E+05	1.18E+06
29	3.350E+03	9.50E+05	2.26E+05	1.18E+06
30	1.230E+03	9.58E+05	2.39E+05	1.20E+06
31	5.830E+02	9.64E+05	2.57E+05	1.22E+06
32	1.010E+02	9.79E+05	2.74E+05	1.25E+06
33	2.900E+01	9.89E+05	2.86E+05	1.28E+06
34	1.070E+01	9.91E+05	2.96E+05	1.29E+06
35	3.060E+00	9.96E+05	3.05E+05	1.30E+06
36	1.130E+00	9.87E+05	3.11E+05	1.30E+06
37	4.140E-01	7.76E+05	1.19E+05	8.96E+05

Table II.6.21. Gamma Flux per Unit Lethargy per Kilowatt.

IR2 FREE FIELD 200 CMS FROM REACTOR

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.400E+07	3.47E+03	1.02E+03	4.49E+03
2	1.000E+07	2.54E+06	7.08E+01	2.54E+06
3	8.000E+06	9.80E+06	1.75E+02	9.81E+06
4	7.000E+06	6.15E+06	1.27E+05	6.28E+06
5	6.000E+06	7.74E+06	1.18E+05	7.85E+06
6	5.000E+06	1.55E+07	4.60E+04	1.55E+07
7	4.000E+06	2.62E+07	5.89E+03	2.62E+07
8	3.000E+06	4.17E+07	1.42E+04	4.18E+07
9	2.500E+06	9.33E+07	3.46E+06	9.68E+07
10	2.000E+06	6.77E+07	0.00E+00	6.77E+07
11	1.500E+06	7.88E+07	2.26E+05	7.90E+07
12	1.000E+06	8.26E+07	7.15E+05	8.33E+07
13	7.000E+05	8.83E+07	9.49E+05	8.93E+07
14	4.500E+05	6.49E+07	9.38E+05	6.58E+07
15	3.000E+05	5.09E+07	1.68E+07	6.77E+07
16	1.500E+05	4.11E+07	2.05E+07	6.17E+07
17	1.000E+05	3.26E+07	2.18E+07	5.45E+07
18	7.000E+04	2.00E+07	1.72E+07	3.72E+07
19	4.500E+04	6.89E+06	6.71E+06	1.36E+07
20	3.000E+04	5.80E+05	5.79E+05	1.16E+06
21	2.000E+04	2.70E+03	2.29E+03	5.00E+03

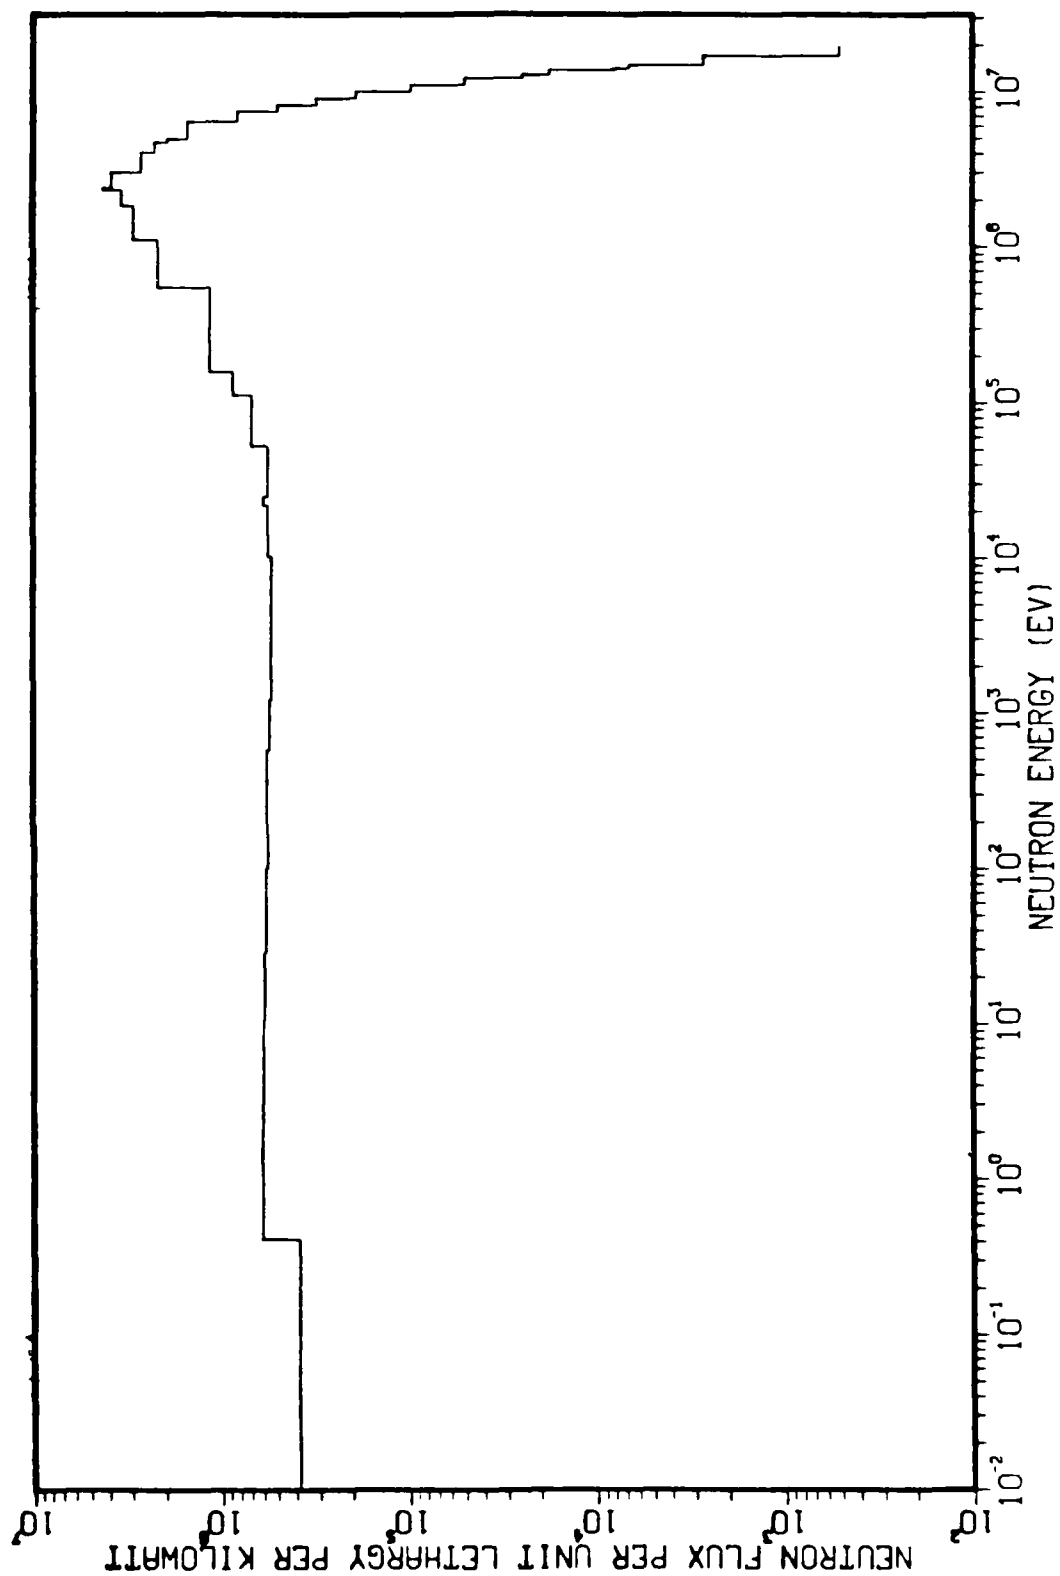


Figure 11.6.61. Front (1-D) Neutron Flux vs Energy Free Field ER2 300 cms from Reactor.

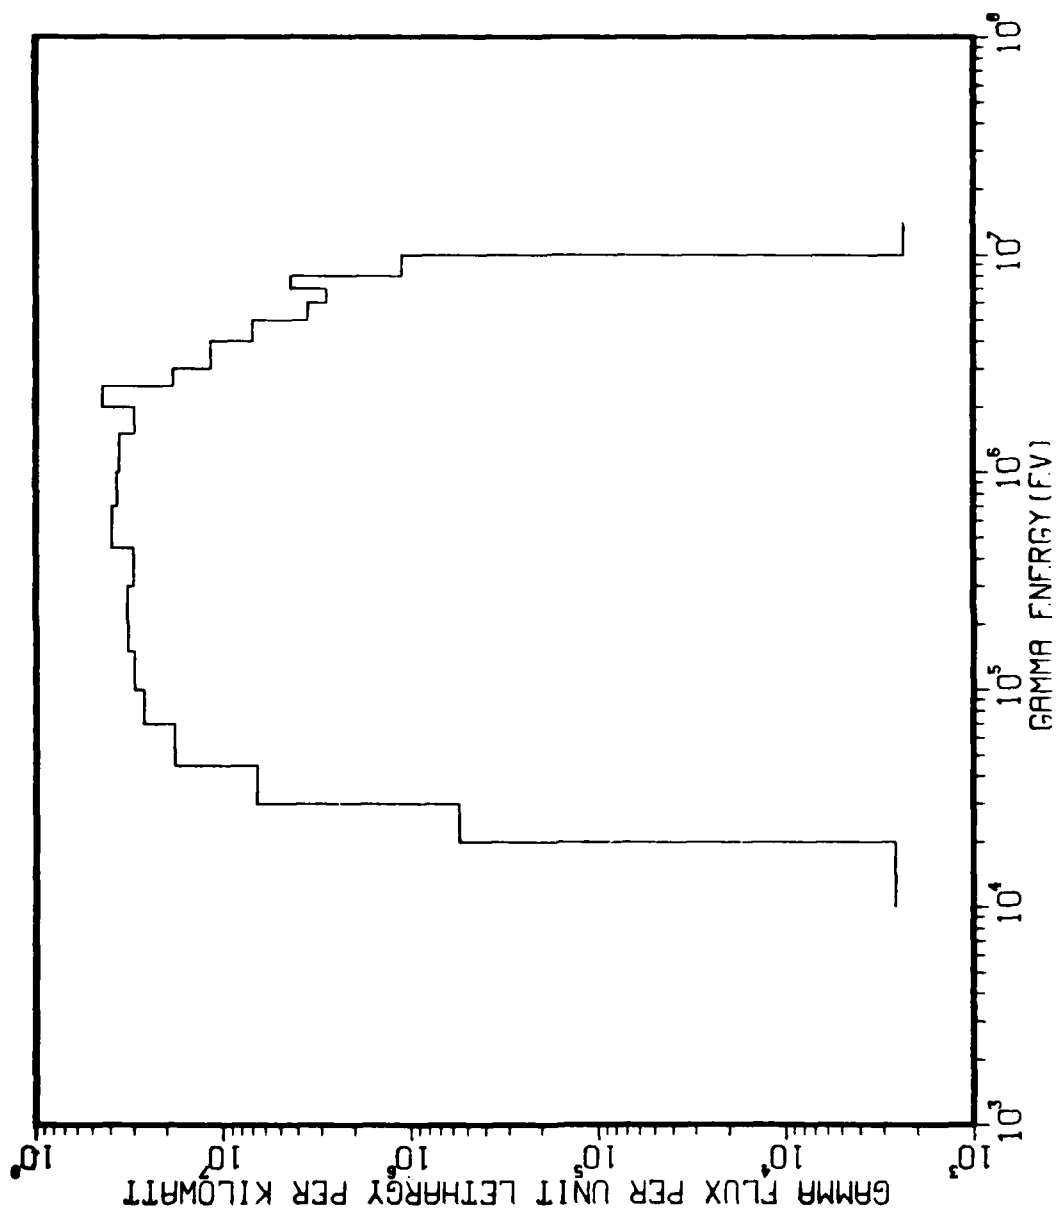


Figure 11.6.62. Front Gamma Flux vs Energy Free Field ER2 300 cms from Reactor.

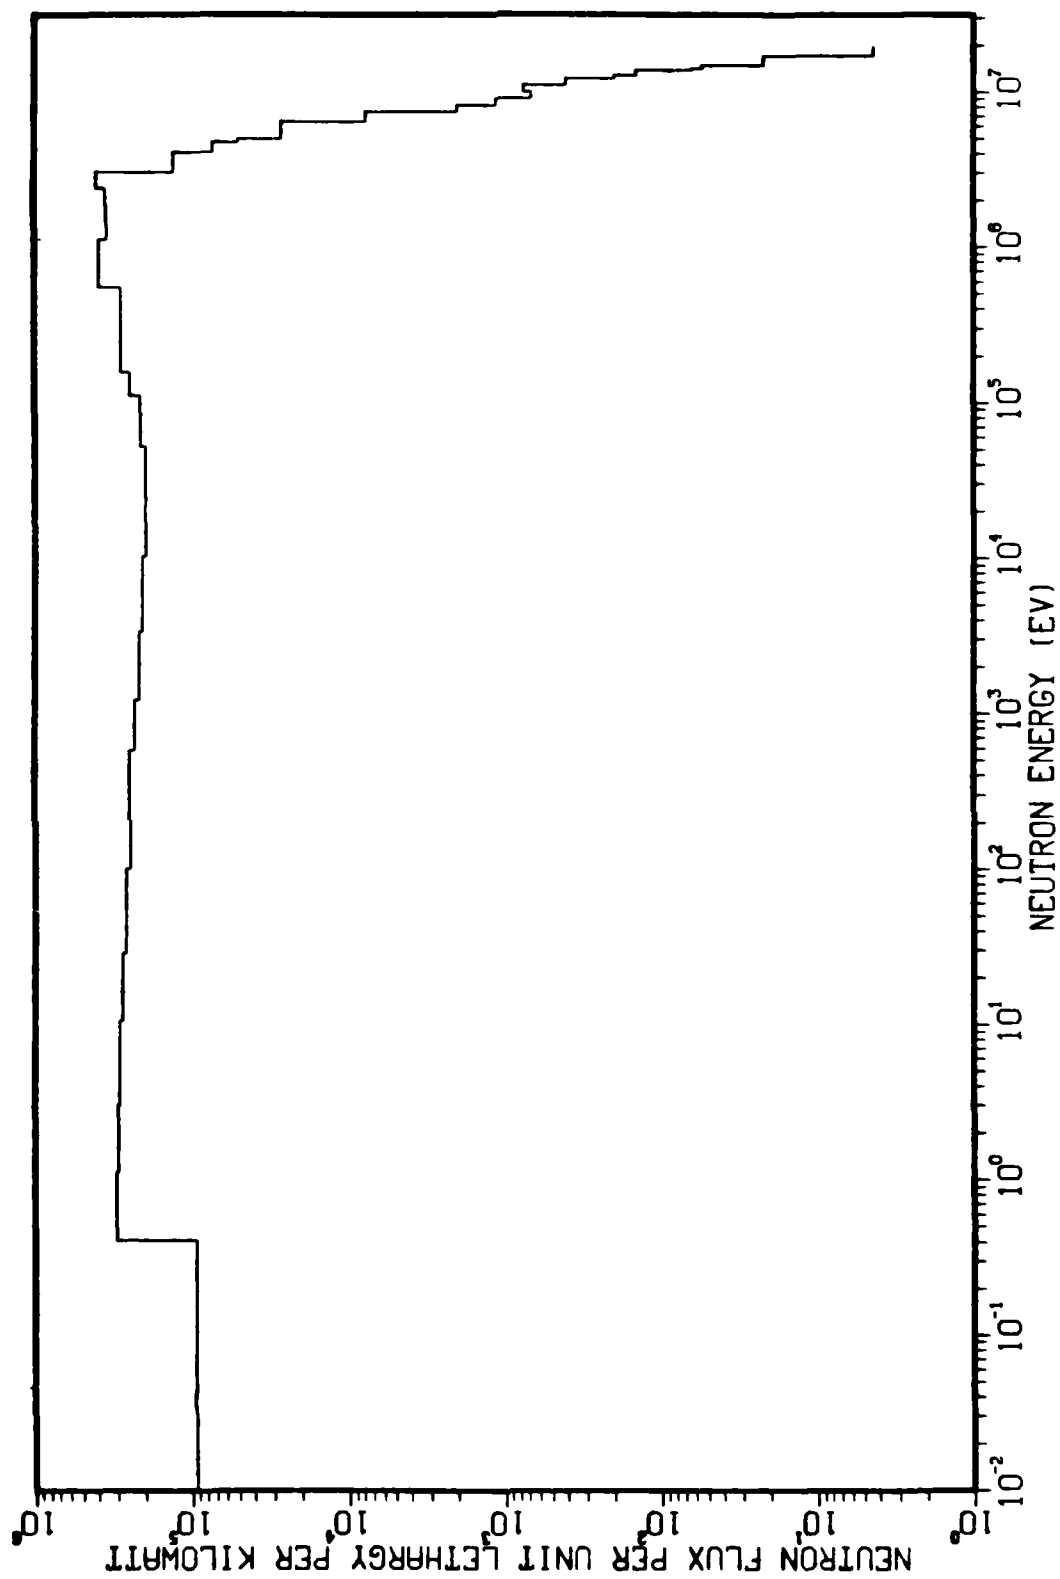


Figure 11.6.63. Back (1-D) Neutron Flux vs Energy Free Field ER2 300 cms from Reactor.

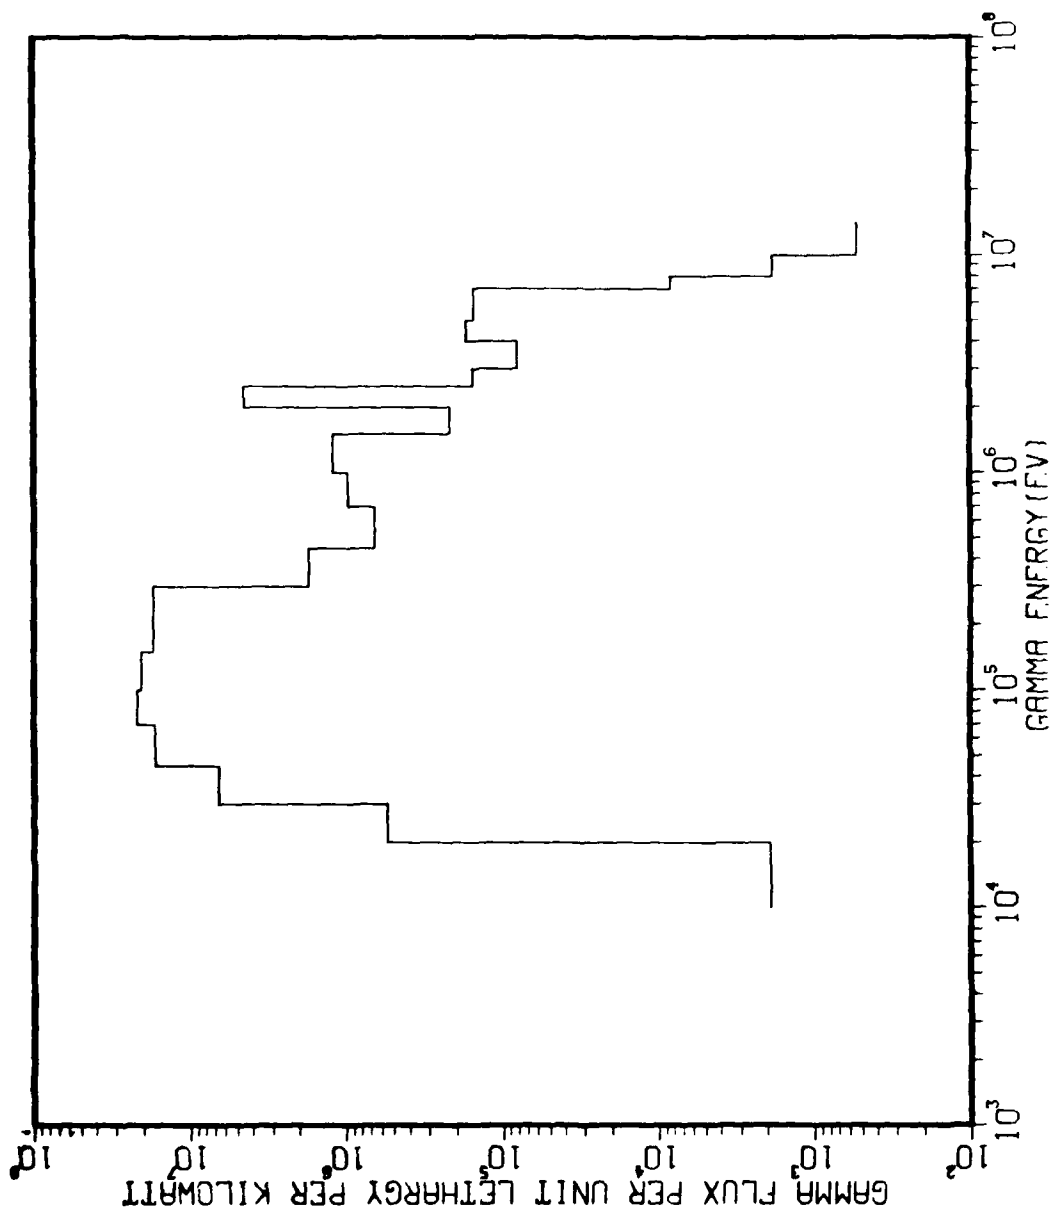


Figure 11.6.64. Back Gamma Flux vs Energy Free Field ER2 300 cms from Reactor.

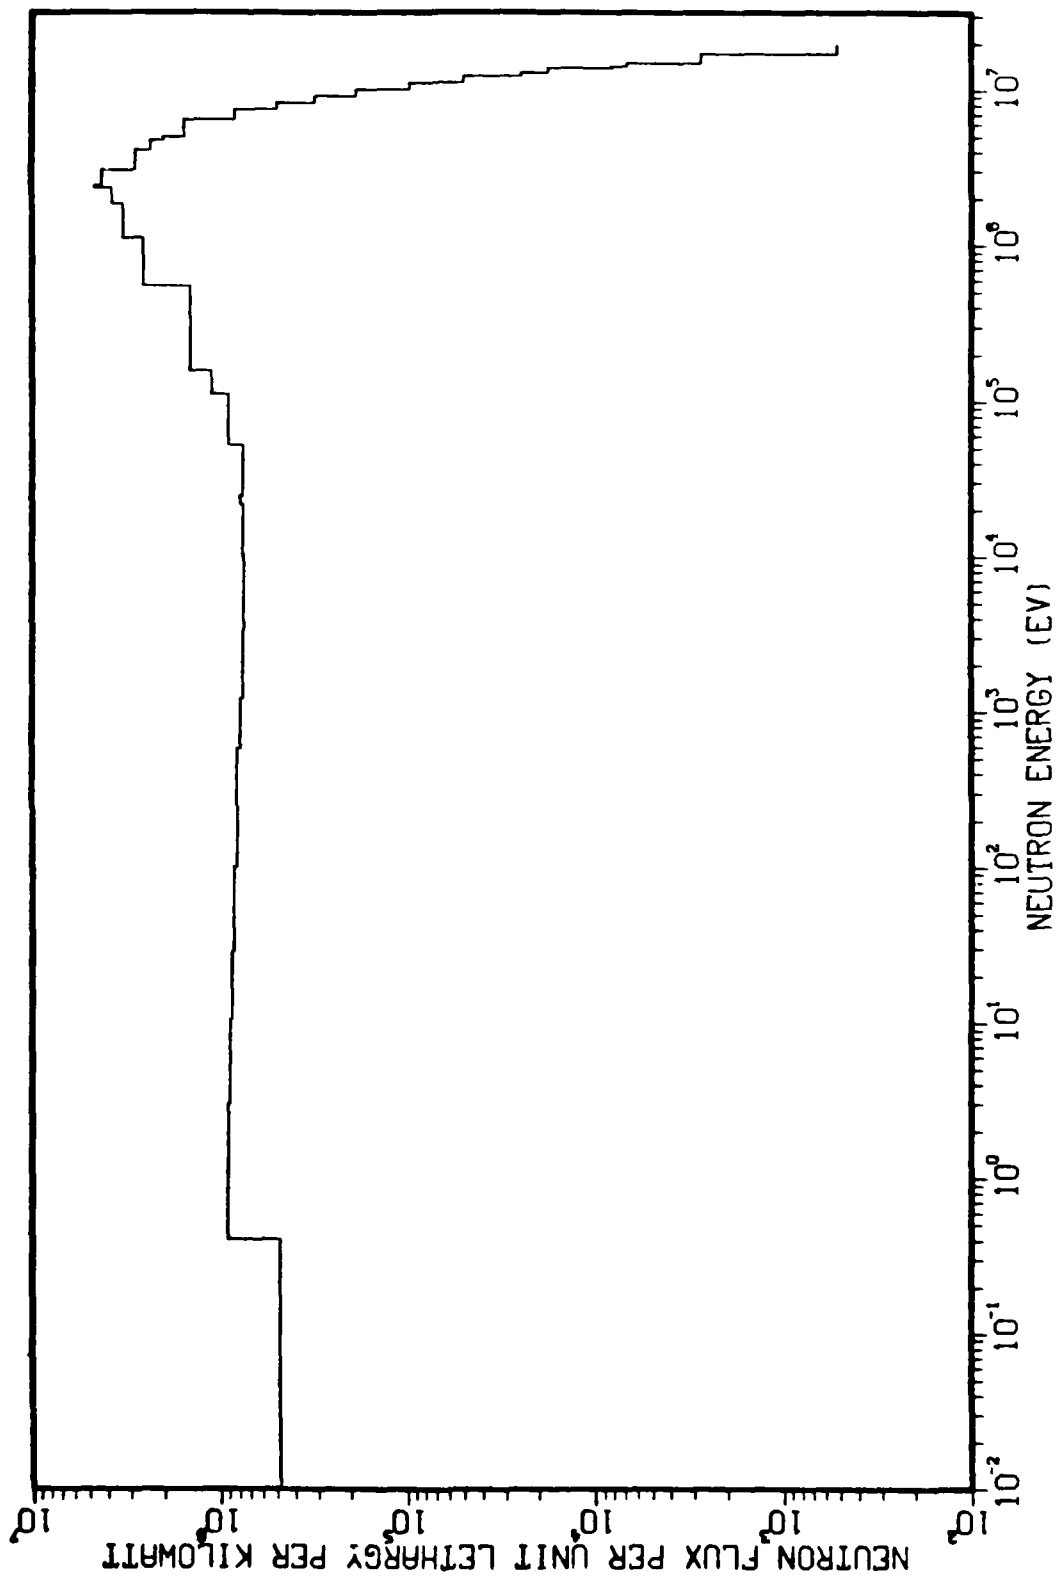


Figure II.6.65. Total (Front+Back, 1-D) Neutron Flux vs Energy Free Field ER2
300 cms from Reactor.

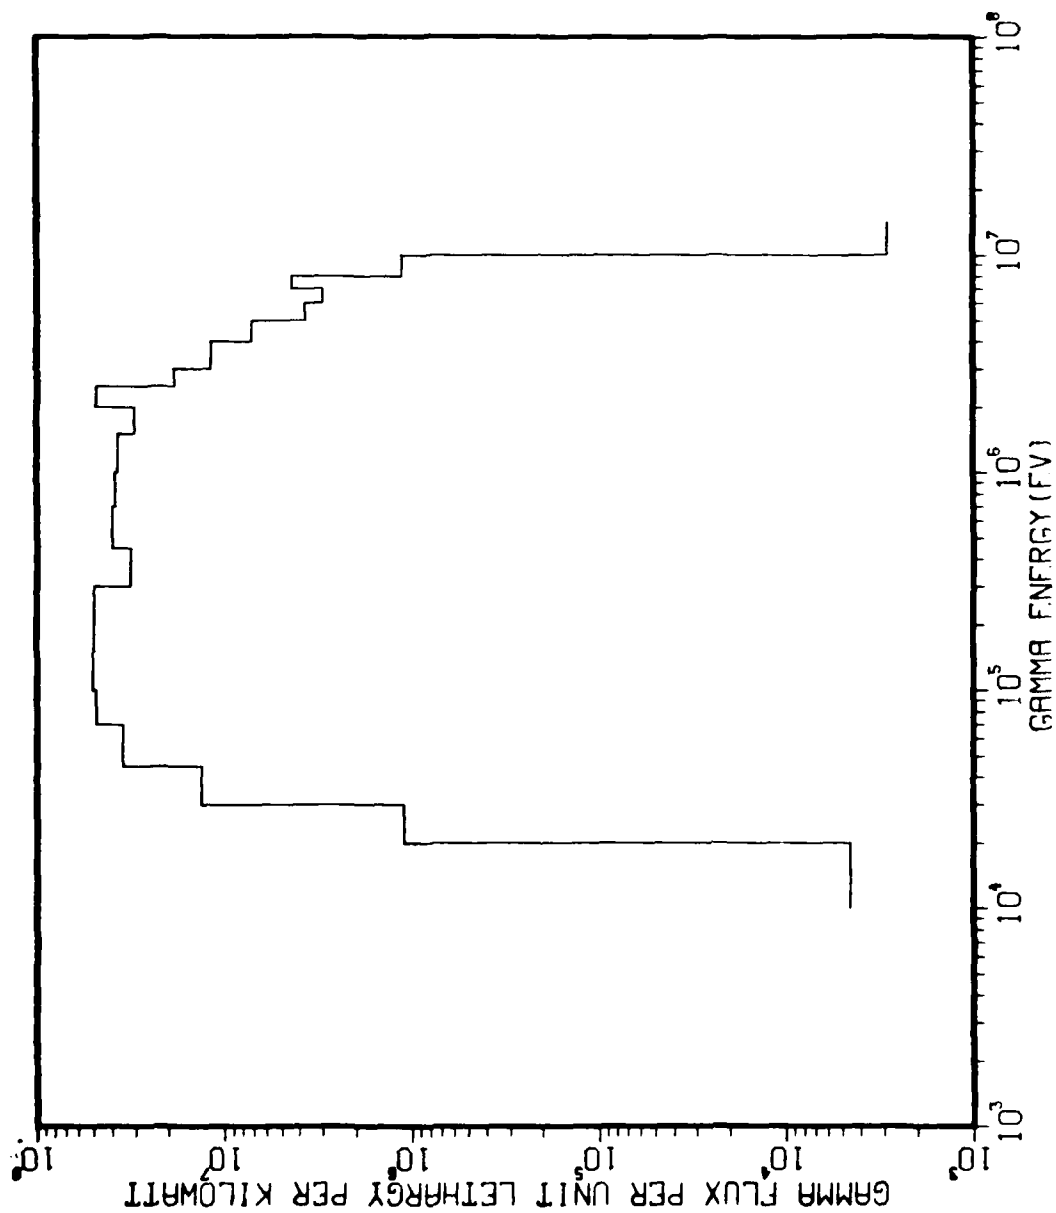


Figure II.6.66. Total (Front+Back) Gamma Flux vs Energy Free Field ER2 300 cms from Reactor.

Table II.6.22. Neutron Flux per Unit Lethargy per Kilowatt.

EN2 FREE FIELD 300 CMS FROM REACTOR

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.960E+07	5.12E+02	4.38E+00	5.16E+02
2	1.690E+07	2.73E+03	2.21E+01	2.75E+03
3	1.490E+07	6.71E+03	5.48E+01	6.77E+03
4	1.420E+07	8.08E+03	6.33E+01	8.15E+03
5	1.380E+07	1.77E+04	1.45E+02	1.79E+04
6	1.280E+07	2.46E+04	1.99E+02	2.48E+04
7	1.220E+07	5.02E+04	4.07E+02	5.06E+04
8	1.110E+07	9.72E+04	7.63E+02	9.79E+04
9	1.000E+07	1.89E+05	6.77E+02	1.90E+05
10	9.050E+06	3.11E+05	1.14E+03	3.12E+05
11	8.190E+06	4.96E+05	2.02E+03	4.98E+05
12	7.410E+06	8.26E+05	7.69E+03	8.34E+05
13	6.880E+06	1.51E+06	2.66E+04	1.54E+06
14	4.970E+06	1.94E+06	4.98E+04	1.99E+06
15	4.720E+06	2.26E+06	7.26E+04	2.33E+06
16	4.070E+06	2.66E+06	1.29E+05	2.79E+06
17	3.010E+06	3.82E+06	4.06E+05	4.23E+06
18	2.390E+06	4.24E+06	3.55E+05	4.59E+06
19	2.310E+06	3.38E+06	3.51E+05	3.73E+06
20	1.830E+06	2.91E+06	3.50E+05	3.26E+06
21	1.110E+06	2.17E+06	3.90E+05	2.56E+06
22	5.500E+05	1.15E+06	2.83E+05	1.43E+06
23	1.580E+05	8.65E+05	2.46E+05	1.11E+06
24	1.110E+05	6.88E+05	2.13E+05	9.01E+05
25	5.250E+04	5.62E+05	1.97E+05	7.59E+05
26	2.480E+04	5.90E+05	1.95E+05	7.86E+05
27	2.190E+04	5.60E+05	1.96E+05	7.55E+05
28	1.030E+04	5.41E+05	2.06E+05	7.47E+05
29	3.350E+03	5.42E+05	2.19E+05	7.60E+05
30	1.230E+03	5.52E+05	2.31E+05	7.84E+05
31	5.830E+02	5.65E+05	2.49E+05	8.14E+05
32	1.010E+02	5.81E+05	2.66E+05	8.47E+05
33	2.900E+01	5.92E+05	2.78E+05	8.71E+05
34	1.070E+01	5.99E+05	2.89E+05	8.88E+05
35	3.060E+00	6.06E+05	2.98E+05	9.04E+05
36	1.180E+00	6.05E+05	3.04E+05	9.09E+05
37	4.140E-01	5.86E+05	3.45E+04	4.81E+05

Table II.6.23. Gamma Flux per Unit Lethargy per Kilowatt.

ER2 FREE FIELD 300 CMS FROM REACTOR

GROUP	ENERGY (EV)	FRONT	BACK	TOTAL
1	1.400E+07	2.35E+03	5.21E+02	2.87E+03
2	1.000E+07	1.12E+06	1.82E+03	1.13E+06
3	8.000E+06	4.35E+06	8.29E+03	4.35E+06
4	7.000E+06	2.82E+06	1.52E+05	2.98E+06
5	6.000E+06	3.53E+06	1.51E+05	3.68E+06
6	5.000E+06	7.01E+06	1.70E+05	7.18E+06
7	4.000E+06	1.16E+07	8.01E+04	1.17E+07
8	3.000E+06	1.85E+07	1.54E+05	1.87E+07
9	2.500E+06	4.42E+07	4.49E+06	4.87E+07
10	2.000E+06	3.00E+07	2.17E+05	3.02E+07
11	1.500E+06	3.59E+07	1.20E+06	3.71E+07
12	1.000E+06	3.72E+07	9.68E+05	3.82E+07
13	7.000E+05	3.94E+07	6.63E+05	4.01E+07
14	4.500E+05	3.02E+07	1.73E+06	3.20E+07
15	3.000E+05	3.25E+07	1.72E+07	4.97E+07
16	1.500E+05	2.98E+07	2.06E+07	5.04E+07
17	1.000E+05	2.66E+07	2.17E+07	4.83E+07
18	7.000E+04	1.82E+07	1.68E+07	3.50E+07
19	4.500E+04	6.68E+06	6.58E+06	1.33E+07
20	3.000E+04	5.56E+05	5.49E+05	1.11E+06
21	2.000E+04	2.60E+03	1.92E+03	4.53E+03

Table II.6.24. Front Response as a Function of Distance in ER2.

Response	Distance from Reactor in ER2 (cms)			
	50	100	200	300
Sulfur Activation (acts/cc-s/atom/bn-cm/kW)	2.15+7	5.16+6	1.29+6	5.88+5
Silicon Damage (1 MeV Equivalent n/cm ² -s/kW)	3.53+8	8.44+7	2.18+7	1.04+7
Neutron Dose (rads/s/kW)	1.20+0	2.87-1	7.52-2	3.55-2
Gamma Dose (rad/s/kW)	1.88+0	4.51-1	1.14-1	5.32-2
Neutron Dose (rem/s/kW)	9.65+0	2.31+0	5.96-1	2.85-1
Total Dose (rad/s/kW)	3.08+0	7.38-1	1.89-1	8.97-2
Total Dose (rem/s/kW)	1.15+1	2.76+0	7.10-1	3.38-1
Total Neutron Flux (n/cm ² -s/kW)	6.03+8	1.44+8	4.00+7	2.06+7
Neutrqn Flux > 1 MeV (n/cm ² -s/kW)	1.91+8	4.58+7	1.16+7	5.43+6

Table II.6.25. Back Response as a Function of Distance in ER2.

Response	Distance from Reactor in ER2 (cms)			
	50	100	200	300
Sulfur Activation (acts/cc-s/atom/bn-cm/kW)	3.17+4	2.18+4	2.06+4	2.67+4
Silicon Damage (1 MeV Equivalent n/cm ² -s/kW)	2.11+6	1.63+6	1.42+6	1.38+6
Neutron Dose (rads/s/kW)	8.99-3	6.95-3	5.98-3	5.73-3
Gamma Dose (rad/s/kW)	3.82-3	3.59-3	3.72-3	4.38-3
Neutron Dose (rem/s/kW)	5.51-2	4.29-2	3.75-2	3.67-2
Total Dose (rad/s/kW)	1.28-2	1.05-2	9.70-3	1.01-2
Total Dose (rem/s/kW)	5.89-2	4.64-2	4.12-2	4.11-2
Total Neutron Flux (n/cm ² -s/kW)	9.01+6	6.99+6	5.92+6	5.47+6
Neutron Flux >1 MeV (n/cm ² -s/kW)	6.91+5	5.22+5	4.63+5	4.78+5

Table II.6.26. Total Response as a Function of Distance in ER2.

Response	Distance from Reactor in ER2 (cms)			
	50	100	200	300
Sulfur Activation (acts/cc-s/atom/bn-cm/kW)	2.16+7	5.18+6	1.31+6	6.15+5
Silicon Damage (1 MeV Equivalent n/cm ² -s/kW)	3.55+8	8.60+7	2.33+7	1.18+7
Neutron Dose (rads/s/kW)	1.21+0	2.94-1	8.12-2	4.22-2
Gamma Dose (rad/s/kW)	1.88+0	4.54-1	1.18-1	5.76-2
Neutron Dose (rem/s/kW)	9.71+0	2.35+0	6.34-1	3.21-1
Total Dose (rad/s/kW)	3.09+0	7.49-1	1.99-1	9.98-2
Total Dose (rem/s/kW)	1.16+1	2.81+0	7.51-1	3.79-1
Total Neutron Flux (n/cm ² -s/kW)	6.12+8	1.51+8	4.60+7	2.61+7
Neutrgn Flux >1 MeV (n/cm ² -s/kW)	1.92+8	4.63+7	1.21+7	5.91+6

7. CONCLUSIONS AND SUMMARY

One-dimensional and three-dimensional calculations have been done for various reactor/exposure room configurations at the AFRRRI Triga reactor facility. In addition to supplying input spectra for the unfolding of the foil data, the calculations were extended to other arrangements that could be of use for future experiments. It was found that except in extreme cases involving complex shapes of hydrogenous materials, one-dimensional techniques were adequate to characterize the neutron and gamma-ray fields in and around the reactor. In addition to spectra and integral results, the calculations also yielded information on the angular distribution of the radiation, especially useful for future irradiation experiments involving large thick subjects.

The excellent agreement between the calculations and the measurements in spectral shape as well as intensity, validated the calculational procedures and allowed the extension of calculations to configurations for which there was no experimental data.

The calculated spectra have been tabulated in such a way as to be of maximum use to the AFRRRI Triga user and as input for further calculations such as cell kill, radiation effects, or further radiation transport analysis. The overall analytic approach taken in performing these calculations also leaves itself open to efficient continuation due to the coupled nature of the runs which prevents unnecessary repetition of calculation in certain sections of the problem.

8. REFERENCES

1. "DLC-31/(DPL-1/FEWG1), 37 Neutron, 21 Gamma Ray Coupled, P3, Multigroup Library in ANISN Format", October, 1975.
2. "Nuclear Rocket Shielding Methods, Modification, Updating, and Input Preparation", Vol. 4, One-Dimensional, Discrete Ordinates Transport Technique, WANL-PR-(LL)-034, August, 1970.
3. "MORSE-CG", CCC-203, August, 1973.
4. "BLENDR, A Program to Mix, Separate, and Collapse Cross Sections", G. L. Simmons, December 1, 1974, 5-310-13-74.
5. "Neutron Cross Sections, Volume II, Curves", D. I. Garber and R. R. Kinsey, BNL 325, January, 1976.
6. G. West of General Atomic Company, private communication, February 21, 1980.
7. M. Crane of General Atomic Company, private communication, June 23, 1980.
8. AFRRI Triga Mark-F Reactor Operations Manual, Major J. L. McKenzie, USAF, Volumes I and II, January, 1975.
9. "Neutron Radiation Damage Characterization Versus Distance from the Berkely Reactor", C. Cassapakis and V. Verbinski, SAI-272-80-371-LJ, May 22, 1980.
10. J. White of Oak Ridge National Laboratory, private communication, June 10, 1980.
11. K. Ferlic of AFRRI, private communication, July 1, 1980.
12. "Neutron Shielding Analysis WPPSS Units 1 and 4", T. Albert, W. Hagan, and R. Howell, SAI01379-842LJ, August 16, 1979.

13. "Analysis of Collar/Saddle Shield for North Anna Units 1 and 2", T. Albert, W. Hagan, and L. Simmons, SA1-78-1041-LJ, December, 1978.

DISTRIBUTION LIST

DEPARTMENT OF DEFENSE

U.S. Documents Officer
ATTN: U.S. Documents Ofc for COL Hunter

Armed Forces Radiobiology Rsch Institute
Defense Nuclear Agency

ATTN: Director
ATTN: Deputy Director
ATTN: Head, SAF
ATTN: Head, RSD
ATTN: Head, CSD
ATTN: Chief, RSRP
ATTN: Chief, RSRS
ATTN: CPT, Alt
ATTN: LT Blake
ATTN: Mr. Webber
ATTN: LtCol Conklin
ATTN: CDR Devine
ATTN: Dr. Hsieh
ATTN: Dr. Ledney
ATTN: Mr. Moore
ATTN: CPT Sholtis
ATTN: MAJ Smoker

3 cy ATTN: Library
10 cy ATTN: CPT Bice
14 cy ATTN: LT K. P. Ferlic

BUMED Dosimetry Center
National Naval Medical Center
ATTN: Rad Safety, C-45, LCDR Zeman

Assistant Secretary of Defense
Program Analysis & Evaluation
ATTN: S. Sienkiewicz
ATTN: Strategic Programs

Assistant to the Secretary of Defense
Atomic Energy
ATTN: L. Michael
ATTN: Strategy & Assessment
ATTN: Executive Assistant
ATTN: T. Sisson
ATTN: Nuclear Policy Planning

Defense Intelligence Agency
ATTN: DB-4C, J. Burfening
ATTN: DB-4C, E. O'Farrell
ATTN: DN
ATTN: RTS-2C
ATTN: Library
ATTN: DIO-GPF, W. Magathan
ATTN: DT, J. Vorona
ATTN: DB-4C, P. Johnson

Defense Technical Information Center
12 cy ATTN: DD

Field Command
Defense Nuclear Agency
ATTN: FCLS, MAJ D. Norton
ATTN: FCLS
ATTN: FCP, J. T. McDaniel

DEPARTMENT OF DEFENSE (Continued)

Field Command
Defense Nuclear Agency
Livermore Branch
ATTN: FCPRL

Field Command
Defense Nuclear Agency
Los Alamos Branch
ATTN: FCPRA

Interservice Nuclear Weapons School
ATTN: Document Control
ATTN: TTV

Joint Chiefs of Staff
ATTN: J-5, Nuclear Division/Strategy Div

Under Secretary of Defense for Rsch & Engrg
ATTN: M. Minneman
ATTN: F. McLeskey
ATTN: Strategic & Space Sys (OS)
ATTN: K. Hinman

Defense Nuclear Agency
ATTN: NASD
ATTN: BA
ATTN: NAFD
ATTN: GC
ATTN: PAO
ATTN: NATD
ATTN: SPTD
ATTN: RAAE
ATTN: NATA
ATTN: RAE
ATTN: STNA
ATTN: STRA
ATTN: STSP
5 cy ATTN: NTPR
10 cy ATTN: NATD, D. Auton
10 cy ATTN: BA, E. Still
4 cy ATTN: TITL

DEPARTMENT OF THE ARMY

Army Library
Department of the Army
ATTN: Military Documents Section

Deputy Chief of Staff for Rsch Dev & Acq
Department of the Army
ATTN: DAMA-CSM-N

Harry Diamond Laboratories
Department of the Army
ATTN: Chief Div 30,000
ATTN: 00100, Commander/Tech Dir/TSO
ATTN: DELHD-N-D
ATTN: DELHD-N-RBG
ATTN: DELHD-N-TD
ATTN: DELHD-N-P
ATTN: Chairman, Nuc Vulnerability Branch

DEPARTMENT OF THE ARMY (Continued)

U.S. Army Armament Rsch Dev & Cmd
ATTN: DRDAR-LCN-E

U.S. Army Ballistic Research Labs
ATTN: DRDAR-BLB
ATTN: DRDAR-VL
ATTN: DRDAR-TSB-S
ATTN: DRDAR-BLV

U.S. Army Center of Military History
ATTN: DAMH

U.S. Army Chemical School
ATTN: ATZN-CM-CS
ATTN: ATZN-CM-AL

U.S. Army Fa Msl Sys Eval Gp
ATTN: ATZR-MG
ATTN: K. McDonald

U.S. Army Foreign Science & Tech Ctr
ATTN: DRXST-SD-1

U.S. Army Material Sys Analysis Actvy
ATTN: X5 (W3JCAA)

U.S. Army Mobility Equip R&D Cmd
ATTN: DRDME-RT, R. Oscar
ATTN: DRDME-RC, Technical Library (Vault)

U.S. Army Nuclear & Chemical Agency
ATTN: Library
ATTN: MUNA-ZB, D. Panzer

U.S. Army TRADOC Sys Analysis Actvy
ATTN: ATAA-TAL

10th Med Lab
Department of the Army
4 CY ATTN: CPT E. Daxon

DEPARTMENT OF THE NAVY

Aviation History Unit
Office of the Deputy CNO
Department of the Navy
ATTN: Library

Bureau of Medicine and Surgery
Department of the Navy
ATTN: Assistant for Medical Surgery

Joint Cruise Missiles Project Ofc
Department of the Navy
ATTN: JCMG-707

Merchant Marine Academy
ATTN: Director of Libraries

Naval Postgraduate School
ATTN: Code 56PR
ATTN: Code 1424, Library
ATTN: Code 61, J. N. Dyer

Naval Research Laboratory
ATTN: Code 2627
ATTN: Library

DEPARTMENT OF THE NAVY (Continued)

Naval School of Health Sciences
ATTN: Library

Naval Sea Systems Command
ATTN: SEA-406
ATTN: Nuclear Technology Div
ATTN: SEA-06H2
2 CY ATTN: SEA-6431G, H. Seguire

Naval Surface Weapons Center
ATTN: Code F30
ATTN: Code U41
ATTN: Code R14
ATTN: Code F31
ATTN: Code U12
ATTN: Code R41, N. Scofield

Naval Surface Weapons Center
ATTN: Code DG-502, E. Freiling
ATTN: Library

Naval Weapons Center
ATTN: Code 32607, L. Thompson
ATTN: Code 233

Naval Weapons Evaluation Facility
ATTN: G. Binns
ATTN: Technical Director
ATTN: J. Abbott
ATTN: Library

Navy Dept Library
ATTN: XXXXX

Navy Nuclear Power School
ATTN: Library

Nimitz Library
U.S. Naval Academy
ATTN: Documents & Reports Dept

Office of Naval Research
ATTN: Code 431
ATTN: Code 200

Surface Warfare Development Group
ATTN: Commander

U.S. Merchant Marine Academy
Department of the Navy
ATTN: XXXXX

DEPARTMENT OF THE AIR FORCE

Academy Library DFSELD
U.S. Air Force Academy
ATTN: Library

Aerospace Defense Command
Department of the Air Force
ATTN: Historian

Air Force Academy
ATTN: Library

Air Force Institute of Technology
ATTN: ENP
ATTN: Library

DEPARTMENT OF THE AIR FORCE (Continued)

Air Force Technical Applications Ctr
ATTN: Historian

Air Force Test & Evaluation Center
ATTN: OA

Air Force Weapons Laboratory
Air Force Systems Command
ATTN: SUL
ATTN: Tech Library
ATTN: NSSB
ATTN: NT
ATTN: NXS

Air University Library
Department of the Air Force
ATTN: AOL-LSE

Ballistic Missile Office
Air Force Systems Command
ATTN: ENSN
ATTN: SYE, R. Landers

Deputy Chief of Staff
Research, Development, & Acq
Department of the Air Force
ATTN: AFRDQR
ATTN: AFRDQI

U.S. Air Force Occupational & Env Health Lab
ATTN: NTPR

U.S. Air Force School of Aerospace Medicine
ATTN: Radiation Sciences Div
ATTN: Strughold Library
ATTN: RZw, Maj Cordts

DEPARTMENT OF ENERGY

Department of Energy
ATTN: OMA

Department of Energy
ATTN: P. Hennig

OTHER GOVERNMENT AGENCIES

Centers for Disease Control
U.S. Public Health Service
ATTN: G. Caldwell

Central Intelligence Agency
ATTN: Office of Medical Services
ATTN: OSwR/NEU
ATTN: OSR/SE/F

Department of Commerce
National Bureau of Standards
ATTN: J. Hubell

Department of Health & Human Svcs
ATTN: Office of General Counsel

Library of Congress
ATTN: Serial & Govt Publication
ATTN: Science & Technology Div
ATTN: Library Service Division

OTHER GOVERNMENT AGENCIES (Continued)

Department of Commerce
National Bureau of Standards
ATTN: XXXXX

National Technical Information Service
12 cy ATTN: Customer Services

U.S. Coast Guard Academy Library
ATTN: XXXXX

U.S. Military Academy
ATTN: Director of Libraries

DEPARTMENT OF ENERGY CONTRACTORS

Lawrence Livermore National Lab
ATTN: Technical Info Dept, Library
ATTN: L-71, R. Howerton
ATTN: L-35, J. Immele
ATTN: L-531, A. Odell
ATTN: L-9, R. Barker
ATTN: L-21, M. Gustavson
ATTN: L-8, F. Barrish

Los Alamos National Laboratory
ATTN: F. Young
ATTN: R. Sandoval
ATTN: ADPA MMS 195
ATTN: M/S634, T. Dowler
ATTN: D. Harris
ATTN: Library
ATTN: E. Chapin
ATTN: R. Stolpe

Oak Ridge National Laboratory
ATTN: C. Clifford
ATTN: Central Rsch Library
ATTN: Rad Shielding Ctr
ATTN: F. Mynatt

Reynolds Electrical and Engr Co, Inc
ATTN: W. Brady
ATTN: CIC

Sandia National Laboratories
Livermore Laboratory
ATTN: T. Gold
ATTN: Library & Security Classification Div

Sandia National Lab
ATTN: Central Library
ATTN: W. Hereford
ATTN: 5612, J. W. Keizur
ATTN: 3141

OTHER

Brookhaven National Laboratory
ATTN: Nat Neu Cross Sec, S. Pearlstein

DEPARTMENT OF DEFENSE CONTRACTORS

Advanced Research & Applications Corp
ATTN: H. Lee

Aerospace Corp
ATTN: Library

DEPARTMENT OF DEFENSE CONTRACTORS (Continued)

Analytical Technology Applications Corp
ATTN: J. Scharfen

Atmospheric Science Assoc
ATTN: H. Normeat

BDM Corp
ATTN: J. Bode
ATTN: R. Welander
ATTN: P. White
ATTN: J. Herzog
ATTN: H. Portnoy
ATTN: R. Buchanan
ATTN: J. Braddock
ATTN: J. Morgan
ATTN: C. Somers
ATTN: C. Wasaff

Boeing Co
ATTN: A. Lowrey
ATTN: L. Harding

Decision-Science Applications, Inc
ATTN: Dr. Pugh

Garjak Research, Inc
ATTN: G. Jacobson

General Research Corp
ATTN: A. Berry
ATTN: P. Lowry
ATTN: Tactical Warfare Operations
ATTN: H. Schroeder

Hudson Institute, Inc
ATTN: H. Kahn
ATTN: C. Gray

Institute for Defense Analyses
ATTN: M. Scher
ATTN: Classified Library

IRT Corp
ATTN: Library

JAYCOR
ATTN: A. Nelson
ATTN: E. Almquist
10 cy ATTN: Health & Environment Div

JRB Associates
10 cy ATTN: L. Novotney

Kaman Sciences Corp
ATTN: V. Cox
ATTN: F. Shelton

Kaman Sciences Corp
ATTN: T. Long

Kaman Tempo
ATTN: DASAC
ATTN: E. Martin

Kaman Tempo
ATTN: R. Miller

DEPARTMENT OF DEFENSE CONTRACTORS (Continued)

Kaman Tempo
ATTN: C. Jones
ATTN: DASAC

Lockheed Missiles & Space Co, Inc
ATTN: TIC-Library

Mantech International Corporation
ATTN: President

Martin Marietta Corp
ATTN: M. Yeager
ATTN: F. Marion

McDonnell Douglas Corp
ATTN: Technical Library Services

McLean Research Center, Inc
ATTN: W. Schilling

McMillan Science Associates, Inc
ATTN: W. McMillan

Mission Research Corp
ATTN: Tech Library

National Academy of Sciences
ATTN: C. Robinette
ATTN: National Materials Advisory Board
ATTN: Medical Follow-up Agency

Pacific-Sierra Research Corp
ATTN: G. Lang
ATTN: H. Brode

Pacific-Sierra Research Corp
ATTN: G. Moe
ATTN: D. Gormley

R & D Associates
ATTN: J. Lewis
ATTN: P. Haas
ATTN: A. Field
ATTN: R. Montgomery
ATTN: A. Lynn

R & D Associates
ATTN: J. Bengston
ATTN: J. Thompson
ATTN: W. Houser

Radiation Research Associates, Inc
ATTN: Library

Rand Corp
ATTN: T. Parker
ATTN: J. Digby
ATTN: Library

Raytheon Co
ATTN: W. Britton

University of Rochester
ATTN: NAVWAG

Santa Fe Corp
ATTN: D. Paolucci

DEPARTMENT OF DEFENSE CONTRACTORS (Continued)

Science Applications, Inc
ATTN: J. Martin
ATTN: M. Drake
ATTN: E. Straker
ATTN: W. Woolson
ATTN: C. Whittenbury
4 cy ATTN: W. Hagan
4 cy ATTN: V. Verbinski
4 cy ATTN: C. Cassapakis

Science Applications, Inc
ATTN: N. Byrn
ATTN: T. Albert

Science Applications, Inc
ATTN: W. Layson
ATTN: J. McGahan
ATTN: Tech Library
ATTN: J. Goldstein

Science Applications, Inc
ATTN: D. Kaul

SRI International
ATTN: B. Gasten
ATTN: W. Jaye
ATTN: G. Abrahamson
ATTN: J. Naar
ATTN: P. Dolan

DEPARTMENT OF DEFENSE CONTRACTORS (Continued)

System Planning & Analysis, Inc
ATTN: P. Lantz

System Planning Corp
ATTN: G. Parks
ATTN: J. Douglas
ATTN: F. Adelman

Systems, Science & Software, Inc
ATTN: Library

T N Dupuy Associates, Inc
ATTN: T. Dupuy

Tetra Tech, Inc
ATTN: F. Bothwell

TRW Defense & Space Sys Group
ATTN: R. Anspach

Vector Research, Inc
ATTN: S. Bonder

PLEMENTARY

FORMATION

ERRATA SHEET

for

DNA 5793F-2 dated 1 June 1981

THE NEUTRON AND GAMMA-RAY ENVIRONMENT IN AND AROUND THE
CTOR, Volume II

front cover and Block 7 of the DD Form 1473 to read as

r V. Verbinski/SAI
G. Cassapakis/SAI
am K. Hagan/SAI
enant Ken Ferlic/AFRRI
in Eric Daxon/AFRRI