

AD-A110 234

NAVAL FACILITIES ENGINEERING COMMAND ALEXANDRIA VA
STRUCTURAL ENGINEERING, STEEL STRUCTURES, DESIGN MANUAL 2.3.(U)
MAY 80

F/6 13/13


UNCLASSIFIED

NAVFAC-DM-2.3

NL


1
4
10 0240

END
DATE
FILMED
2 82
DTIC

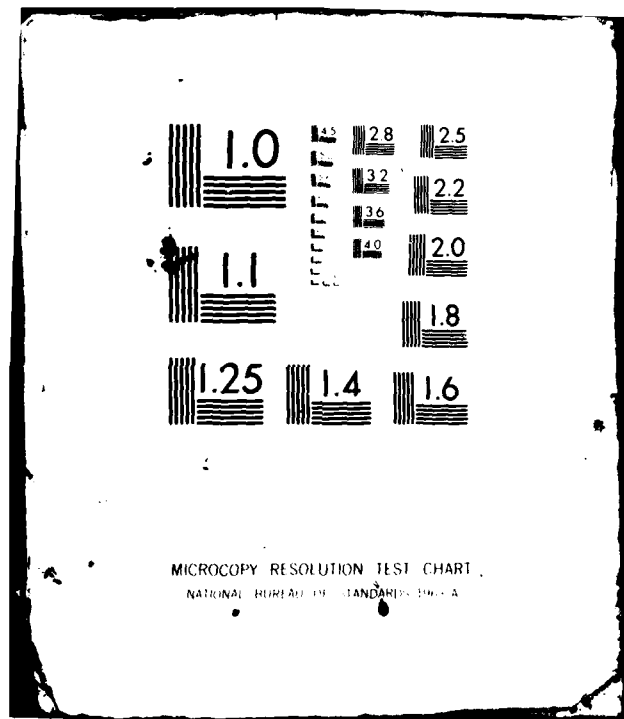

AD A110234

DTIC FILE COPY

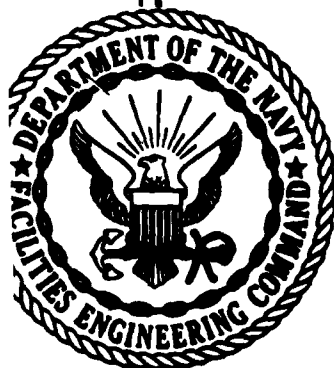

LEVEL

NAVFAC DM-2.3
MAY 1980

(1)

STRUCTURAL ENGINEERING

DTIC
SELECTED
FEB 1 1982
H

STEEL STRUCTURES

DESIGN MANUAL 2.3

APPROVED FOR PUBLIC RELEASE

DEPARTMENT OF THE NAVY
NAVAL FACILITIES ENGINEERING COMMAND

200 STOVALL STREET
ALEXANDRIA, VA. 22332

DISTRIBUTION: (1 copy each unless otherwise specified)

SNDL		FF6		FR3
23A1	(COMNAVFORAZORES only)	FF19	(Brooklyn, New Orleans, and Seattle only)	FR4
24J1				FT1
27G		FF38		FT2
39B		FG2	(Balboa, Harold Holt, Nea Makri, Thurse, Stockton, and Ponce only)	FT6
39C1				FT13
39E				FT18
42A3		FG3	(Cheltenham and East Machias only)	FT19
45B				FT22
49		FG6	(Wahiawa and Norfolk only)	FT27
51A		FH3	(Beaufort only)	FT28
51B1		FH6	(Bethesda only)	FT31
51B3		FH8	(Cairo only)	FT37
B1	(SECDEF only)	FH25	(Philadelphia, Portsmouth VA, Camp Lejeune, Oakland, Newport, Great Lakes, and Long Beach only)	FT55
B2A	(JCS, NSA, DLA, and DNA only)			FT64
B5	(USCG only)			FT73
C34	(Holy Loch, Souda Bay only)	FJ5		FT74A
		FKA6A1		FT74B
C37D	(Port Hueneme only)	FKA6A2		
E3A	(Washington, Barrow, Oakland only)	FKA6A3A		FT78
FA6	(Bermuda, Brunswick, Cecil Field, Key West, Jacksonville, Virginia Beach only)	FKA6A3B		V2
		FKA6A9		V3
FA7	(Guantanamo, Keflavik, Panama Canal, Mayport, Roosevelt Roads only)	FKA6A12		V5
		FKA6A15	(Code LA 151)	V8
FA10		FKA6A16		V12
FA18		FKA9		V14
FA23	(Antigua, Brawdy, Buxton, Leves only)	FKM8		V15
FA25	(10 copies)	FKM9		V16
FA2		FKM12		V17
FB5		FKM13		V23
FB7	(Alameda, Fallon, Lemoore, Oak Harbor, Miramar, North Island, Moffet Field only)	FKM15	(Philadelphia only)	
		FKN1	(West and Lant only (85 copies each))	Copy to: (one copy each unless otherwise indicated)
FB10	(Adak, Midway only)	FKN1	(South and North only (50 copies each))	21A
FB21		FKN1	(Pac and Ches only (25 copies each))	A2A
FB31	(Guam only)	FKN1	(Ches, FPO-1 only)	A3
FB33		FKN1		A4A
FB34	(Kadena only)	FKN2		A5
FB36	(Big Sur, Coos Head, Ferndale, and Pacific Beach only)	FKN3	(6 copies each)	A6
		FKN5		C7
FB41		FKN8		FD1
FB48		FKN10		FE1
FC3	(London only)	FKP1B	(less Concord)	FG1
FC4	(Sigonella only)	FKP1B	(Concord only - 3 copies)	FKA1A
FC5		FKP1E		FKA1B
FC7		FKP1J		FKA1C
FC12		FKP1M		FKA1F
FD2		FKP3A		FKN2
FE2		FKP7		
FE4	(Adak, Edzell, Hanza, Galeta Island, Homestead, Winter Harbor, Sabana Seca, and Sonoma only)	FKP8		FR1
		FKP11		
FF1	(Washington only)	FKQ3		
FF5		FKR1A		
		FKR1B	(2 copies)	
		FKR2A	(Dallas only)	
		FKR3A		
		FKR3C		
		FKR3H		
		FKR4B		
		FKR5		
		FKR7E	(3 copies)	

Additional copies are available from:

Commanding Officer
Naval Publications and
Forms Center
5801 Tabor Avenue
Philadelphia, PA 19120

Unclassified


SECURITY CLASSIFICATION OF THIS PAGE (When Data Entered)

REPORT DOCUMENTATION PAGE		READ INSTRUCTIONS BEFORE COMPLETING FORM
1. REPORT NUMBER NAVFAC DM-2.3	2. GOVT ACCESSION NO.	3. RECIPIENT'S CATALOG NUMBER
4. TITLE (and Subtitle) NAVFAC Design Manual DM-2.3 Structural Engineering Steel Structures		5. TYPE OF REPORT & PERIOD COVERED Design Criteria Final
		6. PERFORMING ORG. REPORT NUMBER DM-2.3
7. AUTHOR(s) Naval Facilities Engineering Command 200 Stovall Street Alexandria, VA 22332 (Code 0452)		8. CONTRACT OR GRANT NUMBER(s)
9. PERFORMING ORGANIZATION NAME AND ADDRESS Naval Facilities Engineering Command 200 Stovall Street Alexandria, VA 22332		10. PROGRAM ELEMENT, PROJECT, TASK AREA & WORK UNIT NUMBERS Engineering and Design
11. CONTROLLING OFFICE NAME AND ADDRESS Naval Facilities Engineering Command (Code 0432) 200 Stovall Street Alexandria, VA 22332		12. REPORT DATE May 1980
		13. NUMBER OF PAGES 25
14. MONITORING AGENCY NAME & ADDRESS (if different from Controlling Office)		15. SECURITY CLASS. (of this report) Unclassified
		15a. DECLASSIFICATION/DOWNGRADING SCHEDULE
16. DISTRIBUTION STATEMENT (of this Report) Unclassified/Unlimited		
17. DISTRIBUTION STATEMENT (of the abstract entered in Block 20, if different from Report) Unclassified/Unlimited		
18. SUPPLEMENTARY NOTES 82 01 29 049		
19. KEY WORDS (Continue on reverse side if necessary and identify by block number) Steel bridges; steel buildings; special steel structures; towers and stacks; special considerations for structural steel.		
20. ABSTRACT (Continue on reverse side if necessary and identify by block number) Basic criteria for the design of structural elements and systems fabricated of various alloys of structural steel are presented for use by experienced engineers. Design standards are established for Class A (Bridge), Class B (Building), and Class C (Special) structures. A discussion of special considerations related to the design of certain types of steel structures such as crane runways, towers, stacks, and storage tanks is included. Problems of corrosion, abrasion, design of expansion joints, and exposure to extreme temperatures are discussed.		

ABSTRACT

Basic criteria for the design of structural elements and systems fabricated of various alloys of structural steel are presented for use by experienced engineers. Design standards are established for Class A (Bridge), Class B (Building), and Class C (Special) structures. A discussion of special considerations related to the design of certain types of steel structures such as crane runways, towers, stacks, and storage tanks is included. Problems of corrosion, abrasion, design of expansion joints, and exposure to extreme temperatures are discussed.

Accession For	
NTIS GRA&I	☒
DTIC TAB	☐
Unannounced	☐
Justification	
By _____	
Distribution/	
Availability Codes	
and/or	
Dist. Statement	
A	



PRECEDING PAGE BLANK-NOT FILMED

FOREWORD

This design manual is one of a series developed from an evaluation of facilities in the shore establishment, from surveys of the availability of new materials and construction methods, and from selection of the best design practices of the Naval Facilities Engineering Command, other Government agencies, and the private sector. This manual uses to the maximum extent feasible, national professional society, association, and institute standards in accordance with NAVFACENGCOM policy. Deviations from these criteria should not be made without prior approval of NAVFACENGCOM Headquarters (Code 04).

Design cannot remain static any more than can the naval functions it serves or the technologies it uses. Accordingly, recommendations for improvement are encouraged from within the Navy and from the private sector and should be furnished to NAVFACENGCOM Headquarters, Code 04. As the design manuals are revised, they are being restructured. A chapter or a combination of chapters will be issued as a separate design manual for ready reference to specific criteria.

This publication is certified as an official publication of the Naval Facilities Engineering Command and has been reviewed and approved in accordance with SECNAVINST 5600.16.



D. G. Iselin
Rear Admiral, CEC, U.S. Navy
Commander
Naval Facilities Engineering Command

PRECEDING PAGE BLANK-NOT FILE

STRUCTURAL ENGINEERING DESIGN MANUALS

<u>New DM Number</u>	<u>Superseded Chapter in Basic DM</u>	<u>Subject</u>
2.1	-	General Requirements
2.2	1	Loads
2.3	2	Steel Structures
2.4	3	Concrete Structures
2.5	4	Timber Structures
2.6	5, 6, 7, 8	Aluminum Structures Masonry Structures Composite Structures Other Structural Materials
2.7	-	Snow Loads (Tri-Service)

CONTENTS
STEEL STRUCTURES

	<u>Page</u>
Section 1. SCOPE AND RELATED CRITERIA	2.3-1
1. SCOPE	2.3-1
2. CANCELLATIONS	2.3-1
3. RELATED CRITERIA	2.3-1
4. STANDARD SPECIFICATIONS	2.3-2
5. MINIMUM CONNECTIONS	2.3-2
Section 2. DESIGN STANDARDS	2.3-3
Part 1. CLASS A STRUCTURES	2.3-3
1. HIGHWAY BRIDGES	2.3-3
2. RAILWAY BRIDGES	2.3-3
3. OTHER	2.3-3
Part 2. CLASS B STRUCTURES	2.3-3
1. STRUCTURAL STEEL	2.3-3
2. STEEL JOISTS	2.3-3
3. LIGHT GAGE COLD-FORMED STEEL	2.3-3
4. STEEL ROOF DECK	2.3-3
5. STEEL CABLES	2.3-3
6. PREFABRICATED BUILDINGS	2.3-3
7. DESIGN ASSUMPTIONS APPLICABLE TO CRANE RUNWAY BEAMS AND SUPPORTS	2.3-4
a. Runway Stops	2.3-4
b. Deflections	2.3-4
Part 3. CLASS C STRUCTURES	2.3-4
1. GENERAL	2.3-4
2. WIRE ROPE	2.3-4
a. Prestretched Zinc-Coated Steel Structural Wire Rope and Strand	2.3-4
b. All Other Types of Wire Rope and Wire Strand and All Non-Prestretched Wire Rope and Wire Strand	2.3-4
c. Fasteners	2.3-4
3. TOWERS	2.3-4
a. Towers Over 300 Feet and Commercial Standard Designs	2.3-4
b. Geometry of Free Standing Towers	2.3-5
c. Foundations for Free Standing Towers	2.3-5
d. Guys	2.3-5
e. Design Assumptions for Guyed Towers	2.3-5

CONTENTS (continued)

	<u>Page</u>
4. SELF-SUPPORTING STACKS	2.3-5
a. Local Buckling	2.3-5
b. Beam Shear	2.3-6
c. Compact Section	2.3-6
d. Deflection	2.3-6
e. Weight of Plate and Lining	2.3-6
f. Wind-Induced Vibration	2.3-6
5. STORAGE TANKS	2.3-6
a. Tanks for Water Storage	2.3-6
(1) Modifications to the AWWA Standard	2.3-6
(2) Design Considerations	2.3-7
b. Tanks for Storage of Liquid Fuel	2.3-7
c. Foundations in Seismic Zones	2.3-7
Section 3. SPECIAL CONSIDERATIONS	2.3-7
1. EXPANSION JOINTS	2.3-7
a. Class A Structures	2.3-7
b. Class B Structures	2.3-7
2. CORROSION	2.3-8
a. Allowance for Corrosion Loss	2.3-8
b. Design Provisions	2.3-8
c. Use of Corrosion-Resistant Steel Conforming to ASTM A242 or A588	2.3-11
d. Use of Corrosion-Resistant Steel Conforming to ASTM A690	2.3-11
e. Use of Stainless Steel (ASTM A306 and A316)	2.3-11
3. WEAR	2.3-11
a. Increase in Metal Thickness	2.3-11
b. Wear Plates	2.3-11
4. CLIMATIC REQUIREMENTS	2.3-11
a. Arctic and Antarctic Zones	2.3-11
b. Tropic Zones	2.3-12
5. ELEVATED TEMPERATURES	2.3-12
a. Hot-Rolled Carbon Steel	2.3-12
b. High Strength and Heat Treated Steels	2.3-12
METRIC CONVERSION FACTORS	2.3-14
REFERENCES	Reference-1

FIGURES

<u>Figure</u>	<u>Title</u>	<u>Page</u>
1.	Time-Corrosion Curves for Industrial and Marine Atmosphere	2.3-9
2.	Time-Corrosion Curves in Soils	2.3-10

CONTENTS (continued)

TABLE

<u>Table</u>	<u>Title</u>	<u>Page</u>
1.	Properties of Steel at Elevated Temperatures	2.3-13

Section 1. SCOPE AND RELATED CRITERIA

1. SCOPE. This manual prescribes criteria for the design of structures, including temporary and prefabricated structures, which are fabricated of "Structural Steel" and related materials.

2. CANCELLATIONS. This manual, NAVFAC DM-2.3, Steel Structures, cancels and supersedes Chapter 2 of Structural Engineering, NAVFAC DM-2, of October 1970, and Changes 1 and 2.

3. RELATED CRITERIA. Certain criteria related to the design of steel structures appear in other manuals in the design manual series and in other sources as follows:

<u>Subject</u>	<u>Source</u>
General Requirements Service Classifications and Other General Requirements	NAVFAC DM-2.1
Soil Mechanics, Foundations and Earth Structures	NAVFAC DM-7
Fire Protection Engineering Fire Protection	NAVFAC DM-8
Electronics Industries Association Towers	RS-222
Bridges	1) AASHTO "Standard Specifications for Highway Bridges" 2) AREA "Manual for Railway Engineering"
Storage Tanks	1) NAVFAC DM-22 Liquid Fueling and Dispensing Facilities 2) AWWA Standard, "Welded Steel Elevated Tanks, Standpipes and Reservoirs for Water Storage" 3) API Standard 650 "Welded Steel Tanks for Oil Storage"
Corrosion Prevention and Control	NAVFAC MO-306

<u>Subject</u>	<u>Source</u>
Cold Regions Engineering	NAVFAC DM-9
Design in Arctic and Antarctic Areas	
Structural Steel	1) AISC "Manual of Steel Construction," "Specification for the Design, Fabrication and Erection of Structural Steel for Buildings"
	2) ASCE "Plastic Design in Steel"
	3) AISC/SJI "Standard Specifications for Open Web Joists," "Standard Specifications for Longspan Steel Joists"
	4) AISI "Cold Formed Steel Design Manual"
	5) SDI "Steel Roof Deck Design Manual"
	6) MBMA "Recommended Design Practices Manual"
Cables	AISI "Manual for Structural Application of Steel Cables for Buildings"

4. STANDARD SPECIFICATIONS. Throughout this manual, where design criteria are obtained from cited sources, those citations are termed "Standard" Specifications.

5. MINIMUM CONNECTIONS. There shall be a minimum of two fasteners in any connection (not including pinned, welded, or glued connections), except for secondary bracing members such as lacing and battens and except for incidental connections (not including primary bracing members) not proportioned on the basis of calculated stress.

Section 2. DESIGN STANDARDS

Part 1. CLASS A STRUCTURES

1. HIGHWAY BRIDGES. AASHTO "Standard Specifications for Highway Bridges" shall apply.
2. RAILWAY BRIDGES. AREA Standard "Manual for Railway Engineering" shall apply.
3. OTHER. Unless special considerations exist, the AASHTO "Standard Specifications for Highway Bridges" shall apply. Specifically, the AASHTO Standard may be followed in the design of structures supporting equipment moving on tracks if the provisions for distribution of concentrated loads are modified to reflect the effects of the tracks.

Part 2. CLASS B STRUCTURES

1. STRUCTURAL STEEL. AISC Standard "Specifications for the Design, Fabrication and Erection of Structural Steel for Buildings" and related standards as published in the AISC "Manual of Steel Construction" shall apply. Analysis and design of steel structures on the basis of plastic design, as described in ASCE "Plastic Design in Steel" and AISC "Plastic Design of Braced Multistory Steel Frames" may be followed.
2. STEEL JOISTS. AISC/SJI "Standard Specifications for Open Web Joists," "Standard Specifications for Longspan Steel Joists" and "Standard Specifications for Deep Longspan Steel Joists" shall apply.
3. LIGHT GAGE COLD-FORMED STEEL. AISI "Cold-Formed Steel Design Manual" shall apply.
4. STEEL ROOF DECK. SDI "Steel Roof Deck Design Manual" shall apply.
5. STEEL CABLES. AISI "Manual for Structural Applications of Steel Cables for Buildings" shall apply. Increase factor of safety up to 5 (based on ultimate) for threaded hardware where wind, earthquake, or other vibratory loadings may occur.
6. PREFABRICATED BUILDINGS. For combinations of loads and minimum thicknesses of materials, MBMA publication "Recommended Design Practices Manual" shall apply. Design loadings shall be as specified in NAVFAC DM-2.2, except as follows: where use of design loadings specified in NAVFAC DM-2.2 would prevent procurement of available off-the-shelf buildings, subject to review and approval by Code 04 (Structural) consideration may be given to deviation from said loadings. Type of occupancy should be among the factors considered in determining whether deviation is permissible. The reader is cautioned to check the loadings used in the design of prefabricated buildings against the requirements of NAVFAC DM-2.2, modified as set forth in paragraph 12 (Exceptions for Minor Structures) of NAVFAC DM-2.1.

7. DESIGN ASSUMPTIONS APPLICABLE TO CRANE RUNWAY BEAMS AND SUPPORTS.

a. Runway Stops. Provide removable stops or bumpers at ends of the runway. Design on basis of:

(1) If the stop engages the tread of the wheel, the height shall not be less than the radius of the wheel. Stops engaging other parts of the crane are recommended.

(2) Proportion stops for crane traveling at rated speed, with power off; using coefficient of restitution of 0.5, check for condition of travel at 20 percent of rated speed, with power off, that deceleration does not exceed 3 ft./sec/sec.

b. Deflections. Vertical deflection of crane runway girders should be limited to $L/1000$. Check horizontal deflection to assure compatibility with clearances between flanges of double-flanged wheels and bearing area of single-flanged wheels.

Part 3. CLASS C STRUCTURES

1. GENERAL. The provisions of the design standards for Class B structures shall apply except as prescribed in NAVFAC DM-2.1 or elsewhere herein.

2. WIRE ROPE. Working loads for various types of wire rope, including guys, but not including running ropes such as in cranes or derricks, and not including wire rope used in other types of equipment or machinery, shall be as follows:

a. Prestretched Zinc-Coated Steel Structural Wire Rope and Strand (ASTM A603, A586, and A475). For guyed towers, the provisions of RS-222 shall apply. For other types of structures, consult NAVFACENGCOM. In general the factor of safety, based on breaking strength, shall not be less than 2.0, and shall be increased for cases where occupied areas would be threatened by failure of the rope or strand.

b. All Other Types of Wire Rope and Wire Strand and All Non-Prestretched Wire Rope and Wire Strand. Consult NAVFACENGCOM.

c. Fasteners. For speltered fasteners, follow recommendations in ASTM Standard applicable to type of rope (or strand) being used. For threaded fasteners in guyed towers, consult NAVFACENGCOM regarding desirability of increasing factor of safety.

3. TOWERS.

a. Towers Over 300 Feet and Commercial Standard Designs. NAVFACENGCOM shall be consulted, on an individual project basis, for the criteria to be used for specific towers over 300 feet in height. To facilitate procurement of standard, commercially manufactured, steel radio towers of 300 feet or less in height, use of the latest Standard RS-222 (Electronic Industries Association) is permitted.

b. Geometry of Free Standing Towers. Taper free standing towers inward toward the top. For high towers, the tapering can consist of two or more slopes. The upper part of the tower can be uniformly shaped. Use a portal base only where functionally required (for access, bringing in equipment, or to straddle an obstruction). Otherwise, connect the bottom struts to the tower legs close to the base.

c. Foundations for Free Standing Towers. For individual leg foundations, the minimum weight of the concrete foundation alone (not considering weight of the earth cover) shall provide a factor of safety of 1.0 against uplift, overturning, and sliding. Factor of safety against uplift, overturning and sliding, including weight of earth cover, shall conform to requirements of DM-2.1 para. 7.

d. Guys. Guys shall be prestretched. Follow recommendations in ASTM Standard applicable to type of rope (or strand) being used.

e. Design Assumptions for Guyed Towers. The following design assumptions should be made:

(1) With no wind and with air temperature at the design value, initial tension in guy cables shall be no more than one-tenth the cable breaking strength.

(2) There should be no increasing of allowable stress due to wind loading except as specified in para. (4).

(3) Working loads for guys shall be as specified in paragraph 2, (Wire Rope). Working loads for insulators and eye bolts of fail-safe insulators shall be 30 percent and 20 percent respectively of the manufacturer's guaranteed minimum breaking strength.

(4) Consider the effect of one guy broken with one-quarter wind load plus dead load, with an increase in allowable stress of 33 percent but not exceeding the yield of the material.

(5) Eccentrically loaded towers should be designed to minimize tower dead load deflections. The design should consider cambering the tower so that introduction of the eccentric dead load will result in a plumb condition.

4. SELF-SUPPORTING STACKS.

a. Local Buckling.

(1) Unstiffened, cylindrical stacks shall be investigated for local buckling due to axial compression and bending when:

D/t is greater than $3300/F_y$.

where:

D = nominal diameter inches

t = wall thickness, inches

F_y = yield strength, ksi

(2) Where the preceding D/t ratio is exceeded, the allowable axial compression and bending stress shall be determined by substituting a reduced effective failure stress F_{yr} for F_y in the appropriate design formulas of the AISC Standard, where:

$$F_{yr} = 1 - (1 - \frac{3300/F_y}{D/t})^2 F_y$$

b. Beam Shear. An effective shear area of one-half the gross cross-sectional area shall be used when calculating beam shear in the cylinder.

c. Compact Section. Cylindrical stacks may be treated as compact sections when D/t is less than or equal to 1300/ F_y .

d. Deflection. Computed deflection at the top of the stack shall not be more than 1/100 of the stack height.

e. Weight of Plate and Lining. Additional compressive stresses in the stack plate due to the weight of the stack plate and light lining (maximum of twice the weight of the stack plate) may be neglected.

f. Wind-Induced Vibration. Effects shall be investigated. In particular, beware of vibration induced by low velocity winds, especially when multiple stacks are in series.¹

5. STORAGE TANKS.

a. Tanks for Water Storage. The design (both elevated and surface tanks) shall conform to the AWWA Standard "Welded Steel Elevated Tanks, Standpipes, and Reservoirs for Water Storage."

(1) Modifications to the AWWA Standard:

(a) Section 3.2: Substitute the loads indicated in DM-2.2 for the provisions of paragraphs 3.2.3, 3.2.4 and 3.2.5.

(b) Section 3.10: See paragraph 2 of Section 3 for criteria on corrosion. Corrosion allowances shall be added to the flanges of beams and channels as well as to the webs.

(c) Where horizontal girders are used as balcony floors, minimum girder widths shall be as follows:

¹See American Society of Mechanical Engineers Publication 63-WA-248 ("Dynamic Response of Tall Stacks to Wind Excitation") and American Society of Civil Engineers, Proc. Vol. 80, Nov. '54 ("The Vibration of Steel Stacks").

<u>Tank capacity</u> <u>(gallons)</u>	<u>Minimum girder</u> <u>widths</u> <u>(inches)</u>
75,000 or less	24
over 75,000 to 100,000	27
over 100,000 to 200,000	30
over 200,000	36

(d) Thickness of hemispherical bottoms shall be proportioned in accordance with paragraph 5.11 of the AWWA Standard, but not less than the thickness of the lowest shell plate in the cylindrical part.

(e) See paragraph 5. SELF-SUPPORTING STACKS for criteria relating to prevention of local buckling in riser pipe.

(f) Use of high-strength steels covered in the AISC Standard will be permitted.

(2) Design Considerations.

(a) Use all-welded, cylindrical construction unless special conditions dictate otherwise.

(b) Shell design shall consider principal stresses, combining ring stresses and vertical compression, with bending due to restraints offered by top and bottom plates.

(c) Design foundations in accordance with criteria for free standing towers.

b. Tanks for Storage of Liquid Fuel. (See NAVFAC DM-22.)

c. Foundations in Seismic Zones. Ring beams shall be provided for all tank foundations in Zones 3 or 4.

Section 3. SPECIAL CONSIDERATIONS

1. EXPANSION JOINTS.

a. Class A Structures. Applicable requirements of the Standard Specification shall govern provisions for expansion and contraction.

b. Class B Structures. Provide expansion joints:

(1) Where structures are more than 300 feet in length, unless special conditions of climate or exposure exist.

(2) At junctures of T-, L-, U-shaped and other irregularly shaped buildings.

(3) Where there is such a change in the type of foundation construction as to expect differential settlements.

2. CORROSION.

a. Allowance for Corrosion Loss (Carbon Steel-ASTM A36). For purposes of estimating service life, the following provisions may be used as "first approximation." Where serious corrosion problems are anticipated, advice of corrosion specialists should be sought. See also, Corrosion Handbook of American Society of Corrosion Engineers.

(1) Atmospheric Corrosion. See Figure 1 for typical time-corrosion curves for industrial and marine atmospheres for various types of steels. Using these values, multiply by relative corrosive effects of atmospheres at different locations throughout the world as presented in Corrosion Prevention and Control, NAVFAC MO-306, Table 4, to approximate corrosion loss.

(2) Corrosion in Soils. Use Figure 2 to estimate corrosion loss for buried steel. These curves do not include allowance for stray current effects.

(3) Seawater Corrosion. For continuously submerged conditions, the rate of loss for the various types of structural steels is approximately 0.004 inch per year for each surface exposed. In, and above, the splash zone the rate of corrosion loss is greater. It shall be assumed, subject to modification by local experience, that conformance to the provisions of paragraph b. following, and to the supplementary provisions of NAVFAC DM-25, will provide the required service life stipulated in NAVFAC DM-2.1.

(4) Electrolytic Corrosion. Do not use dissimilar materials without proper insulators, or cathodic protection, or both.

(5) Corrosion in Tropical Climates. Except where specific values are presented in Table of NAVFAC MO-306, increase allowance for corrosion loss when designing facility in tropical climate in accordance with local experience. Unless otherwise demonstrable, and excepting arid regions, assume a corrosion loss twice that in comparable exposure in temperate climate.


b. Design Provisions. Where applicable:

(1) Design box-shaped members so that all inside surfaces may be readily inspected, cleaned, and painted; or close them entirely.


(2) In outdoor structures, the flanges of two angle members, if not in contact, shall have a minimum of 3/8 inch of space between them.

(3) Pockets or depressions in outdoor structures shall have drain holes or be filled with concrete, mastic, or grout. Provide positive drainage away from exposed steel. Terminate column bases on concrete curbs or piers above grade, and pitch tops of curbs or piers to drain.

(4) Steel sheet piling should be capped with concrete to eliminate rapid corrosion of the exposed ends.

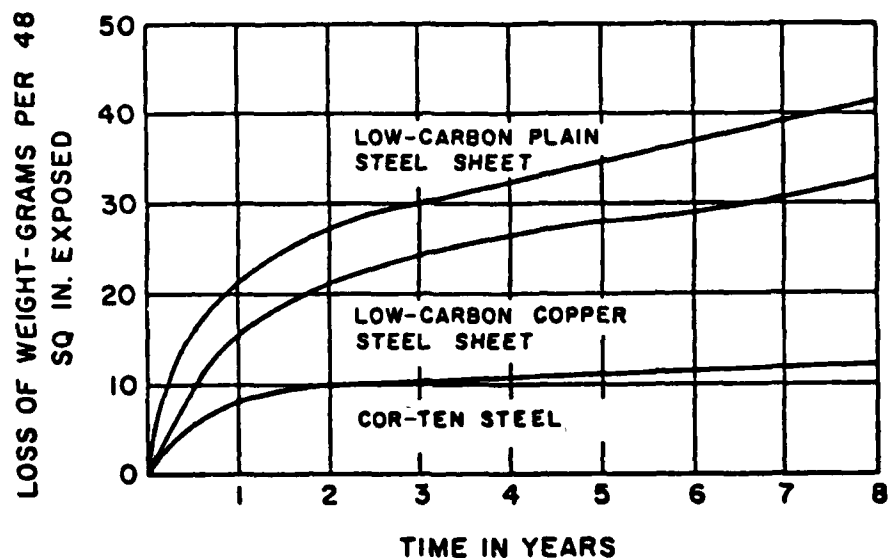

(a) INDUSTRIAL ATMOSPHERE
(KEARNY, N.J.-2 MILES FROM JERSEY CITY)

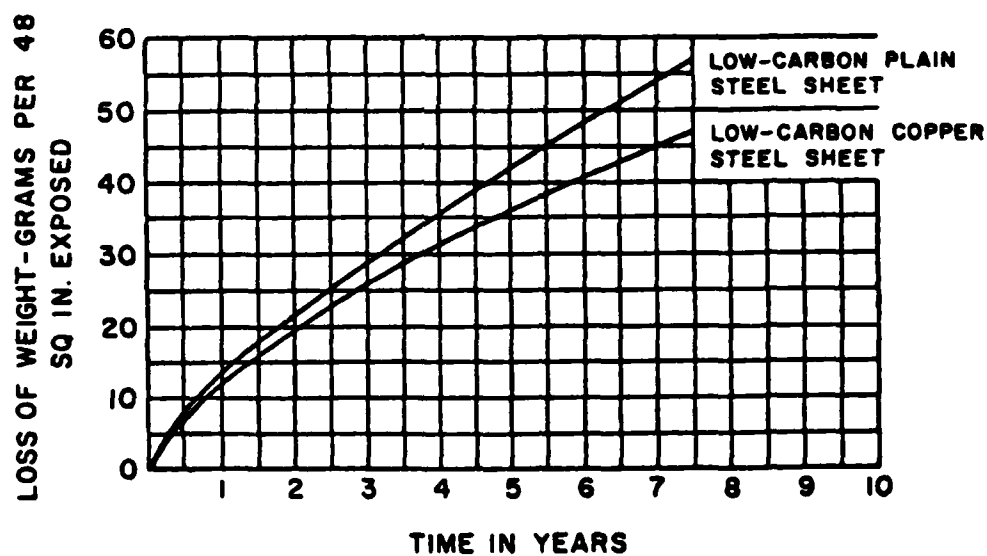

(b) MARINE ATMOSPHERE
(KURE BEACH, N.C.-250 YARDS FROM OCEAN)

FIGURE 1
Time-Corrosion Curves for Industrial
and Marine Atmospheres

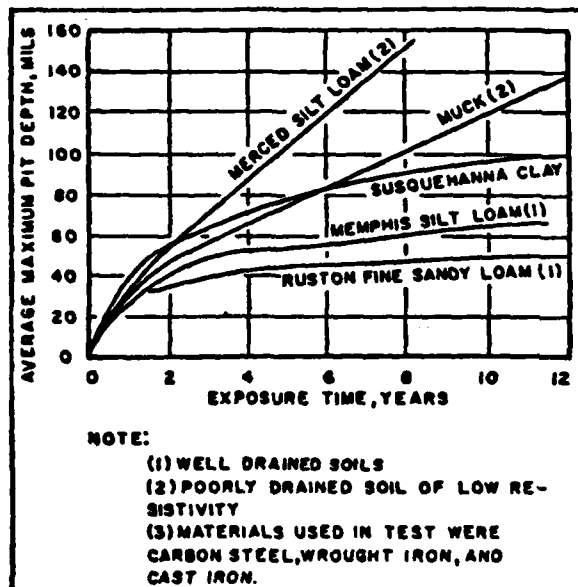


FIGURE 2
Time-Corrosion Curves in Soils

(5) Steel sheet piling for waterfront construction should be encased in concrete or given a protective coating to a minimum of 2 feet below mean low water level. Tie rods for sheet piling should be similarly protected for their entire length.

(6) Steel surfaces for open pier type construction should be given a protective coating as described above for steel sheet piling or shall be zinc-coated, or shall be encased in concrete.

(7) Where extreme corrosion conditions exist, consideration should be given to providing cathodic protection for steel piling exposed under water and tie rods for bulkhead construction in addition to protective coatings.

(8) If cathodic protection is not installed initially, consideration should be given to providing bonded cables for future connection for cathodic protection of the piling exposed under water.

(9) Structural members embedded in concrete and exterior railings, handrails, fences, guardrails, and anchor bolts shall be coated with zinc or coal tar enamel. Coating shall extend 6 inches outside of embedded portion. Where coated anchor bolts are used, consider reduction in bond strength when estimating pull-out resistance.

(10) Isolation of dissimilar metals (aluminum and steel are an example) shall be by use of fiber or plastic pads, by use of nonmetallic coatings, or other means as approved by NAVFACENGCOM HQ.

c. Use of Corrosion-Resistant Steel Conforming to ASTM A242 or A588. ("Weathering" Steels).

(1) Do not use in areas where the atmosphere contains salt spray. This applies even to locations remote from a body of salt water if experience demonstrates that the prevailing winds will carry salt-laden air into contact with the structure.

(2) Do not use in seawater environment. No benefit will derive. Plain carbon steel (ASTM A-36) is a better choice.

(3) Do not use in buried structures, unless coated.

d. Use of Corrosion-Resistant Steel Conforming to ASTM A690. (See DM-25.7 for requirements.)

e. Use of Stainless Steel (ASTM A306 and A316).

(1) Do not use in salt spray zone.

(2) Do not use if buried, or likely to become buried. In general, in an aqueous environment, if contact with oxygen is precluded, accelerated corrosion will occur. This happens under washers, for example.

3. WEAR.

a. Increase in Metal Thickness. Allow for wear by increasing the metal thickness of those portions of the design section subject to wear, beyond the stress requirements. The amount of such increase depends on the material to be handled and on the desired service life. Estimate wear requirements on the basis of previous experience or similar conditions (or both) at existing installations.

b. Wear Plates. Consider the use of replaceable wear plates where extremely severe wear conditions occur.

4. CLIMATIC REQUIREMENTS.

a. Arctic and Antarctic Zones. For carbon steel, the transition from ductile to brittle behavior occurs within temperatures to be expected in Arctic and Antarctic Zones. The lower ductility normally is not important but loss of impact resistance requires that structures subject to impact, such as bridges and crane runways, be designed with the following factors in mind:

(1) Avoidance of "stress raisers" is important. As examples:

(a) provide ample fillets.

(b) two thin plates with welds offset are better than one thicker plate with thicker weld.

(2) Welding is a particular problem. Use riveted or bolted joints, as feasible. Take precautions to eliminate gas and impurities in welds. Proper preheating and postcooling are essential.

(3) Low-carbon steels and nickel-alloy steel show better toughness at low temperature than do carbon steels.

b. Tropic Zones. The effects of increased temperatures, as in tropic zones, on the load capacity of steel members may be neglected.

5. ELEVATED TEMPERATURES.

a. Hot-Rolled Carbon Steel. Up to 500°F, strength of steel shall be assumed to be the same as the strength at normal temperature. Above 500°F, the yield strength shall be assumed to decrease linearly with increasing temperature up to 1,000°F, where the assumed yield point shall be assumed as 70 percent of the strength at 500°F.

b. High Strength and Heat Treated Steels. The effect of elevated temperatures on high strength and heat treated steels should be thoroughly investigated. For example, quenched and tempered materials will undergo radical changes in their mechanical properties as well as toughness when subjected to elevated temperatures.

c. See Table 1 for properties of steel at elevated temperatures.

TABLE 1
Properties of Steel at Elevated Temperatures

Type of Steel	Temperature		Yield Strength		Tensile Strength		Percent Elongation in 2 in. (51mm)
	OF	(°C)	0.2% Offset ksi	(MPa)	ksi	(MPa)	
ASTM A36	80	(25)	36.0	(250)	64.0	(440)	37
	300	(150)	30.2	(210)	64.0	(440)	25
	500	(260)	27.8	(190)	63.8	(440)	28
	700	(370)	25.4	(175)	57.0	(395)	35
	300	(480)	21.5	(150)	44.0	(305)	42
	1100	(595)	16.3	(110)	25.2	(175)	50
	1300	(705)	7.7	(55)	9.0	(60)	71
USS COR-TEN A ASTM A242	80	(25)	54.1	(375)	81.3	(560)	31
	200	(95)	50.8	(350)	76.2	(525)	31
	400	(200)	47.6	(330)	76.4	(525)	27
	600	(315)	41.1	(285)	81.3	(560)	24
	800	(425)	39.9	(275)	76.4	(530)	28
	1000	(540)	35.2	(240)	52.8	(365)	21
	1200	(645)	20.6	(140)	27.6	(190)	48
							in 1 in. (25 mm)
USS COR-TEN ASTM A588 (High-Temp)	80	(25)	58.6	(405)	78.5	(540)	30
	200	(95)	57.3	(395)	79.5	(550)	28
	400	(200)	50.4	(350)	74.8	(515)	24
	600	(315)	42.5	(290)	77.7	(535)	24
	800	(425)	37.6	(260)	70.7	(490)	25
	1000	(540)	32.6	(225)	46.4	(320)	26
	1200	(645)	17.9	(125)	23.3	(160)	48

S.I. Conversion Units

The following metric equivalences were developed in accordance with ASTM E 621 and are listed in the sequence as they appear in the text. All equivalences are approximate.

3 ft/sec/sec.	=	900 mm/sec/sec.
300 feet	=	90 m
.004 inch/year	=	0.1016 mm/year
3/8 inch	=	10 mm
500° F	=	260° C

REFERENCES

AASHTO standards. American Association of State Highway and Transportation Officials, Washington, D.C. 20004
Standard Specifications for Highway Bridges

AISC publications. American Institute of Steel Construction, New York, New York 10017

Manual of Steel Construction

Specifications for the Design, Fabrication and Erection of Structural Steel for Buildings

Standard Specifications for Open Web Joists. AISC/SJI

Standard Specifications for Longspan Steel Joists. AISC/SJI

Standard Specifications for Deep Longspan Steel Joists. AISC/SJI

Plastic Design of Braced Multistory Steel Frames

AIISI publications. American Iron and Steel Institute, New York, New York 10017

Cold-Formed Steel Design Manual

Manual for Structural Application of Steel Cables for Buildings

American Society of Corrosion Engineers. Corrosion Handbook Plastic Design in Steel

AREA publications. American Railway Engineering Association, Chicago, Illinois 60605

Manual for Railway Engineering

ASCE publications and proceedings. American Society of Civil Engineers, New York, New York 10017

Plastic Design in Steel

The Vibration of Steel Stacks

ASME publications. American Society of Mechanical Engineers, New York New York 10017

ASME 63-WA-248. Dynamic Response of Tall Stacks to Wind Excitation

ASTM proceedings and standards. American Society for Testing and Materials, Philadelphia, Pennsylvania 19103 ASTM A36. Carbon Steel

Plates, Shapes and Bars of Structural Quality

ASTM A242 Structural Plates, Bars and Shapes

ASTM A306 Stainless Steel

ASTM A316 Stainless Steel

ASTM A586 Prestretched Zinc-Coated Steel Structural Strand

ASTM A588 Structural Plates, Bars and Shapes

ASTM A603 Prestretched Zinc-Coated Steel Structural Wire Rope

ASTM A690 High-Strength, Low-Alloy Steel H-Piles and Sheet Piling for Use in Marine Environments

ASTM E380 Standard Metric Practice Guide

AWWA. Welded Steel Elevated Tanks, Standpipes and Reservoirs for Water Storage. AWWA Standard D100. American Water Works Association, New York, New York 10016

MBMA. Recommended Design Practices Manual. Metal Building Manufacturers Association, Cleveland, Ohio 44115

NAVFAC Documents and Standards. Government agencies may obtain documents from the U.S. Naval Publications and Forms Center, Philadelphia, Pennsylvania 19120. Telephone: AUTOVON-442-3321; commercial 215-697-3321. Non-government organizations may obtain documents from the Superintendent of Documents, U.S. Government Printing Office, Washington, D.C. 20402.

NAVFAC DM-2.1	General Requirements
NAVFAC DM-7	Soil Mechanics, Foundations and Earth Structures
NAVFAC DM-8	Fire Protection Engineering
NAVFAC DM-9	Cold Regions Engineering
NAVFAC P-355	Seismic Design for Building (Tri-Service)
NAVFAC DM-2.2	Loads
NAVFAC DM-22	Liquid Fueling and Dispensing Facilities
NAVFAC DM-25	Waterfront Operational Facilities
NAVFAC MO-306	Corrosion Prevention and Control

RS-222. Electronics Industries Association, Washington, D.C. 20006

SDI. Steel Roof Deck Design Manual. Steel Deck Institute, St. Louis, Missouri

**DATA
FILM**