

19960906 003

TNO-report

96-CMC-R0290

**SHOCK TESTING OF A DRY CHEMICAL  
FIRE EXTINGUISHER inclusive a BRACKET**

TNO Building and  
Construction Research

Lange Kleiweg 5, Rijswijk  
P.O. Box 49  
2600 AA Delft  
The Netherlands

Phone +31 15 284 20 00  
Fax +31 15 284 39 90  
Telex 38270

Date July 1996

Author(s) F.J. van Bragt

Sponsor : Ministry of Defence (Navy)  
Department : Naval Construction  
Order no. KM : 685/96/0516/01  
Approved : T.H.Smits B.Sc.  
Address : P.O. Box 20702  
2500 ES 's-Gravenhage  
The Netherlands

Monitoring agency : TNO Defence Research Organization  
Project no. : A96/KM/126  
DO no. : 13403

Classified by : T.S. van Tongeren LTZT 1  
Classification date : July 1996  
Classification : Total report unclassified

All rights reserved.  
No part of this publication may be reproduced and/or published by print, photoprint, microfilm or any other means without the previous written consent of TNO.

In case this report was drafted on instructions, the rights and obligations of contracting parties are subject to either the Standard Conditions for Research Instructions given to TNO or the relevant agreement concluded between the contracting parties. Submitting the report for inspection to parties who have a direct interest is permitted.

**DTIC QUALITY INSPECTED 2**

Report no. : 96-CMC-R0290  
Project no. : 62376588  
SA no. : 96007  
Approved : J.M.J. Oostvogels  
Visa : G.T.M. Janssen

M.Sc.  
M.Sc.

© TNO

Total pages : 20  
Appendix

TNO Building and Construction Research provides a comprehensive research and development service specifically geared to the needs of the construction and engineering industry.



Netherlands Organization for  
Applied Scientific Research (TNO)

The Standard Conditions for Research Instructions given to TNO, as filed at the Registry of the District Court and the Chamber of Commerce in The Hague shall apply to all instructions given to TNO.

**MANAGEMENTUITTREKSEL**

Titel : Shock testing of a dry chemical fire extinguisher inclusive a bracket.  
Auteur : F.J. van Bragt  
Datum : July 1996  
Opdrachtnr. : 62376588 / A96/KM/126  
IWP-nr : 792  
Rapportnr. : 96-CMC-R0290

De schokbestendigheid van een poederblusser, type PG9 - fabriek SAVAL, inclusief de ophangbeugel zijn experimenteel onderzocht.

De standaard ophangbeugel voor de poederblusser, is niet schokbestendig. Samenwerking tussen fabrikant en het Ministerie van Defensie (Marine) resulteerde in een prototype-beugel die ter beproeving werd aangeboden.

Er zijn tijdens en na de beproevingen geen tekortkomingen aan de poederblusser geconstateerd.

De vergrendeling van de snelsluiting van de ophangbeugel functioneerde in één beproevingsrichting niet voldoende, waardoor de poederblusser uit de ophangbeugel werd gelanceerd.

Na een vrij simpele modificatie bleef de sluiting goed functioneren, ook na herhaalde schokproeven.

De beproefde poederblusser en de specifieke KM-beugel voldoen aan de gestelde schokeisen, mits de vergrendeling van de snelsluiting wordt gemodificeerd.

## Contents

Managementuittreksel 2

Contents 3

1.	INTRODUCTION	4
2.	IDENTIFICATION OF THE EQUIPMENT	5
3.	SHOCK REFERENCE DATA	6
4.	SHOCK TEST SET UP	7
5.	SHOCK TEST PROCEDURE	9
6.	SHOCK INSTRUMENTATION AND DATA HANDLING	10
7.	TEST RESULTS	12
8.	GRAPHICAL PRESENTATION	13
9.	INSPECTION REPORT	16
10.	CONCLUSION	20

Report Documentation page

## 1. INTRODUCTION

By order of the Netherlands Ministry of Defence (Navy), a dry chemical fire extinguisher and a special bracket, type PG9 - make SAVAL, have been exposed to shock tests.

The shock tests have been performed by the "Centre for Mechanical Engineering" in Delft the Netherlands, on June 13<sup>th</sup> 1996.

The shock tests were carried out in accordance with the specification shock grade B(F).

The special KM bracket was engineered in close cooperation between the manufacturer and the Ministry of Defence (Navy).

The tests were conducted by F.J. van Bragt.

The shock tests were witnessed by T.S van Tongeren LTZT 1, Mr. T.H.Smits from the R.NI.N, Mr. N.Albersen and K.Nooyens from SAVAL.

## 2. IDENTIFICATION OF THE EQUIPMENT

### 2.1.1 Equipment

Name : dry chemical fire extinguisher

Type : PG9

Mass [kg] : 15

NSN : 4210-17-056-3644

### 2.1.2

Name : bracket

Type : KM

Material : stainless steel 316

Mass [kg] : 3.9

Mounting : fixed with 6 bolts M12

## 2.2 Manufacturer and supplier

Name : SAVAL bv  
Address Weststrik 17  
P.O. Box 100  
4840 AC Prinsenbeek  
The Netherlands

## 2.3 Remarks

During the test in progress the safety belt snap lock failed.  
Before the next shock tests a modification was carried out in the snap lock device.

### 3. SHOCK REFERENCE DATA

#### 3.1 Shock requirements

Operating conditions : not applicable during the shock test

Shock directions : vertical, \*perpendicular and \*transverse

Shock grade : B(F)

*\* The requirements in the perpendicular and transverse direction are lower than for the vertical direction. The equipment has been shock tested accordingly, so the mounting position on board of the ship shall always be upright.*

#### 3.2 Shock testing machine

Type : light weight shock machine

Installed at : Centre for Mechanical Engineering

Address : Leeghwaterstraat 5  
P.O. Box 29  
2600 AA DELFT  
The Netherlands  
phone +31-152608408

#### 4. SHOCK TEST SET UP

The fire extinguisher, mounted in the bracket, was fixed to an auxiliary structure which was rigidly mounted to the shock machine table. This is the normal mounting position on board of the ship (see figure 1).

For reasons of economy a second fire extinguisher was mounted on the auxiliary structure in the perpendicular and the transverse directions; in this way the positive and negative orientation were tested in one blow, (see figures 2 and 3).

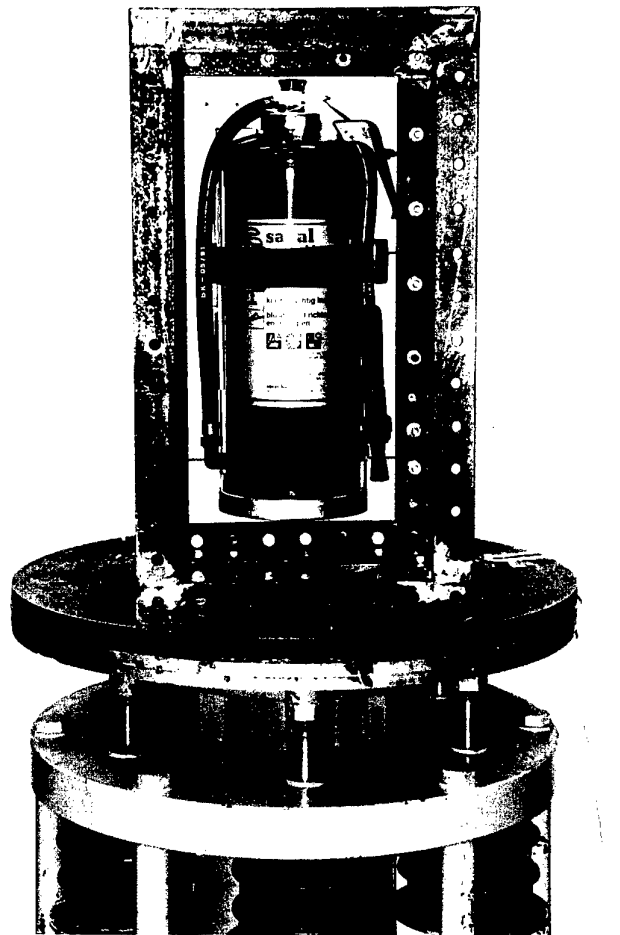


Figure 1, Fire extinguisher on test in the vertical direction (Z).

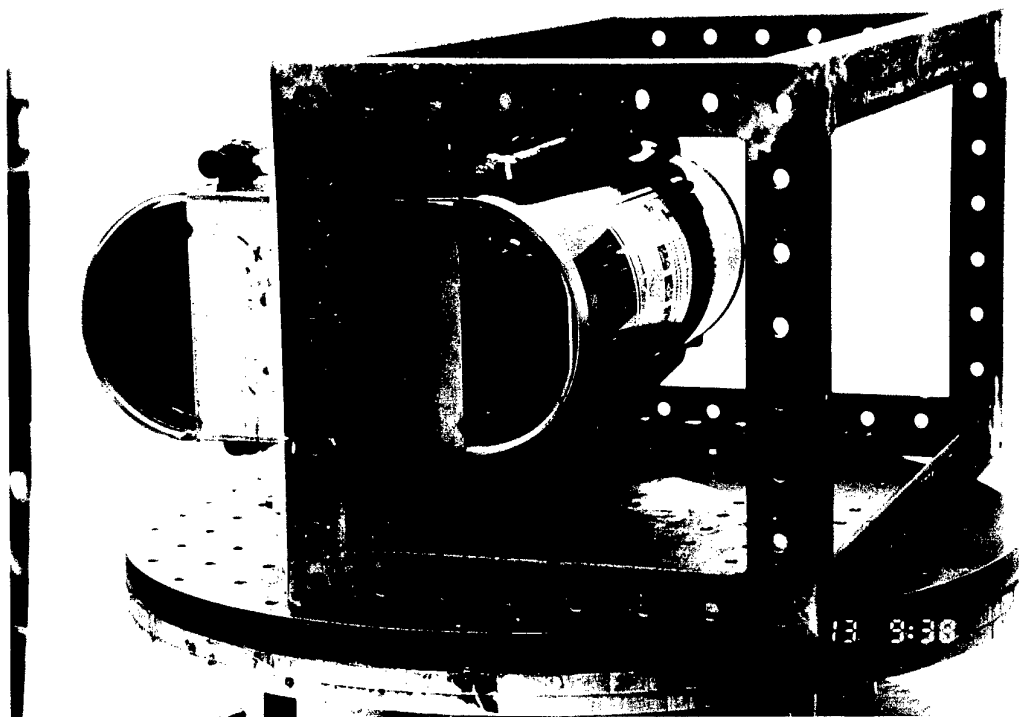


Figure 2, Fire extinguishers on test in the transverse direction (+ and -).

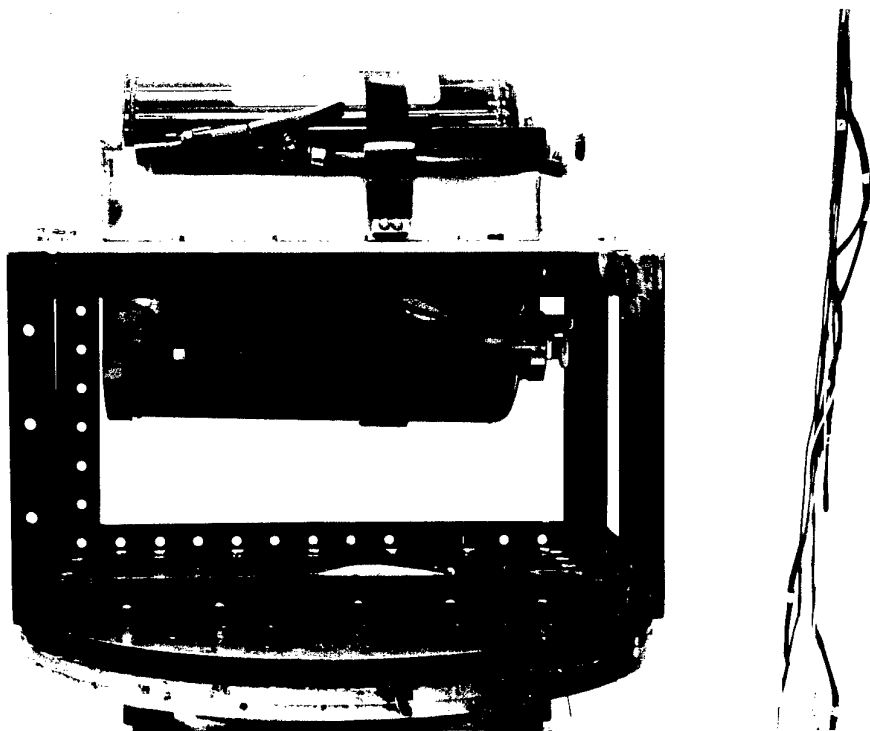


Figure 3, Fire extinguishers on test in the perpendicular direction (+ and -).

## 5. SHOCK TEST PROCEDURE

### 5.1. Shock simulator control

The shock machine can be set for different shock grades and shock level factors. The shock grade is set according to the reference pulse and verified by means of the velocity signal of the simulated shock pulse.

The shock pulse on the shock machine table is measured by means of a piezoresistive accelerometer.

The shock pulse acceleration is digitized, stored in a computer memory, integrated to obtain pulse velocity and double integrated to obtain pulse displacement. From the acceleration signal the maximax shock response spectrum, in terms of pseudo velocity, is calculated over the frequency range 5 - 1000 Hz for a damping factor of 0.01.

The relevant data of the shock tests have been tabulated in the tables of Ch. 7.

The graphical representation is given in Ch. 8 as information only. No claims can be derived from this information.

## 6. SHOCK INSTRUMENTATION AND DATA HANDLING

### 6.1 Transducer locations

For verification of the applied shock with the requirement, acceleration measurements were performed on the table of the shock machine.

### 6.2 Shock instrumentation

The measuring system consisted of:

- \* Accelerometers; type 2262/1000; manufacturer Endevco.  
The last calibration of the accelerometers was carried out in May 1996.
- \* Programmable High Speed Data Acquisition System.  
Type SCADAS 212; serial no: 80904002; Manufacturer DIFA.  
Calibrated July 1995; due July 1996.
- \* Personal Computer T3200 SXC.  
DMA interface.  
D\_TAC software. Manufacturer DIFA.

A block diagram of the hardware and the software can be found in figure 4.

### 6.3 Relevant shock instrumentation settings

Block size : 8192  
Sample frequency : 10 kHz  
Filter frequency : 2 kHz (Equal time delay filters)

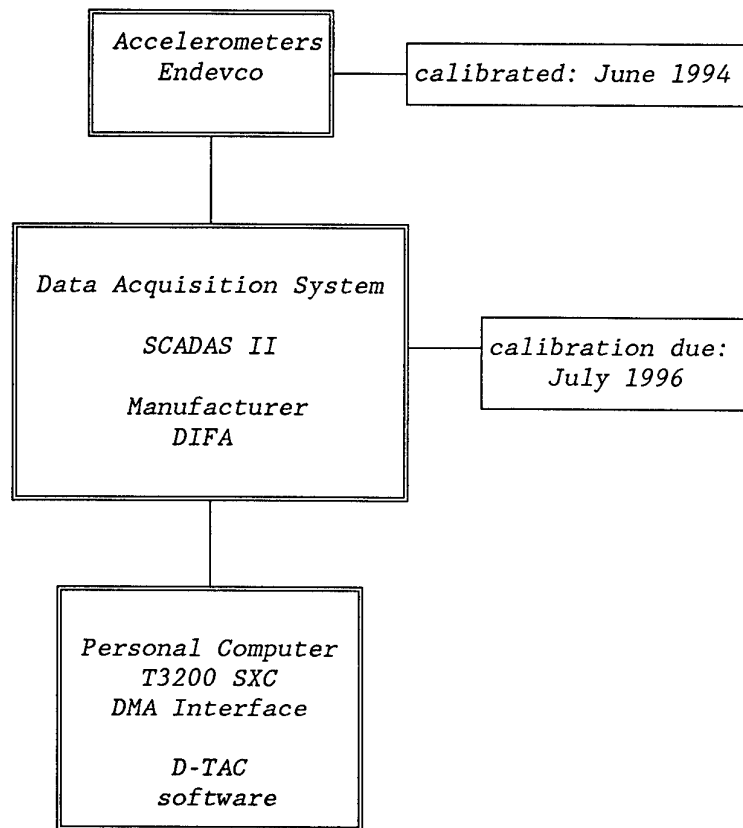


Figure 4, Shock measurement system

## 7. TEST RESULTS

The data measured during the tests are tabulated below.

Shock id.no.		01	02	03		
<b>shock direction</b>	*)	<b>Z</b>	<b>Z</b>	<b>Z</b>		
acceleration	[m/s <sup>2</sup> ]	1178	2140	3260		
deceleration	[m/s <sup>2</sup> ]	325	595	921		
velocity	[m/s]	2.0	4.2	6.0		
displacement	[mm]	15	32	44		
time T1	[ms]	4.3	4.0	4.2		
time T2	[ms]	31	35	33		
page		-	-	13		
date of test		June 13 <sup>th</sup>				

Shock id.no.		04	05	06	07	08
<b>shock direction</b>	*)	<b>X</b>	<b>X</b>	<b>X</b>	<b>X</b>	<b>Y</b>
acceleration	[m/s <sup>2</sup> ]	1594	1950	2110	2200	1795
deceleration	[m/s <sup>2</sup> ]	440	630	548	650	650
velocity	[m/s]	2.7	3.3	3.3	3.3	3.1
displacement	[mm]	19	23	22	22	22
time T1	[ms]	4.1	3.9	4.0	3.9	3,1
time T2	[ms]	33	32	32	32	33
page		-	-	-	14	15
date of test		June 13 <sup>th</sup>				

\*) Z = vertical test direction;  
 X = transverse test direction  
 Y = perpendicular test direction

## 8. GRAPHICS PRESENTATION

The figures 5,6 and 7 show the shock results at maximum intensity in each test direction.

In each figure the velocity time history and the maximax pseudo velocity shock response spectrum are presented. In each of the graphs the motion measured at the table, as well as the requirement are given.




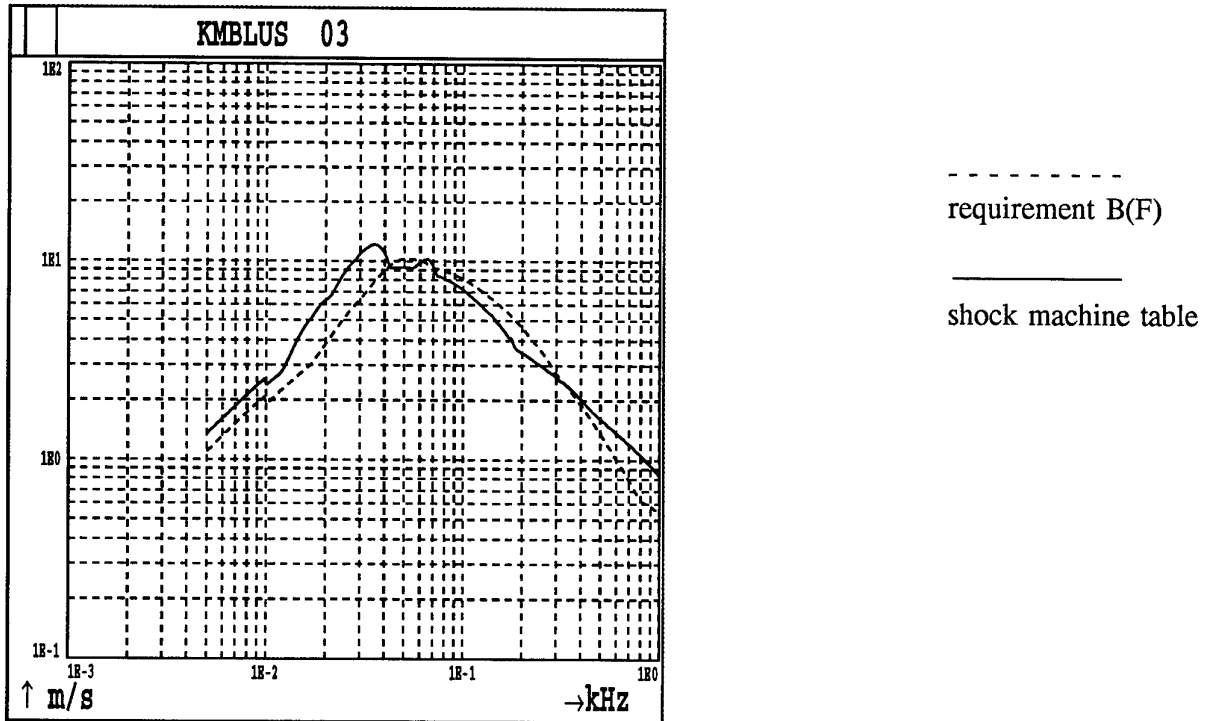


Figure 5, Vertical test orientation.

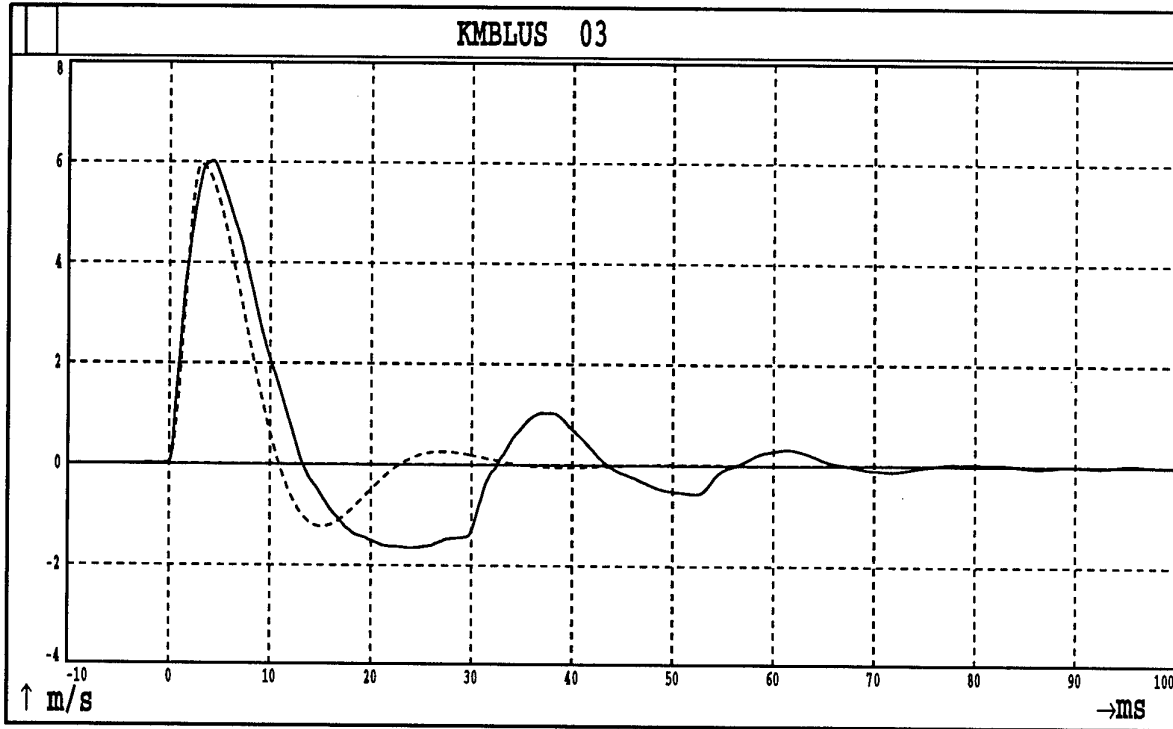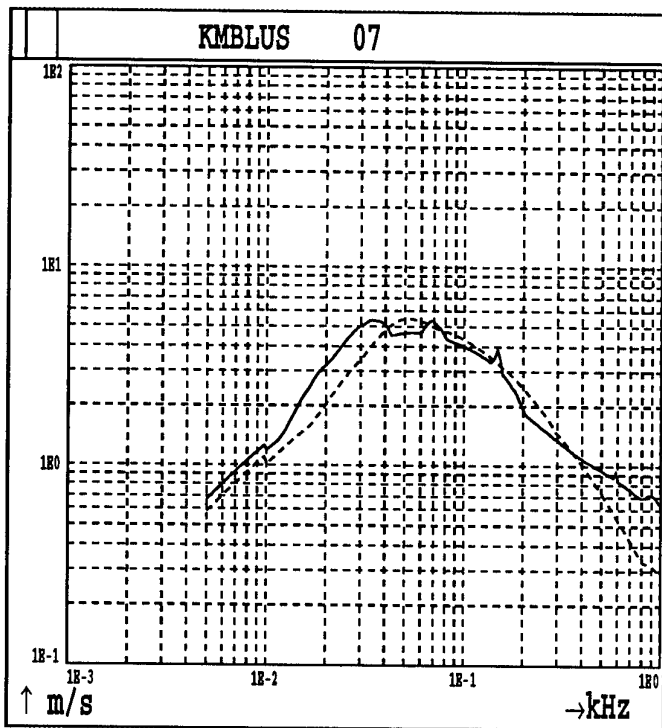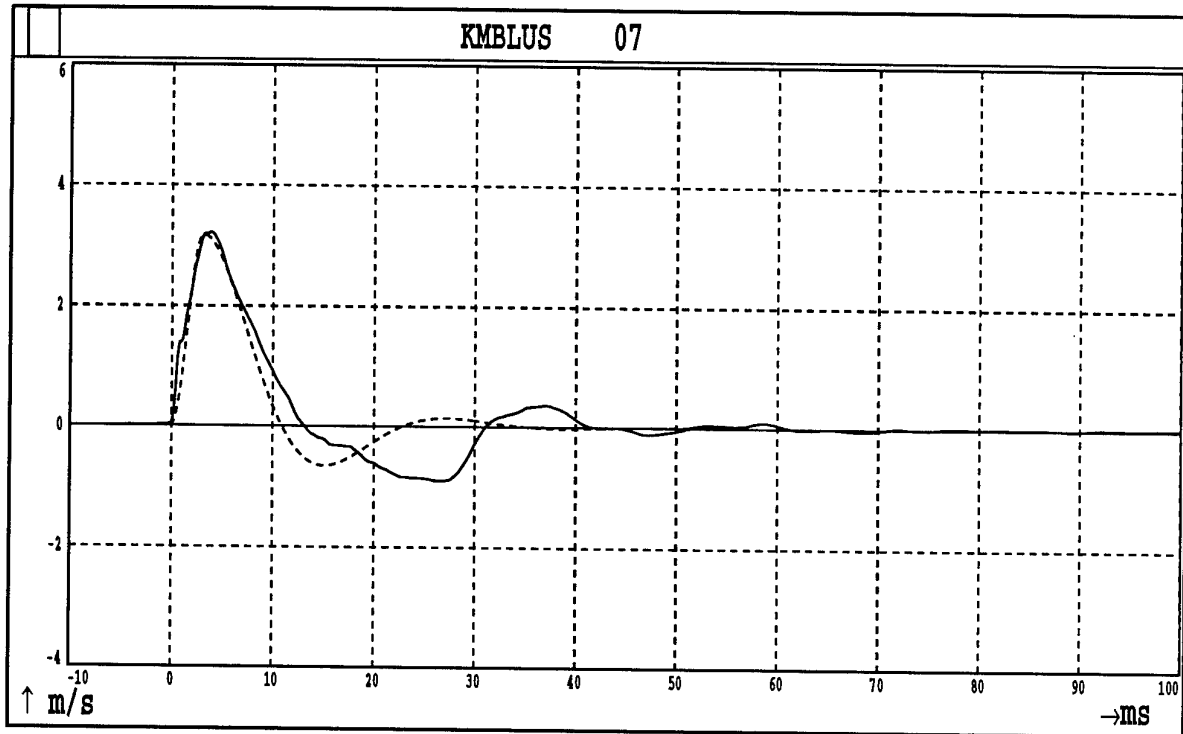

-----  
requirement B(F)  
-----  
shock machine table

Figure 6, Transverse test orientation.

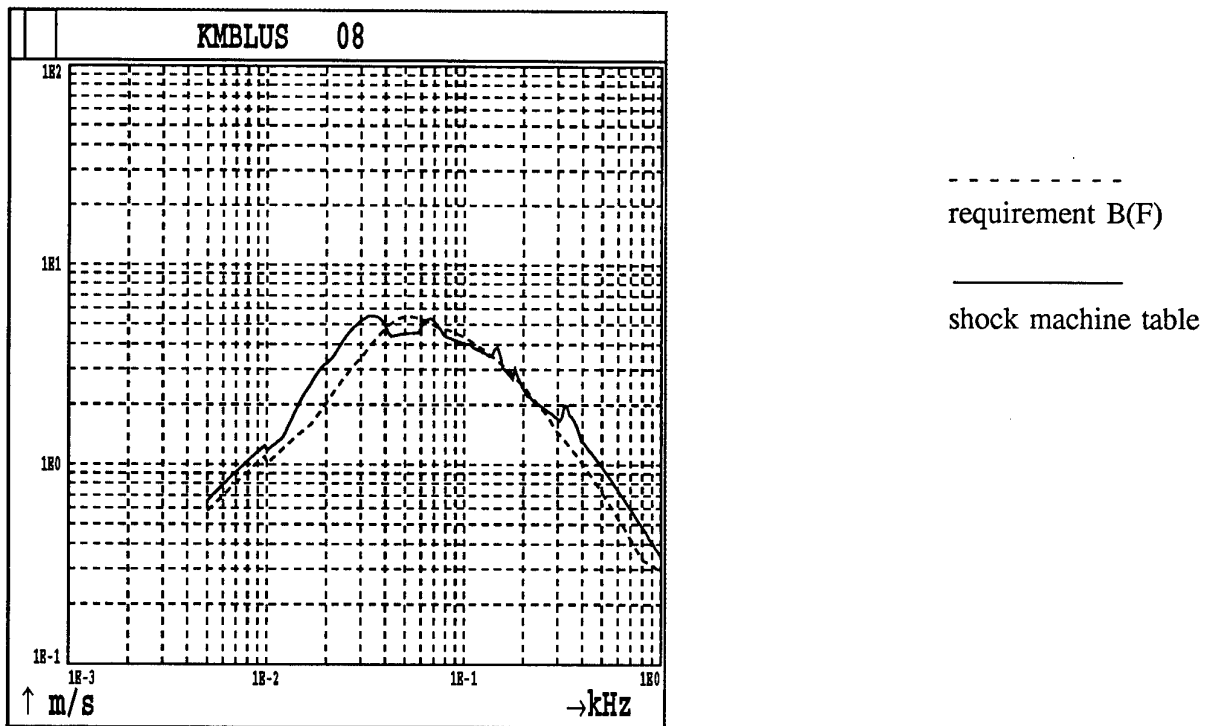
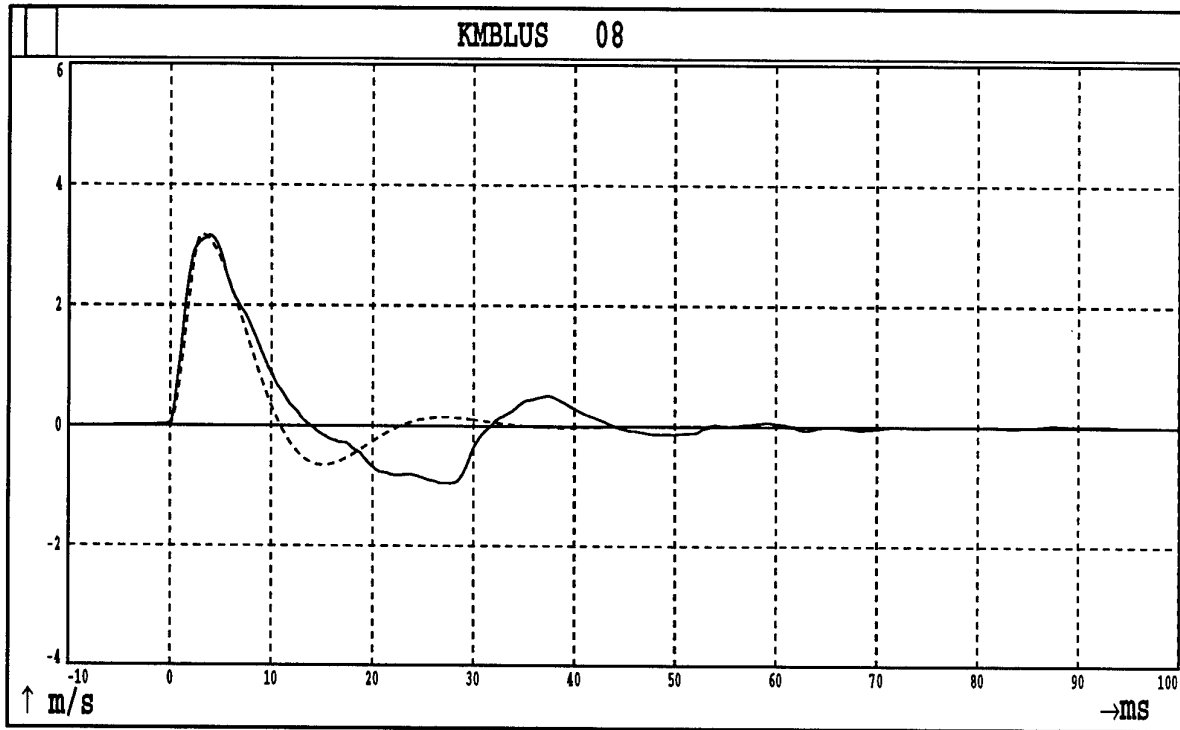


Figure 7, Perpendicular test orientation.

## 9. INSPECTION REPORT

### 9.1 Test results

The results of the tests are presented in the table below.

Shock	Direction	Remarks
01	vertical (Z)	Satisfactory result.
02	vertical (Z)	Some minor deformation was observed at the top right side of the bracket. Satisfactory result. <i>note: due to the deceleration phase in the motion the bottle can move, more or less freely, in upward direction and hit the upper structure of the bracket.</i>
03	vertical (Z)	The rubber strips at the base of the bracket were cut in by the fire extinguisher base. A minor deformation was also observed at the base of the bracket. Satisfactory result.
04	transverse (X)	Minor deformation at the bracket base. Satisfactory result.
05	transverse (X)	The snap lock of the safety belt failed for the test with the bracket in the -X-orientation. As a result the fire extinguisher came out of the bracket. The lock device was opened and showed a leaf spring to keep the lock under tension, (figure 8). Obvious the spring stiffness was not enough to keep the lock in place during the shock test. The fire extinguisher, which was tested in the +X-orientation was in good order.
06	transverse (X)	An additional piece of rubber was placed between the steel spring and the lock cover to increase the stiffness (figure 9). The previous test was repeated with the modified lock (-X) and the original lock (+X). Both safety belt locks were in good order. Satisfactory result.
07	transverse (X)	For optimization the size of the rubber piece was reduced (figure 10). The shock test was repeated, showing no failures in the locks. Quite some deformation was observed with the bracket base after the four tests in the X-direction, (see figure 11). Satisfactory result.
08	perpendicular (Y)	Satisfactory result.

After completion of the shock tests the riser pipe was inspected and proved to be undamaged.

A functional test and inspections were carried out by the manufacturer, see appendix.

## 9.2 Functional inspections

The inspections were carried out by:

Centre for Mechanical Engineering ; name: F.J. van Bragt

Ministry of Defense (PFS/MMT) ; name: T.S. van Tongeren LTZT 1

Ministry of Defense ; name: T.H. Smits

SAVAL ; name: N.Albersen  
K.Nooyens

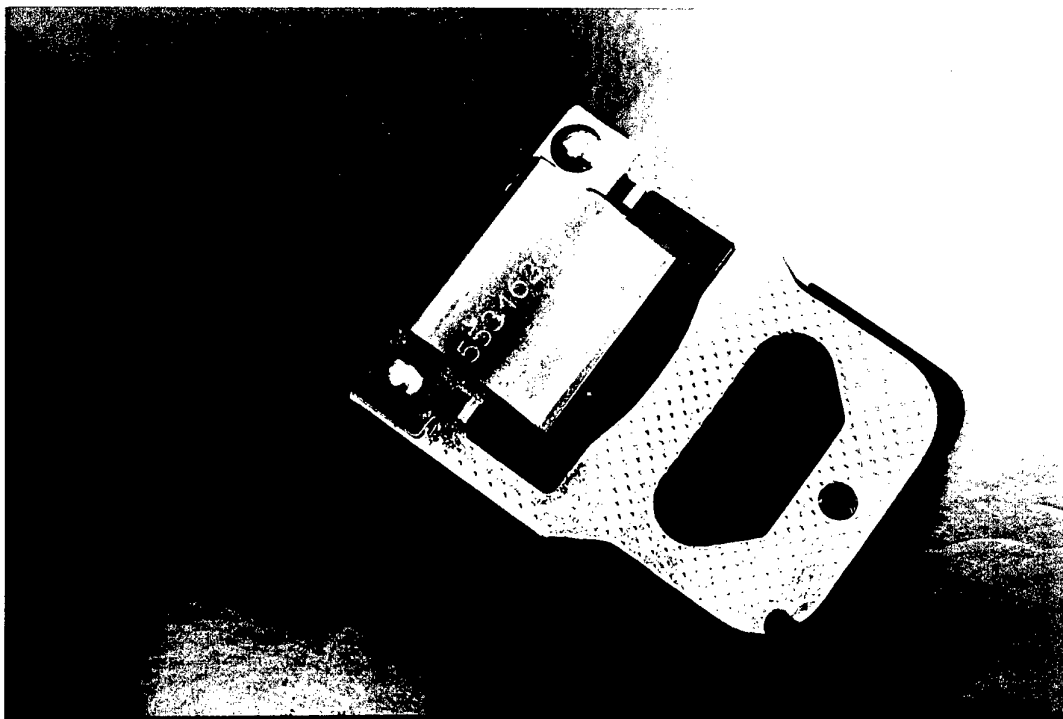


Figure 8, Original snap lock of the safety belt, (note: the cover has been removed).

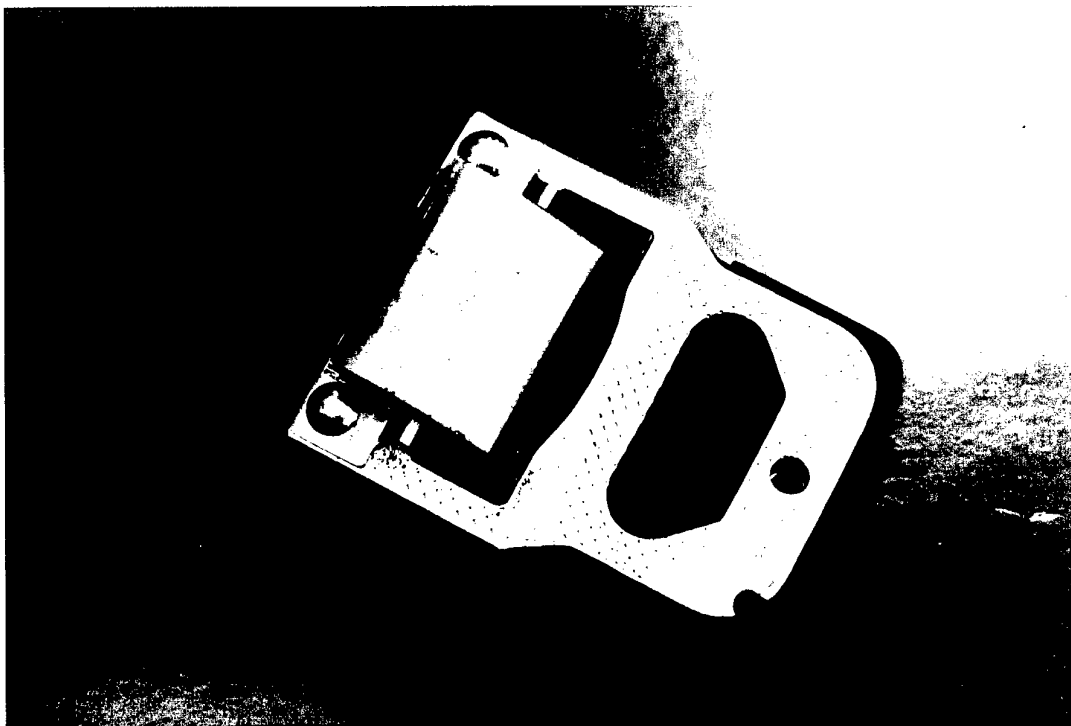


Figure 9, A piece of rubber has been placed on the spring, filling up the gap between the spring and the cover.

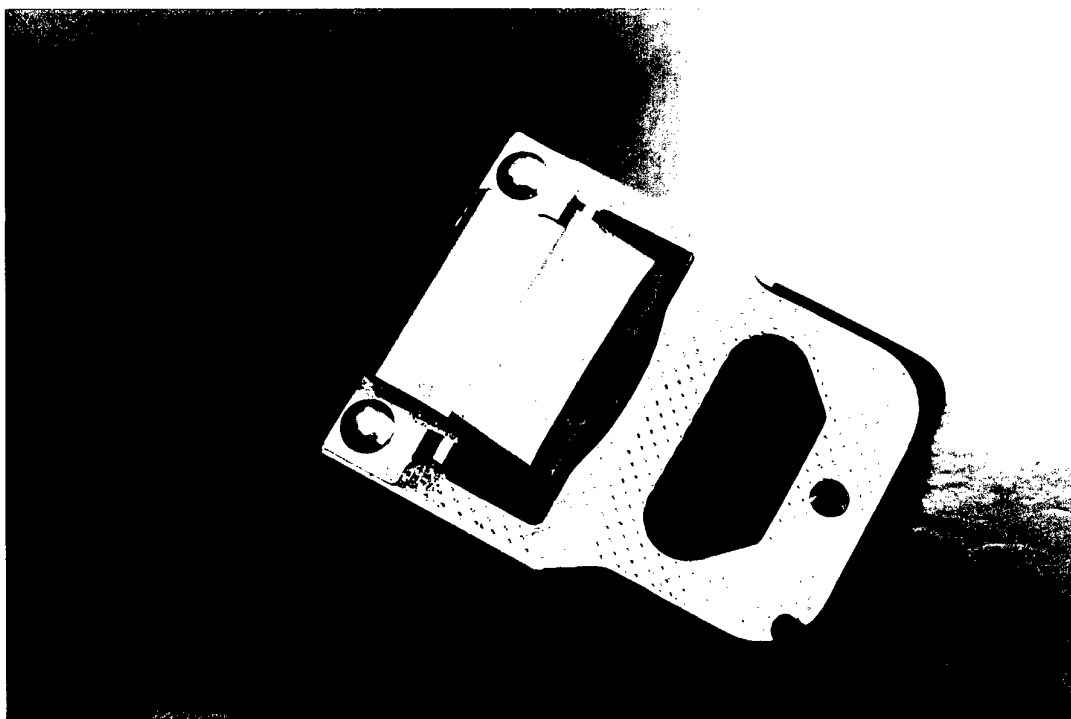


Figure 10, A smaller piece of rubber has been placed on the spring, filling up the gap between the spring and the cover.



Figure 11, Deformed bracket base support.

## 10. CONCLUSION

The tested dry chemical fire extinguisher, type PG9, inclusive the bracket and the modified snap lock sustained the shock tests satisfactorily and meet the given shock requirements.



EINDKONTROLE  
(Bijlage A2 behorende bij procedure 0110.439)

blad/sheet: 8/9

rev.: B:15-03-96

**TEST-CERTIFICAAT**

**TEST-ONDERWERP** : Visuele inspectie Poederblusser ná uitvoering  
300g-test marinebeugel

**PROJEKT** : Testen van schokbeugels PG9 tbv Marine bij  
TNO-Delft

**BEDRIJF** : Koninklijke Marine Den Haag Afd.Platform-  
systemen

**KONTRAKTOR/INKOPER** : Ministerie van Defensie Koninklijke Marine  
**ADRES** : v.d. Burchlaan 31  
**PLAATS** : Den Haag  
**KONTAKT** : Dhr. T. van Tongeren  
**KONTRAKT** : nvt

**SUB-KONTRAKTOR** : SAVAL B.V.  
**ADRES** : Postbus 100, Prinsenbeek, Nederland  
**INKOOPORDER** : nvt


**SYSTEEM/PRODUKT** : 9Kg PG-Poederblusser

**AANTAL** : 2


**TEST-RESULTAAT** :

<u>Onderzocht:</u>	<u>Blusser 1:</u>	<u>Blusser 2:</u>
Patroon	In orde	In orde
Inslagknop	"	"
Binnenbus	"	"
Romp	"	"
Pistool	"	"
Poeder (vloeibaarheid)	"	"
Slang	"	Mechanische beschadiging (boven Wartel)

**VOOR AKKOORD**

**QA-Inspecteur** Naam : D. Nieto  
**Saval B.V.** Stempel/datum : 01-07-96  
Ondertekening : 



**Projektmanager** Naam : N. Albersen  
**Saval B.V.** Ondertekening : 

**QA-Vertegenwoordiger** Naam :  
**Kontraktor/Inkoper** Stempel/datum :  
Ondertekening :

REPORT DOCUMENTATION PAGE		(MOD -NL)
1. <u>Defense report number (MOD-NL)</u> RP 96-0107	2. <u>Recipient's accession number</u>	3. <u>Performing Organization Report Number</u> 96-CMC-R0290
4. <u>Project/Task/Work unit no.</u> 62376588	5. <u>Contract Number</u> A96/KM/126	6. <u>Report date</u> July 1996
7. <u>Number of pages</u> 22+2	8. <u>Number of references</u> ---	9. <u>Type of report</u> Final report
10. <u>Title and subtitle</u> Shock testing of a dry chemical fire extinguisher, type PG9, inclusive special bracket. Manufacturer: SAVAL		
11. <u>Author(s)</u> F.J. van Bragt		
12. <u>Performing organization name(s) and address(es)</u> Centre for Mechanical Engineering Leeghwaterstraat 5 2628 CA DELFT, The Netherlands		
13. <u>Sponsoring/Monitoring agency name(s) and address(es)</u> Netherlands Ministry of Defence (Navy); Naval Construction; P.O.Box 20702; 2500 ES 's-Gravenhage. TNO Division of National Defence Research; P.O.Box 6006, 2600 JA Delft, The Netherlands		
14. <u>Supplementary notes</u> Centre for Mechanical Engineering is part of TNO Building and Construction Research		
15. <u>Abstract (Maximum 200 words, 1044 byte)</u> A dry chemical fire extinguisher and a special bracket, make SAVAL, have been exposed to shock tests. Failure was ascertained with the snap lock belt mechanism. After modification the lock mechanism proved to be working satisfactorily. The shock tests were carried out in accordance with the specification shock grade B(F). The tested dry chemical fire extinguisher inclusive bracket and modified lock meets the given shock requirements.		
16. <u>Descriptors</u> Warship Shock and vibration tests Underwater explosion		<u>Identifiers</u> Damage Surface ship Fire fighting
17a. <u>Security classification</u> (of report) Ongerubriceerd	17b. <u>Security classification</u> (of page) Ongerubriceerd	17c. <u>Security classification</u> (of abstract) Ongerubriceerd
18. <u>Distribution/availability statement</u> No unlimited availability Request shall be referred to Ministry of Defence		17d. <u>Security classification</u> (of titles) Ongerubriceerd

DISTRIBUTIELIJST RAPPORT 96-CMC-R0290

Instituut: TNO Bouw CMC

Project A96/KM/126

DWOO	1
HWO-Centrale Organisatie	(B)
HWO-KM	1
HWO-KL	(B)
HWO-Klu	(B)
Projectleider DMKM, LTZT 1 T.S. van Tongeren	10
Bureau TNO-DO	1
TNO-Centrum voor Mechanische Constructies	3
Bibliotheek KMA	3

(B) = Beperkt rapport