



# NAVAL POSTGRADUATE SCHOOL

MONTEREY, CALIFORNIA

## THESIS

**CHARACTERIZATION OF CARBON NANOTUBE-  
ENHANCED WATER AS A PHASE CHANGE MATERIAL  
FOR THERMAL ENERGY STORAGE SYSTEMS**

by

Brian K. Ryglowski

December 2009

Thesis Advisor:  
Co-Advisor:

Young Kwon  
Randall Pollak

**Approved for public release; distribution is unlimited**

|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |                                                                 |                                                                |                                                            |  |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------|----------------------------------------------------------------|------------------------------------------------------------|--|
| <b>REPORT DOCUMENTATION PAGE</b>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |                                                                 |                                                                | <i>Form Approved OMB No. 0704-0188</i>                     |  |
| Public reporting burden for this collection of information is estimated to average 1 hour per response, including the time for reviewing instruction, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. Send comments regarding this burden estimate or any other aspect of this collection of information, including suggestions for reducing this burden, to Washington headquarters Services, Directorate for Information Operations and Reports, 1215 Jefferson Davis Highway, Suite 1204, Arlington, VA 22202-4302, and to the Office of Management and Budget, Paperwork Reduction Project (0704-0188) Washington DC 20503.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |                                                                 |                                                                |                                                            |  |
| <b>1. AGENCY USE ONLY (Leave blank)</b>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |                                                                 | <b>2. REPORT DATE</b><br>December 2009                         | <b>3. REPORT TYPE AND DATES COVERED</b><br>Master's Thesis |  |
| <b>4. TITLE AND SUBTITLE</b><br>Characterization of Carbon Nanotube-Enhanced Water as a Phase Change Material for Thermal Energy Storage Systems                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |                                                                 |                                                                | <b>5. FUNDING NUMBERS</b>                                  |  |
| <b>6. AUTHOR(S)</b> Brian K. Ryglowski                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |                                                                 |                                                                |                                                            |  |
| <b>7. PERFORMING ORGANIZATION NAME(S) AND ADDRESS(ES)</b><br>Naval Postgraduate School<br>Monterey, CA 93943-5000                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                      |                                                                 |                                                                | <b>8. PERFORMING ORGANIZATION REPORT NUMBER</b>            |  |
| <b>9. SPONSORING /MONITORING AGENCY NAME(S) AND ADDRESS(ES)</b><br>N/A                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |                                                                 |                                                                | <b>10. SPONSORING/MONITORING AGENCY REPORT NUMBER</b>      |  |
| <b>11. SUPPLEMENTARY NOTES</b> The views expressed in this thesis are those of the author and do not reflect the official policy or position of the Department of Defense or the U.S. Government.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                      |                                                                 |                                                                |                                                            |  |
| <b>12a. DISTRIBUTION / AVAILABILITY STATEMENT</b><br>Approved for public release; distribution is unlimited                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |                                                                 |                                                                | <b>12b. DISTRIBUTION CODE</b>                              |  |
| <b>13. ABSTRACT (maximum 200 words)</b><br><br><p>Innovation in electronics and directed energy technologies is accelerating as the 21st century progresses. The requirement to process, store and interpolate information and signals faster and with compact electronic units has led to the engineering of high power electronics. As the power density of these electronic systems increases, the demand for cooling increases. Development of directed energy systems also requires the dissipation of large heat loads. If the heat generated by high power electronics and other high energy systems is not reduced or transferred efficiently and quickly, resultant pre-mature equipment failure, individual component failure or the inability to operate the equipment will occur.</p> <p>Carbon nanotube enhanced fluids have shown increases in the thermal conductivity from 20% to 250% when compared to the base heat transfer fluid. This study focuses on the stability of static, water-based, carbon nanotube enhanced mixtures during thermal cycling (i.e., freezing and thawing) of the nanofluid using various types of carbon nanotubes, loading percentages and surfactants. Electrical resistance measurements were recorded over a series of phase changes in order to assess the stability of the nanofluid.</p> <p>Experimental results showed that static, carbon nanotube enhanced nanofluids are stable between three to five freeze and thaw cycles before the carbon nanotubes start to agglomerate and subside. This resulted in an increased electric conductivity, and validated the use of electrical resistance measurements as a viable means of assessing the stability of the nanofluid. However, ultrasonication of the nanofluids after the instability recovers the original electric conductivity of the nanofluid.</p> |                                                                 |                                                                |                                                            |  |
| <b>14. SUBJECT TERMS</b><br>Carbon Nanotube, Thermal Energy Storage Systems, Characterization of Nanofluids, Static Phase Change Materials, Heat Transfer Nanofluid Systems                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |                                                                 |                                                                | <b>15. NUMBER OF PAGES</b><br>97                           |  |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |                                                                 |                                                                | <b>16. PRICE CODE</b>                                      |  |
| <b>17. SECURITY CLASSIFICATION OF REPORT</b><br>Unclassified                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           | <b>18. SECURITY CLASSIFICATION OF THIS PAGE</b><br>Unclassified | <b>19. SECURITY CLASSIFICATION OF ABSTRACT</b><br>Unclassified | <b>20. LIMITATION OF ABSTRACT</b><br>UU                    |  |

THIS PAGE INTENTIONALLY LEFT BLANK

Approved for public release; distribution is unlimited

**CHARACTERIZATION OF CARBON NANOTUBE-ENHANCED WATER AS A  
PHASE CHANGE MATERIAL FOR THERMAL ENERGY STORAGE  
SYSTEMS**

Brian K. Ryglowski  
Lieutenant, United States Navy  
B.S., United States Merchant Marine Academy, 2003

Submitted in partial fulfillment of the  
requirements for the degree of

**MASTER OF SCIENCE IN MECHANICAL ENGINEERING**

from the

**NAVAL POSTGRADUATE SCHOOL  
December 2009**

Author: Brian K. Ryglowski

Approved by: Young Kwon  
Thesis Advisor

Randall Pollak  
Co-Advisor

Knox T. Millsaps  
Chairman, Department of Mechanical and Astronautical  
Engineering

THIS PAGE INTENTIONALLY LEFT BLANK

## **ABSTRACT**

Innovation in electronics and directed energy technologies is accelerating as the 21st century progresses. The requirement to process, store and interpolate information and signals faster and with compact electronic units has led to the engineering of high power electronics. As the power density of these electronic systems increases, the demand for cooling increases. Development of directed energy systems also requires the dissipation of large heat loads. If the heat generated by high power electronics and other high energy systems is not reduced or transferred efficiently and quickly, resultant premature equipment failure, individual component failure or the inability to operate the equipment will occur.

Carbon nanotube enhanced fluids have shown increases in the thermal conductivity from 20% to 250% when compared to the base heat transfer fluid. This study focuses on the stability of static, water-based, carbon nanotube enhanced mixtures during thermal cycling (i.e., freezing and thawing) of the nanofluid using various types of carbon nanotubes, loading percentages and surfactants. Electrical resistance measurements were recorded over a series of phase changes in order to assess the stability of the nanofluid.

Experimental results showed that static, carbon nanotube enhanced nanofluids are stable between three to five freeze and thaw cycles before the carbon nanotubes start to agglomerate and subside. This resulted in an increased electric conductivity, and validated the use of electrical resistance measurements as a viable means of assessing the stability of the nanofluid. However, ultrasonication of the nanofluids after the instability recovers the original electric conductivity of the nanofluid.

THIS PAGE INTENTIONALLY LEFT BLANK

## TABLE OF CONTENTS

|             |                                                                                                      |           |
|-------------|------------------------------------------------------------------------------------------------------|-----------|
| <b>I.</b>   | <b>INTRODUCTION.....</b>                                                                             | <b>1</b>  |
| <b>A.</b>   | <b>THERMAL MANAGEMENT PROBLEM FOR DENSE, HIGH POWER ELECTRONICS AND DIRECTED ENERGY SYSTEMS.....</b> | <b>1</b>  |
| <b>B.</b>   | <b>APPLICATION OF NANOPARTICLES AND THEIR USE IN NANOFLUIDS.....</b>                                 | <b>2</b>  |
| <b>C.</b>   | <b>CARBON NANOTUBE ENHANCED FLUIDS.....</b>                                                          | <b>3</b>  |
| 1.          | Carbon Nanotubes .....                                                                               | 3         |
| 2.          | Carbon Nanotube-Based Nanofluids .....                                                               | 4         |
| 3.          | The Relationship Between Thermal and Electrical Conductivity .....                                   | 5         |
| 4.          | Naval Postgraduate School Previous Research.....                                                     | 6         |
| <b>D.</b>   | <b>THESIS CONCEPT.....</b>                                                                           | <b>6</b>  |
| <b>II.</b>  | <b>EXPERIMENTAL APPROACH AND VALIDATION.....</b>                                                     | <b>9</b>  |
| <b>A.</b>   | <b>DESIGN OF EXPERIMENT.....</b>                                                                     | <b>9</b>  |
| <b>B.</b>   | <b>PROPERTIES OF SELECTED PARAMETERS .....</b>                                                       | <b>10</b> |
| 1.          | Heat Transfer Fluid .....                                                                            | 10        |
| 2.          | Carbon Nanotubes .....                                                                               | 10        |
| 3.          | Volumetric Loading Percentages.....                                                                  | 11        |
| 4.          | Surfactants.....                                                                                     | 12        |
| <b>C.</b>   | <b>EQUIPMENT DESCRIPTION .....</b>                                                                   | <b>12</b> |
| 1.          | Mechanical Homogenizer .....                                                                         | 12        |
| 2.          | Ultrasonicator.....                                                                                  | 12        |
| 3.          | Commercial Freezer Unit.....                                                                         | 13        |
| 4.          | Digital Multimeter .....                                                                             | 14        |
| <b>D.</b>   | <b>EXPERIMENTAL PROCEDURES .....</b>                                                                 | <b>14</b> |
| <b>E.</b>   | <b>EXPERIMENTAL VALIDATION.....</b>                                                                  | <b>16</b> |
| 1.          | Ultrasonication Parameter Validation.....                                                            | 24        |
| <b>F.</b>   | <b>EXPERIMENTAL SUMMARY.....</b>                                                                     | <b>25</b> |
| 1.          | Ancillary Studies .....                                                                              | 26        |
| <b>III.</b> | <b>RESULTS .....</b>                                                                                 | <b>29</b> |
| <b>IV.</b>  | <b>ANALYSIS OF RESULTS.....</b>                                                                      | <b>35</b> |
| <b>A.</b>   | <b>NPS NANOFLUIDS.....</b>                                                                           | <b>35</b> |
| <b>B.</b>   | <b>LUNA INNOVATIONS INCORPORATED NANOFLUIDS .....</b>                                                | <b>39</b> |
| <b>C.</b>   | <b>COMBINED CNT NANOFLUIDS .....</b>                                                                 | <b>41</b> |
| <b>D.</b>   | <b>SURFACTANT CYCLING .....</b>                                                                      | <b>41</b> |
| <b>V.</b>   | <b>CONCLUSION .....</b>                                                                              | <b>43</b> |
| <b>VI.</b>  | <b>RECOMMENDATIONS FOR FUTURE WORK.....</b>                                                          | <b>45</b> |
|             | <b>APPENDIX A. CALCULATED RESISTANCE VALUES USING THE PLATE ASSEMBLY.....</b>                        | <b>47</b> |



|                                                                                            |    |
|--------------------------------------------------------------------------------------------|----|
| APPENDIX B. PROBE ASSEMBLY—LUNA INNOVATIONS NANOFLUID RESISTANCE MEASUREMENTS.....         | 49 |
| APPENDIX C. PROBE ASSEMBLY—HOLLOW MULTI-WALL CARBON NANOTUBE RESISTANCE MEASUREMENTS ..... | 51 |
| APPENDIX D. PROBE ASSEMBLY—BAMBOO MULTI-WALL CARBON NANOTUBE RESISTANCE MEASUREMENTS ..... | 53 |
| APPENDIX E. LUNA INNOVATION NANOFLUID SURFACE AND BOTTOM RESISTANCE MEASUREMENTS.....      | 55 |
| APPENDIX F. MULTIMETER LEAD ORIENTATION RESISTANCE MEASUREMENTS .....                      | 57 |
| APPENDIX G. NAVAL POSTGRADUATE SCHOOL NANOFLUID RESISTANCE MEASUREMENTS.....               | 59 |
| APPENDIX H. LUNA INNOVATIONS NANOFLUID RESISTANCE MEASUREMENTS .....                       | 63 |
| APPENDIX I. COMBINED CNT NANOFLUID RESISTANCE MEASUREMENTS .....                           | 67 |
| LIST OF REFERENCES .....                                                                   | 73 |
| BIBLIOGRAPHY .....                                                                         | 75 |
| INITIAL DISTRIBUTION LIST .....                                                            | 79 |

## LIST OF FIGURES

|            |                                                                                                                                                   |    |
|------------|---------------------------------------------------------------------------------------------------------------------------------------------------|----|
| Figure 1.  | Graphene Sheet Rolled into Carbon Nanotubes. ....                                                                                                 | 3  |
| Figure 2.  | (Left) SWCNT. (Right) MWCNT. ....                                                                                                                 | 4  |
| Figure 3.  | (Left) Stir-Pak Mechanical Stirrer. (Right) Sonicator 3000 Ultrasonic<br>Liquid Processor .....                                                   | 13 |
| Figure 4.  | Westinghouse Commercial Freezer Unit .....                                                                                                        | 13 |
| Figure 5.  | Fluke 8840A Digital Multimeter .....                                                                                                              | 14 |
| Figure 6.  | (Left) Aluminum Plate Assembly. (Right) Inadequate Dispersion of the<br>Nanofluid within the Plate Assembly. ....                                 | 17 |
| Figure 7.  | Initial Electrical Conductivity Trend using the Plate Assembly .....                                                                              | 18 |
| Figure 8.  | (Top) Probe Assembly. (Bottom) Probe Assembly with Leads .....                                                                                    | 19 |
| Figure 9.  | (Left) Luna Innovation LnW-404 Nanofluid after Five Phase Changes.<br>(Right) NPS Nanofluid after One Phase Change .....                          | 21 |
| Figure 10. | Multimeter Lead Construction .....                                                                                                                | 22 |
| Figure 11. | Luna Innovation Nanofluids Surface and Bottom Average Electrical<br>Resistance Measurements. ....                                                 | 23 |
| Figure 12. | Photographs Describing Physical Appearance of Nanofluids .....                                                                                    | 30 |
| Figure 13. | Average Resistance vs. Thermal Cycling of NPS Nanofluids .....                                                                                    | 35 |
| Figure 14. | 0.1% CNT Loading: MWCNT & SWCNT Resistance Comparison .....                                                                                       | 37 |
| Figure 15. | 0.2% CNT Loading: MWCNT & SWCNT Resistance Comparison .....                                                                                       | 37 |
| Figure 16. | (Left) Initial Appearance of LnW-402. (Middle) Appearance of LnW-402<br>after 12th Cycle. (Right) Appearance of LnW-402 after Re-sonication ..... | 39 |
| Figure 17. | 117% Pure Luna Innovations Nanofluids .....                                                                                                       | 40 |
| Figure 18. | 144% Pure Luna Innovations Nanofluids .....                                                                                                       | 40 |

THIS PAGE INTENTIONALLY LEFT BLANK

## LIST OF TABLES

|           |                                                             |    |
|-----------|-------------------------------------------------------------|----|
| Table 1.  | Design Parameters for Thesis Research.....                  | 9  |
| Table 2.  | Properties of Distilled Water .....                         | 10 |
| Table 3.  | Nano-Lab Incorporated CNT Characteristics .....             | 11 |
| Table 4.  | Luna Innovations Incorporated Nanofluid Information.....    | 11 |
| Table 5.  | Ultrasonication Power Settings and Time Durations.....      | 24 |
| Table 6.  | NPS Nanofluid Experimental Matrix.....                      | 25 |
| Table 7.  | Experimental Matrix for Thermal Cycling of Surfactants..... | 26 |
| Table 8.  | Combined CNT Nanofluid Experimental Matrix .....            | 27 |
| Table 9.  | Description of Physical Appearance of Nanofluid .....       | 29 |
| Table 10. | NPS Nanofluid Results .....                                 | 31 |
| Table 11. | Luna Innovations Incorporated Nanofluid Results .....       | 32 |
| Table 12. | Combined CNT Nanofluid Results .....                        | 33 |
| Table 13. | Thermal Cycling of Surfactant Results.....                  | 34 |

THIS PAGE INTENTIONALLY LEFT BLANK

## **LIST OF ACRONYMS AND ABBREVIATIONS**

|       |                                           |
|-------|-------------------------------------------|
| AC    | Alternating Current                       |
| ASTM  | American Society of Testing and Materials |
| C     | Clear                                     |
| CNT   | Carbon Nanotube                           |
| DC    | Direct Current                            |
| H     | Homogenous                                |
| HS    | Heavy Sediment                            |
| LA    | Large Agglomerates                        |
| LDS   | Lithium Dodecyl Sulfate                   |
| LS    | Light Sediment                            |
| MA    | Medium Agglomerates                       |
| MWCNT | Multi-wall Carbon Nanotube                |
| NPS   | Naval Postgraduate School                 |
| S     | Sediment                                  |
| SA    | Small Agglomerates                        |
| SEM   | Scanning Electron Microscope              |
| SWCNT | Single Wall Carbon Nanotube               |
| VOL   | Volume                                    |
| VSA   | Very Small Agglomerates                   |

THIS PAGE INTENTIONALLY LEFT BLANK

## **ACKNOWLEDGMENTS**

I would like to thank my thesis advisors, Professor Young Kwon and Major Randall Pollak, for their guidance, interest and unending support throughout this study. Their vast knowledge and experience enabled a coherent, solid effort in pursuing this unexplored path in nanofluid technology.

Thank you to Professor Sarath Menon and Tom Christian for their assistance in providing testing equipment, generation of SEM and micrograph images as well providing advice on producing and testing stable nanofluid samples.

Finally, I would like to thank my wife, Kymberly, and children, Mochi and Max, for their unrelenting support and understanding while I was completing this endeavor.



THIS PAGE INTENTIONALLY LEFT BLANK

## **I. INTRODUCTION**

### **A. THERMAL MANAGEMENT PROBLEM FOR DENSE, HIGH POWER ELECTRONICS AND DIRECTED ENERGY SYSTEMS**

Innovation in electronics and directed energy technologies is accelerating as the 21st century progresses. The requirement to process, store and interpolate information and signals faster and with compact electronic units has led to the engineering of high power electronics. As the power density of these electronic systems increases, the demand for cooling increases. Development of directed energy systems also requires the dissipation of large heat loads. If the heat generated by high power electronics and other energy systems is not reduced or transferred efficiently and quickly, resultant pre-mature equipment failure, individual component failure or the inability to operate the equipment will occur. This problem can be solved by using large, elaborate cooling system arrangements with modern technology but defeats the purpose of using a compact unit.

In order to reduce the size, weight and cooling system complexity an efficient and effective means of heat transfer must exist. Optimization of cooling mediums, flow rates, ancillary equipment requirements and installation space restrictions must be taken into account. Conventional methods to increase cooling rates include using extended fin surfaces or microchannels within the cooling assembly. Another approach has revolved around increasing the thermal conductivity of the cooling medium. By improving the thermal properties of the cooling medium, the effective size of the cooling system arrangement can be scaled down to meet various space restrictions.

The inherent properties of water, oil and ethylene glycol mixtures render them as relatively poor heat transfer fluids. Maxwell's theoretical work first alluded to using solid-liquid mixtures to improve the heat transfer properties of conventional fluids since the thermal conductivity of solids is significantly higher than that of liquids [1]. Since then, many studies on the effects of metallic-based nanoparticles suspended in heat transfer fluids have shown a significant improvement in the thermal conductivity of the

fluid [2]. This scientific achievement in the use and application of nanoparticles has laid the foundation for future experiments using nanoparticles and their effects in heat transfer in high power density systems.

## **B. APPLICATION OF NANOPARTICLES AND THEIR USE IN NANOFLUIDS**

Nanofluids are a new class of solid-liquid mixtures consisting of solid particles with diameter sizes on the order of 1 to 100 nanometers (nm) suspended in a heat transfer medium. Some common metallic and non-metallic solids that have been used in nanofluid research include but are not limited to silver, copper, aluminum, diamond, silicon, alumina, and carbon nanotubes. Common heat transfer mediums include water, ethylene glycol and engine oil [3].

Nanofluid research is a growing field and has focused primarily on the improvements in heat transfer properties of the nanofluid. Advantages to using nanofluids include higher cooling rates, smaller and lighter cooling systems, a reduced inventory of heat transfer fluid and miniaturization of individual heat exchangers [3], [4], [5]. However, as studies progress, there are still difficulties in dealing with nanofluids such as ensuring a homogenous dispersion of the nanoparticles throughout the heat transfer fluid, controlling processing techniques for the nanoparticles and understanding the physics of nanoparticle behavior.

Initial studies conducted by Choi et al. [6] showed significant increases in the thermal conductivity of a nanofluid using copper nanoparticles. When comparing the thermal conductivity of metallic and non-metallic solids to various non-metallic heat transfer fluids, solids exhibited thermal conductivities orders of magnitude higher than the base fluid. By adding a more conductive material (metallic or non-metallic solid) to a lower conducting heat transfer fluid, studies could focus on the resultant thermal conductivity properties of the nanofluid.

The improvement in the thermal conductivity of nanofluids can be attributed to the interfacial resistance and the resistance within the nanoparticle microstructure. Each plays an important role in the resistance to heat flow. Regardless of the type and size of nanoparticle, any interface at the microstructure is a barrier for heat flow. As the interface distance between

the nanoparticle and heat transfer fluid decreases or the thickness (diameter) of a nanoparticle decreases, the resistance drop across the particle also decreases. The high surface-to-volume ratio of nanoparticles decreases the overall particle resistance and enables them to be effective conductors. On a nano-scale level, the resistance at the surface of a nanoparticle is almost equivalent to the resistance of the particle itself. Therefore, the overall heat transfer becomes comparable to the nanoparticle microstructure and the conduction paths formed by dispersed nanoparticles [7].

## C. CARBON NANOTUBE ENHANCED FLUIDS

### 1. Carbon Nanotubes

Carbon nanotubes (CNT) were first discovered by S. Iijima in 1991 [8]. CNTs are a member of the fullerene family and are also an allotrope of carbon called graphene. Graphene is a densely packed single, hexagonal layer of carbon-bonded atoms that are rolled to form a cylindrical microstructure. The ends of the cylindrical microstructure can be capped with a hemispherical structure from the fullerene family or left open. The orientation of the graphene microstructure gives CNTs their unique strength, electrical and thermal properties. Figure 1 illustrates the microstructure of a single graphene layer rolled in different orientations [9].

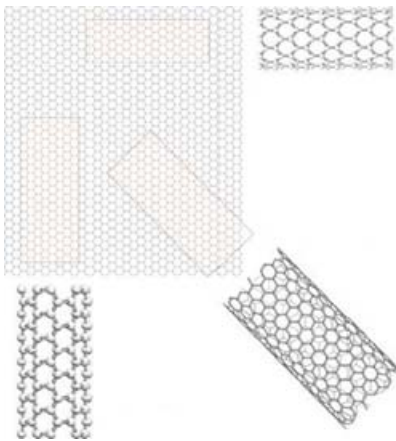


Figure 1. Graphene Sheet Rolled into Carbon Nanotubes.

The two main types of carbon nanotubes are single wall carbon nanotubes (SWCNT) and multi-wall carbon nanotubes (MWCNT). SWCNTs are composed of a

single sheet of graphene rolled into a cylinder capped with one-half of a fullerene molecule at each end of the cylinder. A MWCNT consists of concentric sheets of rolled graphene that are either capped with one-half a fullerene molecule at each end or left open. See Figure 2 for an illustration of a SWCNT and MWCNT [10]. For more information regarding CNT structure, physical properties and synthesis (growth), see reference [11].

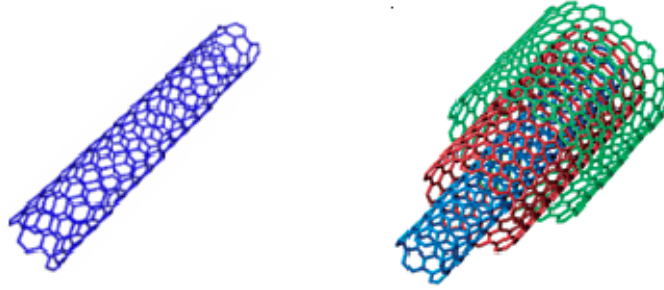


Figure 2. (Left) SWCNT. (Right) MWCNT.

Valence bond theory, or orbital mixing, explains why carbon nanotubes can form various microstructure orientations. Each carbon atom has six electrons which occupy the  $1s^2$ ,  $2s^2$  and  $2p^2$  orbitals. The  $1s^2$  orbital contains two strongly bound electrons where as the  $2s^2$  and  $2p^2$  orbital contain four weakly bonded valence electrons. These four electrons can readily mix with each other or bond with neighboring carbon atoms (hybridization) to form various planar bonds, also known as  $sp^2$  bonds [11].

The orientation of planar bonds between carbon atoms affects the overall energy state of the CNT, which directly impacts the thermal and electrical conductivity of the CNT. In general, a higher energy state carbon atom will have a higher conductivity than a lower energy state carbon atom. The detailed explanation of the electrical properties of various band structures is beyond the scope of this study, but is described in reference [11].

## 2. Carbon Nanotube-Based Nanofluids

Numerous investigations on the improvement of the thermal conductivity of heat transfer fluids using solid particles have been conducted since Maxwell's theoretical observations in 1904 [1]. Using Choi's initial results with solid, metallic nanoparticles

[6], he and others studied the effects of using multiple types of CNTs from different synthesis processes using various dispersion techniques in multiple heat transfer fluids [6], [12], [13], [14], [15]. Those studies have shown increases in the thermal conductivity of the nanofluid ranging from 20% to 250% when compared to the base heat transfer fluid. Although theoretical calculations and modeling based upon experimental data have not been able to accurately predict the thermal conductivity of CNT enhanced nanofluids given various parameters, experimental results clearly demonstrate that CNT suspensions drastically improve the thermal properties of existing heat transfer fluids.

The intensive thermal and electrical properties of CNTs make them an appealing candidate for their use in nanofluids. However, the molecular attractive forces, or Van der Waals forces, between CNTs pose a significant problem in effectively employing CNTs in a heat transfer liquid. Since CNTs are unable to form strong bonds with their surroundings when placed in a liquid, they tend to form agglomerates, or large masses, with neighboring nanotubes. Various dispersion methods have been used to ensure a homogenous dispersion of the CNTs throughout the nanofluid.

CNT dispersion is accomplished by physical or chemical means. Physical dispersion techniques include high speed shearing of the nanofluid using mechanical mixing techniques, ball milling or grinding of CNTs prior to their addition into the nanofluid, and ultrasonication of the nanofluid. Chemical dispersion techniques include the chemical modification of the CNT surface during synthesis and use of surfactants to lower the interfacial tension of the heat transfer liquid and CNTs. The most stable suspensions have been achieved by using a combination of both physical and chemical techniques [16].

### **3. The Relationship Between Thermal and Electrical Conductivity**

The strong atomic bonds between carbon atoms enable it to have excellent conductive properties. The Wiedemann-Franz law is an empirical law of physics that states that the thermal and electrical conductivity properties are directly related by a constant multiplied by the absolute temperature of the metal. This is also known as the Lorentz relation [17, 18]. A linear relationship between the thermal conductivity and

material absolute temperature has been proven in many studies of various metallic and semi-conducting materials. However, electrical conductivity testing of the same materials fails to yield the same linear relationship. Despite inconsistent results from various electrical conductivity tests, the conductivity does, in fact, increase with an increasing absolute temperature [18]. By applying this relationship to nanofluids, the thermal conductivity improvements achieved from using CNTs can be directly associated to improvements in the electrical conductivity of the nanofluid.

#### **4. Naval Postgraduate School Previous Research**

In June of 2008, Kuhlmann studied the various thermal and fluid properties of CNT-enhanced nanofluids and their possible inclusion in advanced thermal management systems. He evaluated various CNT loading concentrations, temperature profiles, various ultrasonication settings and surfactant concentrations. The study also focused on the development of an appropriate protocol for producing stable, colloidal CNT suspensions. His thermal analysis of the nanofluids revealed that CNTs possess a sensitive architecture composed of loosely connected nanotube networks that directly impact the conductivity properties of the nanofluid [19].

#### **D. THESIS CONCEPT**

The goal of this study is to evaluate the stability of static, CNT-enhanced, water-based nanofluids over a specified number of thermal cycles, or phase changes between freeze and thaw. The stability of the CNT-enhanced nanofluid is based upon changes in the conductive paths formed by the homogenous dispersion of the nanotube network. Theoretically, if the dispersed nanotubes maintained a homogenous network, the conductive properties of the nanofluid would remain intact. Any changes in the conductive properties during the thermal cycling of the nanofluid would indicate a change within the nanotube network.

The electrical conductivity of the nanofluid will be used to assess the stability of the nanofluid throughout thermal cycling. This study focuses on the ability to measure electrical resistance to accurately detect changes in the CNT network. This study will also

evaluate the effects of CNT concentration, type of CNT, type of surfactant and the nanofluid temperature during preparation on the electrical conductivity and stability of the nanofluid.

Secondary studies were also conducted using electrical resistance measurements to evaluate the stability of the surfactant during thermal cycling, and the effects of combining different types of CNTs in the nanofluid.



THIS PAGE INTENTIONALLY LEFT BLANK

## II. EXPERIMENTAL APPROACH AND VALIDATION

### A. DESIGN OF EXPERIMENT

Based on the results of previous research using CNT-enhanced nanofluids, the variables that had a significant impact on the thermal conductivity properties of a nanofluid are:

- Type of Base Fluid
- Type of CNT
- CNT Volumetric Loading Percentage (Concentration)
- Type of Surfactant
- Surfactant Volumetric Loading Percentage (Concentration)
- Size, or Aspect Ratio, of CNT

A factorial approach was used to develop an experimental matrix. Each parameter would have two levels, or settings. With the aim of keeping focus on the stability of the nanofluid, some parameters were fixed to reduce the number of samples that needed to be prepared. The base fluid, surfactant loading percentage and CNT size were fixed so as to only have one level. Utilizing the Kuhlmann findings in the NPS 2008 study, similar nanofluid processing techniques and comparable CNT and surfactant loadings were selected in order to produce a stable nanofluid. Table 1 lists the design parameters for this study.

Table 1. Design Parameters for Thesis Research

| Parameter          | Level | Settings                                                       |
|--------------------|-------|----------------------------------------------------------------|
| CNT Type           | 2     | SWCNT<br>MWCNT                                                 |
| CNT Loading        | 2     | 0.1 % volume<br>0.2% volume                                    |
| Surfactant Type    | 2     | Lithium Dodecyl Sulfate (LDS)<br>Igepal                        |
| Base Fluid         | 1     | Distilled Water                                                |
| Surfactant Loading | 1     | 3.0% volume                                                    |
| CNT Size           | 1     | SWCNT: 1—10 $\mu$ m x 1nm<br>MWCNT: 5—20 $\mu$ m x 15 +/- 10nm |

## B. PROPERTIES OF SELECTED PARAMETERS

### 1. Heat Transfer Fluid

The heat transfer fluid used for this research was distilled water. The excellent thermal conductivity properties, specific heat and latent heat of fusion characteristics make it a favorable choice in many heat transfer systems including high power electronics and directed energy systems. Table 2 lists some important properties of distilled water [20].

Table 2. Properties of Distilled Water

| Parameter     | Value                                                          |
|---------------|----------------------------------------------------------------|
| Density       | liquid: 1000 kg/m <sup>3</sup><br>solid: 917 kg/m <sup>3</sup> |
| Melting Point | 0 °C                                                           |
| Boiling Point | 100 °C                                                         |
| Specific Heat | 4180 J/kg per °C                                               |
| Latent Heat   | 333.55 kJ/kg                                                   |
| Viscosity     | 893.5 x 10 <sup>-6</sup> kg-s/m                                |
| pH            | approximately 7.0                                              |

### 2. Carbon Nanotubes

The single-wall and hollow, multi-wall CNTs used in this study were purchased from Nano-Lab Incorporated located in Newton, Massachusetts. The CNTs were synthesized by the chemical-vapor deposition processing technique. CNTs with a high aspect ratio, or length to diameter ratio, were selected for this study. Residual impurities from the synthesis process include less than 1% weight of iron and sulfur [21]. Table 3 lists the Nano-Lab CNT characteristics.

Table 3. Nano-Lab Incorporated CNT Characteristics

| <b>CNT Type</b> | <b>Structure</b> | <b>Catalog Number</b> | <b>Length (μm)</b> | <b>Diameter (nm)</b> | <b>Purity</b> |
|-----------------|------------------|-----------------------|--------------------|----------------------|---------------|
| MWCNT           | Hollow           | PD15L520              | 5 - 20             | 15 +/- 5             | > 95%         |
| SWCNT           | -                | D1L110                | 1 - 10             | 1                    | > 80%         |

In support of this study, prepared and processed CNT-enhanced nanofluids were provided by Luna Innovations Incorporated located in Danville, Virginia. All nanofluids were SWCNT-based with two purity levels and three CNT concentration levels. The CNT synthesis and dispersion techniques used by Luna Innovations are unknown. Their purity classification relied upon the Haddon method where purification levels above 100% were achieved by oxidation and nitric acid treatments. The CNTs were ultrasonically dispersed in distilled water using a 2.0% volumetric loading of gum Arabic surfactant [17]. Table 4 is a summary chart of the nanofluids prepared by Luna Innovations.

Table 4. Luna Innovations Incorporated Nanofluid Information

| <b>Sample</b> | <b>CNT Loading % (vol)</b> | <b>Purity %</b> |
|---------------|----------------------------|-----------------|
| LnW - 0402    | 0.05                       | 117.0           |
| LnW - 0403    | 0.1                        | 117.0           |
| LnW - 0404    | 0.2                        | 117.0           |
| LnW - 0405    | 0.05                       | 144.0           |
| LnW - 0406    | 0.1                        | 144.0           |
| LnW - 0407    | 0.2                        | 144.0           |

### 3. Volumetric Loading Percentages

Based on the results of previous research, the NPS research experimental values, and the concentration of the Luna Innovations nanofluids, CNT loadings for this study were selected to be 0.1% and 0.2% volume. The surfactant loading was fixed at 3.0% volume to reduce the number of samples that could be reasonably evaluated within the scope of this study.

#### **4. Surfactants**

Chemical dispersion of the CNTs was accomplished by using Lithium Dodecyl Sulfate (LDS) (anionic) and Igepal CO-630 (non-ionic) surfactants manufactured by Sigma-Aldrich. These compounds were selected based on previous NPS research and to evaluate their effects on nanofluid electrical resistance measurements. Both LDS and Igepal are soluble in water, where LDS is in the form of a white-powder and Igepal is a clear, viscous liquid compound. Detailed information on the surfactants can be found in reference [22].

### **C. EQUIPMENT DESCRIPTION**

Physical dispersion was accomplished by using a mechanical homogenizer and ultrasonicator. An industrial freezer unit was used to enable the liquid-to-solid phase change of the nanofluid. All electrical resistance measurements were taken using a digital multimeter. The following sections describe the details of the equipment used in this study.

#### **1. Mechanical Homogenizer**

A Stir-Pak mechanical homogenizer (stirrer) manufactured by Cole-Parmer Instrument Company was used to homogenize the surfactant and the CNT additions into the distilled water. A single propeller attachment was used during the homogenization process. The homogenizer did not have an isolation assembly to prevent atmospheric gasses from dissolving into the nanofluid during homogenization. Figure 3 shows a photograph of the homogenizer.

#### **2. Ultrasonicator**

A Sonicator 3000 Ultrasonic Liquid Processor manufactured by Misonix Incorporated was used for CNT dispersion. The ultrasonicator comprised of a probe tip that transmitted ultrasonic energy into the nanofluid. The available ultrasonication power settings were from 6 Watts to 42 Watts in 3 Watt increments with no alternate output power setting available. A temperature probe was used to monitor the temperature of the nanofluid during ultrasonication. Figure 3 shows a photograph of the ultrasonicator.



Figure 3. (Left) Stir-Pak Mechanical Stirrer. (Right) Sonicator 3000 Ultrasonic Liquid Processor

### 3. Commercial Freezer Unit

A commercial deep freezer unit manufactured by Westinghouse was used to conduct the liquid-to-solid phase change of the nanofluid. The freezer unit was set at a constant temperature of  $-13^{\circ}\text{C}$ . Figure 4 is a photograph of the freezer unit.



Figure 4. Westinghouse Commercial Freezer Unit

#### 4. Digital Multimeter

An 8840A digital multimeter manufactured by Fluke Industries was used to measure the electrical resistance of the nanofluid. A two-wire setup was selected since the lead resistance was negligible when compared to the overall resistance of the nanofluid. Figure 5 is a photograph of the multimeter.



Figure 5. Fluke 8840A Digital Multimeter

#### D. EXPERIMENTAL PROCEDURES

The following procedure builds upon the nanofluid preparation protocol developed by Kuhlmann [19]. The following steps outline the preparation procedure used in this study:

- 20 mL of distilled water was poured into a non-conductive, glass beaker.
- Surfactant was measured out and placed directly into the distilled water in accordance with the prescribed test matrix.
- The distilled water and surfactant mixture was homogenized at 600 RPM using the Stir-Pak with a single-propeller attachment. The attachment was placed approximately 0.25 inches from the bottom of the beaker to avoid cavitation and foaming at the surface. The mixture was homogenized until the surfactant was completely dissolved into the distilled water. This process took approximately five minutes for samples containing LDS and thirty minutes for samples containing Igepal.

- CNTs were measured out in accordance with the prescribed test matrix and added to the distilled water and surfactant mixture. The sample will now be referred to as a nanofluid.
- The nanofluid was homogenized at 600 RPM using the Stir-Pak with the same single propeller attachment for thirty minutes.
- The nanofluid was ultrasonicated in accordance with the prescribed test matrix. The ultrasonicator probe was placed approximately 0.25 inches from the bottom of the beaker to avoid foaming in the nanofluid. The temperature of the nanofluid was monitored through the duration of ultrasonication.
  - Due to boiling of the nanofluid during ultrasonication, various ultrasonication power settings and time duration were selected. It should be noted that ultrasonication parameters varied in order to produce a well homogenized, stable nanofluid and *were not optimized for this study.*
- The initial resistance measurements were taken after the nanofluid cooled at room temperature for five minutes.
- All instruments were cleaned using only distilled water. The procedure was repeated for the next sample.

The American Society of Testing and Materials (ASTM) International document D1125—95, Standard Test Methods for Electrical Conductivity and Resistivity of Water, outlines the standard procedures that should be used for static (non-flowing) and continuous in-line conductivity and resistivity measurements. For this study, conductivity measurements could not be taken in strict adherence with the ASTM procedure due to the lack of available testing apparatus described by the ASTM. For detailed information on the ASTM measurement procedures see reference [23].

The nanofluids received from Luna Innovations Inc. were not modified for this study. All samples were taken directly from the container in which they arrived in from Luna Innovations.

Due to the potential health hazards that CNTs pose to the user, basic safety precautions were followed. Nitrile gloves, a protective face mask and safety glasses were used when handling CNTs and the nanofluids. All nanofluids were prepared inside a fume hood that was vented to the atmosphere. All waste and contaminated CNT-enhanced fluids were disposed of using a hazardous material storage tank.



## **E. EXPERIMENTAL VALIDATION**

The success of this study hinged upon the ability to effectively reduce the influence of physical phenomena on the electrical resistance of the nanofluid. Through the initial testing process, this study expected to show a trend that the addition of CNTs does improve the electrical conductivity of the base fluid by decreasing the overall electrical resistance. The results of the initial testing revealed that the most significant factor affecting the electrical resistance measurements of the nanofluid proved to be the construction of the testing assembly.

The initial test assembly consisted of two, 3000 series aluminum plates separated by a 0.5mm thick, non-conducting plastic insulator. The assembly was sealed with waterproof, silicone caulk and multiple, electrically insulated spring clamps placed around the perimeter of the assembly. A nanofluid with concentration of 3.0% Igepal and 0.5% (weight) Bamboo-type, MWCNTs was injected into the assembly using a syringe through a fill-hole drilled in the upper plate sealed with a cork stopper. A smaller hole was also drilled in the upper plate to allow air to escape during the fill process. A direct current (DC) resistance measurement was taken by placing the multimeter leads on the upper and lower plate. An alternating current (AC) voltage measurement using a low voltage signal generator and known resistance in series with the plate assembly was used to calculate the assembly resistance. The DC resistance measurements were compared to the calculated AC resistances to assess any variation due to the test assembly. Resistance measurements of only the distilled water; distilled water and surfactant; and distilled water, surfactant and CNTs were recorded to evaluate the effects each had on the resistance of the base fluid. Figure 6 shows a photograph of the plate assembly.

Since the construction of the test assembly closely resembled that of a capacitor, a capacitive reactance and sensitivity to both polarity and frequency existed within the assembly. This resulted in an unsteady and indefinite resistance measurement. Also, achieving an adequate dispersion of the nanofluid within the plate assembly was hindered due to the small dimensions of the channel between the upper and lower plate. These phenomena and physical variables prevented clear-cut measurements along with the

inability to accurately correlate the calculated AC resistance to the DC resistance measurement. Figure 6 shows the inadequate dispersion of the nanofluid within the plate assembly.

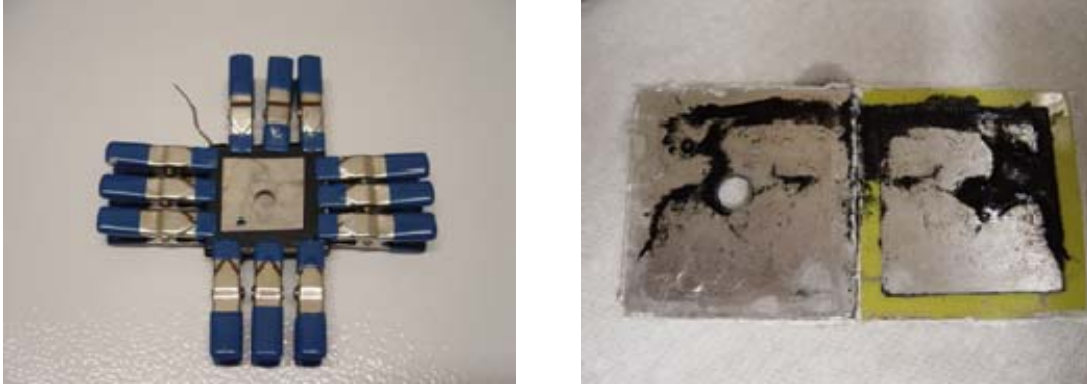


Figure 6. (Left) Aluminum Plate Assembly. (Right) Inadequate Dispersion of the Nanofluid within the Plate Assembly.

The suspected trend that CNTs would improve the electrical conductivity of a base fluid was shown through the initial testing. For example, the calculated AC resistance of the distilled water ranged between 3,100  $\Omega$  and 3,400  $\Omega$  compared to 645  $\Omega$  to 675  $\Omega$  with the distilled water and surfactant and finally 520  $\Omega$  to 575  $\Omega$  with the nanofluid. Since the calculated resistance values of distilled water did not approximately equal the accepted distilled water resistance value of 18.18 M $\Omega$ -cm [24] along with inconsistent resistance values, the plate assembly was suspect of error. Figure 7 shows the trend of decreasing resistance through the addition of surfactant and CNTs to the distilled water. Appendix A shows the plate assembly initial resistance measurements.

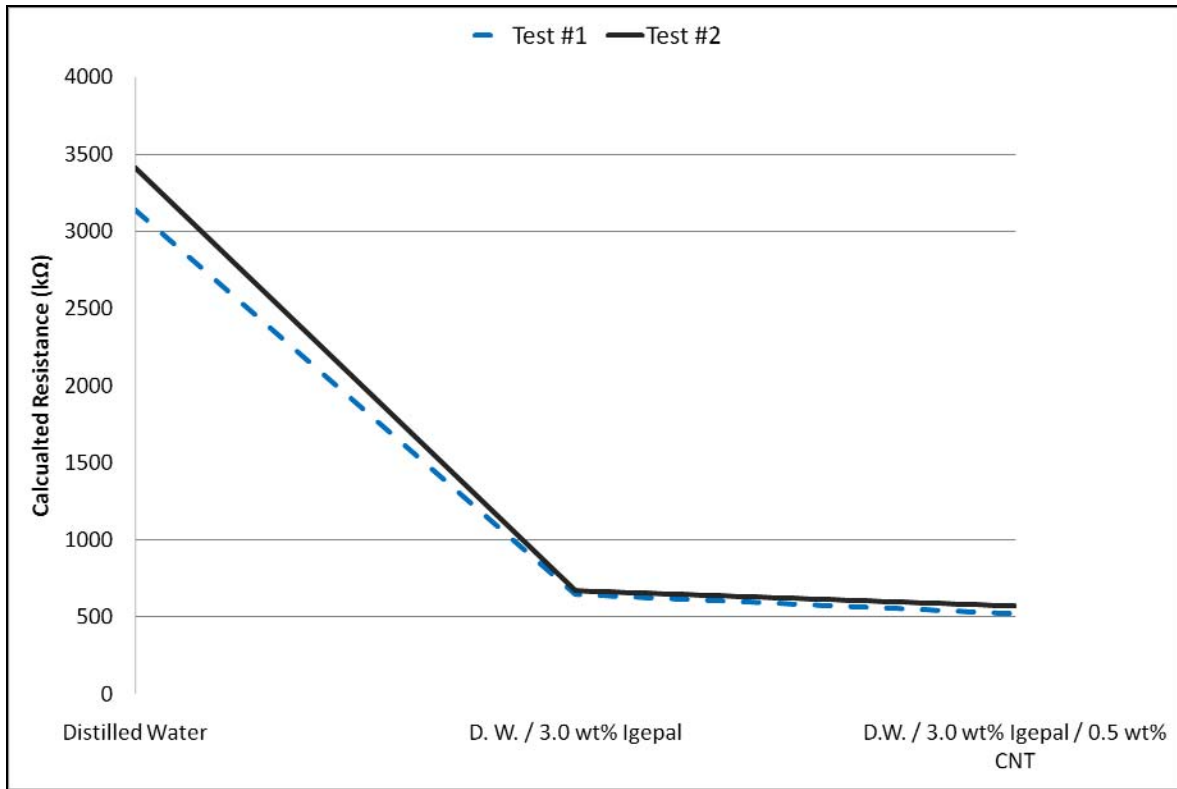


Figure 7. Initial Electrical Conductivity Trend using the Plate Assembly

In order to minimize error or variation introduced by the plate assembly construction, measurement setup, lead placement, contact resistance or nanofluid dispersion, a simplified probe-type test assembly was constructed. This assembly consisted of three, 0.125 inch diameter stainless steel rods, or probes, mounted in a non-conducting, plastic stopper. Each probe was labeled A, B, and C and were spaced 10mm apart. The probes were secured to the stopper so that the probe tips were in-line at 0.25 inches from the bottom of the beaker, but also able to be removed when taking resistance measurements. The multimeter leads were fastened to the probe using Fluke spring clips. DC Resistance measurements were taken between the A—B, B—C and A—C probes to measure the electrical resistance and to see if the resistance changed between various points in the nanofluid. Using the probe assembly, the intention was to show the same conductivity trend as seen with the plate assembly with minimal variation between measurements. Figure 8 is a photograph of the probe assembly.

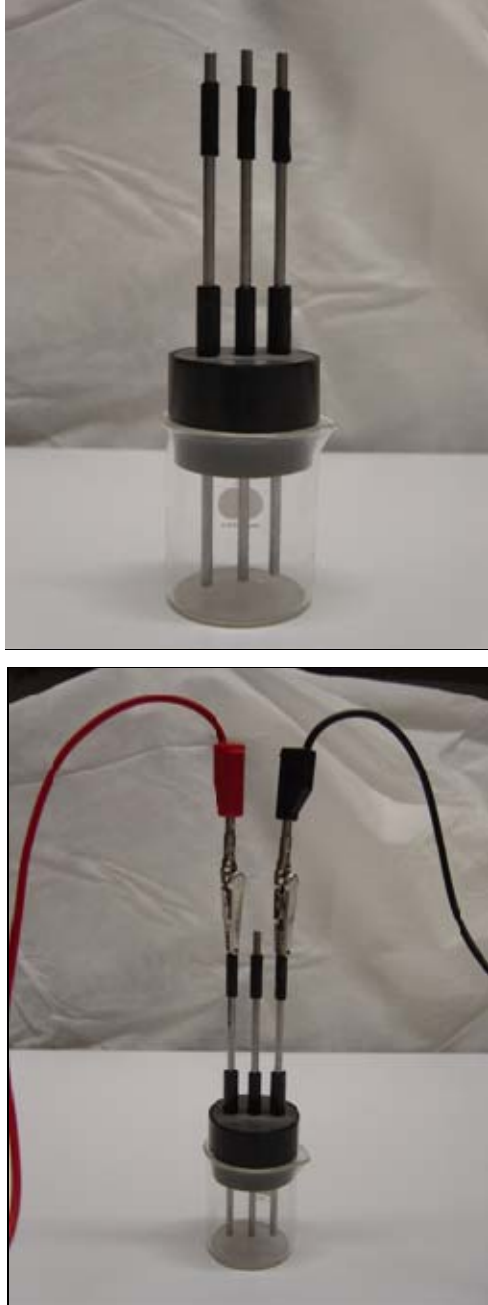


Figure 8. (Top) Probe Assembly. (Bottom) Probe Assembly with Leads

The following nanofluids were used in validating this test assembly:

- All Luna Innovations Nanofluids
- 0.5% (weight) Hollow-MWCNT with 3.0% (weight) Igepal
- 0.5% (weight) Bamboo-MWCNT with 3.0% (weight) Igepal

Resistance measurements between probes were conducted for a period of ten seconds. The beginning resistance value was recorded at the initial connection of the lead to the probe and the ending resistance value was recorded at the expiration of ten seconds. Probes not in use during the measurement were removed from the assembly.

Using the probe assembly, the second phase of experimental validation began with the thermal cycling of the nanofluid. After the initial resistance measurements were recorded, the nanofluid was placed in the deep freezer until completion of the liquid-to-solid phase change. The nanofluid was then removed from the freezer and thawed at room temperature until the completion of the solid-to-liquid phase change. The electrical resistance of the nanofluid was measured and recorded with additional notes on the physical appearance of the nanofluid, i.e., formation of agglomerates, layered separation of the CNTs from the distilled water, sedimentation of CNTs out of solution, etc. All nanofluids underwent five thermal cycles or until the sample showed signs of instability.

The initial results using the probe assembly showed the same trend of decreasing resistance with the addition of surfactant and CNTs but with significantly higher resistance ranges in excess of 30 k $\Omega$  compared to values of less than 1 k $\Omega$  using the plate assembly. Sporadic resistance readings of less than 10 k $\Omega$  made the probe assembly suspect to error. A possible reason for the large difference in resistance ranges could possibly be attributed to the small contact area between the teeth of the spring clip. If the clips did not make good contact or any contact at all with the probes, the contact resistance would significantly increase and prevent accurate measurements.

The physical stability of the nanofluids varied drastically between the Luna Innovation and NPS nanofluids. All of the Luna Innovation nanofluids showed excellent stability with minimal agglomeration and sedimentation after five phase changes. On the other hand, the NPS nanofluids were unstable due to the formation of a large, single agglomerate after the first thaw cycle. These initial results showed the sensitivity of nanofluids to the preparation procedure, loading concentrations and shows the need for nanofluid optimization. Figure 9 shows the physical appearance of the nanofluids upon completion of initial thermal cycling.

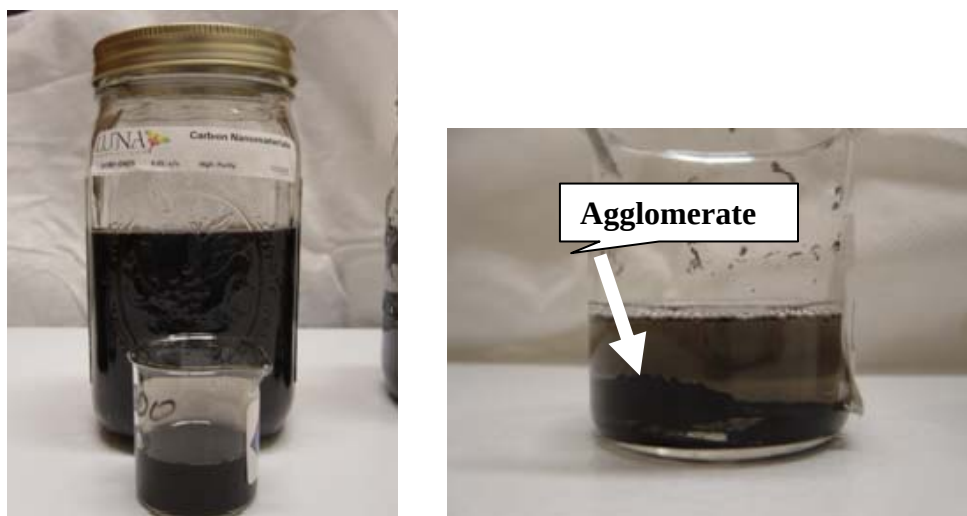


Figure 9. (Left) Luna Innovation LnW-404 Nanofluid after Five Phase Changes.  
(Right) NPS Nanofluid after One Phase Change

These initial results proved that the probe assembly needed to be further refined in order to achieve an accurate resistance measurement and that a lower CNT concentration needed to be selected to prevent the formation of agglomerates. To have comparable nanofluids, 0.2% and 0.1% volume CNT concentration were selected for NPS nanofluids. Appendices B, C and D show the raw electrical resistance data from the Luna Innovations, Hollow and Babmoo MWCNT nanofluids respectively.

The final test assembly was constructed using only the multimeter leads. This setup removed any variation introduced through the construction of a test assembly. The leads were fastened together using electrical tape with a 10mm distance between leads. The multimeter lead resistance was less than  $1\Omega$  and considered negligible when compared to the overall nanofluid resistance. A total of 15 resistance measurements were recorded to evaluate the variation between measurements and obtain a standard deviation between data points. Figure 10 shows a photograph of the multimeter lead construction.

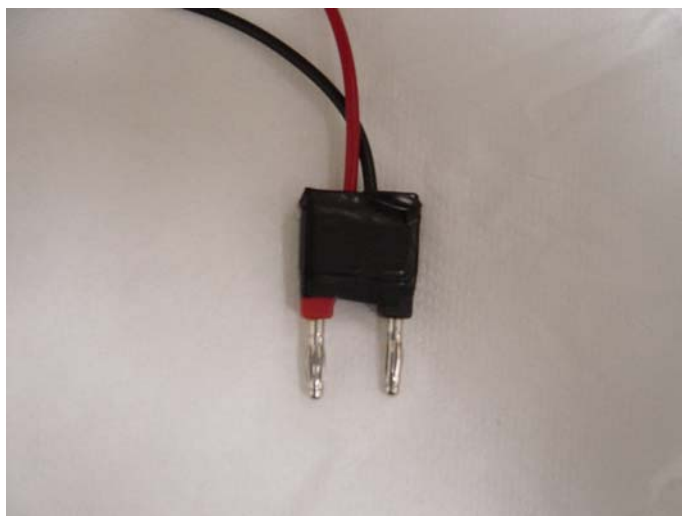


Figure 10. Multimeter Lead Construction

To determine the proper submersion depth of the leads, resistance measurements of all the Luna Innovations nanofluids were taken at the nanofluid surface and bottom of the beaker. Based on the results, the electrical resistance at the nanofluid surface was higher than the bottom of the beaker. This is possibly due to sedimentation effects of static, nanofluids where the CNTs naturally settle out of solution to the bottom of the container creating a more conductive path. In order to avoid these extreme electrical resistance values, resistance measurements would be taken at the mid-level of the nanofluid. Figure 11 shows a plot of the nanofluid surface and bottom average resistance values with the standard deviation between measurements. Appendix E shows the raw data of the electrical resistance measurements.

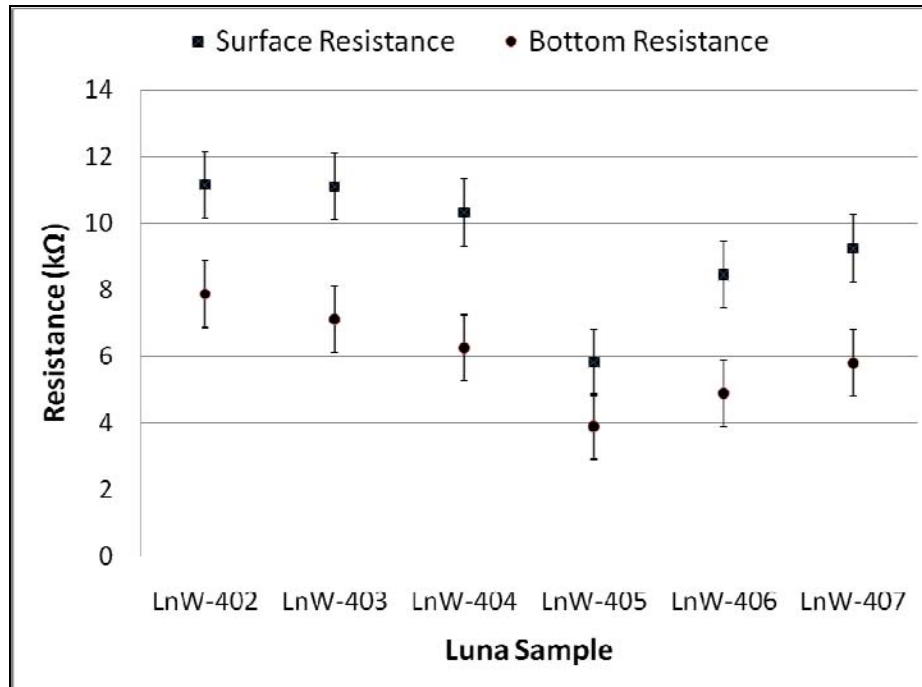


Figure 11. Luna Innovation Nanofluids Surface and Bottom Average Electrical Resistance Measurements.

The leads were rotated in 90° increments at the submerged mid-level in order to determine if the orientation of the leads affected the resistance measurements. Luna Innovation samples LnW-402 and LnW-405 were tested. The results showed less than a 3% difference between resistance measurements of different orientations. The orientation of the multimeter leads was considered negligible for the remainder of this study. Appendix F shows the raw data from the multimeter lead orientation measurements.

After establishing the submerged depth and orientation of the multimeter leads, all Luna Innovation nanofluids were tested and thermally cycled five times using new samples. The initial resistance measurement displayed on the multimeter screen at the moment of lead insertion was recorded. The results using this technique were the most promising of all the tests conducted. Not only did the nanofluids show excellent physical stability, but the resistance measurements ranged between 3 kΩ and 13 kΩ compared to readings in excess of 30 kΩ using the probe assembly.



## 1. Ultrasonication Parameter Validation

In order to determine the effects of ultrasonication during the preparation process of the nanofluid, four different power settings and time durations were evaluated using distilled water with a 3.0% (volume) concentration of LDS and Igepal surfactants. Table 5 lists the tested ultrasonication settings.

Table 5. Ultrasonication Power Settings and Time Durations

| <b>Power<br/>(Watts)</b> | <b>Time<br/>(Minutes)</b> |
|--------------------------|---------------------------|
| 39                       | 5                         |
| 24                       | 30                        |
| 15                       | 15                        |
| 15                       | 60                        |

The largest problem encountered during ultrasonication was controlling the mixture temperature. The energy input from the ultrasonicator caused an increase in mixture temperature, which resulted in excessive foaming, boiling and evaporation of liquid. This significantly altered the volume concentration of surfactant in the mixture. 4mL to 7mL of liquid evaporated when the mixture was ultrasonicated at 24 Watts for 30 minutes and 15 Watts for 60 minutes. Less than 1ml of liquid evaporated using an ultrasonication setting of 39 Watts for 5 minutes and 15 Watts for 15 minutes. In some cases, the mixtures containing Igepal turned an opaque color at temperatures above 40°C whereas the LDS mixtures did not.

In order to control the mixture temperature while ensuring an adequate homogenization of CNTs, using an ice bath during preparation or using the 15 Watts for 15 minutes setting with no ice bath (uncontrolled temperature) could be used. To ensure the preparation of a well homogenized, stable sample with minimal liquid loss, nanofluids were prepared using an ultrasonication setting of 15 Watts for 15 minutes both with and without an ice bath.

## F. EXPERIMENTAL SUMMARY

Nanofluids prepared by NPS consisted of 0.1% (volume) and 0.2% (volume) concentrations of MWCNTs and SWCNTs dispersed in distilled water using a 3.0% (volume) concentration of LDS or Igepal surfactant. The nanofluids were prepared using a combination of physical and chemical means. Based on the results of the experimental validation, the DC electrical resistances of the nanofluids will be tested using only the multimeter leads submerged at mid-level at any orientation in the nanofluid. 15 resistance measurements were recorded from the initial insertion of the leads into the nanofluid and subsequent display on the multimeter screen. All nanofluids (except Luna Innovations samples) will be ultrasonicated at a power setting of 15 Watts for 15 minutes both with and without the use of an ice bath. The initial resistance measurements will be taken five minutes after the completion of ultrasonication. All samples will be thermally cycled up to five times or until the sample shows any signs of instability, in which testing will be discontinued. Table 6 lists the NPS Nanofluid Experimental Matrix and Table 4 lists the Luna Innovation Nanofluids that will be used for this study.

Table 6. NPS Nanofluid Experimental Matrix

| Sample | Ultrasonication Temperature Control | CNT Type | CNT Concentration (% Volume) | Surfactant Concentration (3.0% Volume) |
|--------|-------------------------------------|----------|------------------------------|----------------------------------------|
| 1      | Ice Bath                            | MWCNT    | 0.2                          | LDS                                    |
| 2      | Ice Bath                            | MWCNT    | 0.2                          | Igepal                                 |
| 3      | Ice Bath                            | SWCNT    | 0.2                          | LDS                                    |
| 4      | Ice Bath                            | SWCNT    | 0.2                          | Igepal                                 |
| 5      | Ice Bath                            | MWCNT    | 0.1                          | LDS                                    |
| 6      | Ice Bath                            | MWCNT    | 0.1                          | Igepal                                 |
| 7      | Ice Bath                            | SWCNT    | 0.1                          | LDS                                    |
| 8      | Ice Bath                            | SWCNT    | 0.1                          | Igepal                                 |
| 9      | None                                | MWCNT    | 0.2                          | LDS                                    |
| 10     | None                                | MWCNT    | 0.2                          | Igepal                                 |
| 11     | None                                | SWCNT    | 0.2                          | LDS                                    |
| 12     | None                                | SWCNT    | 0.2                          | Igepal                                 |
| 13     | None                                | MWCNT    | 0.1                          | LDS                                    |
| 14     | None                                | MWCNT    | 0.1                          | Igepal                                 |
| 15     | None                                | SWCNT    | 0.1                          | LDS                                    |
| 16     | None                                | SWCNT    | 0.1                          | Igepal                                 |

The Luna Innovations samples will be thermally cycled up to twelve times to evaluate the stability through extended thermal cycles and re-ultrasonicated at 15 Watts for five minutes to investigate the need for re-homogenization of static, CNT-enhanced nanofluids. Resistance measurements will only be taken at the sixth and twelfth thermal cycles.

### 1. Ancillary Studies

Ancillary studies focused on the stability of the surfactant during thermal cycling and the effects of mixing of Luna Innovation nanofluids with Nano-Lab Industries. The selected surfactants, LDS and Igepal, were homogenized in 20 mL of distilled water and prepared using the ultrasonication settings listed in Table 7, both with and without an ice bath. All mixtures were thermally cycled three times to evaluate the overall stability during the initial phase changes.

Table 7. Experimental Matrix for Thermal Cycling of Surfactants

| <b>Surfactant</b>            | LDS & Igepal | LDS & Igepal | LDS & Igepal | LDS & Igepal |
|------------------------------|--------------|--------------|--------------|--------------|
| <b>Concentration</b>         | 3.0 % vol    | 3.0 % vol    | 3.0 % vol    | 3.0 % vol    |
| <b>Ultrasonication Power</b> | 39 W         | 24 W         | 15 W         | 15 W         |
| <b>Ultrasonication Time</b>  | 5 min        | 30 min       | 15 min       | 60 min       |

For the mixing of different types of CNTs, Nano-Lab Industries hollow-type MWCNTs were mixed with Luna Innovations SWCNT nanofluids. 0.05% (volume) MWCNTs were added to LnW-402 and LnW-405 and ultrasonicated at 39 Watts for 5 minutes and 15 Watts for 15 minutes both with and without and ice bath. The combined CNT concentration of 0.1% (volume) was compared to the LnW-403 and LnW-406 to evaluate their effects on the nanofluid resistance. The ultrasonication settings were selected in order to minimize liquid evaporation during ultrasonication. The nanofluids will be thermally cycled up to five times or until the nanofluid shows signs of instability. Table 8 lists the combined CNT nanofluid experimental matrix.

Table 8. Combined CNT Nanofluid Experimental Matrix

| <b>Sample</b> | <b>Luna<br/>Innovation<br/>Nanofluid</b> | <b>Nano-<br/>Lab<br/>CNT</b>       | <b>Ice Bath<br/>during<br/>Ultrasonication<br/>(Yes / No)</b> | <b>Ultrasonication<br/>Power<br/>(Watts)</b> | <b>Ultrasonication<br/>Time<br/>(Minutes)</b> |
|---------------|------------------------------------------|------------------------------------|---------------------------------------------------------------|----------------------------------------------|-----------------------------------------------|
| L1            | LnW-402                                  | 0.05%<br>volume<br>Hollow<br>MWCNT | Yes                                                           | 15                                           | 15                                            |
| L2            |                                          |                                    | No                                                            | 15                                           | 15                                            |
| L3            |                                          |                                    | Yes                                                           | 39                                           | 5                                             |
| L4            |                                          |                                    | No                                                            | 39                                           | 5                                             |
| L5            | LnW-405                                  | 0.05%<br>volume<br>Hollow<br>MWCNT | Yes                                                           | 15                                           | 15                                            |
| L6            |                                          |                                    | No                                                            | 15                                           | 15                                            |
| L7            |                                          |                                    | Yes                                                           | 39                                           | 5                                             |
| L8            |                                          |                                    | No                                                            | 39                                           | 5                                             |

THIS PAGE INTENTIONALLY LEFT BLANK

### III. RESULTS

The results of this study are presented in a tabular format on the following pages. Each table lists the average DC resistance of 15 resistance measurements using only the multimeter leads. A transparency test was conducted upon the completion of the solid-to-liquid phase change, where the nanofluid was tilted on-edge against white, ambient light and evaluated for the existence of sediment or agglomerates. Table 9 identifies the terms assigned to describe the physical appearance of the nanofluids and Figure 12 is a photograph of the respective terms. Tables 10 through 13 summarize the average resistance measurements of the NPS nanofluids, Luna Innovations nanofluids, combined CNT nanofluids and thermal cycling of surfactant tests respectively. All electrical resistance measurements can be found in Appendices G, H, and I respectively.

Table 9. Description of Physical Appearance of Nanofluid

|     |                         |
|-----|-------------------------|
| C   | Clear                   |
| H   | Homogenous              |
| VSA | Very Small Agglomerates |
| SA  | Small Agglomerates      |
| MA  | Medium Agglomerates     |
| LA  | Large Agglomerates      |
| LS  | Light Sediment          |
| S   | Sediment                |
| HS  | Heavy Sediment          |

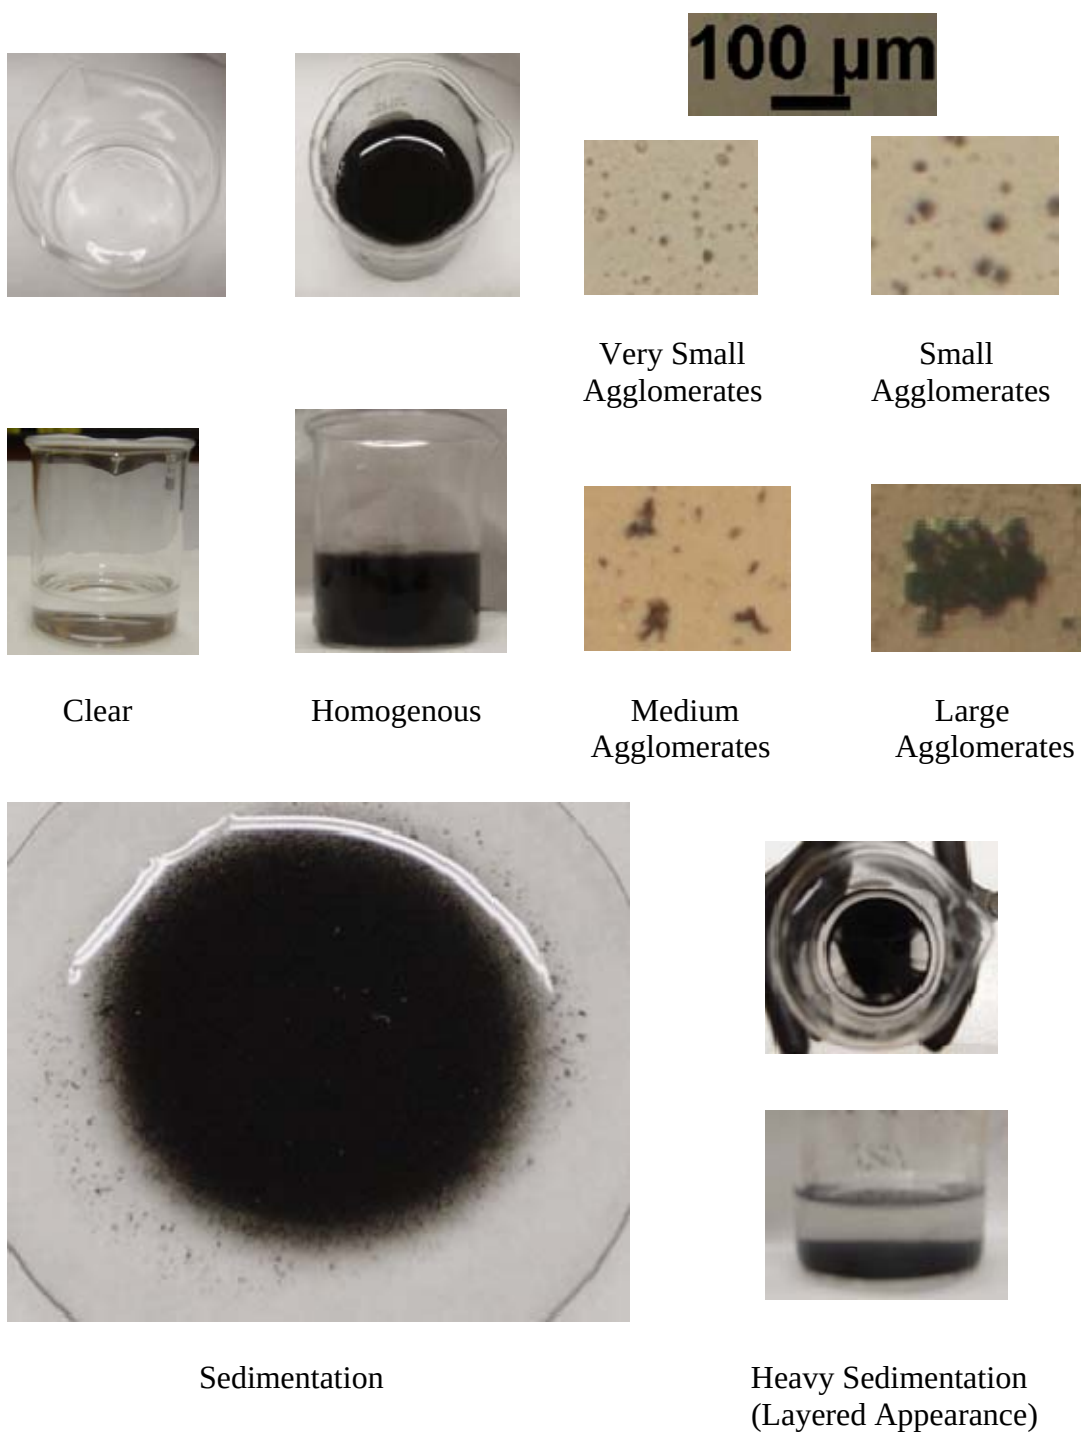


Figure 12. Photographs Describing Physical Appearance of Nanofluids

Table 10. NPS Nanofluid Results

| Sample | Type of Surfactant | DW (MΩ) | Average Resistance (kΩ) |                                                     |          |          |                               |          |            |
|--------|--------------------|---------|-------------------------|-----------------------------------------------------|----------|----------|-------------------------------|----------|------------|
|        |                    |         | DW / LDS                | Initial                                             | 1st Thaw | 2nd Thaw | 3rd Thaw                      | 4th Thaw | 5th Thaw   |
| 1      | LDS                | 0.34    | 13.47                   | 12.24                                               | 8.53     | 8.43     | 6.97                          | 6.73     | 7.13       |
|        | Appearance         | C       | C                       | H                                                   | LS       | SA & S   | SA & S                        | SA & S   | SA & S     |
| 2      | Igepal             | 0.19    | 38.95                   | 37.71                                               | 30.36    | 31.25    | 30.26                         | 30.97    | 26.43      |
|        | Appearance         | C       | C                       | H                                                   | LS       | SA & S   | SA & S                        | MA & S   | MA, LA & S |
| 3      | LDS                | 0.23    | 13.62                   | 6.01                                                | 8.69     | 10.21    | 8.26                          | 8.25     | 7.26       |
|        | Appearance         | C       | C                       | H                                                   | LS       | LS       | SA & S                        | SA & S   | SA & S     |
| 4      | Igepal             | 0.24    | 34.86                   | 36.43                                               | 30.57    | 30.21    | 28.97                         | -        | -          |
|        | Appearance         | C       | C                       | H                                                   | LS       | LS       | Unstable - Layered Appearance |          |            |
| 5      | LDS                | 0.28    | 14.96                   | 9.65                                                | 8.07     | 9.85     | 10.18                         | 8.69     | 7.17       |
|        | Appearance         | C       | C                       | H                                                   | SA       | SA       | SA                            | SA & MA  | LA         |
| 6      | Igepal             | 0.24    | 35.23                   | 36.53                                               | 30.18    | 28.03    | 30.54                         | 24.7     | 24.69      |
|        | Appearance         | C       | C                       | H                                                   | LS       | VSA      | VSA                           | VSA      | VSA        |
| 7      | LDS                | 0.22    | 13.54                   | 5.58                                                | 12.15    | 12.02    | 10.35                         | 9.19     | 8.73       |
|        | Appearance         | C       | C                       | H                                                   | LS       | LS       | LS                            | LS       | LS         |
| 8      | Igepal             | 0.26    | 34.59                   | 40.56                                               | 31.07    | 29.11    | 25.76                         | -        | -          |
|        | Appearance         | C       | C                       | H                                                   | LS       | HS       | Unstable - Layered Appearance |          |            |
| 9      | LDS                | 0.71    | 9.87                    | 2.55                                                | 8.23     | 7.53     | 5.77                          | 8.36     | 5.17       |
|        | Appearance         | C       | C                       | H                                                   | SA       | SA       | MA                            | MA       | MA         |
| 10     | Igepal             | 0.68    | 37.29                   | 15.58                                               | 29.61    | 30.24    | 24.91                         | 27.38    | 27.55      |
|        | Appearance         | C       | C                       | H                                                   | SA       | SA & S   | LA & S                        | LA & S   | LA & S     |
| 11     | LDS                | 0.71    | 12.01                   | 3.48                                                | 8.98     | 8.07     | 8.17                          | 8.19     | 8.41       |
|        | Appearance         | C       | C                       | H                                                   | LS       | LS       | LS                            | LS       | LS         |
| 12     | Igepal             | 0.52    | 31.41                   | -                                                   | -        | -        | -                             | -        | -          |
|        | Appearance         | C       | C                       | Unstable - Layered Separation after Ultrasonication |          |          |                               |          |            |
| 13     | LDS                | 0.62    | 8.97                    | 4.62                                                | 8.36     | 8.17     | 7.18                          | 7.89     | 9.99       |
|        | Appearance         | C       | C                       | H                                                   | SA       | SA       | SA                            | SA       | SA         |
| 14     | Igepal             | 0.65    | 32.55                   | 12.03                                               | 29.64    | 25.55    | 25.73                         | 30.79    | 31.26      |
|        | Appearance         | C       | C                       | H                                                   | VSA      | SA       | SA                            | SA       | SA         |
| 15     | LDS                | 0.56    | 8.85                    | 5.55                                                | 9.46     | 8.97     | 9.19                          | 6.61     | 8.08       |
|        | Appearance         | C       | C                       | H                                                   | LS       | LS       | LS                            | LS       | LS         |
| 16     | Igepal             | 0.61    | 29.53                   | -                                                   | -        | -        | -                             | -        | -          |
|        | Appearance         | C       | C                       | Unstable - Layered Separation after Ultrasonication |          |          |                               |          |            |



Table 11. Luna Innovations Incorporated Nanofluid Results

| Sample  | Type of Surfactant | Average Resistance (k $\Omega$ ) |          |          |          |          |          |          |           |             |          |
|---------|--------------------|----------------------------------|----------|----------|----------|----------|----------|----------|-----------|-------------|----------|
|         |                    | Initial                          | 1st Thaw | 2nd Thaw | 3rd Thaw | 4th Thaw | 5th Thaw | 6th Thaw | 12th Thaw | Re-Sonicate | 1st Thaw |
| LnW-402 | Gum Arabic         | 10.73                            | 11.91    | 12.82    | 12.12    | 12.7     | 8.77     | 9.97     | 21.55     | 7.73        | 11.84    |
|         | Appearance         | H                                | H        | H        | H        | H        | H        | SA       | LA & S    | H           | SA       |
| LnW-403 | Gum Arabic         | 8.58                             | 11.3     | 11.55    | 11.41    | 12.3     | 9.13     | 9.78     | 20.54     | 6.94        | 11.23    |
|         | Appearance         | H                                | H        | H        | H        | H        | H        | SA       | LA & S    | H           | SA       |
| LnW-404 | Gum Arabic         | 7.82                             | 9.05     | 8.92     | 8.85     | 8.27     | 8.53     | 8.81     | 17.9      | 6.71        | 7.23     |
|         | Appearance         | H                                | H        | H        | H        | H        | H        | LS       | MA & S    | H           | SA       |
| LnW-405 | Gum Arabic         | 4.69                             | 6.68     | 7.31     | 7.28     | 6.3      | 5.1      | 6.35     | 13.16     | 6.47        | 9.91     |
|         | Appearance         | H                                | H        | H        | H        | H        | H        | SA       | MA & S    | H           | SA       |
| LnW-406 | Gum Arabic         | 6.47                             | 9.44     | 8.45     | 8.77     | 7.55     | 6.76     | 7.45     | 12.37     | 7.34        | 9.49     |
|         | Appearance         | H                                | H        | H        | H        | H        | H        | S        | MA & S    | H           | SA       |
| LnW-407 | Gum Arabic         | 7.4                              | 10.14    | 9.05     | 9.77     | 8.22     | 7.28     | 7.99     | 16.41     | 6.9         | 9.63     |
|         | Appearance         | H                                | H        | H        | H        | H        | H        | LS       | MA        | H           | SA       |

Table 12. Combined CNT Nanofluid Results

|        |                           |                 | Average Resistance (k $\Omega$ ) |                                        |                                      |          |          |          |
|--------|---------------------------|-----------------|----------------------------------|----------------------------------------|--------------------------------------|----------|----------|----------|
| Sample | Luna Innovation Nanofluid | Luna Innovation | Mixed CNT Initial                | 1st Thaw                               | 2nd Thaw                             | 3rd Thaw | 4th Thaw | 5th Thaw |
| L1     | Gum Arabic                | 8.47            | 7.94                             | 16.51                                  | 7.95                                 | 10.35    | 14.45    | 17.15    |
|        | Appearance                | H               | H                                | S                                      | Unstable - HA and Layered Appearance |          |          |          |
| L2     | Gum Arabic                | 8.43            | 6.01                             | 16.98                                  | 9.05                                 | 11.93    | 12.01    | 16.81    |
|        | Appearance                | H               | H                                | S                                      | SA & S                               | SA & S   | SA & S   | SA & S   |
| L3     | Gum Arabic                | 8.66            | 7.32                             | 16.83                                  | 9.09                                 | 13.41    | 17.05    | 18.73    |
|        | Appearance                | H               | H                                | S                                      | Unstable - HA and Layered Appearance |          |          |          |
| L4     | Gum Arabic                | 8.11            | 5.53                             | 18.1                                   | 8.81                                 | 11.59    | 17.58    | 18.99    |
|        | Appearance                | H               | H                                | Unstable - HA & S                      |                                      |          |          |          |
| L5     | Gum Arabic                | 7.86            | 7.33                             | 9.55                                   | 11.93                                | 11.27    | -        | -        |
|        | Appearance                | H               | H                                | S                                      | Unstable - HA and Layered Appearance |          |          |          |
| L6     | Gum Arabic                | 8.27            | 4.03                             | 9.07                                   | 11.15                                | 9.66     | -        | -        |
|        | Appearance                | H               | H                                | S                                      | Unstable - HA and Layered Appearance |          |          |          |
| L7     | Gum Arabic                | 7.67            | 6.1                              | 8.04                                   | 10.16                                | 8.95     | -        | -        |
|        | Appearance                | H               | H                                | S                                      | Unstable - HA and Layered Appearance |          |          |          |
| L8     | Gum Arabic                | 7.36            | 5.76                             | 8.43                                   | 8.85                                 | 9.35     | -        | -        |
|        | Appearance                | H               | H                                | Unstable - HS & HA, Layered Appearance |                                      |          |          |          |

Table 13. Thermal Cycling of Surfactant Results

| Surfactant                       |          | LDS using an Ice Bath    |       |       |       | LDS (No Ice Bath)    |       |       |       |
|----------------------------------|----------|--------------------------|-------|-------|-------|----------------------|-------|-------|-------|
| Loading                          |          | 3.0% vol                 |       |       |       | 3.0% vol             |       |       |       |
| Ultrasonication Power (Watts)    |          | 39                       | 24    | 15    | 15    | 39                   | 24    | 15    | 15    |
| Ultrasonication Time (Minutes)   |          | 5                        | 30    | 15    | 60    | 5                    | 30    | 15    | 60    |
| Average Resistance (k $\Omega$ ) | Initial  | 13.84                    | 9.93  | 13.45 | 8.48  | 10.35                | 5.09  | 10.55 | 3.67  |
|                                  | 1st Thaw | 13.17                    | 9.85  | 13.74 | 9.25  | 13.34                | 11.32 | 12.21 | -     |
|                                  | 2nd Thaw | 13.9                     | 10.23 | 13.36 | 8.45  | 9.34                 | 9.72  | 13.16 | -     |
|                                  | 3rd Thaw | 15.66                    | 12.61 | 14.87 | 9.01  | 15.06                | 12.1  | 13.33 | -     |
| Surfactant                       |          | Igepal using an Ice Bath |       |       |       | Igepal (No Ice Bath) |       |       |       |
| Loading                          |          | 3.0% vol                 |       |       |       | 3.0% vol             |       |       |       |
| Ultrasonication Power (Watts)    |          | 39                       | 24    | 15    | 15    | 39                   | 24    | 15    | 15    |
| Ultrasonication Time (Minutes)   |          | 5                        | 30    | 15    | 60    | 5                    | 30    | 15    | 60    |
| Average Resistance (k $\Omega$ ) | Initial  | 30.55                    | 33.93 | 34.47 | 36.89 | 31.13                | 14.91 | 31.18 | 18.19 |
|                                  | 1st Thaw | 30.03                    | 32.39 | 29.98 | 30.18 | 35.95                | 32.87 | 36.1  | -     |
|                                  | 2nd Thaw | 39.79                    | 37.34 | 38.11 | 38.11 | 42.93                | 36.71 | 40.05 | -     |
|                                  | 3rd Thaw | 38.95                    | 36.22 | 35.18 | 36.69 | 44.41                | 38.39 | 38.45 | -     |

## IV. ANALYSIS OF RESULTS

### A. NPS NANOFLUIDS

Figure 13 is a plot of the average resistance throughout thermal cycling of all NPS samples. It shows a top-level view of the effects of ultrasonication temperature on the conductivity of the nanofluid and a conductivity comparison of nanofluids dispersed with either Igepal or LDS. Both SWCNT and MWCNT of all concentrations are displayed on the graph. Solid lines represent the nanofluids prepared using an ice bath during ultrasonication and the dashed lines represent nanofluids prepared without an ice bath during ultrasonication (uncontrolled temperature).

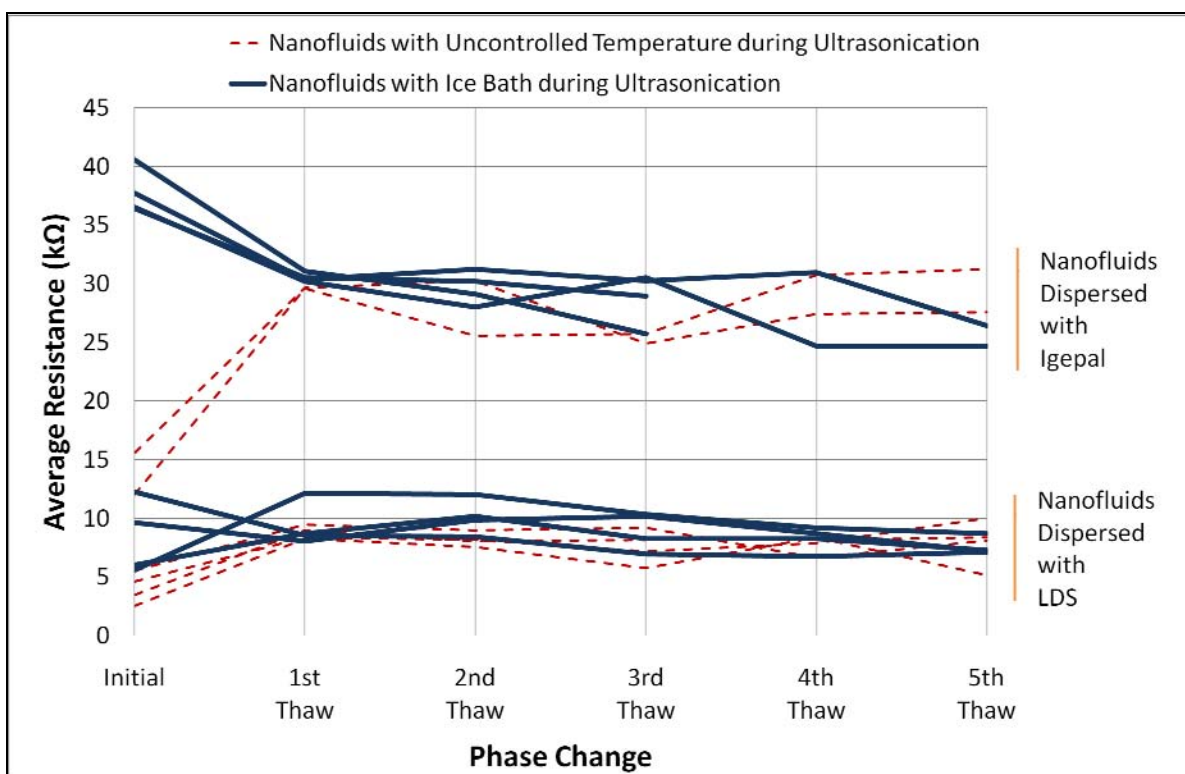


Figure 13. Average Resistance vs. Thermal Cycling of NPS Nanofluids

Using an ice bath during nanofluid ultrasonication did not have a significant effect on the nanofluid resistance throughout thermal cycling. All samples showed both increasing and decreasing changes in electrical resistance after the start of thermal cycling (1<sup>st</sup> Thaw). The largest difference in nanofluid resistance occurred at the initial

measurement due to the higher nanofluid temperatures at the time of measurement. Nanofluids prepared with no temperature control reached temperatures in excess of 70°C compared to 21°C using an ice bath. The conductivity of carbon is notably higher at warmer temperatures due to the increase in atomic movement within the lattice structure. This resulted in higher initial conductivities, or lower resistances, for samples ultrasonicated with no temperature control. After the first phase change, all nanofluids were at the same temperature, which resulted in a convergence of similar surfactant-based resistance measurements. Resistances both increased and decreased for the second through fifth phase changes. A decrease in resistance is possibly due to the natural sedimentation of CNTs out of solution, whereas, an increase in resistances is attributed to the breakdown of the CNT network and formation of agglomerates.

Nanofluids dispersed using LDS had lower resistances than those dispersed with Igepal. The conductive property of LDS assisted in the completion of the conductive paths within the CNT network, whereas the non-conductive property of Igepal was suspect of insulating adjacent CNTs or CNT networks. Also, nanofluids using LDS appeared to have less variation in average resistance values between phase changes than those using Igepal. The resistance values of all the LDS and Igepal samples after the final phase change were relatively the same showing that temperature control during ultrasonication does not have a significant impact on the conductivity of the nanofluid.

No apparent relationship between the effects of controlling nanofluid temperature during ultrasonication on the physical stability of the nanofluid could be identified. All samples showed signs of agglomeration or sedimentation, however, slightly larger agglomerates formed throughout the thermal cycling process in nanofluids using an ice bath.

Figure 14 and Figure 15 illustrate the effects that 0.1% and 0.2% concentration of MWCNTs and SWCNTs have on the resistance of the nanofluid. Each figure shows the average resistance of the nanofluid throughout thermal cycling. Nanofluids prepared both with and without an ice bath during ultrasonication are plotted in each figure.

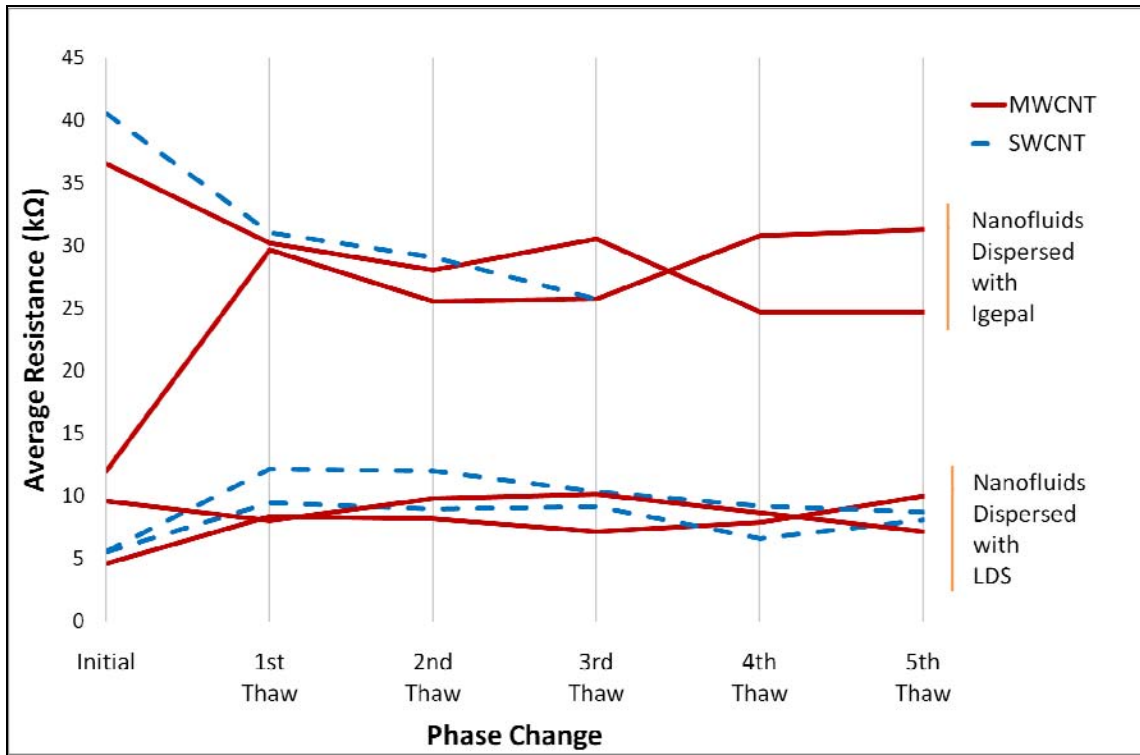


Figure 14. 0.1% CNT Loading: MWCNT & SWCNT Resistance Comparison

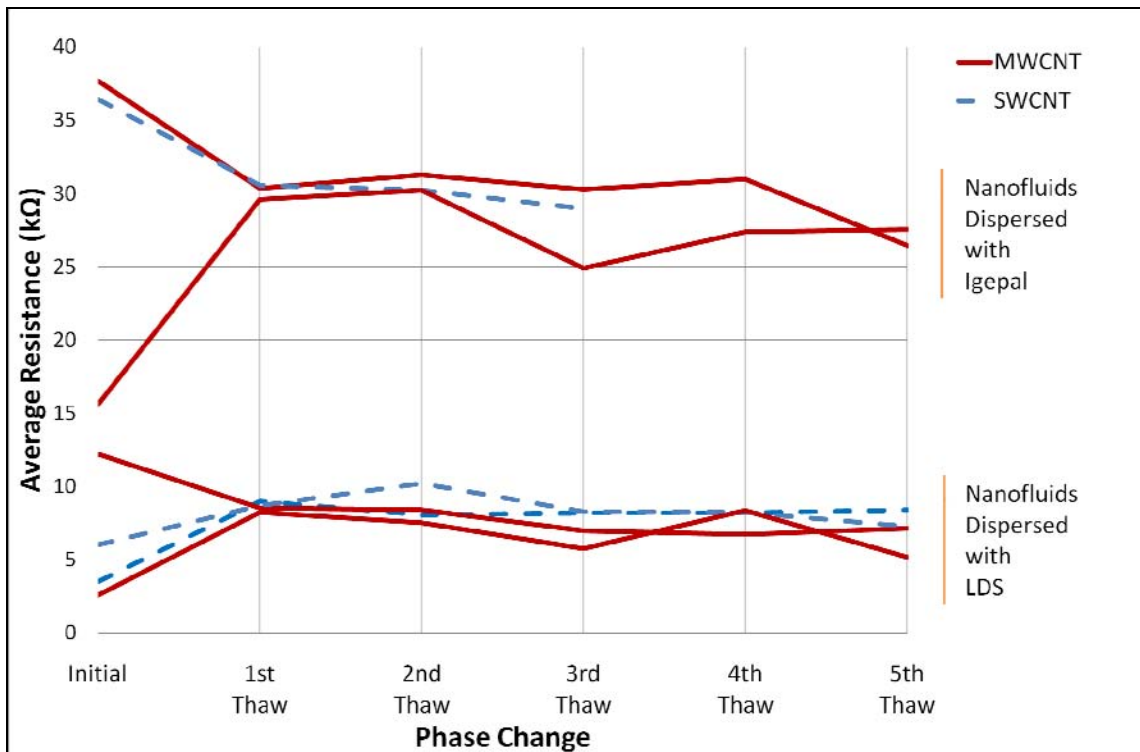


Figure 15. 0.2% CNT Loading: MWCNT & SWCNT Resistance Comparison

Based on the illustrated results in Figure 14 and Figure 15, the type of CNT does not significantly affect the resistance of the nanofluid. Neither MWCNTs nor SWCNTs dispersed in LDS or Igepal proved to show exceptional stability through thermal cycling. All samples using MWCNTs showed signs of agglomeration after the first phase change and SWCNTs showed signs of sedimentation as thermal cycling progressed. Neither type of CNT proved superior over the other within the respective concentration.

On the other hand, the concentration of CNTs had a minor impact on the resistance of the nanofluid. The 0.2% concentration of MWCNTs and SWCNTs showed a small decrease in the nanofluid resistance in both types of surfactants. However, larger-size agglomerates formed as thermal cycling progressed. Using higher concentrations of both SWCNTs and MWCNTs in LDS increased the conductivity of the respective nanofluids. Intuitively, this was expected since using more of a conducting material in a naturally conductive medium should increase the conductivity of the nanofluid. Further optimization of individual nanofluids should balance this trade-off between CNT concentration and acceptable agglomeration.

In both concentration cases, MWCNTs exhibited higher conductivities than SWCNTs. This result was unexpected since SWCNTs have a lower number of defects than MWCNTs, theoretically rendering a higher conductivity. Despite the conductivity gains with MWCNTs, the associated increase in agglomerate size during the progression of thermal cycling yielded those nanofluids more unstable than those using SWCNTs.

SWCNTs dispersed in Igepal showed to be more unstable than those dispersed in LDS. Igepal-based, SWCNT nanofluids prepared with an ice bath during ultrasonication were only stable until the third phase change, whereas, nanofluids using the same parameters were unable to be produced without using an ice bath during ultrasonication. These results should direct future research optimize individual nanofluid combinations.

## B. LUNA INNOVATIONS INCORPORATED NANOFLUIDS

The Luna Innovations nanofluids showed exceptional stability throughout the first five thermal cycles. Light sedimentation and small agglomeration started after the sixth cycle followed by severe instability and agglomeration after the twelfth phase change. After the nanofluids were re-ultrasonicated, the resistances returned to a value near or lower than the initial resistance values. All nanofluids exhibited both increasing and decreasing average resistance values just as the NPS nanofluids. Under identical thermal cycling conditions, the similar trends displayed between each nanofluid may be due to the properties of the surfactant or characteristics of the CNTs selected by Luna Innovations. Figure 16 shows the physical breakdown of sample LnW-402 from initial testing, to the twelfth thermal cycle and appearance after re-sonication.

The nanofluids with a lower purity exhibited a decreasing resistance with higher CNT concentrations just as the NPS nanofluids, but the resistance of the higher purity samples increased as CNT concentration increased. No distinct conclusion could be drawn to explain this behavior. Figure 17 and Figure 18 show the average resistances throughout thermal cycling of the 117% and 144% pure nanofluids.

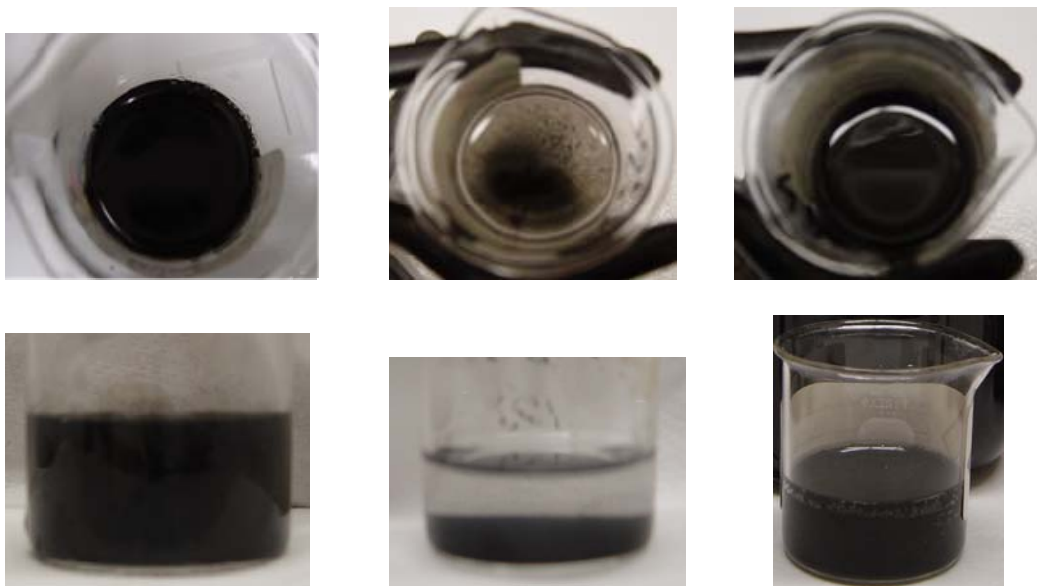


Figure 16. (Left) Initial Appearance of LnW-402. (Middle) Appearance of LnW-402 after 12th Cycle. (Right) Appearance of LnW-402 after Re-sonication



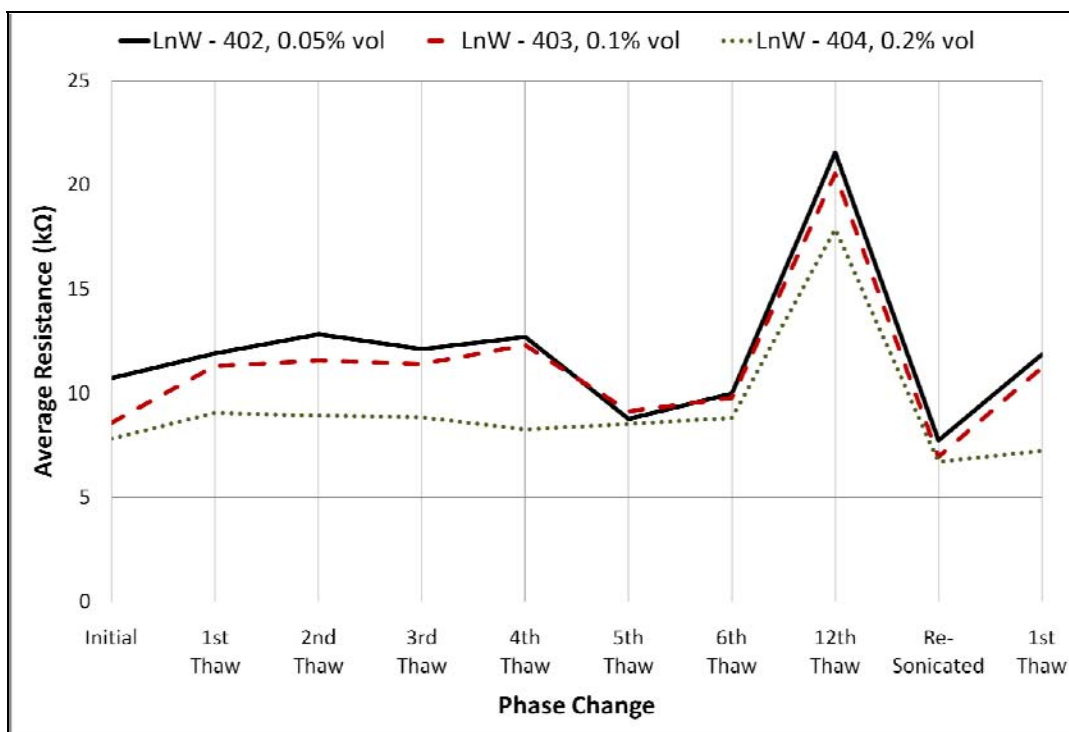


Figure 17. 117% Pure Luna Innovations Nanofluids

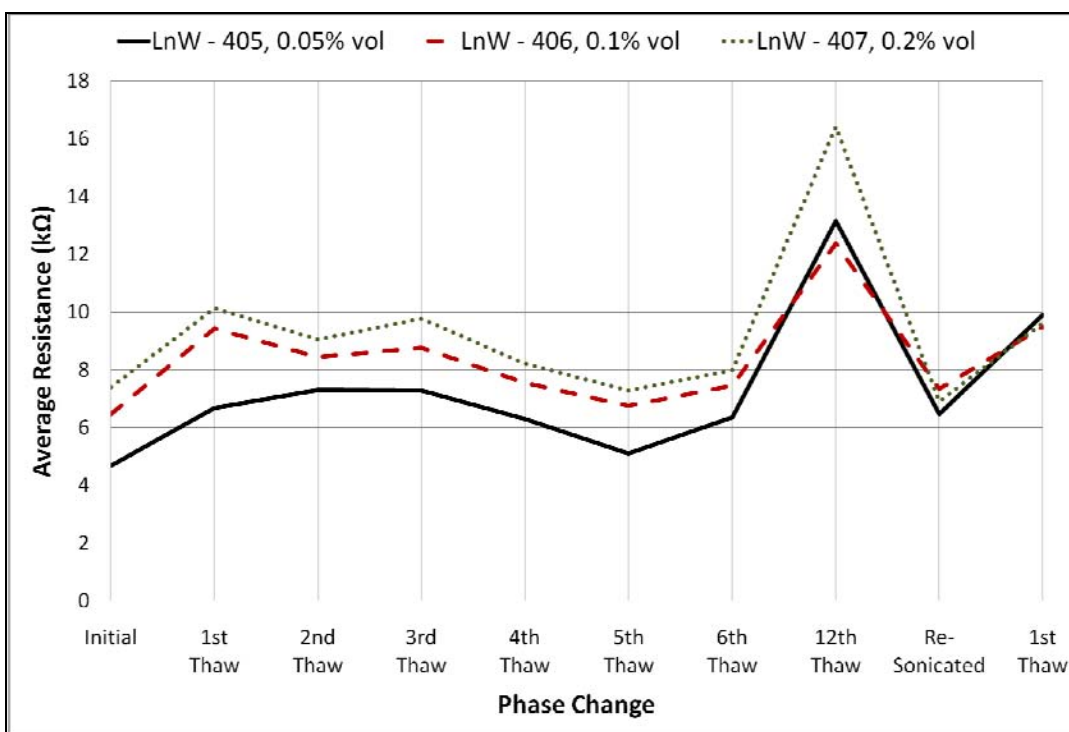


Figure 18. 144% Pure Luna Innovations Nanofluids

### **C. COMBINED CNT NANOFLUIDS**

Combining the Nano-Lab MWCNTs with the Luna Innovations nanofluids did not have a significant effect on the resistance of the nanofluid. The initial measurement after ultrasonication was slightly less than the initial resistances of the 0.05% and 0.1% Luna nanofluid. Although this may seem beneficial, all mixed nanofluids were physically very unstable. In the lower purity samples, signs of agglomeration were noticed after the second phase change with increasing agglomerate formation in subsequent phase changes. The higher purity nanofluids were unstable after the first phase change exhibiting a layered appearance with heavy sedimentation and agglomerate formation.

This combination of CNTs and nanofluid showed to be unstable. However, this does not prove that combining various types of CNTs will always yield unstable nanofluids. Further investigation is required in this area of nanofluid technology.

### **D. SURFACTANT CYCLING**

The average resistance of Igepal and LDS does slightly increase as thermal cycling progresses. The fluctuating trend during thermal cycling resembles the trend displayed by the NPS and Luna Innovations nanofluids. Regardless of the temperature control method used during ultrasonication, all surfactant mixtures maintained a homogenous distribution with no precipitation out of solution. The initial resistances of LDS and Igepal samples prepared without an ice bath were lower than those prepared with an ice bath due to the effects of heat generation during ultrasonication. Samples prepared without an ice bath that were ultrasonicated at 24 Watts for 30 minutes and 15 Watts for 60 minutes lost 4mL to 6mL of liquid due to evaporation. While the increasing resistance of the surfactants during thermal cycling may have a minor contribution to the increasing resistance trends of the nanofluids, it is not indicative of the effects on the heat transfer properties of the nanofluids. This study also shows the need for temperature control during preparation to prevent severely altered surfactant and CNT concentrations from the evaporation of liquid.

THIS PAGE INTENTIONALLY LEFT BLANK

## V. CONCLUSION

Regardless of CNT type, size, concentration, preparation procedure, surfactant type and concentration, static, CNT-enhanced nanofluids used as a phase change material are stable between three to five thermal cycles. This study has shown that the breakdown of the CNT network during thermal cycling adversely affects the electrical conductivity properties of the nanofluid. By using electrical resistance measurements as a surrogate means to identify an approximate range where the nanofluid begins to significantly breakdown, a system can possibly be calibrated to re-sonicate the nanofluid before becoming unstable. The trade-off between the addition of ultrasonication equipment and the reduction in cooling equipment size can only be validated through field-tested investigations.

THIS PAGE INTENTIONALLY LEFT BLANK

## **VI. RECOMMENDATIONS FOR FUTURE WORK**

The versatility of CNTs makes them ideal for a wide range of applications. The limits of CNTs are still being discovered in various industries, while new ideas continue to emerge. For thermal transport applications, the first step after selecting CNT-enhanced nanofluids for use as a phase change material should be to optimize the nanofluid to achieve the highest concentration for the lowest agglomeration over a pre-determined number of thermal cycles. Whether functionalized CNTs or nanotubes of various synthesis techniques are used, this still remains an overwhelming task due to a vast number of combinations and factors that give nanofluids their unique properties. If the focus is directed toward improving the conduction properties of the nanofluid, researchers should focus on how to complete the conductive path within the CNT architecture and network.

Pending nanofluid optimization, field testing with mathematical modeling or computer simulation should be conducted to better understand the heat transfer behavior of the nanofluid. By actually employing nanofluids and validating the calculated gains, proper cost-benefit analyses can be conducted to initiate the acquisition process and phased implementation cycle.

Finally, a follow on study conducting thermal conductivity tests after each thermal cycle would show the actual change in conduction properties throughout thermal cycling. By comparing those results to the conductivity measurements in this study, the relationship between the thermal and electrical conductivity properties of the nanofluid may be better understood.

THIS PAGE INTENTIONALLY LEFT BLANK

## APPENDIX A. CALCULATED RESISTANCE VALUES USING THE PLATE ASSEMBLY

| <b>Test #1</b>                                                                         | <b>Distilled Water</b>                                                                             | <b>D. W.<br/>3.0 wt% Igepal</b>                                                                | <b>D.W.<br/>3.0 wt% Igepal<br/>0.5 wt% CNT</b>                                                                    |
|----------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------|
| Frequency (Hz)                                                                         | 10                                                                                                 | 10                                                                                             | 10                                                                                                                |
| Known Resistance - $R_1$ ( $\Omega$ )                                                  | 100,000                                                                                            | 100,000                                                                                        | 100,000                                                                                                           |
| Input Voltage to Unknown Res - $E_{R1}$                                                | 1.020                                                                                              | 1.007                                                                                          | 1.17                                                                                                              |
| AC Voltage Across<br>Unknown Resistance - $E - E_{R2}$ (V)                             | 0.032                                                                                              | 0.0065                                                                                         | 0.0061                                                                                                            |
| Calculated Unknown<br>Resistance - $R_2$ ( $\Omega$ )                                  | <b>3137.255</b>                                                                                    | <b>645.482</b>                                                                                 | <b>521.368</b>                                                                                                    |
| DC Resistance Measurement ( $\Omega$ )<br>DC Reverse polarity Measurement ( $\Omega$ ) | - Unsteady, increase from<br>58 - 75 kohm<br>- Somewhat unsteady,<br>decrease from 72 - 64<br>kohm | - Unstable, 61 kohm decreasing to<br>45 kohm<br>- Unstable, 53 kohm decreasing to<br>26 kohm   | - Unstable, fluctuate between<br>36 - 40 kohm<br>- Somewhat Stable between 8<br>10 kohm                           |
|                                                                                        |                                                                                                    |                                                                                                |                                                                                                                   |
| <b>Test #2</b>                                                                         | <b>Distilled Water</b>                                                                             | <b>D. W.<br/>3.0 wt% Igepal</b>                                                                | <b>D.W.<br/>3.0 wt% Igepal<br/>0.5 wt% CNT</b>                                                                    |
| Frequency (Hz)                                                                         | 10                                                                                                 | 10                                                                                             | 10                                                                                                                |
| Known Resistance - $R_1$ ( $\Omega$ )                                                  | 100,000                                                                                            | 100,000                                                                                        | 100,000                                                                                                           |
| Input Voltage to Unknown Res - $E_{R1}$                                                | 1.023                                                                                              | 1.0106                                                                                         | 1.0100                                                                                                            |
| AC Voltage Across<br>Unknown Resistance - $E - E_{R2}$ (V)                             | 0.0349                                                                                             | 0.0068                                                                                         | 0.0058                                                                                                            |
| Calculated Unknown<br>Resistance - $R_2$ ( $\Omega$ )                                  | <b>3411.535</b>                                                                                    | <b>672.868</b>                                                                                 | <b>573.267</b>                                                                                                    |
| DC Resistance Measurement ( $\Omega$ )<br>DC Reverse polarity Measurement ( $\Omega$ ) | - Somewhat Unsteady, 60<br>to 72 kohm<br>- Unsteady, 79 to 45<br>kohm                              | - Unstable, 55 kohm decreasing to<br>38.6 kohm<br>- Unstable, 40 kohm decreasing to<br>20 kohm | - Unstable, decreasing from<br>2.0 to less than 1.0 kohm<br>- Unstable decrease from 6.0<br>to less than 2.0 kohm |



THIS PAGE INTENTIONALLY LEFT BLANK

## APPENDIX B. PROBE ASSEMBLY—LUNA INNOVATIONS NANOFLUID RESISTANCE MEASUREMENTS

\*All Resistances in kilo-ohm, Resistance recorded over 10 second immersion

| Sample | Solution             | A - B       | B - C       | A - C     |
|--------|----------------------|-------------|-------------|-----------|
| 402    | Initial Conductivity | 9.4 - 12.5  | 7.8 - 11.4  | 86 - 101  |
|        | 1st Thaw             | 68 - 103    | 14.1 - 19.1 | 72 - 110  |
|        | 2nd Thaw             | 35 - 91     | 14.1 - 21   | 105 - 145 |
|        | 3rd Thaw             | 50 - 101    | 142 - 158   | 221 - 223 |
|        | 4th Thaw             | 61 - 111    | 72 - 103    | 210 - 219 |
|        | 5th Thaw             | 63 - 119    | 17 - 156    | 278 - 300 |
| 405    | Initial Conductivity | 41 - 75     | 6.5 - 13.4  | 191 - 210 |
|        | 1st Thaw             | 48 - 78     | 12.1 - 16.8 | 188 - 220 |
|        | 2nd Thaw             | 6.2 - 16.5  | 12.5 - 17.1 | 258 - 267 |
|        | 3rd Thaw             | 45 - 102    | 30 - 96     | 229 - 238 |
|        | 4th Thaw             | 49 - 113    | 33 - 102    | 238 - 246 |
|        | 5th Thaw             | 36 - 90     | 52 - 105    | 248 - 259 |
| 403    | Initial Conductivity | 11.2 - 15.7 | 8.6 - 13.2  | 183 - 200 |
|        | 1st Thaw             | 58 - 91     | 14.6 - 19.1 | 72 - 110  |
|        | 2nd Thaw             | 48 - 112    | 20 - 80     | 183 - 220 |
|        | 3rd Thaw             | 29 - 65     | 79 - 114    | 223 - 226 |
|        | 4th Thaw             | 51 - 116    | 26 - 100    | 229 - 238 |
|        | 5th Thaw             | 27 - 80     | 80 - 120    | 262 - 273 |
| 406    | Initial Conductivity | 42 - 79     | 6.7 - 16.4  | 96 - 122  |
|        | 1st Thaw             | 29 - 79     | 9.6 - 18    | 186 - 216 |
|        | 2nd Thaw             | 44 - 80     | 73 - 109    | 237 - 242 |
|        | 3rd Thaw             | 51 - 112    | 23 - 98     | 248 - 256 |
|        | 4th Thaw             | 44 - 119    | 23 - 100    | 256 - 265 |
|        | 5th Thaw             | 56 - 108    | 37 - 95     | 252 - 262 |
| 404    | Initial Conductivity | 34 - 75     | 7.6 - 14.2  | 188 - 199 |
|        | 1st Thaw             | 9.4 - 16.2  | 11.1 - 16.9 | 91 - 93   |
|        | 2nd Thaw             | 33 - 45     | 91 - 100    | 48 - 56   |
|        | 3rd Thaw             | 35 - 83     | 50 - 95     | 217 - 232 |
|        | 4th Thaw             | 43 - 105    | 25 - 92     | 233 - 240 |
|        | 5th Thaw             | 47 - 92     | 56 - 115    | 256 - 265 |
| 407    | Initial Conductivity | 45 - 91     | 8.9 - 12.8  | 35 - 79   |
|        | 1st Thaw             | 8.5 - 17.9  | 18.1 - 32   | 101 - 120 |
|        | 2nd Thaw             | 46 - 95     | 56 - 102    | 244 - 157 |
|        | 3rd Thaw             | 50 - 116    | 24 - 101    | 253 - 265 |
|        | 4th Thaw             | 58 - 124    | 24 - 90     | 256 - 263 |
|        | 5th Thaw             | 47 - 115    | 28 - 103    | 256 - 267 |

THIS PAGE INTENTIONALLY LEFT BLANK

## APPENDIX C. PROBE ASSEMBLY—HOLLOW MULTI-WALL CARBON NANOTUBE RESISTANCE MEASUREMENTS

\*All Resistances in kilo-ohm

| Sample | Solution                     | A - B       | B - C       | A - C       | General Notes                                                                                     |           |
|--------|------------------------------|-------------|-------------|-------------|---------------------------------------------------------------------------------------------------|-----------|
| 5      | Distilled Water              | 99 - 160    | 83 - 140    | 267 - 305   | Ultrasonication Power                                                                             | 39 Watts  |
|        | Distilled Water / Surf       | 84 - 119    | 94 - 106    | 193 - 228   | Time Elapsed until Boiling                                                                        | (Min:sec) |
|        | Inbetween Stir and Ultra     | 70 - 100    | 69 - 102    | 197 - 225   | Sample 5                                                                                          | 5:02      |
|        | Distilled Water / Surf / CNT | 0.75 - 1.1  | 0.9 - 1.32  | 3.8 - 4.9   | Sample 6                                                                                          | 4:59      |
|        | 1st Thaw                     | -           | -           | -           | Sample 7                                                                                          | 5:31      |
|        | 2nd Thaw                     | -           | -           | -           | Sample 8                                                                                          | 5:46      |
| 6      | Distilled Water              | 140 - 180   | 92 - 150    | 298 - 326   | Freeze Time (Hours)                                                                               | 6+        |
|        | Distilled Water / Surf       | 52 - 99     | 24 - 66     | 190 - 223   | 1st Thaw Temp                                                                                     | 24 °C     |
|        | Inbetween Stir and Ultra     | -           | -           | -           |                                                                                                   |           |
|        | Distilled Water / Surf / CNT | 0.81 - 0.92 | 0.86 - 1.53 | 2.6 - 3.5   |                                                                                                   |           |
|        | 1st Thaw                     | -           | -           | -           |                                                                                                   |           |
|        | 2nd Thaw                     | -           | -           | -           |                                                                                                   |           |
| 7      | Distilled Water              | 254 - 284   | 86 - 146    | 296 - 335   |                                                                                                   |           |
|        | Distilled Water / Surf       | 51 - 92     | 41 - 97     | 198 - 245   |                                                                                                   |           |
|        | Inbetween Stir and Ultra     | 76 - 107    | 25 - 81     | 190 - 234   | - Conductivity Test inbetween Mech Stir and Ultrasonication Test not conducted due to human error |           |
|        | Distilled Water / Surf / CNT | 0.56 - 0.62 | 0.78 - 0.84 | 0.98 - 1.26 |                                                                                                   |           |
|        | 1st Thaw                     | -           | -           | -           |                                                                                                   |           |
| 8      | Distilled Water              | 223 - 283   | 84 - 142    | 302 - 343   | - Heavy agglomeration in all samples after first thaw. Testing Discontinued.                      |           |
|        | Distilled Water / Surf       | 41 - 98     | 95 - 120    | 197 - 232   |                                                                                                   |           |
|        | Inbetween Stir and Ultra     | 49 - 96     | 22 - 79     | 183 - 228   |                                                                                                   |           |
|        | Distilled Water / Surf / CNT | 0.90 - 0.97 | 1.2 - 1.46  | 2.56 - 7.1  |                                                                                                   |           |
|        | 1st Thaw                     | -           | -           | -           |                                                                                                   |           |

### Measurement Explanation

- All Resistances in kΩ
- 10 sec Elapsed for Recorded Readings
  - First Number - Initial Reading when leads were clamped
  - Second Number - Reading when 10 seconds elapsed
  - All readings increased - Capacitive effects
- Mechanical Stirring for 30 min prior to Ultrasonication
- Ultrasonication only conducted for solutions with CNT's

| Loading              | Weight % | Dimension |
|----------------------|----------|-----------|
| Surfactant           | 3.0      | 0.618 mL  |
| CNT Type             | 0.5      | 0.1005 g  |
| Volume of Dist Water | -        | 20 mL     |

THIS PAGE INTENTIONALLY LEFT BLANK

## APPENDIX D. PROBE ASSEMBLY—BAMBOO MULTI-WALL CARBON NANOTUBE RESISTANCE MEASUREMENTS

| Sample | Solution                     | A - B      | B - C      | A - C      | General Notes                                                                                                             |          |
|--------|------------------------------|------------|------------|------------|---------------------------------------------------------------------------------------------------------------------------|----------|
| 1      | Distilled Water              | 78 - 160   | 77 - 128   | 138 - 175  | Ultrasonication Power                                                                                                     | 39 Watts |
|        | Distilled Water / Surf       | 71 - 122   | 68 - 97    | 75 - 128   | Time Elapsed until Boiling (Min:sec)                                                                                      | 5:03     |
|        | Distilled Water / Surf / CNT | 5.5 - 6.2  | 4.9 - 5.7  | 5.9 - 7.3  | Freeze Temp                                                                                                               | -14°C    |
|        | First Thaw                   | -          | -          | -          | Freeze Time (Hours)                                                                                                       | 6        |
| 3      | Distilled Water              | 105 - 181  | 78 - 170   | 296 - 334  | 1st Thaw Temp                                                                                                             | 23°C     |
|        | Distilled Water / Surf       | 69 - 120   | 91-112     | 103 - 136  | - Heavy Agglomeration noticed at end of 1st Thaw, conductivity tests not conducted.<br>- CNT precipitated out of solution |          |
|        | Distilled Water / Surf / CNT | 6.7 - 12.7 | 8.4 - 12.2 | 8.9 - 11.8 |                                                                                                                           |          |
|        | First Thaw                   | -          | -          | -          |                                                                                                                           |          |
| Sample | Solution                     | A - B      | B - C      | A - C      | General Notes                                                                                                             |          |
| 2      | Distilled Water              | 123 - 187  | 109 - 169  | 297 - 341  | Ultrasonication Power                                                                                                     | 15 Watts |
|        | Distilled Water / Surf       | 81 - 121   | 49 - 99    | 102 - 133  | Time Elapsed until Boiling (Min:sec)                                                                                      | No Boil  |
|        | Distilled Water / Surf / CNT | 31 - 41    | 32 - 40    | 37 - 39    | Freeze Temp                                                                                                               | -14°C    |
|        | First Thaw                   | -          | -          | -          | Freeze Time (Hours)                                                                                                       | 6        |
| 4      | Distilled Water              | 145 - 199  | 82 - 176   | 272 - 350  | 1st Thaw Temp                                                                                                             | 23°C     |
|        | Distilled Water / Surf       | 38 - 92    | 93 - 108   | 103 - 124  | - Heavy Agglomeration noticed at end of 1st Thaw, conductivity tests not conducted.<br>- CNT precipitated out of solution |          |
|        | Distilled Water / Surf / CNT | 21 - 35    | 39 - 47    | 29 - 48    |                                                                                                                           |          |
|        | First Thaw                   | -          | -          | -          |                                                                                                                           |          |

### Measurement Explanation

- All Resistances in kΩ
- 10 sec Elapsed for Recorded Readings
  - First Number - Initial Reading when leads were clamped
  - Second Number - Reading when 10 seconds elapsed
  - All readings increased - Capacitive effects
- Mechanical Stirring for 30 min prior to Ultrasonication
- Ultrasonication only conducted for solutions with CNT's

| <u>Loading</u>       | <u>Weight %</u> | <u>Dimension</u> |
|----------------------|-----------------|------------------|
| Surfactant           | 3.0             | 0.618 mL         |
| CNT Type             | 0.5             | 0.1005 g         |
| Volume of Dist Water | -               | 20 mL            |

THIS PAGE INTENTIONALLY LEFT BLANK

## APPENDIX E. LUNA INNOVATION NANOFLUID SURFACE AND BOTTOM RESISTANCE MEASUREMENTS

| Surface Resistance (k $\Omega$ ) |         |         |         |         |         |         |
|----------------------------------|---------|---------|---------|---------|---------|---------|
| Insertion                        | LnW-402 | LnW-403 | LnW-404 | LnW-405 | LnW-406 | LnW-407 |
| 1                                | 11.6    | 11.7    | 9.9     | 5.2     | 6.9     | 8.1     |
| 2                                | 10.8    | 11.4    | 10.1    | 5.7     | 7.3     | 10.1    |
| 3                                | 10.8    | 11.2    | 12.2    | 5.8     | 9.3     | 9.7     |
| 4                                | 11.2    | 10.0    | 9.6     | 5.9     | 6.9     | 10.2    |
| 5                                | 11.7    | 10.2    | 10.3    | 6.3     | 7.1     | 9.6     |
| 6                                | 10.2    | 10.8    | 9.8     | 5.5     | 9.2     | 8.8     |
| 7                                | 10.1    | 11.3    | 12.1    | 6.0     | 7.4     | 11.5    |
| 8                                | 11.4    | 10.7    | 9.9     | 5.7     | 12.2    | 8.7     |
| 9                                | 13.2    | 11.4    | 10.5    | 5.8     | 7.0     | 9.6     |
| 10                               | 10.3    | 12.8    | 10.1    | 5.3     | 8.2     | 8.3     |
| 11                               | 10.4    | 10.5    | 10.3    | 5.1     | 11.3    | 9.0     |
| 12                               | 11.3    | 11.1    | 9.9     | 6.3     | 8.6     | 10.0    |
| 13                               | 10.5    | 11.3    | 9.8     | 6.8     | 10.6    | 8.7     |
| 14                               | 12.8    | 11.0    | 9.9     | 6.1     | 7.1     | 7.9     |
| 15                               | 10.9    | 11.1    | 10.5    | 5.9     | 7.7     | 8.4     |
| Mean                             | 11.15   | 11.10   | 10.33   | 5.83    | 8.45    | 9.24    |
| Std Dev                          | 0.91    | 0.66    | 0.79    | 0.45    | 1.73    | 0.98    |

| Bottom Resistance(k $\Omega$ ) |         |         |         |         |         |         |
|--------------------------------|---------|---------|---------|---------|---------|---------|
| Insertion                      | LnW-402 | LnW-403 | LnW-404 | LnW-405 | LnW-406 | LnW-407 |
| 1                              | 8.3     | 7.5     | 6.1     | 4.4     | 5.5     | 6.2     |
| 2                              | 8.1     | 7.5     | 6.6     | 4.2     | 5.3     | 5.9     |
| 3                              | 7.8     | 8.1     | 6.0     | 3.8     | 4.8     | 6.4     |
| 4                              | 8.2     | 7.0     | 6.4     | 3.9     | 4.9     | 6.0     |
| 5                              | 7.9     | 7.3     | 6.6     | 3.9     | 5.0     | 5.7     |
| 6                              | 8.0     | 6.7     | 6.5     | 4.1     | 4.9     | 5.9     |
| 7                              | 7.4     | 6.8     | 6.2     | 3.8     | 4.5     | 6.1     |
| 8                              | 8.0     | 7.1     | 6.3     | 3.9     | 4.7     | 5.0     |
| 9                              | 8.2     | 7.3     | 5.9     | 4.0     | 5.1     | 6.1     |
| 10                             | 7.9     | 7.0     | 6.4     | 3.7     | 4.6     | 5.5     |
| 11                             | 8.2     | 7.3     | 6.2     | 3.6     | 4.7     | 5.8     |
| 12                             | 7.4     | 7.1     | 6.1     | 3.9     | 5.0     | 5.6     |
| 13                             | 7.6     | 6.4     | 6.2     | 3.6     | 4.6     | 5.7     |
| 14                             | 7.5     | 6.6     | 6.0     | 4.1     | 5.1     | 5.1     |
| 15                             | 7.7     | 7.0     | 6.4     | 3.7     | 4.8     | 6.0     |
| Mean                           | 7.88    | 7.11    | 6.26    | 3.91    | 4.90    | 5.80    |
| Std Dev                        | 0.30    | 0.42    | 0.22    | 0.23    | 0.28    | 0.39    |



THIS PAGE INTENTIONALLY LEFT BLANK

## APPENDIX F. MULTIMETER LEAD ORIENTATION RESISTANCE MEASUREMENTS

\* All Resistances in kilo-ohm

| Sample | Trial | 0°  | 90° | 180° | 270° |
|--------|-------|-----|-----|------|------|
| 402    | 1     | 7.8 | 7.9 | 7.8  | 7.6  |
|        | 2     | 7.6 | 7.8 | 7.8  | 7.5  |
|        | 3     | 7.7 | 7.4 | 7.4  | 7.5  |
| 405    | 1     | 4.7 | 4.7 | 4.6  | 4.5  |
|        | 2     | 4.0 | 3.7 | 3.8  | 3.8  |
|        | 3     | 3.8 | 3.6 | 3.8  | 3.9  |

THIS PAGE INTENTIONALLY LEFT BLANK

## APPENDIX G. NAVAL POSTGRADUATE SCHOOL NANOFUID RESISTANCE MEASUREMENTS

| MWCNT - LDS vs. Igepal Initial Testing<br>(ICE BATH DURING U/S)                                                                                                                          |                 |          |         |                                                      |             |             |             |             |                                                       |          |         |             |             |             |             |             |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------|----------|---------|------------------------------------------------------|-------------|-------------|-------------|-------------|-------------------------------------------------------|----------|---------|-------------|-------------|-------------|-------------|-------------|
| 0.2% CNT<br>3.0% Surf                                                                                                                                                                    | Sample #1 - LDS |          |         |                                                      |             |             |             |             | Sample #2 - Igepal                                    |          |         |             |             |             |             |             |
|                                                                                                                                                                                          | DW<br>(MΩ)      | DW / LDS | Initial | 1st<br>Thaw                                          | 2nd<br>Thaw | 3rd<br>Thaw | 4th<br>Thaw | 5th<br>Thaw | DW<br>(MΩ)                                            | DW / Ige | Initial | 1st<br>Thaw | 2nd<br>Thaw | 3rd<br>Thaw | 4th<br>Thaw | 5th<br>Thaw |
| 1                                                                                                                                                                                        | 0.33            | 12.3     | 14.1    | 8.1                                                  | 9.7         | 6.7         | 7.2         | 8.4         | 0.29                                                  | 32.8     | 32.8    | 25.9        | 27.1        | 34.4        | 28.4        | 26.7        |
| 2                                                                                                                                                                                        | 0.36            | 12.1     | 16.7    | 9.5                                                  | 8.8         | 6.2         | 6.4         | 6.7         | 0.14                                                  | 34.3     | 38.6    | 27.9        | 34.6        | 30.0        | 34.4        | 25.6        |
| 3                                                                                                                                                                                        | 0.37            | 12.4     | 14.8    | 9.6                                                  | 9.0         | 6.1         | 6.1         | 9.1         | 0.22                                                  | 38.9     | 39.6    | 27.1        | 31.0        | 24.5        | 23.8        | 34.5        |
| 4                                                                                                                                                                                        | 0.36            | 13.4     | 11.5    | 10.1                                                 | 8.0         | 6.7         | 5.9         | 4.8         | 0.11                                                  | 38.2     | 36.0    | 29.2        | 42.1        | 25.3        | 28.8        | 21.4        |
| 5                                                                                                                                                                                        | 0.42            | 13.6     | 12.8    | 9.1                                                  | 8.6         | 5.9         | 5.4         | 5.5         | 0.20                                                  | 41.9     | 39.5    | 35.6        | 35.7        | 34.0        | 34.7        | 23.4        |
| 6                                                                                                                                                                                        | 0.33            | 14.4     | 10.1    | 8.0                                                  | 8.7         | 8.8         | 7.1         | 6.3         | 0.18                                                  | 42.5     | 40.0    | 36.7        | 30.4        | 28.0        | 28.5        | 24.1        |
| 7                                                                                                                                                                                        | 0.30            | 14.7     | 11.6    | 7.4                                                  | 9.2         | 7.8         | 6.6         | 6.7         | 0.21                                                  | 36.3     | 34.6    | 31.7        | 28.6        | 33.7        | 28.0        | 25.3        |
| 8                                                                                                                                                                                        | 0.34            | 14.0     | 11.4    | 7.0                                                  | 7.9         | 6.5         | 7.1         | 7.3         | 0.22                                                  | 32.4     | 42.2    | 34.5        | 29.7        | 31.2        | 31.5        | 22.6        |
| 9                                                                                                                                                                                        | 0.32            | 13.5     | 12.6    | 7.2                                                  | 8.0         | 7.4         | 7.3         | 7.8         | 0.25                                                  | 39.6     | 35.0    | 31.5        | 29.1        | 28.5        | 31.3        | 23.1        |
| 10                                                                                                                                                                                       | 0.32            | 12.1     | 10.6    | 8.0                                                  | 7.1         | 7.2         | 5.7         | 3.9         | 0.12                                                  | 39.8     | 36.9    | 26.2        | 32.5        | 24.6        | 30.9        | 30.8        |
| 11                                                                                                                                                                                       | 0.34            | 12.4     | 10.4    | 9.1                                                  | 7.5         | 7.9         | 5.1         | 6.6         | 0.17                                                  | 44.1     | 36.6    | 27.5        | 30.3        | 25.3        | 35.5        | 23.1        |
| 12                                                                                                                                                                                       | 0.39            | 14.3     | 10.0    | 6.6                                                  | 8.0         | 6.0         | 8.5         | 7.0         | 0.21                                                  | 40.5     | 42.3    | 31.9        | 33.1        | 34.1        | 33.4        | 28.0        |
| 13                                                                                                                                                                                       | 0.31            | 13.7     | 12.9    | 7.0                                                  | 8.1         | 6.9         | 7.4         | 9.3         | 0.13                                                  | 40.6     | 39.4    | 32.5        | 27.1        | 28.4        | 32.9        | 32.0        |
| 14                                                                                                                                                                                       | 0.33            | 14.1     | 12.3    | 11.1                                                 | 8.6         | 7.4         | 8.7         | 8.3         | 0.16                                                  | 44.1     | 34.7    | 26.5        | 28.4        | 37.0        | 29.2        | 25.4        |
| 15                                                                                                                                                                                       | 0.33            | 15.1     | 11.8    | 10.1                                                 | 9.3         | 7.1         | 6.5         | 9.3         | 0.18                                                  | 38.3     | 37.5    | 30.7        | 29.1        | 34.9        | 33.2        | 30.5        |
| Mean                                                                                                                                                                                     | 0.34            | 13.47    | 12.24   | 8.53                                                 | 8.43        | 6.97        | 6.73        | 7.13        | 0.19                                                  | 38.95    | 37.71   | 30.36       | 31.25       | 30.26       | 30.97       | 26.43       |
| Std Dev                                                                                                                                                                                  | 0.03            | 1.00     | 1.86    | 1.38                                                 | 0.71        | 0.81        | 1.04        | 1.62        | 0.05                                                  | 3.69     | 2.83    | 3.52        | 3.93        | 4.24        | 3.18        | 3.91        |
| <b>Notes</b><br>- Hollow MWCNT, 20 mL Sample<br>- All Resistances in k-Ohm<br>- Ultrasonicated at 15W for 15 Min, Sample at 21°C<br>- 0.2% vol CNT (0.04 g)<br>- 3.0% Surfactant (0.6 g) |                 |          |         |                                                      |             |             |             |             |                                                       |          |         |             |             |             |             |             |
|                                                                                                                                                                                          |                 |          |         | 1st Thaw - Light Sediment at bottom                  |             |             |             |             | 1st Thaw - Light Sediment at bottom                   |          |         |             |             |             |             |             |
|                                                                                                                                                                                          |                 |          |         | 2nd Thaw - Small Agglomerates and Sediment at Bottom |             |             |             |             | 2nd Thaw - Small Agglomerates and Sediment at Bottom  |          |         |             |             |             |             |             |
|                                                                                                                                                                                          |                 |          |         | 3rd Thaw - Small Agglomerates and Sediment at Bottom |             |             |             |             | 3rd Thaw - Small Agglomerates and Sediment at Bottom  |          |         |             |             |             |             |             |
|                                                                                                                                                                                          |                 |          |         | 4th Thaw - Small Agglomerates and Sediment at Bottom |             |             |             |             | 4th Thaw - Medium Agglomerates and Sediment           |          |         |             |             |             |             |             |
|                                                                                                                                                                                          |                 |          |         | 5th Thaw - Small Agglomerates and Sediment at Bottom |             |             |             |             | 5th Thaw - Medium and Large Agglomerates and Sediment |          |         |             |             |             |             |             |

| SWCNT - LDS vs. Igepal Initial Testing<br>(ICE BATH DURING U/S) |                 |          |         |                                                      |             |             |             |             |                                                 |         |         |             |             |             |                                                |             |  |
|-----------------------------------------------------------------|-----------------|----------|---------|------------------------------------------------------|-------------|-------------|-------------|-------------|-------------------------------------------------|---------|---------|-------------|-------------|-------------|------------------------------------------------|-------------|--|
| 0.2% CNT<br>3.0% Surf                                           | Sample #3 - LDS |          |         |                                                      |             |             |             |             | Sample #4 - Igepal                              |         |         |             |             |             |                                                |             |  |
|                                                                 | DW<br>(MΩ)      | DW / LDS | Initial | 1st<br>Thaw                                          | 2nd<br>Thaw | 3rd<br>Thaw | 4th<br>Thaw | 5th<br>Thaw | DW<br>(MΩ)                                      | DW/ Ige | Initial | 1st<br>Thaw | 2nd<br>Thaw | 3rd<br>Thaw | 4th<br>Thaw                                    | 5th<br>Thaw |  |
| 1                                                               | 0.23            | 9.3      | 6.3     | 10.4                                                 | 10.5        | 6.9         | 6.9         | 5.7         | 0.21                                            | 29.9    | 31.8    | 25.2        | 27.1        | 29.9        | Sample Unstable<br><br>Testing<br>Discontinued |             |  |
| 2                                                               | 0.32            | 12.0     | 6.5     | 6.4                                                  | 11.5        | 8.5         | 6.7         | 5.3         | 0.22                                            | 33.0    | 35.5    | 29.1        | 27.2        | 29.6        |                                                |             |  |
| 3                                                               | 0.22            | 12.5     | 7.1     | 7.1                                                  | 7.2         | 7.8         | 5.6         | 4.5         | 0.26                                            | 37.6    | 32.0    | 29.7        | 29.9        | 28.7        |                                                |             |  |
| 4                                                               | 0.28            | 14.6     | 6.0     | 7.7                                                  | 10.2        | 6.5         | 8.6         | 5.2         | 0.24                                            | 36.5    | 41.3    | 30.8        | 33.2        | 32.2        |                                                |             |  |
| 5                                                               | 0.21            | 15.1     | 6.4     | 9.4                                                  | 9.3         | 6.0         | 7.8         | 5.9         | 0.23                                            | 38.5    | 36.6    | 31.0        | 31.6        | 22.1        |                                                |             |  |
| 6                                                               | 0.22            | 14.0     | 5.3     | 7.2                                                  | 10.6        | 7.4         | 8.2         | 7.2         | 0.30                                            | 39.6    | 30.7    | 29.4        | 29.2        | 23.7        |                                                |             |  |
| 7                                                               | 0.25            | 15.3     | 5.5     | 8.5                                                  | 9.9         | 8.3         | 8.7         | 8.0         | 0.28                                            | 37.0    | 42.4    | 29.5        | 30.6        | 25.8        |                                                |             |  |
| 8                                                               | 0.24            | 12.6     | 5.7     | 9.1                                                  | 10.1        | 8.1         | 8.1         | 8.5         | 0.21                                            | 31.2    | 41.7    | 30.3        | 35.0        | 27.9        |                                                |             |  |
| 9                                                               | 0.19            | 14.5     | 6.3     | 10.5                                                 | 10.2        | 10.0        | 7.9         | 9.3         | 0.19                                            | 33.1    | 35.0    | 32.5        | 29.2        | 30.1        |                                                |             |  |
| 10                                                              | 0.28            | 15.8     | 5.8     | 11.1                                                 | 9.4         | 8.5         | 8.7         | 7.6         | 0.31                                            | 34.7    | 43.1    | 31.7        | 31.8        | 30.4        |                                                |             |  |
| 11                                                              | 0.23            | 12.2     | 5.7     | 7.5                                                  | 11.0        | 7.1         | 8.9         | 9.0         | 0.24                                            | 34.0    | 37.8    | 33.7        | 29.6        | 29.4        |                                                |             |  |
| 12                                                              | 0.22            | 14.7     | 6.0     | 8.5                                                  | 11.2        | 11.5        | 9.6         | 8.0         | 0.22                                            | 35.5    | 42.5    | 33.0        | 30.0        | 28.0        |                                                |             |  |
| 13                                                              | 0.20            | 14.1     | 6.3     | 9.6                                                  | 10.6        | 10.6        | 9.8         | 7.8         | 0.23                                            | 34.8    | 35.0    | 30.2        | 30.3        | 32.7        |                                                |             |  |
| 14                                                              | 0.18            | 13.0     | 5.2     | 9.9                                                  | 10.4        | 9.1         | 9.3         | 8.6         | 0.22                                            | 35.1    | 29.9    | 30.8        | 27.4        | 30.6        |                                                |             |  |
| 15                                                              | 0.25            | 14.6     | 6.1     | 7.5                                                  | 11.0        | 7.6         | 9.0         | 8.3         | 0.19                                            | 32.3    | 31.2    | 31.6        | 31.0        | 33.4        |                                                |             |  |
| Mean                                                            | 0.23            | 13.62    | 6.01    | 8.69                                                 | 10.21       | 8.26        | 8.25        | 7.26        | 0.24                                            | 34.86   | 36.43   | 30.57       | 30.21       | 28.97       |                                                |             |  |
| Std Dev                                                         | 0.04            | 1.69     | 0.50    | 1.44                                                 | 1.03        | 1.53        | 1.15        | 1.54        | 0.04                                            | 2.71    | 4.78    | 2.01        | 2.18        | 3.15        |                                                |             |  |
| <b>Notes</b>                                                    |                 |          |         |                                                      |             |             |             |             |                                                 |         |         |             |             |             |                                                |             |  |
| - SWCNT, 20 mL Sample                                           |                 |          |         | 1st Thaw - Light Sediment at bottom                  |             |             |             |             | 1st Thaw - Light Sediment at bottom             |         |         |             |             |             |                                                |             |  |
| - All Resistances in k-Ohm                                      |                 |          |         | 2nd Thaw - Light Sediment at bottom                  |             |             |             |             | 2nd Thaw - Light sediment at Bottom             |         |         |             |             |             |                                                |             |  |
| - Ultrasonicated at 15W for 15 Min, , Sample at 21°C            |                 |          |         | 3rd Thaw - Small Agglomerates and Sediment at Bottom |             |             |             |             | 3rd Thaw - Sample Unstable - Layered Appearance |         |         |             |             |             |                                                |             |  |
| - 0.2% vol CNT (0.04 g)                                         |                 |          |         | 4th Thaw - Small Agglomerates and Sediment at Bottom |             |             |             |             | - Heavy Sediment at Bottom                      |         |         |             |             |             |                                                |             |  |
| - 3.0% Surfactant (0.6 g)                                       |                 |          |         | 5th Thaw - Small Agglomerates and Sediment at Bottom |             |             |             |             |                                                 |         |         |             |             |             |                                                |             |  |

| MWCNT - LDS vs. Igepal Initial Testing<br>(ICE BATH DURING U/S)                                                                                                                                                                                      |                 |          |         |             |             |             |             |                                                                                                                                                                                                                                     |                    |         |         |             |             |             |             |             |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------|----------|---------|-------------|-------------|-------------|-------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------|---------|---------|-------------|-------------|-------------|-------------|-------------|
| 0.1% CNT<br>3.0% Surf                                                                                                                                                                                                                                | Sample #5 - LDS |          |         |             |             |             |             |                                                                                                                                                                                                                                     | Sample #6 - Igepal |         |         |             |             |             |             |             |
|                                                                                                                                                                                                                                                      | DW<br>(MΩ)      | DW / LDS | Initial | 1st<br>Thaw | 2nd<br>Thaw | 3rd<br>Thaw | 4th<br>Thaw | 5th<br>Thaw                                                                                                                                                                                                                         | DW<br>(MΩ)         | DW/ Ige | Initial | 1st<br>Thaw | 2nd<br>Thaw | 3rd<br>Thaw | 4th<br>Thaw | 5th<br>Thaw |
| 1                                                                                                                                                                                                                                                    | 0.26            | 9.7      | 8.9     | 8.0         | 11.1        | 10.7        | 9.2         | 5.7                                                                                                                                                                                                                                 | 0.21               | 28.2    | 34.1    | 27.8        | 24.2        | 36.0        | 23.8        | 22.0        |
| 2                                                                                                                                                                                                                                                    | 0.33            | 12.7     | 7.9     | 6.3         | 8.3         | 11.1        | 9.7         | 6.3                                                                                                                                                                                                                                 | 0.29               | 28.8    | 32.7    | 28.9        | 26.6        | 31.5        | 24.0        | 26.3        |
| 3                                                                                                                                                                                                                                                    | 0.21            | 12.9     | 8.8     | 6.5         | 7.8         | 12.1        | 7.2         | 7.5                                                                                                                                                                                                                                 | 0.33               | 29.5    | 35.7    | 35.4        | 32.5        | 28.0        | 27.2        | 23.5        |
| 4                                                                                                                                                                                                                                                    | 0.31            | 14.2     | 10.0    | 7.1         | 10.3        | 10.6        | 7.4         | 4.0                                                                                                                                                                                                                                 | 0.28               | 36.5    | 35.6    | 25.4        | 29.1        | 28.8        | 23.6        | 25.2        |
| 5                                                                                                                                                                                                                                                    | 0.40            | 15.8     | 10.1    | 7.9         | 8.6         | 9.1         | 10.2        | 6.4                                                                                                                                                                                                                                 | 0.21               | 32.1    | 39.5    | 28.6        | 29.6        | 39.9        | 24.7        | 23.9        |
| 6                                                                                                                                                                                                                                                    | 0.36            | 17.3     | 9.2     | 9.1         | 11.1        | 10.8        | 8.6         | 7.0                                                                                                                                                                                                                                 | 0.19               | 35.7    | 37.1    | 40.1        | 27.1        | 30.9        | 27.3        | 35.2        |
| 7                                                                                                                                                                                                                                                    | 0.37            | 14.2     | 9.1     | 8.0         | 9.3         | 9.8         | 8.0         | 7.8                                                                                                                                                                                                                                 | 0.20               | 35.8    | 40.4    | 28.1        | 27.9        | 29.2        | 30.9        | 20.4        |
| 8                                                                                                                                                                                                                                                    | 0.25            | 15.9     | 10.8    | 7.7         | 9.9         | 10.5        | 8.6         | 6.7                                                                                                                                                                                                                                 | 0.27               | 37.0    | 37.0    | 27.3        | 31.3        | 29.8        | 28.9        | 20.6        |
| 9                                                                                                                                                                                                                                                    | 0.26            | 16.6     | 9.6     | 8.1         | 10.0        | 8.6         | 7.8         | 8.1                                                                                                                                                                                                                                 | 0.23               | 34.3    | 40.1    | 29.9        | 23.4        | 27.1        | 30.9        | 22.0        |
| 10                                                                                                                                                                                                                                                   | 0.25            | 16.4     | 9.8     | 9.2         | 11.0        | 10.8        | 8.8         | 6.6                                                                                                                                                                                                                                 | 0.20               | 36.4    | 37.5    | 28.0        | 22.6        | 32.2        | 29.7        | 24.1        |
| 11                                                                                                                                                                                                                                                   | 0.22            | 14.0     | 7.8     | 8.6         | 10.3        | 11.5        | 9.1         | 9.0                                                                                                                                                                                                                                 | 0.22               | 34.6    | 32.7    | 30.6        | 26.5        | 23.8        | 24.7        | 21.8        |
| 12                                                                                                                                                                                                                                                   | 0.20            | 17.0     | 11.3    | 7.5         | 10.8        | 8.8         | 9.0         | 8.0                                                                                                                                                                                                                                 | 0.28               | 41.2    | 34.7    | 28.5        | 25.0        | 33.4        | 27.8        | 26.1        |
| 13                                                                                                                                                                                                                                                   | 0.28            | 15.9     | 10.4    | 10.5        | 10.2        | 8.9         | 9.4         | 8.6                                                                                                                                                                                                                                 | 0.21               | 39.0    | 36.6    | 27.8        | 28.0        | 29.8        | 31.8        | 25.0        |
| 14                                                                                                                                                                                                                                                   | 0.29            | 15.5     | 9.8     | 7.9         | 8.5         | 9.5         | 9.1         | 7.0                                                                                                                                                                                                                                 | 0.19               | 40.5    | 39.1    | 34.7        | 34.0        | 29.6        | 31.3        | 29.9        |
| 15                                                                                                                                                                                                                                                   | 0.25            | 16.3     | 11.3    | 8.7         | 10.6        | 9.9         | 8.2         | 8.9                                                                                                                                                                                                                                 | 0.22               | 38.8    | 35.2    | 31.6        | 32.6        | 28.1        | 33.2        | 24.4        |
| Mean                                                                                                                                                                                                                                                 | 0.28            | 14.96    | 9.65    | 8.07        | 9.85        | 10.18       | 8.69        | 7.17                                                                                                                                                                                                                                | 0.24               | 35.23   | 36.53   | 30.18       | 28.03       | 30.54       | 24.70       | 24.69       |
| Std Dev                                                                                                                                                                                                                                              | 0.06            | 2.04     | 1.07    | 1.07        | 1.09        | 1.05        | 0.84        | 1.33                                                                                                                                                                                                                                | 0.04               | 4.07    | 2.49    | 3.84        | 3.49        | 3.83        | 3.26        | 3.81        |
| <b>Notes</b><br>- Hollow MWCNT, 20 mL Sample<br>- All Resistances in k-Ohm<br>- Ultrasonicated at 15W for 15 Min, , Sample at 21°C<br>- 0.1% vol CNT (0.02 g)<br>- 3.0% Surfactant (0.6 g)                                                           |                 |          |         |             |             |             |             |                                                                                                                                                                                                                                     |                    |         |         |             |             |             |             |             |
| 1st Thaw - Small Agglomerates at bottom<br>2nd Thaw - Small Agglomerates at bottom<br>3rd Thaw - Small Agglomerates at bottom<br>4th Thaw - Medium and Small Agglomerates and Suspensions<br>5th Thaw - Large Agglomerates and Suspensions at Bottom |                 |          |         |             |             |             |             | 1st Thaw - Light Sediment at Bottom<br>2nd Thaw - Very small agglomerates at Bottom<br>3rd Thaw - Very small agglomerates at Bottom<br>4th Thaw - Very small agglomerates at Bottom<br>5th Thaw - Very small agglomerates at Bottom |                    |         |         |             |             |             |             |             |

| SWCNT - LDS vs. Igepal Initial Testing<br>(ICE BATH DURING U/S) |                 |          |         |                                     |             |             |             |             |                                                 |                    |         |             |             |             |                                                |             |  |  |
|-----------------------------------------------------------------|-----------------|----------|---------|-------------------------------------|-------------|-------------|-------------|-------------|-------------------------------------------------|--------------------|---------|-------------|-------------|-------------|------------------------------------------------|-------------|--|--|
| 0.1% CNT<br>3.0% Surf                                           | Sample #7 - LDS |          |         |                                     |             |             |             |             |                                                 | Sample #8 - Igepal |         |             |             |             |                                                |             |  |  |
|                                                                 | DW<br>(MΩ)      | DW / LDS | Initial | 1st<br>Thaw                         | 2nd<br>Thaw | 3rd<br>Thaw | 4th<br>Thaw | 5th<br>Thaw | DW<br>(MΩ)                                      | DW/ Ige            | Initial | 1st<br>Thaw | 2nd<br>Thaw | 3rd<br>Thaw | 4th<br>Thaw                                    | 5th<br>Thaw |  |  |
| 1                                                               | 0.21            | 9.2      | 5.5     | 12.9                                | 12.2        | 9.5         | 7.1         | 7.1         | 0.25                                            | 28.2               | 43.0    | 27.4        | 30.4        | 25.5        | Sample Unstable<br><br>Testing<br>Discontinued |             |  |  |
| 2                                                               | 0.19            | 11.3     | 5.2     | 12.0                                | 12.9        | 9.3         | 9.6         | 7.7         | 0.26                                            | 32.2               | 45.9    | 30.2        | 26.7        | 25.3        |                                                |             |  |  |
| 3                                                               | 0.25            | 12.0     | 6.0     | 14.5                                | 9.7         | 9.4         | 7.9         | 7.1         | 0.30                                            | 31.3               | 44.2    | 29.5        | 28.7        | 29.9        |                                                |             |  |  |
| 4                                                               | 0.18            | 12.4     | 6.3     | 13.6                                | 11.3        | 9.8         | 9.2         | 7.5         | 0.29                                            | 37.0               | 39.2    | 27.8        | 26.5        | 22.6        |                                                |             |  |  |
| 5                                                               | 0.19            | 12.2     | 5.8     | 12.3                                | 12.1        | 9.7         | 10.2        | 7.7         | 0.32                                            | 33.0               | 45.7    | 29.2        | 24.7        | 25.0        |                                                |             |  |  |
| 6                                                               | 0.26            | 11.4     | 5.4     | 13.1                                | 11.1        | 10.6        | 8.8         | 9.3         | 0.25                                            | 38.5               | 41.8    | 32.2        | 29.3        | 26.4        |                                                |             |  |  |
| 7                                                               | 0.27            | 14.8     | 5.7     | 9.7                                 | 12.4        | 11.2        | 6.1         | 9.0         | 0.24                                            | 33.4               | 35.2    | 34.8        | 27.4        | 23.8        |                                                |             |  |  |
| 8                                                               | 0.19            | 13.9     | 4.9     | 12.9                                | 13.0        | 11.1        | 8.3         | 9.1         | 0.28                                            | 33.9               | 37.0    | 33.8        | 29.1        | 25.9        |                                                |             |  |  |
| 9                                                               | 0.20            | 13.6     | 5.4     | 9.6                                 | 11.9        | 11.3        | 9.7         | 8.5         | 0.29                                            | 31.9               | 41.7    | 29.2        | 26.8        | 26.8        |                                                |             |  |  |
| 10                                                              | 0.22            | 17.1     | 5.7     | 10.6                                | 11.8        | 10.8        | 11.3        | 9.6         | 0.25                                            | 32.8               | 33.5    | 27.6        | 29.5        | 22.1        |                                                |             |  |  |
| 11                                                              | 0.19            | 14.0     | 4.9     | 12.1                                | 12.0        | 10.7        | 9.7         | 10.8        | 0.26                                            | 37.1               | 40.4    | 32.7        | 32.1        | 22.6        |                                                |             |  |  |
| 12                                                              | 0.20            | 16.6     | 6.4     | 13.8                                | 11.5        | 9.1         | 10.5        | 9.9         | 0.24                                            | 39.1               | 36.2    | 30.3        | 28.9        | 28.9        |                                                |             |  |  |
| 13                                                              | 0.19            | 16.7     | 6.2     | 13.1                                | 11.3        | 11.1        | 9.6         | 11.0        | 0.18                                            | 41.6               | 47.1    | 31.3        | 33.6        | 26.2        |                                                |             |  |  |
| 14                                                              | 0.29            | 14.4     | 5.1     | 11.2                                | 14.2        | 10.4        | 11.6        | 7.2         | 0.28                                            | 35.3               | 39.5    | 33.9        | 32.4        | 28.9        |                                                |             |  |  |
| 15                                                              | 0.24            | 13.5     | 5.2     | 10.9                                | 12.9        | 11.3        | 8.2         | 9.4         | 0.27                                            | 33.5               | 38.0    | 36.1        | 30.5        | 26.5        |                                                |             |  |  |
| Mean                                                            | 0.22            | 13.54    | 5.58    | 12.15                               | 12.02       | 10.35       | 9.19        | 8.73        | 0.26                                            | 34.59              | 40.56   | 31.07       | 29.11       | 25.76       |                                                |             |  |  |
| Std Dev                                                         | 0.04            | 2.21     | 0.49    | 1.48                                | 1.04        | 0.80        | 1.50        | 1.31        | 0.03                                            | 3.49               | 4.14    | 2.75        | 2.45        | 2.35        |                                                |             |  |  |
| <b>Notes</b>                                                    |                 |          |         |                                     |             |             |             |             |                                                 |                    |         |             |             |             |                                                |             |  |  |
| - SWCNT, 20 mL Sample                                           |                 |          |         | 1st Thaw - Light Sediment at Bottom |             |             |             |             | 1st Thaw - Light Sediment at Bottom             |                    |         |             |             |             |                                                |             |  |  |
| - All Resistances in k-Ohm                                      |                 |          |         | 2nd Thaw - Light Sediment at Bottom |             |             |             |             | 2nd Thaw - Heavier Sediment Layer at Bottom     |                    |         |             |             |             |                                                |             |  |  |
| - Ultrasonicated at 15W for 15 Min, , Sample at 21°C            |                 |          |         | 3rd Thaw - Light Sediment at Bottom |             |             |             |             | 3rd Thaw - Sample Unstable - Layered Appearance |                    |         |             |             |             |                                                |             |  |  |
| - 0.1% vol CNT (0.02 g)                                         |                 |          |         | 4th Thaw - Light Sediment at Bottom |             |             |             |             | - Heavy Sediment at Bottom                      |                    |         |             |             |             |                                                |             |  |  |
| - 3.0% Surfactant (0.6 g)                                       |                 |          |         | 5th Thaw - Light Sediment at Bottom |             |             |             |             |                                                 |                    |         |             |             |             |                                                |             |  |  |

| MWCNT - LDS vs. Igepal Initial Testing |                 |          |                                             |             |             |             |             |             |                     |          |                                            |             |             |             |             |             |
|----------------------------------------|-----------------|----------|---------------------------------------------|-------------|-------------|-------------|-------------|-------------|---------------------|----------|--------------------------------------------|-------------|-------------|-------------|-------------|-------------|
| 0.2% CNT<br>3.0% Surf                  | Sample #9 - LDS |          |                                             |             |             |             |             |             | Sample #10 - Igepal |          |                                            |             |             |             |             |             |
|                                        | DW<br>(MΩ)      | DW / LDS | Initial                                     | 1st<br>Thaw | 2nd<br>Thaw | 3rd<br>Thaw | 4th<br>Thaw | 5th<br>Thaw | DW<br>(MΩ)          | DW / Ige | Initial                                    | 1st<br>Thaw | 2nd<br>Thaw | 3rd<br>Thaw | 4th<br>Thaw | 5th<br>Thaw |
| 1                                      | 0.61            | 10.9     | 3.2                                         | 10.1        | 7.3         | 6.0         | 7.9         | 4.8         | 0.71                | 38.8     | 17.2                                       | 24.8        | 24.4        | 24.0        | 23.5        | 34.9        |
| 2                                      | 0.62            | 8.2      | 1.7                                         | 9.7         | 5.6         | 2.5         | 6.6         | 4.6         | 0.65                | 36.4     | 17.9                                       | 29.6        | 29.8        | 22.4        | 21.8        | 24.5        |
| 3                                      | 0.70            | 7.9      | 2.8                                         | 8.3         | 7.7         | 1.9         | 6.8         | 2.9         | 0.69                | 40.0     | 16.0                                       | 28.5        | 32.2        | 26.0        | 28.2        | 31.2        |
| 4                                      | 0.69            | 9.1      | 1.5                                         | 7.7         | 5.7         | 3.1         | 9.2         | 4.4         | 0.80                | 34.5     | 14.0                                       | 24.4        | 33.6        | 23.7        | 26.8        | 26.4        |
| 5                                      | 0.72            | 8.6      | 1.4                                         | 7.3         | 4.5         | 0.6         | 8.6         | 5.1         | 0.65                | 35.0     | 15.7                                       | 31.4        | 31.1        | 21.5        | 25.2        | 27.1        |
| 6                                      | 0.73            | 9.3      | 3.0                                         | 9.2         | 6.4         | 5.8         | 9.1         | 4.5         | 0.72                | 36.0     | 12.3                                       | 33.2        | 33.9        | 23.6        | 27.2        | 26.5        |
| 7                                      | 0.65            | 9.2      | 3.1                                         | 8.0         | 7.1         | 6.1         | 6.4         | 6.2         | 0.60                | 37.0     | 17.0                                       | 32.0        | 29.3        | 21.4        | 22.6        | 29.4        |
| 8                                      | 0.71            | 9.4      | 2.0                                         | 7.6         | 8.5         | 6.7         | 7.4         | 6.1         | 0.65                | 35.9     | 12.3                                       | 31.8        | 28.1        | 28.9        | 29.8        | 26.5        |
| 9                                      | 0.67            | 10.8     | 2.5                                         | 7.8         | 7.7         | 7.1         | 8.7         | 5.2         | 0.66                | 36.3     | 15.5                                       | 26.6        | 26.3        | 26.0        | 31.6        | 27.7        |
| 10                                     | 0.70            | 9.9      | 3.4                                         | 7.7         | 7.8         | 8.7         | 9.8         | 6.7         | 0.71                | 37.6     | 15.8                                       | 25.6        | 34.4        | 26.4        | 31.9        | 26.3        |
| 11                                     | 0.93            | 11.5     | 2.2                                         | 7.8         | 8.9         | 8.9         | 8.2         | 4.8         | 0.75                | 38.7     | 17.1                                       | 30.7        | 31.2        | 23.2        | 32.9        | 24.2        |
| 12                                     | 0.73            | 12.5     | 2.7                                         | 7.4         | 8.7         | 8.0         | 9.1         | 5.6         | 0.70                | 40.1     | 13.2                                       | 31.9        | 27.5        | 28.6        | 27.5        | 28.2        |
| 13                                     | 0.80            | 10.3     | 2.6                                         | 9.5         | 9.0         | 7.2         | 8.4         | 6.0         | 0.62                | 42.4     | 17.0                                       | 27.9        | 38.1        | 24.5        | 26.2        | 28.9        |
| 14                                     | 0.63            | 11.3     | 3.0                                         | 7.6         | 9.4         | 6.1         | 10.0        | 5.4         | 0.64                | 35.4     | 15.5                                       | 35.2        | 24.9        | 27.9        | 27.9        | 24.1        |
| 15                                     | 0.71            | 9.2      | 3.1                                         | 7.8         | 8.6         | 7.8         | 9.2         | 5.2         | 0.65                | 35.2     | 17.2                                       | 30.6        | 28.8        | 25.6        | 27.6        | 27.4        |
| Mean                                   | 0.71            | 9.87     | 2.55                                        | 8.23        | 7.53        | 5.77        | 8.36        | 5.17        | 0.68                | 37.29    | 15.58                                      | 29.61       | 30.24       | 24.91       | 27.38       | 27.55       |
| Std Dev                                | 0.08            | 1.31     | 0.64                                        | 0.92        | 1.44        | 2.56        | 1.13        | 0.93        | 0.05                | 2.27     | 1.83                                       | 3.22        | 3.80        | 2.40        | 3.29        | 2.81        |
| Notes                                  |                 |          | Max Temp during U/S - 73°C, Sample Stable   |             |             |             |             |             |                     |          | Max Temp during U/S- 73°C, Sample Stable   |             |             |             |             |             |
| - Hollow MWCNT, 20 mL Sample           |                 |          | 1st Thaw - Small Agglomerates at Bottom     |             |             |             |             |             |                     |          | 1st Thaw - Small Agglomerates at Bottom    |             |             |             |             |             |
| - All Resistances in k-Ohm, except DW  |                 |          | 2nd Thaw - Small Agglomerates at Bottom     |             |             |             |             |             |                     |          | 2nd Thaw - Small Agglomerates and Sediment |             |             |             |             |             |
| for 15 Min                             |                 |          | 3rd Thaw - Medium Agglomerates and Sediment |             |             |             |             |             |                     |          | 3rd Thaw - Large Agglomerates and Sediment |             |             |             |             |             |
| - 0.2% vol CNT (0.04 g)                |                 |          | 4th Thaw - Medium Agglomerates and Sediment |             |             |             |             |             |                     |          | 4th Thaw - Large Agglomerates and Sediment |             |             |             |             |             |
| - 3.0% Surfactant (0.6 g)              |                 |          | 5th Thaw - Medium Agglomerates and Sediment |             |             |             |             |             |                     |          | 5th Thaw - Large Agglomerates and Sediment |             |             |             |             |             |
|                                        |                 |          |                                             |             |             |             |             |             |                     |          | - Ultrasonicated at 15W                    |             |             |             |             |             |

| SWCNT - LDS vs. Igepal Initial Testing |                  |          |                                           |             |             |             |             |             |            |                     |                                                       |             |             |             |             |             |  |
|----------------------------------------|------------------|----------|-------------------------------------------|-------------|-------------|-------------|-------------|-------------|------------|---------------------|-------------------------------------------------------|-------------|-------------|-------------|-------------|-------------|--|
| 0.2% CNT<br>3.0% Surf                  | Sample #11 - LDS |          |                                           |             |             |             |             |             |            | Sample #12 - Igepal |                                                       |             |             |             |             |             |  |
|                                        | DW<br>(MΩ)       | DW / LDS | Initial                                   | 1st<br>Thaw | 2nd<br>Thaw | 3rd<br>Thaw | 4th<br>Thaw | 5th<br>Thaw | DW<br>(MΩ) | DW/ Ige             | Initial                                               | 1st<br>Thaw | 2nd<br>Thaw | 3rd<br>Thaw | 4th<br>Thaw | 5th<br>Thaw |  |
| 1                                      | 0.75             | 10.2     | 3.6                                       | 8.5         | 6.0         | 6.8         | 6.5         | 4.4         | 0.52       | 33.1                | Sample Unstable after U/S<br><br>Testing Discontinued |             |             |             |             |             |  |
| 2                                      | 0.80             | 11.1     | 3.5                                       | 8.8         | 6.5         | 5.1         | 4.3         | 9.8         | 0.55       | 34.8                |                                                       |             |             |             |             |             |  |
| 3                                      | 0.79             | 9.8      | 3.3                                       | 7.9         | 8.1         | 6.6         | 7.5         | 7.0         | 0.48       | 29.7                |                                                       |             |             |             |             |             |  |
| 4                                      | 0.67             | 12.3     | 3.7                                       | 6.4         | 8.2         | 7.2         | 7.4         | 8.6         | 0.52       | 29.1                |                                                       |             |             |             |             |             |  |
| 5                                      | 0.71             | 13.6     | 3.2                                       | 8.7         | 7.9         | 8.0         | 8.9         | 9.0         | 0.49       | 28.8                |                                                       |             |             |             |             |             |  |
| 6                                      | 0.64             | 11.5     | 3.3                                       | 7.8         | 8.3         | 8.9         | 10.5        | 8.5         | 0.48       | 30.3                |                                                       |             |             |             |             |             |  |
| 7                                      | 0.82             | 10.3     | 3.4                                       | 9.4         | 8.8         | 6.6         | 7.4         | 9.8         | 0.51       | 33.0                |                                                       |             |             |             |             |             |  |
| 8                                      | 0.75             | 12.5     | 3.6                                       | 10.0        | 8.3         | 7.5         | 7.2         | 7.2         | 0.53       | 32.4                |                                                       |             |             |             |             |             |  |
| 9                                      | 0.71             | 14.2     | 3.9                                       | 9.6         | 8.7         | 9.6         | 8.8         | 9.4         | 0.57       | 34.3                |                                                       |             |             |             |             |             |  |
| 10                                     | 0.66             | 13.6     | 3.3                                       | 10.4        | 8.3         | 12.3        | 8.5         | 9.8         | 0.49       | 33.1                |                                                       |             |             |             |             |             |  |
| 11                                     | 0.62             | 13.6     | 3.4                                       | 8.7         | 8.5         | 8.6         | 10.2        | 5.2         | 0.60       | 34.5                |                                                       |             |             |             |             |             |  |
| 12                                     | 0.65             | 13.0     | 3.7                                       | 9.1         | 9.3         | 9.5         | 11.0        | 9.6         | 0.49       | 29.9                |                                                       |             |             |             |             |             |  |
| 13                                     | 0.68             | 14.0     | 3.9                                       | 9.5         | 7.2         | 7.1         | 8.1         | 9.0         | 0.48       | 31.0                |                                                       |             |             |             |             |             |  |
| 14                                     | 0.71             | 9.7      | 3.3                                       | 10.0        | 8.2         | 9.5         | 7.5         | 9.2         | 0.52       | 28.7                |                                                       |             |             |             |             |             |  |
| 15                                     | 0.63             | 10.7     | 3.1                                       | 9.9         | 8.7         | 9.3         | 9.0         | 9.6         | 0.50       | 28.4                |                                                       |             |             |             |             |             |  |
| Mean                                   | 0.71             | 12.01    | 3.48                                      | 8.98        | 8.07        | 8.17        | 8.19        | 8.41        | 0.52       | 31.41               |                                                       |             |             |             |             |             |  |
| Std Dev                                | 0.06             | 1.62     | 0.25                                      | 1.05        | 0.88        | 1.76        | 1.69        | 1.71        | 0.04       | 2.30                |                                                       |             |             |             |             |             |  |
| Notes                                  |                  |          | Max Temp during U/S - 70°C, Sample Stable |             |             |             |             |             |            |                     | Max Temp during U/S- 74°C, Sample Unstable            |             |             |             |             |             |  |
| - SWCNT, 20 mL Sample                  |                  |          | 1st Thaw - Light Sediment at bottom       |             |             |             |             |             |            |                     | - Layered Separation after U/S -> Heavy sediment      |             |             |             |             |             |  |
| - All Resistances in k-Ohm, except DW  |                  |          | 2nd Thaw - Light Sediment at bottom       |             |             |             |             |             |            |                     | at bottom with small agglomerates                     |             |             |             |             |             |  |
| - Ultrasonicated at 15W for 15 Min     |                  |          | 3rd Thaw - Light Sediment at bottom       |             |             |             |             |             |            |                     |                                                       |             |             |             |             |             |  |
| - 0.2% vol CNT (0.04 g)                |                  |          | 4th Thaw - Light Sediment at bottom       |             |             |             |             |             |            |                     |                                                       |             |             |             |             |             |  |
| - 3.0% Surfactant (0.6 g)              |                  |          | 5th Thaw - Light Sediment at bottom       |             |             |             |             |             |            |                     |                                                       |             |             |             |             |             |  |

| MWCNT - LDS vs. Igepal Initial Testing |                  |          |                                           |             |             |             |             |             |                                              |         |         |             |             |             |             |             |
|----------------------------------------|------------------|----------|-------------------------------------------|-------------|-------------|-------------|-------------|-------------|----------------------------------------------|---------|---------|-------------|-------------|-------------|-------------|-------------|
| 0.1% CNT<br>3.0% Surf                  | Sample #13 - LDS |          |                                           |             |             |             |             |             | Sample #14 - Igepal                          |         |         |             |             |             |             |             |
|                                        | DW<br>(MΩ)       | DW / LDS | Initial                                   | 1st<br>Thaw | 2nd<br>Thaw | 3rd<br>Thaw | 4th<br>Thaw | 5th<br>Thaw | DW<br>(MΩ)                                   | DW/ Ige | Initial | 1st<br>Thaw | 2nd<br>Thaw | 3rd<br>Thaw | 4th<br>Thaw | 5th<br>Thaw |
| 1                                      | 0.63             | 9.9      | 4.2                                       | 10.6        | 6.6         | 6.4         | 5.0         | 7.7         | 0.65                                         | 32.2    | 10.5    | 30.0        | 23.3        | 20.3        | 25.9        | 28.8        |
| 2                                      | 0.66             | 7.1      | 5.1                                       | 10.2        | 6.8         | 5.5         | 6.5         | 9.1         | 0.67                                         | 28.4    | 9.8     | 27.7        | 18.8        | 25.6        | 33.3        | 27.5        |
| 3                                      | 0.71             | 9.8      | 4.8                                       | 7.3         | 8.0         | 7.1         | 5.8         | 9.8         | 0.61                                         | 28.5    | 10.6    | 32.6        | 24.7        | 21.1        | 29.5        | 37.5        |
| 4                                      | 0.56             | 8.4      | 5.3                                       | 7.8         | 7.5         | 12.1        | 6.6         | 7.9         | 0.60                                         | 33.4    | 11.1    | 31.2        | 26.6        | 24.9        | 34.9        | 32.5        |
| 5                                      | 0.55             | 8.9      | 3.7                                       | 9.5         | 8.8         | 8.6         | 8.3         | 9.5         | 0.59                                         | 31.7    | 14.3    | 29.7        | 23.1        | 26.2        | 28.2        | 29.3        |
| 6                                      | 0.59             | 9.2      | 5.5                                       | 8.0         | 9.5         | 6.2         | 7.2         | 10.4        | 0.71                                         | 33.8    | 12.3    | 27.6        | 24.6        | 31.3        | 34.5        | 27.1        |
| 7                                      | 0.68             | 9.4      | 4.8                                       | 7.1         | 6.1         | 6.1         | 8.6         | 8.9         | 0.69                                         | 32.1    | 12.7    | 28.8        | 26.9        | 27.4        | 26.4        | 36.2        |
| 8                                      | 0.62             | 8.6      | 3.6                                       | 8.9         | 7.1         | 8.0         | 10.3        | 8.8         | 0.68                                         | 29.3    | 12.3    | 29.6        | 25.6        | 19.4        | 32.0        | 35.3        |
| 9                                      | 0.57             | 9.3      | 4.0                                       | 8.0         | 9.2         | 7.4         | 9.3         | 12.4        | 0.62                                         | 36.8    | 12.1    | 33.3        | 27.6        | 22.7        | 34.4        | 32.4        |
| 10                                     | 0.54             | 10.0     | 4.7                                       | 7.7         | 8.9         | 6.8         | 9.1         | 11.0        | 0.65                                         | 34.7    | 10.9    | 27.8        | 29.1        | 30.7        | 31.7        | 28.0        |
| 11                                     | 0.61             | 9.9      | 4.8                                       | 7.6         | 9.5         | 5.4         | 7.2         | 9.0         | 0.63                                         | 35.7    | 11.9    | 27.0        | 25.0        | 29.4        | 28.6        | 29.1        |
| 12                                     | 0.70             | 8.4      | 6.0                                       | 8.5         | 8.5         | 7.5         | 7.1         | 10.4        | 0.70                                         | 36.8    | 13.6    | 28.4        | 27.2        | 27.3        | 33.0        | 31.5        |
| 13                                     | 0.68             | 7.8      | 5.1                                       | 8.1         | 8.7         | 8.8         | 10.5        | 12.4        | 0.69                                         | 32.4    | 12.9    | 27.6        | 29.3        | 23.8        | 31.9        | 27.8        |
| 14                                     | 0.55             | 8.8      | 4.8                                       | 7.9         | 8.3         | 5.6         | 8.1         | 11.8        | 0.59                                         | 30.1    | 12.1    | 30.8        | 23.2        | 24.0        | 25.8        | 32.1        |
| 15                                     | 0.59             | 9.0      | 2.9                                       | 8.2         | 9.1         | 6.2         | 8.7         | 10.8        | 0.63                                         | 32.3    | 13.3    | 32.5        | 28.3        | 31.8        | 31.7        | 33.8        |
| Mean                                   | 0.62             | 8.97     | 4.62                                      | 8.36        | 8.17        | 7.18        | 7.89        | 9.99        | 0.65                                         | 32.55   | 12.03   | 29.64       | 25.55       | 25.73       | 30.79       | 31.26       |
| Std Dev                                | 0.06             | 0.82     | 0.81                                      | 1.02        | 1.10        | 1.73        | 1.59        | 1.49        | 0.04                                         | 2.73    | 1.26    | 2.05        | 2.78        | 3.96        | 3.17        | 3.36        |
| <b>Notes</b>                           |                  |          | Max Temp during U/S - 72°C, Sample Stable |             |             |             |             |             | Max Temp during U/S- 77°C, Sample Stable     |         |         |             |             |             |             |             |
| - Hollow MWCNT, 20 mL Sample           |                  |          | 1st Thaw - Small Agglomerates at Bottom   |             |             |             |             |             | 1st Thaw - Very Small Agglomerates at Bottom |         |         |             |             |             |             |             |
| - All Resistances in k-Ohm, except DW  |                  |          | 2nd Thaw - Small Agglomerates at Bottom   |             |             |             |             |             | 2nd Thaw - Small Agglomerates at Bottom      |         |         |             |             |             |             |             |
| - Ultrasonicated at 15W for 15 Min     |                  |          | 3rd Thaw - Small Agglomerates at Bottom   |             |             |             |             |             | 3rd Thaw - Small Agglomerates at Bottom      |         |         |             |             |             |             |             |
| - 0.1% vol CNT (0.02 g)                |                  |          | 4th Thaw - Small Agglomerates at Bottom   |             |             |             |             |             | 4th Thaw - Small Agglomerates at Bottom      |         |         |             |             |             |             |             |
| - 3.0% Surfactant (0.6 g)              |                  |          | 5th Thaw - Small Agglomerates at Bottom   |             |             |             |             |             | 5th Thaw - Small Agglomerates at Bottom      |         |         |             |             |             |             |             |

| SWCNT - LDS vs. Igepal Initial Testing |                  |          |                                           |             |             |             |             |             |                                                  |         |                                                       |             |             |             |             |             |  |
|----------------------------------------|------------------|----------|-------------------------------------------|-------------|-------------|-------------|-------------|-------------|--------------------------------------------------|---------|-------------------------------------------------------|-------------|-------------|-------------|-------------|-------------|--|
| 0.1% CNT<br>3.0% Surf                  | Sample #15 - LDS |          |                                           |             |             |             |             |             | Sample #16 - Igepal                              |         |                                                       |             |             |             |             |             |  |
|                                        | DW<br>(MΩ)       | DW / LDS | Initial                                   | 1st<br>Thaw | 2nd<br>Thaw | 3rd<br>Thaw | 4th<br>Thaw | 5th<br>Thaw | DW<br>(MΩ)                                       | DW/ Ige | Initial                                               | 1st<br>Thaw | 2nd<br>Thaw | 3rd<br>Thaw | 4th<br>Thaw | 5th<br>Thaw |  |
| 1                                      | 0.53             | 8.2      | 5.5                                       | 9.3         | 7.2         | 6.2         | 4.5         | 4.2         | 0.61                                             | 25.4    | Sample Unstable after U/S<br><br>Testing Discontinued |             |             |             |             |             |  |
| 2                                      | 0.56             | 9.7      | 6.2                                       | 8.1         | 6.4         | 7.9         | 4.9         | 5.4         | 0.65                                             | 34.1    |                                                       |             |             |             |             |             |  |
| 3                                      | 0.52             | 9.6      | 5.3                                       | 8.4         | 8.7         | 9.0         | 5.3         | 6.4         | 0.59                                             | 27.9    |                                                       |             |             |             |             |             |  |
| 4                                      | 0.57             | 9.5      | 5.8                                       | 8.5         | 8.0         | 8.1         | 7.1         | 7.2         | 0.57                                             | 27.8    |                                                       |             |             |             |             |             |  |
| 5                                      | 0.53             | 7.3      | 7.1                                       | 9.4         | 9.5         | 9.4         | 5.1         | 8.6         | 0.62                                             | 26.5    |                                                       |             |             |             |             |             |  |
| 6                                      | 0.54             | 8.2      | 6.0                                       | 9.0         | 8.6         | 9.1         | 7.5         | 9.6         | 0.55                                             | 30.3    |                                                       |             |             |             |             |             |  |
| 7                                      | 0.55             | 8.3      | 4.5                                       | 9.6         | 9.7         | 8.2         | 6.0         | 9.5         | 0.61                                             | 29.9    |                                                       |             |             |             |             |             |  |
| 8                                      | 0.59             | 8.0      | 5.1                                       | 12.2        | 10.0        | 9.3         | 6.5         | 7.2         | 0.60                                             | 28.4    |                                                       |             |             |             |             |             |  |
| 9                                      | 0.63             | 8.2      | 4.8                                       | 10.0        | 9.0         | 11.7        | 8.5         | 8.6         | 0.70                                             | 27.7    |                                                       |             |             |             |             |             |  |
| 10                                     | 0.51             | 10.1     | 5.4                                       | 9.8         | 9.4         | 11.4        | 5.9         | 7.3         | 0.62                                             | 34.4    |                                                       |             |             |             |             |             |  |
| 11                                     | 0.65             | 9.4      | 5.3                                       | 7.8         | 9.3         | 9.6         | 6.0         | 9.1         | 0.64                                             | 29.2    |                                                       |             |             |             |             |             |  |
| 12                                     | 0.51             | 8.8      | 5.7                                       | 9.5         | 10.9        | 8.4         | 7.1         | 9.6         | 0.63                                             | 30.7    |                                                       |             |             |             |             |             |  |
| 13                                     | 0.52             | 9.3      | 5.4                                       | 11.2        | 10.8        | 10.1        | 7.5         | 10.4        | 0.60                                             | 28.9    |                                                       |             |             |             |             |             |  |
| 14                                     | 0.55             | 9.1      | 4.9                                       | 8.7         | 8.3         | 8.9         | 7.7         | 10.1        | 0.62                                             | 29.1    |                                                       |             |             |             |             |             |  |
| 15                                     | 0.60             | 9.0      | 6.2                                       | 10.4        | 8.7         | 10.5        | 9.5         | 8.0         | 0.59                                             | 32.7    |                                                       |             |             |             |             |             |  |
| Mean                                   | 0.56             | 8.85     | 5.55                                      | 9.46        | 8.97        | 9.19        | 6.61        | 8.08        | 0.61                                             | 29.53   |                                                       |             |             |             |             |             |  |
| Std Dev                                | 0.04             | 0.78     | 0.65                                      | 1.17        | 1.21        | 1.40        | 1.41        | 1.79        | 0.04                                             | 2.59    |                                                       |             |             |             |             |             |  |
| Notes                                  |                  |          | Max Temp during U/S - 69°C, Sample Stable |             |             |             |             |             | Max Temp during U/S- 72°C, Sample Unstable       |         |                                                       |             |             |             |             |             |  |
| - SWCNT, 20 mL Sample                  |                  |          | 1st Thaw - Light Sediment at Bottom       |             |             |             |             |             | - Layered Separation after U/S -> Heavy sediment |         |                                                       |             |             |             |             |             |  |
| - All Resistances in k-Ohm except DW   |                  |          | 2nd Thaw - Light Sediment at Bottom       |             |             |             |             |             | at bottom with small agglomerates                |         |                                                       |             |             |             |             |             |  |
| - Ultrasonicated at 15W for 15 Min     |                  |          | 3rd Thaw - Light Sediment at Bottom       |             |             |             |             |             |                                                  |         |                                                       |             |             |             |             |             |  |
| - 0.1% vol CNT (0.02 g)                |                  |          | 4th Thaw - Light Sediment at Bottom       |             |             |             |             |             |                                                  |         |                                                       |             |             |             |             |             |  |
| - 3.0% Surfactant (0.6 g)              |                  |          | 5th Thaw - Light Sediment at Bottom       |             |             |             |             |             |                                                  |         |                                                       |             |             |             |             |             |  |

## APPENDIX H. LUNA INNOVATIONS NANOFLUID RESISTANCE MEASUREMENTS

\*All Resistances in kilo-ohm

| LnW - 402 Resistance (kΩ) |         |         |         |         |         |         |         |          |        |         |
|---------------------------|---------|---------|---------|---------|---------|---------|---------|----------|--------|---------|
| Insertion                 | Initial | Thaw #1 | Thaw #2 | Thaw #3 | Thaw #4 | Thaw #5 | Thaw #6 | Thaw #12 | Re-Son | Thaw #1 |
| 1                         | 11.2    | 12.3    | 14.0    | 12.0    | 13.5    | 8.5     | 10.0    | 21.6     | 7.6    | 10.2    |
| 2                         | 10.6    | 11.4    | 14.2    | 12.2    | 12.3    | 8.9     | 9.2     | 17.4     | 8.2    | 13.3    |
| 3                         | 10.9    | 11.7    | 10.8    | 11.7    | 12.6    | 7.8     | 10.2    | 18.4     | 8.5    | 11.0    |
| 4                         | 10.1    | 10.8    | 12.7    | 13.4    | 13.5    | 8.6     | 9.1     | 21.0     | 8.0    | 11.1    |
| 5                         | 10.5    | 11.8    | 14.9    | 12.6    | 11.7    | 8.3     | 9.3     | 20.9     | 6.4    | 12.7    |
| 6                         | 11.0    | 12.7    | 11.5    | 11.8    | 12.3    | 8.9     | 9.5     | 22.0     | 7.6    | 9.5     |
| 7                         | 10.9    | 11.7    | 13.8    | 11.5    | 13.4    | 8.4     | 9.6     | 27.9     | 7.7    | 11.0    |
| 8                         | 10.4    | 12.2    | 11.7    | 11.9    | 13.0    | 8.6     | 10.1    | 23.1     | 8.1    | 10.6    |
| 9                         | 10.8    | 11.6    | 12.1    | 12.6    | 12.9    | 9.1     | 10.4    | 23.7     | 8.0    | 10.1    |
| 10                        | 11.0    | 11.9    | 13.6    | 12.0    | 12.3    | 9.7     | 10.1    | 19.5     | 7.2    | 11.1    |
| 11                        | 10.6    | 12.7    | 14.1    | 11.3    | 13.0    | 8.6     | 10.2    | 21.9     | 8.4    | 11.7    |
| 12                        | 12.1    | 11.3    | 12.0    | 13.5    | 12.7    | 8.2     | 9.8     | 23.4     | 8.0    | 12.8    |
| 13                        | 10.4    | 12.1    | 11.5    | 11.7    | 12.6    | 10.1    | 12.5    | 20.8     | 8.9    | 13.5    |
| 14                        | 9.9     | 13.1    | 11.7    | 12.7    | 11.9    | 9.3     | 9.6     | 19.5     | 6.5    | 15.6    |
| 15                        | 10.6    | 11.4    | 13.7    | 10.9    | 12.8    | 8.6     | 10.0    | 22.1     | 6.8    | 13.4    |
| Mean                      | 10.73   | 11.91   | 12.82   | 12.12   | 12.70   | 8.77    | 9.97    | 21.55    | 7.73   | 11.84   |
| Std Dev                   | 0.52    | 0.61    | 1.28    | 0.73    | 0.54    | 0.59    | 0.80    | 2.51     | 0.73   | 1.66    |
| LnW - 403 Resistance (kΩ) |         |         |         |         |         |         |         |          |        |         |
| Insertion                 | Initial | Thaw #1 | Thaw #2 | Thaw #3 | Thaw #4 | Thaw #5 | Thaw #6 | Thaw #12 | Re-Son | Thaw #1 |
| 1                         | 9.1     | 11.7    | 12.0    | 11.8    | 12.3    | 8.4     | 9.3     | 18.4     | 4.4    | 12.8    |
| 2                         | 8.4     | 11.3    | 10.6    | 10.5    | 12.0    | 9.5     | 9.0     | 18.1     | 7.1    | 10.3    |
| 3                         | 8.9     | 10.7    | 13.2    | 10.7    | 13.3    | 9.0     | 10.3    | 20.5     | 6.3    | 10.4    |
| 4                         | 8.2     | 11.7    | 12.0    | 11.7    | 12.4    | 9.8     | 9.6     | 25.1     | 7.1    | 11.9    |
| 5                         | 8.0     | 11.4    | 11.4    | 11.6    | 12.8    | 9.9     | 9.9     | 22.8     | 7.0    | 10.3    |
| 6                         | 8.3     | 11.5    | 11.0    | 9.5     | 12.7    | 8.4     | 9.5     | 19.6     | 7.5    | 10.5    |
| 7                         | 9.1     | 11.2    | 11.3    | 11.2    | 12.9    | 9.9     | 9.9     | 16.7     | 6.9    | 11.6    |
| 8                         | 8.3     | 10.5    | 12.0    | 11.6    | 11.9    | 9.5     | 9.3     | 20.5     | 6.7    | 12.3    |
| 9                         | 8.5     | 12.2    | 11.0    | 12.7    | 11.5    | 8.3     | 9.0     | 18.8     | 5.5    | 10.3    |
| 10                        | 8.2     | 11.6    | 10.9    | 12.4    | 12.2    | 8.7     | 10.4    | 20.8     | 7.2    | 12.2    |
| 11                        | 8.8     | 10.9    | 11.5    | 11.3    | 12.9    | 9.0     | 10.1    | 22.6     | 7.9    | 11.6    |
| 12                        | 8.9     | 10.8    | 12.2    | 11.5    | 12.3    | 9.5     | 10.2    | 21.8     | 7.4    | 13.3    |
| 13                        | 8.3     | 11.6    | 11.0    | 12.6    | 11.6    | 8.6     | 10.5    | 20.6     | 8.2    | 9.9     |
| 14                        | 8.7     | 10.9    | 11.8    | 10.9    | 11.9    | 9.7     | 10.2    | 21.7     | 7.0    | 10.6    |
| 15                        | 9.0     | 11.5    | 11.3    | 11.1    | 11.8    | 8.7     | 9.5     | 20.1     | 7.9    | 10.5    |
| Mean                      | 8.58    | 11.30   | 11.55   | 11.41   | 12.30   | 9.13    | 9.78    | 20.54    | 6.94   | 11.23   |
| Std Dev                   | 0.37    | 0.46    | 0.67    | 0.84    | 0.53    | 0.59    | 0.50    | 2.11     | 0.97   | 1.07    |



\*All Resistances in kilo-ohm

| LnW - 404 Resistance (kΩ) |         |         |         |         |         |         |         |          |        |         |
|---------------------------|---------|---------|---------|---------|---------|---------|---------|----------|--------|---------|
| Insertion                 | Initial | Thaw #1 | Thaw #2 | Thaw #3 | Thaw #4 | Thaw #5 | Thaw #6 | Thaw #12 | Re-Son | Thaw #1 |
| 1                         | 8.6     | 8.4     | 9.6     | 9.8     | 8.9     | 8.9     | 9.0     | 15.4     | 5.1    | 6.3     |
| 2                         | 7.4     | 9.3     | 9.4     | 7.8     | 9.2     | 7.7     | 8.5     | 15.6     | 6.4    | 3.9     |
| 3                         | 7.2     | 8.8     | 9.5     | 7.3     | 9.1     | 8.4     | 9.2     | 16.1     | 6.7    | 3.4     |
| 4                         | 7.4     | 8.8     | 7.9     | 9.0     | 7.8     | 8.7     | 9.0     | 19.4     | 6.5    | 6.7     |
| 5                         | 7.9     | 9.7     | 9.1     | 9.2     | 7.3     | 8.3     | 7.4     | 17.6     | 7.5    | 7.1     |
| 6                         | 7.6     | 9.4     | 8.4     | 8.8     | 7.4     | 7.8     | 9.0     | 18.8     | 6.8    | 8.2     |
| 7                         | 8.1     | 9.7     | 9.3     | 9.3     | 7.4     | 9.8     | 8.6     | 15.2     | 6.9    | 7.3     |
| 8                         | 7.4     | 8.7     | 9.0     | 9.0     | 8.5     | 8.6     | 9.9     | 17.1     | 6.6    | 8.5     |
| 9                         | 7.9     | 9.1     | 9.5     | 8.5     | 8.3     | 8.3     | 8.5     | 18.5     | 6.4    | 5.4     |
| 10                        | 8.2     | 9.5     | 8.4     | 7.8     | 7.9     | 9.2     | 8.1     | 16.8     | 7.5    | 7.9     |
| 11                        | 8.0     | 9.1     | 8.0     | 9.5     | 8.2     | 9.7     | 8.9     | 23.5     | 7.1    | 6.4     |
| 12                        | 7.5     | 9.2     | 8.8     | 8.6     | 8.4     | 8.6     | 8.5     | 17.5     | 6.4    | 8.0     |
| 13                        | 8.3     | 8.3     | 9.3     | 9.8     | 7.8     | 7.6     | 9.6     | 21.5     | 7.2    | 7.7     |
| 14                        | 8.1     | 8.7     | 9.2     | 9.0     | 8.9     | 8.0     | 9.1     | 16.7     | 6.3    | 11.7    |
| 15                        | 7.7     | 9.0     | 8.4     | 9.4     | 9.0     | 8.3     | 8.9     | 18.8     | 7.2    | 9.9     |
| Mean                      | 7.82    | 9.05    | 8.92    | 8.85    | 8.27    | 8.53    | 8.81    | 17.90    | 6.71   | 7.23    |
| Std Dev                   | 0.40    | 0.43    | 0.57    | 0.74    | 0.65    | 0.66    | 0.60    | 2.30     | 0.60   | 2.10    |
|                           |         |         |         |         |         |         |         |          |        |         |
| LnW - 405 Resistance (kΩ) |         |         |         |         |         |         |         |          |        |         |
| Insertion                 | Initial | Thaw #1 | Thaw #2 | Thaw #3 | Thaw #4 | Thaw #5 | Thaw #6 | Thaw #12 | Re-Son | Thaw #1 |
| 1                         | 5.1     | 6.9     | 7.3     | 6.4     | 7.1     | 4.8     | 6.4     | 13.1     | 5.7    | 8.7     |
| 2                         | 4.9     | 6.9     | 7.2     | 8.2     | 6.9     | 5.7     | 6.9     | 13.5     | 6.0    | 11.5    |
| 3                         | 5.3     | 8.0     | 7.8     | 7.0     | 8.9     | 4.6     | 6.7     | 13.0     | 6.1    | 9.1     |
| 4                         | 4.6     | 6.3     | 8.4     | 8.2     | 6.4     | 4.7     | 6.9     | 12.3     | 6.2    | 9.5     |
| 5                         | 4.6     | 7.3     | 7.3     | 7.0     | 6.2     | 5.1     | 6.5     | 16.0     | 6.8    | 9.3     |
| 6                         | 4.2     | 6.9     | 7.7     | 6.7     | 6.3     | 5.4     | 6.8     | 11.8     | 6.0    | 10.3    |
| 7                         | 4.5     | 6.1     | 7.3     | 8.1     | 5.9     | 4.6     | 6.0     | 13.0     | 6.3    | 9.2     |
| 8                         | 4.4     | 6.8     | 6.6     | 7.2     | 6.2     | 5.9     | 6.2     | 13.8     | 6.7    | 9.1     |
| 9                         | 5.0     | 6.2     | 6.7     | 8.2     | 5.7     | 4.9     | 6.1     | 16.0     | 7.2    | 10.9    |
| 10                        | 4.7     | 6.7     | 7.0     | 6.9     | 5.8     | 4.3     | 5.8     | 13.0     | 6.1    | 11.5    |
| 11                        | 4.6     | 6.1     | 7.4     | 7.4     | 5.7     | 5.0     | 5.7     | 11.0     | 6.3    | 10.5    |
| 12                        | 4.9     | 6.3     | 8.2     | 6.8     | 6.0     | 6.1     | 5.9     | 12.5     | 6.9    | 11.1    |
| 13                        | 4.8     | 6.7     | 6.6     | 7.2     | 6.3     | 4.6     | 6.2     | 13.4     | 7.4    | 9.7     |
| 14                        | 4.2     | 6.2     | 7.3     | 7.0     | 5.4     | 5.7     | 7.0     | 12.6     | 7.0    | 9.9     |
| 15                        | 4.6     | 6.8     | 6.8     | 6.9     | 5.7     | 5.1     | 6.2     | 12.4     | 6.3    | 8.4     |
| Mean                      | 4.69    | 6.68    | 7.31    | 7.28    | 6.30    | 5.10    | 6.35    | 13.16    | 6.47   | 9.91    |
| Std Dev                   | 0.31    | 0.52    | 0.54    | 0.60    | 0.85    | 0.54    | 0.43    | 1.35     | 0.50   | 1.00    |

\*All Resistances in kilo-ohm

| LnW - 406 Resistance (kΩ) |         |         |         |         |         |         |         |          |        |         |
|---------------------------|---------|---------|---------|---------|---------|---------|---------|----------|--------|---------|
| Insertion                 | Initial | Thaw #1 | Thaw #2 | Thaw #3 | Thaw #4 | Thaw #5 | Thaw #6 | Thaw #12 | Re-Son | Thaw #1 |
| 1                         | 6.2     | 9.1     | 7.4     | 7.6     | 6.3     | 6.2     | 7.2     | 9.4      | 8.0    | 7.0     |
| 2                         | 6.4     | 8.6     | 8.6     | 8.2     | 7.4     | 6.7     | 7.3     | 11.0     | 7.8    | 8.2     |
| 3                         | 6.9     | 9.2     | 8.7     | 9.4     | 7.7     | 5.6     | 7.6     | 10.1     | 7.7    | 8.4     |
| 4                         | 6.6     | 9.5     | 8.5     | 8.4     | 7.1     | 6.2     | 7.3     | 11.2     | 8.1    | 8.9     |
| 5                         | 6.3     | 9.9     | 8.2     | 7.6     | 7.6     | 7.3     | 7.4     | 13.2     | 8.0    | 9.1     |
| 6                         | 6.0     | 9.2     | 7.9     | 9.6     | 8.6     | 7.0     | 6.9     | 13.7     | 9.1    | 9.5     |
| 7                         | 6.2     | 10.6    | 7.8     | 8.8     | 7.3     | 5.9     | 7.3     | 13.3     | 5.6    | 11.4    |
| 8                         | 6.1     | 8.9     | 8.9     | 9.1     | 6.2     | 6.5     | 7.9     | 10.1     | 7.3    | 9.5     |
| 9                         | 6.9     | 8.6     | 8.2     | 8.2     | 7.7     | 6.9     | 7.8     | 11.4     | 7.0    | 10.3    |
| 10                        | 6.3     | 8.9     | 9.3     | 9.3     | 8.1     | 8.1     | 7.7     | 12.1     | 6.4    | 8.5     |
| 11                        | 6.5     | 9.7     | 8.9     | 8.7     | 7.2     | 7.5     | 7.8     | 14.9     | 7.3    | 10.7    |
| 12                        | 6.9     | 9.8     | 7.9     | 9.2     | 7.8     | 6.1     | 7.7     | 14.2     | 7.5    | 10.0    |
| 13                        | 6.2     | 10.3    | 8.3     | 8.5     | 8.6     | 7.1     | 7.3     | 15.3     | 6.6    | 13.9    |
| 14                        | 6.9     | 10.2    | 7.8     | 9.1     | 8.3     | 6.7     | 7.2     | 12.5     | 6.5    | 8.6     |
| 15                        | 6.7     | 9.1     | 10.4    | 9.9     | 7.4     | 7.6     | 7.3     | 13.1     | 7.2    | 8.3     |
| Mean                      | 6.47    | 9.44    | 8.45    | 8.77    | 7.55    | 6.76    | 7.45    | 12.37    | 7.34   | 9.49    |
| Std Dev                   | 0.32    | 0.62    | 0.74    | 0.69    | 0.71    | 0.69    | 0.29    | 1.80     | 0.85   | 1.65    |
|                           |         |         |         |         |         |         |         |          |        |         |
| LnW - 407 Resistance (kΩ) |         |         |         |         |         |         |         |          |        |         |
| Insertion                 | Initial | Thaw #1 | Thaw #2 | Thaw #3 | Thaw #4 | Thaw #5 | Thaw #6 | Thaw #12 | Re-Son | Thaw #1 |
| 1                         | 7.5     | 9.5     | 9.3     | 9.7     | 8.0     | 6.2     | 7.1     | 15.4     | 5.8    | 9.2     |
| 2                         | 7.1     | 10.5    | 9.1     | 9.3     | 7.4     | 6.7     | 8.2     | 18.3     | 5.9    | 8.0     |
| 3                         | 7.3     | 9.9     | 8.6     | 10.1    | 8.3     | 7.8     | 7.7     | 16.7     | 5.8    | 9.9     |
| 4                         | 7.4     | 10.6    | 8.2     | 9.4     | 8.8     | 7.9     | 9.0     | 16.0     | 6.2    | 8.9     |
| 5                         | 7.4     | 10.3    | 8.8     | 10.7    | 7.7     | 6.6     | 8.8     | 17.7     | 7.3    | 9.7     |
| 6                         | 7.6     | 10.5    | 9.5     | 9.5     | 7.8     | 8.0     | 8.1     | 15.3     | 6.5    | 10.1    |
| 7                         | 7.3     | 9.9     | 8.5     | 9.8     | 8.6     | 6.6     | 7.1     | 16.4     | 8.0    | 9.6     |
| 8                         | 7.6     | 10.0    | 8.7     | 10.7    | 8.4     | 7.5     | 7.9     | 16.2     | 7.4    | 8.7     |
| 9                         | 7.2     | 10.4    | 8.6     | 9.2     | 7.9     | 7.6     | 7.3     | 15.9     | 8.2    | 10.3    |
| 10                        | 7.3     | 10.0    | 9.0     | 10.8    | 8.9     | 7.7     | 8.2     | 16.1     | 7.3    | 10.2    |
| 11                        | 7.2     | 10.1    | 8.6     | 8.3     | 7.6     | 6.9     | 8.4     | 16.7     | 7.4    | 9.5     |
| 12                        | 7.9     | 9.5     | 10.8    | 9.0     | 8.1     | 7.7     | 8.8     | 17.2     | 7.5    | 9.7     |
| 13                        | 7.3     | 9.9     | 8.4     | 10.6    | 8.4     | 7.3     | 7.9     | 16.0     | 7.3    | 10.1    |
| 14                        | 7.1     | 10.0    | 9.4     | 9.7     | 8.3     | 6.9     | 7.3     | 16.4     | 6.5    | 10.2    |
| 15                        | 7.8     | 11.0    | 10.2    | 9.8     | 9.1     | 7.8     | 8.1     | 15.9     | 6.4    | 10.4    |
| Mean                      | 7.40    | 10.14   | 9.05    | 9.77    | 8.22    | 7.28    | 7.99    | 16.41    | 6.90   | 9.63    |
| Std Dev                   | 0.24    | 0.41    | 0.71    | 0.71    | 0.50    | 0.58    | 0.61    | 0.81     | 0.79   | 0.68    |

THIS PAGE INTENTIONALLY LEFT BLANK

## APPENDIX I. COMBINED CNT NANOFLUID RESISTANCE MEASUREMENTS

| Mixed LnW - 402 Resistance                                                                                                                                                                                                                                                                                                                                                      |         |       |          |          |          |          |          |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------|-------|----------|----------|----------|----------|----------|
| L1 - 15W / 15 min, U/S with Ice bath                                                                                                                                                                                                                                                                                                                                            |         |       |          |          |          |          |          |
| Insertion                                                                                                                                                                                                                                                                                                                                                                       | Initial | Mixed | 1st Thaw | 2nd Thaw | 3rd Thaw | 4th Thaw | 5th Thaw |
| 1                                                                                                                                                                                                                                                                                                                                                                               | 8.8     | 8.6   | 16.1     | 7.5      | 11.1     | 12.4     | 16.7     |
| 2                                                                                                                                                                                                                                                                                                                                                                               | 7.6     | 7.3   | 16.6     | 8.4      | 12.0     | 14.2     | 17.3     |
| 3                                                                                                                                                                                                                                                                                                                                                                               | 8.1     | 8.5   | 17.4     | 7.8      | 10.3     | 13.6     | 18.6     |
| 4                                                                                                                                                                                                                                                                                                                                                                               | 9.0     | 8.3   | 17.1     | 8.2      | 9.2      | 14.0     | 17.1     |
| 5                                                                                                                                                                                                                                                                                                                                                                               | 8.1     | 8.1   | 18.4     | 7.3      | 8.7      | 13.3     | 16.5     |
| 6                                                                                                                                                                                                                                                                                                                                                                               | 8.8     | 7.8   | 17.4     | 7.4      | 10.6     | 13.4     | 15.4     |
| 7                                                                                                                                                                                                                                                                                                                                                                               | 7.2     | 7.4   | 15.4     | 7.9      | 9.9      | 16.2     | 22.9     |
| 8                                                                                                                                                                                                                                                                                                                                                                               | 8.8     | 7.9   | 16.2     | 8.5      | 10.1     | 14.3     | 13.6     |
| 9                                                                                                                                                                                                                                                                                                                                                                               | 7.6     | 7.8   | 14.1     | 8.4      | 9.4      | 14.1     | 15.4     |
| 10                                                                                                                                                                                                                                                                                                                                                                              | 8.7     | 7.5   | 15.1     | 7.9      | 12.7     | 15.3     | 15.9     |
| 11                                                                                                                                                                                                                                                                                                                                                                              | 8.9     | 7.8   | 15.4     | 8.0      | 9.6      | 18.3     | 17.9     |
| 12                                                                                                                                                                                                                                                                                                                                                                              | 7.9     | 8.2   | 18.8     | 8.1      | 11.5     | 15.7     | 19.2     |
| 13                                                                                                                                                                                                                                                                                                                                                                              | 8.8     | 8.0   | 17.3     | 7.9      | 11.7     | 13.6     | 15.9     |
| 14                                                                                                                                                                                                                                                                                                                                                                              | 9.1     | 8.0   | 15.1     | 7.2      | 10.0     | 14.1     | 17.9     |
| 15                                                                                                                                                                                                                                                                                                                                                                              | 9.6     | 7.9   | 17.3     | 8.8      | 8.5      | 14.2     | 17.0     |
| Mean                                                                                                                                                                                                                                                                                                                                                                            | 8.47    | 7.94  | 16.51    | 7.95     | 10.35    | 14.45    | 17.15    |
| Std Dev                                                                                                                                                                                                                                                                                                                                                                         | 0.67    | 0.37  | 1.32     | 0.47     | 1.23     | 1.44     | 2.12     |
| <b>Notes</b><br>Max Temp during U/S - 21 °C<br>1st Thaw - Sediment at Bottom<br>2nd Thaw - Heavy Agglomerates at Bottom - Sample Unstable<br>3rd Thaw - Small and Large Agglomerates Suspended and Sediment at Bottom<br>4th Thaw - Heavy Agglomeration and Sediment at Bottom, Layered Appearance<br>5th Thaw - Heavy Agglomeration and Sediment at Bottom, Layered Appearance |         |       |          |          |          |          |          |

| Mixed LnW - 402 Resistance                                                                                                                                                                                                                                                                                                                                |         |       |          |          |          |          |          |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------|-------|----------|----------|----------|----------|----------|
| L2 - 15W / 15 Min, No Ice bath                                                                                                                                                                                                                                                                                                                            |         |       |          |          |          |          |          |
| Insertion                                                                                                                                                                                                                                                                                                                                                 | Initial | Mixed | 1st Thaw | 2nd Thaw | 3rd Thaw | 4th Thaw | 5th Thaw |
| 1                                                                                                                                                                                                                                                                                                                                                         | 7.8     | 6.6   | 17.6     | 9.0      | 12.1     | 8.4      | 17.2     |
| 2                                                                                                                                                                                                                                                                                                                                                         | 8.7     | 7.0   | 18.2     | 8.6      | 14.3     | 8.7      | 16.4     |
| 3                                                                                                                                                                                                                                                                                                                                                         | 8.9     | 6.3   | 17.4     | 8.7      | 10.9     | 6.3      | 16.8     |
| 4                                                                                                                                                                                                                                                                                                                                                         | 8.1     | 6.4   | 18.0     | 9.6      | 10.3     | 7.2      | 15.1     |
| 5                                                                                                                                                                                                                                                                                                                                                         | 7.4     | 7.4   | 17.0     | 9.5      | 9.9      | 9.2      | 17.9     |
| 6                                                                                                                                                                                                                                                                                                                                                         | 8.2     | 7.2   | 16.7     | 8.1      | 10.2     | 11.3     | 16.3     |
| 7                                                                                                                                                                                                                                                                                                                                                         | 9.0     | 5.2   | 19.1     | 9.8      | 10.0     | 11.8     | 18.1     |
| 8                                                                                                                                                                                                                                                                                                                                                         | 8.4     | 6.0   | 14.7     | 9.3      | 11.2     | 13.2     | 17.0     |
| 9                                                                                                                                                                                                                                                                                                                                                         | 8.3     | 5.5   | 15.9     | 9.0      | 10.7     | 14.6     | 15.6     |
| 10                                                                                                                                                                                                                                                                                                                                                        | 9.2     | 6.2   | 17.9     | 10.0     | 15.8     | 16.8     | 15.0     |
| 11                                                                                                                                                                                                                                                                                                                                                        | 8.1     | 5.4   | 16.7     | 9.4      | 12.0     | 16.2     | 16.8     |
| 12                                                                                                                                                                                                                                                                                                                                                        | 9.1     | 5.0   | 15.6     | 8.3      | 13.3     | 13.6     | 17.3     |
| 13                                                                                                                                                                                                                                                                                                                                                        | 9.0     | 4.7   | 18.2     | 9.0      | 10.3     | 13.8     | 19.4     |
| 14                                                                                                                                                                                                                                                                                                                                                        | 8.4     | 6.1   | 16.2     | 8.9      | 14.6     | 14.0     | 15.8     |
| 15                                                                                                                                                                                                                                                                                                                                                        | 7.8     | 5.2   | 15.5     | 8.5      | 13.3     | 15.0     | 17.4     |
| Mean                                                                                                                                                                                                                                                                                                                                                      | 8.43    | 6.01  | 16.98    | 9.05     | 11.93    | 12.01    | 16.81    |
| Std Dev                                                                                                                                                                                                                                                                                                                                                   | 0.54    | 0.83  | 1.23     | 0.55     | 1.90     | 3.33     | 1.18     |
| <b>Notes</b><br>Max Temp during U/S - 72 °C<br>1st Thaw - Sediment at Bottom<br>2nd Thaw - Small Agglomerate Suspensions and Sediment at Bottom<br>3rd Thaw - Small Agglomerates and Sediment at Bottom<br>4th Thaw - Small Agglomerates and Suspensions with Sediment at Bottom<br>5th Thaw - Small Agglomerates and Suspensions with Sediment at Bottom |         |       |          |          |          |          |          |

\*All Resistances in kilo-ohm

| Mixed LnW - 402 Resistance                                                                                                                                                                                                                                                                                                                                                     |         |       |          |          |          |          |          |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------|-------|----------|----------|----------|----------|----------|
| L3 - 39 W / 15 Min, U/S with Ice Bath                                                                                                                                                                                                                                                                                                                                          |         |       |          |          |          |          |          |
| Insertion                                                                                                                                                                                                                                                                                                                                                                      | Initial | Mixed | 1st Thaw | 2nd Thaw | 3rd Thaw | 4th Thaw | 5th Thaw |
| 1                                                                                                                                                                                                                                                                                                                                                                              | 8.4     | 7.4   | 16.6     | 9.1      | 15.0     | 15.8     | 21.3     |
| 2                                                                                                                                                                                                                                                                                                                                                                              | 7.8     | 7.3   | 17.1     | 9.2      | 13.0     | 16.2     | 22.6     |
| 3                                                                                                                                                                                                                                                                                                                                                                              | 9.0     | 7.2   | 18.9     | 9.4      | 13.3     | 16.3     | 18.0     |
| 4                                                                                                                                                                                                                                                                                                                                                                              | 9.1     | 6.0   | 15.1     | 9.2      | 14.2     | 19.0     | 17.5     |
| 5                                                                                                                                                                                                                                                                                                                                                                              | 8.1     | 6.9   | 16.2     | 10.2     | 12.3     | 16.8     | 16.7     |
| 6                                                                                                                                                                                                                                                                                                                                                                              | 8.2     | 7.2   | 18.0     | 9.8      | 15.6     | 17.1     | 18.4     |
| 7                                                                                                                                                                                                                                                                                                                                                                              | 8.9     | 7.1   | 15.1     | 9.5      | 10.4     | 17.0     | 16.6     |
| 8                                                                                                                                                                                                                                                                                                                                                                              | 8.7     | 7.7   | 17.8     | 9.2      | 11.6     | 15.8     | 17.8     |
| 9                                                                                                                                                                                                                                                                                                                                                                              | 9.6     | 8.1   | 17.5     | 8.4      | 13.6     | 16.9     | 18.3     |
| 10                                                                                                                                                                                                                                                                                                                                                                             | 10.1    | 6.7   | 16.4     | 8.7      | 11.7     | 16.2     | 23.2     |
| 11                                                                                                                                                                                                                                                                                                                                                                             | 8.1     | 7.0   | 16.9     | 8.1      | 14.0     | 15.9     | 15.2     |
| 12                                                                                                                                                                                                                                                                                                                                                                             | 8.7     | 8.1   | 15.5     | 9.5      | 12.5     | 18.4     | 18.9     |
| 13                                                                                                                                                                                                                                                                                                                                                                             | 8.2     | 7.4   | 16.0     | 8.8      | 14.1     | 17.2     | 23.4     |
| 14                                                                                                                                                                                                                                                                                                                                                                             | 8.6     | 7.7   | 18.5     | 9.0      | 14.6     | 19.2     | 17.2     |
| 15                                                                                                                                                                                                                                                                                                                                                                             | 8.4     | 8.0   | 16.8     | 8.3      | 15.3     | 18.0     | 15.9     |
| Mean                                                                                                                                                                                                                                                                                                                                                                           | 8.66    | 7.32  | 16.83    | 9.09     | 13.41    | 17.05    | 18.73    |
| Std Dev                                                                                                                                                                                                                                                                                                                                                                        | 0.61    | 0.56  | 1.16     | 0.57     | 1.50     | 1.12     | 2.65     |
| <b>Notes</b><br>Max Temp during U/S - 34 °C<br>1st Thaw - Minor Sediment at Bottom<br>2nd Thaw - Heavy Agglomeration at Bottom - Sample Unstable<br>3rd Thaw - Small and Large Agglomerates Suspended and Sediment at Bottom<br>4th Thaw - Large Agglomerates and Suspensions with Sediment at Bottom<br>5th Thaw - Large Agglomerates and Suspensions with Sediment at Bottom |         |       |          |          |          |          |          |

| Mixed LnW - 402 Resistance                                                                                                                                                                                                                                                                                                                                 |         |       |          |          |          |          |          |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------|-------|----------|----------|----------|----------|----------|
| L4 - 39W / 15 Min, No Ice bath                                                                                                                                                                                                                                                                                                                             |         |       |          |          |          |          |          |
| Insertion                                                                                                                                                                                                                                                                                                                                                  | Initial | Mixed | 1st Thaw | 2nd Thaw | 3rd Thaw | 4th Thaw | 5th Thaw |
| 1                                                                                                                                                                                                                                                                                                                                                          | 8.5     | 5.0   | 17.4     | 8.3      | 13.8     | 14.3     | 17.9     |
| 2                                                                                                                                                                                                                                                                                                                                                          | 9.0     | 4.9   | 18.3     | 9.5      | 11.4     | 15.6     | 20.1     |
| 3                                                                                                                                                                                                                                                                                                                                                          | 7.2     | 5.6   | 17.1     | 8.6      | 12.7     | 17.8     | 17.1     |
| 4                                                                                                                                                                                                                                                                                                                                                          | 7.3     | 4.9   | 17.3     | 8.8      | 8.7      | 17.2     | 15.2     |
| 5                                                                                                                                                                                                                                                                                                                                                          | 7.4     | 5.8   | 20.1     | 8.9      | 11.4     | 17.5     | 18.5     |
| 6                                                                                                                                                                                                                                                                                                                                                          | 8.6     | 5.7   | 22.3     | 7.9      | 9.9      | 18.1     | 19.5     |
| 7                                                                                                                                                                                                                                                                                                                                                          | 9.2     | 5.5   | 15.4     | 8.5      | 8.0      | 16.2     | 22.9     |
| 8                                                                                                                                                                                                                                                                                                                                                          | 8.5     | 5.2   | 18.3     | 8.3      | 8.8      | 19.1     | 20.4     |
| 9                                                                                                                                                                                                                                                                                                                                                          | 7.4     | 4.8   | 16.2     | 9.3      | 12.7     | 16.8     | 19.2     |
| 10                                                                                                                                                                                                                                                                                                                                                         | 8.3     | 5.5   | 19.6     | 9.5      | 12.4     | 18.0     | 19.0     |
| 11                                                                                                                                                                                                                                                                                                                                                         | 8.5     | 5.9   | 18.2     | 8.5      | 12.9     | 19.1     | 21.8     |
| 12                                                                                                                                                                                                                                                                                                                                                         | 7.4     | 6.4   | 19.8     | 8.4      | 12.0     | 17.2     | 18.2     |
| 13                                                                                                                                                                                                                                                                                                                                                         | 8.3     | 6.2   | 15.7     | 9.8      | 11.9     | 19.2     | 16.9     |
| 14                                                                                                                                                                                                                                                                                                                                                         | 8.5     | 5.6   | 17.7     | 9.3      | 14.3     | 18.4     | 19.1     |
| 15                                                                                                                                                                                                                                                                                                                                                         | 7.6     | 6.0   | 18.1     | 8.6      | 13.0     | 19.2     | 19.0     |
| Mean                                                                                                                                                                                                                                                                                                                                                       | 8.11    | 5.53  | 18.10    | 8.81     | 11.59    | 17.58    | 18.99    |
| Std Dev                                                                                                                                                                                                                                                                                                                                                    | 0.66    | 0.49  | 1.81     | 0.55     | 1.91     | 1.43     | 1.91     |
| <b>Notes</b><br>Max Temp during U/S - 78 °C<br>1st Thaw - Heavy Sediment and agglomeration at Bottom - Sample Unstable<br>2nd Thaw - Heavy Sediment and agglomeration at Bottom<br>3rd Thaw - Heavy Sediment and agglomeration at Bottom<br>4th Thaw - Heavy Sediment and agglomeration at Bottom<br>5th Thaw - Heavy Sediment and agglomeration at Bottom |         |       |          |          |          |          |          |

\*All Resistances in kilo-ohm

| Mixed LnW - 405 Resistance                                                                                                                                                                                                                                                    |         |       |          |          |          |          |          |
|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------|-------|----------|----------|----------|----------|----------|
| L5 - 15W / 15 min, U/S with Ice bath                                                                                                                                                                                                                                          |         |       |          |          |          |          |          |
| Insertion                                                                                                                                                                                                                                                                     | Initial | Mixed | 1st Thaw | 2nd Thaw | 3rd Thaw | 4th Thaw | 5th Thaw |
| 1                                                                                                                                                                                                                                                                             | 8.4     | 7.5   | 11.8     | 15.2     | 12.5     |          |          |
| 2                                                                                                                                                                                                                                                                             | 7.4     | 7.3   | 9.9      | 16.6     | 11.7     |          |          |
| 3                                                                                                                                                                                                                                                                             | 7.8     | 7.8   | 10.1     | 11.5     | 11.1     |          |          |
| 4                                                                                                                                                                                                                                                                             | 7.6     | 7.1   | 9.2      | 16.8     | 9.3      |          |          |
| 5                                                                                                                                                                                                                                                                             | 7.9     | 6.8   | 8.7      | 9.8      | 13.9     |          |          |
| 6                                                                                                                                                                                                                                                                             | 7.3     | 7.1   | 9.8      | 12.5     | 9.0      |          |          |
| 7                                                                                                                                                                                                                                                                             | 8.0     | 7.0   | 11.6     | 10.8     | 13.0     |          |          |
| 8                                                                                                                                                                                                                                                                             | 7.9     | 8.0   | 8.6      | 10.6     | 10.5     |          |          |
| 9                                                                                                                                                                                                                                                                             | 8.8     | 7.1   | 9.1      | 9.1      | 10.1     |          |          |
| 10                                                                                                                                                                                                                                                                            | 6.8     | 7.6   | 7.7      | 10.6     | 11.5     |          |          |
| 11                                                                                                                                                                                                                                                                            | 7.8     | 7.1   | 10.5     | 9.6      | 14.9     |          |          |
| 12                                                                                                                                                                                                                                                                            | 7.5     | 7.7   | 8.8      | 9.7      | 10.3     |          |          |
| 13                                                                                                                                                                                                                                                                            | 7.7     | 6.8   | 8.9      | 13.6     | 11.3     |          |          |
| 14                                                                                                                                                                                                                                                                            | 7.4     | 6.6   | 9.2      | 11.7     | 10.7     |          |          |
| 15                                                                                                                                                                                                                                                                            | 9.6     | 8.5   | 9.3      | 10.8     | 9.3      |          |          |
| Mean                                                                                                                                                                                                                                                                          | 7.86    | 7.33  | 9.55     | 11.93    | 11.27    | #DIV/0!  | #DIV/0!  |
| Std Dev                                                                                                                                                                                                                                                                       | 0.67    | 0.51  | 1.11     | 2.52     | 1.71     | #DIV/0!  | #DIV/0!  |
| <b>Notes</b><br>Max Temp during U/S - 20°C<br>1st Thaw - Minor Sediment at Bottom<br>2nd Thaw - Layered Appearance, Sample Unstable, Heavy Agglomeration and Sediment at Bottom<br>3rd Thaw - Layered Appearance, Sample Unstable, Heavy Agglomeration and Sediment at Bottom |         |       |          |          |          |          |          |

| Mixed LnW - 405 Resistance                                                                                                                                                                                                                                                     |         |       |          |          |          |          |          |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------|-------|----------|----------|----------|----------|----------|
| L6 - 15W / 15 Min, No Ice bath                                                                                                                                                                                                                                                 |         |       |          |          |          |          |          |
| Insertion                                                                                                                                                                                                                                                                      | Initial | Mixed | 1st Thaw | 2nd Thaw | 3rd Thaw | 4th Thaw | 5th Thaw |
| 1                                                                                                                                                                                                                                                                              | 7.7     | 3.9   | 10.7     | 14.1     | 12.6     |          |          |
| 2                                                                                                                                                                                                                                                                              | 8.5     | 4.0   | 8.8      | 13.4     | 9.7      |          |          |
| 3                                                                                                                                                                                                                                                                              | 8.6     | 4.6   | 9.0      | 11.4     | 10.7     |          |          |
| 4                                                                                                                                                                                                                                                                              | 8.1     | 4.0   | 8.8      | 14.0     | 9.9      |          |          |
| 5                                                                                                                                                                                                                                                                              | 7.9     | 4.8   | 9.7      | 10.8     | 9.3      |          |          |
| 6                                                                                                                                                                                                                                                                              | 8.3     | 3.8   | 9.0      | 9.2      | 10.0     |          |          |
| 7                                                                                                                                                                                                                                                                              | 8.0     | 4.2   | 9.1      | 9.6      | 8.1      |          |          |
| 8                                                                                                                                                                                                                                                                              | 8.3     | 4.0   | 9.7      | 8.8      | 8.2      |          |          |
| 9                                                                                                                                                                                                                                                                              | 6.8     | 3.8   | 8.7      | 13.9     | 12.1     |          |          |
| 10                                                                                                                                                                                                                                                                             | 9.7     | 3.6   | 7.6      | 10.6     | 8.7      |          |          |
| 11                                                                                                                                                                                                                                                                             | 7.6     | 3.9   | 9.5      | 10.3     | 7.7      |          |          |
| 12                                                                                                                                                                                                                                                                             | 10.0    | 3.7   | 11.3     | 9.3      | 8.0      |          |          |
| 13                                                                                                                                                                                                                                                                             | 8.4     | 3.9   | 8.2      | 9.5      | 9.3      |          |          |
| 14                                                                                                                                                                                                                                                                             | 8.0     | 4.0   | 8.4      | 8.7      | 8.9      |          |          |
| 15                                                                                                                                                                                                                                                                             | 8.2     | 4.3   | 7.6      | 13.6     | 11.7     |          |          |
| Mean                                                                                                                                                                                                                                                                           | 8.27    | 4.03  | 9.07     | 11.15    | 9.66     | #DIV/0!  | #DIV/0!  |
| Std Dev                                                                                                                                                                                                                                                                        | 0.78    | 0.32  | 1.02     | 2.08     | 1.53     | #DIV/0!  | #DIV/0!  |
| <b>Notes</b><br>Max Temp during U/S - 69 °C<br>1st Thaw - Minor Sediment at Bottom<br>2nd Thaw - Layered Appearance, Sample Unstable, Heavy Agglomeration and Sediment at Bottom<br>3rd Thaw - Layered Appearance, Sample Unstable, Heavy Agglomeration and Sediment at Bottom |         |       |          |          |          |          |          |

\*All Resistances in kilo-ohm

| Mixed LnW - 405 Resistance                                                                                                                                                                                                                                                     |         |       |          |          |          |          |          |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------|-------|----------|----------|----------|----------|----------|
| L7 - 39 W / 15 Min, U/S with Ice Bath                                                                                                                                                                                                                                          |         |       |          |          |          |          |          |
| Insertion                                                                                                                                                                                                                                                                      | Initial | Mixed | 1st Thaw | 2nd Thaw | 3rd Thaw | 4th Thaw | 5th Thaw |
| 1                                                                                                                                                                                                                                                                              | 6.8     | 6.1   | 8.7      | 15.4     | 7.5      |          |          |
| 2                                                                                                                                                                                                                                                                              | 7.3     | 5.7   | 6.9      | 9.4      | 7.8      |          |          |
| 3                                                                                                                                                                                                                                                                              | 7.7     | 5.5   | 7.8      | 11.6     | 8.8      |          |          |
| 4                                                                                                                                                                                                                                                                              | 6.6     | 5.8   | 7.1      | 9.0      | 8.3      |          |          |
| 5                                                                                                                                                                                                                                                                              | 7.5     | 6.0   | 7.6      | 7.9      | 10.5     |          |          |
| 6                                                                                                                                                                                                                                                                              | 7.3     | 5.7   | 8.5      | 9.1      | 9.0      |          |          |
| 7                                                                                                                                                                                                                                                                              | 7.5     | 6.0   | 9.2      | 9.3      | 8.3      |          |          |
| 8                                                                                                                                                                                                                                                                              | 7.0     | 5.4   | 8.1      | 9.1      | 7.3      |          |          |
| 9                                                                                                                                                                                                                                                                              | 7.2     | 5.7   | 8.6      | 9.5      | 10.5     |          |          |
| 10                                                                                                                                                                                                                                                                             | 8.6     | 6.2   | 9.0      | 9.6      | 7.6      |          |          |
| 11                                                                                                                                                                                                                                                                             | 10.0    | 7.0   | 6.5      | 15.4     | 8.9      |          |          |
| 12                                                                                                                                                                                                                                                                             | 8.4     | 7.5   | 8.3      | 8.8      | 10.7     |          |          |
| 13                                                                                                                                                                                                                                                                             | 7.5     | 7.0   | 8.5      | 10.0     | 9.6      |          |          |
| 14                                                                                                                                                                                                                                                                             | 8.4     | 6.2   | 8.3      | 9.9      | 9.1      |          |          |
| 15                                                                                                                                                                                                                                                                             | 7.2     | 5.7   | 7.5      | 8.4      | 10.4     |          |          |
| Mean                                                                                                                                                                                                                                                                           | 7.67    | 6.10  | 8.04     | 10.16    | 8.95     | #DIV/0!  | #DIV/0!  |
| Std Dev                                                                                                                                                                                                                                                                        | 0.87    | 0.61  | 0.79     | 2.28     | 1.17     | #DIV/0!  | #DIV/0!  |
| <b>Notes</b><br>Max Temp during U/S - 43 °C<br>1st Thaw - Minor Sediment at Bottom<br>2nd Thaw - Layered Appearance, Sample Unstable, Heavy Agglomeration and Sediment at Bottom<br>3rd Thaw - Layered Appearance, Sample Unstable, Heavy Agglomeration and Sediment at Bottom |         |       |          |          |          |          |          |

| Mixed LnW - 405 Resistance                                                                                                                                                                                                                                                                       |         |       |          |          |          |          |          |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------|-------|----------|----------|----------|----------|----------|
| L8 - 39W / 15 Min, No Ice bath                                                                                                                                                                                                                                                                   |         |       |          |          |          |          |          |
| Insertion                                                                                                                                                                                                                                                                                        | Initial | Mixed | 1st Thaw | 2nd Thaw | 3rd Thaw | 4th Thaw | 5th Thaw |
| 1                                                                                                                                                                                                                                                                                                | 6.7     | 6.2   | 8.9      | 7.8      | 11.0     |          |          |
| 2                                                                                                                                                                                                                                                                                                | 7.3     | 5.4   | 7.9      | 8.2      | 10.5     |          |          |
| 3                                                                                                                                                                                                                                                                                                | 7.0     | 5.8   | 7.6      | 8.4      | 9.6      |          |          |
| 4                                                                                                                                                                                                                                                                                                | 7.8     | 7.5   | 8.0      | 7.4      | 9.0      |          |          |
| 5                                                                                                                                                                                                                                                                                                | 6.8     | 6.4   | 6.9      | 8.5      | 10.7     |          |          |
| 6                                                                                                                                                                                                                                                                                                | 7.1     | 5.4   | 6.6      | 9.1      | 8.2      |          |          |
| 7                                                                                                                                                                                                                                                                                                | 8.2     | 5.0   | 7.8      | 10.0     | 7.6      |          |          |
| 8                                                                                                                                                                                                                                                                                                | 7.5     | 5.6   | 7.9      | 9.4      | 9.5      |          |          |
| 9                                                                                                                                                                                                                                                                                                | 8.7     | 5.3   | 9.7      | 8.5      | 8.1      |          |          |
| 10                                                                                                                                                                                                                                                                                               | 7.1     | 5.7   | 8.5      | 8.6      | 10.0     |          |          |
| 11                                                                                                                                                                                                                                                                                               | 6.8     | 5.0   | 11.4     | 9.1      | 8.3      |          |          |
| 12                                                                                                                                                                                                                                                                                               | 6.9     | 6.4   | 8.5      | 8.1      | 9.1      |          |          |
| 13                                                                                                                                                                                                                                                                                               | 7.4     | 5.6   | 9.7      | 9.9      | 7.9      |          |          |
| 14                                                                                                                                                                                                                                                                                               | 7.2     | 5.9   | 8.1      | 10.6     | 9.4      |          |          |
| 15                                                                                                                                                                                                                                                                                               | 7.9     | 5.2   | 9.0      | 9.1      | 11.3     |          |          |
| Mean                                                                                                                                                                                                                                                                                             | 7.36    | 5.76  | 8.43     | 8.85     | 9.35     | #DIV/0!  | #DIV/0!  |
| Std Dev                                                                                                                                                                                                                                                                                          | 0.57    | 0.66  | 1.20     | 0.87     | 1.18     | #DIV/0!  | #DIV/0!  |
| <b>Notes</b><br>Max Temp during U/S - 84 °C<br>1st Thaw - Heavy Sediment and agglomeration at Bottom<br>2nd Thaw - Layered Appearance, Sample Unstable, Heavy Agglomeration and Sediment at Bottom<br>3rd Thaw - Layered Appearance, Sample Unstable, Heavy Agglomeration and Sediment at Bottom |         |       |          |          |          |          |          |



THIS PAGE INTENTIONALLY LEFT BLANK

## LIST OF REFERENCES

- [1] J. C. Maxwell, *Electricity and Magnetism, Part 2*, 3rd ed. United Kingdom: Clarendon Press, 1904.
- [2] S. U. S. Choi, "Nanofluid Technology: Current Status and Future Research," Argonne National Laboratory, Argonne, Illinois, Tech. Rep. 97466, 1999.
- [3] J. A. Eastman, S. R. Phillpot, S. U. S. Choi, and P. Keblinski, "Thermal Transport in Nanofluids," *Annual Review of Materials Science*, p. 219, 2004.
- [4] J. Li and C. Kleinstreuer, "Thermal Performance of Nanofluid Flow in Microchannels," *International Journal of Heat and Fluids Flow*, p. 1221, 2008.
- [5] X. Wang and A. S. Mujumdar, "A Review on Nanofluids—Part II: Experiments and Applications," *Brazilian Journal of Chemical Engineering*, vol. 25, p. 631, 2008.
- [6] S. U. S. Choi and J. A. Eastman, "Enhancing Thermal Conductivity of Fluids with Nanoparticles," Argonne National Laboratory, Illinois, Tech. Rep. ANL/ET/CP—88239; CONF-951135—29, 1995.
- [7] E. T. Swartz and R. O. Pohl, "Thermal Boundary Resistance," *Review of Modern Physics*, vol. 61, 1989.
- [8] S. Iijima, "Helical Microtubules of Graphitic Carbon," in *Nature*. Anonymous, 1991, pp. 56–354.
- [9] Penn Engineering, "Carbon Nanotube," 2009.
- [10] Web site Graphic: <http://www.antnanousa.cn> "SWCNT & MWCNT," 2009.
- [11] M. S. Dresselhaus and G. Dresselhaus, *Carbon Nanotubes: Properties, Synthesis, Structure and Applications*. New York: Springer, 2001.
- [12] H. Xie, H. Lee, W. Youn, and M. Choi, "Nanofluids Containing Multitwalled Carbon Nanotubes and Their Enhanced Thermal Conductivities," *Journal of Applied Physics*, vol. 94, p. 4967, 2003.
- [13] D. Wen and Y. Ding, "Effective Thermal Conductivity of Aqueous Suspensions of Carbon Nanotubes (Carbon Nanotube Nanofluids)," *Journal of Thermophysics and Heat Transfer*, vol. 18, 2004.
- [14] M. J. Assael, C. F. Chen, I. Metaxa, and W. A. Wakeham, "Thermal Conductivity of Suspensions of Carbon Nanotubes in Water," *International Journal of Thermophysics*, vol. 25, p. 971, 2004.

- [15] F. D. S. Marquis and L. P. F. Chilbante, "Improving the Heat Transfer of Nanofluids and Nanolubricants with Carbon Nanotubes," *JOM*, p. 32, 2005.
- [16] M. Bahrami, M. M. Yovanovich, and J. R. Culham, "Assessment of Relevant Physical Phenomena Controlling Thermal Performance of Nanofluids," *Journal of Thermophysics and Heat Transfer*, vol. 21, 2007.
- [17] S. Joslin, "Nanofluids," 2009.
- [18] A. Jorio, G. Dresselhaus, and M. S. Dresselhaus, *Carbon Nanotubes: Advanced Topics in the Synthesis, Structure, Properties and Application*, 1st ed. Springer, 2008.
- [19] J. A. Kuhlmann, "Development of Thermal Management Systems for High Energy Applications," Master's thesis, Naval Postgraduate School, Monterey, CA 2008.
- [20] The International Association for the Properties of Water and Steam, "Guidelines on the Use of Fundamental Physical Constants and Basic Constants of Water," 2001.
- [21] Web site: Nano-Lab Incorporated, Internet Home Page, <http://www.nano-lab.com/nanotubes-research-grade.html>, 2009.
- [22] Web site: Sigma-Aldrich, Internet Home Page, <http://www.sigmaaldrich.com/sigma-aldrich/home.html>, 2009.
- [23] American Society of Testing and Materials International, "Standard Test Methods for Electrical Conductivity and Resistivity of Water," ASTM International, Tech. Rep. D1125-95, 2009.
- [24] T. S. Light, S. Licht, A. C. Bevilacqua, and K. R. Morashc, "The Fundamental Conductivity and Resistivity of Water," *Electrochemical and Solid-State Letters*, vol. 8, p. E16, 2005.

## BIBLIOGRAPHY

- Nano-lab Incorporated Home Page. 2009 [cited 11/14 2009]. Available from <http://www.nano-lab.com/nanotubes-research-grade.html>.
- Sigma-aldrich Home Page. 2009 [cited 08/15 2009]. Available from <http://www.sigmaaldrich.com/sigma-aldrich/home.html>.
- SWCNT & MWCNT. [cited 11/12 2009]. Available from [http://images.google.com/imgres?imgurl=http://www.antnanousa.cn/dev/samples/images/thumb/mwnt.gif&imgrefurl=http://www.antnanousa.cn/dev/samples/nanotubes.asp&usq=\\_\\_wC77ILUkrHc5yMksEMHvvr419s=&h=147&w=160&sz=13&hl=en&start=10&um=1&itbs=1&tbnid=8mkhHKhqIrZYqM:&tbnh=90&tbnw=98&prev=/images%3Fq%3DMWNT%2Band%2BSWNT%2Bpicture%26hl%3Den%26sa%3DN%26um%3D1](http://images.google.com/imgres?imgurl=http://www.antnanousa.cn/dev/samples/images/thumb/mwnt.gif&imgrefurl=http://www.antnanousa.cn/dev/samples/nanotubes.asp&usq=__wC77ILUkrHc5yMksEMHvvr419s=&h=147&w=160&sz=13&hl=en&start=10&um=1&itbs=1&tbnid=8mkhHKhqIrZYqM:&tbnh=90&tbnw=98&prev=/images%3Fq%3DMWNT%2Band%2BSWNT%2Bpicture%26hl%3Den%26sa%3DN%26um%3D1).
- American Society of Testing and Materials International. 2009. *Standard Test Methods for Electrical Conductivity and Resistivity of Water*. ASTM International, D1125-95.
- Assael, M. J., C. F. Chen, I. Metaxa, and W. A. Wakeham. 2004. Thermal conductivity of Suspensions of Carbon Nanotubes in Water. *International Journal of Thermophysics* 25, (4): 971.
- Bahrami, Majid, M. M. Yovanovich, and J. R. Culham. 2007. Assessment of Relevant Physical Phenomena Controlling Thermal Performance of Nanofluids. *Journal of Thermophysics and Heat Transfer* 21, (4).
- Bigg, Donald M. 1979. Mechanical, Thermal and Electrical Properties of Metal Fiber-filled Polymer Composites. *Polymer Engineering and Science* 19, (16).
- Choi, S. U. S. 1999. *Nanofluid technology: Current Status and Future Research*. Argonne, Illinois: Argonne National Laboratory, 97466.
- Choi, S. U. S. and J. A. Eastman. 1995. *Enhancing Thermal Conductivity of Fluids with Nanoparticles*. Illinois: Argonne National Laboratory, ANL/ET/CP—88239; CONF-951135—29.
- Choi, S. U. S., Z. G. Zhang, W. Yu, F. E. Lockwood, and E. A. Grulke. 2001. Anomalous Thermal Conductivity Enhancement in Nanotube Suspensions. *Applied Physics Letters* 79, (14): 2252.
- Dresselhaus, M. S. and G. Dresselhaus. 2001. *Carbon Nanotubes: Properties, Synthesis, Structure and Applications*, ed. Ph Avouris. New York: Springer.

- Eastman, J. A., S. R. Phillpot, S. U. S. Choi, and P. Keblinski. 2004. Thermal Transport in Nanofluids. *Annual Review of Materials Science* (August): 219.
- Grace, Tom. 2003. *An Introduction to Carbon Nanotubes*.
- Hong, Haiping, Jesse Wensel, Feng Liang, W. E. Billups, and Walter Roy. 2006. Heat Transfer Nanofluids Based on Carbon Nanotubes. *American Institute of Aeronautics and Astronautics* (June).
- Hong, Haiping, Jesse Wensel, Shelley Peterson, and Walter Roy. 2007. Efficiently Lowering the Freezing Point in Heat Transfer Coolants Using Carbon Nanotubes. *Journal of Thermophysics and Heat Transfer* 21, (2).
- Iijima, S. 1991. Helical Microtubules of Graphitic Carbon. In *Nature*, 56–354.
- Jorio, A., G. Dresselhaus, and M. S. Dresselhaus. 2008. *Carbon Nanotubes: Advanced Topics in the Synthesis, Structure, Properties and Application*, eds. G. Dresselhaus, M. S. Dresselhaus. 1st ed. Springer.
- Joslin, S. 2009. Nanofluids. Luna Innovations, Danville, VA.
- Kim, Bong Hun, and G. P. Peterson. 2007. Effect of Morphology of Carbon Nanotubes on Thermal Conductivity Enhancement of Nanofluids. *Journal of Thermophysics and Heat Transfer* 21, (3).
- Kuhlmann, James A. 2008. Development of Thermal Management Systems for High Energy Applications. Master's thesis, Naval Postgraduate School, Monterey, CA.
- Lee, Shinpyo and S. U. S. Choi. 1996. Application of Metallic Nanoparticle Suspensions in Advanced Cooling Systems. Paper presented at International Mechanical Engineering Conference, Atlanta, GA.
- Li, Jie and Clement Kleinstreuer. 2008. Thermal Performance of Nanofluid Flow in Microchannels. *International Journal of Heat and Fluids Flow* (January): 1221.
- Light, T. S., S. Licht, A. C. Bevilacqua, and K. R. Morashc. 2005. The Fundamental Conductivity and Resistivity of Water. *Electrochemical and Solid-State Letters* 8, (1): E16.
- Liu, Zhen-Hua and Lin Lu. 2009. Thermal Performance of an Axially Microgrooved Heat Pipe Using Carbon Nanotube Suspensions. *Journal of Thermophysics and Heat Transfer* 23, (1).
- Marquis, F. D. S. and L. P. F. Chilbante. 2005. Improving the Heat Transfer of Nanofluids and Nanolubricants with Carbon Nanotubes. *JOM* (December): 32.

- Maxwell, J. C. 1904. *Electricity and Magnetism, part 2*. 3rd ed. United Kingdom: Clarendon Press.
- Penn Engineering. Carbon Nanotube. [cited 11/06 2009]. Available from <http://www.seas.upenn.edu/mse/images/nanotube1.jpg>.
- Rahman, Muhammad M. and Shantanu S. Shevade. 2003. Microchannel Thermal Management During Volumetric Heating or Cooling. *American Institute of Aeronautics and Astronautics* (August).
- Swartz, E. T. and R. O. Pohl. 1989. Thermal Boundary Resistance. *Review of Modern Physics* 61, (3).
- The International Association for the Properties of Water and Steam. 2001. *Guideline on the Use of Fundamental Physical Constants and Basic Constants of Water*. International Association for the Properties of Water and Steam.
- Wang, Xiang-Qi and Arun S. Mujumdar. 2008. A Review on Nanofluids - Part II: Experiments and Applications. *Brazilian Journal of Chemical Engineering* 25, (4): 631.
- Wen, Dongsheng and Yulong Ding. 2004. Effective Thermal Conductivity of Aqueous Suspensions of Carbon Nanotubes (Carbon Nanotube Nanofluids). *Journal of Thermophysics and Heat Transfer* 18, (4).
- Xie, H., H. Lee, W. Youn, and M. Choi. 2003. Nanofluids Containing Multilayered Carbon Nanotubes and Their Enhanced Thermal Conductivities. *Journal of Applied Physics* 94, (8): 4967.
- Young, Stuart H. 1996. An Optimization Technique Using the Finite Element Method and Orthogonal Arrays. M.S. in Mechanical Engineering., Naval Postgraduate School, Monterey, CA, [http://edocs.nps.edu/npspubs/scholarly/theses/1996/Sep/96Sep\\_Young.pdf](http://edocs.nps.edu/npspubs/scholarly/theses/1996/Sep/96Sep_Young.pdf)

THIS PAGE INTENTIONALLY LEFT BLANK

## INITIAL DISTRIBUTION LIST

1. Defense Technical Information Center  
Ft. Belvoir, Virginia
2. Dudley Knox Library  
Naval Postgraduate School  
Monterey, California
3. Young W. Kwon, Professor  
Naval Postgraduate School  
Dept. of Mechanical & Astronautical Engineering  
Monterey, California
4. Randall Pollak, Major USAF  
Asst Professor, Space Systems Academic Group  
Naval Postgraduate School  
Dept. of Mechanical & Astronautical Engineering  
Monterey, California
5. Brian Ryglowski, LT USN  
Naval Postgraduate School  
Monterey, California