



AFRL-RX-TY-TP-2010-0048

ADVANCED INTEGRATED POWER SYSTEM – PROGRAMMATIC REVIEW (BRIEFING SLIDES)

Marcus D. Smith

Air Force Research Laboratory
139 Barnes Drive, Suite 2
Tyndall Air Force Base, FL 32403-5323

Contract No. FA4819-09-C-0031

MAY 2010

DISTRIBUTION A: Approved for public release; distribution unlimited.

AIR FORCE RESEARCH LABORATORY MATERIALS AND MANUFACTURING DIRECTORATE

■ Air Force Materiel Command ■ United States Air Force ■ Tyndall Air Force Base, FL 32403-5323

REPORT DOCUMENTATION PAGE					Form Approved OMB No. 0704-0188	
The public reporting burden for this collection of information is estimated to average 1 hour per response, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. Send comments regarding this burden estimate or any other aspect of this collection of information, including suggestions for reducing the burden, to Department of Defense, Washington Headquarters Services, Directorate for Information Operations and Reports (0704-0188), 1215 Jefferson Davis Highway, Suite 1204, Arlington, VA 22202-4302. Respondents should be aware that notwithstanding any other provision of law, no person shall be subject to any penalty for failing to comply with a collection of information if it does not display a currently valid OMB control number. PLEASE DO NOT RETURN YOUR FORM TO THE ABOVE ADDRESS.						
1. REPORT DATE (DD-MM-YYYY) 12-MAY-2010		2. REPORT TYPE Presentation		3. DATES COVERED (From - To) 01-JAN-2009 -- 31-MAY-2010		
4. TITLE AND SUBTITLE Advanced Integrated Power System -- Programmatic Review (BRIEFING SLIDES)				5a. CONTRACT NUMBER FA4819-09-C-0031		
				5b. GRANT NUMBER		
				5c. PROGRAM ELEMENT NUMBER 63112F		
6. AUTHOR(S) Smith, Marcus D.				5d. PROJECT NUMBER 4918		
				5e. TASK NUMBER D2		
				5f. WORK UNIT NUMBER Q110D8B3		
7. PERFORMING ORGANIZATION NAME(S) AND ADDRESS(ES) Air Force Research Laboratory Materials and Manufacturing Directorate Airbase Technologies Division 139 Barnes Drive, Suite 2				8. PERFORMING ORGANIZATION REPORT NUMBER		
9. SPONSORING/MONITORING AGENCY NAME(S) AND ADDRESS(ES) Air Force Research Laboratory Materials and Manufacturing Directorate Airbase Technologies Division 139 Barnes Drive, Suite 2 Tyndall Air Force Base, FL 32403-5323				10. SPONSOR/MONITOR'S ACRONYM(S) AFRL/RXQD		
				11. SPONSOR/MONITOR'S REPORT NUMBER(S) AFRL-RX-TY-TP-2010-0048		
12. DISTRIBUTION/AVAILABILITY STATEMENT Distribution Statement A: Approved for public release; distribution unlimited.						
13. SUPPLEMENTARY NOTES Ref AFRL/RXQ Public Affairs Case # 10-094. Document contains color images.						
14. ABSTRACT AFRL's deployed base smart grid project named AIPS (Advanced Integrated Power System) is a smart grid test bed where proposed modifications to the existing deployed base power grid infrastructure are tested and evaluated. Adding intelligent control systems in addition to alternative and renewable power sources distributed throughout the grid requires careful testing. AIPS is fully instrumented to evaluate the impact these technologies will have on the deployed base power grid. Modifications to the traditional grid infrastructure are also evaluated since these modifications are necessary to implement important smart grid capabilities such as automated integration of renewable and alternative energy sources, priority power routing, on demand load shedding, power quality compensation, advanced energy storage systems, seamless transition to backup supplies, peak load management, and grid master control shared by multiple dispersed controllers. These technologies increase grid reliability as well as making the deployed grid less vulnerable to attack.						
15. SUBJECT TERMS Smart grid, microgrid, intelligent grid management, renewable power source, distributed generation, deployed base power system, priority power routing						
16. SECURITY CLASSIFICATION OF:			17. LIMITATION OF ABSTRACT UU	18. NUMBER OF PAGES 27	19a. NAME OF RESPONSIBLE PERSON Reza Salavani	
a. REPORT U	b. ABSTRACT U	c. THIS PAGE U			19b. TELEPHONE NUMBER (Include area code)	


Reset



Advanced Integrated Power System (Microgrid Test Bed)

2010

Marcus Smith
Engineering Lead (Energy Group)
AFRL/RXQD
Air Force Research Laboratory

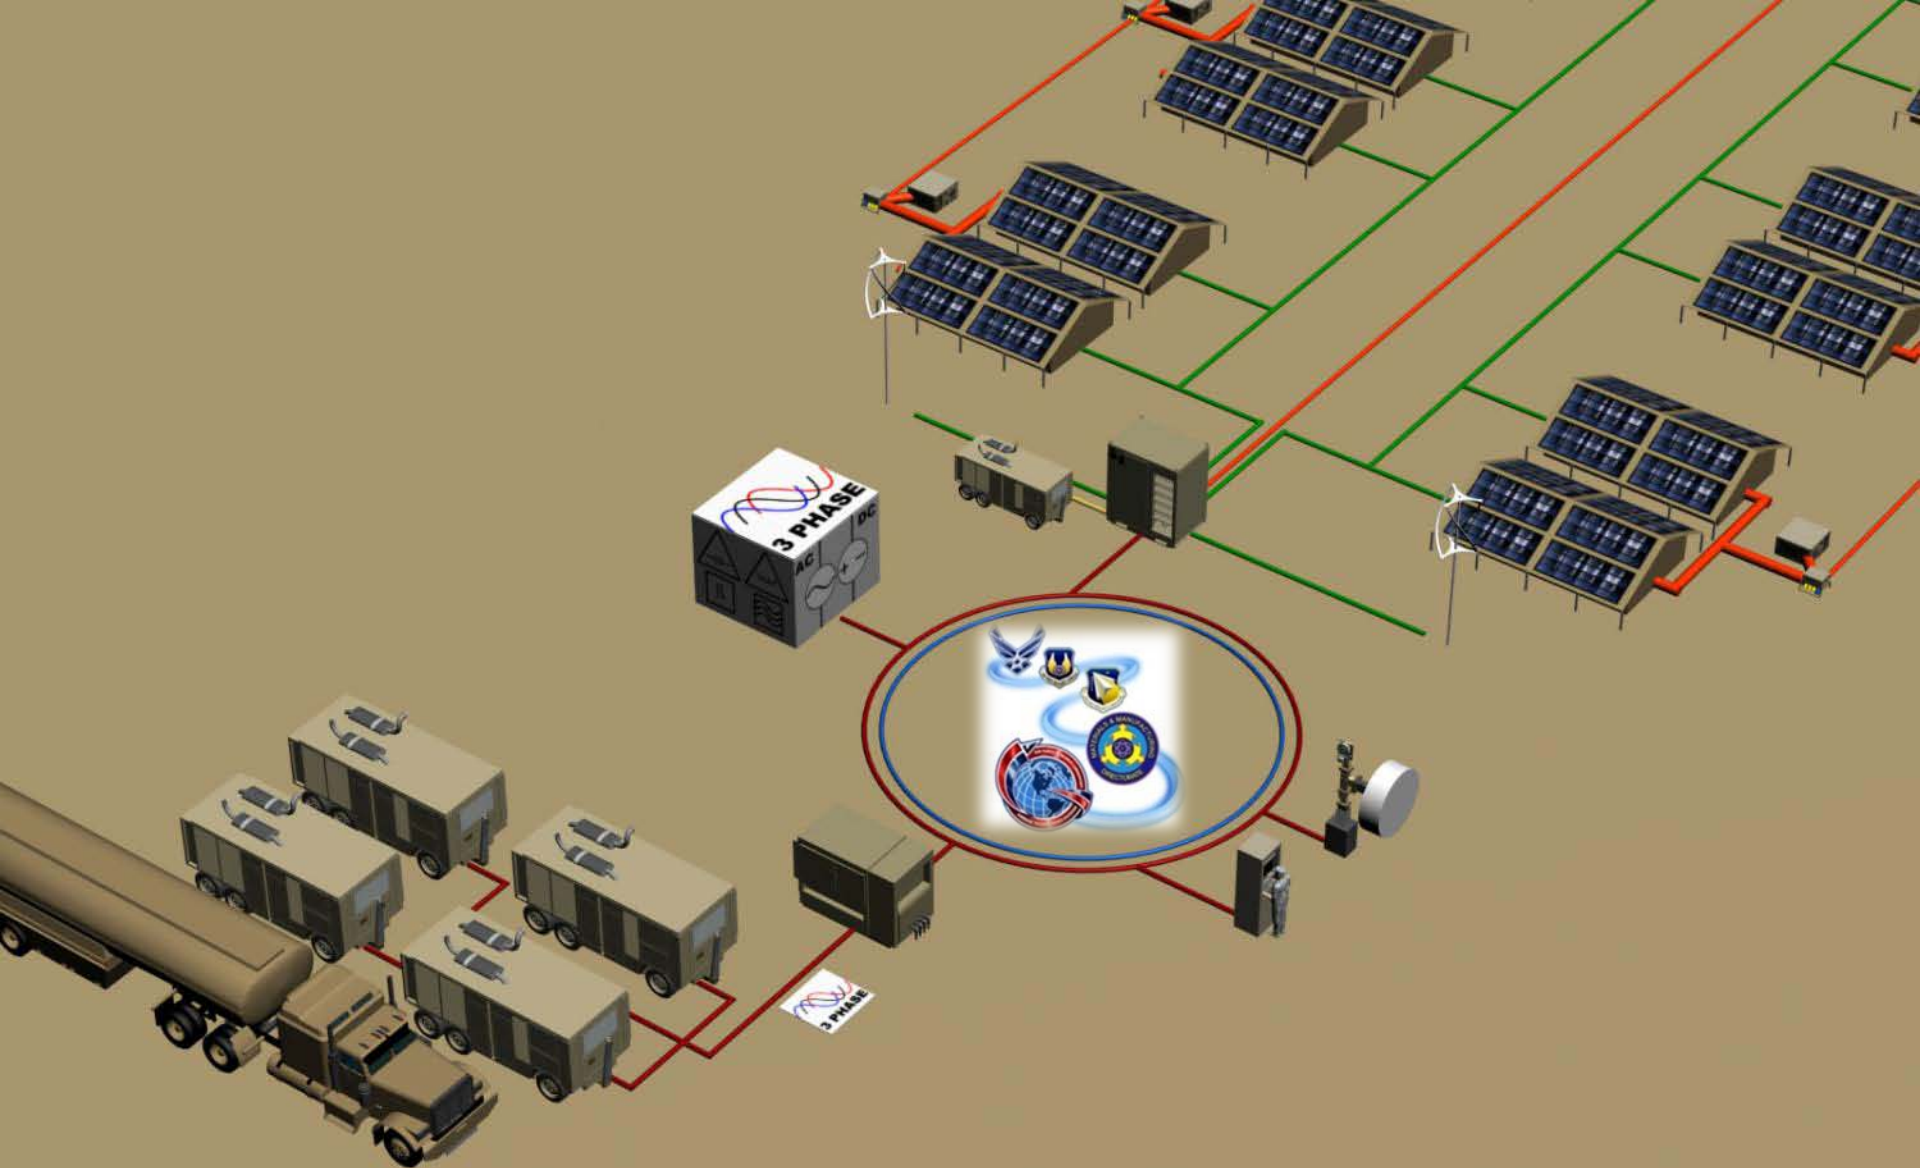

Advanced Integrated Power System (AIPS)




AIPS Programmatic Review



AIPS Goals and Strategy



Capabilities to be Evaluated AIPS Test Bed



System Modeling




Phase 1 AIPS Components



Partnerships and Collaborations




AIPS Testing Strategy

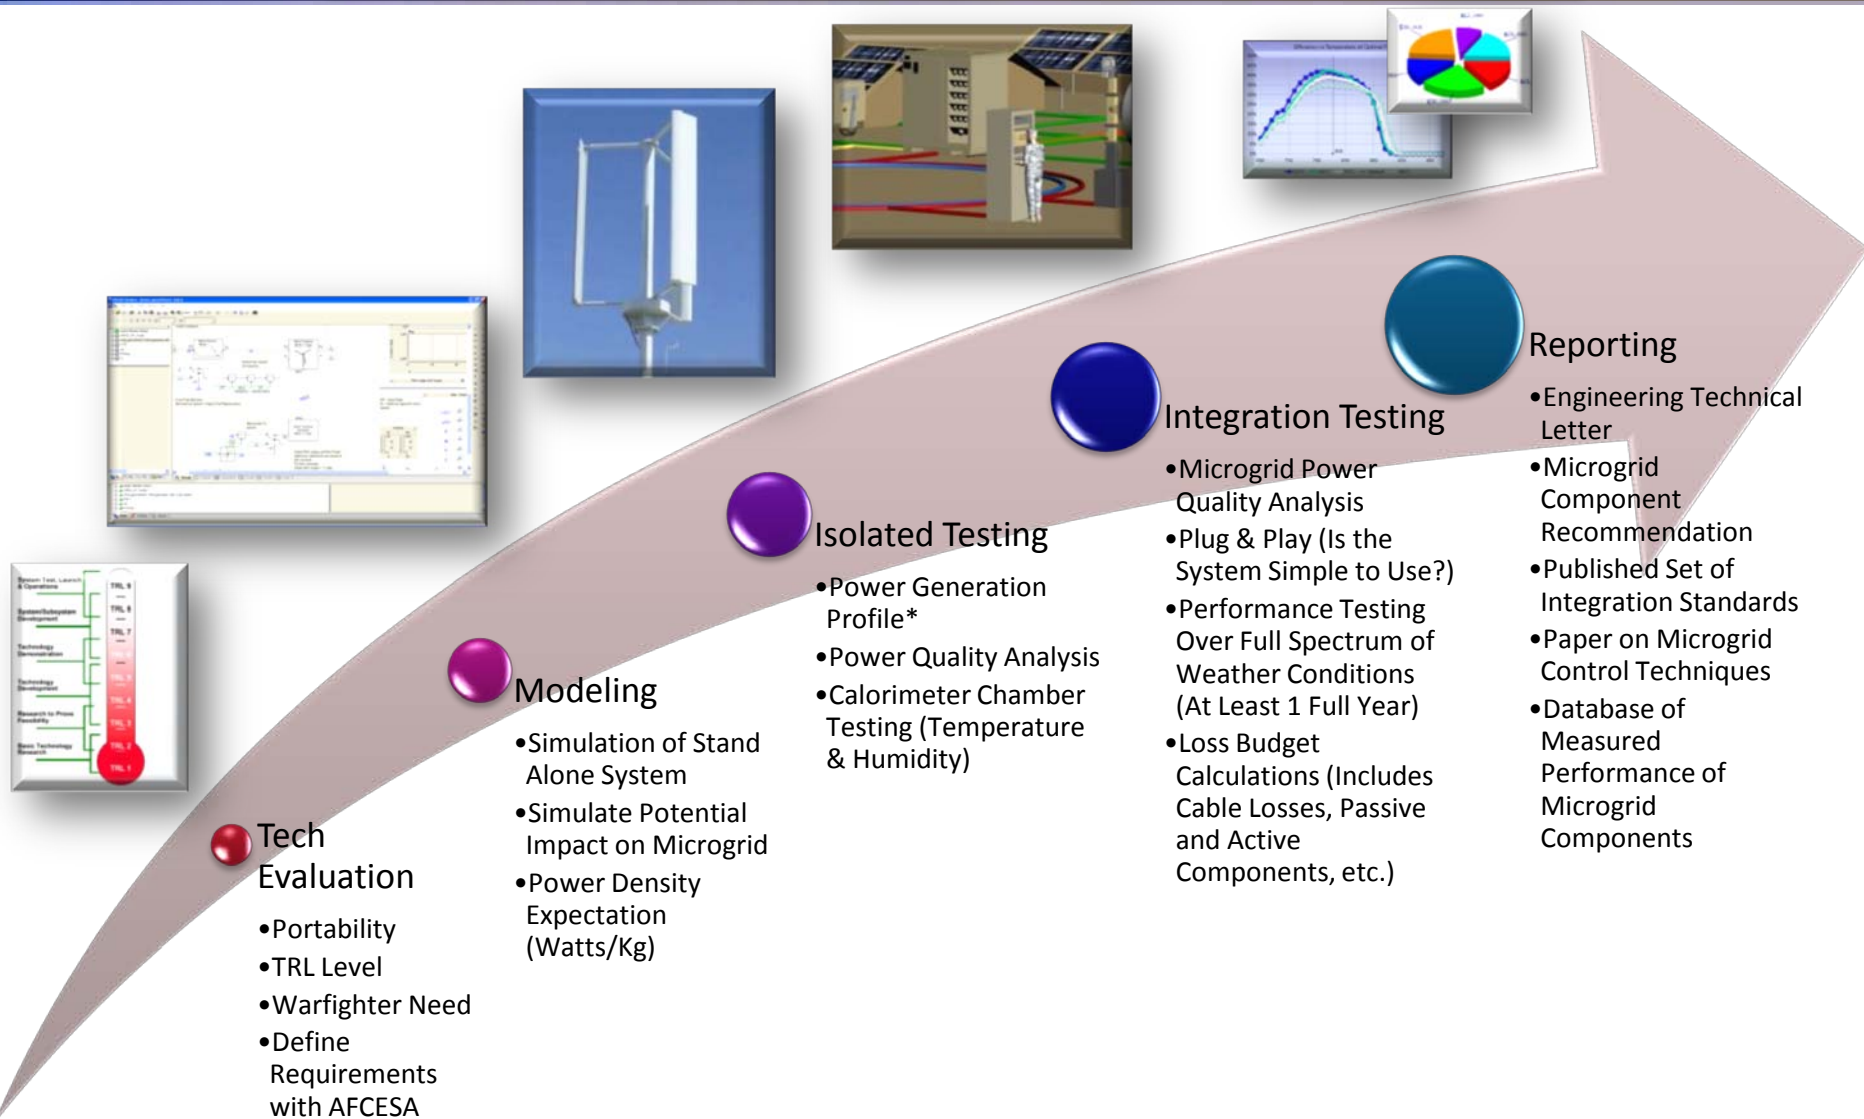

* Power Source
Computer hardware



AIPS System Goals

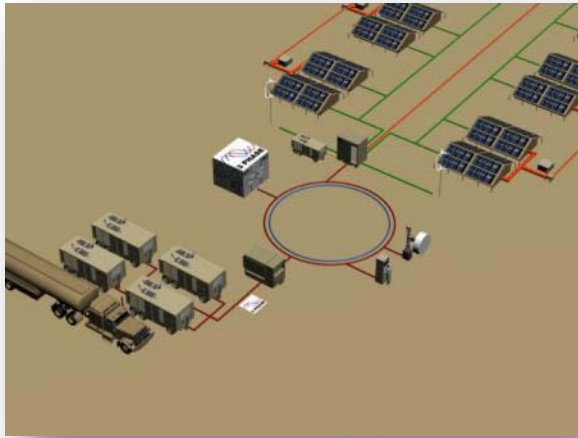

- Create a fully instrumented microgrid test bed where new energy technologies and control methods will be demonstrated and evaluated before deployment.



- Development of a set of Integration Standards that describes the method for Integrating, conditioning, and controlling renewable & alternative power sources in a deployed air base microgrid.



- Build and program microprocessor based field controllers to automate power routing, load shedding, power conditioning, etc.




Current Power System



- Power plant consists of a MEP 12 (750 kW) generator farm. These units are Placed away from the main camp due to noise and fumes.



- Each Generator Consumes 55 Gal/hr of JP8. Fuel is placed next to the generators in large fuel bladders. This makes the primary power source vulnerable.

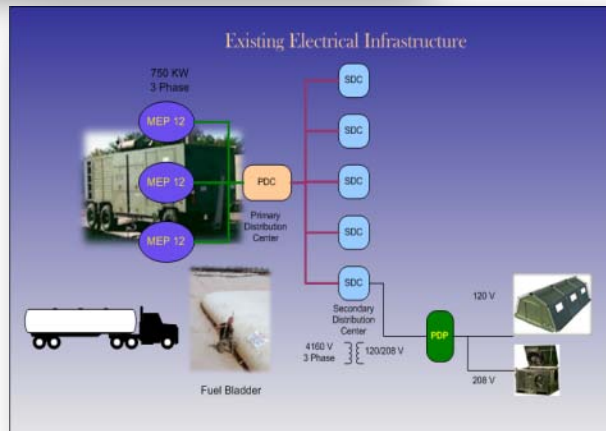

- Power branches out from the generator farm in one direction.



Smart Grid Power Routing & Self Healing



- Survivability & redundancy for assured power is accomplished by using Inter-connected smart controllers to route remaining power resources around damaged portions of the grid.



- Backup supplies are brought online and energy storage reserves are made available to insure power is available to critical loads.




- Distributed power sources throughout the grid minimize the potential for all of the base's power generation capability being destroyed in a single attack.



Triage Load Shedding

- ECUs (Environmental Conditioning Unit) consume ~70 % of available base power.
- These units could be temporarily disconnected from the microgrid using smart controllers and addressable breakers to increase available power to priority loads such as flight ops, perimeter security, etc.

ECU

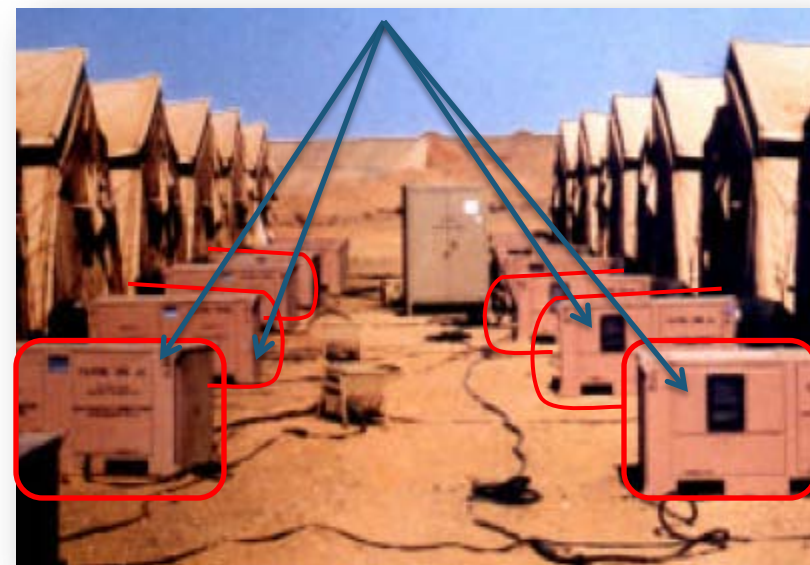

Flightline






Communication Over Power Lines

- Communication between grid elements is vital since automated decisions are based on available resources .
- Microgrid components communicate their status and capability to the microgrid controller.
- The microgrid controller transmits control signals and collects sensor data utilizing the power cables already in place.
 - This approach reduces infrastructure and eliminates potential signal conflicts presented by current wireless communication solutions.
 - Power companies use this type of technology to read power meters remotely. Adapting this technology to our need is a key research area for AIPS.



energy through empty space, stored in the propagating electric and magnetic fields.
<http://www.themodernapprentice.com/electroduction.htm>

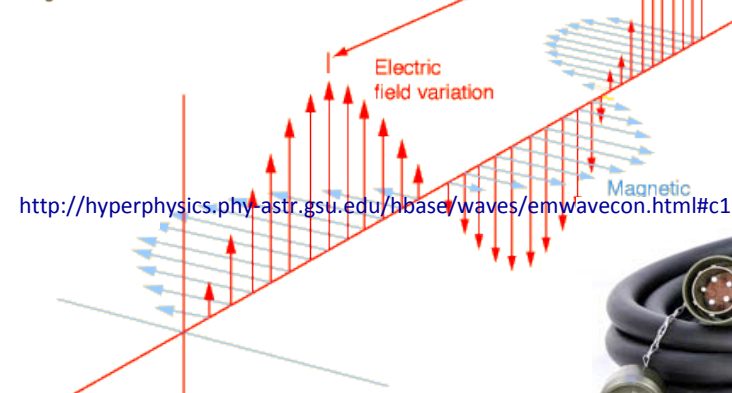




Power Quality Improve System Efficiency



- Poor power quality can damage sensitive equipment, shorten the life of some systems, produce waste heat, and reduce the efficiency of the overall grid requiring more power production.
- DC power producers such as solar PV material must be inverted to AC in order to use the power elsewhere in the microgrid.
- This requires phase and voltage matching to prevent poor power quality.
- Noise filtering and other power quality correction approaches will be analyzed and the best solutions recommended to the CE community.

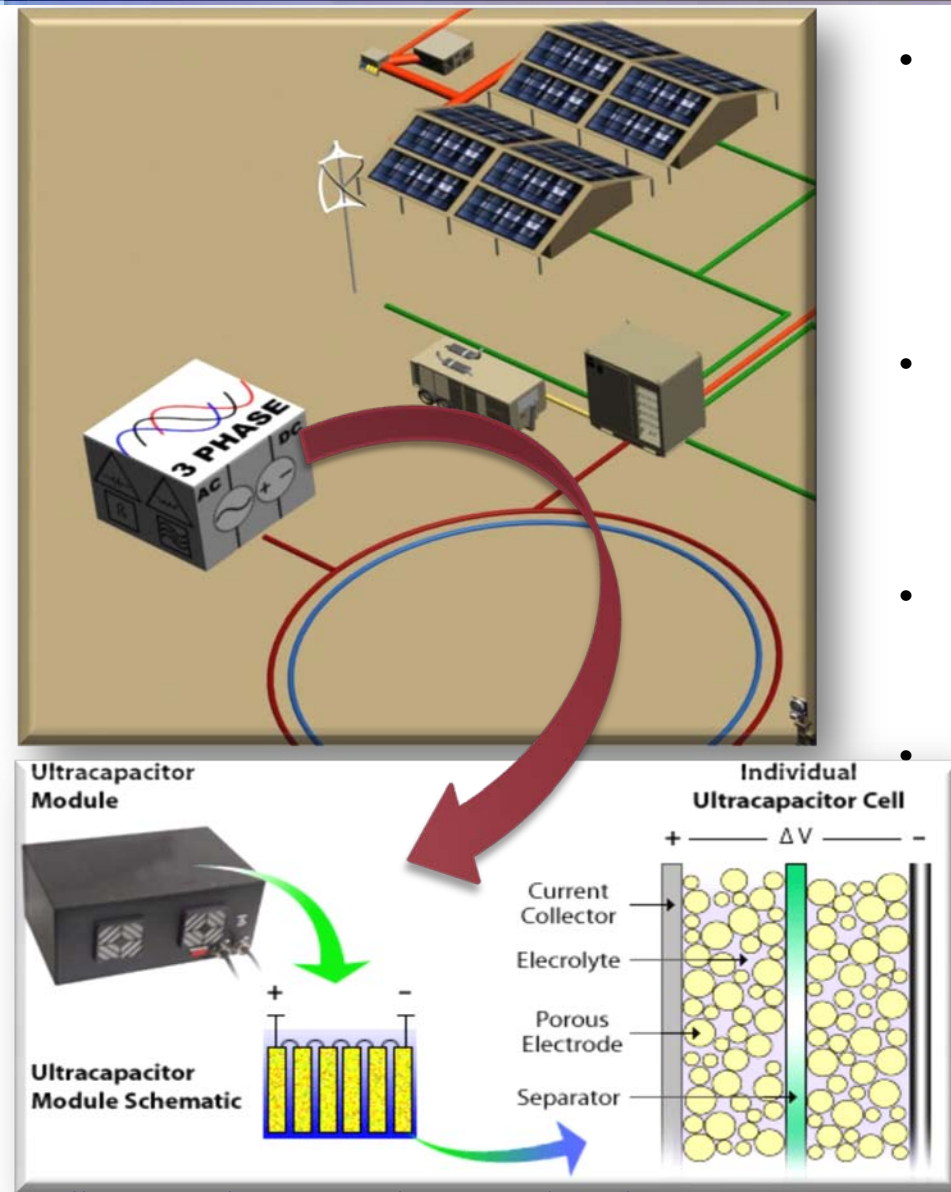




Energy Storage & Peak Load Management



- Renewable power sources such as solar and wind produce electricity sporadically throughout the day and night.
- High density energy storage devices are necessary to provide predictable power when it is needed.
- Peak power requirements such as large load starts that would normally require the use of additional generators can be met using the power stored by renewable power sources.

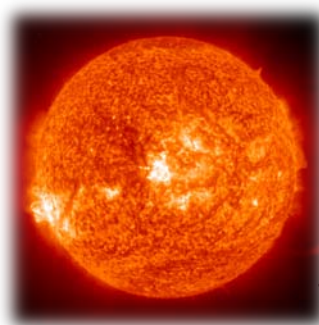


<http://science.nasa.gov/science-news/science-at-nasa/2003/28junstorm/>

Energy Storage Cycle



http://www.nasa.gov/worldbook/moon_worldbook.html

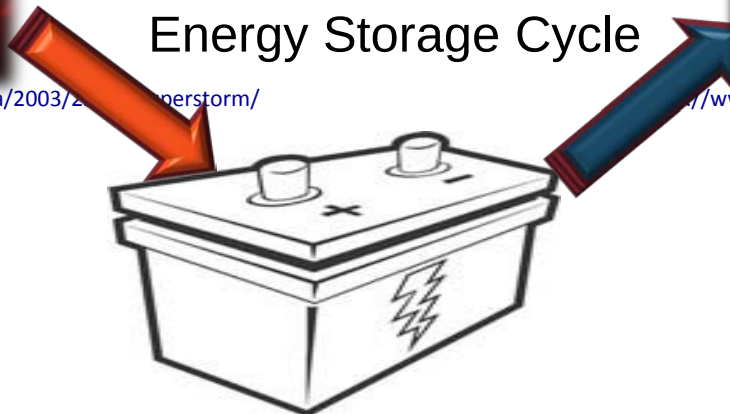


<http://www.fotosearch.com/photos-images/battery.html>




Smart Control Functions Reduce Power Requirements



- Large devices such as ECUs (Environmental Control Units), welding equipment, 3 phase motors, etc. use up to 3 times the normal operating power at start up (Due to Large Inrush Currents).
- **Staggering** large load **start times** will reduce the peak power requirement which reduces the number of generators needed.



ECU #1



ECU #2






System at a Glance Control & Health Monitoring




- The smart grid user interface enables the base power management team to instantly determine the health of the microgrid and make instantaneous changes.
- Changes to the management and distribution of the microgrid are implemented by a simple touch of the screen.

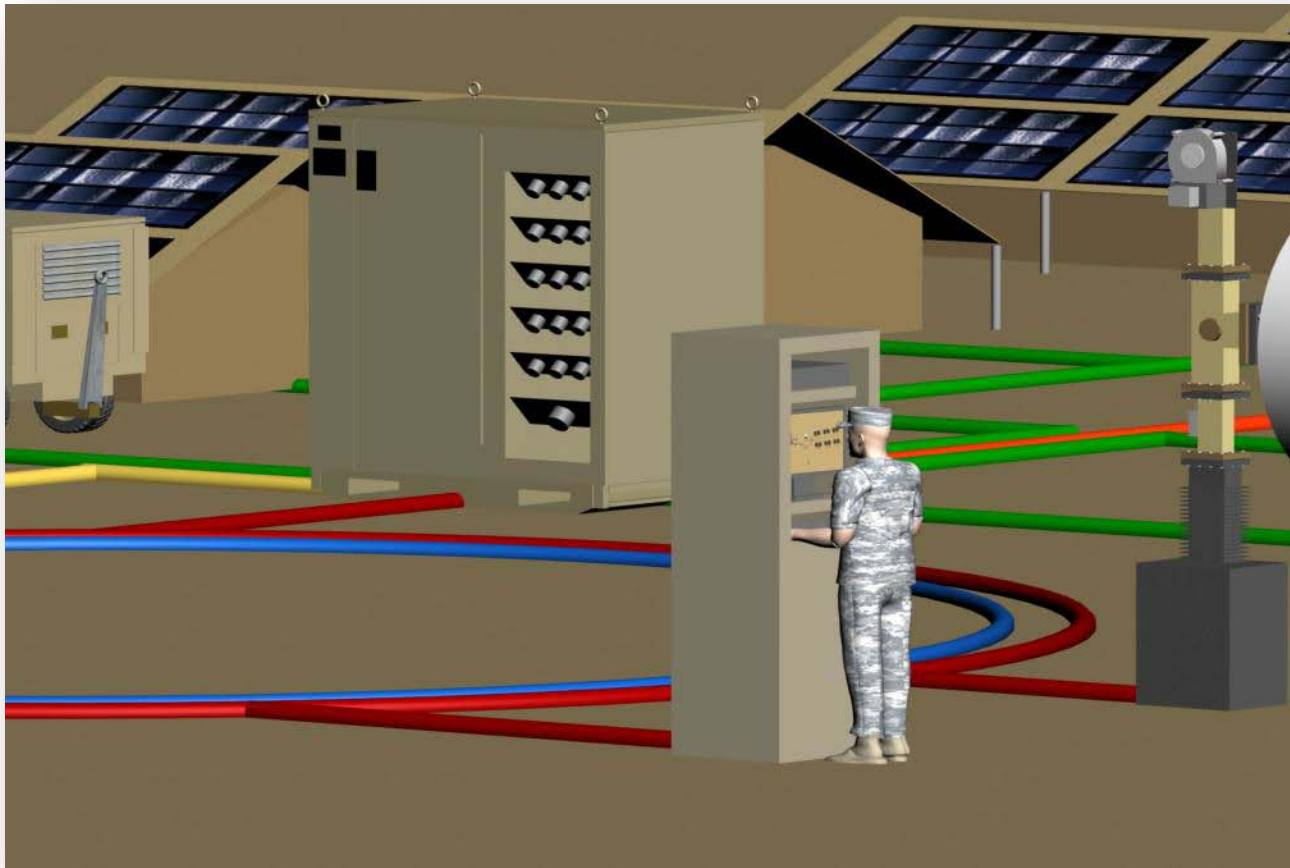



System Modeling Streamlines Grid Compatibility Testing

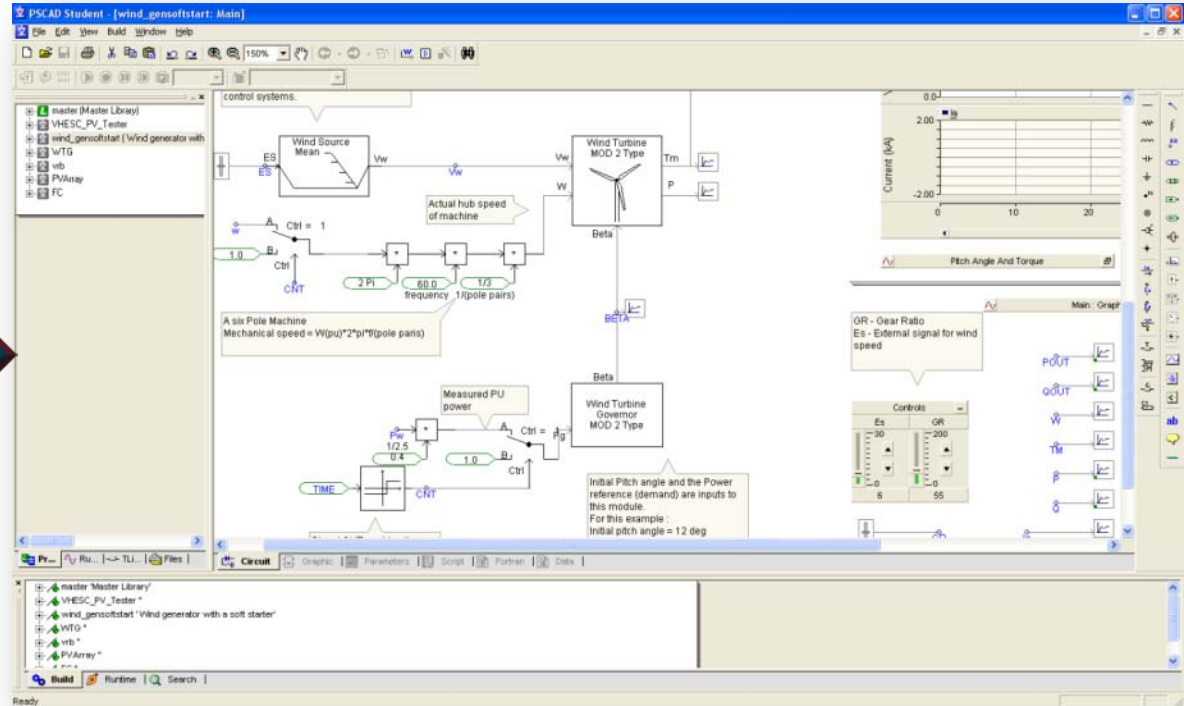

<http://www-personal.umich.edu/~dopila/research.html>

- Microgrid system component software models will be compatible with PSCAD (Power Systems Computer Assisted Drafting). This requirement will enable the components to be modeled as a part of the whole microgrid which should indicate any potential grid compatibility issues.
- The microgrid system model is a valuable research tool because design concepts can be virtually evaluated before the first piece of hardware is made. This model will also help in determining power quality correction measures that may need to be implemented.



Stand Alone & Integration Modeling

- Each system will be modeled 1st as a stand-alone system. This model will be refined later as physical stand-alone testing is conducted.
- Integration modeling will bring to light how the system should perform once it has been added to the microgrid. Loss budgets will be predicted as well as alternative wiring configurations tested.
- Once the system has been added to the microgrid at least 1 full year of data will be collected to evaluate how the system will operate over a variety of weather conditions.






AIPS 1st Phase



- Phase 1 of AIPS will center around the SDC (Secondary Distribution Center).
- Power will come from 4 sources: solar carport, vertical axis wind turbine, JP8 powered backup generator (MEP 805A), & PEM fuel cell. Some of these sources are on site already and others are in the final stages of construction.
- Addressable breakers and power relays will be used to route power, transition to the backup generator, and shed loads.
- The smart controller will manage all of these functions as well as collect data.

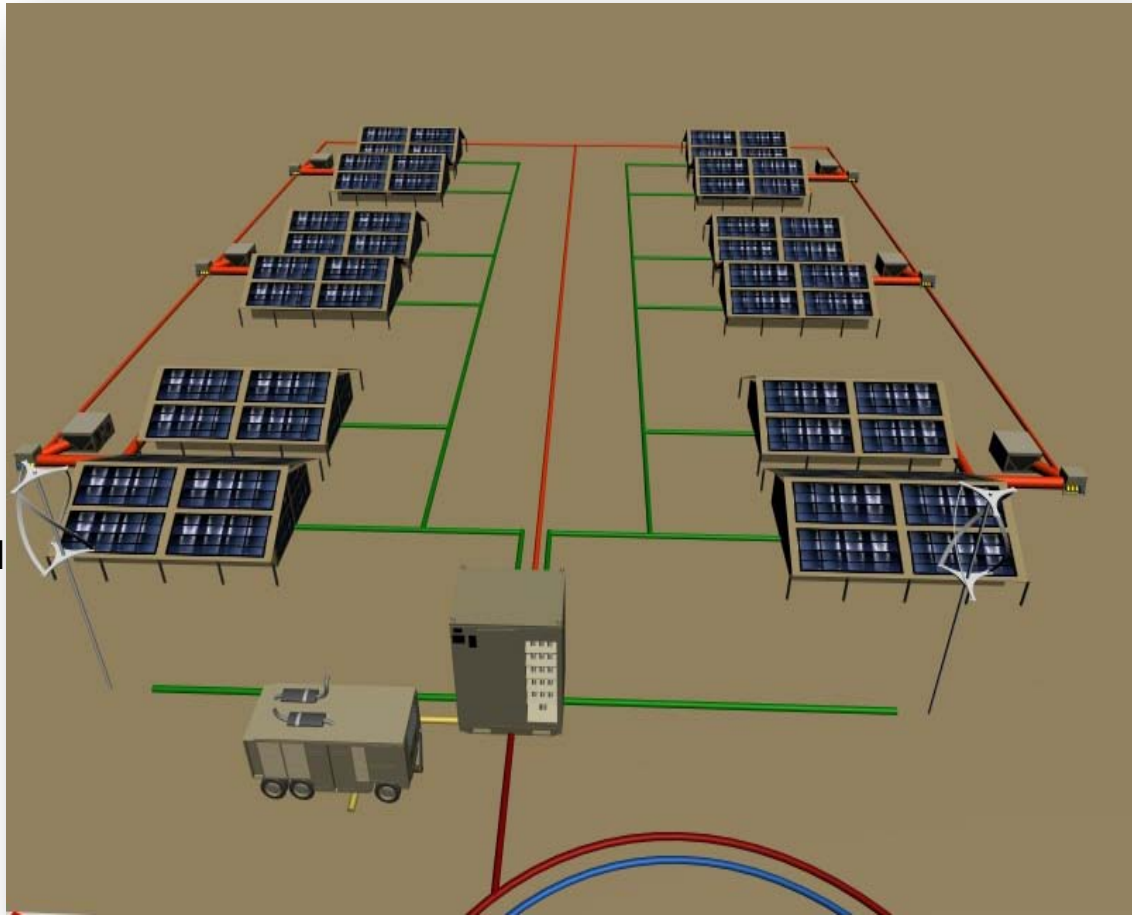



AIPS 1st Phase Data Acquisition & Control

- Smart field controllers will collect sensor data and send control signals.
- System modifications and status updates are available via a touch panel PC.



<http://www.ni.com/compactrio/>



<http://us.fluke.com>



- Power Quality Analyzers will assess the impact (Noise, Harmonics, Flicker, etc.) of microgrid components being evaluated.





AIPS 1st Phase Primary Power Source “Solar Carport”



- Solar carport puts out a maximum of 25 kW of power for use in the microgrid test bed.
- Additional power sources for Phase 1 include a PEM fuel cell, 30 kW JP8 generator (MEP 805A), & vertical axis micro wind turbine.



MEP 805A






AIPS 1st Phase Core Pieces



- AIPS will have at its core a revolutionary battery system for energy storage, PEM fuel cell, and other impressive hardware that is coming to AFRL as part of a joint program with APTO (Advanced Power Technology Office) and their contractors.

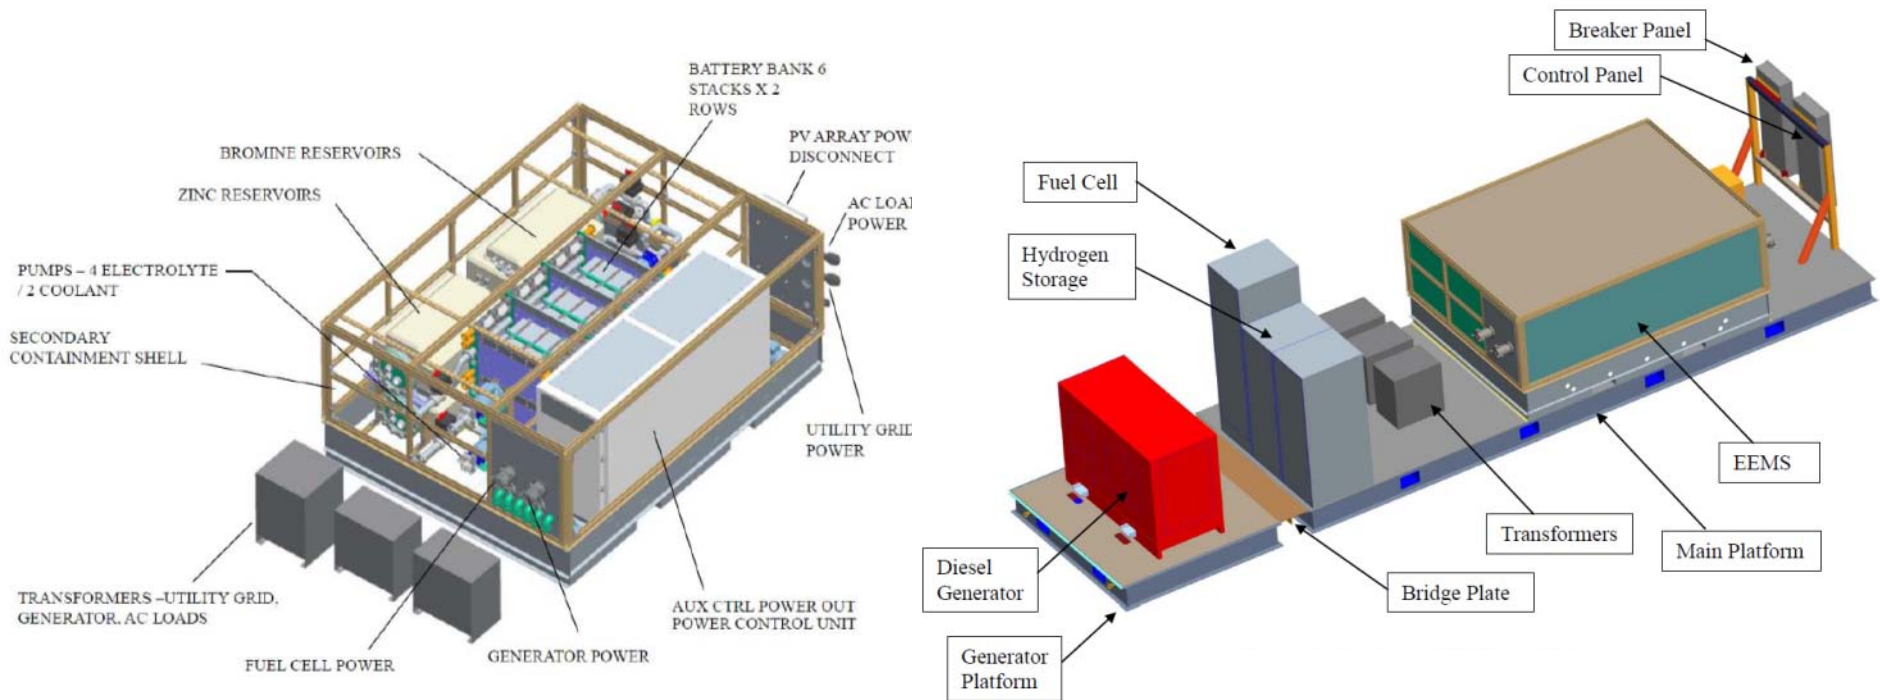


Tipton, Brian, and Loraine Bell. APTO Research, Development, Test, Evaluation and Sustainment Support Next Generation Microgrid with Solar Power and Fuel Cell Technologies. Rep. no. TO2-A013-6. Tyndall AFB: CTC, 2010. Print.



Microgrid Test Bed - DARPA

- DARPA's revolutionary new solar collection system titled VHESC (Very High Efficiency Solar Cell) will be tested in the Tyndall AFB microgrid test bed.

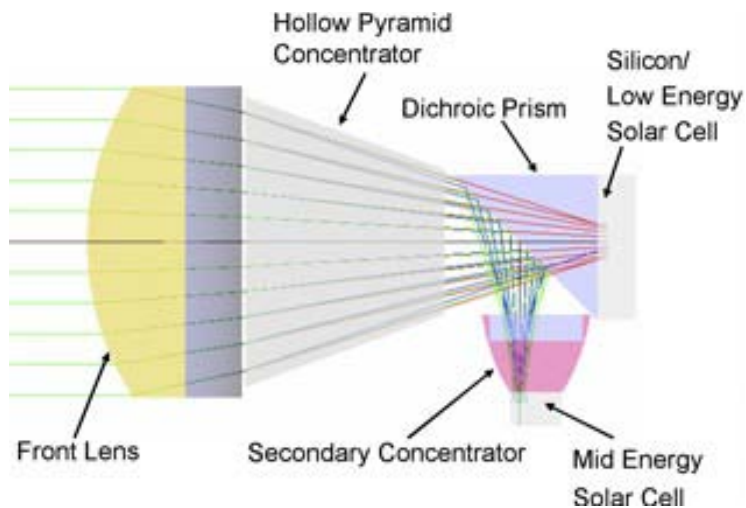

http://www.semiconductor-today.com/news_items/2009/SEPT/ENERGYFOCUS_280909.htm

DARPA VHESC Phase 3 Field Testing Setup



Microgrid Test Setup

VHESC Cell Concept



Microgrid Test Bed – AFRL/RXBC



- Revolutionary vertical axis wind turbine developed by the composites group (AFRL/RXBC) will be tested in the microgrid test bed.
- The blades will be stronger and lighter than the best available technologies.
- This system will be able to generate electricity at much lower wind speeds.




AFRL/RXBC & University of Dayton Aerospace Mechanics Division




Microgrid Test Bed – Missouri University of Science and Technology



- The software model for AIPS will include software models (PSCAD) created for other Air Force programs such as the microgrid project at Missouri University of Science and Technology.
- Work is continuing with models for both the modified wind turbine and revolutionary PEM fuel cell.

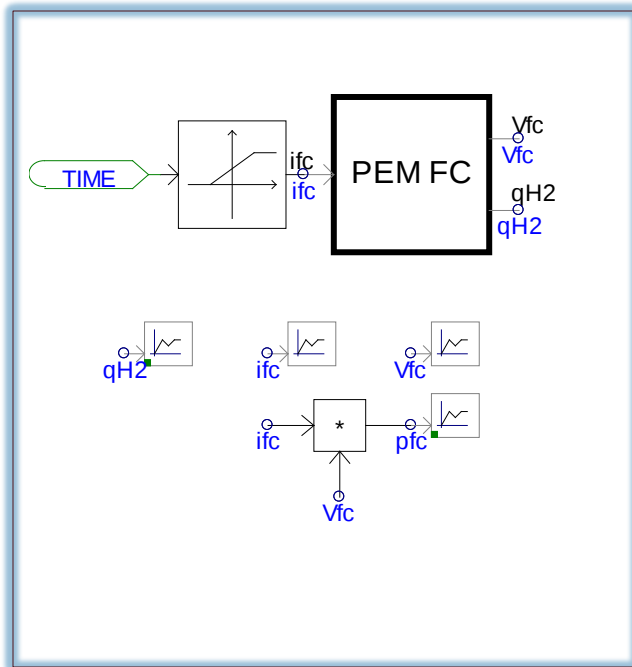

PEM Fuel Cell

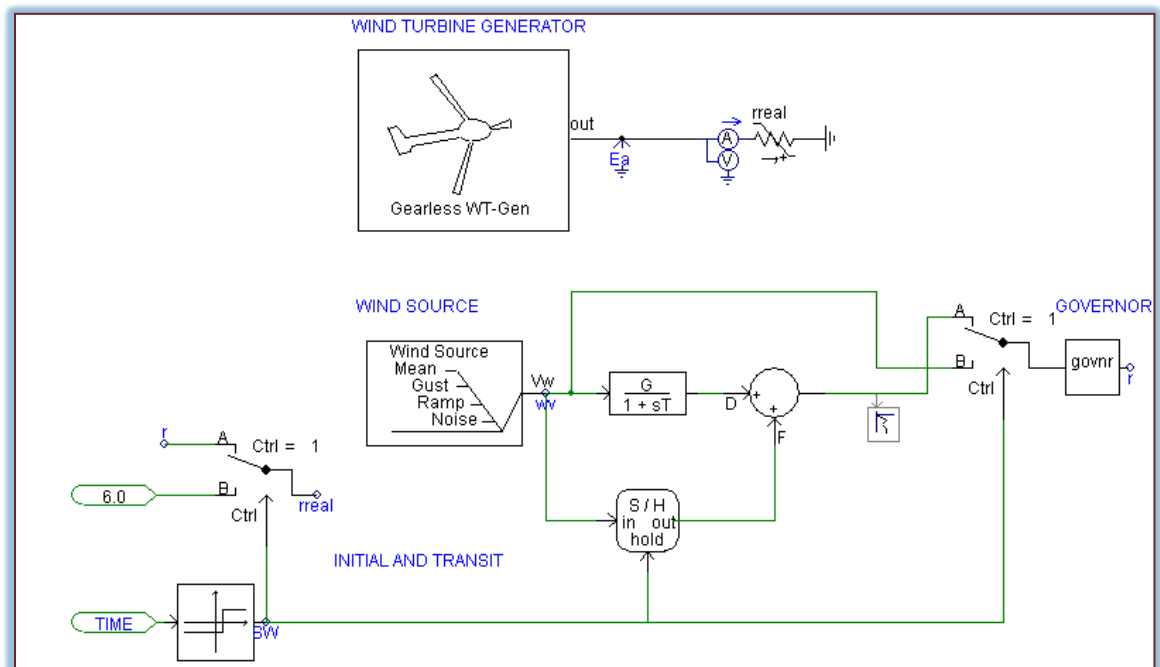

Wind Turbine



Microgrid Test Bed – Partnerships and Collaborations



Programs

- Missouri University of Science and Technology Microgrid Component Development
- Auburn University, AF Security Forces, & AFRL/RD & RH Laser to PV wireless Power Program
- APTO & CTC Microgrid Demonstration
- DARPA VHESC Field Testing
- AFRL/RXBC Composites Wind Turbine




AUBURN
UNIVERSITY





Phase 1 Timeline

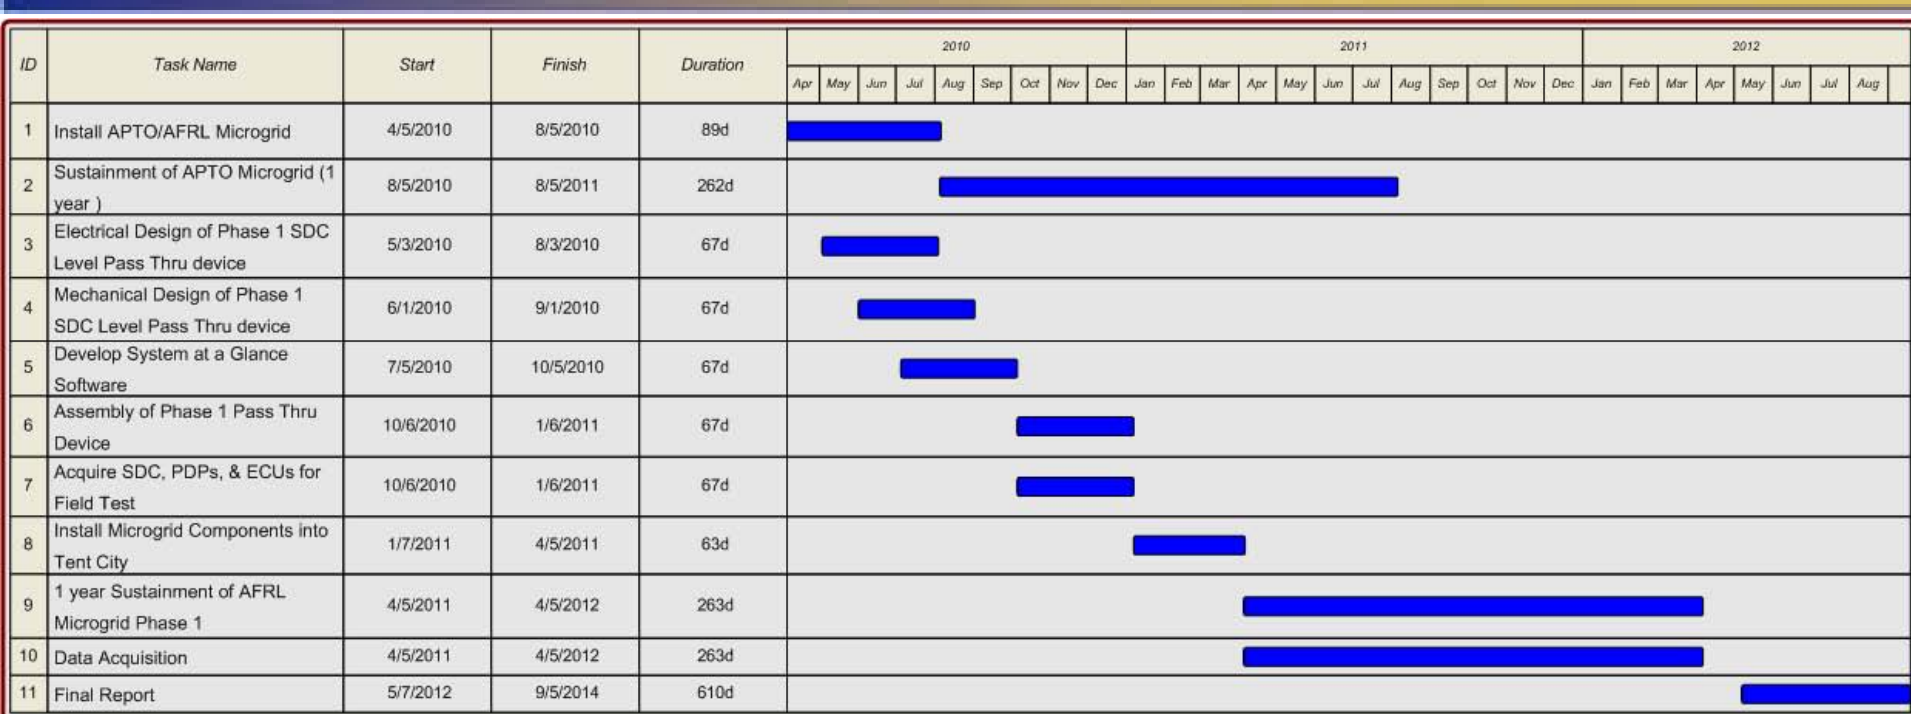

- This chart lays out the timeline to test the 1st phase of the deployed base microgrid.
- The test bed will be put in place 1st so that the 1st phase deployable system can be analyzed and formal recommendations proposed to the CE community.
- Collaboration efforts that will rely on the instrumented test bed will be worked into the schedule and will follow the testing strategy outlined in slide # 3 titled “AIPS Testing Strategy”.



Take Away Thoughts

1. The Advanced Integrated Power System (AIPS) is a fully instrumented research microgrid test bed where new technologies in the power generation and distribution areas will be evaluated.
2. The AIPS is where microgrid components, communication systems, control algorithms, etc. will be modeled, tested, integrated, and evaluated for at least 1 full year.
3. AIPS serves the needs of the warfighter by providing a conduit for smart grid technologies to find their way to the battlefield where reliability, portability, and simplicity are essential.